



ALL DIMS. ARE IN MM.

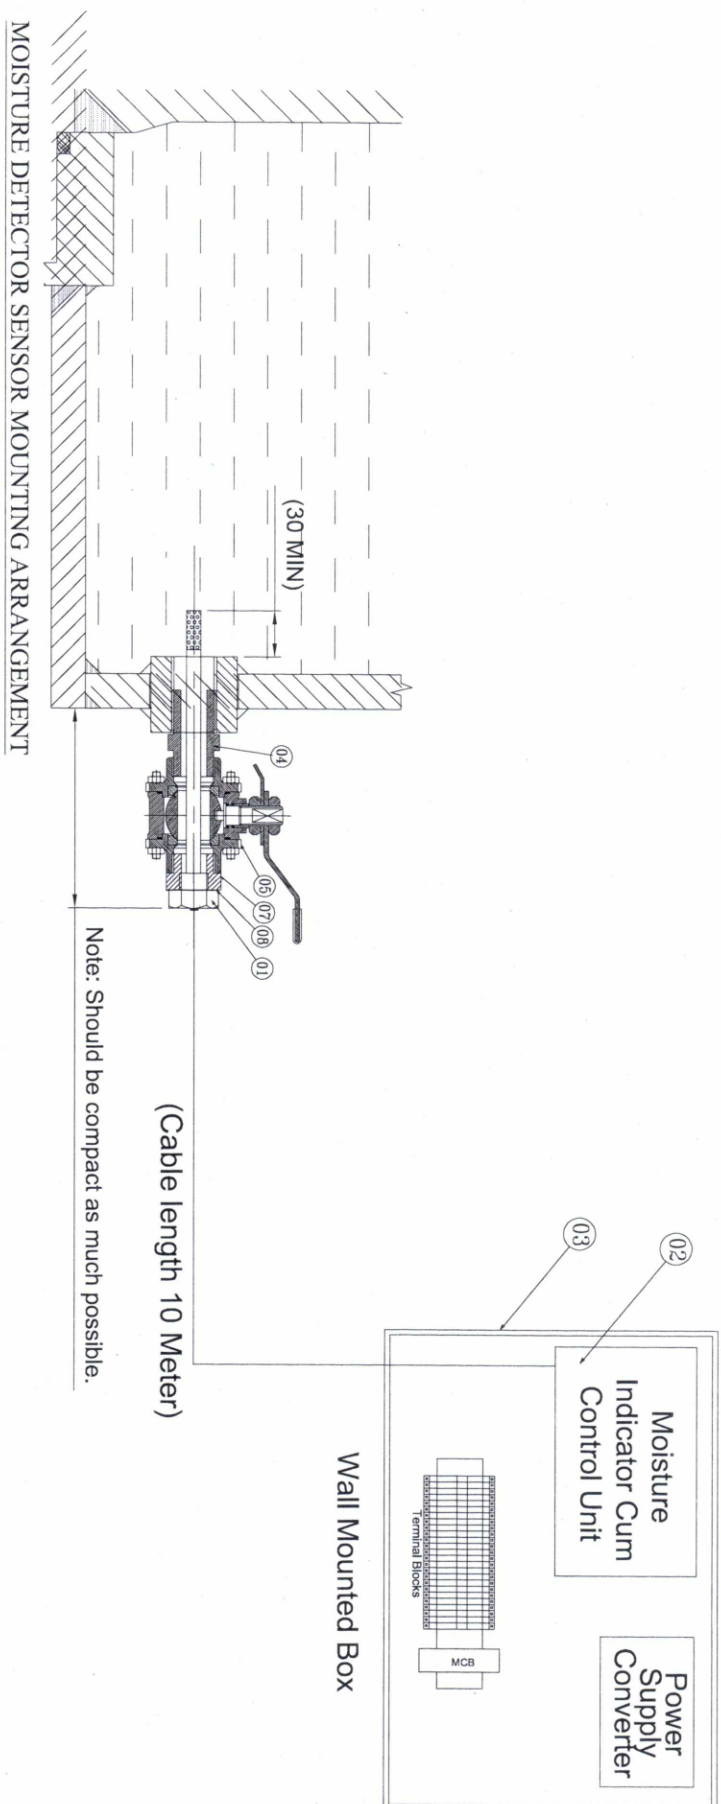

SECTIONAL VIEW OF MOISTURE DETECTOR SENSOR MOUNTING SUMP

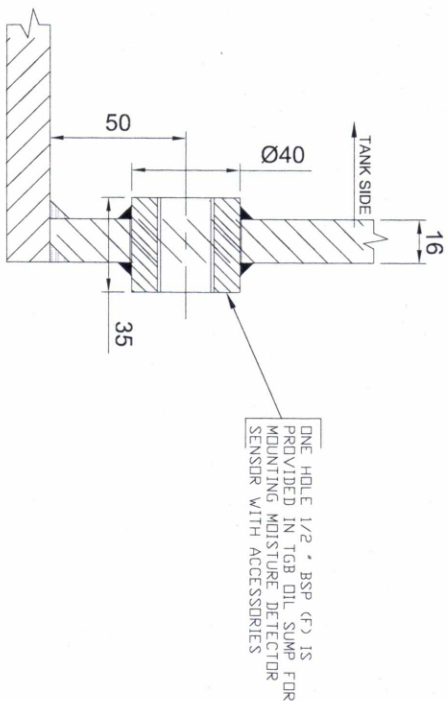

SCOPE OF SUPPLY:

- ONE SET OF MOISTURE DETECTOR CONSISTS OF ONE NO. EACH OF FOLLOWING ITEMS:-
01. SENSOR WITH 10 METER CABLE
 02. FINAL MOUNTING PROCESS CONNECTION : 1/2" BSP (M)
 03. MOISTURE INDICATOR CUM CONTROL UNIT
 04. WALL MOUNTED BOX WITH TERMINAL BLOCKS, MCB, POWER SUPPLY CONVERTER etc.
 05. ADAPTER TO SUIT BALL VALVE AND SUMP TANK CONNECTION (SS)
 06. BALL VALVE WITH SS BALL (1/2" BSP)
 07. TEFLON WASHER
 07. ADAPTER TO SUIT SENSOR AND BALL VALVE (SS) [If Required]

NOTE : Auxiliary power supply to the Moisture detector is 240 VAC. If Moisture Indicator cum control unit require supply other than 240 VAC, then, Power supply converter as shown in the drawing may please be provided.

ONLINE MOISTURE DETECTOR

PROJECT : PUNATSANGCHHU-II HEP
SKETCH NO. HPE-GC-404 Rev. 00.

Final