
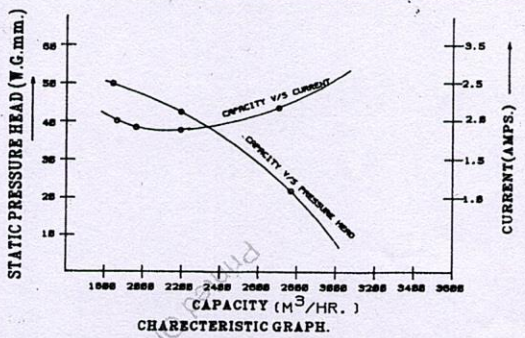



34730050033

INLET FLANGE 2601/0x320 0/0.6 HOLES  $\phi$  11.5 ON 295 PCO.  
FLAT 30x6 & COVERED WITH 2mmx2m. WIRE MESH.

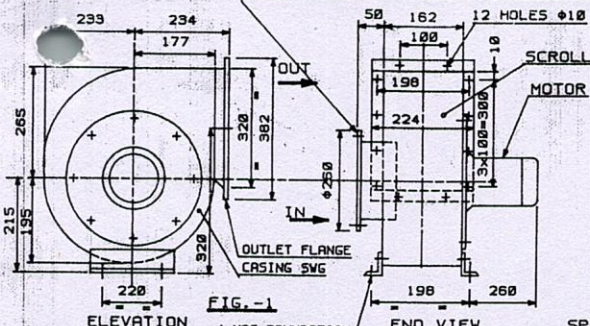

SPECIFICATION OF CENTRIFUGAL FAN FOR DRY TYPE TRANSFORMER

| FAN MOTOR                 | SPEED R.P.M. | STATIC PRESSURE HEAD W.G. mm | RATING                         | MOTOR INPUT KW | MOTOR RATED CURRENT | STARTING CURRENT RATIO | SOUND LEVEL VOL. AT MAX. | AIR DELIVERY M³/HR. | INSULATION CLASS | WEIGHT KG. | REMARK |
|---------------------------|--------------|------------------------------|--------------------------------|----------------|---------------------|------------------------|--------------------------|---------------------|------------------|------------|--------|
| BAJAJ/BHARAT 61JLI 4-POLE | 1415         | SEE-GRAPH                    | 415V $\pm$ 10% 3 $\phi$ . 50Hz | 1.5HP/ 1.1 KW  | 2.9 AMPS            | 3                      | 86 (d.b)                 | SEE-GRAPH           | B                | 19         |        |

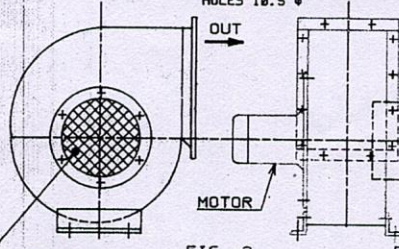

NO. 1  
FANS SHOULD BE SUPPLIED SET WISE CONSISTING OF 1 NO. AS FIG.-1 & 1 NO. AS FIG.-2.  
STYLE NO. ST-626630, FIG.-1(L.H.S.)  
ST-626639, FIG.-2(R.H.S.)

|                                                                                    |  |                                                           |  |
|------------------------------------------------------------------------------------|--|-----------------------------------------------------------|--|
| ADDITIONAL INFORMATION                                                             |  | TYPE OF PRODUCT<br>OR<br>NAME OF CUSTOMER/PROJECT         |  |
| STATUS OF DRAWING<br>STD.                                                          |  | DRY TYPE TRANSFORMER                                      |  |
| DISTRIBUTION OF PRINTS                                                             |  | BHARAT HEAVY ELECTRICALS LTD.<br>JHANSI                   |  |
| O/C PE IE BAY 1 & 2 BAY 7 BAY-3<br>1 1 1 3 2 2                                     |  | DR. DHARMENDRA NARAYAN<br>THE COMPUTER CENTRE<br>22.08.92 |  |
| REV. 01 DATE 06.03.92 ALTERED CHECKED                                              |  | CHK. RK LOHARYA<br>APPD. M. DUTTA                         |  |
| REV. 02 DATE 15.01.96 ALTERED CHECKED                                              |  | SIGN. SD.                                                 |  |
| REV. 03 DATE 03.04.96 ALTERED CHECKED                                              |  | DATE 22.08.92                                             |  |
| FAN MOTOR SPEED, INPUT & RATED CURRENT WERE 1400 RPM, 1.2 KW & 4/231 AMPS, RESPLY. |  | DRAWING IS REDRAWN FOR CHARACTERISTIC GRAPH ADDITION.     |  |
| PRESSURE HEAD & AIR DELIVERY WAS 48 W.G. & 3200 CM/HOUR RESPLY.                    |  | TITLE<br>CENTRIFUGAL FAN                                  |  |
|                                                                                    |  | ORG. NO.<br>34730050033                                   |  |
|                                                                                    |  | SHEET NO. NO. OF SHEET                                    |  |