

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.:	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 25.04.18
			SHEET 1	OF 4
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	
GENERAL *	* PROJECT	2 X 660 MW UDANGUDI TPP		
	OFFER REFERENCE			
	* TAG NO. SERVICE			
	* DUTY	☐ ON / OFF ☐ INCHING		
	* LINE SIZE (inlet/outlet): MATERIAL			
	* VALVE TYPE	☐ GLOBE ☐ GATE ☐ REG. GLOBE ☐ BUTTERFLY		
	* OPENING / CLOSING TIME			
	* WORKING PRESSURE			
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF -20 to 70 DEG C AND RELATIVE HUMIDITY OF 0-95% IN HOT HUMID AND TROPICAL ATMOSPHERE AND HIGHLY POLLUTED AT PLACES OF COAL DUST AND FLY DUST		
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY		
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY		
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY		
	CONSTRUCTION AND SIZING	CONSTRUCTION	TOTALLY ENCLOSED, WEATHER PROOF, DUST TIGHT SUITABLE FOR OUTDOOR USE WITHOUT CANOPY, NEMA6/IP:68	
MECHANICAL POSITION INDICATOR		TO BE PROVIDED FOR 0-100% TRAVEL		
BEARINGS		DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.		
GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION		METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.		
SIZING		OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 90% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING SERVICE - 150 STARTS/HR MINIMUM.		
HANDWHEEL	* REQUIRED	☒ YES ☐ NO		
	* ORIENTATION	☐ TOP MOUNTED ☐ SIDE MOUNTED		
	* TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.			
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY		
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY		
	@ MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT-INCLUSIVE OF I.S. TOLERANCE		
	ACTUATOR APPLICABLE WIRING DIAGRAM	☒ ENCLOSED (BIDDER TO CONFIRM) A: ☐ DRG. NO. 3-V-MISC-24227 R00 B: ☐ DRG. NO. 3-V-MISC-24550 R00 C: ☒ DRG. NO. 3-V-MISC-24283 R00 D: ☐ DRG. NO. 4-V-MISC-90271 R11 E: ☐ For Thyristor based Integral starter, Bidder/Vendor to furnish wiring diagram		
	COLOUR SHADE	☐ BLUE (RAL 5012) ☒ SIEMENS GRAY RAL 7030		
	PAINT TYPE (## Refer Notes)	☐ ENAMEL ☒ EPOXY ☐		
	SHAFT RPM	BIDDER TO SPECIFY		
	OLR SET VALUE	BIDDER TO SPECIFY		
	@ STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY		
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY		
	@ PWR SUPP TO MTR / STARTER	415V +/- 10%, 3 Phase, 3 Wire 50HZ +/- 5%		
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED FROM THE POWER SUPPLY TO THE STARTER ☐ 230 V ☒ 110 V		



SPECIFICATION FOR MOTORISED VALVE ACTUATOR

SPECIFICATION NO.:

VOLUME II B

SECTION D

REV. NO. 00

DATE: 25.04.18

SHEET 2

OF 4

Data Sheet A & B

DATA SHEET-A
(TO BE FILLED BY PURCHASER)

DATA SHEET-B
(TO BE FILLED-UP BY BIDDER)

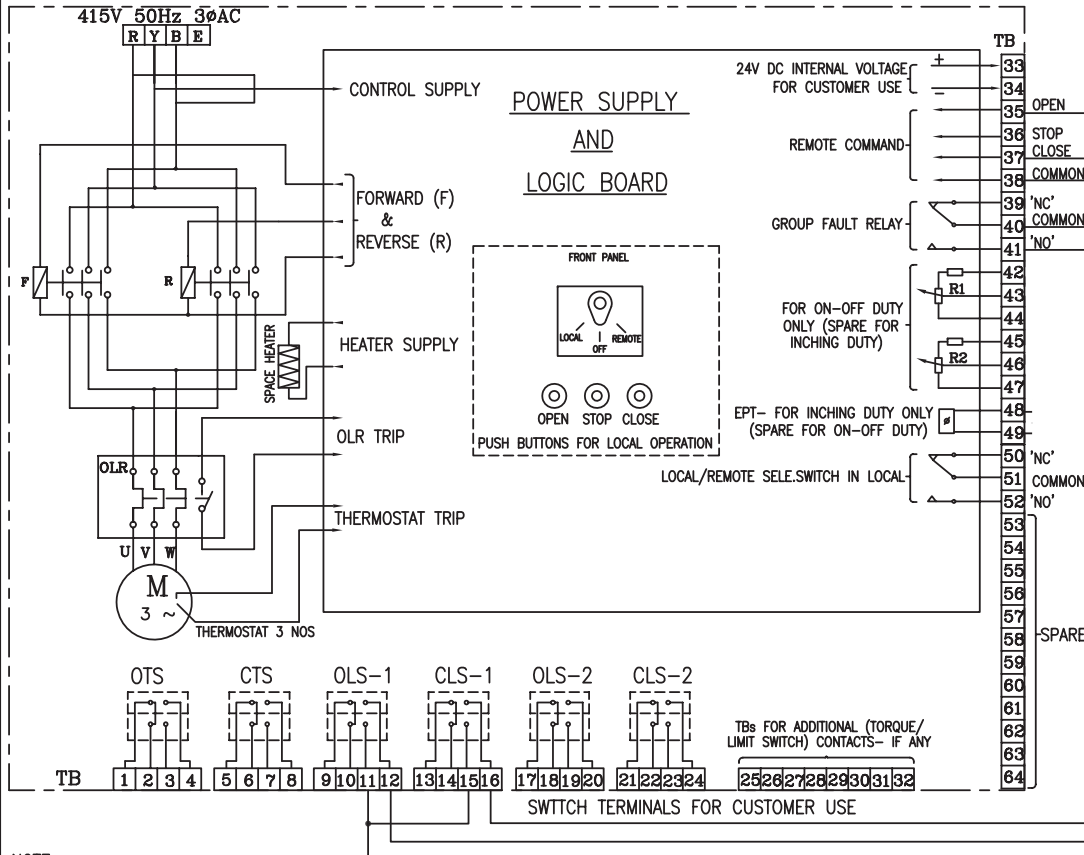
	@ ENCLOSURE CLASS OF MOTOR	☐ IP 68 ☐ FLAME PROOF			
	@ INSULATION CLASS	CLASS-F TEMP. RISE LIMITED TO CLASS-B			
	@ WINDING TEMP PROTECTION	☒ THERMOSTAT (3 Nos.,1 IN EACH PHASE) ☐ -----			
	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED			
INTEGRAL STARTER	INTEGRAL STARTER	☒ REQUIRED ☐ NOT REQUIRED			
	TYPE OF SWITCHING DEVICE	☒ CONTACTORS(Reversing type) ☐ THYRISTORS			
	TYPE	☒ CONVENTIONAL ☐ SMART (NON-INTRUSIVE)			
	IF SMART				
	a) SERIAL LINK INTERFACE	☐ INTEGRAL ☐ FIELD MOUNTED			
	b) SERIAL LINK PROTOCOL	☐ FOUNDATION FIELD-BUS ☐ PROFI-BUS ☐ DEVICE NET ☐			
	c) SERIAL LINK MEDIA	☐ TWISTED PAIR Cu-CBL ☐ CO-AXIAL Cu-CBL ☐ OFC			
	d) HAND HELD PROGRAMMER	☐ REQUIRED ☐ NOT REQUIRED			
	e) TYPE OF HAND HELD PROGRAMMER	☐ BLUETOOTH ☐ INFRARED ☐			
	f) MASTER STATION	☐ REQUIRED ☐ NOT REQUIRED			
	g) MASTER STN INTRFACE WITH DCS	☐ MODBUS ☐ TCP/IP			
	h) DETAILS OF SPECIAL CABLE	☐ ENCLOSED ☐ NOT REQUIRED			
	STEP DOWN CONT. TRANSFORMER	☒ REQUIRED			
	OPEN-STOP-CLOSE PB(running open/close LED) THREE POSITION SELECTOR SWITCH	☒ REQUIRED ☐ NOT REQUIRED			
	INDICATING LAMPS	☒ REQUIRED ☐ NOT REQUIRED			
	LOCAL-OFF- REMOTE S/S(THREE POSITION SELECTOR SWITCH)	☒ REQUIRED ☐ NOT REQUIRED			
	STATUS CONTACTS FOR MONITORING	☒ REQUIRED ☐ NOT REQUIRED			
	INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (MOTOR THERMOSTAT TRIP/O/L RELAY OPERATED, CONT. /POWER SUPPLY FAILED, S/S IN LOCAL/REMOTE/OFF MODE, TORQUE SWITCH OPEN/CLOSE CUT OFF/STOP PB OPTD.)			
	INTERPOSING RELAY/OPTO COUPLER (Applicable for integral Starter)	TYPE OF ISOLATING DEVICE	☐ INTERPOSING RELAY ☒ OPTO COUPLER ☐ EITHER		
		QUANTITY	☒ 2 Nos. ☐ 3 Nos.		
DRIVING VOLTAGE		☒ 20.5 – 24V DC ☐ _____ V DC			
DRIVING CURRENT		☒ 125mA MAX ☐ _____ mA MAX			
LOAD RESISTANCE		☒ > 192 ohms - <25 k ohms ☐ > _____ ohms - < _____ ohms			
TORQUE SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY			
	OPEN / CLOSE	☒ 1 No. ☐ 2Nos. / ☒ 1 No. ☐ 2Nos			
	CONTACT TYPE	2 NO + 2 NC			
	RATING	10A 240V AC AND 0.5A 220V DC			
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE			
	ACCURACY	+3% OF SET VALUE			
LIMIT SWITCH (Not Applicable for Smart Actuator) (\$\$ Refer Notes)	MFR & MODEL NO.	BIDDER TO SPECIFY			
	OPEN : INT : CLOSE	☒ 2 Nos. 2 nos(adj) 1 No.	☒ 2Nos.		
	CONTACT TYPE	2 NO + 2 NC			
	RATING (AC / DC)	10A 240V AC AND 0.5A 220V DC			

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.:	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 25.04.18
			SHEET 3	OF 4
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	
POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty & other specific applications)	REQUIRED for regulating/inching duty only.		
	MFR & MODEL NO.	BIDDER TO SPECIFY		
	TYPE	☐ ELECTRONIC (2 WIRE) R/I CONVERTER ☒ ELECTRONIC (2 WIRE) contactless inductive type		
	SUPPLY	☒ 24V DC ☐		
	OUTPUT	☒ 4-20mA		
	ACCURACY	$\pm 1\%$ FS		
SPACE HEATER	@SPACE HEATER	REQUIRED		
	@ POWER SUPPLY (NON INTEGRAL)	240V AC, 1 PH., 50 Hz		
	@ POWER SUPPLY (INTEGRAL)	BIDDER TO SPECIFY		
	@ RATING			
TERMINAL BOX	ACTUATOR/MOTOR TERMINAL BOX	REQUIRED		
	ENCL CLASS ACTUATOR/MOTOR T.B.	☒ IP 68 @ ☐ NEMA6		
	@ EARTHING TERMINAL	REQUIRED		
	PLUG & SOCKET (9 PIN) (FOR COMMD, LS/TS FEED BACK, PoT)	☒ REQUIRED ☐ NOT REQUIRED ☐ ☒ 2 NOS. ☐		
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:-----		
	@ SPACE HEATER CABLE GLAND	SIZE:-----		
	OTHER CONTROL CABLE GLANDS-1	☐ 1No. for BFV of CW PUMP (Cable size 2Px1.5mm ²)		
	OTHER CONTROL CABLE GLANDS-2	1 no suitable for 8P X 0.5 sq mm Additional 1 no suitable for 2P X 0.5 sq mm (inching duty only)		

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.:	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 25.04.18
			SHEET 4	OF 4
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	
WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY	_____ Kg.	
NOTES: SCOPE: DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY. CODES & STANDARDS: DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH: IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722 - TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C. - CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL SHALL BE PROVIDED. - THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE. - THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY, -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%. - THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING. \$\$ TORQUE SWITCH & LIMIT SWITCH SHALL ACT INDEPENDENT OF EACH OTHER. TANDEM OPERATION IS NOT ACCEPTABLE. ## EPOXY PAINT IS RECOMMENDED FOR COASTAL AREAS. - IT SHOULD BE POSSIBLE TO OPERATE THE ACTUATOR LOCALLY. LOCKABLE LOCAL/REMOTE SELECTION SHALL BE PROVIDED ON THE ACTUATOR. - POSITION INDICATOR SHALL BE PROVIDED FOR 0 TO 100 % TRAVEL - WIRING SHALL BE SUITABLE VOLTAGE GRADE COPPER WIRE 1.5 SQ. MM. - THE MOTOR SHALL BE CAPABLE OF STARTING AT 85 PERCENT OF RATED VOLTAGE AND RUNNING AT 80 PERCENT OF RATED VOLTAGE AT RATED TORQUE AND 85 PERCENT RATED VOLTAGE AT 33 PERCENT EXCESS RATED TORQUE FOR A PERIOD OF 5 MINUTES EACH. - THE ACTUATORS SHALL BE DESIGNED TO BE SELF-LOCKING UPON LOSS OF POWER. MOTOR SHALL BE DESIGNED TO CLOSE IN 30 SECS. FROM FULL OPEN POSITION AND SHALL HAVE ADEQUATE CAPACITY TO OPEN AND CLOSE UNDER FULL UNBALANCED DESIGN PRESSURE. - THE INTEGRAL STARTER WHICH SHALL HAVE SOPHISTICATED ELECTRONIC CONTROLS WITH FIELD PROGRAMMING FEATURE. IT SHALL BE DESIGNED FOR REMOTE CONTROL FROM DCS/RESPECTIVE CONTROL SYSTEM. REQUIRED INTERPOSING RELAYS FOR RECEIVING OPEN/CLOSE/STOP COMMAND FROM DCS/RESPECTIVE CONTROL SYSTEM SHALL BE PROVIDED. POTENTIAL FREE CONTACTS AND TRANSDUCERS SHALL BE PROVIDED TO PROVIDE STATUS INDICATION AT REMOTE DCS/RESPECTIVE CONTROL SYSTEM. - THE REMOTE COMMAND SIGNAL (OPEN-STOP-CLOSE) FROM DCS/RESPECTIVE CONTROL SYSTEM/CONTROL PANEL SHALL BE ISOLATED FROM CONTROL ELECTRONICS THROUGH OPTO-ISOLATOR. - THE FOLLOWING INDIVIDUAL STATUS ANNUNCIATION LED'S (COLOUR-GREEN) SHALL BE PROVIDED LOCALLY (INTEGRAL TO ACTUATOR) TO ANNUNCIATE THE FOLLOWING FOR EASY LOCAL MONITORING. ACTUATOR IN LOCAL MODE ACTUATOR IN REMOTE MODE ACTUATOR RUNNING IN OPEN DIRECTION ACTUATOR RUNNING IN CLOSE DIRECTION ACTUATOR IN INCHING MODE. ACTUATOR IN SELF-RETAINING MODE LIMIT SWITCH OPEN TRIP LIMIT SWITCH CLOSE TRIP CONTROL VOLTAGE AVAILABILITY				
NOTES* = TO BE FILLED BY MPL (LEAD AGENCY). @= TO BE FILLED BY ES				

3-V-MISC-24283

DRAWING NO.



NOTE:-

- ALL TORQUE AND LIMIT SWITCHES (OTS, CTS, OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE.
- ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
- OTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
- OLS-1, OLS-2 - LIMITSWITCHES FOR POSITION OPEN
- CLS-1, CLS-2 - LIMITSWITCHES FOR POSITION CLOSE
- EPT - ELECTRONIC POSITION TRANSMITTER (CONTACTLESS TYPE, FOR INCHING DUTY)
- R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
- FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24 VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
- M - MOTOR 3φ 415V 50 Hz AC SUPPLY
- TORQUE SWITCH BYPASS WITH LIMITSWITCH BOTH ON OPEN & CLOSE DIRECTION TO BE DONE INTERNALLY.

REV	DATE	ALTERED
		CHD & APPD

CAUTION: The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD. It must not be used directly or indirectly in any way detrimental to the interest of the company.

TYPE OF PRODUCT

ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS
2 X 800 MW UPPLUR TPP
(DRAWN FOR INTERMEDIATE POSITION OF VALVES)



BHARAT HEAVY ELECTRICALS LTD.,
UNIT: HIGH PRESSURE BOILER PLANT.
TIRUCHIRAPALLI-620014.

DEPT VL
CODE -



SCALE
NTS

WEIGHT (KG).
-

TITLE
WIRING DIAGRAM (TERMINAL PLAN)
FOR ACTUATOR WITH INTEGRAL STARTER WITH PLUG & SOCKET

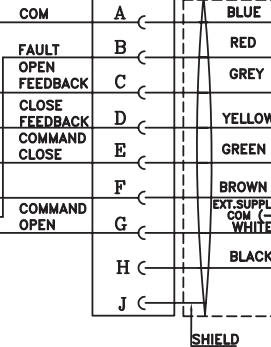
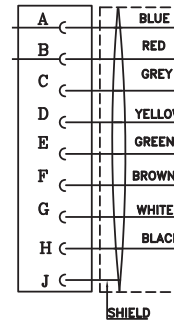
DRN	NAME	SIGN	DATE	NO. OF VAR.
CHD	N.P.ESWAR	N.P.	17.03.05	-
APPD	D.DINAKARAN	D.D	17.03.05	-
	K.ARUNACHALAM	K.A	17.03.05	-

REFERENCE INFORMATION
NO. OF ITEMS
-

DRAWING NO.
3-V-MISC-24283
REV
0

CONTACT DEVELOPMENT DIAGRAM

OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL
CTS	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL
	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL
OLS-1	9-10	
	11-12	
CLS-1	13-14	
	15-16	
OLS-2	17-18	
	19-20	
CLS-2	21-22	
	23-24	
SWITCH	TERMINAL NO.	VALVE POSITION
	FULL OPEN	INTERMEDIATE
		FULL CLOSE
		INDICATES CONTACT CLOSED
		INDICATES CONTACT OPEN
		CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC

9 PIN PLUG & SOCKET
(FOR ALL ACTUATORS)9 pin PLUG & SOCKET
(FOR ALL ACTUATOR)

SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH

VALVES	OPEN		CLOSE	
	MAIN	BACK UP	MAIN	BACK UP
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#
# - CLS NOT TO BE CONNECTED IN TRIP CIRCUIT				
* - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)				