
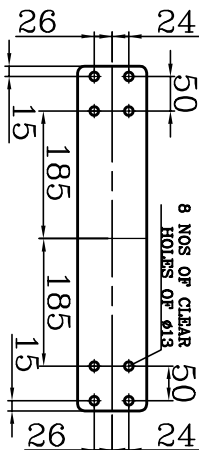


THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED.  
IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETRIMENTAL TO THE INTEREST OF THE COMPANY.

SIGN. AND DATE


REF. DRG. NO.

INVENTORY NO.

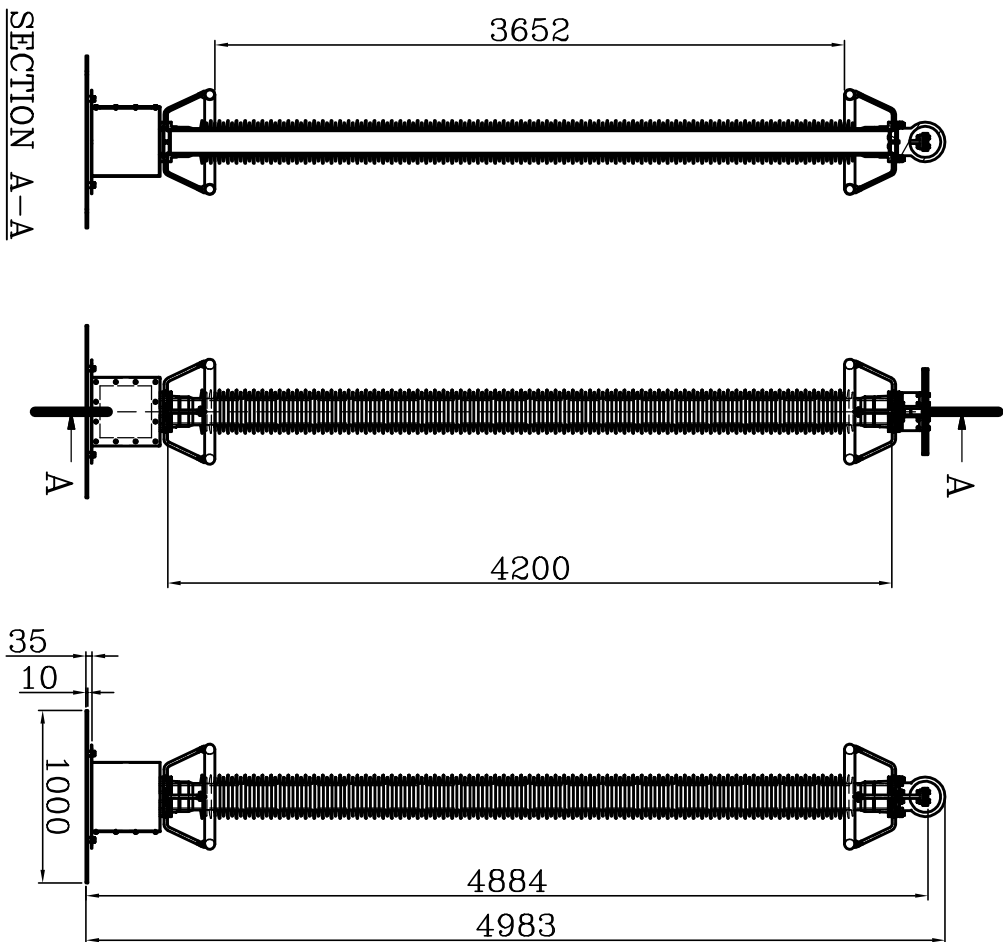

## DETAIL Z

NOTE: HOLE DETAILS FOR BUS BAR  
TERMINATION FOR STC TESTING AT TEST LAB

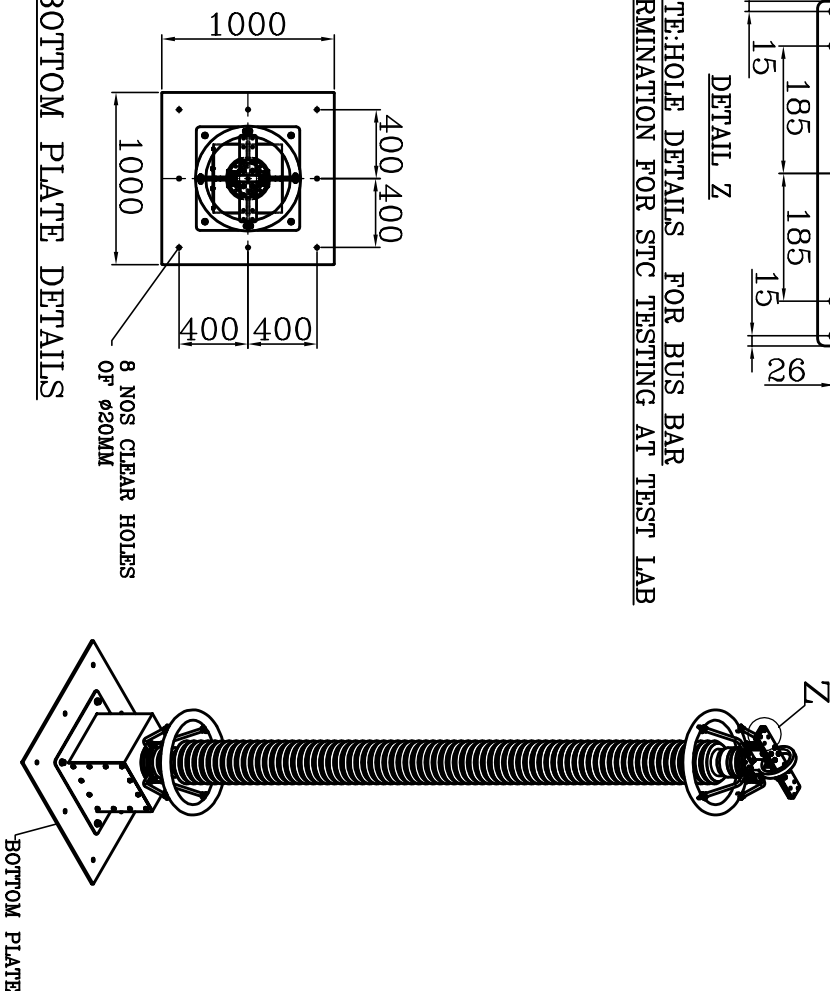

## BOTTOM PLATE DETAILS

NOMINAL CURRENT RATING = 4000A
NOMINAL VOLTAGE RATING = 420KV

VAR. NO.	REMARKS	VAR. NO.	ITEM NO.	DESCRIPTION	STD	DRAWING NO.	IT. NO.	MATL. CODE	A	UNIT	UNIT WGT.	GS	ZONE
							VAR.	MATL. SPECUL.			C		
							NO						

TYPE OF PRODUCT	STC TESTING OF
NAME OF CUSTOMER	FIBRE OPTIC CURRENT TRANSFORMER

NAME OF CUSTOMER



**BHARAT HEAVY ELECTRICALS LTD.**  
**HYDERABAD**

NAME	SIGN.	DATE	NO.OF VAR.
AMISHRA	-sd/-	19.03.19	
MURTHUNAY KR	-sd/-	19.03.19	
AKHIL	-sd/-		

DEPT.	GRADE OR TOY DIV
-------	---------------------

	10L DIM.
CODE	C/M/F



1:1

243

## SINGLE PHASE FOCT

## ASSEMBLY

CARD CODE	RDDG434126 0000
--------------	-----------------

SHEET NO.	01	NO.
-----------	----	-----

D. OF SHEETS 01