FIRST ANGLE PROJECTION

(ALL DIMENSIONS ARE IN mm)

DRG. NO. PY-LE-1M088-1260-02

SHT. 01 OF 02



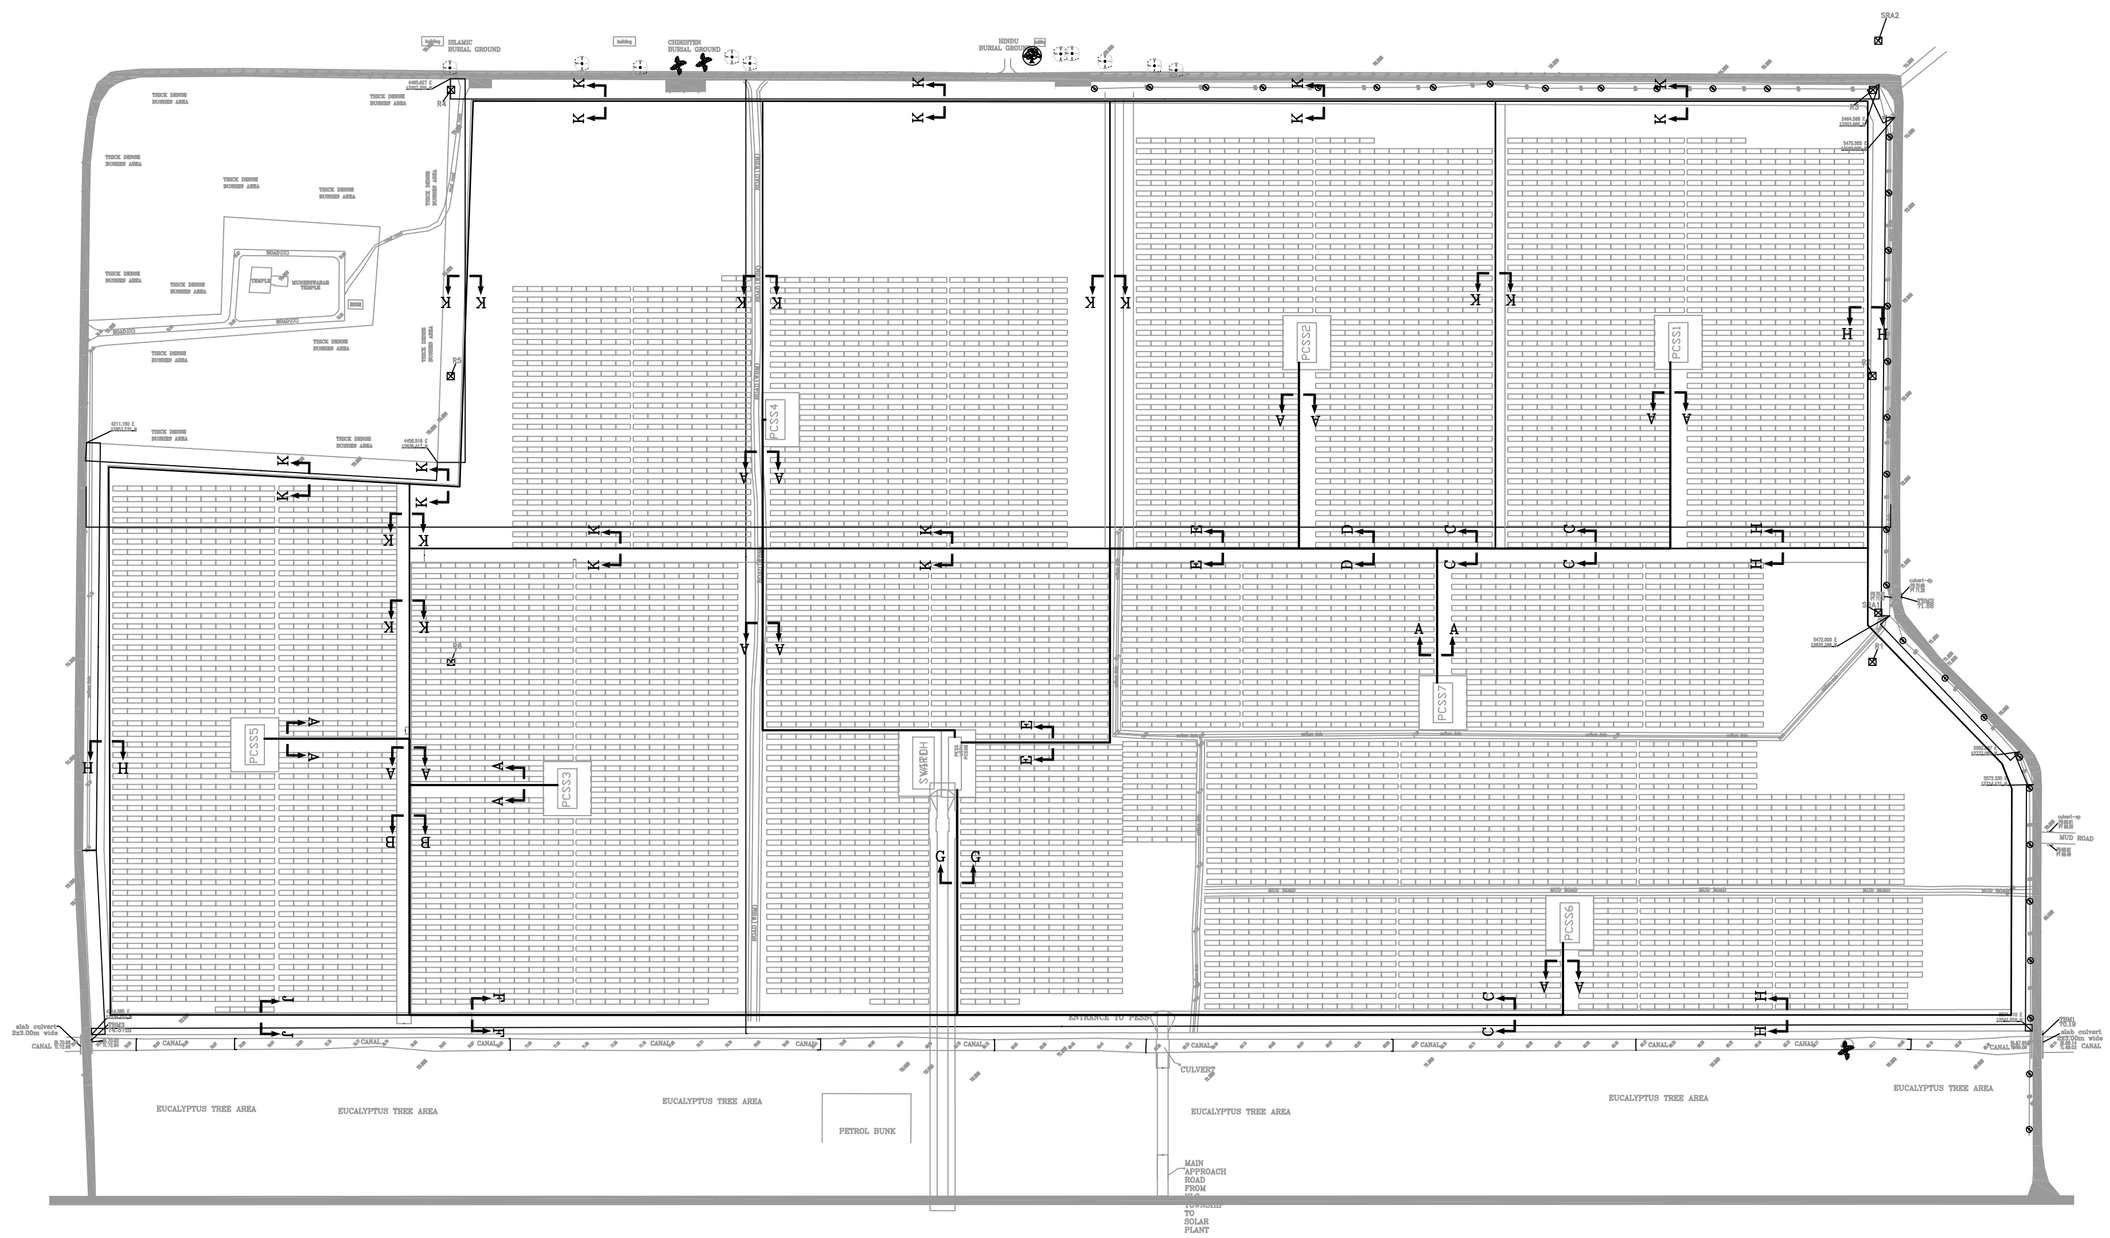

NOTE:

1. ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED.
2. FOR CABLING PLEASE REFER AC CABLE SCHEDULE.
3. ARMOURED CABLES WILL BE LAID DIRECTLY IN GROUND WITHOUT CONDUIT, UNARMOURED CABLES IN TRENCH WILL BE LAID IN CONDUITS.
4. THE TRENCH MARKED IS INDICATIVE ONLY.IT CAN BE CHANGED AS PER SITE CONDITION IN CONSULTATION WITH ENGINEER IN CHARGE.
5. CONDUIT OPENINGS SHALL BE SEALED PROPERLY.
6. EXCAVATED SOIL SHOULD BE FREE FROM ROCK,STONE AND OTHER SHARP OBJECT.
7. CABLE SHALL BE LAID 300MM MINIMUM BELOW THE FGL.
8. DISTANCE BETWEEN POWER AND COMMUNICATION CABLE SHALL BE 300MM MINIMUM.
9. POWER CABLE AND COMMUNICATION CABLE SHALL BE INTERCHANGED BASED ON TRENCH & SMB LOCATION.DISTANCE BETWEEN THEM SHALL BE MAINTAINED AS PER SECTION SHOWN.

For Tender Purpose Only

THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED. IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETRIMENTAL TO THE INTEREST OF THE COMPANY

GENERAL DIMENSIONAL LIMITS,FITS & TOLERANCES AS PER HY0230261

INVENTORY NO	SIGN. AND DATE	REF. DRG. NO.	COMPUTER FILE NAME

REV.	DATE	ALTERED	CHD/APPD
ZONE			

PROJECT : 65MWp SOLAR POWER PLANT

CUSTOMER / CONSULTANT : NEYVELI LIGNITE CORPORATION LTD. NEYVELI-TAMILNADU

BHARAT HEAVY ELECTRICALS LTD. UNIT : PE&SD-HYDERABAD

	NAME	SIGN.	DATE	NO.OF VAR.
DRN.	G.SESHU KIRAN		06.08.16	N.A.
CHD.	P SURESH		06.08.16	
APPD.	J K PATTANAIK		06.08.16	

DEPT.	UNTOL DIMS.	SCALE	WEIGHT (KG)	REF. TO ASSY. DRG.	ITEM NO.	NO.OF ITEMS
PE&SD	GR.	1:90	N.A.	N.A.	N.A.	N.A.
CODE 450	G/M/F					

TITLE: PESS ROOM EQUIPMENT LAYOUT

CARD CODE: NA

DRAWING NO.: PY-LE-1-M088-1260-02

REV.: 00

SHT. No 01 NO. OF SHT. 02