

TECHNICAL SPECIFICATION
FOR
HT XLPE POWER CABLES

VOLUME-II

SPECIFICATION NO: *PE-TS-412-507-E001A*

REVISION: 00

TANGEDCO
2X660 MW ENNORE TPS



BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA, UP (INDIA) – 201301



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 412-507-E001A

VOLUME II

SECTION -

REVISION 00

DATE: 18.03.17

SHEET -

CONTENTS

<u>S. NO.</u>	<u>CONTENTS</u>	<u>NO. OF SHEETS</u>
01	SECTION – I	
a)	COMPLIANCE CERTIFICATE	01
b)	SPECIFIC TECHNICAL REQUIREMENTS	03
c)	DATA SHEET-A	04
d)	DATA SHEET-C (GUARANTEED TECHNICAL PARTICULARS)	03
02	SECTION – II	
a)	STANDARD TECHNICAL SPECIFICATION	02
b)	ANNEXURE- C TO SECTION-II (STEEL DRUM DRAWING, TYPICAL)	02
c)	QUALITY PLAN (ALONGWITH ANNEXURE)	11
	TOTAL NO. OF SHEETS= (INCLUDING COVER/ SEPARATOR SHEETS)	XX



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 412-507-E001A

VOLUME II

SECTION I

REVISION - 00

DATE: 18.03.17

SHEET -

SECTION – I

SPECIFIC TECHNICAL REQUIREMENTS



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 412-507-E001A

VOLUME II

SECTION I

REVISION - 00

DATE: 18.03.17

SHEET -

COMPLIANCE CERTIFICATE

The bidder shall confirm compliance to the following by signing/ stamping this compliance certificate and furnishing same with the offer.

1. The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusion/ deviation with regard to same.
2. There are no deviation with respect to specification other than those furnished in the 'schedule of deviations'
3. Only those technical submittals which are specifically asked for in NIT to be submitted at tender stage shall be considered as part of offer. Any other submission, even if made, shall not be considered as part of offer.
4. Any comments/ clarifications on technical/ inspection requirements furnished as part of bidder's covering letter shall not be considered by BHEL, and bidder's offer shall be construed to be in conformance with the specification.
5. Any changes made by the bidder in the price schedule with respect to the description/ quantities from those given in Annexure-A [BOQ-Cum-Price schedule] of the specification shall not be considered (i.e., technical description & quantities as per specification shall prevail).

BIDDER'S STAMP & SIGNATURE



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- XXX-507-E001A

VOLUME II

SECTION I

REVISION - 00

DATE: 03.01.17

SHEET 1 of 1

1.0 SCOPE OF ENQUIRY

- 1.1 This specification covers the Design, Manufacture, Inspection and Testing at Manufacturer's works, proper packing and delivery to site of HT XLPE POWER CABLES.
- 1.2 It is not the intent to specify herein all the details of design & manufacture. However, the equipment shall conform in all respects to high standards of design engineering and workmanship and shall be capable of performing in continuous commercial operation at site conditions.
- 1.3 General technical requirements of the HT XLPE POWER CABLE are indicated in Section-II. Project specific technical/ quality requirements / changes are listed in Section-I.
- 1.4 The stipulations of Section-I, followed by those of Data Sheet-A shall prevail in case of any conflict between the stipulations of Section-I, Data Sheet - A & Section-II.
- 1.5 The documents shall be in English Language and MKS system of units

2.0 BILL OF QUANTITIES:

- 2.1 Quantity requirements shall be as per Annexure for Bill of Quantities (BOQ) enclosed as part of NIT.

3.0 TECHNICAL REQUIREMENTS

- 3.1 Specific Technical Requirement:

<u>S.No.</u>	<u>Reference Clause No. of Section- II (if any)</u>	<u>Specific Requirement/ Change</u>
1	4.0	Cables shall be supplied in non returnable wooden or steel drums of heavy construction. The surface of the drum and the outer most cable layer shall be covered with water proof cover. Both the ends of the cables shall be properly sealed with heat shrinkable PVC/ rubber caps secured by 'U' nails so as to eliminate ingress of water during transportation, storage and erection. Wood preservative anti-termite treatment shall be applied to the entire drum. Wooden drums shall comply with IS: 10418.

- 3.2 Quality/ Inspection:

<u>S.No.</u>	<u>Reference Clause No. of Section- II (if any)</u>	<u>Specific Requirement/ Change</u>



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 412-507-E001A

VOLUME II

SECTION I

REVISION 00

DATE: 18.03.17

SHEET -

DATASHEET A



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- XXX-507-E001A

VOLUME II

SECTION I

REVISION 00

DATE: 03.01.17

SHEET 1 of 4

DATASHEET-A

1.0	Type of Cable	Flame Retardant-Low Smoke (FR-LSH)			
2.0	Standard applicable in general(Latest amendment to be referred if any)	IS:7098 (Part-2), IS:8130, IS:5831, IS:10810, IS:3975, ASTM D:2843, ASTM D:2863, IEC-754-1, IEC:60332 (Part-1), IEC:60332-3-23, IEEE:60383			
3.0	Voltage Grade	3.3/3.3 kV (unearthed)	11/11 kV (unearthed)		
4.0	Number of cores, cross sectional area of conductors and quantities	As per BOQ-Cum-Price Schedule			
5.0	CONDUCTOR				
(a)	Material	Aluminium			
	Grade and Class	Stranded, H2, Class 2			
(b)	Standard Applicable	IS: 8130			
(c)	Shape	Compacted Circular & Shaped			
(d)	Min. number and diameter of strands	As per Class-2 of IS: 8130			
(e)	Conductor screen				
(i)	Material	Extruded Cross-linked Semi-conducting compound			
(ii)	Minimum thickness	0.3 mm			
6.0	INSULATION				
(a)	Material	Extruded Cross-Linked Polyethylene(XLPE)			
(b)	Standard Applicable	IS: 7098 (Part-2)			
(c)	Continuous withstand temperature	90°C			
(d)	Short-circuit withstand temperature	250°C			
7.0	INSULATION SCREEN	For both single core cable & Multi core cables			
(a)	Non-metallic				
(i)	Material	Extruded Cross-linked Semi-conducting compound			
(ii)	Type of Semiconducting compound	Bonded			
(iii)	Minimum thickness	0.3 mm			
(b)	Metallic				
(i)	Material	Copper			
(ii)	Type	Tape			
(iii)	Size	Nominal thickness 0.1mm with tolerance (±) 10%			
(iv)	Minimum Overlap	10%			
(c)	Earth fault current withstand capacity	300A, 2 sec (For multi-core cables, screen of each core shall be rated individually for the above value).			
8.0	EXTRUSION (Insulation and Screens)				
(a)	Process	Triple Extrusion (Extruded semi-conducting compound conductor screen and insulation screen shall be applied along with XLPE insulation in			



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- XXX-507-E001A

VOLUME II

SECTION I

REVISION 00

DATE: 03.01.17

SHEET 2 of 4

		a single operation by triple extrusion process).
(b)	Method of Curing	<i>Dry curing/Gas curing/Steam curing</i>
9.0	CORE IDENTIFICATION	By coloured strips applied on the cores or by numerals printing on the cores
10.0	INNER SHEATH	For both single core cable & Multi core cables
(a)	Material	Extruded HRPVC Type ST-2
(b)	Standard Applicable	IS: 7098 (Part-2) & IS: 5831
(c)	Colour	<i>Black</i>
(d)	Whether FR-LSH	YES
(e)	Inner sheath applicable for single core cable	YES
(f)	Fillers	Acceptable
(g)	Material of fillers (if permitted)	Same as inner sheath (Material of filler to be compatible with that of inner sheath)
(h)	Method of application	
(1)	Multi-core cables:	
(i)	With fillers	<i>Pressure extruded</i>
(ii)	Without fillers	<i>Pressure extruded</i>
(2)	Single-core cables:	<i>Pressure extruded</i>
(i)	Thickness of inner sheath	As per Table-5 of IS: 7098 (Part-2)
11.0	ARMOUR	
(a)	<i>Applicable</i>	YES
(b)	Material:	
(i)	Single core cables	Aluminium Round Wire H4 grade to IS: 8130
(ii)	<i>Multi-core cables</i>	<i>Galvanised Steel Strip conforming to (i) Table-6 of IS 7098 part-2</i>
(iii)	Standard Applicable	Dimension as per IS: 7098 (Part-2) Table-6 and tolerance on dimension as per IS:3975
(c)	Minimum Coverage	90%
(d)	Gap between armour wires	Shall not exceed one armour wire space (No cross-over/ over-riding)
(e)	Breaking load of joint	95 % of normal armour
12.0	OUTERSHEATH	
(a)	Material	Extruded HRPVC Type ST2 as per IS: 5831
(b)	Colour	<i>Black</i>
(c)	Whether FR-LSH	Yes
(d)	Method of application	Extruded
(e)	Thickness of outer sheath	As per Table-7 of IS: 7098 (Part-2)
(f)	Marking	Owner's name ,Manufacturer's name and /or trade mark,voltage grade,year of manufacture,Type of insulation,Cable size (cross section area of onductor and no. of cores) IS Number(s) Type of inner & outer sheath e.g. "FRLSH" etc, Sequential Length, 'BHEL-PEM' @ 1m (by embossing) for 11kV & 3.3 kV Cables.



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- XXX-507-E001A

VOLUME II

SECTION I

REVISION 00

DATE: 03.01.17

SHEET 3 of 4

		ISI mark @ 1m (by embossing).
13.0	FR-LSH CHARACTERISTICS	
(a)	Oxygen index	Min 29 (As per IS 7098-2 /ASTMD 2863)
(b)	Temperature index	Min. 250°C(As per IS 7098-2 /ASTMD 2863)
(c)	Acid gas generation	Max. 20% by weight (As per IS 7098-2 /IEC-60754-1)
(d)	Smoke density rating	Max. 60% (As per IS 7098-2 /ASTM D 2843)
(e)	Flammability Test	
(i)	Flammability test for single cable	YES As per: IEC-60332 Part-1
(ii)	Flammability test for bunched cables	YES As per: IEC-60332 Part-3, CAT-B
(iii)	Flammability test as per IEEE: 60383	YES
(iv)	As per Swedish Chimney test SEN-SS-424-1475-F3	YES
14.0	Anti-rodent and Termite repulsion Test	YES
15.0	Anti-Fungal Test	No
16.0	Special Tests	
(a)	Hydrolytic Stability as per ASTM D 3137 :81 (Duration:- 14 days)	No
(b)	UV Radiation Test as per BS EN ISO 4892-2 (Duration:- 14 days)	No
(c)	UV Radiation Test as per ASTM G 154 (Duration:- 14 days)	No
17.0	TOLERANCE ON OUTER DIAMETER	(±)2 mm. over the declared value
18.0	CABLE DRUMS	
(a)	Type of Drum	Wood/Steel
(b)	Standard drum length	500m (+) 5% / 700M (+) 5% / 1000M (+) 5% (as specified in BOQ-Cum-Priced Schedule). No negative tolerance allowed.
©	Marking on drum	Each drum shall carry manufacturer's name, Owner's name, address and contract number, Type of cable & voltage grade, Year of manufacture, Type of insulation / sheath e.g. XLPE /HRPVC FRLS as applicable, No. of core and size of cables, Cable code, Length of cable on drum, ISI Mark, Approx. gross mass stenciled on both side of the drum. A tag containing same information shall be attached to the leading end of the cable. An arrow and suitable accompanying wording shall be marked on one end of the reel indicating the direction in which it should be rolled.
19.0	SEA WORTHY PACKING	NO

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS- XXX-507-E001A	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: XX:XX:XXXX
		SHEET 1 OF 4	

DATASHEET C

**GUARANTEED TECHNICAL PARTICULARS
(TO BE SUBMITTED BY SUCCESSFUL BIDDER)**

S.No.	Particulars	Unit	Description
1.0	GENERAL		
1.1	Name of Manufacturer	-	
1.2	Place of Manufacture	-	
2.0	STANDARDS APPLICABLE		
2.1	IS: 7098 Part-2 For general specification of XLPE Cables	YES	
2.2	IS: 8130 For conductor material	YES	
2.3	IS: 5831 For material of innersheath & outersheath	YES	
2.4	IS: 3975 / IS: 8130 For armour of 3 core/ single core cables	YES	
2.5	IS: 10810 For method of tests	YES	
2.6	ASTMD-2863 For oxygen index test	YES	
2.7	SS:424-14-75 & IEC-60332-3 & IEC-60332-1 & IEEE: 60383 For flammability test	YES	
2.8	IEC-60754-1 For acid gas generation test	YES	
2.9	ASTMD-2843 For smoke generation test	YES	
2.10	Current rating of cables conforms to	-	
2.11	Short circuit rating conforms to	-	
2.12	Formula for calculating short circuit current for different durations	-	
3.0	INSTALLATION CONDITIONS AT SITE		
3.1	Ambient air temperature	deg. C	
3.2	Ground temperature	deg. C	
3.3	Depth of laying of cables buried in ground	cm	
3.4	Thermal resistivity of soil	deg. C cm/W	
4.0	INSTALLATION CONDITIONS FOR CURRENT RATING		

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS- XXX-507-E001A	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: XX:XX:XXXX
		SHEET 2 OF 4	

	SPECIFIED AT CLAUSE 7.3		
5.0	CHARACTERISTICS OF FR-LSH SHEATH		
5.1	Oxygen index	-	
5.2	Temperature index	-	
5.3	Acid gas generation	-	
5.4	Smoke density rating	-	
6.0	CABLE DRUMS		
6.1	Type & construction	-	
6.2	Standard drum length	-	
6.3	Tolerance on drum length	-	
7.0	INFORMATION TO BE FILLED IN FOR EACH SIZE CABLE IN THE FORM OF TABLE		
7.1	No. of cores x size	-	
7.2	Voltage grade (Uo/U)	kV	
7.3	Base current ratings (*) based on Clause No. 3.0		
a)	In air	Amp	
b)	In ground	Amp	
c)	ducts	Amp	
7.4	Short circuit rating	kA, sec	
7.5	Properties		
a)	D.C. resistance of conductor at 20 deg. C	ohm/km	
b)	A.C. resistance of conductor at 90 deg. C	ohm/km	
c)	Reactance of cable at normal frequency	ohm/km	
d)	Electrostatic capacitance of cable at normal frequency	mF/km	
7.6	CONDUCTOR		
a)	Material type & grade	-	
b)	No & dia of wires in each core before stranding	no x mm	
c)	Shape	-	
7.7	CONDUCTOR SCREEN		
a)	Material	-	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS- XXX-507-E001A	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: XX:XX:XXXX
		SHEET 3 OF 4	

b)	Minimum thickness	mm	
7.8	XLPE INSULATION		
a)	Nominal thickness of insulation	mm	
b)	Method of curing	-	
7.9	INSULATION SCREEN		
a)	Type of screen	-	
b)	Material and thickness (minimum and nominal)	mm	
i)	Metallic	-	
	No. of tapes and Minimum overlapping	-	
ii)	Non-metallic	-	
iii)	Earth fault current withstand capacity (calculation to be furnished)	kA, sec.	
7.10	PVC ST2 INNERSHEATH		
a)	Material	-	
b)	Thickness (min.)	mm.	
c)	Method of application	-	
1)	Multi-core cables		
i)	With fillers	-	
ii)	With out fillers	Pressure Extruded	
2)	Single core cables		
d)	Type & Shape of fillers (if used)	-	
e)	Colour	-	
7.11	ARMOUR		
a)	Material	-	
b)	Size/ dimensions	-	
c)	Minimum no. of wires/ formed wires	-	
d)	Tolerance on formed wire dimension	-	
e)	Maximum resistivity of GS formed wire	-	
f)	Maximum resistivity of Al round wire	-	
7.12	PVC/POLYETHYLENE ST2 FR-LSH OUTERSHEATH		
a)	Nominal thickness of outer sheath	mm.	
7.13	DIAMETERS		
a)	Diameter of insulated conductor	mm.	
b)	Cable diameter under armour	mm.	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS- XXX-507-E001A	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: XX:XX:XXXX
		SHEET 4 OF 4	

c)	Cable diameter over armour	mm.	
d)	Overall diameter of cable	mm.	
7.14	Tolerance on overall diameter	(±) mm	
7.15	Minimum bending radius	x O.D.	
7.16	Safe pulling force	kg.	
7.17	Weight of cable	kg./km	
a)	Weight of conductor	MT./km	
b)	Weight of XLPE insulation	MT./km	
c)	Weight of PVC (Inner Sheath & Fillers)	kg./km	
d)	Maximum resistivity of GS formed wire	kg./km	
e)	Weight of PVC/Polyethylene (Outer Sheath & Fillers)	kg./km	
7.18	Dimension of drum	mm.	
7.19	Shipping weight	kg	
7.20	Cable marking on outer sheath	-	

(*) For single core cables, the continuous current rating shall be furnished separately for armour earthed at one end and at both ends.

:

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS-XXX-507-E001A

VOLUME II

SECTION II

REVISION 00

DATE: 10.05.2016

SHEET -

SECTION-II

STANDARD TECHNICAL SPECIFICATION



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS-XXX-507-E001A

VOLUME II

SECTION II

REVISION 00

DATE: 10.05.2016

SHEET 1 of 2

1.0 TECHNICAL REQUIREMENTS

- 1.1 Technical requirements for HT XLPE POWER CABLES shall be as indicated in this section, in addition to those specified in Section I & Datasheet-A.

2.0 CODES & STANDARDS

- 2.1 The design, material, construction, manufacture, inspection, testing and performance of HT XLPE POWER CABLES shall conform to the latest revision of relevant standards and codes of practices mentioned in Data Sheet – A.
- 2.2 In case of conflict between the applicable reference standard and this specification, this specification shall govern.

3.0 QUALITY ASSURANCE REQUIREMENTS

- 3.1 Bidder shall confirm compliance with the BHEL Standard Quality Plan (PE-QP-999-507-E001 as attached with the specification without any deviations. At contract stage, the successful bidder shall submit the same QP for BHEL/ultimate customer's approval. In case bidder has reference QP agreed with ultimate customer, same can be submitted for specific project after award of contract for BHEL/ultimate customer's approval. There shall be no commercial implication to BHEL on account of minor changes in QP during contract stage.
- 3.2 All materials shall be procured, manufactured, inspected and tested by vendor/ sub-vendor as per approved Quality Plan.
- 3.3 Type testing requirements, routine / acceptance testing and special testing requirements shall be as per Annexure to QAP. Charges for all these tests for all the equipment & components shall be deemed to be included in the bid price (except UV Radiation & Hydrolytic Stability test).
- 3.4 The charges of UV Radiation test & Hydrolytic Stability test (if applicable) shall be reimbursed extra at actual against original money receipt of Govt. Lab. (CPRI/ ERDA etc).
- 3.5 Cost of cables consumed for testing shall be to bidder's account.

4.0 Packing

- 4.1 Cables shall be supplied in non-returnable heavy construction steel drums. New or practically new cable drums made of steel and painted with epoxy resin paint are to be used. Cable ends are carefully protected before packing. Polyethylene sheet shall be wrapped over the cables and then sealed properly. For Typical details of Steel drums, Annexure-I to Section-II, may be referred by the bidder. Bidder may modify, to choose appropriate dimensions of steel drums to suite various sizes/weight/ lengths of HT XLPE power cables. BIS certification mark shall be stamped on each cable drum.

5.0 DRAWINGS & DOCUMENTS TO BE SUBMITTED

- 5.1 Documents/drawings to be submitted as part of technical offer & after placement of order for BHEL & customer's approval shall be as part of NIT.
- 5.2 Following documents/drawings shall be submitted after placement of order for BHEL & customer's approval

Sl. No.	Drawings/Document Description	Drawings / Document Number
1.	Technical Data Sheet for HT XLPE Power Cables	PE-V0-XXX-507-E101



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS-XXX-507-E001A

VOLUME II

SECTION II

REVISION 00

DATE: 10.05.2016



SHEET 2 of 2



Sl. No.	Drawings/Document Description	Drawings / Document Number
2.	Cross-sectional Drawings for HT XLPE Power Cables	PE-V0-XXX-507-E102
3.	Manufacturing Quality Plan for HT XLPE Power Cables	PE-V0-XXX-507-E103
4.	Type Test Reports for Tests conducted under this contract	PE-V0-XXX-507-E104

5.2 All drawings/ documents indicated above shall be submitted through Document Management System (DMS).

Annexure-C to Section D

(Sheet 1 of 2)

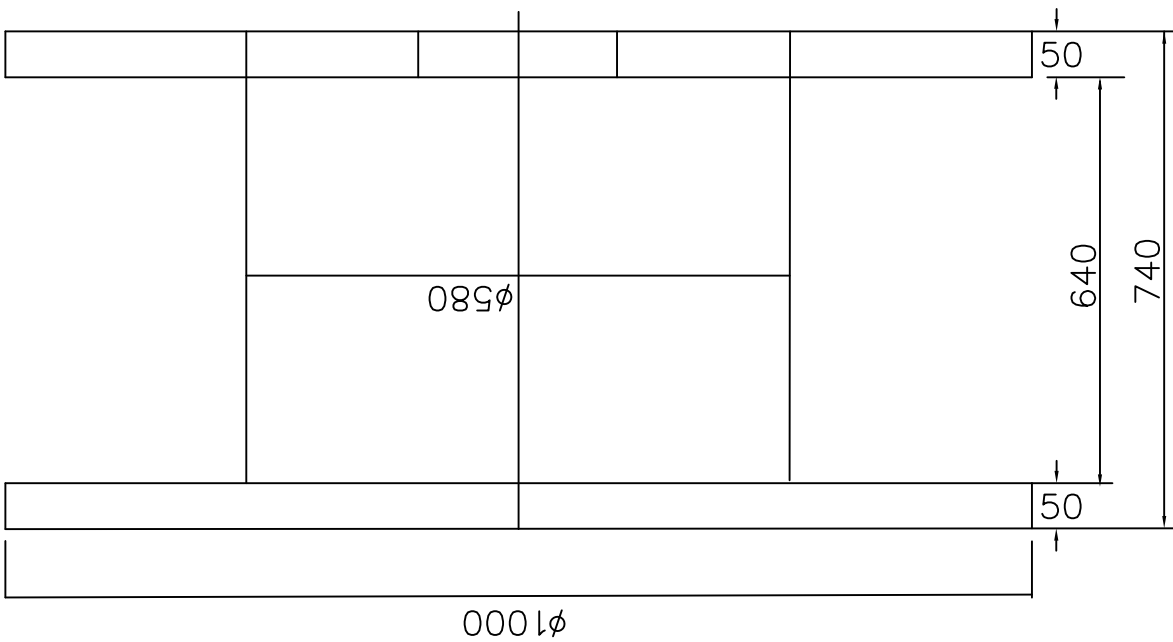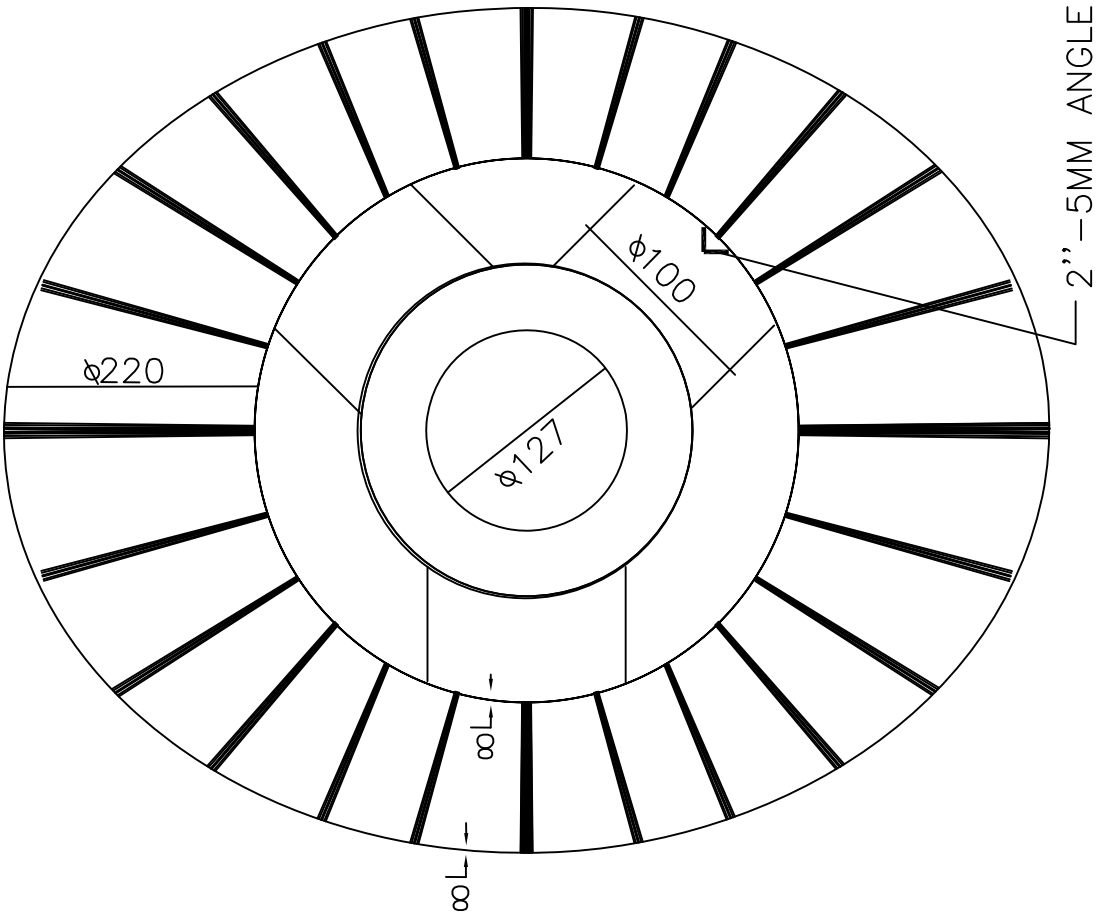

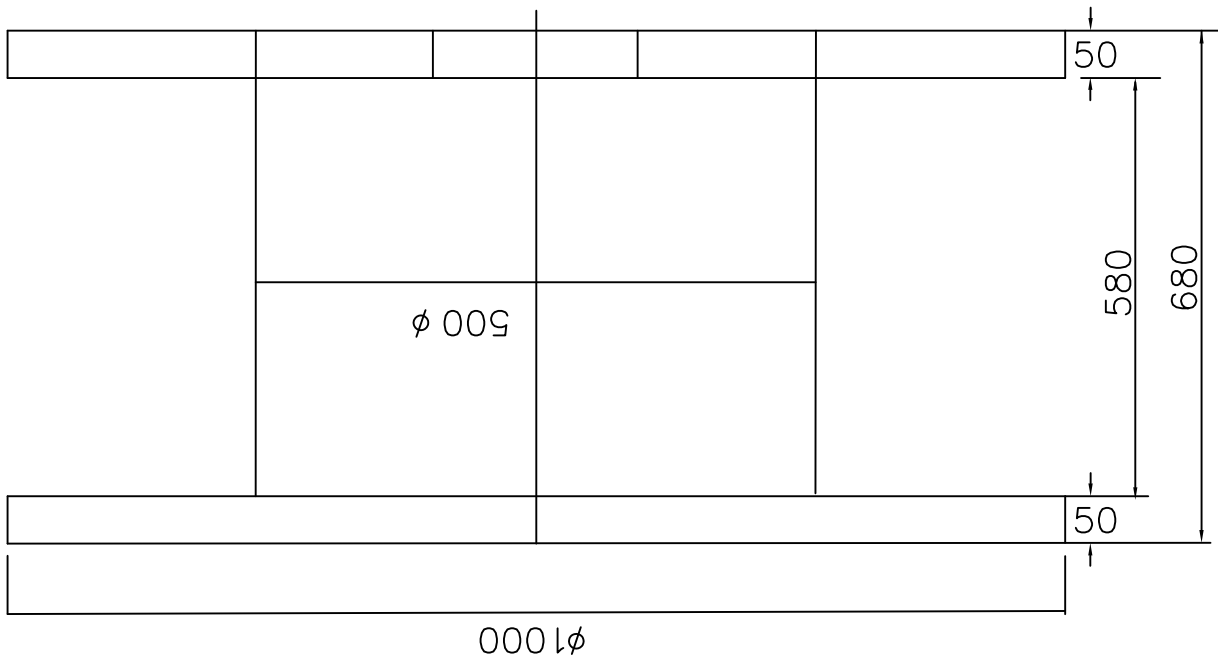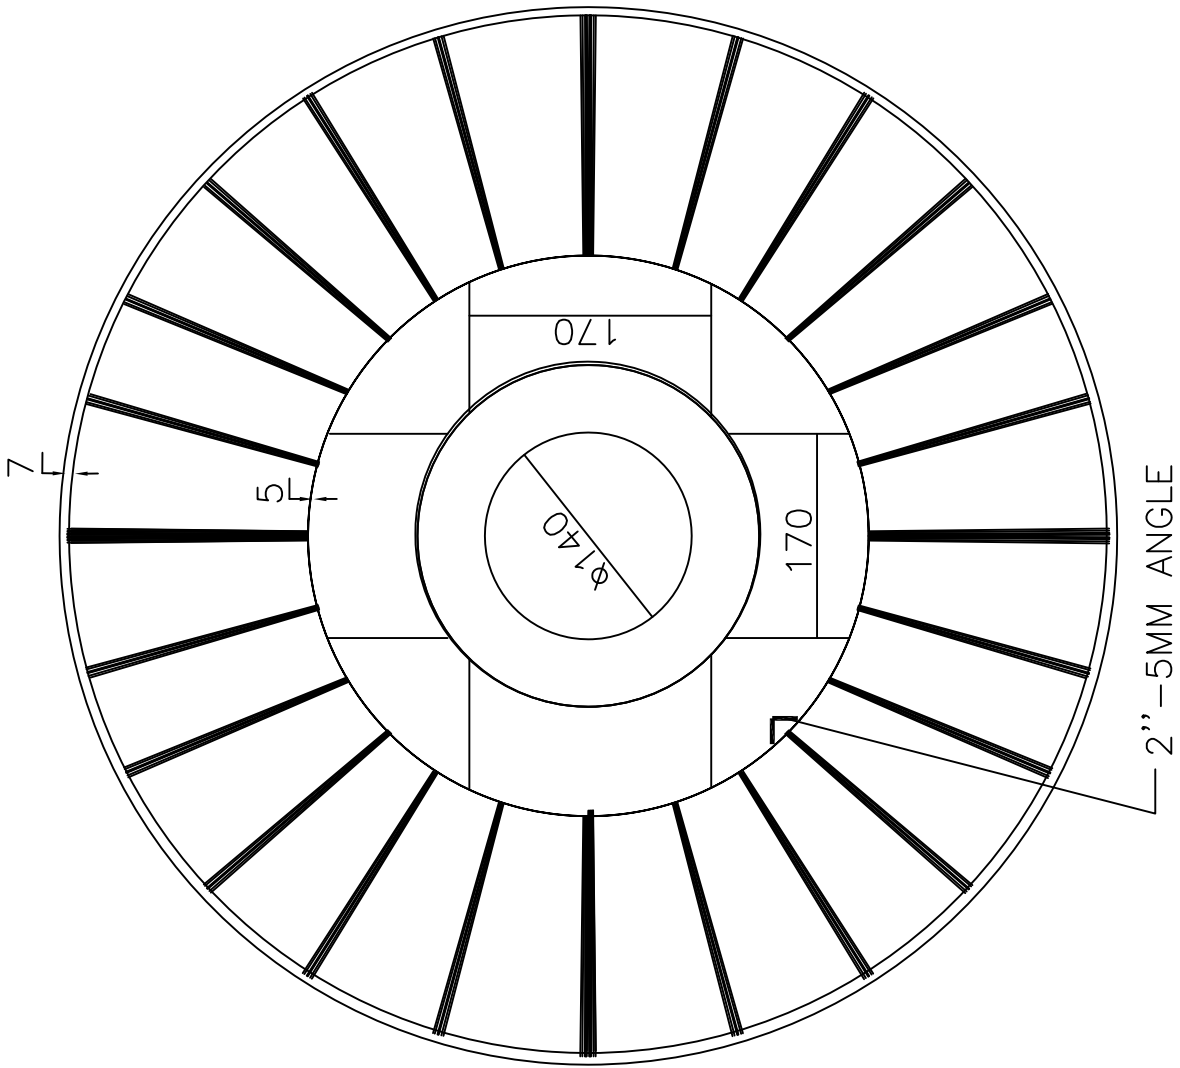

DIMENSION in mm



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- XXX-507-E001A

VOLUME II

SECTION II

REVISION 00

DATE: 10.05.2016

SHEET -

ANNEXURE-II

QUALITY PLAN

		STANDARD QUALITY PLAN				CUSTOMER :		PROJECT:		SPECIFICATION		
						BIDDER/ :		TITLE		NUMBER :		
		SHEET 1 OF 11		VENDOR		SYSTEM		QUALITY PLAN NUMBER: PE-QP-999-507-E001A, R0		SPECIFICATION : TITLE		
SL. NO.	COMPONENT/ OPERATION	CHARACTERISTIC CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	SECTION			VOLUME III
									P	W	V	REMARKS
1	2	3	4	5	6	7	8	9	10			11
Instructions: 1. Cable manufacturer to maintain records to show co-relation of raw materials to finished cables i.e. raw material batch/ lot no. should be traceable to the final cable drum number or batch no. 2. Cable manufacturer to maintain all quality records identified as per all QP stages enumerated below whether it is identified for BHEL verification or witness or not.												
1.0	RAW MATERIALS & BOUGHT OUT ITEMS											
1.1	Aluminium Rods (Conductor/ Armour Wire)	GENERAL : 1. Physical properties 2. Elec.Properties SPECIFIC CHECKS : a) Make b) Grade c) Resistivity	MA	Physical Tests	Sample/ Batch	IS:7098-II,IS: 5082, IS:5484, IS:8130 & Appd Datasheet	IS:7098-II,IS: 5082, IS:5484, IS:8130 & Appd Datasheet	Inpection Report/ Test Cert.	2/3	-	1/2	
			MA	Electrical Tests	Sample/ Batch	-do-	-do-	-do-	2/3	-	1/2	
			MA	Verify	100%	Manufacturer approved source	Manufacturer approved source	COC/ Test Cert.	2/3	-	1	
			MA	-do-	-do-	IS 8130, IS 5082/ Approved datasheet	IS 8130, IS 5082/ Approved datasheet	-do-	2/3	-	1	
			MA	Electrical Tests	Manufacturer std.	IS 8130, IS 5082	IS 8130, IS 5082	-do-	2/3	-	1	
1.2	XLPE Compound for insulation	GENERAL : 1. Physical properties 2. Elec.Properties SPECIFIC CHECKS : a) Make b) Type/ Grade c) Shelf life/ Storage condition	MA	Physical Tests	Sample/ Batch	IS 7098-II & Mfs Std./ Approved datasheet	IS 7098-II & Mfs Std./ Approved datasheet	Inpection Repor/ Test Cert.	2/3	-	1/2	
			MA	Electrical Tests	Sample/ Batch	-do-	-do-	-do-	2/3	-	1/2	
			MA	Verify	100%	Manufacturer approved source	Manufacturer approved source	COC/ Test Cert.	2/3	-	1	
			MA	-do-	-do-	Approved datasheet	Approved datasheet	-do-	2/3	-	1	
			MA	-do-	-do-	Compound Manufacturer std.	Compound Manufacturer std.	-do-	2/3	-	1	
BHEL			PARTICULARS			BIDDER/VENDOR						
			NAME									
			SIGNATURE									
			DATE						BIDDER'S/VENDORS COMPANY SEAL			

		STANDARD QUALITY PLAN		CUSTOMER :		PROJECT:			SPECIFICATION			
				BIDDER/ :		TITLE			NUMBER :			
		SHEET 2 OF 11		VENDOR		QUALITY PLAN			SPECIFICATION :			
		SYSTEM		NUMBER: PE-QP-999-507-E001A, R0			TITLE			SECTION		
				ITEM : HT XLPE Power Cables						VOLUME III		
SL. NO.	COMPONENT/ OPERATION	CHARACTERISTIC CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	P	W	V	REMARKS
1	2	3	4	5	6	7	8	9	10			11
1.3	Semi Conducting Compound	GENERAL : 1. Physical properties SPECIFIC CHECKS : 1. Make 2. Type/ Grade 3. Shelf life/ Storage condition	MA	Physical Tests	Sample/ Batch	IS 7098-II & Mfs Std./ Approved datasheet	IS 7098-II & Mfs Std./ Approved datasheet	Inpection Report/ Test Cert.	2/3	-	1/2	(Fillers material chosen shall be compatible with the temerature rating of the cable and shall have no deleterious effect on any other componenet of the cable)
			MA	Verify	100%	Manufacturer approved source	Manufacturer approved source	COC/ Test Cert.	2/3	-	1	
			MA	-do-	-do-	Approved datasheet	Approved datasheet	-do-	2/3	-	1	
			MA	-do-	-do-	Compound Manufacturer std.	Compound Manufacturer std.	-do-	2/3	-	1	
1.4	Copper Tape	GENERAL : 1. Physical properties 2. Elec.Properties 3. Dimension SPECIFIC CHECKS : 1. Resistivity	MA	Physical Tests	Sample/ Batch	IS 7098-II, IS 1897, IS 613 & Mfr. Std./ Approved datasheet	IS 7098-II, IS 1897, IS 613 & Mfr. Std./ Approved datasheet	Inpection Report/ Test Cert.	2/3	-	1/2	
			MA	Electrical Tests	Sample/ Batch	-do-	-do-	-do-	2/3	-	1/2	
			MA	Measurement	-do-	-do-	-do-	-do-	2/3	-	2	
			MA	Electrical Tests	Manufacturer std.	IS 613	IS 613	-do-	3/2	-	1	
1.5	Fillers (as applicable)	1. Make 2. Type/ Grade	MA	Verify	100%	Manufacturer approved source	Manufacturer approved source	COC/ Test Cert.	2/3	-	1	
			MA	-do-	-do-	Approved datasheet	Approved datasheet	-do-	2/3	-	1	
1.6	PVC Compound (for sheath)	GENERAL : 1. Physical properties 2. Elec.Properties 3. FRLS Properties (as applicable)	MA	Physical Tests	Sample/ Batch	IS 7098-II, IS 5831& Mfr. Std./ Approved datasheet	IS 7098-II, IS 5831& Mfr. Std./ Approved datasheet	Inpection Report/ Test Cert.	2/3	-	1/2	
			MA	Electrical Tests	Sample/ Batch	-do-	-do-	-do-	2/3	-	1/2	
			CR	Chemical/ Environ.	Sample/ Batch	-do-	-do-	-do-	2/3	-	1/2	
BHEL			PARTICULARS		BIDDER/VENDOR							
			NAME									
			SIGNATURE									
			DATE					BIDDER'S/VENDORS COMPANY SEAL				

		STANDARD QUALITY PLAN		CUSTOMER :		PROJECT: TITLE			SPECIFICATION NUMBER :			
				BIDDER/ : VENDOR		QUALITY PLAN NUMBER: PE-QP-999-507-E001A, R0			SPECIFICATION : TITLE			
		SHEET 3 OF 11		SYSTEM		ITEM : HT XLPE Power Cables			SECTION		VOLUME III	
SL. NO.	COMPONENT/ OPERATION	CHARACTERISTIC CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	P	W	V	REMARKS
1	2	3	4	5	6	7	8	9	10			11
1.7	Galvanised steel wire/strip for Armour (as applicable)	SPECIFIC CHECKS :										
		a) Make	MA	Verify	100%	Manufacturer approved source	Manufacturer approved source	COC/ Test Cert.	2/3	-	1	* Sample from each armour size/ Batch / Lot
		b) Type/ Grade	MA	-do-	-do-	Approved datasheet	Approved datasheet	-do-	2/3	-	1	
		c) Shelf life/ Storage condition	MA	-do-	-do-	Compound Manufacturer std.	Compound Manufacturer std.	-do-	2/3	-	1	
GENERAL :												
	1. Make	MA	Verify	Manufacturer std.	Manufacturer approved source	Manufacturer approved source	Inspection Report/ Test Cert.	2/3	-	1		
	2. Dimension	MA	Measurement	-do-	IS 7098-II, IS 3975 & Approved datasheet	IS 7098-II, IS 3975 & Approved datasheet	-do-	2/3	-	2		
	3. Phy.and Elec. Properties	MA	Physical & Electrical Tests	Sample*	-do-	-do-	-do-	2/3	-	2		
	4.Galvanization Quality	MA	Galv.Tests	-do-	IS 3975 & Mfr. Std.	IS 3975 & Mfr. Std.	-do-	2/3	-	2		
1.8	Steel Drum	1. Dimension	MA	Meas.	Mfr's Plant Std.	Approved drawing of steel drum / BHEL specification	Approved drawing of steel drum / BHEL specification	Inspection Report/ Test Cert.	2/3	-	1	
		2. Surface finish	MA	Meas.	-do-	Surface shall be smooth	Surface shall be smooth	-do-	2/3		1	
BHEL			PARTICULARS		BIDDER/VENDOR							
			NAME									
			SIGNATURE									
			DATE					BIDDER'S/VENDORS COMPANY SEAL				

		STANDARD QUALITY PLAN		CUSTOMER :		PROJECT TITLE		SPECIFICATION : NUMBER :				
				BIDDER/ VENDOR :		QUALITY PLAN NUMBER: PE-QP-999-507-E001A, R0		SPECIFICATION : TITLE				
		SHEET 4 OF 11		SYSTEM		ITEM : HT XLPE Power Cables		SECTION		VOLUME III		
SL. NO.	COMPONENT/OPERATION	CHARACTERISTIC CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	P	W	V	REMARKS
1	2	3	4	5	6	7	8	9	10			11
2.0	<u>IN PROCESS</u>											
2.1	Wire Drawing	1. Size	MA	Dimensional	Plant Mfg. Std.	IS 8130 & Appd. Datasheet	IS 8130 & Appd. Datasheet	Inpection Report	2	-	1	
		2. Surface finish	MA	Visual	-do-	Surface shall be smooth	Surface shall be smooth	-do-	2	-	1	
		3. % of Elongation	MA	Mechanical	-do-	IS 8130 & Appd. Datasheet	IS 8130 & Appd. Datasheet	-do-	2	-	1	
2.2	Stranding of wires	1. No. of wires	MA	Counting	Plant Mfg. Std.	IS 8130 & Appd. Datasheet	IS 8130 & Appd. Datasheet	Inpection Report	2	-	-	
		2. Resistance	CR	Electrical	-do-	-do-	-do-	-do-	2	-	-	
		3. Sequence, lay length & Direction	MA	Visual, Meas.	One Sample of each size/ lot	Mfrs Std. / Appd. Datasheet	Mfrs Std. / Appd. Datasheet	-do-	2	-	-	
		4. Surface Finish	MA	Visual	100%	Surface shall be smooth	Surface shall be smooth	-do-	2	-	-	
		5. Dimension	MA	Measurement	One Sample of each size/ lot	IS 8130 & Appd. Datasheet	IS 8130 & Appd. Datasheet	-do-	2	-	-	
2.3	Conductor Screening	1. Surface Finish	MA	Visual	100%	Surface shall be smooth	Surface shall be smooth	Inpection Report	2	-	-	
		2. Radial Thickness	CR	Mechanical	One Sample of each size/ lot	IS 7098-II & Appd. Datasheet	IS 7098-II & Appd. Datasheet	-do-	2	-	-	
2.4	Core Insulation (XLPE) (No repair permitted)	1. Surface finish	MA	Visual	100%	Free from bulging, burnt particles, lumps, cuts & scratches	Free from bulging, burnt particles, lumps, cuts & scratches	Inpection Report	2	-	1	
		2. Eccentricity & Ovality #	CR	Measurement	One Sample of each size/ lot	IS 7098-II & Appd. Datasheet	IS 7098-II & Appd. Datasheet	-do-	2	-	1	# To be checked at starting & finished end of extruded length.
		3. Insulation Thickness	CR	Measurement	-do-	-do-	-do-	-do-	2	-	-	
		4. Dia over insulation	MA	Measurement	-do-	-do-	-do-	-do-	2	-	-	
		5. Tensile Strength & % Elongation	MA	Mechanical	100%	-do-	-do-	-do-	2	-	-	
BHEL			PARTICULARS		BIDDER/VENDOR							
			NAME									
			SIGNATURE									
			DATE					BIDDER'S/VENDORS COMPANY SEAL				

		STANDARD QUALITY PLAN		CUSTOMER :		PROJECT TITLE		SPECIFICATION : NUMBER :					
				BIDDER/ VENDOR :		QUALITY PLAN NUMBER: PE-QP-999-507-E001A, R0		SPECIFICATION : TITLE					
		SHEET 5 OF 11		SYSTEM		ITEM : HT XLPE Power Cables		SECTION		VOLUME III			
SL. NO.	COMPONENT/OPERATION	CHARACTERISTIC CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY			REMARKS	
1	2	3	4	5	6	7	8	9	10	P	W	V	11
2.5	Insulation Screening	<u>NON METTALIC</u> 1. Surface finish 2. Thickness <u>METALLIC</u> 1. Dimension of tape 2. Overlap of Tape Band 3. Tightness of Tape	MA CR CR MA MA	Visual Measurement Measurement -do- Visual	100% One Sample of each size/ lot One Sample of each size/ lot -do- -do-	Surface shall be smooth IS 7098-II & Appd. Datasheet Mfrs Std. / Appd. datasheet -do- Mfs Std.	Surface shall be smooth IS 7098-II & Appd. Datasheet Mfrs Std. / Appd. datasheet -do- Mfs Std.	Inpection Report -do- Inpection Report -do- -do-	2 2 2 2 2	- - - - -	- - - - -	(Pimple, fish eye, porosity & burnt particles not permitted.)	
2.6	Core Laying	1. Dia over laid up core 2. Sequence of lay & direction 3. Lay Length	MA MA MA	Measurement Visual & Meas. Measurement	One Sample of each size/ lot -do- -do-	IS 7098-II & Appd. Datasheet IS 7098-II & Mfr. Std. -do-	IS 7098-II & Appd. Datasheet IS 7098-II & Mfr. Std. -do-	Inpection Report -do- -do-	2 2 2	- - -	- - -		
2.7	InnerSheath Extrusion (as applicable)	1. Surface finish 2. Thickness 3. Dia over inner sheath	MA CR MA	Visual Measurement -do-	100% One Sample of each size/ lot -do-	Surface shall be smooth IS 7098-II & Appd. Datasheet -do-	Surface shall be smooth IS 7098-II & Appd. Datasheet -do-	Inpection Report -do- -do-	2 2 2	- - -	- - -		
2.8	Armour(as applicable)	1. No.of wires/Strips 2. Lay length & Direction 3. Dia over armouring 4. Coverage	MA MA MA MA	Counting Visual & Meas. Measurement Measurement	At the start of the process -do- -do- -do-	IS 7098-II & Appd. Datasheet IS 7098-II & Mfr. Std. IS 7098-II & Appd. Datasheet -do-	IS 7098-II & Appd. Datasheet IS 7098-II & Mfr. Std. IS 7098-II & Appd. Datasheet -do-	Inpection Report -do- -do- -do-	2 2 2 2	- - - -	- - - -		
BHEL			PARTICULARS			BIDDER/VENDOR							
			NAME										
			SIGNATURE										
			DATE						BIDDER'S/VENDORS COMPANY SEAL				

			STANDARD QUALITY PLAN			CUSTOMER :		PROJECT TITLE		SPECIFICATION : NUMBER :			
						BIDDER/ : VENDOR		QUALITY PLAN NUMBER: PE-QP-999-507-E001A, R0		SPECIFICATION : TITLE			
			SHEET 6 OF 11			SYSTEM			ITEM : HT XLPE Power Cables		SECTION		VOLUME III
SL. NO.	COMPONENT/OPERATION		CHARACTERISTIC CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	P	W	V	REMARKS
1	2		3	4	5	6	7	8	9	10			11
2.9	Outer Sheath Extrusion (No repair permitted)		1. Surface finish 2. Sheath Thickness 3. Dia over outer sheath 4. Embossing/ Sequential Marking	MA CR MA MA	Visual Measurement -do- Visual	100% One Sample of each size/ lot -do- 100%	Surface shall be smooth IS 7098-II & Appd. Datasheet -do- Approved data sheet	Surface shall be smooth IS 7098-II & Appd. Datasheet -do- Approved data sheet	Inspection Report -do- -do-	2 2 2 2	- - - -	- - - -	(Pimple, fish eye, porosity & burnt particles not permitted.)
3.0	Finished Cable (INTERNAL)		1. Routine Test (Refer Note-F)	CR	Electrical Tests & Measurement	100%	IS 7098-II & Appd. Datasheet	IS 7098-II & Appd. Datasheet	Test Report	2	-	1	
4.0	Final Inspection (EXTERNAL)		1. Finish 2. Length 3. Dimension 4. Armouring - Coverage No.of Wires/Strips	MA MA MA MA	Visual Measurement -do- Visual & Meas.	One drum in each Lot -do- As per IS -do-	IS 7098-II & Appd. Datasheet -do- -do- -do-	Free from Porosity, Bulging, Burnt particles,lumps, cuts & Approved Data Sheet -do- -do- -do-	Test Report -do- -do- -do-	2 2 2 2	1 1 1 1	- - - -	
BHEL			PARTICULARS			BIDDER/ VENDOR							
			NAME										
			SIGNATURE										
			DATE						BIDDER'S/VENDORS COMPANY SEAL				

		STANDARD QUALITY PLAN		CUSTOMER :			PROJECT TITLE			SPECIFICATION : NUMBER :			
				BIDDER/ VENDOR			QUALITY PLAN NUMBER: PE-QP-999-507-E001A, R0			SPECIFICATION : TITLE			
		SHEET 7 OF 11		SYSTEM			ITEM : HT XLPE Power Cables			SECTION VOLUME III			
SL. NO.	COMPONENT/OPERATION	CHARACTERISTIC CHECK	CAT.	TYPE/ METHOD OF CHECK	EXTENT OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORM	FORMAT OF RECORD	AGENCY			REMARKS	
1	2	3	4	5	6	7	8	9	10	P	W	V	11
5.0	Packing	5. Marking & Colour Coding	MA	Visual	As per IS	-do-	Approved Data Sheet	-do-	2	1	-	# Refer Annexure to QAP enclsosed	
		6. Acceptance Tests (Refer Note-F)	CR	Phy, Elect. Tests FRLS Tests	-do-	-do-	-do-	-do-	2	1	-		
		7. Type Tests (Refer Note-F)	CR	Physical & Electrical Tests	Sample #	-do-	-do-	-do-	2	1	-		
		Sealing Identification	MA	Visual	100%	As per IS	As per IS	-do-	2	1	-		
NOTES:- (A) JOINTS IN WIRE SHALL BE AS PERMITTED BY IS / BHEL SPECIFICATION, VENDOR TO CERTIFY THE SAME. (B) NO REPAIR OF CORE INSULATION PERMITTED (C) RECORD OF RAW MATERIAL, PROCESS & ALL STAGES SHALL BE CERTIFIED BY VENDORS QC. AND ARE LIABLE TO AUDIT CHECK BY PURCHASER. (D) FILLERS/DUMMY CORES ETC. SHALL BE AS PER APPROVED DATA SHEET (E) VENDOR SHALL FURNISH COMPLIANCE CERTIFICATE TO THE INSPECTION AGENCY CONFIRMING THE PACKING AS PER BHEL SPECIFICATION. (F) FOR LIST OF ROUTINE, TYPE & ACCEPTANCE TESTS, REFER ANNEXURE TO QAP ENCLOSED.													
LEGEND : P : PERFORMER W: WITNESSER V: VERIFIER 1- BHEL 2-VENDOR 3- SUB VENDOR CHP:CUSTOMER HOLD POINT WHICH WILL BE DECIDED AT CONTRACT STAGE													
BHEL			PARTICULARS			BIDDER/ VENDOR			BIDDER'S/VENDORS COMPANY SEAL				
			NAME										
			SIGNATURE										
			DATE										

TYPE/ ACCEPTANCE/ ROUTINE TEST REQUIREMENTS**A. Type Test Conduction:**

- Tests for which "T" is indicated in the 'Test Conduction Required As' column below shall be conducted as Type Test.
- Sampling:
 - Type test to be conducted on 1 drum for every 10 drums or less of each type and size of cable/ lot.
 - Electrical tests to be conducted on one drum of every size & voltage grade of cables.
 - FRLS test & Flammability Test to be conducted on every size & voltage grade of cables. Sampling quantity as per appendix –D of IS 7098-2, D2.2.

B. Acceptance Test Conduction:

- Tests for which "A" is indicated in the 'Test Conduction Required As' column below shall be conducted as Acceptance tests.
- Sampling:
 - Acceptance tests shall be as per 1 drum for every 10 drums or less of each type and size of cable/ lot.
 - FRLS test & Flammability Test to be conducted on every size & voltage grade of cables. Sampling quantity as per appendix –D of IS 7098-2, D2.2.

C. Routine Test Conduction:

- Tests for which "R" is indicated in the 'Test Conduction Required As' column below shall be conducted as Routine tests.
- Sampling: Routine tests shall be conducted on 100% cable drums.

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
1.0	Tests for Conductor				
I.	Annealing test	For copper conductor only	T, A	IS 10810 Pt 1	<i><u>Internal in process Test Report to be furnished for acceptance test</u></i>
II.	Tensile test	For aluminium conductor only (Not applicable for compacted circular or shaped conductor)	T, A	IS 10810 Pt 2	
III.	Wrapping test	For aluminium conductor only (Not applicable for compacted circular or shaped conductor)	T, A	IS 10810 Pt 3	
IV.	Resistance test	For Al/Cu	T, A, R	IS 10810 Pt 5	
2.0	Tests for Armour Wires/Strips				
I.	Measurement of dimensions	Applicable for Aluminium wire & GS wire/Strip	T,A	IS 10810 Pt 36	
II.	Tensile test	Applicable for Aluminium wire & GS wire/Strip	T, A	IS 10810 Pt 37	
III.	Elongation at break test	Applicable for GS wire/Strip only	T, A	IS 10810 Pt 37	

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
IV.	Torsion test	For GS round wire only	T, A	IS 10810 Pt 38	
V.	Winding test	For GS strip only	T, A	IS 10810 Pt 39	
VI.	Resistivity test	Applicable for Aluminium wire & GS wire	T, A	IS 10810 Pt 42	
VII.	Uniformity of Zinc coating test	For G. S. wires/Strip only	T, A	IS 10810 Pt 40	
VIII.	Mass of Zinc coating test	For G. S. wires/Strip only	T, A	IS 10810 Pt 41	
IX.	Wrapping Test	For Aluminium wires only	T, A	IS 10810 Pt 3	
3.0	Physical Tests for XLPE Insulation & PVC sheath				
I.	Test for thickness & Eccentricity	Applicable for XLPE insulation, PVC inner sheath & For PVC inner/outer sheath only	T, A	IS 10810 Pt 6	
II.	Tensile strength and elongation test at break	Applicable for XLPE insulation & For PVC inner/outer sheath only			
(a)	Before ageing		T, A	IS 10810 Pt 7	
(b)	After ageing		T, A	IS 10810 Pt 7	
III.	Ageing in air oven	Applicable for XLPE insulation & For PVC inner/outer sheath only	T	IS 10810 Pt 11	
IV.	Loss of mass in air oven test	For PVC inner/outer sheath only	T	IS 10810 Pt 10	
V.	Hot deformation test	For PVC inner/outer sheath only	T	IS 10810 Pt 15	
VI.	Heat shock test	For PVC inner/outer sheath only	T	IS 10810 Pt 14	
VII.	Shrinkage test	For XLPE insulation & For PVC inner/outer sheath only	T	IS 10810 Pt 12	
VIII.	Thermal stability test	For PVC inner/outer sheath only	T	IS 10810 Pt 60	
IX.	Hot set test	For XLPE insulation only	T, A	IS 10810 Pt 30	
X.	Water absorption (gravimetric) test	For XLPE insulation only	T	IS 10810 Pt 33	
XI.	Degree of cross-linking	For XLPE insulation only	T	IS 7098-II	
4.0	Tests On Extruded Semi-conducting Screen				
I.	Test for Strippability	Applicable for Semi-conducting Strippable screen	T	IS 7098-II	Not applicable since it is bonded type
II.	Volume Resistivity	Applicable for Semi-conducting Strippable screen	T	IS 7098-II	
III.	Test for cross linking		A	IS 7098-II	
5.0	Improved Fire performance (FR-LSH) Tests				
I.	Oxygen index test	For inner/outer sheath only	T, A	IS 10810 Pt 58 / ASTM D 2863	Sample shall be as per IS 7098, Part 2
II.	Smoke density test	For inner/outer sheath only	T, A	ASTM D 2843	
III.	Acid gas generation test	For inner/outer sheath only	T, A	IS 10810 Pt 59 / IEC-754-1	
IV.	Temperature Index Test	For inner/outer sheath only	T, A	IS 10810 Pt 64 / ASTM D 2863	

S. No.	TEST	APPLICABLE FOR	TEST CONDUCTION REQUIRED AS	REFERENCE STANDARD	REMARKS
6.0	Flammability Tests				
I.	Flammability test for bunched cables	For complete cable	T,A	IEC-60332 (Part-3)	
II.	Flammability test for single cable	For complete cable	T,A	IEC:60332 Part-1	
III.	Swedish chimney test	For complete cable	A	SEN SS 424 1475 (Class F3)	
IV.	Flammability test	For complete cable	A	IEEE: 60383	
7.0	Electrical Tests				
I.	High Voltage Test	For complete cable	T, A, R	IS 10810 Pt 45	
II.	Insulation Resistance Test (Volume resistivity method)	For complete cable	T, A	IS 10810 Pt 43	
III.	Partial discharge test (shall be carried out on full drum length)		T,A,R	IS 10810 Pt 46	
IV.	Bending Test followed by Partial Discharge test		T	IS 10810 Pt 50	
V.	Dielectric Power Factor Test (i) As a function of voltage (ii) As a function of temperature		T	IS 10810 Pt 48	
VI.	Heat Cycle Test		T	IS 10810 Pt 49	
VII.	Impulse Withstand Test		T	IS 10810 Pt 47	
VIII.	Thermal ageing test	For complete cable	T	IS 7098-II	
IX.	Flammability Test	For PVC sheathed cable	T	IS 10810 Pt 53	
8.0	Anti-rodent and Termite Repulsion test	For PVC inner/outer sheath only	T	--	