

TTTD-106-1 Rev No. 5 Form No.		PROJECT ENGINEERING & SYSTEM DIVISION BHEL, HYDERABAD –32.			PY51393													
					Rev No. 00													
					Page 1 of 7													
<u>TECHNICAL SPECIFICATION</u> <u>FOR FIRE HOSE WITH COUPLING</u>																		
<table border="1"> <tr> <td rowspan="2"> Revisions : </td> <td> Prepared by: </td> <td> Checked by: </td> <td> Approved By: </td> <td rowspan="2"> Date </td> </tr> <tr> <td> -SD- </td> <td> -SD- </td> <td> -SD- </td> </tr> <tr> <td> 00 </td> <td> Anupam </td> <td> Amit/PCS </td> <td> MNSR </td> <td> 27.07.18 </td> </tr> </table>						Revisions :	Prepared by:	Checked by:	Approved By:	Date	-SD-	-SD-	-SD-	00	Anupam	Amit/PCS	MNSR	27.07.18
Revisions :	Prepared by:	Checked by:	Approved By:	Date														
	-SD-	-SD-	-SD-															
00	Anupam	Amit/PCS	MNSR	27.07.18														

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED,
It must not be used directly or indirectly in any way detrimental to the interest of the company.

TD-106-2 Rev.No. 5 Form No.		PROJECT ENGINEERING & SYSTEM DIVISION BHEL, HYDERABAD –32.	PY51393
			Rev No. 00
			Page 2 of 7

COPYRIGHT AND CONFIDENTIAL
 The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
 It must not be used directly or indirectly in any way detrimental to the interest of the company.

1. SCOPE/INTENT:

1.1. This specification covers the technical requirements of constructional features, accessories, inspection, tests, test certificates, documentation, preservation, packing and forwarding of Fire Hose with coupling.

1.2. Scope of supply shall include design, manufacture, inspection, shop testing, shop painting, packing and delivery.

1.3. The supplier shall strictly comply with this standard in all respects. No deviation shall be allowed. However, bidder can raise technical queries on the specification during pre-bid stage and clarifications may be sought from BHEL before the bid submission.

APPLICATION:
 These items suitable for fire protection systems (Water based protection system).

2. VARIANT TABLE:

Var. No.	Description	Material Code
01	25M FIRE HOSE WITH COUPLING (UL LISTED)	PY9751393019
02	15M FIRE HOSE WITH COUPLING (UL LISTED)	PY9751393027
03	7.5M FIRE HOSE WITH COUPLING (UL LISTED)	PY9751393035
04	15M FIRE HOSE WITH COUPLING (IS636-A-II)	PY9751393043
05	7.5M FIRE HOSE WITH COUPLING (IS636-A-II)	PY9751393051
06	15M FIRE HOSE WITH COUPLING (IS 636-B)	PY9751393060
07	7.5M FIRE HOSE WITH COUPLING (IS 636-B)	PY9751393078

Note: Bidder to quote as per Material Code as mentioned in the Enquiry

3. TECHNICAL REQUIREMENTS:

3.1. FIRE HOSE WITH COUPLING (UL LISTED):

Sl. No.	Requirements	Compliance
	FIRE HOSE	
3.1	Application	Hydrant System
3.2	Code/Standard	BS 6391:2009 Type I
3.3	Size & Length*	
3.3.1		63 mm x 25 Meter length
3.3.2		63 mm x 15 Meter length
3.3.3		63 mm x 7.5 Meter length
3.4	Type of Hose	RRL flexible hose
3.5	Working Pressure	14 kg/cm ² (g)

TD-106-2 Rev.No. 5 Form No.		PROJECT ENGINEERING & SYSTEM DIVISION BHEL, HYDERABAD –32.	PY51393
			Rev No. 00
			Page 3 of 7

COPYRIGHT AND CONFIDENTIAL
 The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
 It must not be used directly or indirectly in any way detrimental to the interest of the company.

3.6	Test Pressure	22 kg/cm ² (g)
3.7	Burst Pressure	40 kg/cm ² (g)
3.8	End Fitting / Material	Instantaneous spring lock type male / female coupling of SS 304 construction at both sides confirming to BS 336
3.9	Type of Coupling	SS (304) Instantaneous Spring type BS 336 Marked Coupling
3.10	Approval	UL Listed
3.11	Marking	a) Type of the hose b) Size of the hose c) Length of the hose d) Manufacturer's name or trade-mark or both e) Month and year of manufacture.
COUPLING		
3.12	Type	Instantaneous Spring lock type male and female for 63 MM hose
3.13	Code/Standard	BS 336 Marked Coupling
3.14	Material of Construction	SS 304

3.2. FIRE HOSE WITH COUPLING AS PER IS 636 TYPE A

Sl. No.	Requirements	Compliance
FIRE HOSE		
3.1	Application	Hydrant System
3.2	Code/Standard	IS: 636, Type-A (Type-II)
3.3	Size & Length*	
3.3.1		63 mm x 15 Meter length
3.3.2		63 mm x 7.5 Meter length
3.4	Type of Hose	RRL confirming to IS: 636, Type-A with elastomeric coating
3.5	Working Pressure	14 kg/cm ² (g)
3.6	Test Pressure	22 kg/cm ² (g)
3.7	Burst Pressure	40 kg/cm ² (g)
3.8	End Fitting / Material	Instantaneous spring lock type male / female coupling of SS-304 construction at both sides confirming to IS: 903
3.9	Type of Coupling	SS-304 instantaneous type IS: 903 marked coupling
3.10	Approval	BIS approved
3.11	Marking	a) Type of the hose b) Size of the hose

Ref.
Doc

TD-106-2 Rev.No. 5 Form No.		PROJECT ENGINEERING & SYSTEM DIVISION BHEL, HYDERABAD –32.	PY51393
			Rev No. 00
			Page 4 of 7

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED.
It must not be used directly or indirectly in any way detrimental to the interest of the company.

		c) Length of the hose d) Manufacturer's name or trade-mark or both e) Month and year of manufacture.
	COUPLING	
3.12	Type	Instantaneous Spring lock type male and female for 63 MM hose
3.13	Code/Standard	IS:903
3.14	Material of Construction	SS 304

3.3. FIRE HOSE WITH COUPLING AS PER IS 636 TYPE B

Sl. No.	Requirements	Compliance
	FIRE HOSE	
3.1	Application	Hydrant System
3.2	Code/Standard	IS: 636, Type-B
3.3	Size & Length*	
3.3.1		63 mm x 15 Meter length
3.3.2		63 mm x 7.5 Meter length
3.4	Type of Hose	RRL confirming to IS: 636, Type-B with elastomeric coating
3.5	Working Pressure	14 kg/cm ² (g)
3.6	Test Pressure	22 kg/cm ² (g)
3.7	Burst Pressure	40 kg/cm ² (g)
3.8	End Fitting / Material	Instantaneous spring lock type male / female coupling of SS-304 construction at both sides confirming to IS: 903
3.9	Type of Coupling	SS-304 instantaneous type IS: 903 marked coupling
3.10	Approval	BIS approved
3.11	Marking	a) Type of the hose b) Size of the hose c) Length of the hose d) Manufacturer's name or trade-mark or both e) Month and year of manufacture.
	COUPLING	
3.12	Type	Instantaneous Spring lock type male and female for 63 MM hose
3.13	Code/Standard	IS:903
3.14	Material of Construction	SS 304

***Size & Length of Fire Hose shall be as per Description mentioned in the Enquiry.**

Ref.
Doc

TD-106-2 Rev.No. 5 Form No.		PROJECT ENGINEERING & SYSTEM DIVISION BHEL, HYDERABAD –32.	PY51393									
			Rev No. 00									
			Page 5 of 7									
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.	4. PAINTING Color of the Hose shall be informed after post order. 5. INSPECTION AND TESTING As per BHEL QAP (Refer attached Annexure) 6. DOCUMENTATION: 6.1. Along with the offer: Signed and stamped copy of this specification as token of acceptance of the specification for execution in the event of Order. 6.2. After PO Placement: Two copies each of the following documents shall be submitted for approval. • G.A. Drawings with weights and dimensions • Technical Data sheets, Catalogue • Material specification details • Tests to be conducted • O&M manuals • Storage/Preservation instructions for at least three years. Final documentation consisting of above documents shall be submitted in requisite sets (to be decided post order) of hard and soft copies. Schedule for document submissions: <table border="1"> <thead> <tr> <th>S.no</th> <th>Description</th> <th>Schedule</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Submission of GA drawing & Technical Datasheet by vendor</td> <td>7 days from the date of P.O.</td> </tr> <tr> <td>2</td> <td>Approval GA drawing & Technical Datasheet by BHEL</td> <td>14 days from receipt of the document*</td> </tr> </tbody> </table> * The GA drawing & Technical Datasheet submitted by vendor shall be strictly in compliance to all applicable standards and specification.			S.no	Description	Schedule	1	Submission of GA drawing & Technical Datasheet by vendor	7 days from the date of P.O.	2	Approval GA drawing & Technical Datasheet by BHEL	14 days from receipt of the document*
	S.no	Description	Schedule									
1	Submission of GA drawing & Technical Datasheet by vendor	7 days from the date of P.O.										
2	Approval GA drawing & Technical Datasheet by BHEL	14 days from receipt of the document*										
Ref. Doc												

TD-106-2 Rev.No. 5	Form No.		PROJECT ENGINEERING & SYSTEM DIVISION BHEL, HYDERABAD –32.	PY51393 Rev No. 00 Page 6 of 7
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED. It must not be used directly or indirectly in any way detrimental to the interest of the company.		7. PRESERVATION, PACKING & MARKING OR PACKING CASE: 7.1. A suitable temporary rust preventive with minimum life of two years shall be applied inside the item/equipment body in order to prevent corrosion. 7.2. All the item / equipment shall be packed suitably in closed wooden cases in order to avoid damage during transit and storage at BHEL. Suitable supports shall be provided inside the cases in order to avoid internal movement. In case of exported consignments, the packing shall be seaworthy (Refer enclosed Annexure for Export Packing guidelines, AA 0490009, Rev-01). Each item / equipment after end protection should be wrapped in polythene sheet before packing in the cases. Each packing case must contain two copies of the shipping list giving details of all the contents of the case. 7.3. The following marking shall be done on each packing case minimum on two sides and at the top. (a) Complete address of the consignee and destination as per BHEL Purchase Order. (b) BHEL Purchase order Number (c) BHEL item Material Code (d) Number of pieces in each packing case (e) Net Weight (f) Gross Weight (g) Packing case number and total number of packing (h) Arrow indicating top of the packing case.		
Ref.	Doc			

TD-106-3 Rev.No. 5 Form No.		PRODUCT STANDARD BHEL, HYDERABAD –32. PROJECT ENGINEERING & SYSTEM DIVISION				PY51393	
						Rev No. 00	
						Page 7 of 7	
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED, It must not be used directly or indirectly in any way detrimental to the interest of the company.		RECORD OF REVISIONS					
	Rev. No.	Date	Revision Details	Revised By	Checked By	Approved By	
	00	27.07.2018	First Issue	-SD-	-SD-	-SD-	
	Ref. Doc.						



CORPORATE STANDARD

AA0490009

Rev. No. 01

PAGE 1 of 7

EXPORT PACKING

(PACKING INSTRUCTIONS FOR GENERAL COMPONENTS / ASSEMBLIES / EQUIPMENT)

1 GENERAL

This standard lays down packing instructions for export packing of components/assemblies/equipment to be dispatched against Customer's contracts, for which there are no special instructions issued by the Engineering Departments.

The components/assemblies need to be packed suitably to avoid physical damage & corrosion during transit for storage. For specific applications, the concerned engineering department shall issue a product standard. Reference of this standard, must appear in the Shipping list/Packing List.

2 SCOPE

This procedure gives minimum guidelines for export packing to be complied with for packing of components/assemblies/equipment. This packing shall be suitable for different handling operations and for the adverse conditions during transportation and during indoor / outdoor storage for periods more than one year.

3 WOOD SPECIFICATION FOR PACKING:

- The wood shall conform to specification AA51401.
- Ply Wood planks as per specification IS:303 Gr. "MR" Type A,B are used for the sides, top & bottom of the packing cases.
- Ply Wood of marine grade as per IS:710 for packing of control equipment and for support batten pinewood to be used as per specification AA51401.

4 TYPE OF PACKING:

The following types of packings have been standardized for packing of general components/assemblies.

4.1 Open Type:

Packing subjected to BHEL approval.

4.2 Closed packing cases:

- Export packing of the specific items requiring additional protection shall be covered with G.I. sheet covering as per customer/contractual/engineering requirements. G.I. shall conform to specification AA10166.
- Any other special or export seaworthy packing (improvement or equivalent to the above) shall be subjected to BHEL Engg & QC approval).

4.3 Special Packing

Components requiring special packing (as per customer/contractual/ engineering requirements) not included in this specification shall be covered by product standards.

5 TREATMENT OF WOOD AS PER ISPM-15

As per customer requirement for export packing, wood to be treated as per International Standards for Phytosanitary Measures ISPM:15.

Revisions:			APPROVED: PROCEDURAL GUIDELINES COMMITTEE – PGC (Packing)		
Rev. No. 01	Amd. No.	Reaffirmed	Prepared HEP, Bhopal	Issued Corp. R&D	Dt. of 1 st Issue 31-05-2018
Dt: 12-06-2018	Dt:	Year:			

**6 PREPARATION OF PACKING CASE:**

- 1) Export items are to be packed in sea worthy wooden/Ply board cases.
- 2) The base of the case shall be made of wooden battens for planks giving necessary reinforcement, such that the bottom of the equipment is at a height of 100 to 200mm from the ground level depending upon size & weight of equipment. However for packing cases of smaller size equipment can be at a height of 40mm from the ground level.
- 3) The four sides & top cover shall be lined, from inside with multi-layered cross-laminated polyethylene sheet of 90GSM as per AA51420 and tacked at suitable places.
Whenever specified the top cover will have a layer of multi-layered cross laminated polyethylene sheet of 90 GSM over the cover. This should project about 100 - 250mm on all sides.
It is preferable to have a single piece of the above Multi-layered cross laminated polyethylene sheet fixed on the four sides. In case jointing is unavoidable, it should be done by overlapping of approximately 100mm.
- 4) Put the job on the base and wherever necessary may be screwed / fastened.
- 5) In case of delicate component Packing Viz. Electrical & Electronic components for instruments/ assemblies, a rubber sheet, Self-expanded polyethene foam sheet as per AA51423, preferably 10mm thick, shall be fixed on to the base to act as cushioning to the equipment.
- 6) Place the Components/cartons with corrosion inhibitors duly applied wherever necessary for place suitably, thin muslin cloths bags containing 100grams (approx.) of activated Blue Silica Gel to AA55619, wherever necessary. Alternatively VCI Powder or Tablet may be used.
- 7) In case, depression is formed, at the top, after the equipment is lowered, provide ply board/wooden batons.
- 8) Whole Equipment shall be covered and sealed with Multi-layered cross-laminated Polyethylene sheet to AA51420.
- 9) For indoor panels/equipment, provide suitable packing batons with covering of Thermocole/ expanded soft polyethylene foam/polyethylene air bubble film wrapped with suitable cords, to avoid cutting of the polyethylene sheet so that finished surface is not damaged.
- 10) Empty space in the box shall be filled with adequate cushioning material e.g. Thermocole Chips, Wood Wool etc. to avoid movement for shocks. Alternatively put wooden blocks/batons wherever necessary.
- 11) The inner side of the top cover shall be lined with M.L.C. laminated polyethylene sheet of at least 90GSM, which shall project approximately 25 to 150mm depending upon the size of the case on all sides of the top cover shall be provided below the top cover. This projection, after nailing the top cover, shall be folded over, on the sides of the crates & tacked, to, prevent ingress of water from the top.
- 12) For specific applications requiring additional protection the packing cases are covered with GI sheet on outside for sides and top; inside for bottom as per specification AA10166, thickness of G.I. sheet shall be 0.25mm.
- 13) For specific applications requiring inspection, additional inspection window has to be provided for custom clearance for export jobs.

7 SEALED PACKING:

Components sub-assemblies and assemblies sensitive to climatic conditions shall be packed seal tight. All the openings of the sensitive components, sub-assemblies and assemblies shall be blanketed to prevent the ingress of dust and moisture.

The components sub-assemblies and assemblies are completely covered with 2 layers of M.L.C. laminated poly film. All sharp corners and edges are to be protected by rubber mats to prevent the polyethylene sheet from damage. Top surface of the case shall be free from dents to prevent rain water pockets.

Certain special precautions are required for seal tight packing of specific item have to be covered by product standard.



CORPORATE STANDARD

AA0490009

Rev. No. 01

PAGE 3 of 7

8 OTHER PACKING MATERIAL

8.1 Volatile Corrosion Inhibitor (VCI) Paper as per AA51406:

- a) Un-protected surfaces of steel and cast iron components, tools bearing, shaft seals etc. are covered with VCI paper. VCI paper has been impregnated with corrosion inhibitors which by evaporation and chemical conversion protect metals in an enclosed area against corrosion.
- b) 7m³ VCI paper is necessary for 1 m³ of packed item approximately as per AA51406.

Application Limitation:

VCI paper shall not be used for components made of aluminium, aluminium alloys as well as Zinc, copper, brass, cadmium and silver. VCI powder is sprinkled inside the piping components ends shall be protected with end cover as specified in plant standards, drawings.

8.2 Moisture Absorber:

Silica gel is used for this purpose to protect the contents over sufficiently long time from corrosion. At the time of use, silica gel should be so dried that its colour becomes dark blue. These shall be filled in small cotton bags. Before sealing the equipment, the silica gel bags should be kept inside the polyethylene film cover at different locations. The quantity of silica gel depends on the dimension of the polyethylene sheet as well as transit and storage time.

8.3 Sling Plate:

Sling plate shall be provided to prevent damage to the packing box during lifting. Size of the sling plate shall be selected depending upon the net weight of the consignment.

8.4 Packing Slip Holders:

Two nos. of packing list with suitable protecting cover shall be fixed one inside and the other outside of the packing box as per specification AA7240901.

8.5 Nails

The length and diameter of the nails depends upon the size of planks

8.6 Strapping Strips:

These are used for strapping the boxes. Suitable size of box strapping strip can be used as per size and weight of consignment. The material shall be free from rust.

8.7 Brackets:

These brackets are used for nailing to the corners of cubicle boxes. The brackets shall be of "L" shape, suitable holes shall be provided towards the end of each side for screwing /nailing.

8.8 Fasteners:

Bolts, double nuts, spring washers of suitable size will have to be used for packing of some special items like transformers, reactors, breakers, etc., to hold the job to the bottom plank of the box.

8.9 Polyethylene Sheet:

The polyethylene sheets are used to make covers to the jobs individually. multi-layered cross laminated polyethylene sheet as per AA 51420 can be used for packing of jobs.

8.10 Expanded Poly Foam Sheet and Air Bubble Film:

This item is used for covering the delicate items, Expanded Polyethylene Foam Sheet as per specification AA51423 and air bubble film as per specification AA51426

8.11 Thermocol (Expanded Polystyrene) Sheets:

This is used for covering delicate items. This material shall be as per spec. no AA51416

8.12 Cotton Bags:

These are used for holding silica gel.

**8.13 Marking Ink:**

The ink used normally is black in color. In some special cases other color also will have to be used. The ink shall be non-fading/indelible and non-washable by water

8.14 Polyethylene Bags:

These are to be used for keeping the, Packing slips. The bag shall be of size 70 mm X 100 mm (minimum).

8.15 Mechanical Latching Clamps:

For specific items self locking clamps can also be used on need basis in conjunction with or apart from regular bolt and nut fixing arrangement, if needed.

9 DESIGN OF PACKING BOXES

Design/drawing of packing boxes shall be prepared based on actual weight and size of the equipment and shall be covered by concern product standards.

10 GENERAL PRECAUTIONS:

- 1) While fixing nails during packing, necessary care shall be taken to ensure that materials used for protection inside the case e.g. paper, polyethylene sheet, coir etc. do not get damaged.
- 2) Sling protection brackets to be provided on cases wherever required.
- 3) It shall be ensured that all stencil marks external, front & rear sides of the casing shall be of water proof Material to prevent obliteration in transit.
- 4) For packing of small/delicate items - Item may be wrapped properly with M.L.C. laminated polyethylene and wrapped item may be further wrapped with air bubble film as per spec. AA51426, these curtains will be subsequently packed in wooden/ply boxes as at clause 8.0.
- 5) The various caution signs shall be marked with stencil on both sides of the packing box.
- 6) Instructions on handling, storage, preservation, represervation and transport of export order components at works and site shall be covered by product standards.


11 MARKING

The following details are to be marked on the packing cases.

- a) Address of consignee.
- b) Purchase Order No.
- c) Description of item or title of packing list.
- d) Case identification Number.
- e) Net Weight.
- f) Gross Weight.
- g) Dimensions of box
- h) Marking showing upright position.
- i) Marking showing sling position.
- j) Marking showing umbrella (i.e. for machines/components to be stored under covered storage).

MARKINGS ON PACKING CASES

1. THIS PLANT STANDARD PRESCRIBES THE VARIOUS CAUTION SIGNS AND OTHER MARKINGS ON PACKING CASES.
2. DIMENSIONS IN THE TABLE 1 SHALL BE USED FOR MAKING STENCILS ONLY.

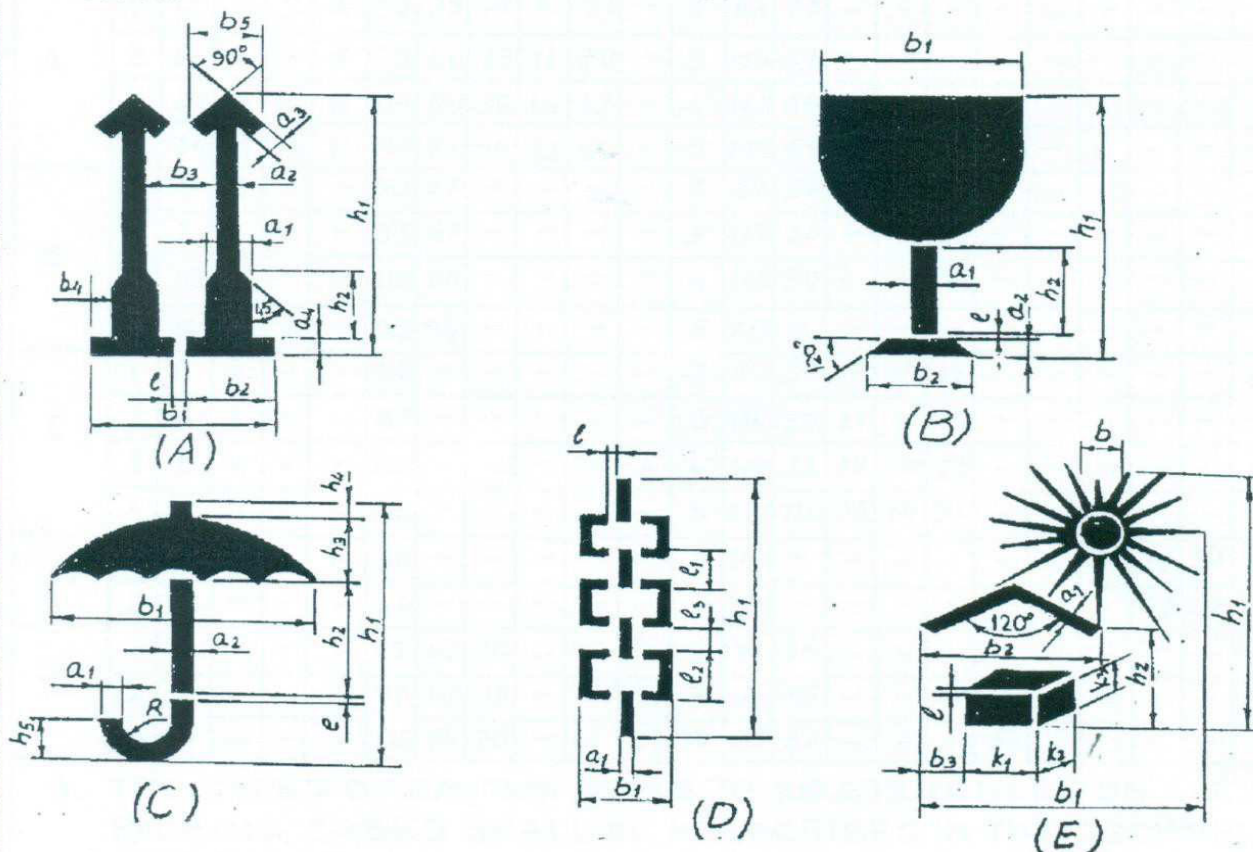

- A. UPRIGHT
- B. FRAGILE
- C. PROTECTION FROM FALLING OR CONDENSING MOISTURE.
- D. SLINGING POSITION
- E. PROTECTION FROM DIRECT RADIATIONS.

CENTER OF GRAVITY

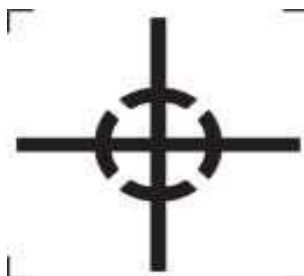


Figure 1 – Markings

CORPORATE STANDARD



DESIGN- ATION		DIMENSIONS IN mm.																						
		α_1	α_2	α_3	α_4	b_1	b_2	b_3	b_4	b_5	b	ℓ	h_1	h_2	h_3	h_4	h_5	K_1	K_2	K_3	ℓ_1	ℓ_2	ℓ_3	R
A	1	12	5	5	4	52	25	19	8	21	-	2	84	23	-	-	-	-	-	-	-	-	-	-
	2	17	7	7	6	75	36	29	11	30	-	3	119	33	-	-	-	-	-	-	-	-	-	-
	3	24	10	10	8	104	50	38	16	42	-	4	168	46	-	-	-	-	-	-	-	-	-	-
	4	34	14	14	11	147	71	59	23	60	-	5	239	65	-	-	-	-	-	-	-	-	-	-
B	1	5	5	-	-	50	33	-	-	-	-	2	84	25	-	-	-	-	-	-	-	-	-	-
	2	7	7	-	-	71	47	-	-	-	-	3	119	36	-	-	-	-	-	-	-	-	-	-
	3	10	10	-	-	100	66	-	-	-	-	4	168	50	-	-	-	-	-	-	-	-	-	-
	4	14	14	-	-	142	94	-	-	-	-	5	239	71	-	-	-	-	-	-	-	-	-	-
C	1	4	3	-	-	66	-	-	-	-	-	2	80	39	19	5	11	-	-	-	-	-	-	6
	2	6	4	-	-	85	-	-	-	-	-	3	114	55	27	7	16	-	-	-	-	-	-	9
	3	8	6	-	-	120	-	-	-	-	-	4	160	78	38	10	22	-	-	-	-	-	-	12
	4	11	9	-	-	170	-	-	-	-	-	5	227	110	54	14	31	-	-	-	-	-	-	17
D	1	6	-	-	-	30	-	-	-	-	-	4	148	-	-	-	-	-	-	-	30	30	10	-
	2	9	-	-	-	42	-	-	-	-	-	5	209	-	-	-	-	-	-	-	42	42	14	-
E	1	3	-	-	-	69	47	10	-	-	16	2	91	26	-	-	-	17	8	11	-	-	-	-
	2	4	-	-	-	98	67	15	-	-	23	3	128	33	-	-	-	24	11	16	-	-	-	-
	3	6	-	-	-	138	94	20	-	-	32	4	182	62	-	-	-	34	16	22	-	-	-	-

Black and Red Marking Ink to IS:1234 "Ink, Stencil, Oil Base, For Marking Porous Surfaces" or duplicating ink stencilling, oil base for marking porous surfaces.

All cases containing fragile items are to be stencilled with red marking and stencilling paint/ink

"HANDLE WITH CARE", "FRAGILE DO NOT TURN OVER".

Besides the caution signs the product information's shall be stencilled of letters with 13mm to 50mm height.

Incase of consignment consists of more than one package; each package shall carry its package no as given in shipping list. All caution signs shall be stencilled in higher quality full glossy out door finishing paint red in colour (AA56126). All other markings shall be carried out in black enamel (AA56126).

Caution signs & other markings shall be stencilled on both the end shooks & the side shooks. Caution sign (for slinging) shall be stencilled only on side shooks at the appropriate place.

Note: Incase the size of package is small for using the stencils, and then hand written letters/figures shall be allowed.

12 PROCEDURE FOR HANDLING OF COMPONENTS

The purpose of this procedure is to protect the quality of the components/equipment while handling in various stages of manufacturing packing & despatching.

- 1) Adequate care shall be taken in handling the material, and components to avoid damage during receipts, storage issue manufacture & despatch operations.
- 2) Appropriate material handling equipment like fork lifters, cranes etc. Shall be used where needed.
- 3) Lifting by crane and transportation by trolley of critical items and large components like rotors castings etc. Shall be done carefully.



CORPORATE STANDARD

AA0490009

Rev. No. 01

PAGE 7 of 7

- 4) For critical items, where specified, special handling fixtures shall be used for lifting.
- 5) Slings and shackles used for lifting the components/equipment shall be checked for fitness and suitability before use.
- 6) Slings used on machined surfaces shall be suitably padded. No slings shall be used on journal surfaces.
- 7) Precision machined components like blades, catches, rollers etc. Shall be lifted using suitable wooden pallets.

8) HANDLING OF COMPONENTS ON RECEIPT/DESPATCH:

Before loading/unloading a packing case from the carrier look for the following shipping instructions painted on the packing case.

- The markings showing the upright position.
 - The markings showing the sling position
 - Markings showing the fragile contents.
 - Other required markings as per Cl.No:11
- a) Appropriate cranes and slings should be used for different components/ cases. Slings should normally make an angle as minimum as possible (width wise) but in no case more than 15°.
 - b) Handling and lifting should be done without jerks or impacts.
 - c) Immediately after receipt of the goods, the packing should be examined all-round for any sign of damage. If necessary, lift the cover or a number of boards of the case so as to make the contents visible. In the event of sealed packing being used the plastic sheeting should not be damaged. It is imperative that the packing material is restored in original condition after the inspection.
 - d) On receipt of the equipment it should be checked with the shipping list and missing or damage if any should be reported immediately. It is important to arrange for immediate examination to determine the extent of the damage, the cause of the damage and where applicable the person or persons responsible for the damage. According to general practice when transporting by railway or by road vehicle the carrier concerned should be immediately called upon (within specified periods) for jointly establishing a statement of the damage. This is essential as a basis for a subsequent claim and possible damage report to the insurance company.
 - e) Protective coating applied on machined surfaces should not be disturbed. The plastic covering should be put back carefully so that it prevents ingress of dust and moisture. Some packing may have vapour phase inhibitor (VPI) paper enclosed inside the packing cases. This should be restored to its original place as far as possible.
 - f) Silica gel and such other chemicals kept in the box as desiccants and indicators should also be left in the box itself.

13 PROVISION FOR INSPECTION:

This clause is applicable only where contractual requirement of customer is there. For other packings this is not applicable.

Each transportable packing's shall have provision for inspection by customer authority etc. during transport from origin of dispatched until destination. This inspection may require opening of the package and subsequently closing it again. For this purpose, suitable designed opening with bolted cover shall be provided. Such an opening shall be clearly marked as "OPENING" with clear instruction for opening & closing written on this cover. For large consignment, the size of the opening shall be suitable to facilitate entry of personnel.

14 REFERRED STANDARDS (Latest publications including amendments):

- | | | | |
|------------|-------------|-------------|-------------|
| 1) AA51401 | 2) IS:303 | 3) IS:710 | 4) AA10166 |
| 5) ISPM:15 | 6) AA51420 | 7) AA51423 | 8) 55619 |
| 9) AA51406 | 10) AA51416 | 11) AA51426 | 12) AA56126 |