



BHARAT HEAVY ELECTRICALS LIMITED
RANIPET - 632406
NON - DESTRUCTIVE TESTING

BHE:NDT:RP:MT:01
REVISION : 02
PAGE NO:1 OF 15

PROCEDURE
FOR
MAGNETIC PARTICLE EXAMINATION
OF
FERRITIC MATERIALS AND WELDED COMPONENTS

Prepared by:

K.Velladurai
Level II

Reviewed and
Approved by:

L.Senguttuvan
Level III

Effective Date: 14.08.03

MASTER COPY



BHARAT HEAVY ELECTRICALS LIMITED
RANIPET - 632406
NON - DESTRUCTIVE TESTING

BHE:NDT:RP:MT:01
REVISION : 02
PAGE NO:2 OF 15

RECORD OF REVISION

Rev.No.	Date of revision	Reason for revision
01	28 07 99	Revision in entirety
02	14 08 03	Clause 14.0,19.44,18.1and23.0 added Clause 15.1.1,21.2,21.3,22.2 and22.3 modified



1.0 SCOPE

- 1.1 This procedure describes the method, techniques and acceptance standards for Magnetic particle Examination of all shapes of ferromagnetic product forms in Boiler components, Boiler Auxiliaries, pressure vessels, Heat Exchangers and Structural.
- 1.2 The examination shall include all Gas cut openings, attachment welds with a throat thickness over 6mm and on finished surface of welds as required by referencing code/section. The examination includes base material 13mm on each side of the welds.

2.0 REFERENCE

- 2.1 ASME Section V,I & VIII (Division 1 & 2) – 2002 Addenda
- 2.2 ASME B 31.1 (2001)
- 2.3 ANSI / AWS D 1.1 (2002)

3.0 EQUIPMENT

- 3.1 Equipments generating half-wave rectified alternating current employing prods at the end of magnetizing cables shall be used for examination by circular magnetization method.
- 3.2 Direct / Alternating current electromagnetic yokes shall be used to detect discontinuities that are open to the surface of the part by longitudinal magnetization method and to examine the surface where arcing is not permitted or prod method is not practicable.

4.0 EXAMINATION MEDIUM

- 4.1 The ferromagnetic particles used as examination medium shall be either wet or dry. Wet particles shall be non – fluorescent type.
- 4.2 Dry magnetic particles black, gray or red in color shall be used as examination medium for examination of welds and other product forms to provide adequate contrast with the surface being examined. The surface temperature of the part examined with dry particles shall not exceed 315°C.
- 4.3 Non fluorescent wet particles will be black or reddish brown in color that provide adequate contrast with the surface being examined. Wet particles shall be suspended in kerosene for application to the test surface by flowing or spraying. Suitable conditioning agents shall be added to the water to provide proper wetting and corrosion protection for the parts being examined.
- 4.4 The temperature of the wet particle suspension and the surface of the part being examined shall not exceed 57°C.



- 4.5 The bath concentration shall be determined by measuring the settling volume through the use of pear-shaped centrifuge tube. The settling volume shall be within 1.2 ml to 2.4 ml for non- fluorescent particles.

5.0 SURFACE CONDITIONING

5.1 Preparation

- 5.1.1 As welded, as rolled, as cast or as forged surface is generally acceptable provided the surface irregularities will not mask the indication due to discontinuities. Otherwise surface preparation by grinding or machining may be necessary. Undercuts, Overlaps or abrupt ridges and valleys in the welds and opening shall be smoothly merged with the parent metal.
- 5.1.2 Prior to magnetic particle examination, ensure that the surface to be examined and adjacent area within at least 25mm of the area of interest shall be dry and free of any dirt, grease, lint, scale, welding flux, spatter, oil or other extraneous matter that would interfere with the examination.
- 5.1.3 Cleaning may be accomplished by detergents, organic solvents, descaling solution and paint removers, sand or grit blasting method.
- 5.1.4 Thin nonconductive coating such as painting will not normally interfere with the formation of indications. They must be removed at all points where electrical contact is to be made for direct magnetisation.

5.2 Surface contrast Enhancement

- 5.2.1 When coating are applied temporarily to enhance particle contrast or if coating are left on the part being examine, it must be demonstrated that indications can be detected through the enhanced coating thickness on a test plate with machined grooves as in 16.0
- 5.2.2 If indications of required sensitivity could not be detected, the coating shall be removed.

6.0 METHOD OF EXAMINATION

- 6.1 Examination shall be made by continuous method.

6.1.1 Dry continuous magnetisation method

- 6.1.1.1 The magnetizing current remains on while the examination medium (Dry particle) is being applied and while the excess of the examination medium is being removed.



6.1.2 Wet continuous magnetisation method

- 6.1.2.1 The magnetic particle application involves bathing the surface of the part with examination medium and terminating the bath application immediately prior to cutting off the magnetizing current with two or more shots given to the part. The duration of the magnetizing current is typically on the order of $\frac{1}{2}$ seconds.

7.0 TECHNIQUES

- 7.1 One of the following magnetization techniques shall be used.
- a) Prod Technique
 - b) Yoke Technique

8.0 TYPE OF CURRENT FOR MAGNETISATION

- 8.1 Single phase half -wave rectified current (HWAC) / (HWDC) shall be employed for testing with prod techniques.
- 8.2 The amperage required with single - phase Half-wave rectified current shall be verified by measuring the average current during the conducting half cycle only.
- 8.3 For Yokes, the current shall be either AC or DC.

9.0 CALIBRATION

- 9.1 Ammeter of magnetizing equipment shall be calibrated as per NDT: WI:004 at least once a year, or after each time it has been subjected to major electrical repair, periodic overhaul or damage. If equipment has not been in use for a year or more, calibration shall be done prior to first use.
- 9.2 Lifting power of yokes
- 9.2.1 The magnetizing force of yokes shall be checked at least once a year or whenever a yoke has been damaged. If a yoke has not been in use for a year or more, a check shall be done prior to first use.
- 9.2.2 Each alternating current electromagnetic yoke shall have a lifting power of at least 4.5 kg and direct current / permanent magnetic yoke shall have a lifting power of 18.kg, at the maximum pole spacing that will be used or the pole distance shall be the spacings at which the yoke lifts the stipulated weight.
- 9.2.3 Each weight shall be weighed with a scale from a reputable manufacturer and stenciled with the applicable nominal weight prior to first use. A weight need only be verified again if damaged in a manner that could have caused potential loss of material.



10.0. EXAMINATION

10.1 Direction of magnetization

- 10.1.1 At least two separate examination shall be carried out on each area. During the second examination the prods/poles are spaced so that the lines of flux are approximately perpendicular to those used during the first examination. A different technique for magnetization may also be used for the second examination

10.2 Examination Coverage

- 10.2.1 Examination shall be made with sufficient overlap to assure 100% coverage of testing.

11.0 PROD TECHNIQUE: (Fig. 1,2&3)

11.1 Magnetizing procedure

- 11.1.1 The prod electrodes are pressed firmly against the surface in the area to be examined. In order to avoid arcing a remote control switch shall be built in to the prod handles, to permit the current to be turned on after the prods have been properly positioned and to be turned off before they are removed.

11.2 Magnetising current

- 11.2.1 The current shall be 100 to 125 (maximum) amperes/25mm of prod spacing for sections 19mm thick or greater.
- 11.2.2 For sections less than 19mm thick, the current shall be 90 to 110 amperes / 25mm of prod spacing.

11.3 Prod spacing

- 11.3.1 Prod spacing shall not be less than 75mm nor exceed a maximum of 200mm.
- 11.3.2 The prod tips shall be kept clean and dressed and the contact areas of the test surface shall be free from dirt, scale, oil etc, to minimize electrical arcing. In the open circuit voltage of the magnetizing current is greater than 25 volts, Lead, steel or Aluminum rather than copper tipped prods shall be preferred to avoid copper deposits on the part being examined.

12.0 YOKE TECHNIQUE

- 12.1 The pole spacing shall be between 100mm to 150mm. The field indicator will be used to check the direction of the part magnetization.



13.0 APPLICATION OF DRY PARTICLES

13.1 The dry particles shall be applied in such a manner that a light uniform dust-like coating settles on the surface of the area being examined. The application technique shall be such that the particles are suspended in air and reaches the examination surface in a uniform cloud with a minimum forces, using a hand powder applicators (Squeeze bulb) or specially designed mechanical blower or by a spray nozzle.

13.1.1 Dry particles shall not be applied to a wet surface nor when there is excessive wind. The particles shall not be applied by pouring, throwing, or spreading with fingers.

13.1.2 Any excess powder shall be removed while the magnetization current is on and shall be with a gentle air stream without removing or disturbing particles attracted by a leakage field that may prove to be a relevant indication.

13.2 APPLICATION OF WET PARTICLES

13.2.1 The application of wet particles involves the bathing of the area to be examined, by spraying or flowing during the application of magnetizing current.

13.2.2 Two or more shots shall be applied, but the last shot shall be applied while the bath still remains on the area to be examined and after the particles flow has been stopped. Care shall be taken to cut off the bath application before removing the magnetic field, to prevent high-velocity particle flow that wash away or remove fine or weakly held indications.

14.0 MAGNETISING FIELD ADEQUACY AND DIRECTION

14.1 By using one or more of the following three methods, the magnetizing field adequacy and direction may be verified.

14.1.1 Pie shaped Magnetic Field Indicator, artificial flaw shims and Hall effect Tangential Field probe.

15.0 LIGHTING

15.1 Visible Light Intensity

15.1.1 The examination and evaluation of indications shall be performed under minimum light intensity of 100 fc (1000 lx).

16.0 SYSTEM PERFORMANCE CHECK (Fig. 4)

16.1 For prod magnetization with HWAC, performance sensitivity shall be checked at least once in a shift before start of the examination on a test plate that contains machined grooves to different depths. The indication of a groove at 3mm depth from the surface of the test plate will indicate adequate sensitivity.



16.2 If the part is to be tested with contrast coat, the sensitivity shall be checked with the contrast coat on the surface of the test block.

16.3 For electromagnetic yokes, the adequacy or direction of the magnetizing force shall be verified by positioning the 'Magnetic Field Indicator' on the surface to be examined. The pattern in the indicator should be clearly developed on the surface of the block.

17.0 DEMAGNETISATION

17.1 No demagnetization will be done after the test except specifically required.

18.0 EVALUATION OF INDICATION

18.1 Mechanical discontinuity at the surface would be indicated by the retention of the powder or medium.

18.1.1 All the indication are not necessarily discontinuity indications since certain metallurgical discontinuities and magnetic permeability variation may produce similar unacceptable discontinuity indication. These non-relevant indications shall be reexamined by any other suitable NDT methods such as Liquid penetrant or macro etching.

18.2 Relevant indications are those which result from unacceptable mechanical discontinuities.

18.2.1 Linear indications are those indications in which length is greater than three times the width.

18.2.2 Rounded indications are circular or elliptical with the length equal to or less than three times the width.

19.0 ACCEPTANCE STANDARDS AS PER ASME (SEC I,VIII Div 1&2 and B 31.1) AND OTHERS

19.1 Welds and Materials

19.2 An indication of an imperfection may be larger than the imperfection that causes it: however, the size of the indication is the basis for acceptance for evaluation.

19.3 Only indications with major dimension greater than 1.6mm shall be considered relevant.

19.4 All surface to be examined, except as mentioned in 19.5, 19.6 and 19.7 shall be free of

19.4.1 Relevant linear indications.



19.4.2 Relevant rounded indication greater than 4.8mm

19.4.3 Four or more relevant rounded indications in a line separated by 1.6mm or less edge to edge.

19.4.4 Ten or more rounded indications in any 3870 mm² (6 inch²) of surface with the major dimension of this area not to exceed 150mm with the area taken in the most unfavourable location relative to the indication being evaluated.

19.5 Cut edges and openings:

19.5.1 All surface to be examined shall be free of

(a) Cracks

(b) Laminations exceeding 25mm in length.

19.6 In welds joining nipples to drums, spheres or headers, all slag or porosity indications shall be investigated to assure that no leak – path exists.

19.7 In attachment welds of non-load carrying class, indications from crack or due to material separation are unacceptable.

20.0 ACCEPTANCE STANDARD FOR STRUCTURAL COMPONENTS AS PER AWS

20.1 The magnetic particle acceptance criteria is based on the size of the actual discontinuity and not the size of the discontinuity as indicated by the magnetic particle inspection medium. Where discontinuity cannot be visually seen (with magnification if required) after removal of the indicating medium, evaluation shall be based on size and nature of the magnetic particle indication.

21.0 Statically loaded Non tubular connections

21.1 Cracks, Lack of Fusion, and Incomplete penetration are not acceptable.

21.2 **Undercut**-for material with thickness less than 25mm undercut shall not exceed 1.0mm, except that a maximum 2.0 mm is permitted for a accumulated length of 50mm in any 300mm. For material equal to or greater than 25.0 mm thick, undercut shall not exceed 2.0 mm for any length of weld.

21.3 **Porosity** – a complete joints penetration groove welds in butt joints transverse to the direction of computed tensile stress shall have no visible piping porosity. For all other groove welds and for fillet welds, the sum of the visible piping porosity 1.0mm or greater in diameter shall not exceed 10mm in any linear 25mm of weld and shall not exceed 20mm in any 300mm length of weld.



22.0 Cyclically Loaded Non tubular Connections

- 22.1 **Undercut** - In primary members, undercut shall be no more than 0.25mm deep when the weld is transverse to tensile stress under any design loading condition. Undercut shall not be more than 1.0mm deep for all other cases.
- 22.2 **Porosity** - The frequency of piping porosity in fillet welds shall not exceed one in each 100 mm of weld length and the maximum diameter shall not exceed 2.5mm. Exception : for fillet connecting stiffeners to web, the sum of the diameter of the piping porosity shall not exceed 10mm in any linear 25mm of weld and shall not exceed 20mm in any 300 mm length of weld.
- 22.3 Complete joint penetration groove welds in butt joints transverse to the direction of computed tensile stress shall have no piping porosity.
- 22.3 **PIPING POROSITY** - (General) is elongated porosity whose major dimension lies in a direction approximately normal to the weld surface. Frequently referred to as pin holes when the porosity extends to the weld surface.

23.0 EDGE DISCONTINUITIES IN CUT MATERIALS

- 23.1.1 No crack is acceptable.
- 23.1.2 Mill induced discontinuity
- 23.1.3 Length 25mm and less- Acceptable
- 23.1.4 Length over 25mm and depth up to 3mm- Acceptable
- 23.1.5 Length over 25mm and depth between 3mm and 25mm - indications to be removed.
- 23.1.6 Length over 25mm and depth greater than 25mm - indications to be removed to a depth up to 25mm.

24.0 REPAIR AND RE-EXAMINATION

- 24.1 Whenever an imperfection is repaired by chipping or grinding or and subsequent repair by welding is not required, the excavated area shall be blended into the surrounding surface so as to avoid sharp notches, crevices, or corners.
- 24.2 After a defect is thought to have been removed and prior to making weld repairs, the area will be examined by suitable method to ensure that the defect has been removed or reduced to an acceptable size of an imperfection.



BHARAT HEAVY ELECTRICALS LIMITED
RANIPET - 632406
NON - DESTRUCTIVE TESTING

BHE:NDT:RP:MT:01
REVISION : 02
PAGE NO:11 OF 15

24.3 where welding is required after repair of an imperfection the area shall be cleaned and repair carried out. After repairs have been made the repaired area shall be blended into the surrounding surface so as to avoid sharp notches, crevices or corners.

24.4 After repairs have been made, the repaired area shall be re-examined by methods of examination that were originally required for the affected area.

25.0 PERSONNEL QUALIFICATION

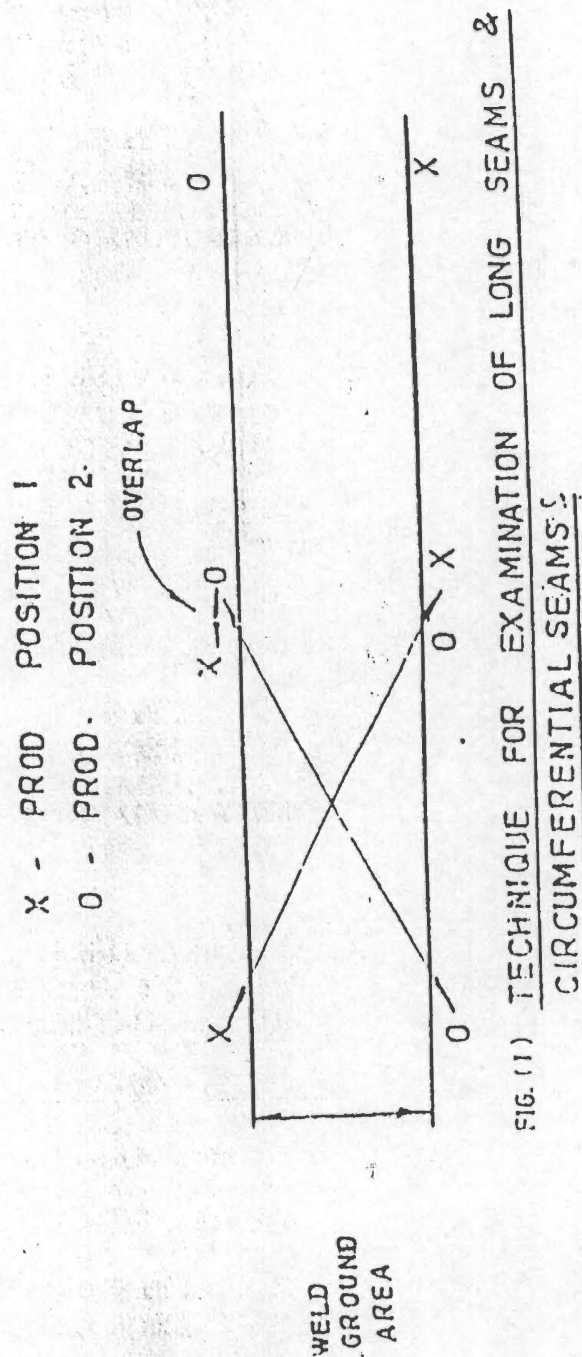
25.1 All personnel carrying out the examination and evaluation shall be qualified to minimum Level - I as per ASNT:SNT - TC - 1A.

26.0 FINAL CLEANING

26.1 When the inspection is concluded, the magnetic particles shall be removed by any suitable means, leaving the product in a dry and clean condition.

27.0 REPORT

27.1 Copies of the report in a standard format R 49-719-B or equivalent duly signed by a minimum Level - II personnel shall be issued after the test.



NOTE:

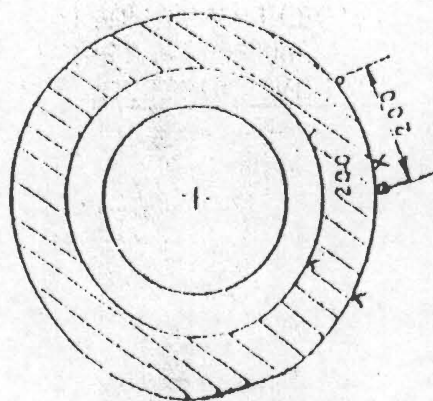
1. SUCCESSIVE SHOTS SHALL OVERLAP A MINIMUM OF 10% OR 20 MM
2. EXAMINATIONS ON O.D. AND I.D. OF THE SEAM SHALL BE CARRIED OUT IN THE SAME MANNER.
3. PRODS MUST BE PLACED ON DRUM/ VESSEL PERPENDICULAR TO PLATE SURFACE.



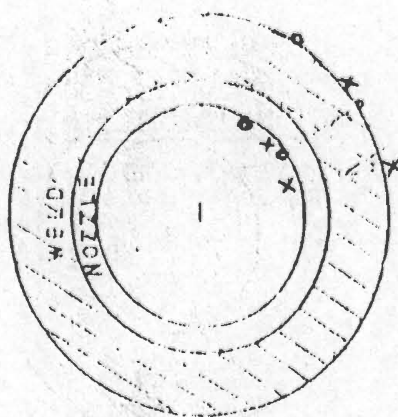
BIHARAT HEAVY ELECTRICALS LIMITED
RANIPET - 632406
NON - DESTRUCTIVE TESTING

BIHENDT:RP:MT:01
REVISION : 02
PAGE NO:13 OF 15

LONGITUDINAL INDICATIONS



TRANSVERSE INDICATIONS



25MM MIN

25MM MIN

O - PROD POSITION . 1
X - PROD POSITION . 2

FIG. (2) TECHNIQUE FOR EXAMINATION OF CORNER JOINTS

1. PROD LOCATION AT TOP OF WELD
ALL THE WAY AROUND & AT THE
BOTTOM ALL THE WAY AROUND
2. O, X - 10% OVERLAP BETWEEN SHOTS

PROD LOCATED AT LEAST 25MM UP ON

NOZZLE ± 25MM OUT ON DRUM / VESSEL

2. 10% OVERLAP (15MM) BETWEEN SHOTS

NOTE:

PRODS MUST BE PLACED ON DRUM / VESSEL / NOZZLE
PERPENDICULAR TO PLATE SURFACE.

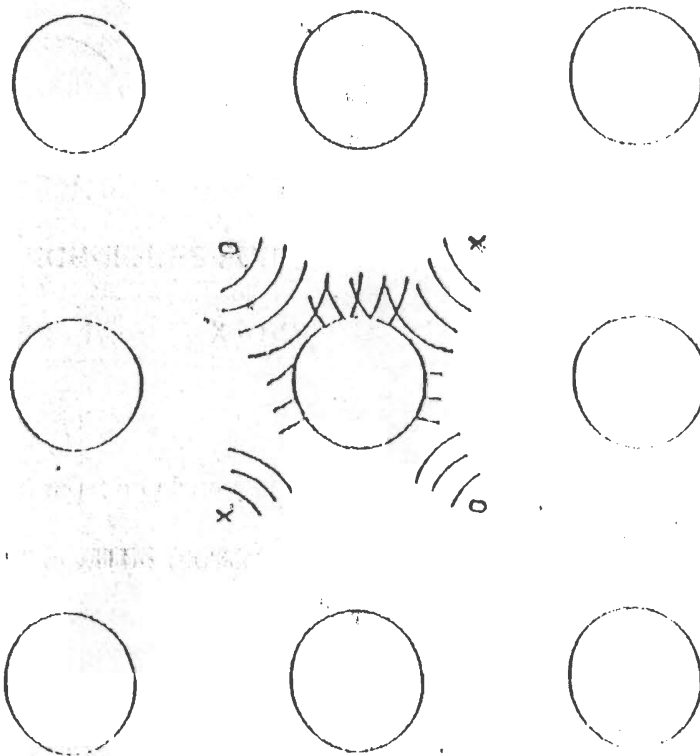


FIG (3) TECHNIQUES FOR EXAMINATION OF FILLET WELDS

0 - POSITION - 1

X - POSITION - 2

ARC BREAK LOCATION

NOTE :

- 1) PRODS must be placed on drum / header perpendicular to plate surface.
- 2) Inspection will be 100% of weld for each shot.



BHARAT HEAVY ELECTRICALS LIMITED
RANIPET - 632406
NON - DESTRUCTIVE TESTING

BHENDT:RP:MT:01
REVISION : 02
PAGE NO:15 OF 15

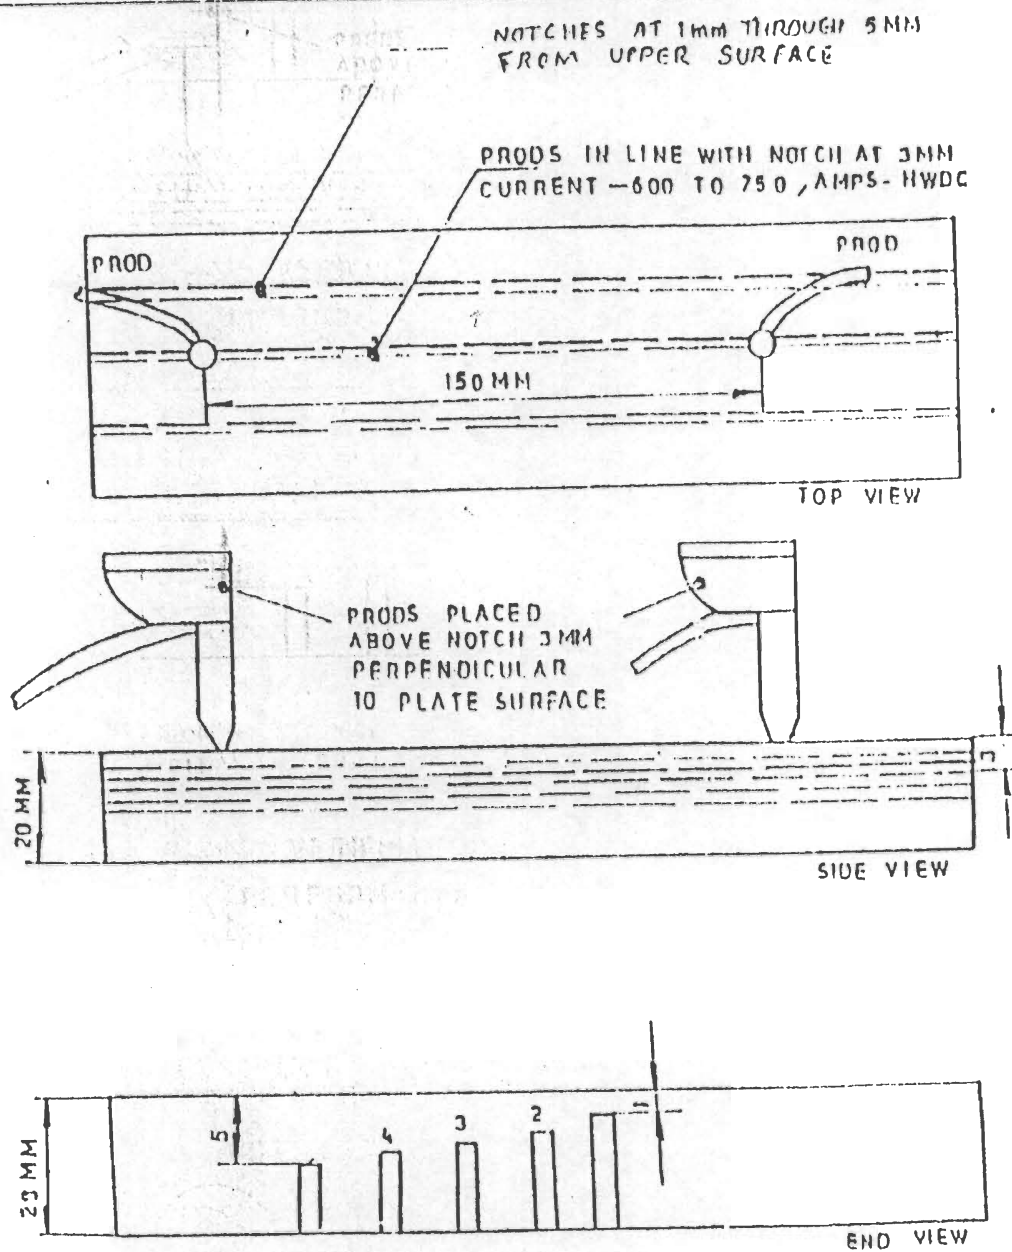


FIG (4)

VERIFICATION OF SYSTEM
PERFORMANCE FOR PROD TECHNIQUE



BHARAT HEAVY ELECTRICALS LIMITED
RANIPET 632406
NON-DESTRUCTIVE TESTING

BHE:NDT:RP:PT:01
REVISION :02
PAGE 1 OF 10

PROCEDURE FOR LIQUID PENETRANT EXAMINATION

Prepared by:

K.Velladurai
Level II

Reviewed and
Approved by:

L.Senguttuvan
Level III

Effective Date : 14. 08. 03

MASTER COPY



BHARAT HEAVY ELECTRICALS LIMITED
RANIPET 632406
NON-DESTRUCTIVE TESTING

BHE:NDT:RP:PT:01
REVISION :02
PAGE 2 OF 10

RECORD OF REVISION

Revision No.	Date of revision	Reason for revision
		Revision in entirety
01	28 07 99	
02	14 08 03	Clause 2.1, 2.2, 2.3, 12.1.2.2, 12.1.3.1, 12.1.3.2 and 13.1.2.1 modified Clause 8.2 added



1.0 SCOPE

1.1 This procedure defines the method, techniques and acceptance standards for Liquid penetrant Examination of all shapes of ferrous and Non-ferrous product forms in Boilers, Boiler Auxiliaries, pressure vessels, Heat Exchangers and structural.

1.2 In pressure vessels the Examination shall include all welds around openings, attachment welds with a throat thickness over 6mm and on finished surfaces of welds as required by referencing code. The examination includes base material 13mm on each side of the weld.

2.0 REFERENCE

2.1 ASME Section V, I & VIII (Division 1 & 2) -2002 Addenda

2.2 ASME B 31.1 / 2001

2.3 ANSI / AWS D 1.1 / D1.1M: 2002

3.0 EQUIPMENT

3.1 The term 'penetrant materials' as used in the procedure is intended to include all liquid penetrants, solvents (penetrant removers) or cleaning agents, developers etc used for 'Liquid penetrant Examination'.

3.2 Penetrant used shall be of solvent removable type and have a color contrast, which can be seen, readily in daylight or under normal interior illumination.

3.3 The cleaner used for the surface cleaning shall be an organic chemical such as Acetone or Trichloro Ethylene.

3.4 Developer shall be of non-aqueous suspendible type. When the developer dries, it shall form a white coating of fine powder on the part.

3.5 The Chemicals used for the examination of austenitic stainless steel or nickel base alloys shall be analysed for sulphur and total halogens. The residual amount of total sulphur and chlorine content shall not exceed 1% by weight.

4.0 SURFACE PREPARATION

4.1 In general satisfactory results may be obtained when the surface is as welded, as rolled, as forged or as cast condition. When the surface irregularities might mask the indications of unacceptable discontinuities, the surface shall be prepared by grinding or machining or any other suitable method.



- 4.2 The surface to be examined and all adjacent areas within at least 25mm shall be dry and free of any dirt, grease, lint, scale, welding flux, weld spatter, rust, paint, oil or any other extraneous matter that could obscure surface openings or otherwise interfere with the examination by preventing the penetration.
- 4.3 Shot blasting may close discontinuities at the surface and should not be used before conducting penetrant examination. If the component is shot blasted, the surface is to be etched before conducting penetrant examination.
- 4.4 Prior to the application of the penetrant, the surface is recleaned with typical industrial cleaning agents such as Acetone.
- 5.0 DRYING AFTER PREPARATION
- 5.1 After cleaning, drying of the surface shall be accomplished by normal evaporation and ensure that the cleaning solution has evaporated. The minimum time required for the cleaner to dry from the surface is 20 to 30 seconds depending on the position.
- 6.0 TECHNIQUES
- 6.1 Color contrast (visible) penetrant shall be used with solvent removable penetrant process.
- 6.1.1 The temperature of the penetrant and the surface of the part shall not be below 10°C and not above 52°C throughout the examination period. Local heating or cooling is permitted provided the part temperature remains in the range of 10°C to 52°C during the examination.
- 6.2 TECHNIQUE RESTRICTIONS
- 6.2.1 Intermixing of penetrant materials from different families or different manufacturers is not permitted.
- 7.0 EXAMINATION
- 7.1 Penetrant Application
- 7.1.1 The penetrant shall be applied by brushing, spraying or dipping after the surface is dried. For spraying a handpump or an aerosol spray cans will be used.



7.2 Penetration time

7.2.1 The penetrant shall be allowed to remain wet on the part for a minimum period for 10 minutes. (dwell time).

7.2.2 If the penetrant has completely dried up during the dwell time, then the surface shall be recleaned and reexamined.

7.3 REMOVAL OF EXCESS PENETRANT

7.3.1 After the required dwell time has elapsed, the excess penetrant remaining on the surface shall be removed by wiping with a lint free cloth, repeating the operation until most traces of penetrant have been removed. Final left out penetrant shall be remove by wiping with a clean cloth moistened with the solvent. Excessive application of the cleaner shall be avoided to prevent the possibility of removing the penetrant from discontinuities causing a decrease in the sensitivity of the test. FLUSHING THE MATERIAL SURFACE WITH THE SOLVENT FOLLOWING THE APPLICATION OF PENETRANT AND PRIOR TO DEVELOPING IS PROHIBITED.

7.3.2 Drying after excess penetrant removal.

7.3.2.1 After the removal of excess penetrant the surface shall be dried by normal evaporation. The minimum time required for the surface to get dried by normal evaporation is 20 seconds.

7.4 DEVELOPING

7.4.1 The developer shall be applied by spraying to provide uniform coating as soon as possible to the dry surface after the removal of excess penetrant. Insufficient coating thickness may not draw penetrant out of discontinuities. Excessive coating thickness may mask indications.

7.4.2 WET DEVELOPER APPLICATION

7.4.2.1 Prior to applying suspension type wet developer to the surface the developer must be thoroughly agitated too ensure adequate dispersion of suspended particles. The developer shall be applied by spraying using spray pump or aerosol spray can. The developer shall be applied over the surface in such a manner to assure complete coverage of the part with a thin, uniform film of developer. Drying of developer shall be by normal evaporation.



7.4.3 DEVELOPMENT TIME

- 7.4.3.1 The surface shall be closely observed during the application of the developer to monitor the behavior of the indication, which tends to bleed-out. Developing time for final interpretation begins as soon as a wet developer coating is dry. The minimum developing time shall be 7 minutes.

8.0 INTERPRETATION

- 8.1 Final interpretation shall be made within 7 to 60 minutes after the wet developer coating is dry. If the bleed - out does not alter the examination results longer periods are permitted.
- 8.2 The surface shall be examined in increments if the surface to be examined is large enough to complete the inspection within the prescribed time.
- 8.3 A minimum light intensity of 50 foot candle (500 lux) is required to ensure adequate sensitivity during the examination and evaluation of indications, which can be achieved by a hand lamp or torch light positioning at a distance of 300mm.

9.0 EVALUATION

- 9.1 Flaws at the surface will be indicated by bleed out of the penetrant. However localized surface irregularities such as machining marks or other surface conditions may produce false indications. Broad areas of pigmentation which would mask indications are not acceptable and such areas shall be cleaned and reexamined.
- 9.2 Welds made to ASME Boiler and pressure vessel code
- 9.2.1 An indication of an imperfection may be large than the imperfection that causes it: however, the size of the indication is the basis for acceptance evaluation.
- 9.2.2 Relevant indications are those which result from mechanical discontinuities (imperfection).
- 9.2.3 Only indications with major dimension greater than 1.6mm shall be considered relevant.
- 9.2.4 Any indication which is believed to be non-relevant shall be regarded as a defect until the indication is either eliminated by surface conditioning or it is evaluated by other non - destructive testing and proved to be non - relevant.



- 9.2.5 Linear indications are those indications in which the length is more than three times the width.
- 9.2.6 Rounded indications are those which are circular or elliptical with the length equal to or less than three times the width.
- 9.2.7 Any questionable or doubtful indications shall be reexamined to determine whether they are relevant, or not.
- 10.0 ACCEPTANCE STANDARD (as per ASME Sec I and VIII Div 1&2)
- 10.1 Cut edges and openings
- 10.1.1 All surfaces to be examined shall be free of
- (a) Cracks
 - (b) Non laminar discontinuities (having length not parallel to the material surface).
 - (c) Laminations exceeding 25mm in length.
 - (d) Laminations under 25mm in length and adjacent to each other within 25mm shall be considered as one defect.
- 10.2 Welds and Materials
- 10.2.1 All surfaces to be examined shall be free of
- a) Relevant linear indications.
 - b) Relevant rounded indications greater than 4.8mm.
 - c) All relevant indications shall be investigated to assure that no leak-path exists in welds joining nipples to drums, dished – ends and headers.
- 10.2.2 Four or more relevant rounded indications in a line separated by 1.6mm or less edge to edge.
- 10.2.3 Ten or more rounded indication in any 3870mm² (6 inch²) of surface with the major dimension of this area not exceed 150 mm with the area taken in the most unfavorable location relative to the indication being evaluated.



- 10.2.4 In attachment welds of non-load carrying class, indications from cracks or due to material separation are unacceptable.
- 11.0 WELDS MADE TO STRUCTURAL WELDING CODE ANSI / AWS D 1.1
- 11.1 For statically and cyclically loaded non-tubular connections made to AWS code the acceptance of any discontinuity shall be based upon a visual examination of the discontinuity after the removal of developer medium and evaluated for its nature and size. Where the discontinuity cannot be seen after removal of the developer medium either directly or using magnifying glass evaluation shall be based on the size and nature of liquid penetrant indication.
- 12.0 ACCEPTANCE STANDARD (AS PER AWS)
- 12.1 Statically loaded non-tubular connections.
- 12.1.1 Indications from cracks, lack of penetration and lack of fusion are not acceptable.
- 12.1.2 Porosity.
- 12.1.2.1 Complete joint penetration groove welds in butt joints transverse to the computed tensile stress shall have no visible piping porosity.
- 12.1.2.2 For all other groove welds and for fillet welds, the sum of the visible piping porosity of 1.0 mm or greater in diameter shall not exceed 10 mm in any linear 25 mm of weld and shall not exceed 20 mm in any 300 mm length of weld.
- 12.1.3 Undercut
- 12.1.3.1 For material less than 25 mm thick, undercut shall not exceed 1.0 mm except that a maximum 2.0 mm is permitted for an accumulated length of 50 mm in any 300 mm
- 12.1.3.2 For material equal to or greater than 25 mm thick undercut shall not exceed 2.0 mm for any length of weld.
- 13.0 Cyclically loaded non-tubular connections.
- 13.1 Indications from Cracks, Lack of penetration and lack of fusion are not acceptable in any welds.



13.1.2 Porosity

13.1.2.1 Complete joint penetration groove welds in butt joints transverse to the direction of computed tensile stress shall have no piping porosity. For all other groove welds, the frequency of piping porosity shall not exceed one in 100mm of length and the maximum diameter shall not exceed 2.5 mm.

13.1.2.2 The Frequency of piping porosity in fillet welds shall not exceed one in each 100mm of weld length and the maximum diameter shall not exceed 2.5mm. EXCEPTION for fillet welds connecting stiffeners to web, the sum of the diameter of piping porosity shall not exceed 10mm in any linear 25mm of weld and shall not exceed 20mm in any 300mm length of weld.

13.1.3 Undercut.

13.1.3.1 In primary members, undercut shall not be more than 0.25mm deep when the weld is transverse to tensile stress under any design loading condition. Undercut shall not be more than 1mm deep for all other cases.

14.0 REPAIR AND RE-EXAMINATION

14.1 Whenever an imperfection is repaired by chipping or grinding the excavated area shall be blended into the surrounding surface so as to avoid sharp notches, crevices or corners.

14.2 After a defect is thought to have been removed and where welding is required after repair, the area shall be examined for removal of defects, area cleaned and repair carried out. The repaired area shall be blended into the surrounding surface as in 14.1 and re-examined by the liquid penetrant or any other NDT methods originally required for the affected area.

15.0 PERSONAL QUALIFICATION

15.1 Wherever penetrant examination is required by the referencing code, the same shall be conducted and evaluated by a personnel qualified to minimum, Level – I as per ASNT SNT-TC-1A.



BHARAT HEAVY ELECTRICALS LIMITED
RANIPET 632406
NON-DESTRUCTIVE TESTING

BHE:NDT:RP:PT:01
REVISION :02
PAGE 10 OF 10

16.0 POST CLEANING

- 16.1 After the examination and evaluation is completed all penetrant testing material shall be removed from the surface, so that it will not interfere with the subsequent processing or service requirements.

17.0 REPORTING

- 17.1 Where penetrant test is mandatory, a copy of the report signed by personnel certified to minimum Level II will be issued in the format R49-720B or equivalent, after the completion of the examination.







 Ranipet	Splicing Norms for Plates & sheets of APH components	Doc. No	PRQA: 410
		Rev	05
		Date	21 06 08
		Page NO	1 of 3

1.0 Scope

- 1.1 This procedure details out the **SPlicing NORMS** for **DIAPHRGM PLATES, Housing Panels and Pedestals, Sector plate, connecting plate assembly, cleaning device Assembly of Air pre Heater.**

2.0 General Requirement

- 2.1 Check for the material specifications of plates/sheets, which are to be joined to avoid mix up of material. TCN to be obtained for change of material.
- 2.2 Electrode Selection shall be as per respective WPS. (E 7018 shall only be used for carbon steel)
- 2.3 Welding shall be followed with suitable methods and controls to minimize the distortion.
- 2.4 Stiffeners parallel to joint (Splice) shall be in such a way that welds over joint is avoided and a minimum distance between stiffeners parallel to weld joint shall be maintained as Two times the thickness of thicker plate.
- 2.5 Whenever back grinding is not feasible due to location of the plate /sheet, root welding to be carried out with 3.15 mm electrode and LPI to be carried out after thorough cleaning and repeat LPI after final welding.
- 2.6 Plus joint shall not be permitted when building up of plate to drawing size. However minimum offset of 100 mm is to be maintained.
- 2.7 Cut out on welds shall be avoided. In case any such opening on the joint the same shall be strengthened with pad plate of 50mm width all round on one side with the thickness equal to the parent material.
- 2.8 Unless otherwise mentioned against specific requirement minimum joint piece shall not be less than 500 mm. For hot end center section (tub plate) end joint piece shall be min 500 mm however for other joint piece shall be of max available sizes in order to reduce the number of joints.

Prepared By	Reviewed By			Approved BY
	M G Rajashankar	QA		 (DGM/ QA & BE)
	B Srinivasa Rao	QC		
	G JAYASEKAR	QC-OLI		
	S RAGHUNATHAN	ENGG		
	G Balasubramaniam	OP&C		

	Splicing Norms for Plates & sheets of APH components	Doc. No	PRQA: 410
		Rev	05
		Date	21 06 08
		Page NO	2 of 3

2.9 Following are the guidelines if Edge preparation (EP) is not specified in drawing/ OP&C Sketch.

- **Plates and sheets up to 5mm:** No EP is required. Provide 2 to 3 mm root gap, weld on both sides.
- **Plates of 6mm** No EP is required. Welds shall be with square butt with 2 to 3 mm gap. Weld from first side and turn the plate for back grind and conduct LPI. Complete the weld.
- **Plates above 6mm and up to 8 mm** Single 'V', 60° EP. Weld from V side and turn the plate, Back grind and conduct LPI, complete the weld.
- **Plates above 8 mm:** Double 'V', 60° EP. Weld one side. Carry out back chipping/Grinding, conduct LPI to ensure sound metal and weld from other side.

2.10 Wherever cross members are fouling on the weld, Flush grind weld metal and ensure flatness. There shall not be any depression at weld zone. Thickness at weld zone shall not go below the actual thickness of the plate. Check 100 % visual inspection.

2.11 Cleaning device support channel plate: One joint is permitted up to 4 meters length and 2 joints for more than 4 meters (perpendicular to the bend line.) and the minimum Joint piece shall be 500mm.

3.0 Specific Requirements for Diaphragm plate

1. One joint only allowed perpendicular to axis of the Rotor post. (Along the Length of the Plate)
2. Joint shall be made at least 650 mm from the edge.
3. Place the plates to-be-welded together. Check for straightness of minimum two sides & right angle of the plate. Check the mismatch of joint edge. The mismatch shall be within 1 mm. Check for length, width and diagonal as per OP&C Sketch. Length and Width tolerance shall be as per OP & C Sketch, Maximum allowed diagonal difference is 2 mm and record the readings.
4. Weld one side and reverse & back grind. Conduct LPI. Ensure defect free joint and weld the other side. Butt welds shall be ground flush. Conduct final LPI.

 Ranipet	Splicing Norms for Plates & sheets of APH components	Doc. No	PRQA: 410
		Rev	05
		Date	21 06 08
		Page NO	3 of 3

5. Identify the Right angle corner of the each plate with Paint and Hard punch the Specification, size, Firm code by punching and border with white paint.
6. Load all the plates in such a way that the identified right angle corners are in one corner with details visible from top.
7. Tack welds the stack as per OP&C Sketch.

4.0 Specific Requirements for Pedestals

1. One joint only allowed parallel to flange bend. (90° Deg) in addition to site joints envisaged in drg.
2. Joint shall be made at least 500 mm away from any side.

5.0 Specific Requirements for Housing Panels

1. One joint only permitted in either Horizontal or Vertical direction of each panel plate.
2. Minimum Joint shall be 500mm from any edge

6.0 Specific Requirements for bottom plate and side Plates and plate formed channels of Sector plates

1. No joint is permitted on Bottom plate.
2. One joint is permitted up to 4 meters length and 2 joints for more than 4 meters (across the bend line.) in side Plates and plate formed channels. Minimum Joint piece shall be 500mm.
3. EP and other requirement shall be as per Clause 2.9 and 100% LPI shall be carried out on final weld in the joint area.

7.0 Splicing of stay plate and Shell plate.

1. Splicing of stay plate and Shell plate is permitted if both dimension (length and width) is more than 1 meter. Joint shall be perpendicular to the axis of the rotor post. Minimum joint piece shall be 500 mm. Weld one side and reverse & back grind. Conduct LPI. Ensure defect free joint and weld the other side. Butt welds shall be ground flush. Conduct final LPI.

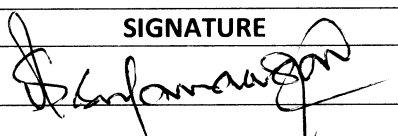
- 8.0 Splicing of duct wall is permitted if both dimension length and width is more than 1 meter. Minimum joint piece shall be 500 mm.

Revision Number/Date	Changes made
00/13 05 96	Original Issue.
01/31 05 96	Cl 2.10 Deleted
02/04 12 02	Requirement are reviewed & Up dated
03/ 01 09 04	Revised to include splicing norms for pedestals and housing panels
04/ 20 09 06	Clause 6 added in sub section-3 based on shop feed back.
05/ 21 06 08	Requirements completely reviewed and updated based on the discussion with WRI /Trichy. Amendment A1 details merged.





	SPLICING NORMS FOR SHEETS, PLATES AND ROLLED SECTIONS APPLICABLE TO GATES AND DAMPERS	Doc. No	PR: QA: 476
		Rev	00
		Date	30.05.2013

**SPLICING NORMS FOR SHEETS, PLATES AND ROLLED SECTIONS
APPLICABLE TO GATES AND DAMPERS**


PREPARED BY :

DEPARTMENT	NAME S/Shri	SIGNATURE
QA	K. Jothi Arulanandam Dy Mgr /QA	

REVIEWED BY:

DEPARTMENT	NAME S/Shri	SIGNATURE
Out Sourcing	N. Nandagopal Sr. Mgr / OS	
EDC – Gates & Dampers	V. Kesavan Sr. Mgr / Engg(GAD)	
Quality Control (OLI)	O. K. Abdulhuq Sr. Mgr /QC(OLI)	
Quality Assurance	R. Arunachalam Mgr/QA	

APPROVED BY:

DEPARTMENT	NAME S/Shri	SIGNATURE
QA	G. Balasubramanian Sr. DGM /QA, QC(Proc.) & BE	

	SPLICING NORMS FOR SHEETS, PLATES AND ROLLED SECTIONS APPLICABLE TO GATES AND DAMPERS	Doc. No	PR: QA: 476
		Rev	00
		Date	30.05.2013

1.0 SCOPE:

This procedure details out the **SPLICING NORMS** for Blade Plates and Rolled Sections viz., Angles, Channels, Beams and other structural applicable to Guillotine Gates and various Dampers.

2.0 GENERAL REQUIREMENTS:

- 2.1 Check for the material specifications of plates/sections, which are to be joined to avoid mix up of material.
- 2.2 TCN to be obtained for change of material
- 2.3 Welding Electrode selection shall be as per respective WPS.
- 2.4 Welding shall be followed with suitable methods and controls to minimize the distortion.
- 2.5 Welds over joint shall be avoided and minimum distance between stiffeners parallel to weld joint is 50mm.
- 2.6 Whenever back grinding is not feasible due to location of the plate / sheet, root welding to be carried out with 3.15 mm electrode and LPI to be carried out after thorough cleaning and repeat LPI after final welding.
- 2.7 Plus joint shall not be permitted when building up of plate to drawing size.
- 2.8 Cut out/opening /drilling on weld joint shall be avoided.

3.0 GUIDE LINES FOR EDGE PREPARATION (EP) :

Following are the guidelines for Edge Preparation (EP) if not specified in drawing.

- 3.1 **Plates and sheets up to 5mm:** No EP is required. Welds shall be with square butt with 2 to 3 mm root gap, weld on both sides. Final LPI / MPI
- 3.2 **Plates of 6mm:** No EP is required. Welds shall be with square butt with 2 to 3 mm gap. Weld from first side and turn the plate for back grind and conduct Root LPI. Complete the weld. Final MPI.
- 3.3 **Plates of 7mm, 8 mm:** Single "V" 60° EP on any one Plate. Weld from "V" side and turn the plate, back grind and conduct LPI, complete the weld. Final MPI.
- 3.4 **Plate above 8 mm:** Double "V" 60° EP . Weld one "V" side. Carry out back grind and conduct LPI, complete the weld. Final MPI.
- 3.5 **For structural (Angles, Channels, Beams) :** Single "V" 60° EP. Weld from "V" side and back grind and conduct LPI, complete the weld. Final LPI before splice plate setting.
- 3.6 **For Pipe Strut Joints –** Refer the clause no. 7.8

Note: Wherever cross members / seals are fouling on the weld, Flush grind weld metal and ensure flatness. There shall not be any depression at weld zone. Thickness at weld zone shall not go below the actual thickness on the plate. Check 100 % visual inspection.

	SPLICING NORMS FOR SHEETS, PLATES AND ROLLED SECTIONS APPLICABLE TO GATES AND DAMPERS	Doc. No	PR: QA: 476
		Rev	00
		Date	30.05.2013

4.0 SPECIFIC REQUIREMENTS FOR GATE BLADE:

- 4.1 Splicing of Gate (blade) plate may be either horizontal or vertical. Minimum width of plate shall be 500mm for blades joint and no joint shall be permitted with in 200 mm from the middle of blade for vertical joint.
- 4.2 No splicing in gate blade is permitted if blade width is 1.2 meter or less
- 4.3 Guillotine Gates – Electrically Operated (With or Without Bulb Seal) and Pneumatically Operated (Without Bulb Seal) – One joint is permitted for a plate width more than 1.2 mtr and up to 2.4 meter.
- 4.4 Guillotine Gates – Pneumatically Operated (Cold Air Gate / Hot Air Gate) with Bulb Seal – No joint is permitted on these gate blades as the width of blade will be always less than 2 Mtr.
- 4.5 For Plates of width more than 2.4 Mtr maximum two joints are permitted.
- 4.6 For Plate butt joints – Root LPI, back grinding and LPI shall be conducted 100%. Flush grind the joint and straighten the plate. Final MPI shall be conducted on both sides, if the plate thickness is more than 8 mm. Otherwise follow the clause no. 3.0 of this PR:QA.
- 4.7 Linear tolerance on length and width is + / - 1 mm /mtr subject to maximum of 5 mm.
- 4.8 Diagonal variation shall be within 1 mm / Mtr subject to maximum of 5 mm.
- 4.9 Blade bend shall not be more than 5 mm.
- 4.10 Blade shall be identified with size (Thickness X Length X Width) in each corner with Firm code.
- 4.11 Blade shall be stacked on a leveled platform to avoid any damage during stacking. Proper handling to be followed to avoid bend and damage.

5.0 SPECIFIC REQUIREMENT FOR SEAL AIR CHAMBER PLATE AND PLATE FORMED CHANNEL

- 5.1 No joint is permitted if the length is up to 2.0 Mtr and one joint is permitted for above 2.0 Mtr and up to 5.0 Mtr.
- 5.2 For above 5.0 Mtr two joints are permitted to build up the required length. However in any case more than two joints are not permitted.
- 5.3 The NDT requirements for this type of butt joints will be as per the clause no.3.0 & 4.6 as applicable of this PR:QA.

6.0 SPECIFIC REQUIREMENT FOR GATE FRAME

- 6.1 No joint is permitted for the channel section used in the gate frame (Bottom, side and super structure).
- 6.2 No joint is permitted in Port / Bonnet angles and plates.

	SPLICING NORMS FOR SHEETS, PLATES AND ROLLED SECTIONS APPLICABLE TO GATES AND DAMPERS	Doc. No	PR: QA: 476
		Rev	00
		Date	30.05.2013

7.0 SPECIFIC REQUIREMENT FOR CONTROL, LOUVER AND BI-PLANE DAMPER BLADES / CHANNELS / PLATES AND ANGLES

- 7.1 For Plates / Channels / Angles – No joint is permitted if the length is up to 2.0 Mtr and one joint is permitted for above 2.0 Mtr and up to 5.0 Mtr.
- 7.2 For above 5.0 Mtr two joints are permitted to build up the required length. However in any case more than two joints are not permitted.
- 7.3 Damper Blade joints are to be staggered on top and bottom.
- 7.4 Damper Frame – One joint (Plate) shall be permitted in length wise to built up the drawing size.
- 7.5 Damper side wall plate joint shall be 75 mm away from the end of Glade plate location.
- 7.6 Splicing of Channel joint is to be done inside only (in damper frame). For angle and plate no splicing plate is required on the joint area.
- 7.7 NDT requirement for this type of joints shall be as per the clause no. 3.0 & 4.6 as applicable.
- 7.8 For pipe strut joints, the same pipe for a length of 1.25 D has to be cut and strap joint has to be made with 3mm all around fillet weld.

NOTE:

The Splicing requirements mentioned in this PR:QA (PR:QA:476 Rev.00) is superseding the requirements mentioned in SQP:NP:03 with its relevant amendments and as well as SQP:NP:04 with its relevant amendments.

00	30.05..2013	a) As per QMI 1, this document has been renumbered to PR:QA:476 as this QWI is pertaining to Gates & Dampers and the existing PR:QA 602 Rev.00 Dtd.03.09.2009 has been withdrawn. b) Based on the requirement of Engg, OS and feedback from OS Vendors – more clarity and interpretation had been brought and incorporated in this document for Gate blade joints-Clause No.4, Pipe strut joints-Clause no.3.6 & 7.8 and Port & Bonnet joint requirements-Clause no.6.2 d) This document has been released with new QWI No as PR:QA:476 applicable to Gates & Dampers.
Rev No.	Effective Date	Details of Revision / Changes Made

Record Of Revisions

BHEL
RANIPET

BHARAT HEAVY ELECTRICALS LTD.
BOILER AUXILIARIES PLANT
RANIPET 632 406

PR:QA:500
PAGE 01 OF 05

QUALITY DEPARTMENT

PROCEDURE FOR

**ALLOWABLE DEVIATIONS FOR
DIMENSIONS WITHOUT SPECI-
FIED TOLERANCES**

EFFECTIVE DATE

16/01/93

	NAME	SIGNATURE	DATE
PREPARED BY	K NITHIANANDAM	<i>K. Nithianandam</i>	16/1/93
REVIEWED BY	S ANIL KUMAR	<i>S. Anil Kumar</i>	16/1/93
APPROVED BY	P H TAMBAKHE	<i>P. H. Tambakhe</i>	16/1/93

ISSUED BY : **QUALITY ASSURANCE**

REVISION : **NIL**

DATE :

DOCUMENT CONTROL NO:

7

File Name :PHT.RSU

QUALITY DEPARTMENT

1. Table 1 given below indicates the permissible variation in Linear Dimension of fabricated and machined components. The coarse grade is to be followed for fabricated components and medium grade for machined components.
2. Table 2 given below indicates the permissible deviations for Radii & Chamfers for machined components.
3. Table 3 given below indicates the permissible deviations for Angular dimensions for machined components.
4. Table 4 given below indicates the conditions under which the deviations given in this standard are not applicable.
5. Special rulings may be stated for linear dimensions of welded structures consisting of several assemblies.
6. If closer tolerances than those given in this procedure are necessary, the same shall be indicated in the relevant drawings.

TABLE - 1

 PR:QA:500
 Page 03 of 05

Deviations in mm for the nominal size range in mm													
Degree of accuracy	0.5 * up to 3	Over 3 upto 6	Over 6 upto 30	Over 30 upto 120	Over 120 upto 400	Over 400 upto 1000	Over 1000 upto 2000	Over 2000 upto 4000	Over 4000 upto 8000	Over 8000 upto 12000	Over 12000 upto 16000	Over 16000 upto 20000	
f (fine)	± 0.05	± 0.05	± 0.1	± 0.15	± 0.2	± 0.3	± 0.5	± 0.8	-	-	-	-	
m (medium)	± 0.1	± 0.1	± 0.2	± 0.3	± 0.5	± 0.8	± 1.0	± 2	± 3	± 4	± 5	± 6	
g (coarse)	± 0.15	± 0.2	± 0.5	± 0.8	± 1.2	± 2	± 3	± 4	± 5	± 6	± 7	± 8	
sg (very coarse)	-	± 0.5	± 1	± 1.5	± 2	± 3	± 4	± 6	± 8	± 10	± 12	± 12	

* In the case of nominal sizes below 0.5 mm, the deviations must be specified directly by the side of the nominal size.

TABLE - 2

DEVIATIONS FOR RADII & CHAMFERS

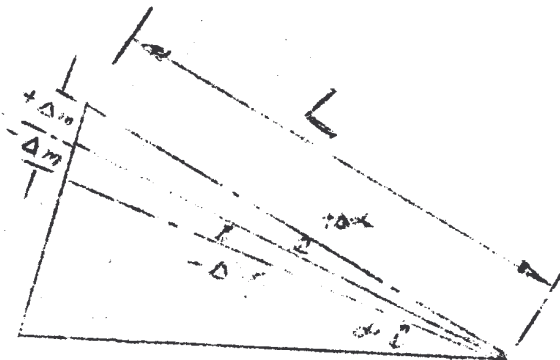
All dimensions are in mm

CLASS OF DEVIATION	RANGE OF NOMINAL DIMENSIONS					
	Above	0.5	3	6	30	120
Fine & Medium	Upto and Including	3	6	30	120	315
		± 0.2	± 0.5	± 1	± 2	± 4

TABLE - 3

DEVIATIONS FOR ANGULAR DIMENSIONS

$\Delta\alpha$ =Angle Tolerance
in angular units
 Δm =Angle Tolerance
in linear units



All Dimensions are in mm

CLASS OF DEVIATIONS	Length (L) of shorter side of angle in mm							
	Above	-	10	50	120	500	800	1250
	Upto & including	10	50	120	500	800	1250	2000
FINE AND MEDIUM	Δm (mm)	± 0.1	± 0.2	± 0.6	± 0.8	± 0.96	± 1.125	± 1.5
	$\Delta\alpha$ (deg or min)	$\pm 1^\circ$	$\pm 30'$	$\pm 20'$	$\pm 10'$	$\pm 4'$	$\pm 3'$	$\pm 2'3''$

TABLE - 4
NON APPLICABILITY OF THE STANDARD

STANDARD SPECIFICATION	CONDITIONS FOR TOLERANCING	DIMENSIONS	PRODUCTION METHOD	SPECIAL AGREEMENTS
where permissible deviations have been specified	where higher values than those specified in Table 1 and 2 may be allowed.	For dimensions required to give a certain class of it	Casting, forging, pressing, rolling, welding, flame cutting	where variations from this standard are agreed upon between the purchaser and the manufacturer
	Where only positive or only negative deviations are desired Where parts are manufactured separately and are required to be assembled together without any further treatment (selective assembly, spare parts etc)	Where concentricity between parts is required For angular dimensions of a circular division (For example, angular position- ing of teeth of clutches) For angular dimensions in precision taps and in pipe bends For dimensions of welded assemblies (unless the part is to be machined)		


BHEL: BAP:RANIPET
QUALITY DEPARTMENT

MASTER COPY

PR : QA :505
REV . NO . 01
DATE . 14 .07 .93
PAGE 01 OF 05

PROCEDURE FOR STORAGE OF SHELF LIFE ITEMS LIKE RUST
PREVENTIVE FLUIDS , PAINTS , RUBBER COMPONENTS ,
GREASE AND ANTISEIZE COMPOUNDS AND SIMILAR
COMPONENTS / ITEMS.

EFFECTIVE DATE : 14 . 07 . 93

	Name	Signature with date
Prepared by	V JAYRAMAN	 14/7/93
Reviewed by	P H TAMBAKHE	 14/7/93
Approved by	R N MISRA	 14/7/93

ISSUED BY : SM / QUALITY ASSURANCE

CONTROLLED COPY NO | |

INFORMATION COPY | |

BHEL : BAP : RANIPET
QUALITY DEPARTMENT

PR : QA : 505
REV . NO . 01
DATE . 14 . 07 . 93
PAGE 02 OF 05

Record of Revisions

Sl no	Revision carried out	Reason
01	S1 nos 1, 5, 7, 9 & 10 the method of storage revised.	-----

PROCEDURE FOR STORAGE OF LOW SHELF LIFE ITEMS LIKE

ANTI SEIZE / THREAD COATING COMPOUNDS , GREASES , PAINTS ,
RUST PREVENTIVE FLUIDS, RUBBER COMPONENTS

1.0 SCOPE:

This procedure spells out the method of storage of low shelf life items like antisize/thread coating compounds , greases , paints , rust preventive fluids and rubber compounds .

2.0 STORAGE

Please See the table . 1 . The method of storage of low shelf items is given in the table .

TABLE 1

S.No.	Description	Category	Method of storage	Items covered under the category .
01	Anti Seize compound/greases	L	Indoor storage in closed containers well ventilated and dry rooms , away from heat sources sunshine , flames , gas cylinders .	Thread Coating compounds , greases , molysulf lubricants etc.
02	Sealing Compounds	L	Indoor storage closed containers well ventilated and dry rooms , away from heat sources sunshine , flames , gas cylinders / solvents etc. . If containers are damaged, reject the item	All sealing compounds

03	Rust preventive fluids (film forming type)	RPF	Outdoor, undershade Dry condition away from 1)Flame heat 2) Sunshine, 3)Gas cylinders, 4)Petrol Diesel, Kerosene other solvents 5) Near Fire extinguishing equipment .	Collecting Electrode rust preventive fluids, candopeel, strippable Coating.
04	Rust preventive fluids (non film forming type)	RPN	- DO -	APH heating element rust preventive fluids .
05	Natural Rubber Solvents, alkalis ,	RB	Indoor storage well ventilated dry rooms with paper and chalk powder wrappings, Away from oils, acids and flames , sunshine , weld heat.	Gaskets ,washers, forms, shapes, tubes pipes , conduits etc. .
06	Synthetic Rubber	RS	- DO -	- DO -
07	Red Oxide Zinc Chrome paints IS 2074	PR	In sealed containers indoors: In dry and well ventilated rooms Away from heat & flame , gas cylinders, flammable materials like Petrol , Diesel ,Kerosene etc .	- DO -
08	IS 2932 Synthetic enamel paints		- DO -	All Colors shades .

09 . Epoxy Paints	PEPX	In sealed containers. Indoor Dry condition . On separate racks ; Away from heat , flammable materials like Petrol , Diesel Kerosene , solvents .	This category includes Inorganic Zinc Rich paints also .
-------------------	------	--	--

10 . Chlorinated rubber paints .	PCLR	In sealed containers. Cool Dry place . Indoor only. Away from flame , heat, flammable materials like petrol , Diesel kerosene.
-------------------------------------	------	---

D: PRQA

BHEL
RANIPET
QUALITY DEPARTMENT

PR :QA:509

PAGE 01 OF 02

GUIDELINES FOR

NDT REQUIREMENTS ON
GAS CUT EDGES

EFFECTIVE DATE

04-08-93

PREPARED BY

B SRINIVASA RAO

B. Srinivasa Rao

REVIEWED BY

P.H.TAMBAKHE

P.H. Tambakhe

APPROVED BY

R N MISTRA

R.N. Mistra

ISSUED BY: QUALITY ASSURANCE

REV. NO.:00

CONTROL NO

1.0 SCOPE :

The procedure specifies the items for which for which Magnetic Particle Testing shall be conducted on gas cut edges.

2.0 PREFERENCE:

Sheet 7 of 12 of CE spec .M&P spec No.: 5.11.1.1.(s) dated 05-11-84 and review with SM/QA

3.0 GENERAL :

All gas cut edges which are machined later need not be examined by MT (Magnetic Particle Testing)

3.1 Plates above 38.1 mm for the items specified below shall only be tested. Stiffeners need not be non-destructively tested.

3.1 A FANS: Center plate , AP fan impeller hub flanges. Flanges for Conical cover plate, Flange for AP fan cover plate ,Impeller rings made of plate ,Conical cover plate seating rings.

3.1 A APH: Lug plates of lug assembly ,Rotor post header plates.

3.1 C ESP/Structural items: plates used as flanges for floor beams and those structural items for which NDT requirements are specified in other transmittals like QPS, Letters etc.

4.0 Reference standard and acceptance norm for MT shall be as per BHE :NDT:RP:MT:01/ latest revision.

BHEL::BAP::RANIPET
QUALITY DEPARTMENT

PR:QA:512
REV:00
Dt:31.1.94
Page 01 OF 04

PROCEDURE FOR

CONTROL OF SURFACE PREPARATION AND
PAINTING OF FABRICATED COMPONENTS
AT SUB-CONTRACTORS WORKS.

EFFECTIVE DATE

31.1.94

NAME

SIGNATURE & DATE

PREPARED BY

V JAYARAMAN

REVIEWED BY

H ANANTHANARAYAN

APPROVED BY

R V MISRA

ISSUED BY

QUALITY ASSURANCE

CONTROL COPY NUMBER

MASTER COPY

PROCEDURE FOR CONTROL OF SURFACE PREPARATION AND PAINTING OF
FABRICATED COMPONENTS AT SUB-CONTRACTORS WORKS.

1.0 SCOPE:

- 1.1 This procedure details out the requirement for surface preparation and painting of all fabricated components at sub-contractors works.

1.1.1 Surface preparation equipment:

The sub-contractor should have the minimum surface preparation equipment as mentioned below:

- a) Wire brush
- b) Emery sheets of rough type
- c) Power wire brush to be used with pneumatic or electrical motors
- d) Brush for cleaning the dust removed by wire brushing power tool cleaning

- 1.2 Whenever any special requirement for surface preparation and painting are required, the same shall be indicated in the drawing or shall be informed separately to sub-contractors.

- 1.3 This PRQA is in line with the requirement of Painting Schedule RP 0674199.

2.0 SURFACE PREPARATION:

2.1 CLEANING OF OIL, GREASE ETC

- 2.1.1 The entire outer surface of the fabricated components shall be thoroughly cleaned using mineral turpentine, wire wheel, grinding wheel to make it free from OIL, GREASE, RUST, MILL SCALES and weld spatters.

2.2 METHOD OF RUST REMOVAL

- 2.2.1 Wire brush, emery sheets of rough type, Power /rotary wire wheel may be used for removing the dust, rust and mill scales from the surface.

- 2.2.2 The "Rustkil" (rust remover/converter) shall be applied whenever the rust cannot be removed by using power tool cleaning.

- 2.2.3 Only after clearance of surface preparation by BHEL Inspection/BHEL Authorised Inspection Agencies the sub-contractor can proceed with painting.

0 PAINTING

1 Only paints from BHEL approved suppliers shall be applied.

2 After visual inspection and clearance by QC BHEL/Authorised Inspection Agency one coat of red oxide Zinc chrome primer as per IS 2074 shall be applied by brushing to a dry film thickness of approx 25 microns.

3 The paint shall be allowed to hard dry and thoroughly before applying the second coat. Second coat shall be applied only after 18 hours.

4 A second coat of IS 2932 Synthetic Enamel smoke grey paint shall be applied over the primer to a coating thickness of 20 microns approximately.

5 The small items shall be dipped in the paint tank.

The final inspection of the component shall be offered to QC BHEL/Authorised Inspection Agency only after hard drying of the enamel paint and stencilling of work order No, D.U.No, details.

All edge prepared areas for welding at shop/site at later stage shall be applied with one coat of weldable primer.

Any scratches and soil sticking on the surfaces during handling shall be repaired before despatch to BHEL/Shipping.

K. S. S. S.

RECORDS:

The firm shall record the make/brand name and batch number of the approved paint used in the dimension report.

1. The sub-contractors shall maintain records of the primer paints procured, the source of the primer paints namely dealer, the manufacturer of the primer paints, the batch number of the primer paints and the delivery chalan reference for the paint procured along with the quantity and also copy of the test certificates certifying the quality of the paint. These records shall be verified by BHEL inspector immediately on procurement of the paint by sub-contractor and shall be countersigned by BHEL inspector. This record is subject to audit by Quality Assurance.

4.2 The firm shall show the details/evidence for procurement of approved paints to QC personnel(BHEL)/Authorised Inspection Agency whenever required during surveillance checks/audits. The sub-contractor before use of primer paints shall verify the correctness of specification of the primer paints before opening the drums. The drum shall be rolled roughly 20 times before opening the seal and stirring the contents. the contents shall be thoroughly stirred using a steel rod and shall be checked for any settling of pigment. If any pigment settlement is observed the process of resealing, rolling, stirring thereby redispersal of the paint pigment into the medium is to be ensured. Now a small quantity can be transferred to painting cans and applied by neat brushes of width atleast 3 inches.

4.3 The sub contractor shall ensure that the required number of primer coats are given on the components as per the painting schedule RP 0674199. Visual inspection shall be done for checking damages, poor paints, improper finish. After the paint films dry the inspector will randomly check the coating thickness with coating thickness gauge for the correctness of the thickness of the paint in case of any doubt.

5.0 TESTING OF PAINT SAMPLES

5.1 QC BHEL personnel shall collect random samples of paint (approx 1 litre) and submit the same to Quality Assurance for testing. Such random samples may be collected whenever any doubt arises about the quality of paint while carrying out visual inspection. Alternately QC/OLI may scrape dried paint film from painted surfaces for testing at paint test lab.

5.2 In case any batch of paint is found not conforming to requirement, the concerned brand of paint shall be removed from the approved list of paint suppliers of BAP, Ranipet.

 Ranipet	Rust preventive fluid specification (Non drying type)	Doc. No	PRQA: 522
		Rev	00
		Date	12 02 08
		Page NO	01 of 01


1.0 Scope

1.1 This specification covers the requirements of temporary rust preventive fluid (Non drying type) used for APH heating elements by dipping process.






1.2 Details of specification

SL No	Details	Acceptance norms
01	Specific gravity at 27 ° C	0.80 – 0.85
02	Flash point degree C (Min)	35°C
03	Viscosity Ford Cup 4	18± 2 seconds
04	Water content (max)	0.5%
05	Drying time max (hard dry)	No drying
06	Corrosion under conditions of condensation for 300 hrs	No rusting
07	Corrosion resistance under indoor conditions for one month	No rusting.

1.3 shop QC to verify the viscosity using ford cup 4 at regular interval (once in a week time) to maintain with in 18± 2 seconds and record.

 Prepared By	Reviewed By	QC		 Approved BY
		QA	B. Srinivasulu	

 RANIPET	<u>QUALITY ASSURANCE</u> SURFACE PREPARATION AND PAINTING PROCEDURE FOR DESALINATION COMPONENTS	PRQA: 526 REVISION: 01 DATE: 14.08.01 PAGE: 1 OF 5
---	--	---

PROCEDURE FOR		<i>SURFACE PREPARATION AND PAINTING OF COMPONENTS OF DESALINATION PLANTS</i>	
EFFECTIVE DATE		14.08.2001	
PREPARED BY	NAME	DEPARTMENT	SIGNATURE
	K.RAJADURAI	QA	
REVIEWED BY	B.SRINIVASA RAO	QA	
	M.NATARAJAN	EDC/DCI	
	M.RAVINDRA	MSA	
	P.RAJASEKARAN	QC/OLI	
APPROVED BY	H.ANANTHANARAYANAN	QA	
REVISION NO.		01	
ISSUED BY		QUALITY ASSURANCE	
CONTROL COPY NO.			
ISSUED TO SHRI.			

 RANIPET	<u>QUALITY ASSURANCE</u> SURFACE PREPARATION AND PAINTING PROCEDURE FOR DESALINATION COMPONENTS	PRQA: 526 REVISION: 01 DATE: 14.08.01 PAGE: 2 OF 5
--	---	---

RECORD OF REVISIONS		
REVISION NO.	DETAILS OF ISSUE	DATE OF ISSUE
00	ORIGINAL ISSUE	09.05.96
01	EDITORIAL CORRECTION	14.08.01

 RANIPET	<u>QUALITY ASSURANCE</u> SURFACE PREPARATION AND PAINTING PROCEDURE FOR DESALINATION COMPONENTS	PRQA: 526 REVISION: 01 DATE: 14.08.01 PAGE: 3 OF 5
--	--	---

PROCEDURE FOR SURFACE PREPARATION AND PAINTING OF COMPONENTS OF DESALINATION PLANTS

1.0 SCOPE:

This procedure gives guidelines for surface preparation and painting of components of Desalination Plants.

2.0 The following are not under the purview of this procedure.

- 2.1 Masonry structures, PVC tubes, pipes & fittings, FRP vessels, pipes components and glass.

3.0 PROCEDURE:

- 3.1 The following components of Desalination Plants are under the purview of this procedure.

- (a) Membrane Racks
- (b) Valve supports and clamps, Pipe supports and clamps
- (c) Supporting Structures
- (d) Carbon steel filters, hand rails, platforms
- (e) Shed Structures
- (f) Handling Equipment
- (g) Cranes
- (h) Electric motors, base frame
- (i) Any other component specified in the drawings.

4.0 SURFACE PREPARATION SCHEME:

- 4.1 Except stainless steel pipes and fittings (and Aluminium if any) all other steel surfaces shall be sand / shot blasted to SA 2½ finish as per Swedish Standard SIS 055900 before painting.

 RANIPET	QUALITY ASSURANCE SURFACE PREPARATION AND PAINTING PROCEDURE FOR DESALINATION COMPONENTS	PRQA: 526 REVISION: 01 DATE: 14.08.01 PAGE: 4 OF 5
--	---	---

5.0 PAINTING SCHEME:

See Table – 1 below.

TABLE – 1

Scheme	Paint Type
PS 1	Epoxy Zinc Phosphate Primer Paint
PS 2	Epoxy finish Paint

5.1 The probable paint supplier can be as follows:

- a. Asian Paint (India) Ltd.
- b. Bombay Paints
- c. Berger paints India Ltd.
- d. Goodlass Nerolac paints Ltd.
- e. Garware Paints
- f. Jenson & Nicholson
- g. Shalimar paints

Sl. No	Component	Surface Preparation	Primer	No. of Coats	DFT Total Microns	Finish Paint	No. of Coats	DFT Total Microns
01	Membrane Racks	SA 2 ½	PS 1	2	100	PS 2	2	100
02	Valve Supports and Clamps	SA 2 ½	PS 1	2	100	PS 2	2	100
03	Supporting Structures	SA 2 ½	PS 1	2	100	PS 2	2	100
04	Carbon steel filters (outer surfaces)	SA 2 ½	PS 1	2	100	PS 2	2	100
05	Hand Rails & Platforms	SA 2 ½	PS 1	2	100	PS 2	2	100
06	Shed Structures & Clamps	SA 2 ½	PS 1	2	100	PS 2	2	100
07	Handling Equipment	Leave greased/oiled surfaces free (for other follow scheme)	PS 1	2	100	PS 2	2	100
08	Cranes	- do -	PS 1	2	100	PS 2	2	100

 RANIPET	<u>QUALITY ASSURANCE</u> SURFACE PREPARATION AND PAINTING PROCEDURE FOR DESALINATION COMPONENTS	PRQA: 526 REVISION: 01 DATE: 14.08.01 PAGE: 5 OF 5
---	---	---

6.0 GENERAL PRECAUTIONS:

- 6.1 Do not delay painting after Sand / Shot blasting. Maximum delay permitted is only half an hour.
- 6.2 Do not paint when the weather is rainy or the temperature is below 20⁰ C.
- 6.3 The epoxy primer and finished paints are two component paints. The components must be mixed in the proportions given by the manufacturer only. The application of epoxy paints shall be completed with in 2 hours of mixing.
- 6.4 The etch/wash primers are also two component paints, which must be mixed in proportions given by the manufacturer.

7.0 IMPORTANT:

If the components are to be painted at site one coat of EPOXY FINISH PAINT of DFT 50 Microns SHALL BE GIVEN.

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	1 of 12

Procedure for Surface preparation and Painting

Prepared By	V SUNDARAM SEF/QA	<i>V Sundaram</i>
-------------	-------------------	-------------------

Reviewed By	B SRINIVASA RAO DGM/QA	<i>B. Srinivasa Rao</i>
	S RAGHUNATHAN SM/EDC/APH	<i>S Raghunathan</i>
	P JAYAKANTH DGM/EDC/AQCS	<i>P. Jayakanth</i>
	K GOPALASAMY SDGM /EDC/FANS	<i>K. Gopal</i>
	P RAVIKUMAR DGM/ EDC /G&D AND DP	<i>P. Ravi Kumar</i>

Approved By	H ANANTHANARAYANAN AGM/QA&OLI	<i>H Ananth</i>
-------------	-------------------------------	-----------------

 Ranipet	Procedure for Surface Preparation and Painting	Doc. No	PRQA: 590
		Rev	01
		Date	02 02 08
		Page NO	2 of 12

Record of revision

Rev No.	Effective Date	Details of revision
00	10 10 02	RP0674199 Rev 05 requirements and PRQA 590 rev 12 requirements were fully reviewed and this document is released as Rev 00 taking care of painting requirements of BAP projects. For project specific painting schemes respective CIS or contract specific painting schemes to be referred.
01	22 05 07	Painting requirement are fully reviewed. Red oxide Zinc chromate for primer application (IS 2074) is corrected as Red oxide Zinc phosphate primer (IS 12744) and also number coats & DFT corrected.

Issued by: Quality Assurance Dept BHEL Ranipet.

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	3 of 12

1.0 SCOPE

- 1.1. This procedure specifies requirements for surface preparation and painting and coating, for APH, Fan, ESP, Gates & Dampers and Chimney. (For WEG and Desalination, please refer PRQA: 518/Latest and PRQA: 526/Latest respectively).
- 1.2. Section I deals with surface preparation schedule and section II deals with painting and coating.
- 1.3. Special contractual requirements, if any, will be indicated through a separate contract specific documents with customer approval, when required. The linkage will be provided in the CQR issued by QA.

2.0 GENERAL

- 2.1 This procedure specifies painting requirements to provide adequate protection up to one year in open yard at site.
- 2.2 No painting shall be applied on the stainless steel, galvanized and any plated surfaces. For estimation of requirements of painting, the approximate area of coverage on non-absorbing surface is as given below: -

SL. No.	Generic nature of paint	Theoretical covering area (Sq.M/litre)	DFT /Coat (Min)	Shade
1	Red oxide zinc phosphate primer to IS 12744	10	30	Red oxide
2	Synthetic enamel paint to IS 2932	10	20	Smoke grey
3	Heat resistant aluminum paint to IS 13183	10	20	Aluminium

- 2.3 For bought out items, the painting scheme shall be as per purchase specification. If this is not specified in purchase specification, the following is the minimum requirement
 - a) Primer: One coat of red oxide zinc Phosphate primer to IS 12744- DFT 30 microns
 - b) Finish: Two coats of synthetic enamel to IS 2932 smoke grey shade No.692 of IS 5. -DFT 20 microns per coat

Section –I

3.0 SURFACE PREPARATION REQUIREMENTS FOR PAINTING AND COATING

- 3.1. The effectiveness and duration of the protection provided by organic, inorganic and metallic coatings for corrosion protection depends among other things decisively on proper surface preparation. This section deals with the methods of surface preparation, their effectiveness and fields of application.
- 3.2. This section largely based on ISO 8501 – 1: 1988 that in turn is based on the Swedish standard SS 05 59 00.

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	4 of 12

3.3. SURFACE PREPARATION METHODS

3.3.1. Surface preparation depends on initial condition of uncoated surfaces. The details of rust level, rust removal methods and characteristics surfaces are given in table 1.0.

3.4. DEFINITIONS AND METHODS OF CLEANING

3.5. CLEANLINESS OF SURFACES.

3.5.1. Cleaning requirements and levels of cleanliness, contaminants such as dirt, oil that will interfere with the adhesion or effectiveness of the proposed coating must be removed. Coats of materials related to the metal (scale, rust) and coats of different materials (e.g. existing coating) should be removed until the agreed level of cleanliness is attained.

3.5.2. Contaminants/coats, both of related material and of materials different from the metal may be removed in one operation if the nature, level and thickness permit this. The required level of cleanliness depends on

- The corrosion protection system selected
- The type of corrosion exposure expected
- The initial condition of the surface being prepared
- The possible rust removal method
- Economic considerations

3.5.3. Generally, the standard levels of cleanliness as in table 1.0 should be used as a basis. This does not cover the removal of weld spatter, weld or flame cutting slag or chips, repair grinding of rolling defects (laminations) deburring and similar operations.

3.6. MECHANICAL METHODS OF REMOVING RUST

3.6.1. Manual rust removal:

3.6.1.1. This applies to standard levels of cleanliness St 2, St3 as per table 1.0 manual cleaning uses wire brush, stripping knife, Swedish scraper, rust removing hammer etc., The method must not damage the metal being derusted. Subsequent cleaning by sweeping or brushing off or by blowing off with dry air.

3.6.2. Mechanical rust removal:

3.6.2.1. This applies to standard levels of cleanliness St2, St3 as per table 1.0 cleaning can be done by mechanically driven rust removing tools viz., rotating wire brush, impact piston devices or rotary descalers, sanding discs etc. The surface areas where the power driven tool cannot enter, manual cleaning should be done. The method must not damage the metal being derusted. Subsequent cleaning by sweeping or brushing off or blowing off with dry air.

3.6.3. Blast cleaning

3.6.3.1. This applies to standard levels of cleanliness Sa 1, Sa 2½, Sa 3 as per table- 1.0. Chemically contaminated surfaces must be pre-washed. Surfaces having coarse rust must be pre-cleaned with impact tools prior to blast cleaning.

3.6.3.2. Compressed air blasting is generally recommended for our operations. It is a freely directed air blasting in blasting cubicles, Rooms or sheds with re-circulation of blasting abrasives.

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	5 of 12

3.6.4. REMOVAL OF CONTAMINANTS/COATS OF MATERIAL DIFFERENT FROM THE METAL

3.6.4.1. Surface of metal contaminated with cutting fluid (machine coolant) oil or grease shall be wiped with mineral turpentine/tri-chloroethylene prior to applying any methods of mechanical surface preparation.

3.6.4.2. If any old paint film or rust preventive films are present they may be removed with paint removing jelly.

3.6.4.3. As far as possible the cleaning method should be so chosen that all the scale is removed from the metallic surface to be coated. For heavily scaled metallic surfaces either blasting or pickling may be adopted over and above the requirements called for in the table 1.0.

3.6.5. NOTES TO TABLE 1.0

3.6.5.1. Initial condition of uncoated surfaces (rust grade as per SS 05 59 00)

- Steel surface largely covered with adhering mill scale but little, if any rust.
- Steel surface, which has begun to rust, and from which the mill scale has begun to flake.
- Steel surface on which the mill scale has rusted away or from which it can be scrapped, but with slight pitting visible under normal vision.
- Steel surface on which the mill scale has rusted away and on which general pitting is visible under normal vision.

3.6.5.2. Standard level of cleanliness equivalent to steel structures painting council of US (SSPC) also given in brackets in table 1.0.

Table 1.0

Standard level of cleanliness	Rust removal method	Initial condition of steel surfaces (Uncoated ref.4.5)	Essential Characteristics of the prepared steel surface
St 2 (SSPC-SP 2)	Thorough hand and power tool cleaning	B, C, D	When viewed without magnification, the surface shall be free from visible oil, grease and dirt, and from poorly adhering mill scale, rust coatings and foreign matter.
St 3 (SSPC SP 3)	Very Thorough hand and power tool cleaning	B, C, D	As for St 2, but the surface shall be treated much more thoroughly to give a metallic sheen arising from the metallic substrate.
Sa 1 (SSPC SP 7)	Light blast cleaning	B, C, D	When viewed without magnification, the surface shall be free from visible oil, great and dirt, and from poorly adhering mill scale, rust, paint coatings and foreign matter.
Sa 2 (SSPC SP 6)	Thorough blast cleaning	B, C, D	When viewed without magnification, the surface shall be free from visible oil, grease and dirt, and from most of the mill scale, rust, paint coatings and foreign matter. Any residual contamination shall be firmly adhering.

 Ranipet	Procedure for Surface Preparation and Painting	Doc. No	PRQA: 590
		Rev	01
		Date	02 02 08
		Page NO	6 of 12

Standard level of cleanliness	Rust removal method	Initial condition of steel surfaces (Uncoated ef.4.5)	Essential Characteristics of the prepared steel surface
Sa 2 ½ (SSPC SP 10)	Very Through blast cleaning	B, C, D	When viewed without magnification, the surface shall be free from visible oil, grease and dirt, and from the mill scale, rust, paint coatings, and foreign matter. Any remaining traces of contaminations shall show only as slight stains in the form of spots or stripes
Sa 3 (SSPC SP 5)	Blast cleaning to visually clean steel.	A,B, C, D	When viewed without magnification, the surface shall be free from visible oil, grease and dirt, and from mill scale, rust, paint coatings and foreign matter. It shall have a uniform metallic colour.

 Ranipet	Procedure for Surface Preparation and Painting			Doc. No	PRQA: 590
				Rev	01
				Date	02 02 08
				Page NO	7 of 12

Section -II

4.0 SCHEDULE OF PAINTING AND COATING:

Table 2.0

Sl.No.	Component/PGMA	Surface preparation	Primer	DFT in µm (Min)	Finish	DFT in µm (Min)	Total DFT (Min)
1.0	Regenerative Air Pre-Heaters						
1.0.1	Heating element baskets (without elements) 52 010, 024, 025	Power tool cleaning to ST-3 (SSPC SP3)	One coat of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	30	NIL	--	30
1.0.2	Heating elements (with elements) 52 010, 024, 025	--	(*) Temporary rust preventive oil non dry type (Dipping)	--	NIL	--	--
1.0.3	Rotor post assembly machined items of (52 011), Pin rack assembly (52 012) seals (52 013,054,055), sector plates (52 041,042) and machined components of APH.	--	(**) Temporary rust preventive oil Dry type	20	NIL	--	20
1.0.4	Components in flue gas path and insulated Rotor post assy (52 011), T bars (52 013), Rotor housing assy. (52 030), Hot and cold connecting plate assy. (52 041,042),	Power tool cleaning to ST-3 (SSPC SP3)	Two coats of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	60	NIL	NIL	60

(*) Specification as per PRQA 522/Rev 00

(**) Specification as per PRQA 523/Rev 00



Ranipet

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	8 of 12

Sl.No.	Component/PGMA	Surface preparation	Primer	DFT in μm (Min)	Finish	DFT in μm (Min)	Total DFT (Min)
--------	----------------	---------------------	--------	-------------------------------	--------	-------------------------------	--------------------

1.0.5	Components exposed to Atmosphere Rotor drive assy (52 100), Access door (52 210, Air seal piping (52 211), observation port other than glass part (52 212), Rotor stoppage alarm other than aluminum (52 217), Loose items of Air receiver (52 220), Guide bearing assy (52 261), Support bearing assy (52 262), Oil piping GB, SB (52 271,272) oil circulation unit (52 274), Deluge and wash pipe assy. (52 301,302,401,402) Cleaning device assy (52 325, 326), Cleaning device drive (52 329,429), Thermo couple pipe assy. Other than SS (52 360)	Power tool cleaning to ST-3 (SSPC SP3)	One coat of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	30	Two coats of synthetic enamel paint to IS 2932 shade 692 of IS 5 unless specified otherwise.	40	70
-------	--	--	--	----	--	----	----

2.0	TUBULAR AIRPREHEATER						
2.1	Side walls (external surfaces and internal surfaces).	Power tool cleaning to ST-3 (SSPC SP3)	Two coats of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	60	--	--	60
2.2	Machined surfaces, tubes of TAPH, Tube plates and intermediate plates	---	(**) Temporary rust preventive oil Dry type	20	NIL	NIL	20



Ranipet

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	9 of 12

Sl.No.	Component/PGMA	Surface preparation	Primer	DFT in μ m (Min)	Finish	DFT in μ m (Min)	Total DFT (Min)
--------	----------------	---------------------	--------	-------------------------	--------	-------------------------	-----------------------

3.0	Fans						
3.1	Foundation materials 55 0XX, 56 0XX	Power tool cleaning to ST-3 (SSPC SP3)	Temporary Rust preventive	20	--	--	20
3.2	<u>Components exposed to atmosphere</u> a) Bearing Pedestals, Base frame, Servomotor assy, shaft with Bearing assy, OGV, IGV (55-1XX, 55-2XX 55-3XX). b) Bearing Pedestals, Base frame, Shaft with bearing assy, RVC, IGV, Support for Seal, shaft protecting tube, Spiral casing (if no insulation is applicable), Damper (56-1XX, 56-2XX 56-3XX, 56-4XX) c) Coupling guard (56-8XX, 55-8XX). Tools (56-000, 55-000)	Power tool cleaning to ST-3 (SSPC SP3)	One coat of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	30	Two coats of synthetic enamel paint to IS 2932 shade 692 of IS 5 unless specified otherwise.	40	70
3.3	<u>Components in AIR/GAS and under insulation</u> a) Suction chamber, diffuser, housing, OGV, impeller (55-1XX, 55-2XX, 55-3XX), b) Spiral casing, damper, IGV, RVC, impeller, shaft (56-1XX, 56-2XX, 56-3XX 56-4XX). c) Silencer (56-9XX, 55-9XX)	Power tool cleaning to ST-3 (SSPC SP3)	Two coats of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	60	NIL	NIL	60
3.4	Journal area Of shaft (55-1XX, 56-1XX, 55-2XX, 56-2XX, 55-3XX, 56-3XX 56 4XX						
3.5	All machined surfaces shall be applied with rust preventive.						

Refer PRQA 341 / Latest

Issued by: Quality Assurance Dept BHEL Ranipet.



Ranipet

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	10 of 12

Sl.No.	Component/PGMA	Surface preparation	Primer	DFT in μm (Min)	Finish	DFT in μm (Min)	Total DFT (Min)
--------	----------------	---------------------	--------	-------------------------------	--------	-------------------------------	-----------------------

4.0 Electro static precipitator

4.1	GD drive Arrangement (7X X10), Drive arrangement for emitting system (7X X17), Inspection doors (7X X23), Drive arrangement for CE rapping (7X X26), Outer roof (7X X42), ESP pent House (7X X55), ESP test equipment (7X X61) Water washing system (7X X66) Tools and tackles (7X 996), Lifting beam (7X X20), Columns (7X X81) Hopper approach platform (7X X 65), Stringer and Guard plates (7X 610).	Power tool cleaning to ST-3 (SSPC SP3)	One coat of red oxide zinc phosphate primer to IS 12744 (Varnish medium alkyd)	30	Two coats of synthetic enamel paint to IS 2932 shade 692 of IS 5 unless specified otherwise.	40	70
-----	--	--	--	----	--	----	----

4.2	Insulator Housing assy.(7X X06), Gas distribution assy.(7X X08),GD rapping mechanism(7X X09), Gas screening (7X X11), Emitting system suspension (7X X13), Emitting electrode rapping (7X X16), Suspension arrangement for CE (7X X19), Frame of Emitting system Top & Bottom and Middle.(7X X21,X22,X32),Shock bars(7X X24), CE Rapping mechanism (7X X25), Ridges(7X X43), Hopper upper and Lower & Middle part (7X X44, X45),Insulator support panel (7X X46), Roof panel assy. (7X X47), Casing structure (7X X28, X48), Casing shell (7X X49), ESP Funnel (7X X50), Splitter&Guidevane (7X X57)	Power tool cleaning to ST-3 (SSPC SP3)	Two coats of red oxide zinc phosphate primer to IS 12744 (Varnish medium alkyd)	60	NIL	--	60
-----	--	--	---	----	-----	----	----

Issued by: Quality Assurance Dept BHEL Ranipet.



Ranipet

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	11 of 12

Sl.No.	Component/PGMA	Surface preparation	Primer	DFT in µm (Min)	Finish	DFT in µm (Min)	Total DFT (Min)
--------	----------------	---------------------	--------	-----------------	--------	-----------------	-----------------

4.3	Hand rails, post, step treads, Floor grills (89 610,611,7X X65)	Power tool cleaning to ST-3 (SSPC SP3) *	One coat of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	30	Two coats of synthetic enamel paint to IS 2932 black shade	40	70
4.4	EE (7X X15)EE hook, EE suspension hook (7X X13), CE (7X X20)CE, CE suspension hook (7X X19), Foundation material foe ESP structures& ducts (7X X80).	--	(**) Temporary rust preventive oil Dry type	20	--	--	20

5.0	Gates and Dampers						
5.1	Gates and dampers temperature ≤ 95°C (57 XXX)	Power tool cleaning to ST-3 (SSPC SP3)	One coat of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	30	Two coats of synthetic enamel paint to IS 2932 shade 692 of IS 5 unless specified otherwise.	40	70
5.2	Gates and dampers temperature > 95°C (57 XXX)	Power tool cleaning to ST-3 (SSPC SP3)	Two coats of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	60	NIL	--	60
5.3	Gate blades, Machined components of G&D	---	(**) Temporary rust preventive oil Dry type	20	NIL	NIL	20

6.0	Chimney						
6.1	Foundation bolt (87 010)	Power tool cleaning to ST-3 (SSPC SP3)	(**) Temporary Rust preventive	20	--	--	20
6.2	Shells-Inside and Un insulated side, base plate (87 100),	Blast Cleaning to Sa 2 ½ (Near white metal with Surface profile 35 – 50 µm)	Two coats of Heat resistant aluminum paint as per IS 13183 (GR I -Up to 600°C,GR II 200°C to 400°C,GR III Up to 200°C)	40	NIL	--	40
6.3	Ducts un insulated, Strakes, (87 150), Painter trolley (87 200)	Power tool cleaning to ST-3 (SSPC SP3)	Two coats of Heat resistant aluminum paint as per IS 13183 (GR I -Up to 600°C,GR II 200°C to 400°C,GR III Up to 200°C)	40	NIL	--	40

Issued by: Quality Assurance Dept BHEL Ranipet.



Ranipet

Procedure for Surface Preparation and Painting

Doc. No	PRQA: 590
Rev	01
Date	02 02 08
Page NO	12 of 12

Sl.No.	Component/PGMA	Surface preparation	Primer	DFT in μm (Min)	Finish	DFT in μm (Min)	Total DFT (Min)
6.4	Shells –out side insulated (87 100), Ducts- Insulated (87 150)	Power tool cleaning to ST-3 (SSPC SP3)	Two coats of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl).	60	--	--	60
6.5	Ladders, Hand rails, floor grills, platforms (87 300)	Power tool cleaning to ST-3 (SSPC SP3)	One coat of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyl)	30	Two coats of synthetic enamel paint to IS 2932 black shade	40	70

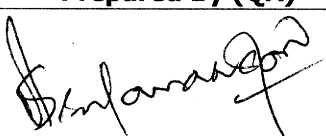


7.0	Products meant for overseas application						
7.1	Internal and External parts of APH, ESP, Fan and Gates and Damper	Blast Cleaning to Sa 2 ½ (Near white metal with Surface profile 35 – 50 μm)	Epoxy red oxide Zinc phosphate primer to IS 13238	30	Epoxy polyamide cured paint to IS 14209	30	60

Note: All components covered under different PGMA are to be painted .In case any component is left out, the same shall be deemed to be included under relevant section.

Issued by: Quality Assurance Dept BHEL Ranipet.

QUALITY ASSURANCE	
QWI NO: PR:QA:590 Rev.01 Dtd.02.02.2008	
Amendment to Quality Work Instruction (QWI)	
Amendment No: A1	Date:11.10.2013
Title: <i>Procedure for Surface Preparation and Painting</i>	

Details of Amendment		
Clause No	Amended As	Basis for Amendment
Refer Clause no 4.0 – Table 2 and further clause no. 3.2 a) and 3.3 a) of Table.	AP Fan components like Servo Motor Assy, Shaft with Bearing Assy (refer clause 3.2 a) and impeller (refer clause 3.3 a) of table 2.0 Presently Existing Painting Scheme: 1. Primer: one coat of red oxide zinc phosphate primer to IS 12744 (varnish medium alkyd) DFT = 30 µm. 2. Two coats of synthetic enamel paint to IS 2932 shade 692 of IS 5 Unless specified otherwise Finish= 40 µm(Primer+Finish: total DFT- 30+40=70 µm) The above painting scheme has been modified as below - only for AP fan components like Servo Motor Assy, Shaft with Bearing Assy (refer clause 3.2 a) and impeller (refer clause 3.3 a) of table 2.0 • Epoxy based Zinc Phosphate Primer (Two Pack system) as per IS:13238 – Two coats and each coat min. 30µm and total DFT will be 60 µm • Finish Paint : Not Applicable	Feedback from RCA Sub-Committee Meeting. Dt- 14.05.2013 (For quick drying of paint)

Prepared By (QA)	Reviewed By	Approved By
	QC-Shop 197 	
	QA 	

 Ranipet	Procedure for Fabrication of Gland plate and follower plate, Gland and Stud welding	Doc. No	PRQA: 599
		Rev	00
		Date	18 09 08
		Page NO	1 of 5

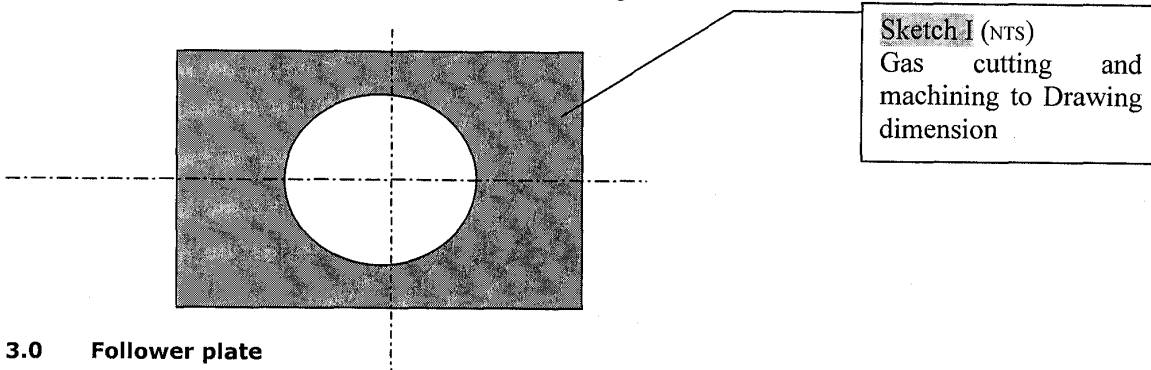
1.0 This procedure gives the Guide line / method of fabrication of Gland and Follower with Gland and stud welding assembly used in Damper assembly

2.0 Gland plate

2.0.1 Mark the size of the gland plate with plus 3 mm on each side and Gas cut using pug cutting machine

2.0.2 Grind the gas cutting sides to a maximum square out of 1 mm. Mark the center line on both axis as shown in the sketch I and prick punch the line and extend this to two sides on thickness.

2.0.3 Mark the Hole size with sufficient machining allowance and gas cut. Machine to drawing dimension. Check and record the readings.

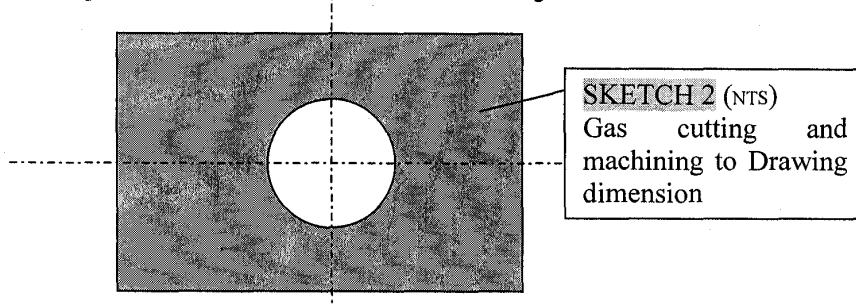






3.0 Follower plate

3.0.1 Mark the size of the follower plate with plus 3 mm on each side and Gas cut using pug Cutting machine.

3.0.2 Grind the gas cutting sides to a maximum square out of 1 mm. Mark the center line on both axis as shown in the sketch I and prick punch the line and extend this to two sides on thickness.

2.0.4 Mark the Hole size with sufficient machining allowance and gas cut. Machine to drawing dimension. Check and record the readings.



Prepared By	Reviewed By		Approved BY
	P Karthikeyan DM/QA		 Head / QA
	G Jeyasekar /SM/QC-OLI		


 Ranipet	Procedure for Fabrication of Gland plate and follower plate, Gland and Stud welding	Doc. No	PRQA: 599
		Rev	00
		Date	18 09 08
		Page NO	2 of 5

Note: Gland plate and Follower plate Hole can be done by drilling and further enlarging of Gland plate by boring in Butted condition of the both plates. However reference of Stud pitch shall be taken reference from Gland plate and follower plate hole.

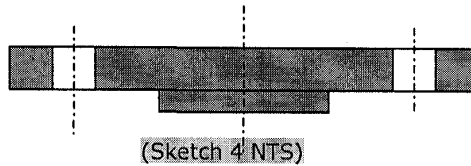
4.0 Assembly of Gland plate and follower plate, Stud

- 4.0.1 Place the Gland plate over the Follower plate. Align the co axiality both holes by using stepped pin gauge as per Sketch 3 and tack weld.




(Sketch 3 NTS)

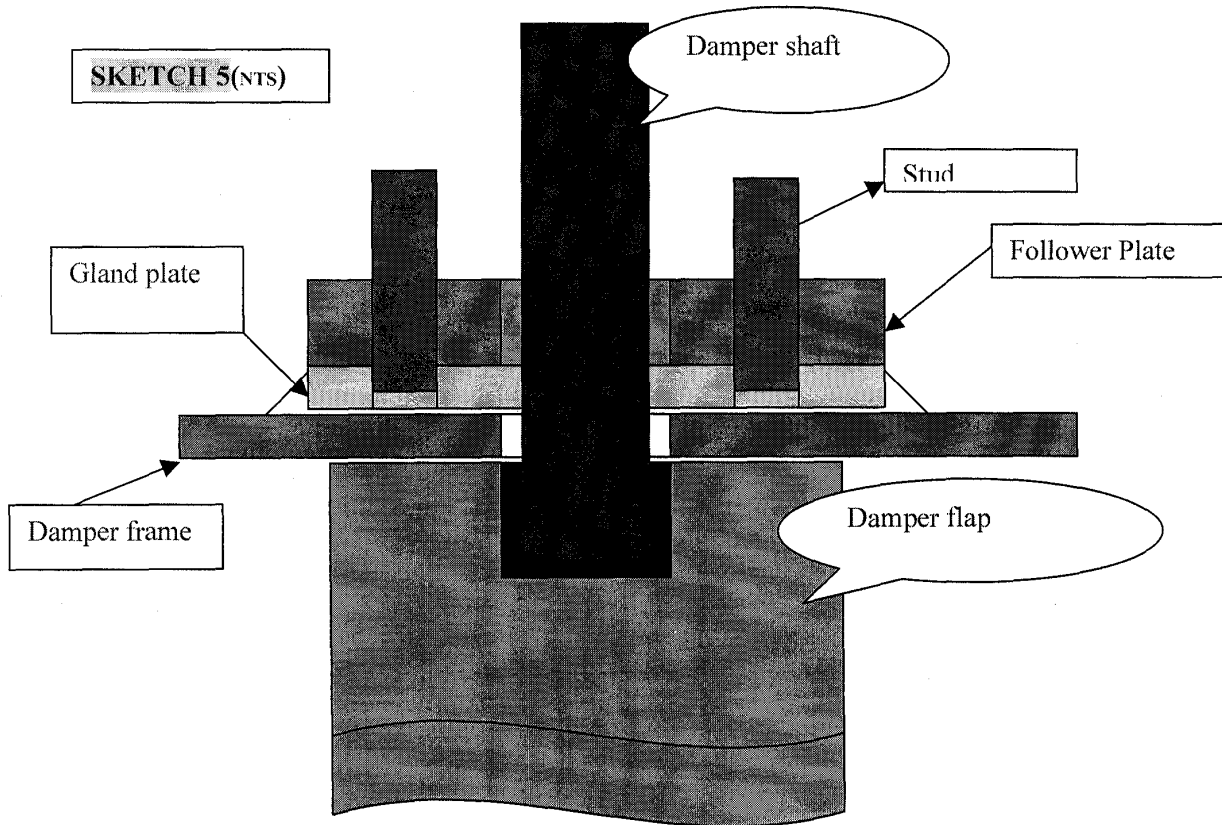






- 4.0.2 Using template mark the Stud location (the template shall be made in such a way that stud location-marking w.r.to Gland and follower plate center. as per Sketch 4



- 4.0.3 Match drill the Stud hole using drill jig supplied by BHEL . Insert the Stud and complete the stud welding as per WPS.Flush grind the stud weld. Ensure Pre heating and Root run, Root LPI and Final MPI to have a defect free weld. (Refer detailed welding procedure issued by QC OLI to sub contractor for better understanding of the requirement)
- 4.0.4 Match mark to have a unique identification after dismantling.
- 4.0.5 Dismantle the Gland plate and Follower plate and Grind the Tack weld.
- 4.0.6 Weld the Gland with Gland plate (In order to avoid weld distortion use suitable shaft, which is having same diameter of damper shaft being assembled. Claen and grind.
- 4.0.7 Re assemble the Gland plate assembly with Follower plate to ensure any interference with the stud and follower plate hole as shown in the sketch 5. Do not enlarge follower plate hole.
- 4.0.8 Clean and apply rust preventive coating and preserve for further assembly with Damper

Prepared By	Reviewed By		Approved BY
	P Karthikeyan DM/QA		 Head / QA
	G Jeyasekar /SM/QC-OLI		






Prepared By	Reviewed By		Approved BY
	P Karthikeyan DM/QA		 Head /QA
	G Jeyasekar /SM/QC-OLI		

 Ranipet	Procedure for Fabrication of Gland plate and follower plate, Gland and Stud welding	Doc. No	PRQA: 599
		Rev	00
		Date	18 09 08
		Page NO	4 of 5

PROCEDURE FOR GLAND STUD WELDING

01. Ensure Gland plates (GP) and Follower plates (FP) are received intact with match marking and firm code.
02. Ensure Gland studs received are having proper identification for specification SA193B7 with inspector's seal.
03. Ensure GPs and FPs are having dimensions as per drg. taking care of co-axiality and w.r.t center axis of stud holes and record 100%.
04. During the process, butting surfaces of GP & FP should not be reversed and should not be interchanged.
05. Locate the GP on a fixture having guides for bore and stud holes to maintain 1mm uniform clearance of Gland bush and tack the gland bush. Ref Fig 5
06. Weld the Gland bush (GB) all round maintaining fillet all-round and remove / ground flush any excess weld.
07. Conduct LPI on GB weld.
08. Gland studs that are having chamfers already are to be chamfered further to accommodate 2.5 electrodes for root welding.
09. Fit up of Gland studs should be made using follower plate also as per the sketch enclosed, maintaining gap 6mm / as per drg for plug welding. Sufficient chamfering of gland stud holes also necessary for proper plug welding. (Ref Fig 6)
10. After Gland studs tacked and after fit up clearance plug weld the gland stud. Please note during fit up and welding of stud pre-heating of stud opposite to plug weld should be done. Electrode specification and pre heating temperature shall be as per WPS.
11. Ensure root weld slag and subsequent layer weld slag are cleaned properly.
12. After welding Gland stud, ensure perpendicularity of stud.
13. Grind the plug welding area properly without making undulations.
14. Conduct MPI on plug weld after 48 hours of plug weld.
- 15 Also, tighten the stud with assy. of Follower plate to ensure soundness of weld.

Prepared By	Reviewed By		Approved BY
	P Karthikeyan DM/QA		 Head /QA
	G Jeyasekar /SM/QC-OLI		

 Ranipet	Procedure for Fabrication of Gland plate and follower plate, Gland and Stud welding	Doc. No	PRQA: 599
		Rev	00
		Date	18 09 08
		Page NO	5 of 5

FIG -5

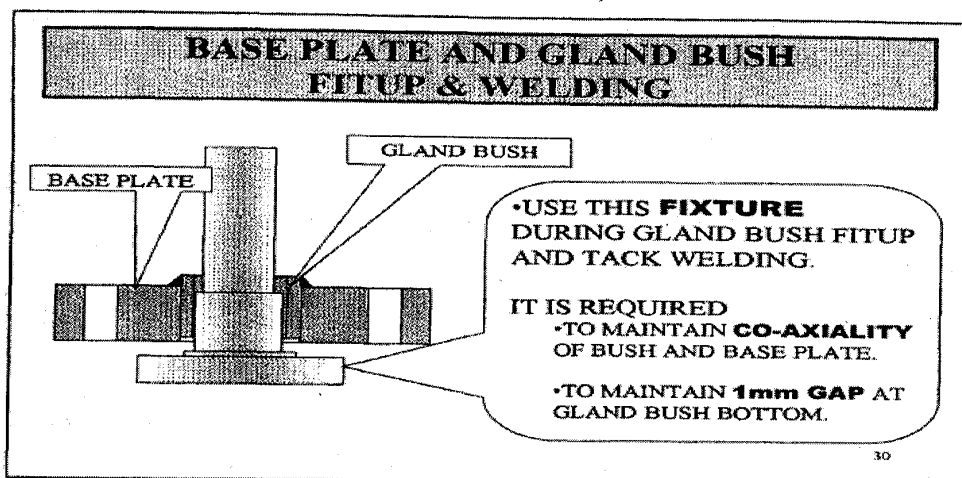
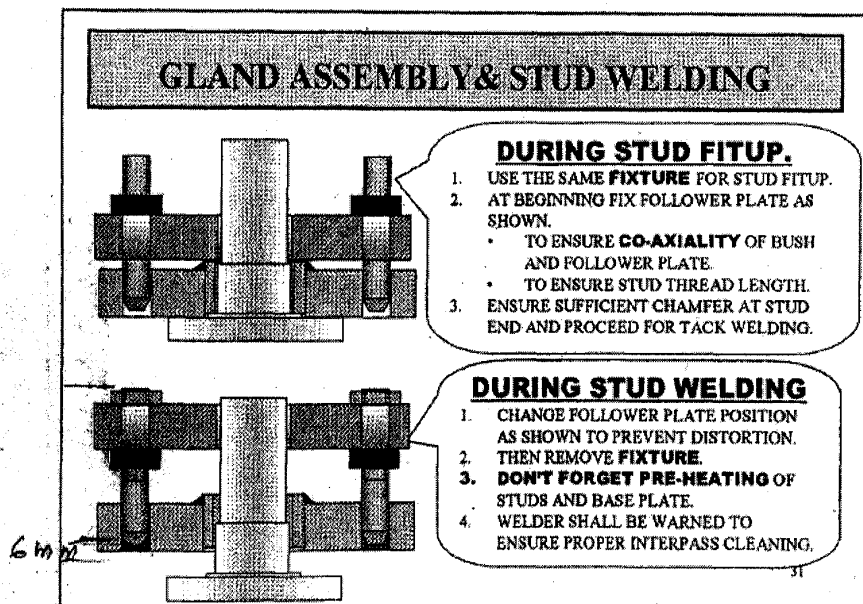






FIG -6.



Prepared By	Reviewed By		Approved BY
	P Karthikeyan DM/QA		 Head /QA
	G Jeyasekar /SM/QC OLI		

 Ranipet	Non Destructive Examination (NDE) requirement for Gates and Dampers	Doc. No	PRQA: 603
		Rev	02
		Date	17 02 2011
		Page NO	1 of 1

1.0 Scope



1.1 This procedure details out the **Liquid penetration Inspection (LPI), Magnetic Particle Inspection (MPI) requirement** for the Components of Gates and Dampers

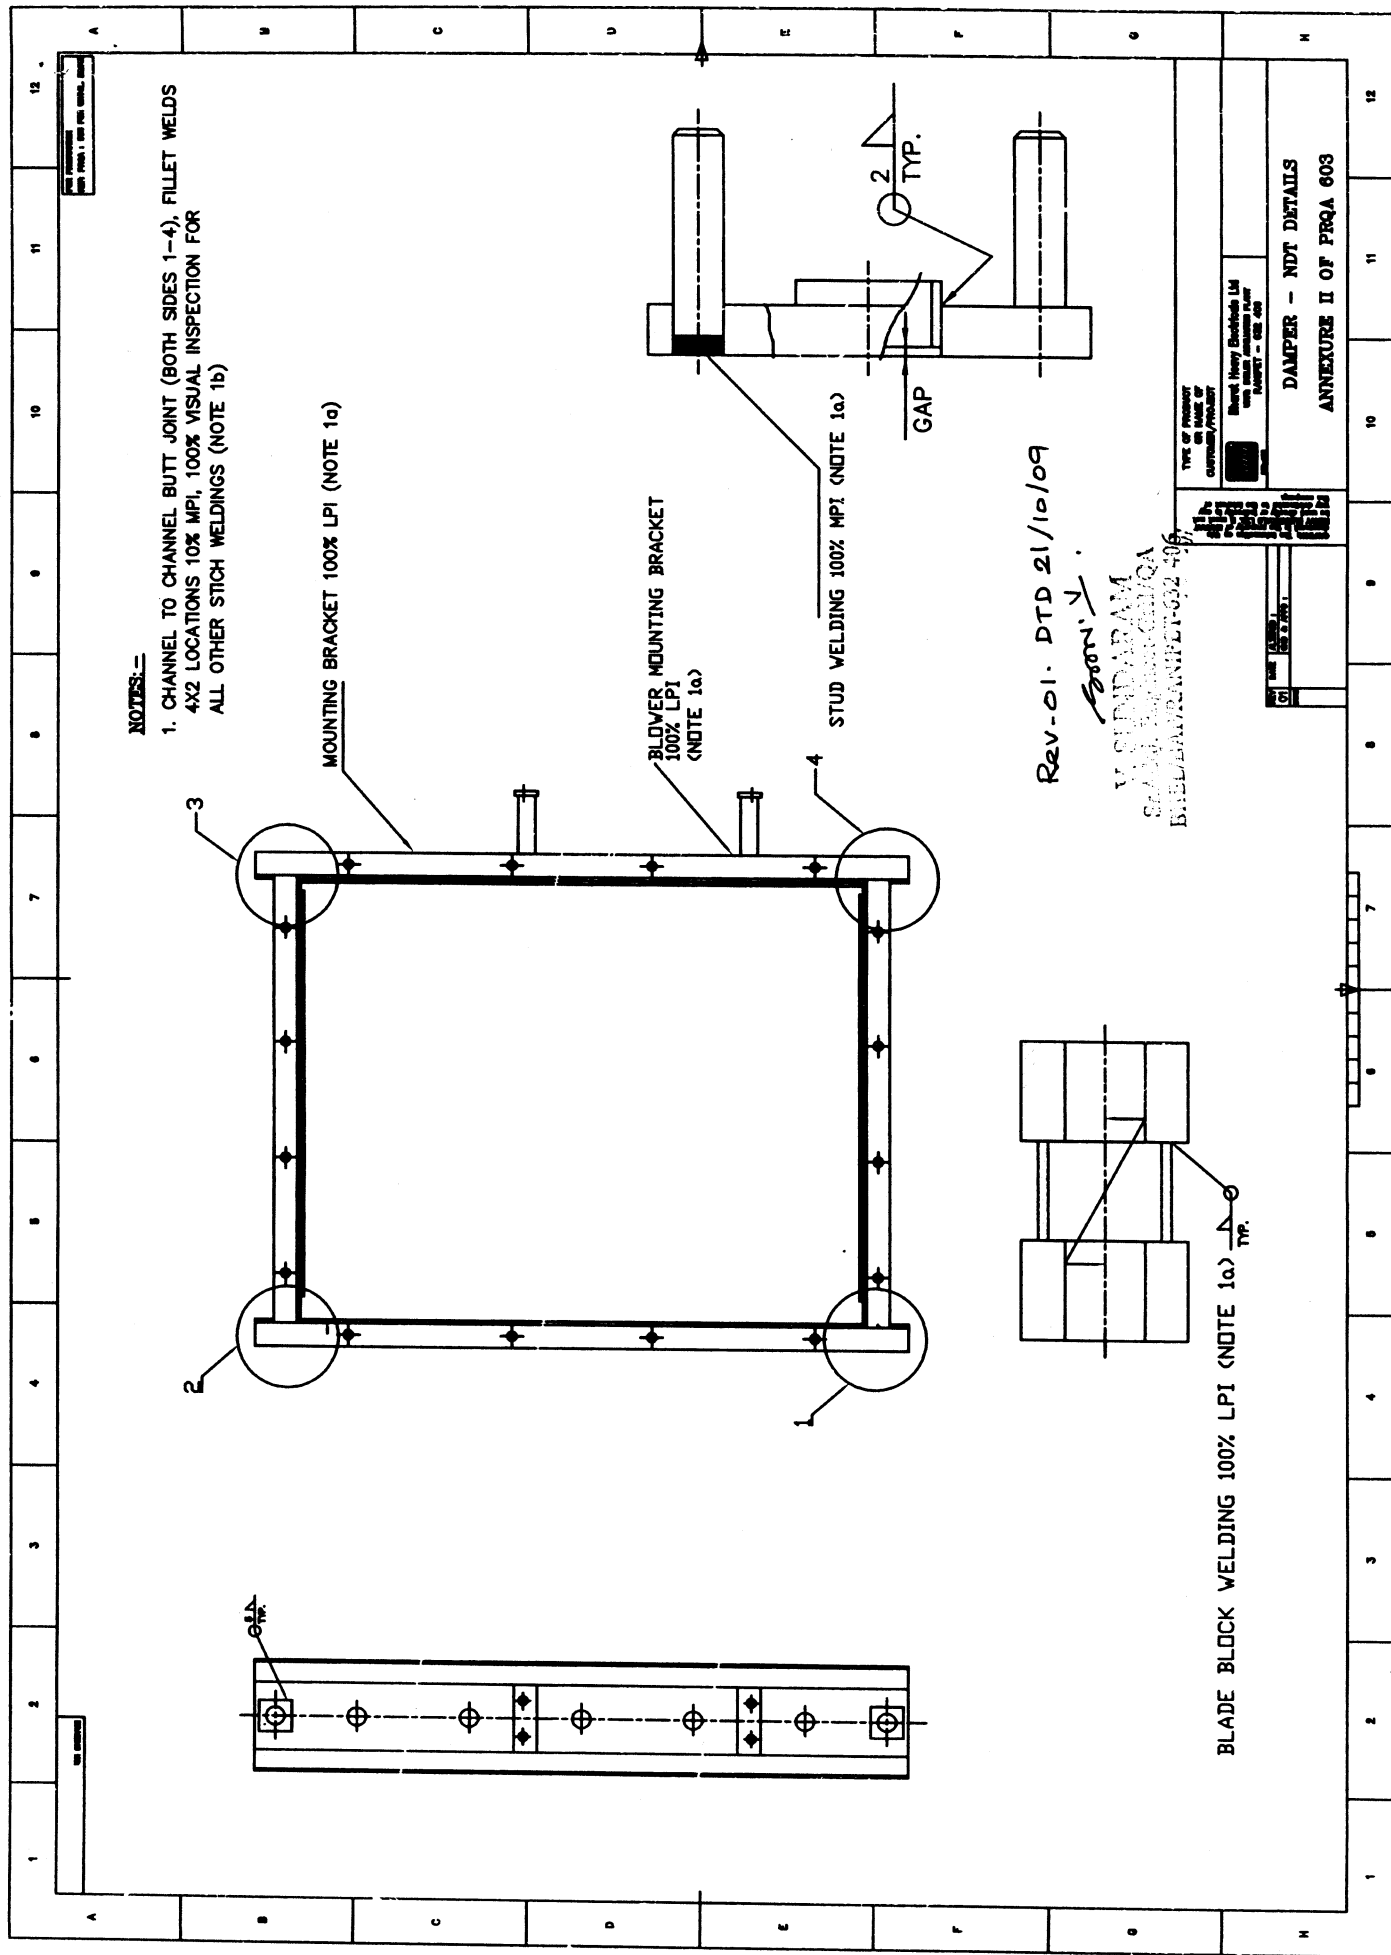
1.2 Reference.

- RQP for Gates : 0000-999-QVM-P-267 Rev 02 DT 27 06 08 /Clause 2.1 Note 1a,1b,and 1c
- RQP for Dampers: 0000-999-QVM-P-268 Rev 02 DT 26 05 08 / Clause 2.1 Note 1a,1b.

1.3 The details of NDE locations for gates are as per **Annexure I** and for Dampers as per **Annexure II**

Revision Number/Date	Changes made
00/ 05 09 09	Original Issue.
01/24 10 09	Correction done in Note - C of Annexure I & II
02/17 02 11	Correction done in Annexure under Note 1b (T bar welding)

Prepared By	Reviewed & Approved BY
	 17/2/11



**BHARAT HEAVY ELECTRICALS LIMITED
TIRUCHIRAPPALLI 620 014 INDIA**

**QUALITY CONTROL PROCEDURE FOR
MANUFACTURE OF NON PRESSURE PARTS**







QCP:002 / 02


Page 1 of 14

Prepared by
Quality Assurance

G S N Murthy



Reviewed by	Signature	
Engineering	Structures	Fuel Firing
		
OP & C		
Manufacturing	Shops	Ancillary Development
		
Quality Assurance		
Quality Control	RM Area	OLI
		

Revision No.	Date	Approved by	Signature
00	01/04/93	SM / QA	- sd -
01	01/01/95	SM / QA	- sd -
02	24/04/04	SDGM / QA	

Proprietary Data - For Internal Use Only

RECORD OF REVISIONS

Rev No...	Clause No	Details of revision
00	--	This document consolidates all the general requirements and technical disciplines covered in the various previous
01	--	All amendments issued has been regularized and editorial correction made for better clarity. Scope of machining added in this document.
02		Shaded clauses are Revised /added

1.0 SCOPE

- 1.1 This procedure details out the process control and quality requirements for manufacture of Non Pressure Parts.

2.0 REFERENCE DOCUMENTS

- 2.1 AWS D.1.1, D1.6, IS 7215 and CE: M&P 5.11.1.1, 5.11.2.1 & 5.11.2.2 as guidelines.

3.0 MATERIALS

- 3.1 CLASSIFICATION OF MATERIALS (commonly used):

<u>P No. Group</u>	<u>Specifications</u>
P1 - Group 1 - 515 Gr 60.	Carbon steel IS 2062 Gr A & B, IS 1239, IS 1161, A 36, SA
P1 - Group 2 - IS 8500.	H.Strength CS :SA105, SA 515 Gr 70, SA 299, SA 516 Gr 70,
P4 - Alloy Steel	SA 387 Gr 11 & Gr 12, SA 182 Gr F 11 & F 12.
P5 – Gr A,	SA 387 Gr 22, SA 182 Gr F 22
P6 -	SA 240-410,429
P8 - Stainless steel	SA 240 - 304 ,309,310, 316, 321, 347

Any other materials as specified in the drawings.

- 3.2 Raw materials used shall conform to the relevant specification as given in drawings and applicable TDC/PO. Any substitution of materials shall be done only with prior approval of engineering through applicable documents. Where subcontractors procure the raw materials, the same shall have valid test certificates.
- 3.3 Raw materials shall be free from visual defects like cracks, seams, laps, laminations, heavy pitting etc. When defects are noticed in visual inspection the same shall be confirmed using appropriate NDE techniques and repaired using applicable approved process.
- 3.4 All materials are procured with permitted dimensional tolerances of the material specifications and / or TDC. Wherever required, the raw materials shall be corrected prior to fabrication to achieve the required product tolerances.
- 3.5 Customer supplied materials are to be verified as per SP 0626.
- 3.6 The requirements of material traceability shall be as indicated in the respective drawings.
- 3.6.1 Product Attest "P" items indicated as in drawings are traceable to the test certificates and identified with material Specification, grade and melt number by stamping.
- 3.6.2 CERTIFIED items indicated as "C" in drawings are traceable to material Specification / grade only and identified by stamping / engraving / stenciling / painting.
- 3.6.3 Raw materials not covered by the above shall be identified by its W.O.No / material code / Specification / grade by painting / stenciling / engraving.
- 3.6.4 All subdeliveries shall be identified by its material code by painting or through name plates / tags.

- 3.7 When materials (including stock) are to be upgraded for special contract requirements QC shall ensure that the respective specification / contract TDC (as applicable) are complied..

4.0 FABRICATION

4.1 MARKING, CUTTING AND PREPARATION

- 4.1.1 Raw material shall be marked and cut to size by shearing, machining, saw cutting , flame or plasma (for SS materials) cutting. Flame cut edges shall be cleaned to remove slag. Uneven edges shall be dressed by grinding. Gas cutting notches shall be filled up by welding using compatible electrodes and ground before taking up for further fabrication.
- 4.1.2 Wherever raw materials supplied / available are not sufficient for the sizes required, the same can be built up using the splicing instructions given in the respective SQPs/ Drawings (Incl. Production Notes) / DCN.
- 4.1.3 Layout for size and shape shall be marked before cutting (for other than CNC applications) The tolerance for marking shall be maintained within + 2mm unless otherwise specified. The diagonal difference shall be within 3 mm.
- 4.1.4 The markings shall be punched at convenient intervals and bordered with white paint.
- 4.1.5 Stainless Steel (SS) materials shall be cut using plasma cutting or shearing only. Any further dressing/ grinding of cut surfaces should be done with separate and clean abrasive wheels.
- 4.1.5.1 The cut edges should be smoothly ground.
- 4.1.5.2 Notches above 3 mm or 20 % 'T' shall be thoroughly cleaned and welded by using a qualified WPS and examined visually and by LPI . The repaired surfaces are to be cleaned to bright metal surface.
- 4.1.6 Clip / Cleat angles above 10mm thick used for beam connections which are sheared to length shall require heat treatment.
- 4.1.7 Heat treatment shall be done after shearing for P4 materials $t > 12.5\text{mm}$ and for P5 materials $t > 10\text{mm}$.
- 4.1.8 The requirements of preheat for gas cutting are as follows:
- | | | |
|------------------|------------------------|----------------|
| Carbon steel | $t \leq 50\text{mm}$: | : Nil |
| Carbon steel | $t > 50\text{mm}$: | : 100 ° C.min. |
| Alloy steel (P4) | $t \leq 25\text{mm}$: | : Nil |
| Alloy steel (P4) | $t > 25\text{mm}$: | : 150 ° C |
| Alloy steel (P5) | All | : 150 ° C |
| Stainless steel | Not applicable | |
- 4.1.8.1 Stress relieving for gas cut edges shall be as follows.

Material	Thickness	Heat treatment cycle
P1	> 50 mm	600 ° - 650 ° C for 30 minutes . Furnace cool (Alternatively, the cut surface can be ground / machined upto 3 mm to remove HAZ)
P4	> 16 mm	650 ° – 700 ° C for 30 minutes . Furnace cool
P5	All	680 ° - 730 ° C for 30 minutes . Furnace cool
SS (plasma)	Any	Not required

4.1.9 The prepared plates shall be visually inspected and repaired if required as per SIP:NP:06.

4.1.10 The raw materials after cutting shall be identified with relevant WO No., DU No., Part No. and Material Spec / Grade (transferred).

4.2 FORMING

4.2.1 Forming shall be done using proper tooling free from damages. Method of forming and work centre shall be identified in OPS / relevant QWI referred in PO.

4.2.2 Forming operations of sheets / plates shall be done by rolling / pressing. Circularity of rolled shells shall be checked using templates (of length > ¼ of ID).

4.2.3 Suitable nonmetallic padding shall be provided while forming of stainless steels to avoid contamination.

4.2.4 All formed components shall be checked for orientation, angle, and other dimensions as per drg. All formed parts shall have smooth finish and shall be free from bends, folds and sudden transitions.

4.2.5 Minimum thickness after forming shall be ensured whenever specified in drg.

4.2.6 Tolerances for formed components when not specified in drg. Shall be as follows

- a) St.Length / Dia, : + 1 mm / M, 5 mm Max
Width & Height
- b) Verticality : 1 mm / M, 5 mm Max
- c) Squareness : 1 mm / M of length / Dia
- d) Straightness : 1 mm / M, 5 mm Max
- e) Radius : + 5 mm
- f) Bend Angle : + 2°
- g) Ovality : 1%
- h) E.P Angle : + 5° / - 2.5°
- i) Diagonal diff : 3 mm

4.3 WELDING

4.3.1 WELDING CONSUMABLES

4.3.1.1 Welding consumables conforming to the qualified welding procedures shall be used. However the following guide lines are provided.

4.3.1.2 Only Basic coated electrodes shall be used in the following cases:-

- a. All Strength welds like welds in main ceiling girders, flange butt welds in other beams, columns etc.
- b. For all structural welds, or when thickness of any one member of the weld joint is > 12 mm (unless otherwise indicated in the drawings / Qualified WPS).
- c. For welding of high tensile steels like IS 8500, SA299, SA515 Gr.70, SA516 Gr.70.

4.3.1.3 Rutile electrodes may be used for other weld joints.

4.3.1.4 All low hydrogen electrodes (EXX 16 & EXX 18) shall be dried in the baking oven at 350 deg.C for 2 hours and the electrodes shall be held at 100 deg.C until they are used.

- 4.3.1.5 All rutile electrodes (EXX 13) shall be dried at 100 deg. C for 1 hour min. and held at 100 deg.C till use.
- 4.3.1.6 Fluxes for SAW shall be dried at 200 deg.C for 1 hour min. before use. Height of flux bed while drying in pan or oven, shall not be more than 100mm.

4.3.1.7 Unless otherwise specified, SS consumable shall be baked as per Electrode manufacturer's recommendations and stored at 120 ° - 150 ° C until use.

4.3.2 FIT UP

- 4.3.2.1 Proper fit up shall be ensured before welding as per Drawing. Tack welding or mechanical clampings shall be used to maintain the fit up requirements before and during welding. Bridge pieces used during fit up shall be of ferritic for ferritic materials and stainless for stainless steel materials.
- 4.3.2.2 Dimensions of the cross sections of groove welded joint shall be within the following tolerances w.r.t. drawing requirements:

	Root not back gouged	Root back gouged
1. Root face of joint(land)	± 2 mm	Not limited
2. Root opening of joint (with out backing)	± 2 mm	+ 2 mm - 3 mm
Root opening of joint* with backing)	+ 6 mm - 2 mm	Not Applicable
3. Groove angle of of joint	+ 10° - 5°	+ 10° - 5°

*(NOTE): Root opening wider than permitted by above tolerances but not greater than twice the thickness of the thinner part or 19mm, whichever is less may be corrected by edge buildup to acceptable dimensions prior to welding. Such build up edge shall be MPI / LPI checked.

- 4.3.2.3 For C. S. fillet welds, the parts shall be as close as practicable and gap shall be limited to 5 mm (If gap exceeds 2 mm, the leg of fillet shall be increased by the amount of gap but in no case shall exceed 4.8 mm). For thickness 75 mm and above gap up to 8 mm can be permitted provided suitable backing is used.

4.3.2.4 For S. S. fillet welds, the parts shall be as close as practicable. Gaps 2 mm and above upto 5mm are acceptable if the fillet size is increased by an amount equal to the gap.

- 4.3.2.4 Parts to be joined by butt welds shall be properly aligned. An offset not exceeding 10% of the thickness of the thinner part joined can be permitted, but in no case more than 3.2 mm, is permitted.

4.3.3 PRE HEATING

- 4.3.3.1 Pre heating requirements for welding shall be as per Clause 4.6.7 and controls shall be exercised as detailed below. No preheating is required for stainless steels.
- 4.3.3.2 Preheating shall be maintained during the entire process of welding.

- 4.3.3.3 Preheating is to be done using gas burner or induction / resistance heating. The temperature must be uniform and verified using thermal chinks or thermocouples prior to start of welding as well as during welding for a width of 't' (maximum) or 75 mm whichever is less.
- 4.3.3.4 Where interpass temperature control is required during welding, the temperature must be ensured using thermal chinks / thermocouples. Inter pass nitrogen / air cooling can be adopted to maintain inter pass temperature in case of stainless steels.
- 4.3.3.5 Wherever post heating is specified, the preheating shall be continued after welding till attaining the post heat temperature and maintained for the required time and cooled slowly by wrapping suitable insulating blankets like asbestos.
- 4.3.4 Welding shall be performed using qualified procedures and qualified personnel. Edge preparation and welding details shall be as per drawing.
- 4.3.5 For items to be manufactured at subcontractor's works, for requirements of qualification of procedure and personnel as per SIP:NP: 07 shall be followed.
- 4.3.6 When double bevel welding is adopted, back gouging and grinding is to be done. Back gouged groove shall be checked with PT / MT before welding from second side.
- 4.3.7 Proper sequence of welding shall be adopted to minimise distortion. The distortion of the finished jobs, if any may be corrected by mechanical means / hot correction.
- 4.3.7.1 For welding of SS extreme care is to be taken in weld sequencing to minimize the weld distortion and shrinkage. For complex weldments a weld sequence instructions may be prepared by contractor prior to work commencement. Weld joints likely to have high shrinkage should be welded (with minimum restraints) before welding other joints providing allowance for shrinkage.
- 4.3.7.2 While cutting long web plates suitable camber may be required to compensate for the distortion during cutting and welding.
- 4.3.8 All butt welds of divider plate and guide vanes in ducts shall be flush ground inside.
- 4.3.9 The use of jigs and fixtures is recommended where ever practicable. Suitable allowances shall be provided for weld shrinkage. Proper sequence of welding shall be followed to control the distortion during welding.
- 4.3.10 All temporary attachments shall be welded with the required preheat. After their removal welded spots shall be ground flush and LPI checked.
- 4.3.11 Groove welds shall preferably be made with minimum reinforcement unless and otherwise specified in drawing / SQP. In case of butt welds, reinforcement shall not exceed 3.2 mm. and shall have gradual transition to the plane of the base material surface.
- 4.3.12 The surface of the welds shall be free from coarse ripples, overlaps, undercuts and abrupt ridges to avoid stress raisers.
- 4.3.13 Where parts of different thicknesses are welded or surface offset is more, the transition shall be made gradual by grinding / machining with 1: 2.5 taper.
- 4.3.14 Stray arcs shall be avoided to the extent possible. Arc spots if noticed shall be ground and checked by LPI / MPI. Thickness requirements shall be ensured after grinding.

4.4 WELD REPAIRS

- 4.4.1 Removal of defective weld / portions of the base material may be done by machining, grinding, chipping, gas cutting, oxygen gouging or carbon arc gouging. Defective portions of the weld shall be removed without substantial removal of sound base metal.
- 4.4.2 For under sized welds additional weld metal shall be deposited using an electrode preferably smaller than that used for making original weld limited to 4mm in diameter. The surfaces shall be cleaned thoroughly before deposition.
- 4.4.3 Defective welds/base metal shall be repaired by removing or/and rewelding as follows:
- 4.4.3.1 Overlap / excess weld metal shall be removed by grinding.
- 4.4.3.2 For excess concavity, crater, undersize & undercuts, deposit additional weld metal after cleaning the weld surface.
- 4.4.3.3 For Cracks in weld or base metal, ascertain the extent of crack by suitable NDE / acid etching, remove the crack to sound metal upto each end of the crack by arresting the ends for further propagation and reweld.
- 4.4.3.4 For weld porosity, slag inclusions & lack of fusion remove defective portions & reweld

4.5 HOT CORRECTION

- 4.5.1 Members which require hot correction are to be supported at suitable locations and mark the locations for heating.
- 4.5.2 Heat the locations marked by using neutral flame. Torches used for heating shall be moved continuously & uniformly over selected area to avoid localised over heating.
- 4.5.3 For Carbon steels the maximum temperature shall not exceed 650 ° C and shall be ensured using thermal chalks / thermocouples.

For alloy steels P4 – 705° C , P5 – 735° C temperatures are to be maintained for hot corrections

- 4.5.3.1 For Austenitic stainless steels the maximum temperature shall not exceed 430 ° C and shall be made known to inspection authorities . Otherwise , after hot correction solution annealing at 1050 – 1100 deg C is to be done.
- 4.5.3.2 For Ferritic/Martensitic/Duplex stainless steels the maximum temperature shall not exceed 315° C and shall be made known to inspection authorities . The temperature shall be ensured using thermal chalks / thermocouples.
- 4.5.4 Additional dead weights may be placed over the positive side of the bend depending upon the requirement to accelerate hot correction.
- 4.5.5 Allow for natural cooling. Accelerated cooling shall not be adopted. Remove the dead weights used after cooling.
- 4.5.6 Wherever the correction for distortion affects the weld joints, applicable NDE shall be repeated after the correction.

4.6 POST WELD HEAT TREATMENT (PWHT)

- 4.6.1 The process controls (temperature control and recording) for heat treatment shall cover the activities before, during and after heat treatment.

- 4.6.2 The weldment shall be cleaned to free of grease, oil etc. prior to heat treatment.
- 4.6.3 PWHT shall be done in a furnace or by local heating a band (including the entire weld and adjacent area of the base metal) .
- 4.6.4 The thermocouples and recording instruments shall be calibrated as per applicable standards and records maintained. The furnace shall have been qualified and calibrated.
- 4.6.5 All materials to be heat treated in furnace shall be loaded in such a way that they shall not be subjected to direct flame impingement. Jobs shall be preferably loaded on raised plat forms so that no material projects into the plane of burners. Alternatively flame deflectors may be provided in front of the burners to avoid direct flame impingement. Ensure loading of test coupons wherever applicable. The furnace temperature shall not exceed 315 ° C at the time of loading material / weldment.
- 4.6.6 Number of thermocouples and their location shall be decided covering maximum and minimum thickness and covering all the zones. The temperature variation within 5 meters shall not exceed 140 ° C during heating period (above 315 ° C).
- 4.6.7 The **temperature requirements** for Pre heating, Post Weld Heat Treatment(PWHT) & temperatures are as below.(Unless otherwise specified.)

Material	Thickness	Pre heating	PWHT Temp.	Remarks
P1 Gr 1&2	t < 38	Nil	600 – 650 ° C	a) For all butt welds in plate welded girders when t > 50mm.
	T= 39-62	100 ° C		
	t > 63	150 ° C		
P4 Gr 1&2	All	150 ° C	680 – 700 ° C	a)All butt welds in tension member b)All fabricated components when t>16mm(Note1)
P5 Gr 1&2	All	150 ° C (Note2)	680 – 730 ° C	All welds (Note 3)
P8	300 type	120 ° C	-	
	400type	205 ° C	-	

Note 1 All fabricated structural components of P4 materials with any member above 16mm thickness, the entire assembly shall be post weld heat treated. However when size of fillet weld is less than 12 mm, PWHT is not required for non load carrying members.

Note 2 All welds on P5 material shall be post heated at 250 ° C for 2 hrs or 150 ° C for 4 Hrs, immediately following welding.

Note 3 All welds of P5 material shall be post weld heat treated. In case where the size of fillet is less than 12 mm, PWHT is not required for non load carrying members.

4.6.7.1 The **soaking time** shall be as follows:

- For P1 materials the soaking time shall be 1 hr/inch of thickness(t) (2.5 mts / mm) upto 2" and 2 hrs + 15 minutes for each additional inch for t > 2".
- For P4 & P5 materials the soaking time shall be 1 hr/inch of thickness (2.5 mts / mm) upto 5" and 5 hrs + 15 minutes for each additional inch for t > 5".

- c. For combination cycles mentioned above, calculate the minimum soaking time for individual components as 2.5 minutes/mm of the thickness of weld/material whichever is applicable. Soaking time selected for the cycle shall not exceed the limits given below:

Material	Thickness (mm)	Max. soaking time (minutes)
P1 (A,B,C), P4, P5A, P1 (A,B) + P4, P4 + P5A	Up to 25 mm	125
	26 - 50 mm	200
	51 - 80 mm	250
	81 - 150mm	375
P1C + P4, P1 + P3	Up to 25 mm	65
	26 - 50 mm	125

4.6.7.2 Unless otherwise specified, in case of mixed loads of materials not covered under simulation HT, the following heat treatment temperatures shall be followed. In such cases, guidelines for soaking can be taken from Clause 4.6.9.

For components having butt joint between P1 & P4, or P3 & P4, the cycle shall be 630 - 670° C.

Where a component has a butt joint between P4 & P5A, the cycle shall be 680 - 710° C.

Where a component has a butt joint between P1 & P3, the cycle shall be 620-660 ° C

For P1+P5A material combination, follow the WPS requirements

The following jobs shall not be combined in the same cycle during PWHT.

Separate jobs of P1 and P4 Separate jobs of P4 and P5

- 4.6.8 The following rules shall apply to establish the thickness to be used in determining the soaking time for PWHT.
- 4.6.8.1 For Butt welds, the thickness shall be the thickness of the material at the weld. For bar stock, the thickness shall be the diameter.
- 4.6.8.2 For fillet welds, the thickness shall be the throat thickness. If a fillet weld is used in conjunction with a groove weld, the thickness shall be the greater of the depth of the groove or the throat thickness.
- 4.6.8.3 For partial penetration branch welds, the thickness shall be the depth of the groove prior to welding.
- 4.6.8.4 For repairs, thickness shall be the depth of the groove as prepared for repair welding.
- 4.6.8.5 For combination of different welds in a component, maximum thickness of weld shall govern.
- 4.6.9 Requirements of Rate of Heating (ROH) above loading temperature 315 ° C and Rate of Cooling (ROC) are as given below. During heating and cooling, variation in temperature between thermocouples shall be 85 ° C maximum, unless otherwise specified.

Thickness	ROH / ROC (Max) Above / upto 315 ° C
Up to 25mm	220 ° C / hour
26 - 50 mm	95 ° C / hour
50 – 75 mm	70° C / hour
Above 75 mm	55 ° C
For S.S Matl	200 ° C / hour min (Forced air cooling)

- 4.6.10 In case of interruption during Heat treatment the following action has to be taken depending on the stage of occurrence:

Type of Heat treatment	Stage of interruption	Action
Annealing & stress relieving	Heating	Heat treat subsequently as specified
	Soaking	Heat treat subsequently for balance soaking
	Cooling	If the ROC during interruption period meets the specified rate, cool subsequently at required rate upto 400° C. Otherwise, reheat to the soaking temperature, hold for 15 minutes and then cool at the specified rate
Normalising(N) Tempering (T) & Soln. annealing (S)	Heating	Heat treat subsequently as specified
	Soaking	Heat treat subsequently for full soaking(N,S) / Balance soaking (T)
	Cooling	Not applicable

- 4.6.11 Local heat treatment can be carried out by Resistance heating or Induction heating. For local heat treatment of weld joints, width of the heated band on either side of the weld must be at least 3 times the width of the weld groove of the thickest part or 3 times the highest section thickness, whichever is greater.
- 4.6.11.1 The width of the insulation band beyond the heating band shall be at least twice the total width of the heating band.
- 4.6.11.2 A minimum of three thermocouples shall be placed such that at least one is on the weldment and the other two on the base material on either side of the weldment.
- 4.6.11.3 The winding arrangement shall be established to attain the required temperature. The initial rate of heating shall be minimum such that it stabilises at the required rate of heating before reaching 400 deg C.
- 4.6.12 After heat treatment, the charts shall be correlated with the job and cleared by QC. The chart shall contain cycle no, Date, W.O and DU details. Temperature, ROH, ROC and soaking time shall be calculated, entered in the chart and signed off by QC.
- 4.6.13 Wherever applicable the test coupons shall be tested and reports obtained to complete the clearance of heat treatment operation.

5.0 NON-DESTRUCTIVE TESTING

- 5.1 The requirement of NDE, extent and type of examination shall be as per respective product SQP and / or CQP. Wherever product SQP is not existing the following requirements shall apply.
- 5.2 Visual inspection shall be performed as per SIP:NP:06
- 5.3 RADIOGRAPHY.
- All Butt welds of Carbon steel for thickness $t \geq 32\text{mm}$
 - All butt welds of alloy steels for thickness $t > 12.0\text{mm}$ for P5 and $T > 16\text{mm}$ for P4.
 - All butt welds in monorails.
 - SS butt welds of $T > 16\text{mm}$ unless otherwise specified.

5.3.1 All radiographic films shall possess Firm code , RT agency, Cust. No, Part No, RT reference No. and weld location reference no. The job shall be numbered with Radiograph no.

5.4 MPI / LPI BEFORE PWHT

- a. All flame cut edges of Carbon steel for $t > 37.5$ mm and alloy steels for $t > 12$ mm.
- b. All butt welds joining plate members in which one of the plate member is over 25 mm thick for Carbon steel and over 12 mm thick for alloy steel.
- c. All fillet welds between tension flange and web.
- d. All fillet welds joining plate members in which both the plate members are over 25 mm thick for Carbon steel and over 12 mm thick for alloy steel.
- e. For all butt welds of CS & AS weld groove after back chipping prior to welding from second side.
- f. All main fillet welds for SS require LPI
- g. MPI/LPI for all fillet welds & HAZ of SA387 Gr.22 materials after HT.

5.5 All NDE shall be carried out by qualified personnel as per BHEL NDT procedures. Where subcontractors use their own procedures for NDE the same shall have the approval of BHEL NDTL.

6.0 MACHINING

6.1 GENERAL

6.1.1 Ensure of raw material identification throughout the machining process. Traceability to the contract shall be ensured by stamping or marking / painting or by tags(WO No.and DU / Part no.)

6.1.2 Where the material identification is likely to be removed during cutting or machining , the transfer of material identification shall be ensured.

6.1.3 In case of components / part processed items received from Subcontracting / other shops, ensure the completeness and clearance by QC / Customer Inspector through Inspection Reports / OPS.

6.1.4 Proper care shall be taken during handling of materials at all stages of manufacture. Items stored in the shop floor shall be properly identified and preserved to prevent mixup and damages / rusting / warpages.

6.1.5 All Machined surfaces shall be properly protected and stored. Wherever long storage is envisaged, they shall be preserved with grease / rust preventive oils and protected suitably with polythene / gunny bag or plastic peel off coatings.

6.2 MARKING

6.2.1 The marking on machined components shall be in such a location which will not be detrimental to the surface finish requirements of the component.

6.2.2 Purpose of marking is to:

- 1. Ensure availability of machining allowance.
- 2. Identify locations for machining.
- 3. Provide reference for setting and inspection.

6.3 PROCESS CONTROLS

6.3.1 The following shall be ensured for selection of work centers, tools, jigs and fixtures:

- a The work centre for machining shall be identified in OPS / loading sheet based on the process capability of the machine or Machine accuracy established to suit the tolerances.
- b Test hardware (Jigs, Fixtures and Templates) used as a means of inspection / process control shall have been qualified through first off trials and shall be regulated through valid number. The same shall be reflected in the OPS / loading sheet .
- c Softwares used in case of CNC / NC machines shall have been validated through trials or inspection of similar components produced and accepted.
- d All cutting tools shall have been ensured for its correctness before use. In case of regrinding of tools they shall be verified after regrinding.

6.3.2 The following shall be ensured before setting the job on the machine, during processing and after completion of machining:

- a Ensure the verticality and flatness of the job after clamping by using the reference markings or dialing the surfaces. Ensure the adequacy of clamping.
- b Ensure proper clamping of the correct tool in to the tool holders.
- c After machining the machined surfaces shall be cleaned and all corners shall be deburred. After removing from the machine they shall be properly stored.
- d Before starting reaming ensure proper material allowance for finish operation.
- e During drilling, reaming and tapping the removal of chips shall be done periodically to prevent clogging of chips. For deep drilling ensure that run out and drill travel are verified in free condition and ensure proper clamping of the tools.

6.4 INSPECTION

6.4.1 Ensure completeness of all final machining operations. Dimensional inspection shall be done with relevant drawings. Ensure use of calibrated instruments / gauges.

6.4.2 Unless otherwise specified in the drawing or SQP, the following tolerances can be used for untoleranced dimensions.

1.Linear Tolerance (:millimeters) - Medium

PERMISSIBLE DEVIATIONS FOR BASIC SIZE RANGE						
Up to 6	From 6 TO 30	from 30-120	From 120-400	From 400-1000	From 1000-2000	Above 2000
± 0.1	± 0.2	± 0.3	± 0.5	± 0.8	± 1.2	± 2.0

2. Angular Tolerance

- a. Assembly characteristics ± 0.5°
- b. Other characteristics ± 1°

7.0 FINAL INSPECTION

7.1 All dimension shall be inspected as per relevant drawings. Tolerances for fabricated items when not specified in drawings shall be as per clause 4.2.6.

8.0 CLEANING AND PAINTING

8.1 All the temporary cleats, bridge pieces shall be removed carefully so as to avoid damage to parent material. Temporary tack welds shall be ground smooth. Complete assembly shall be cleaned to remove mill scales, spatter, slag, rust, oil or grease. Surfaces shall be prepared and painted as per SIP:PP:22 (latest). Site EPs shall be applied with weldable primer. All site EP shall be protected suitably from mechanical damage.

8.2 All temporary stiffeners / attachments used for transportation and handling that are removed after site assembly shall be painted with yellow paint.

8.3 Match marking and flow direction for applicable components shall be as per the respective product SQP./Drawing

8.4 The following details shall be clearly marked with relevant details by paint, bordered and covered by one coat of transparent varnish

Project Name :
Work order number :
Component / Assly. Designation :
DU Number :
Weight :
Sub-contractor Name / Code :

8.5 Tension flanges in girders are to be identified by hard punching indicating 'TENSION FLANGE'.

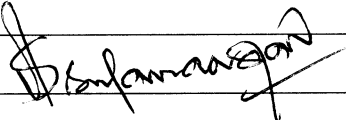
8.6 For subcontracted items the firm code shall be punched and bordered with white paint.

	QUALITY ASSURANCE	QCP : E : 002
	QUALITY CONTROL PROCEDURE FOR SPLICING NORMS FOR SHEETS / PLATES / STRUCTURALS APPLICABLE TO ESP COMPONENTS FABRICATION	Rev. No. 03
		DT. 30.05.2013




QUALITY CONTROL PROCEDURE

**FOR SPLICING NORMS FOR SHEETS / PLATES / STRUCTURALS APPLICABLE TO
ESP COMPONENTS FABRICATION**


PREPARED BY :

DEPARTMENT	NAME & Designation S/Shri	SIGNATURE
QA	K. Jothi Arulanandam Dy.Mgr/QA	

REVIEWED BY:

DEPARTMENT	NAME & Designation S/Shri.	SIGNATURE
EDC / AQCS	C. Ganesh Sr.Mgr/AQCS	
OUT SOURCING	N. Nandagopal Sr.Mgr/OS	
QUALITY CONTROL	O. K. Abdulhuq Sr.Mgr/QC-OLI	
QUALITY ASSURANCE	R. Arunachalam Mgr/QA	

APPROVED BY

DEPARTMENT	NAME & Designation S/Shri	SIGNATURE
QA	G. BALASUBRAMANIAN SR.DGM / QA, QC(Proc.) & BE	

	QUALITY ASSURANCE QUALITY CONTROL PROCEDURE FOR SPLICING NORMS FOR SHEETS / PLATES / STRUCTURALS APPLICABLE TO ESP COMPONENTS FABRICATION		QCP : E : 002
			Rev. No. 03
			DT. 30.05.2013

03	30.05.2013	Amendment A1 merged. Feedback from OS and Engg (AQCS) Splicing Norms with applicable Drawing for carbon steel materials and SS Liner Sheet were added and re-issued.
02	03.03.2000	Feedback from MSA and Engg were included and re-issued.
01	16.06.1999	All amendments were merged, feedback from Engg and MSA were included and re-issued.
00	30.10.1985	Original Issue
REV. NO.	EFFECTIVE DATE	REVISIONS MADE

HISTORY OF RECORD OF REVISIONS

1.0 SCOPE

- 1.1 This Quality Control Procedure (QCP) specifies the requirements for splicing of sheets / plates / structural which may warrant joints to make the required length / width in order to achieve the final product as per drawing.
- 1.2 This QCP is applicable to Sheets / Plates / Structural – Angles, Beams of all types, Sections of Rolled / Built up, Rounds, Pipes and Tubes.
- 1.3 The splicing norms dealt in this QCP is applicable to following ESP components ;
 - 1.3.1 7X-X42 Outer Roof Assy
 - 1.3.2 7X-X44 Hopper Upper & Middle
 - 1.3.3 7X-X45 Hopper Lower with SS Liner Sheet
 - 1.3.4 7X-X46 Insulator Support Panels
 - 1.3.5 7X-X47 Inner Roof Panel Assy
 - 1.3.6 7X-X49 Casing Shell Panels
 - 1.3.7 7X-X50 Inlet / Outlet Funnel
- 1.4 This QCP covers both Carbon Steel and SS Liner Sheet materials applicable to ESP Components.

2.0 SPLICING NORMS - GENERAL POLICY

- 2.1 The fabricator or OS cutting plan section shall categorically try to avoid joints as much as possible with the supplied raw materials.
- 2.2 Further to explain the point no. 2.1 – the fabricator and OS cutting plan section shall try to make the supplied raw materials without any joints to cover up the loaded quantities – Eg., Out of 10 Nos of casing shell Panels loaded - maximum no. of panels shall be accommodated without any joints by fabricator and only to reduce the material wastage the balance quantity of casing shell panels shall be made with permitted joints as applicable.

	QUALITY ASSURANCE QUALITY CONTROL PROCEDURE FOR SPLICING NORMS FOR SHEETS / PLATES / STRUCTURALS APPLICABLE TO ESP COMPONENTS FABRICATION	QCP : E : 002
		Rev. No. 03
		DT. 30.05.2013

2.3 The joints permitted are considered with a following view only

- 2.3.1 To reduce the material wastage
- 2.3.2 To make the best use of supplied raw materials sizes without prejudice to appearance and quality of final product as applicable
- 2.3.3 Aesthetic appearance shall not be sacrificed in accommodating the splicing norms.
- 2.3.4 Splicing Joints shall be avoided where a cross member is meeting or on bolt hole region. This is to be strictly adhered by fabricator and shall study the drawing fully with all the matching components.

2.4 ESP Components where joints are not permitted

- 2.4.1 Shock Beam
- 2.4.2 Rapping Shaft
- 2.4.3 Vertical Beam
- 2.4.4 Foundation Bolt
- 2.4.5 Suspension Rod
- 2.4.6 Emitting Frame Top, Middle and Bottom
- 2.4.7 Collecting Suspension Arrangements
- 2.4.8 Lifting Holder
- 2.4.9 Vertical Stay
- 2.4.10 Shock bar

3.0 SPLICING NORMS – SPECIFIC TO RAW MATERIALS

3.1 SHEETS / PLATES (CARBON STEEL)

- 3.1.1 The preparation of joints shall be staggered one so that formation of (+) plus type joint is avoided. The minimum offset (staggering) to avoid the plus type joint shall be minimum 100mm.
- 3.1.2 For a surface area including 2 Mtr X 2 Mtr and less - the permitted smallest dimension of any piece shall be minimum 400 mm (either length wise or breadth wise) and the same will be 600mm minimum for more than 2 Mtr X 2 Mtr surface area – Refer sketch - S1
- 3.1.3 The distance between nearest stiffener and the joint parallel to it shall be minimum 50mm – Refer sketch – S1
- 3.1.4 The vertical joint is permitted on the taper portion. However the distance between meeting of the vertical joint with the horizontal joint shall be minimum 100mm – Refer sketch – S1
- 3.1.5 Butt weld reinforcement shall be ground flush wherever stiffeners cross them.
- 3.1.6 When bending of the plate is done before welding, the parallel joints shall be minimum 100 mm away from the bend line. The weld quality shall be ensured by

	QUALITY ASSURANCE QUALITY CONTROL PROCEDURE FOR SPLICING NORMS FOR SHEETS / PLATES / STRUCTURALS APPLICABLE TO ESP COMPONENTS FABRICATION	QCP : E : 002
		Rev. No. 03
		DT. 30.05.2013

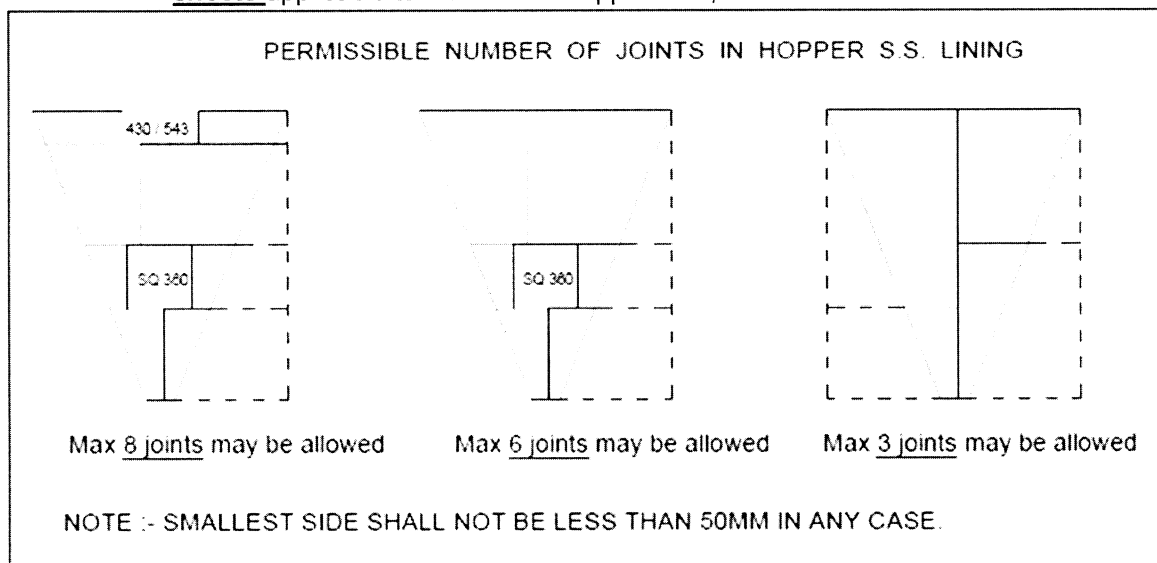
MPI / LPI. If the weld joint is subjected to bend, the weld shall be checked by LPI subsequent to bending.

- 3.1.7 The maximum number of permitted joints shall be as given below for carbon steel sheets / plates

Sl. No.	Surface Area in Sq. Mtr	Maximum No. Of joints permitted put together both axis (X & Y)
1	Less than & Up to 2	1
2	More than & Up to > 2 < 5	3
3	More than & Up to > 5 < 10	6
4	More than & Up to > 10 < 15	7
5	More than & Up to > 15 < 20	9
6	More than & Up to > 20 < 25	11
7	More than & Up to > 25 < 30	13
8	More than > 30	15

NOTE: The above permitted joints supersedes the maximum no. of joints given in clause no. 4.13 & 4.14 of SQP:ESP:284 Rev.01 Dtd.06.06.2007

- 3.1.8 The maximum number of permitted joints shall be as given below for **SS Liner sheets** applicable to ESP Lower hopper area;



	QUALITY ASSURANCE QUALITY CONTROL PROCEDURE FOR SPLICING NORMS FOR SHEETS / PLATES / STRUCTURALS APPLICABLE TO ESP COMPONENTS FABRICATION	QCP : E : 002
		Rev. No. 03
		DT. 30.05.2013

3.2 ANGLES, CHANNELS, BEAMS (BOTH ROLLED / BUILT UP - INCLUDING NPB&UB) APPLICABLE TO ESP ROOF BEAMS & SUPPORTING COLUMNS 7X-X28 and 7X-X81, 82, 83 & 84

- 3.2.1 The splicing norms for Angles, Channels and Beams (both rolled / built-up) shall be strictly followed as per the drawing no.1-79-081-02331 Rev.00.
- 3.2.2 Any change other than given in above referred drawing shall be approved by Engg (AQCS) and the request for the same shall be forwarded by cutting plan section of OS Dept.
- 3.2.3 Only one joint is permitted on the transverse roof beams.

3.3 “ H “ BEAMS APPLICABLE TO CASING STRUCTURE COLUMNS – 7X-X48 (BOTH ROLLED / BUILT UP)

- 3.3.1 The splicing norms for “H” Beams shall be strictly followed as per the drawing no. 4-79-000-00763 Rev.00.
- 3.3.2 Maximum two joints ie., one for shop and another for site / field shall be permitted for a maximum length of 16.5 Mtr of section considering ODC constraints.
- 3.3.3 Joints on flange shall be staggered by minimum 300 mm avoiding falling of joint on the same side of the built up sections.
- 3.3.4 The splice plate provided for web joints shall not foul with the gusset plates provided on the “H” beams and a minimum clearance of 50 mm shall be maintained.
- 3.3.5 The minimum distance permissible between a joint and the nearest gusset / bracket location shall be 200mm.

3.4 RODS, ROUNDS, PIPS AND TUBES

- 3.4.1 No joint is permitted if the length of rod is 2 M or less.
- 3.4.2 Minimum length for splicing using sleeve shall be 500mm for tubes
- 3.4.3 Only one joint is permitted for Tie Rods / Strut

4.0 EDGE PREPARATION, WELDING, WELD NDE DETAILS :

- 4.1 Check for material specification of plates / sections which are to be joined to avoid mix up of material. TCN to be obtained for change of material.
- 4.2 Electrode selection shall be as per the respective WPS.

	QUALITY ASSURANCE QUALITY CONTROL PROCEDURE FOR SPLICING NORMS FOR SHEETS / PLATES / STRUCTURALS APPLICABLE TO ESP COMPONENTS FABRICATION	QCP : E : 002
		Rev. No. 03
		DT. 30.05.2013

- 4.3 Welding shall be followed with suitable methods of sequence and controls to minimize the weld distortion.
- 4.4 Weld over joint shall be avoided and minimum distance between stiffeners parallel to weld joint is 50mm.
- 4.5 Wherever, back grinding is not feasible due to location of the plate / sheet, root welding to be carried out with 3.15mm electrode and LPI to be carried out after thorough cleaning and repeat LPI after final welding.
- 4.6 Following are the guidelines for Edge Preparation (EP) if not specified in drawing;
- Plates / Sheets up to 5mm** : No EP required. Provide 2 to 3 mm root gap, weld on both sides. MPI to be conducted after final welding.
 - Plates of 6 mm** : No EP required. Weld shall be with square butt with 2 to 3 mm gap. Weld from first side and turn the plate for back grinding and conduct root LPI. Complete the weld and conduct the final MPI.
 - Plates of 7 & 8 mm** : Single "V" , 60° EP, Weld from V side and turn the plate, back grind and conduct LPI, complete the Weld. Final MPI.
 - Plates above 8 mm** : Double "V" , 60° EP, Weld one side, Carryout back grind and conduct LPI to ensure sound metal and weld from other side. Final both side MPI after completion of weld.
 - For Structural (Angle, Channel, Beam)** : Single "V" , 60° EP, Weld from V side and back grind and conduct LPI. Complete the weld, conduct final LPI before splice plate setting.

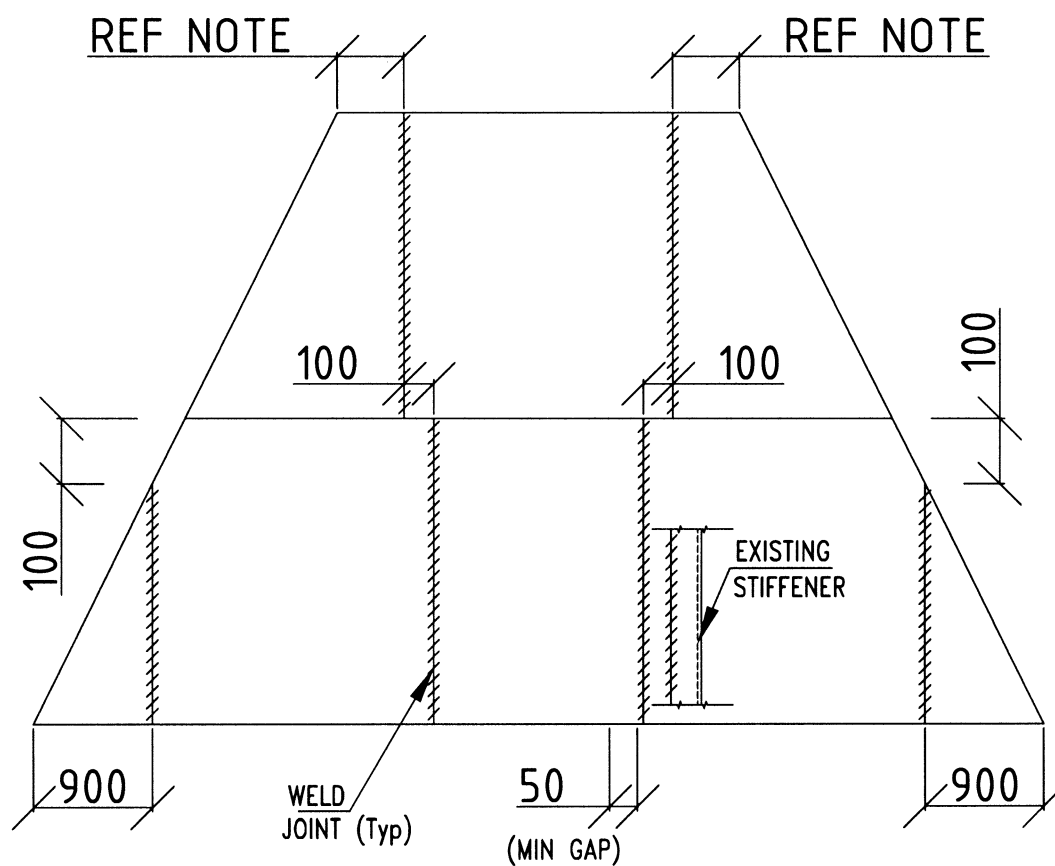
Note:

- Splice plate details shall be taken from relevant fabrication Engg drawing.
- Splice Joint shall be avoided where a cross member is meeting.
- The weld should be ground flush and smooth and the proper splice plate is placed & welded.

!!!@@@###

QUALITY CONTROL PROCEDURE FOR SPLICING OF SHEETS,
PLATES AND OTHER STRUCTURAL ITEMS

SKETCH FOR CLAUSES 3.1.2 TO 3.1.4



NOTE : MINIMUM DIMENSION OF SPLICED PLATE = 200 MM FOR
DUCT WALL OF ANY SIZE

ALL DIMENSIONS ARE IN MM

Page 7 of 7

BHARAT HEAVY ELECTRICALS LIMITED
TIRUCHIRAPALLI 620 014
QUALITY ASSURANCE

SIP:NP:06/01

PAGE : 1 Of 6

PROCEDURE FOR VISUAL INSPECTION OF NON PRESSURE PARTS

REV.	DATE	PREPARED	REVIEWED	APPROVED
00	15/07/96	P.S.Narayanan	A.R.Reddy	V.Raghavendran
01	28/03/04	 A Francis	 G S N Murthy	 C R Raju

REVISION STATUS

REVISION NO:	CLAUSE NO	DETAIL OF REVISION
00	----	1)PR:QE:021/02 renumbered as SIP:NP:06. 2)Editorial corrections for clarity. 3)Clause 3.1 modified.
01	3.1	Code related change
	3.2	For better clarity
	3.2.1	-do-
	3.2.3	Code related change
	3.2.5	For better clarity
	4.4	Code related change

1.0 SCOPE

- 1.1 This procedure details out the visual inspection of all base metal surfaces and weld joints of Non pressure parts.

2.0 REFERENCE DOCUMENTS

AWS D 1.1 & Relevant drawings

3.0 VISUAL INSPECTION OF GAS CUT EDGES

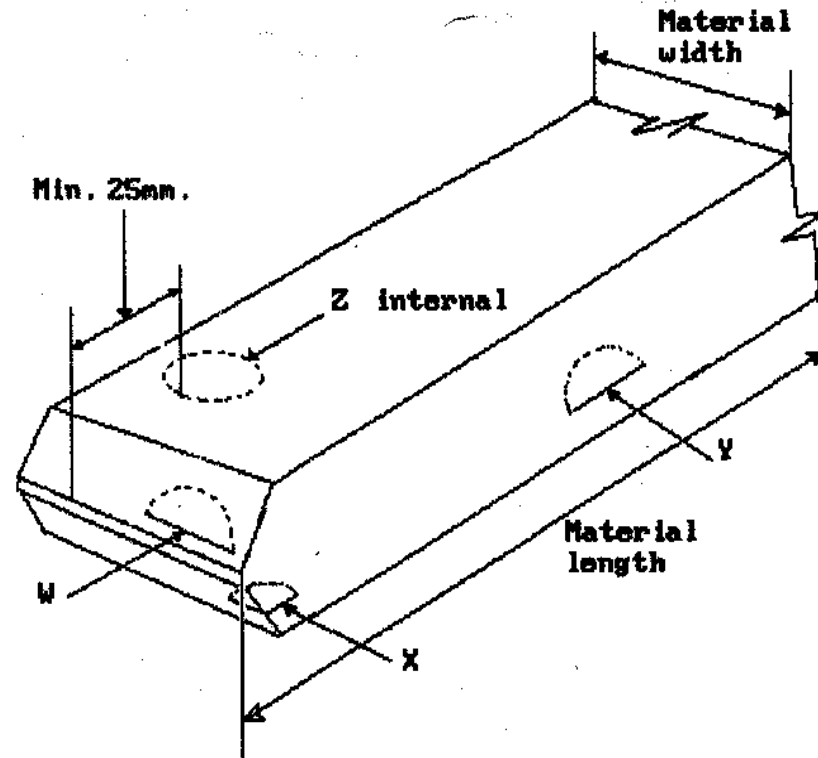
- 3.1 Acceptability and repair of mill induced laminar discontinuities in cut surfaces

Description of Discontinuity	Repair Required
Any discontinuity 25mm in length or less	No repair .
Any discontinuity over 25mm in length and 3mm max. depth (after grinding & confirmation of depth on 10% of total such locations)	No repair
Any discontinuity over 25mm in length with depth over 3mm but not greater than 6mm.	Remove by grinding and weld
Any discontinuity over 25mm in length with depth over 6mm but not greater than 25mm.	Completely remove and weld.
Any discontinuity over 25mm in length with depth greater than 25mm.	See Cl.3.2

- 3.2 For discontinuities over 25mm in length with depth greater than 25mm, discovered by visual inspection (and subsequent grinding for depth assessment) of plate cut edges/ bevel edges before welding or during examination of welded joints by radiography or ultrasonic inspection, following procedure shall be followed:

- 3.2.1 Prior to completing the weld joint, the discontinuities such as (W), (X) or (Y) shall be determined visually (for length) and by NDT (UT, and /or MPI) for depth and recorded for the size and shape of discontinuity as per Fig.1.

Fig.1 EDGE DISCONTINUITIES IN CUT PLATE



- 3.2.2 The repair of the discontinuity by welding shall be allowed in case area of discontinuity does not exceed 4% of the cut area with the following exceptions. If the width of the discontinuity or the aggregate width of discontinuities on any transverse section, as measured perpendicular to the plate length, exceeds 20% of the plate width, the limit of 4% area shall be reduced by percentage amount of the width exceeding 20% (e.g., if the discontinuity is 30% of plate width, the area of discontinuity cannot exceed 3.6% of the plate area). The discontinuity on the cut edge of the plate shall be gouged out to a depth of 25mm beyond its intersection of the surface by chipping, or carbon arc gouging, or grinding and blocked off by welding with manual shielded metal arc process in layers not exceeding 3mm in the thickness.

- 3.2.3 If discontinuity (Z) not exceeding the allowable area is discovered after the joint has been completed and is determined to be 25mm or more away from the face of the weld, as measured on the plate surface, no repair of discontinuity is required. If the discontinuity (Z) is less than 25mm away from the weld, it shall be gouged out to a distance of 25mm from the fusion zone of the weld by chipping, air carbon arc gouging or grinding. It shall then be blocked off by welding with low hydrogen SMAW process for at least four layers not to exceed 3mm thickness per layer. Submerged arc or other welding process may be used for remaining layers.
- 3.2.4 If the area of discontinuity (W), (X), (Y) or (Z) exceeds the allowable limits of Cl.3.2.2, the plate or sub-component shall be rejected.
- 3.2.5 The aggregate length of weld repair shall not exceed 20% of length of plate surface being repaired.
- 4.0 **VISUAL INSPECTION OF WELDS**
- 4.1 Visual examination of welds shall be performed after completion of welding and subsequent cooling to room temperature. However for ASTM A514 and A517 steels visual examination of welds shall be performed only after 48 hours of completion of welding.
- 4.2 All welds shall be cleaned to remove slag, spatter etc. and visually examined for defects like crack, undercut, porosity, lack of fusion etc.
- 4.3 The welds shall also be examined for size, shape and reinforcement.

4.4 ACCEPTANCE CRITERIA AND DISPOSITION DETAILS ARE AS FOLLOWS

<u>Nature of defects</u>	<u>Acc. norms</u>	<u>Disposition</u>
1) Crack, Lack of fusion, Overlap	Not accepted	Confirm by LPI/MPI, repair and retest.
2) Crater (Except at the ends of stitch welds outside the required length)	Not accepted	Fill by weld deposit.
3) Undercut		
For T < 25.mm	Up to 1.0 mm accepted. (Upto 2.0 mm if within 50mm for any 300 mm weld Length.)	To be ground & merged/welded otherwise.
For T => 25.4 mm	Up to 2 .0 mm accepted.	>2.0mm to be ground and merged/welded
4) Porosity- Transverse Butt Welds	Piping porosity not permitted	
Porosity for other Butt/Fillet welds	One pore of <= 2.5 mm for Each 100 mm of Weld length is permitted. (*)	(*) Combined length of pores in fillet welds in web to stiffener: 10mm for 25 mm weld & 20mm for 300mm weld is however acceptable.
<u>Weld contour</u>		
1) Face of fillet	Flat or concave (meeting the throat) accepted. convexity is acceptable as below. 2mm for weld width <= 8mm 3mm for weld width > 8mm < 25 mm 5mm for weld width >= 25 m	
2) Size (Minimum)	As per drawing. Under size permitted as below (*) 2mm for nominal size < 5mm 2.5mm for nominal size 6mm 3mm for nominal size >= 8 mm * if undersized weld length is less than of 10% of the total weld length.	
3) Reinforcement (groove)	Max. 3 mm	

BHARAT HEAVY ELECTRICALS LIMITED




TIRUCHIRAPALLI 620 014

QUALITY ASSURANCE

QUALITY ASSURANCE

SIP: NP: 07/02

WELDING/WELDER QUALIFICATION FOR STRUCTURAL APPLICATIONS

REV.	DATE	PREPARED	REVIEWED	APPROVED
00	15/07/96	P.S.Narayanan	A.R.Reddy	V.Raghavendran
01	13/10/03	 A Francis	 GSN Murthy	 C R Raju
02	25/11/09	 T. Palanisamy	 Bikramaditya Roy	 Ravikumar V

Revision no	Clause no	Revision details
00	--	--
01	--	1.PR:QE:172/00 Renumbered as SIP:NP:07 2.Editorial corrections for better clarity
02	--	1.Completely modified

1.0 SCOPE

1.1 This procedure details out the requirements of Welding procedure qualification/ Performance Qualification tests for welders and welding operators/ Welding procedure specification and maintenance of records for the same at sub Vendor works for structural application.

1.2 REFERENCE DOCUMENTS

1.2.1 AWS D1.1/D1.1M:2008.

2.0 WELDING PROCESS

- SMAW -Shielded Metal Arc Welding.
- SAW --Submerged Arc Welding.
- GMAW -Gas Metal Arc welding. (Note 1to3 to be strictly followed)

#Note,

- Prior approval for GMAW to be obtained from BHEL/quality.
- Gas Mixture of 80% Argon & 20% CO2 to be ensured.
- All Production welds shall be done inside the closed shed only.

3.0 WELDING PROCEEDURE QUALIFICATION

3.1 Prepare draft WPS and get it approved by BHEL WTC.

3.2 Consumable selected for draft WPS shall be as per BHEL approved brand.

3.2.1 All NDE and pre treatment for plate before/after cutting & during/ after welding shall be as per the respective QCP & SQP.

3.3 Test plate of size 180x380mm of Specified thickness-2 nos for all butt (fig 5), corner (Fig 9) & fillet (fig 2) weld joints.

3.4 Minimum procedure qualification test requirement for Structural Fabrication : Carbon Steel to IS 2062 E250 GR A OR B.

Sl. NO	Process	PL. thick	Pre-heat	PWHT	Type of Jt.	Test-position	Position qualified
1	SMAW	25mm	NIL	NIL	Groove butt weld	1G	1G,1F
2	SMAW	40mm	YES 100deg.C	NIL	Groove butt Weld	2G	1G,2G,1F,2F
3	SMAW	56mm	Yes 100deg.C	Yes	Groove Butt weld	1G	1G,1F
4	SMAW	10mm	NIL	NIL	Corner weld	3G	3G, 3F
5	SMAW	*	NIL	NIL	Fillet	3F	3F
6	SAW	25mm	NIL	NIL	Butt weld	1G	1G,1F
7	SAW	25	Yes 100deg.C	NIL	Butt weld	1G	1G & 1F
8	SAW	56mm	YES 100deg.C	NIL	Corner weld	1G	1G & 1F
9	SAW	*	NIL	NIL	Fillet	1F	1F
10	SAW	*	NIL	NIL	Fillet	1F	1F
11	GMAW	10mm	NIL	NIL	fillet	3F	1F
12	GMAW	10mm	NIL	NIL	Groove butt weld	2G	1G,2G,1F,2F

Note:

1.0 * Ref fig 8 for size of test plates for fillet welds.

- 2.0 For all other material combinations separate procedure to the relevant code/standard shall be qualified before start of production welds.
- 3.0 SAW corner groove weld qualification with 15°+30° groove angle (ref fig9) shall be done along with plate groove butt weld.
- 4.0 For pipe WPS qualification Dia. 2 inch of schedule 80 and 6 inch of schedule 120 are to be welded in 5G & 2G position respectively. This qualifies for all sizes, positions and unlimited thickness of pipes and tubes.

3.5 Base material other than Carbon steel, applicable welding process is SMAW only. In such cases PQR shall be qualified as per AWS D.1.1.

3.6 Test shall be done in presence of BHEL/ QC or BHEL nominated AIA.

4.0 **BASE MATERIAL.**

4.1 Test plate base material shall match with drawing or other engineering Documents.

4.2 Test plate weld surface shall be ground smooth and free from Oil & scales.

5.0 **WELDING REQUIREMENT**

5.1 Weld groove configuration and dimensions shall be as shown in the Draft WPS, drawing or Sketch authorized by engineering for processing.

5.2 All Procedure qualification and production welds of SAW process shall be done in 1G/1F position only.

5.3 Details of process and consumable used for welding such as Preheat, consumable size, brand name, AWS classification for electrode, Wire and flux, Shielding gas etc shall be recorded and maintained.

5.4 Details of the welding parameters Such as Welding current, voltage, travel speed, wire feed, shielding gas mixture & gas flow rate etc shall be recorded and maintained.

5.5 Details of number of layers and passes of groove or fillet welds (fig6) shall be recorded.

5.6 Back gouge/grind the second side as applicable and ensure weld soundness by MT/PT before second side weld.

5.7 Complete the weld and ensure weld soundness by applicable NDE (MT, PT, and RT or UT).

5.8 Necessary PWHT (as per draft WPS) shall be done before marking the test Specimen for mechanical test.

5.9 The defective portion of the welds in the test plate shall be discarded and not repaired

6.0 Test plate Specimen & test requirement:

6.1 Test Specimen for butt welded test plate as per fig 5 and Fillet/ corner welded test plate as per fig 7 shall be punched with inspecting engineer's stamp before cutting the test specimen. (No. of test specimen shall be as per table-2)

6.2 WPS test specimen requirement for mechanical test are as follows:

Table 2

Test pl. thickness & dia. In mm	Reduced Section tensile	Bend test 4t, 180°			Macro	thick qualified		Dia. Qualified
		Root	face	Side		Min.	Max.	
T 3 to 10	2	2	2	*	--	3mm	2T	--
T>10 T < 25	2	--	--	4	--	3mm	2T	--
T25 & over	2	--	--	4	----	3mm	Unlimited	--
Dia. 50 & t6	2	2	2	-	--	3mm	20mm	Dia. 20-100
Dia. 150 t12	2	2	2	-	--	5mm	Unlimited	Dia. >100mm
Corner/ fillet weld	--	--	--	--	3	5mm	Unlimited	--

*For 10mm plate or wall thickness, a side bend test may be substituted for each of the required face- and root- bend tests.

7.0 Mechanical test

7.1 Prepare the test specimen as per AWS D1.1 and move to BHEL Lab or NABL accredited lab for mechanical testing.

7.2 Mechanical test to be done in presence of BHEL/QC or BHEL nominated AIA.

8.0 Preparation of PQR & WPS

8.1 Generate qualified WPS and PQR (as per the format enclosed in page 9 and 10) indicating all process parameters, Mechanical/ NDE test results, reports as applicable and submit to inspection engineer for verification and approval.

9.0 Welder/ Welding operator qualification (WQ)

9.1 The welder/ welding operators engaged for procedure qualification tests are automatically qualified for production welding.

9.2 Test material: for carbon and alloy steel respective materials shall be used for test.

9.3 Test plate size: 200x200x25 mm or 200x200 and respective plate thicknesses.

9.4 WQ Test and production position qualified are as follows.

Table 3.

Weld type	Test Position	Production position qualified
Plate Groove	3G	1G, 2G, 3G, 1F, 2F & 3F
Plate groove	1G	1G & 1F
Plate fillet	1F	1F
Plate Fillet	3F	1F, 2F & 3F
Pipe Groove	2G & 5G	All position.
Pipe fillet	4F	1F, 2F & 4F

Note: Additional position can be qualified if required. Only qualified personnel shall be engaged in respective positions for production weld.

9.5 WQ Test requirement: Two Nos of side bend tests or 100% RT for butt welded test piece. Macro examination at three faces for fillet welds as per fig 7.

9.6 On successful test results WQR (as per the format enclosed in page 8) to be prepared & countersigned by inspection engineer and maintained for verification.

9.7 **WQ period of effectiveness:**

Qualification is effective unless : 1) The operator or welder is not engaged in welding for a period exceeding six months or unless 2) There is a specific reason to question his ability.

10 **Documentation:**

10.1 Prepare consolidated list of qualified WPS, Welder and Welding operator qualification records and maintain.

11 **Qualification-Types & Limitations**

11.1 Requalification of WPS is required in the following cases

S1. No	Welding variable	SMAW	SAW	GMAW
1.	Change from Low hydrogen to non low hydrogen electrode	Yes	--	--
2.	Change from wire & flux combination	--	Yes	--
3.	Change in nominal filler metal diameter by	>0.8mm	Increase	yes
4.	>7% Change in voltage each dia. used	--	Yes	Yes
5.	% change in travel speed	--	>15	>25
6.	Change in position qualified	Yes	Yes	Yes
7.	A decrease in Groove angle	Yes	Yes	Yes
8.	A decrease in Root gap	Yes	Yes	Yes
9.	An increase in root face	Yes	Yes	Yes
10.	Addition or deletion of PWHT	Yes	Yes	Yes

12 **PQR/ WPS requirement for Different strength Base materials**

12.1 For dissimilar composition of Low strength to high strength welded connections separate PQR and WPS shall be qualified.

12.2 In such cases Low hydrogen electrodes shall only be used.
(Preheat, Post heat and PWHT as per applicable SQP and draft WPS).

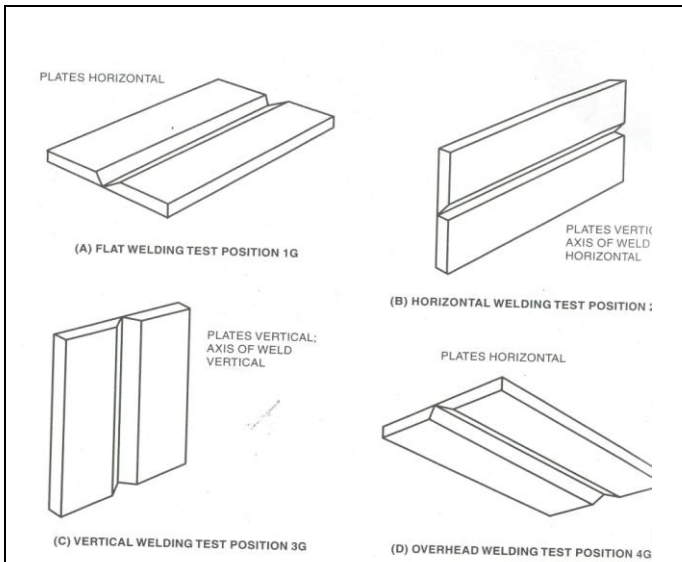


Figure 1

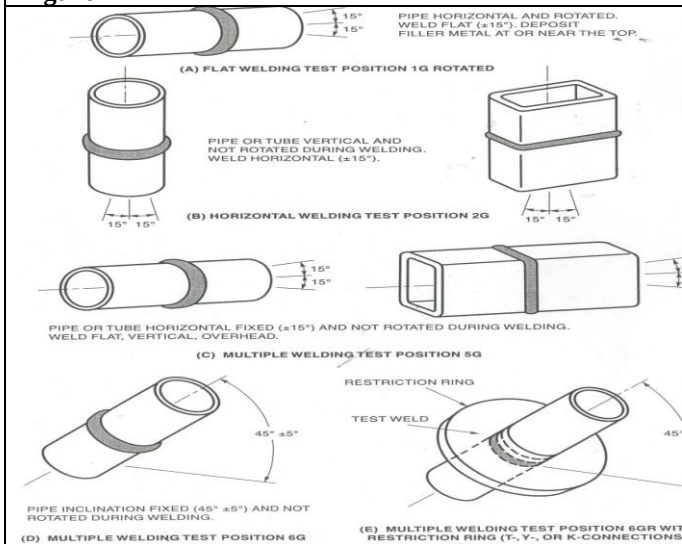


Figure 3

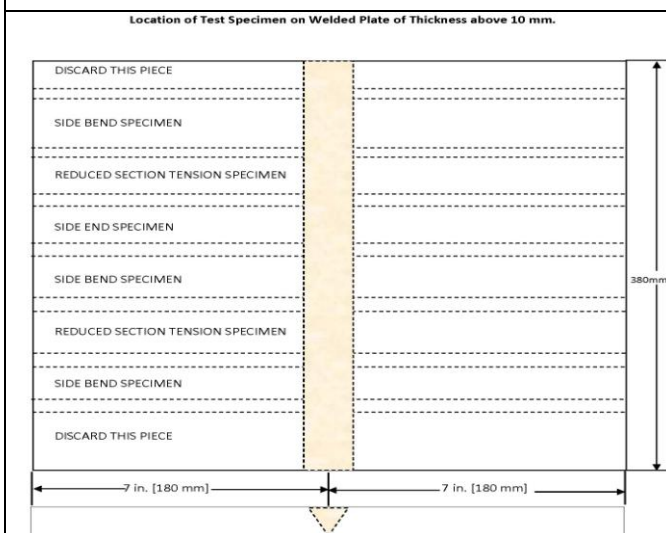


Figure 5

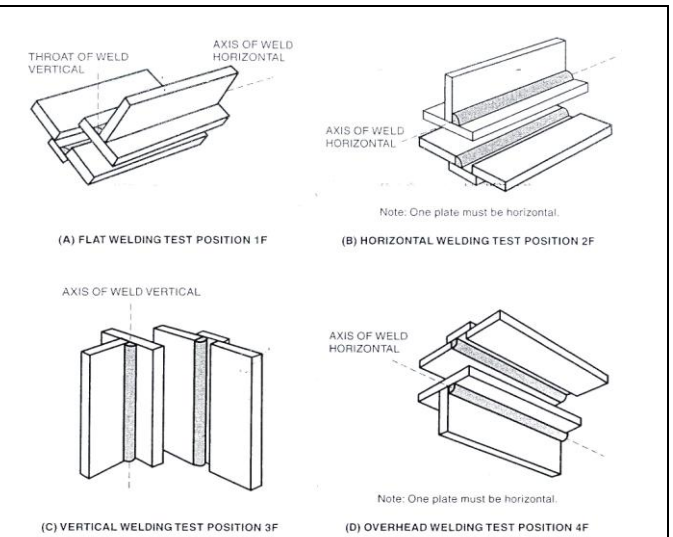


Figure 2

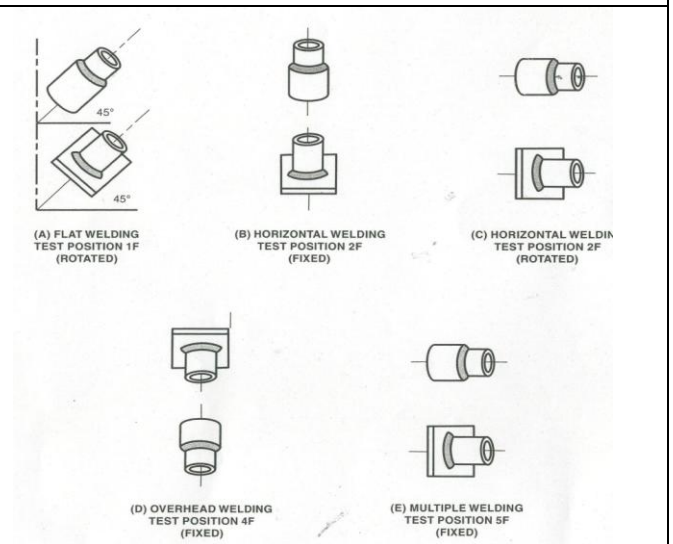
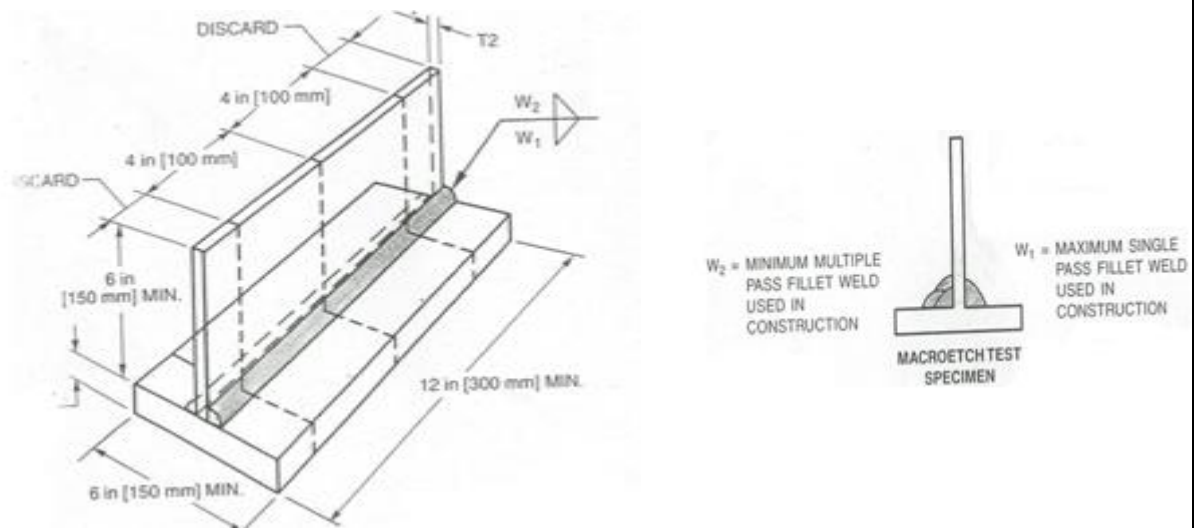


Figure 4

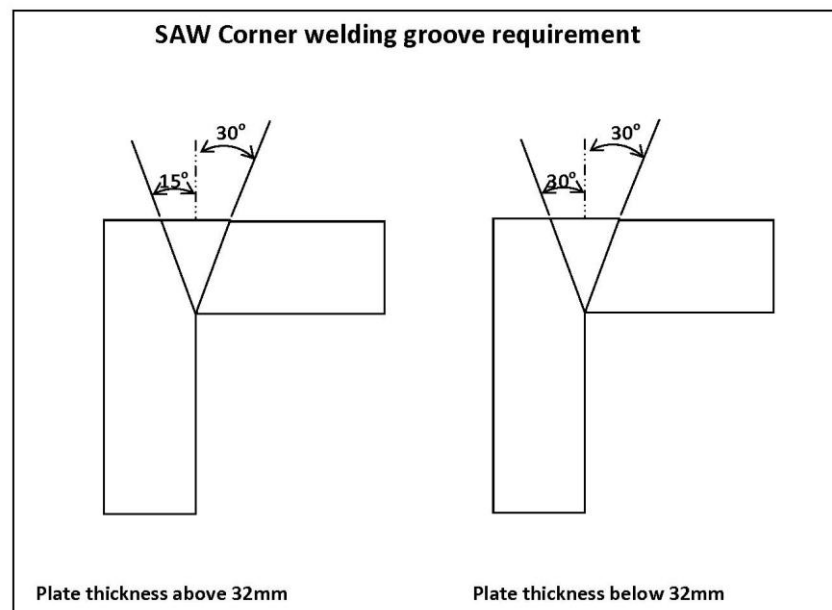
Fillet size	No. of layer	No. of Passes	Joint layer & passes
Up to 10mm	1	1	
12	1 2	1 2	
16	1 2 2	1 2 3	
20	1 2 3 3	1 2 3 4	
25	1 2 3 3 4 4 4	1 2 3 4 5 6 7	

Figure 6

Figure 7 Fillet weld test specimen Details**Figure 8 Fillet weld Test plate Selection details**

Weld Size in mm	T1 minimum	T2 minimum
5	12	5
6	20	6
8	25	8
10	25	10
12	25	12
16	25	16
20	25	20
>20	25	25

Note: Where the maximum plate thickness used in Production is less than the value shown above, the Maximum thickness of the production plates may be Substituted for T1 & T2.

Figure 9

WELDER, WELDING OPERATOR, OR TACK WELDER QUALIFICATION TEST RECORD

Type of Welder _____
 Name _____ Identification No. _____
 Welding Procedure Specification No. _____ Rev _____ Date _____

Variables	Record Actual Values Used in Qualification	Qualification Range
Process/Type [Table 4.12, Item (1)]		
Electrode (single or multiple) [Table 4.12, Item (7)]		
Current/Polarity		
Position [Table 4.12, Item (4)]		
Weld Progression [Table 4.12, Item (5)]		
Backing (YES or NO) [Table 4.12, Item (6)]		
Material/Spec.	to	
Base Metal		
Thickness: (Plate)		
Groove		
Fillet		
Thickness: (Pipe/tube)		
Groove		
Fillet		
Diameter: (Pipe)		
Groove		
Fillet		
Filler Metal (Table 4.12)		
Spec. No.		
Class		
F-No. [Table 4.12, Item (2)]		
Gas/Flux Type (Table 4.12)		
Other		

VISUAL INSPECTION (4.8.1)

Acceptable YES or NO _____

Guided Bend Test Results (4.30.5)

Type	Result	Type	Result

Fillet Test Results (4.30.2.3 and 4.30.4.1)

Appearance _____ Fillet Size _____
 Fracture Test Root Penetration _____ Macroetch _____
 (Describe the location, nature, and size of any crack or tearing of the specimen.)

Inspected by _____ Test Number _____
 Organization _____ Date _____

RADIOGRAPHIC TEST RESULTS (4.30.3.2)

Film Identification Number	Results	Remarks	Film Identification Number	Results	Remarks

Interpreted by _____ Test Number _____
 Organization _____ Date _____

We, the undersigned, certify that the statements in this record are correct and that the test welds were prepared, welded, and tested in conformance with the requirements of Clause 4 of AWS D1.1/D1.1M, (_____) *Structural Welding Code—Steel*.
 (year)

Manufacturer or Contractor _____ Authorized By _____
 Form N-4 Date _____

WELDING PROCEDURE SPECIFICATION (WPS) Yes ☐ PREQUALIFIED _____ QUALIFIED BY TESTING _____ or PROCEDURE QUALIFICATION RECORDS (PQR) Yes ☐								
Company Name _____ Welding Process(es) _____ Supporting PQR No.(s) _____				Identification # _____ Revision _____ Date _____ By _____ Authorized by _____ Date _____ Type—Manual ☐ Semiautomatic ☐ Machine ☐ Automatic ☐				
JOINT DESIGN USED Type: Single ☐ Double Weld ☐ Backing: Yes ☐ No ☐ Backing Material: _____ Root Opening _____ Root Face Dimension _____ Groove Angle: _____ Radius (J-U) _____ Back Gouging: Yes ☐ No ☐ Method _____				POSITION Position of Groove: _____ Fillet: _____ Vertical Progression: Up ☐ Down ☐				
BASE METALS Material Spec. _____ Type or Grade _____ Thickness: Groove _____ Fillet _____ Diameter (Pipe) _____				ELECTRICAL CHARACTERISTICS Transfer Mode (GMAW) Short-Circuiting ☐ Globular ☐ Spray ☐ Current: AC ☐ DCEP ☐ DCEN ☐ Pulsed ☐ Power Source: CC ☐ CV ☐ Other _____ Tungsten Electrode (GTAW) Size: _____ Type: _____				
FILLER METALS AWS Specification _____ AWS Classification _____				TECHNIQUE Stringer or Weave Bead: _____ Multi-pass or Single Pass (per side) _____ Number of Electrodes _____ Electrode Spacing Longitudinal _____ Lateral _____ Angle _____ Contact Tube to Work Distance _____ Peening _____ Interpass Cleaning: _____				
SHIELDING Flux _____ Gas _____ Composition _____ Electrode-Flux (Class) _____ Flow Rate _____ Gas Cup Size _____				POSTWELD HEAT TREATMENT Temp. _____ Time _____				
PREHEAT Preheat Temp., Min. _____ Interpass Temp., Min. _____ Max. _____								
WELDING PROCEDURE								
Pass or Weld Layer(s)	Process	Filler Metals		Current		Volts	Travel Speed	Joint Details
		Class	Diam.	Type & Polarity	Amps or Wire Feed Speed			

Form W-1 (Front)

Procedure Qualification Record (PQR) # _____**Test Results****TENSILE TEST**

Specimen No.	Width	Thickness	Area	Ultimate Tensile Load, lb	Ultimate Unit Stress, psi	Character of Failure and Location

GUIDED BEND TEST

Specimen No.	Type of Bend	Result	Remarks

VISUAL INSPECTION

Appearance _____

Undercut _____

Piping porosity _____

Convexity _____

Test date _____

Witnessed by _____

Radiographic-ultrasonic examination

RT report no.: _____ Result _____

UT report no.: _____ Result _____

FILLET WELD TEST RESULTS

Minimum size multiple pass Maximum size single pass

Macroetch Macroetch

1. _____ 3. _____ 1. _____ 3. _____

2. _____ 2. _____

Other Tests

All-weld-metal tension test

Tensile strength, psi _____

Yield point/strength, psi _____

Elongation in 2 in, % _____

Laboratory test no. _____

Welder's name _____

Clock no. _____ Stamp no. _____

Tests conducted by _____ Laboratory

Test number _____

Per _____

We, the undersigned, certify that the statements in this record are correct and that the test welds were prepared, welded, and tested in conformance with the requirements of Clause 4 of AWS D1.1/D1.1M, (_____) *Structural Welding Code—Steel*
(year)

Signed _____

Manufacturer or Contractor

By _____

Title _____

Date _____

KARAT HEAVY ELECTRICALS LTD
BOILER AUXILIARIES PLANT
ANIPET-632 406 (INDIA)
QUALITY ASSURANCE DEPT.

STANDARD QUALITY PLAN FOR
WELDING

MASTER COPY

Q.P.No. SQH
REV.No. NIL
DATE 10-06-93
PAGE 01 of 02

PREPARED BY: V. Jayaram

REVIEWED BY: M. Tammish

APPROVED BY: M. Tammish

No.	COMPONENT & OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE STANDARD	FORMAT OF REC.	AGENCY	REMARKS
	2	3	4	5	6	7	8	9	10	11
1	WELDING ELECTRODE/FLUXES	CHEMISTRY	MAJOR	LAB TEST	EACHBATCH	AWS A5.1, 5.7 5.5, 5.17OR 5.18	AWSA5.1, 5.5 5.7, 5.17or 5.18	TC	SUPPLIER	*T.C's WILL BE MAINTAINED BY WTC
2	STORAGE OF ELECTRODES/FLUXES IN STORES	METHOD OF STORAGE	MAJOR	VISUAL	100%	AS PER AWS 5.8, 5.17	A5.1, 5.5, 5.18 etc		STORES WTC	
3	ISSUE CONTROL	METHOD OF ISSUE	MAJOR	WQR	10%	AS PER WTC	DP&DI		WTC	
4	WELDER QUALIFICATION	WQR	MAJOR	LIST OF QUALIFIED WELDERS IN PRODN BAYS TO BE CHECKED	100%	ONLY QUALIFIED WELDERS AS PER WQR SHALL BE USED FOR WELDING THAT PARTICULAR WELD.	LIST OF QUALIFIED WELDER	WTC	VERIFICATION OF RECORD 1.e, WQR	
5	PROCEDURE QUALIFICATION	WPS	MAJOR	WPS TO BE VERIFIED FOR THE PARTICULAR MATL.COMBINATION	100%	ONLY THE QUALIFIED/PRE-QUALIFIED PROCEDURE FOR PARTICULAR MATERIAL COMBINATION AND POSITION METHOD SHALL BE USED	LIST OF QUALIFIED WPS	WTC	VERIFICATION OF RECORDS 1.e, WPS	
6	BAKING & DRYING OF LOW H2 ELECTRODES	DRYNESS OF LOW HYDRO-GEN ELECTRODES	MAJOR	VISUAL	RANDOM	WTCI:002/REV 02 DT.15.7.93 AWS D.1.1 (LATEST)		LOG BOOK	WTC	VERIFICATION OF RECORDS AT RANDOM

STANDARD QUALITY PLAN FOR
WELDING

Q.P. SQW01
REV.NO.NIL
DATE 10.06.93
PAGE 02 OF 02

1	2	3	4	5	6	7	8	9	10	11
7	PREHEAT, INTER PASS HEAT POST HEATING	TEMPERATURE OF JOB	MAJOR	BY THERMAL CHALK	RANDOM	PR:QA:/WPS/ OPS AND APPLICABLE	COLOUR CHANGE TO INDICATE CORRECT TEMP		PROD/N/ QC	WITNESS AT RANDOM
8	ROOT WELDING OTHER WELDING	QUALITY OF WELD, INTER PASS CLEANING WIRE BRUSHING GRINDING	MAJOR	VISUAL	RANDOM	AS PER APPLI CABLE WPS, OPS, QCP, PR:QA	NO CRACKS ALLOWED		PROD/N/ QC	WITNESS WELD REINFORCEMENT WELD UNDERCUT STANDARD REF. OF INSTRUMENT USED
9	NDE	QUALITY OF WELD	MAJOR	UT, RT PT, MT	AS PER APPLICABLE WI	AS PER APPLICABLE WORK INSTRUCTIONS		HC	QC	WITNESS
10	FILLET SIZES OF FILLET WELD	SIZE OF WELD	M	FILLET GAUGE CHECK	100%	AS PER DRAWING		HC	QC	WITNESS
11	POST WELD HEAT TREATMENT	CORRECTNESS OF SRT CYCLE	C	VERIFICA- TION OF CYCLE AS PER PRODUCT HT CYCLE FROM HT SCHEDULE HT:001	100%	TEMPERATURE AT WHICH JOB LOADED IN FURNACE HEAT ING RATE SOAKING RATE SOAKING TIME COOLING RATE TEMPERATURE TO WHICH JOB TO BE FURNACE COOLED	AS PER SRT CYCLE IN HT:001 FOR THE PARTICULAR COMPONENT	HC	PROD/N/ QC	VERIFICATION HT CYCLE