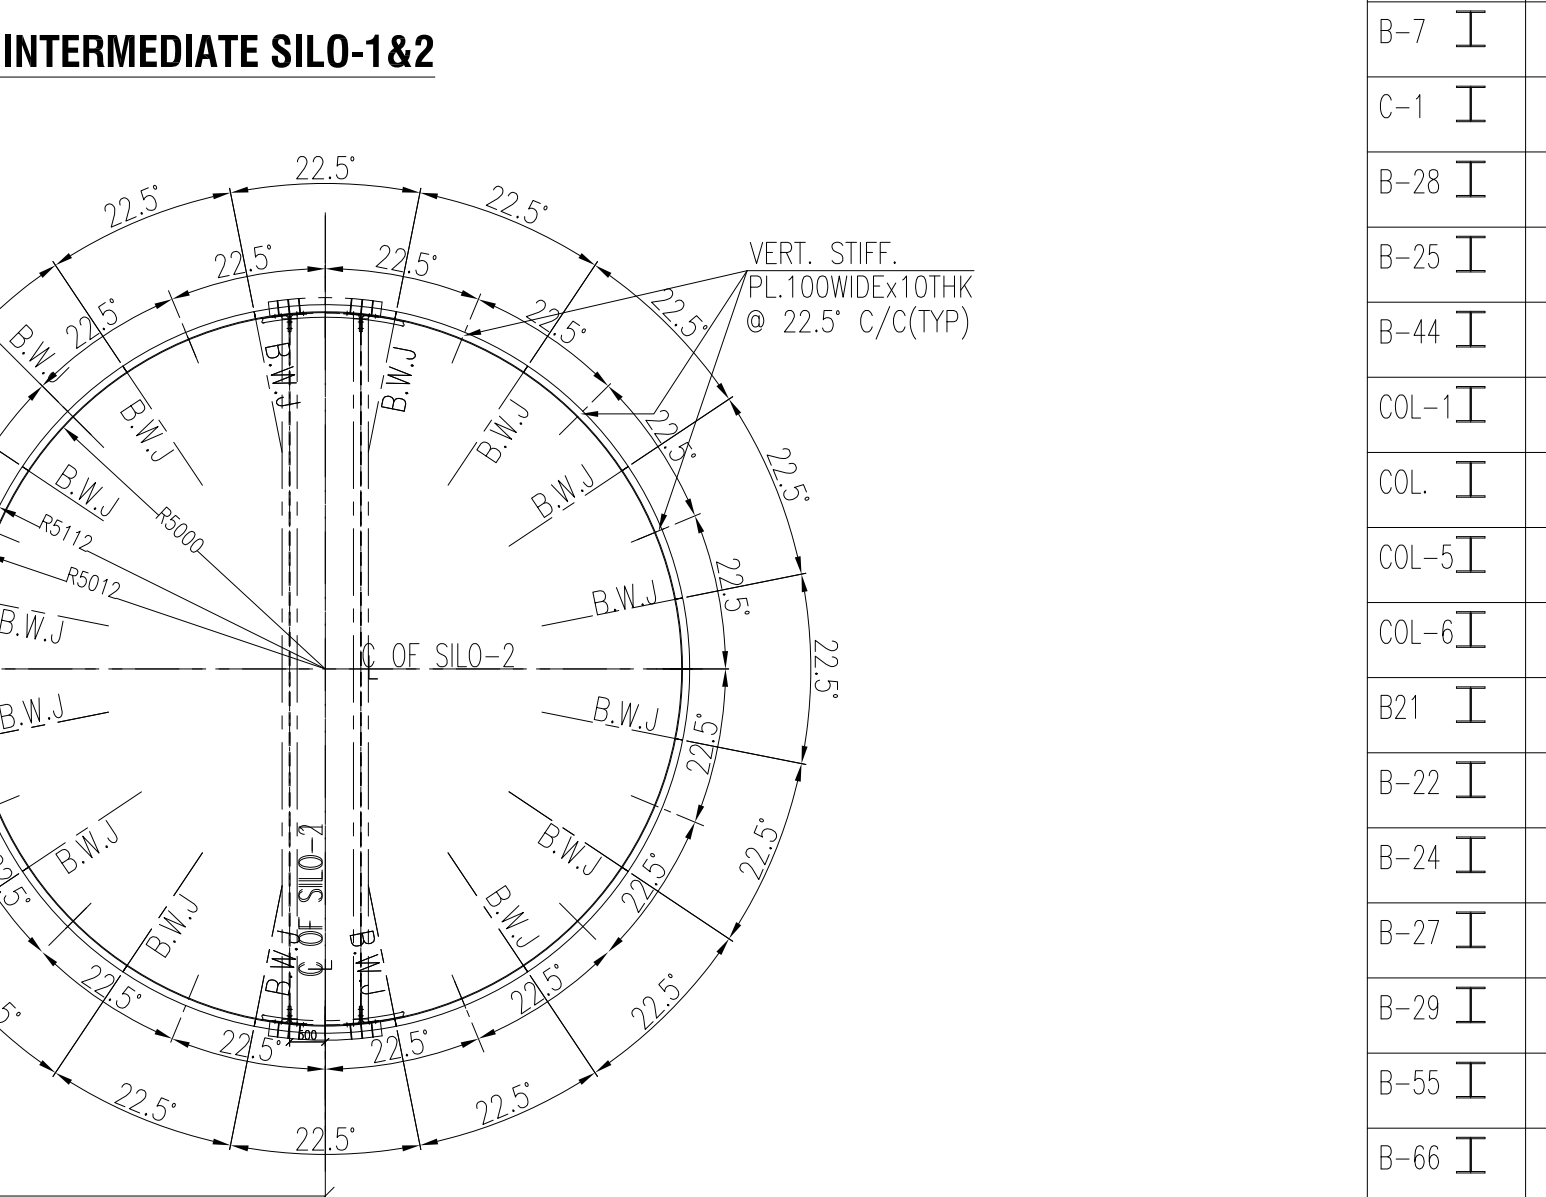
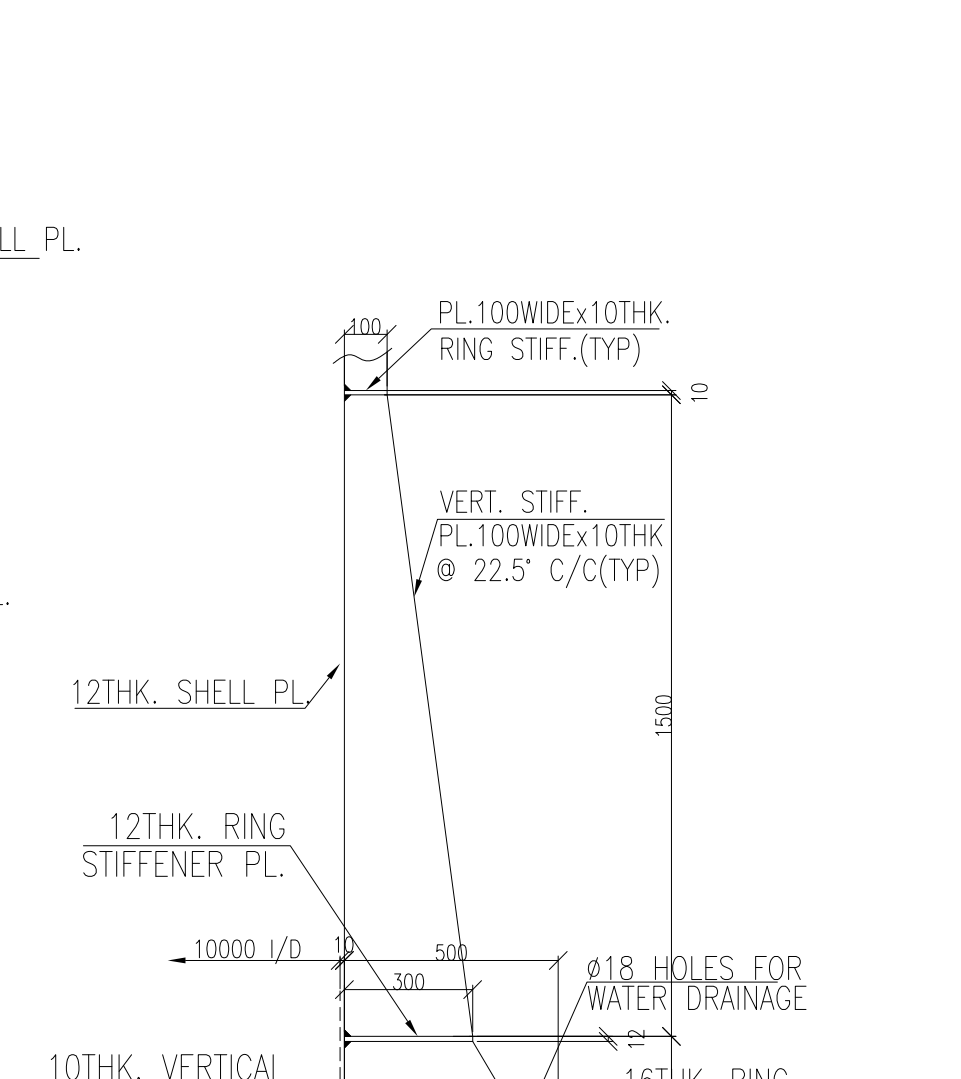
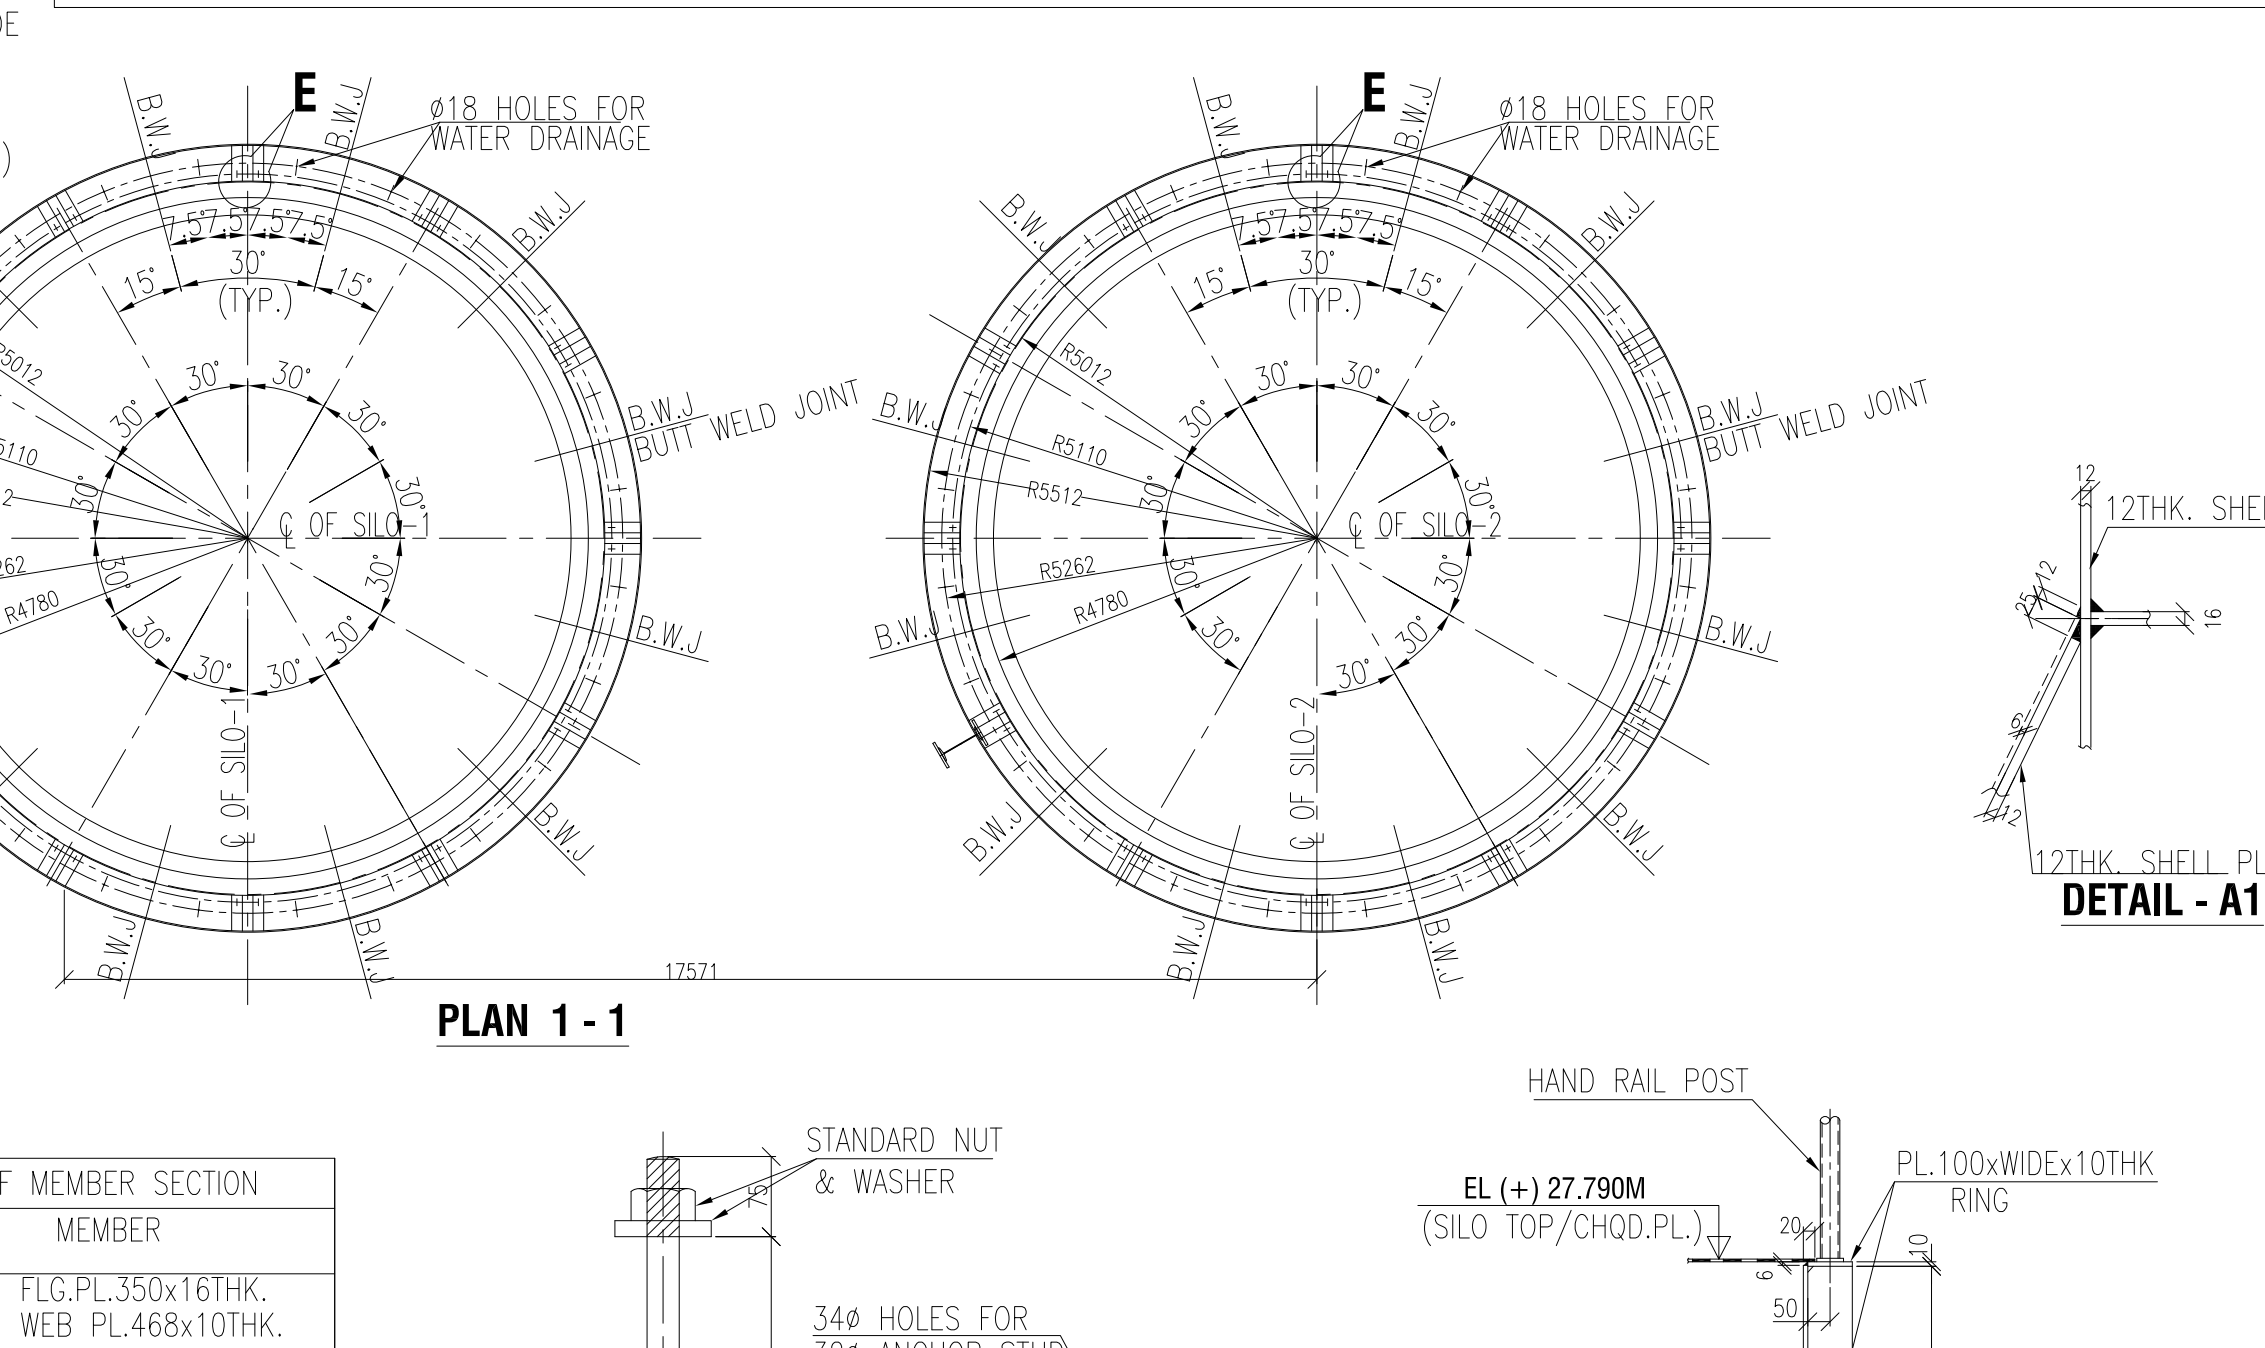
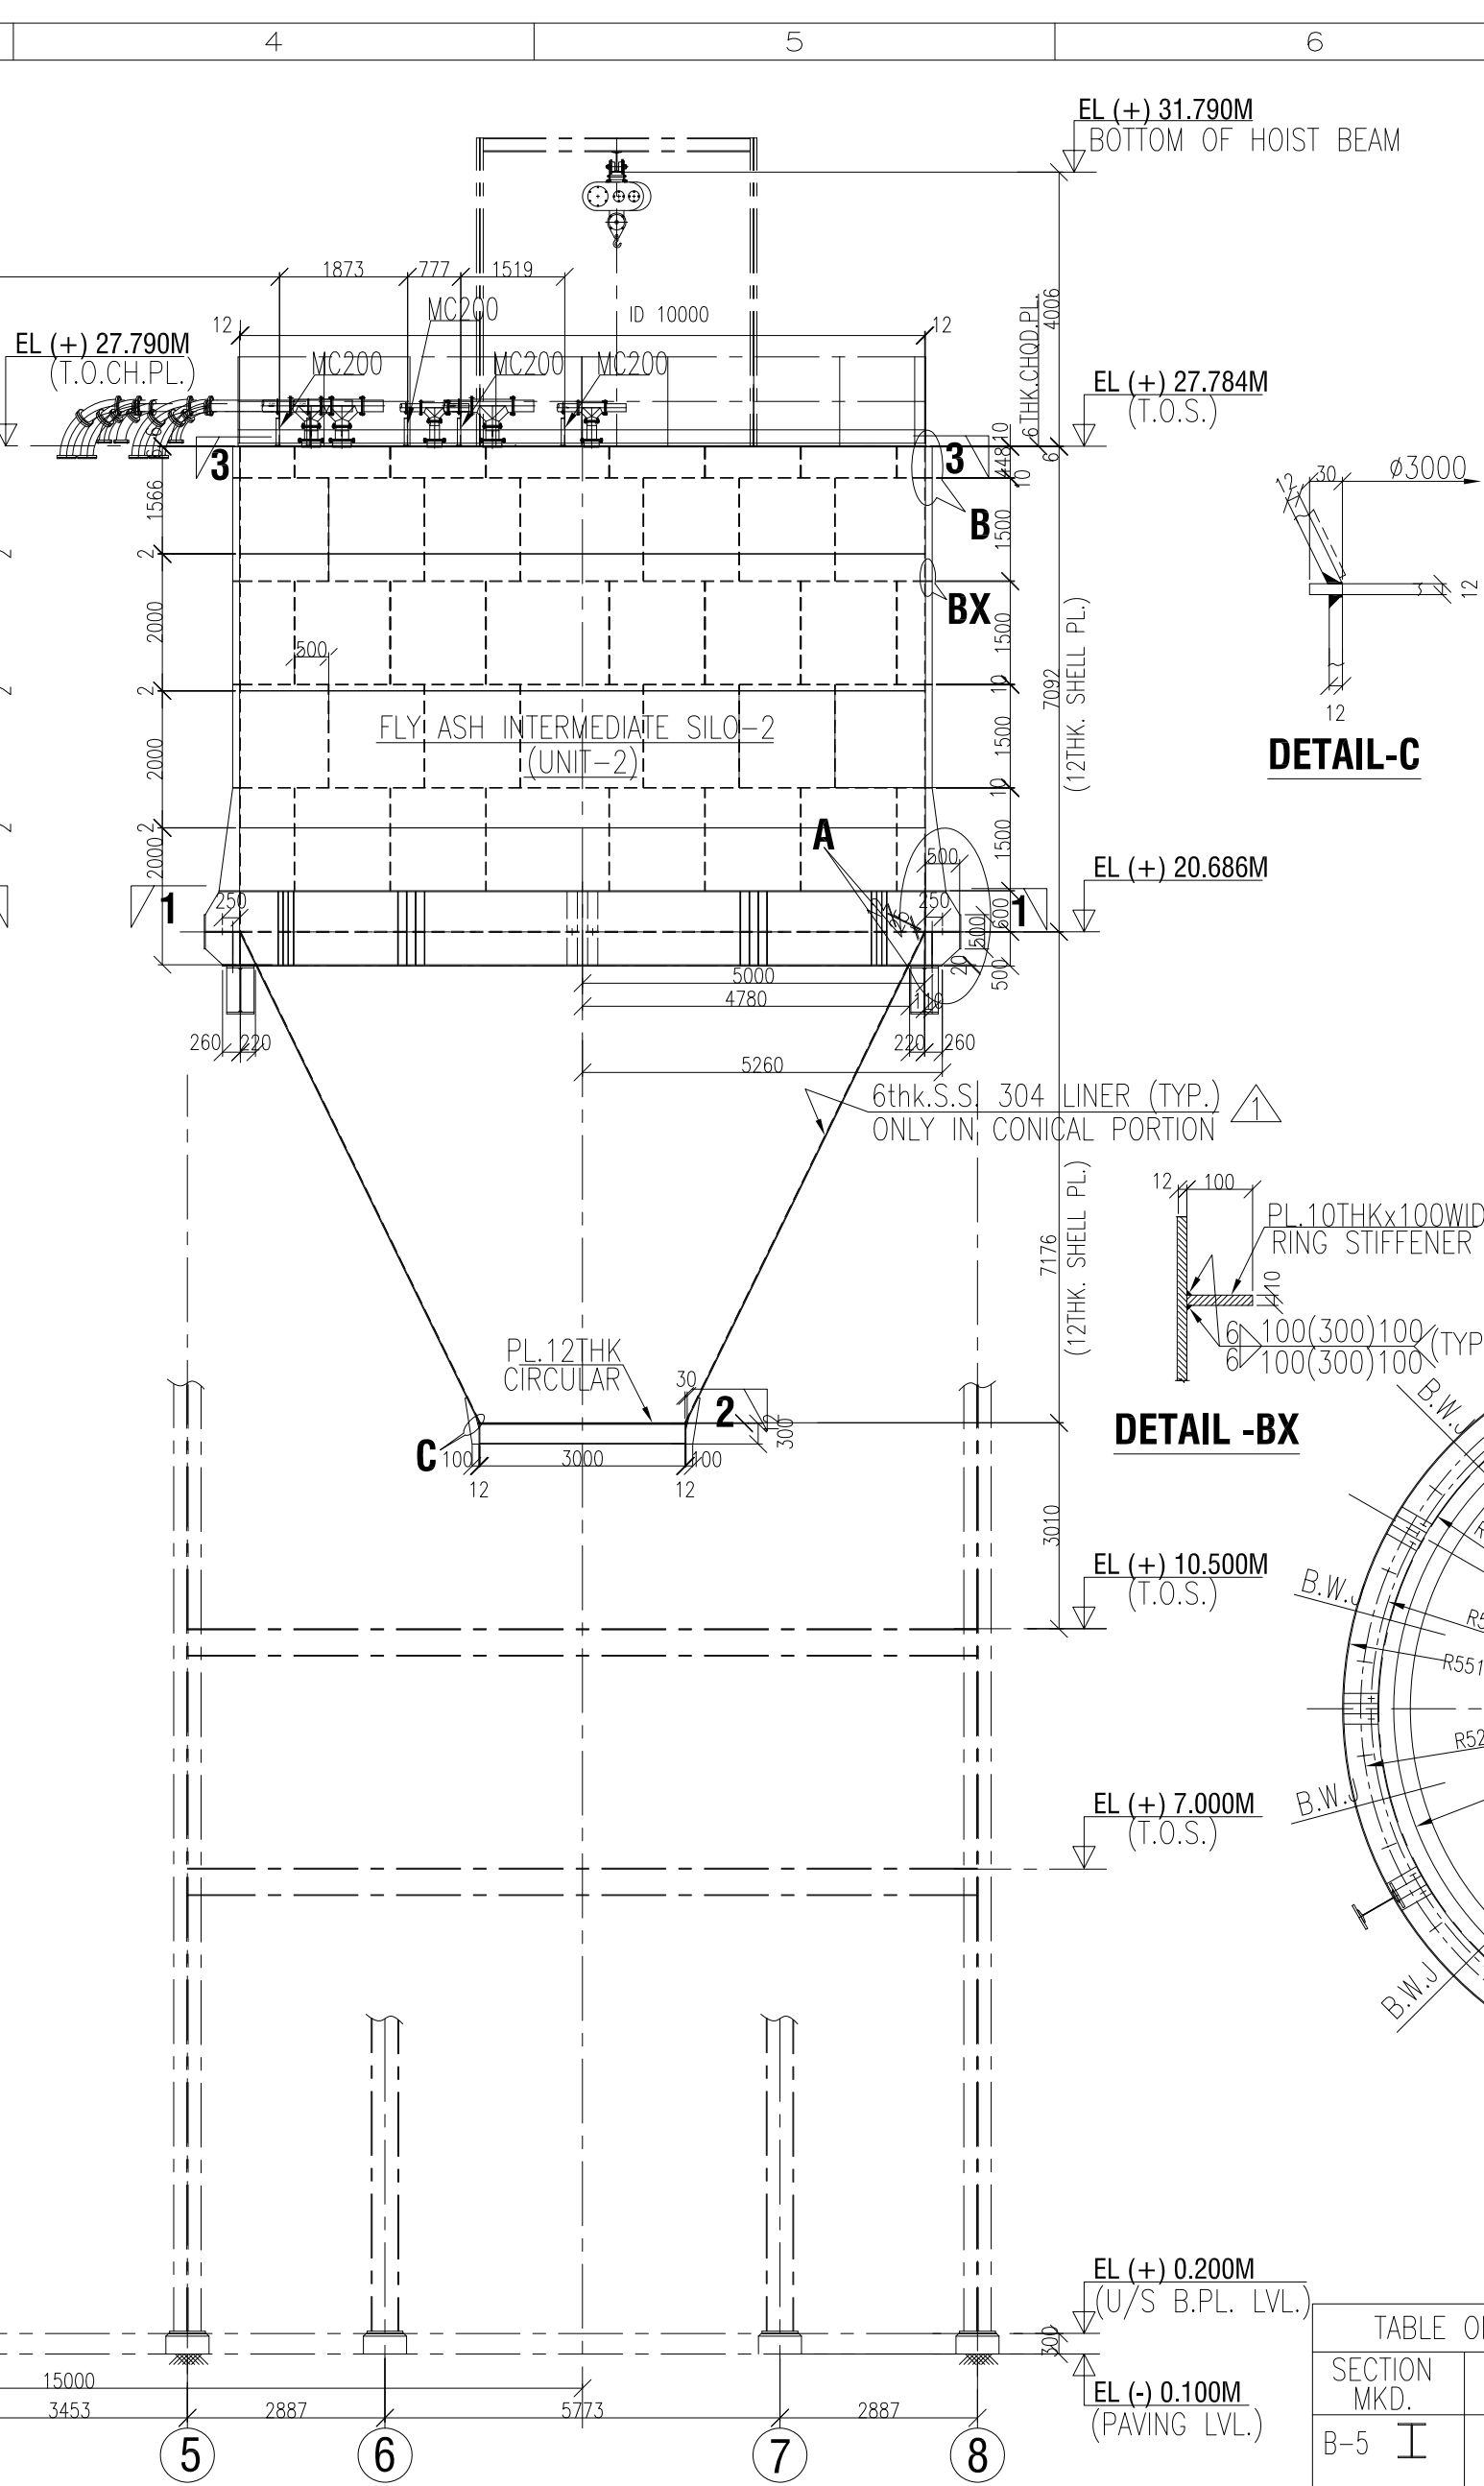
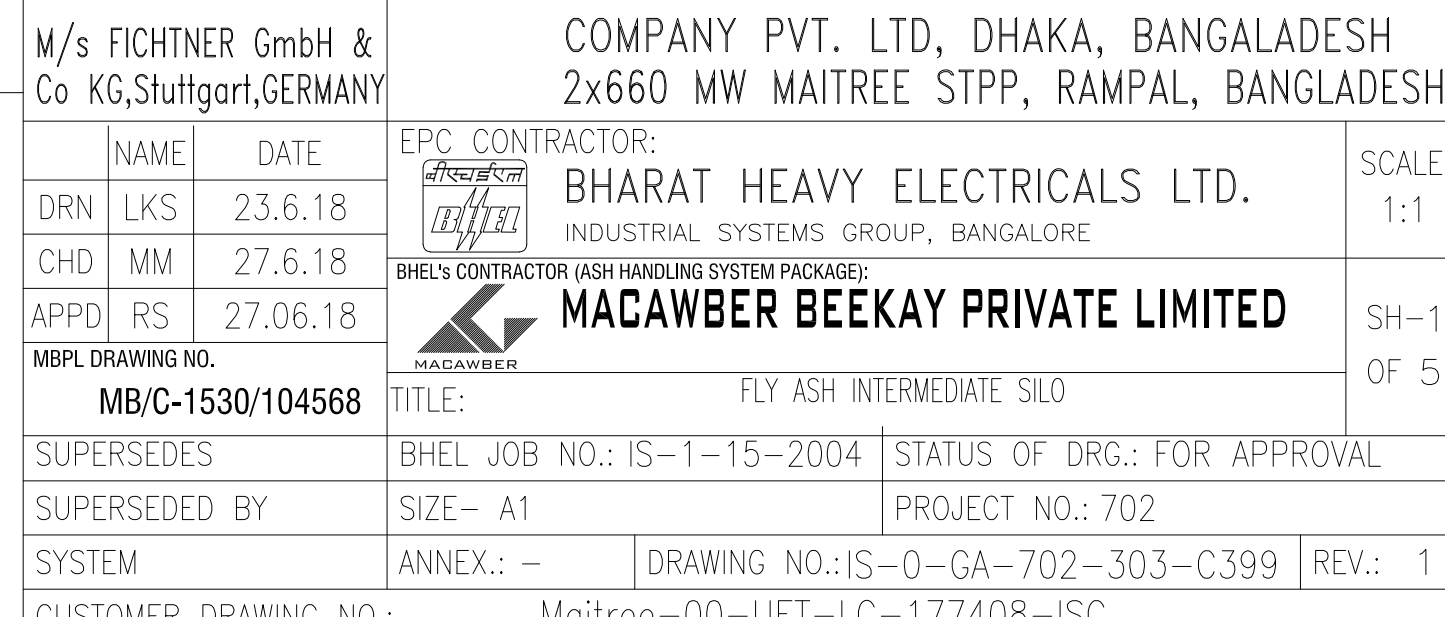


[illegible]

1. ALL DIMENSIONS ARE IN m.m. AND LEVELS ARE IN METER.
2. ALL WELDS ARE MINIMUM 6m.m LEG SIZE CONTINUOUS FILLET (U.O.N)
3. ALL BUTT WELDS SHALL BE FULL PENETRATION.
4. ALL TESTS OF WELD SHALL BE DONE AS PER APPROVED Q.A.P.
5. ALL ROLLED SECTIONS SHALL BE OF GRADE DESIGNATION E250, QUALITY A, SEMI-KILLED/KILLED CONFORMING TO IS 2062. ALL STEEL PLATES SHALL BE OF GRADE DESIGNATION E250, QUALITY BR (FULLY KILLED), CONFORMING TO IS 2062. PLATES BEYOND 12mm THICKNESS AND UP TO 40mm THICKNESS SHALL BE NORMALIZED ROLLED.
6. ALL ERECTION HOLES ARE 18Ø MKD. FOR 16Ø ERECTION BOLTS (U.N.O) 
7. PERMANENT BOLT SHOWN THUS 
8. a) GRATING : BS 4592 PART 1&2, SA/IS:2062 OR EQUIVALENT. 
- b) MS PIPE HANDRAIL : BS EN 10219, BS 5395 OR EQUIVALENT. 
9. ALL INCLINED MEMBERS & SIZE OF GUSSET PLATE ARE TO BE

NOTE: UNCL

10. THE WELDING SEQUENCE/PROCESS SHALL BE SO ADOPTED THAT NO ACCUMULATION OF SECONDARY WELDING STRESSES TAKES PLACE IN THE MEMBERS. 

11. LENGTH OF WELD SHOWN IN DRG. MIN. HOWEVER FULL CONTACT LENGTH SHOULD BE WELDED PROPERLY.

12. ALL CONTACT SURFACES OF GUSSET PLATE HAVING ERECTION BOLTS SHALL BE WELDED AFTER ERECTION AND ALIGNMENT

13. THIS DRAWING IN NOT BE SCALED, ONLY WRITTEN DIMENSION ARE TO BE FOLLOWED.


14. IN CASE OF ANY DOUBT SEEK CLARIFICATION BEFORE EXECUTION.

15. CHEQUERED PLATE/GRATING TO BE SUITABLY NOTCHED AT SITE TO SUIT ANY OBSTRUCTION WHILE LAYING.


16. EL (+)0.000M CORRESPOND TO POWER HOUSE GROUND FLOOR EL. WHICH CORRESPOND RL (+) 5.600M.

17. FOR MECHANICAL G.A. REFER DRG. NO: Maitree-00-ETH-LH-176047--ISG


18. FOR CIVIL LOAD DATA REFER DRG. NO: Maitree-00-UET-LC-177408--ISG

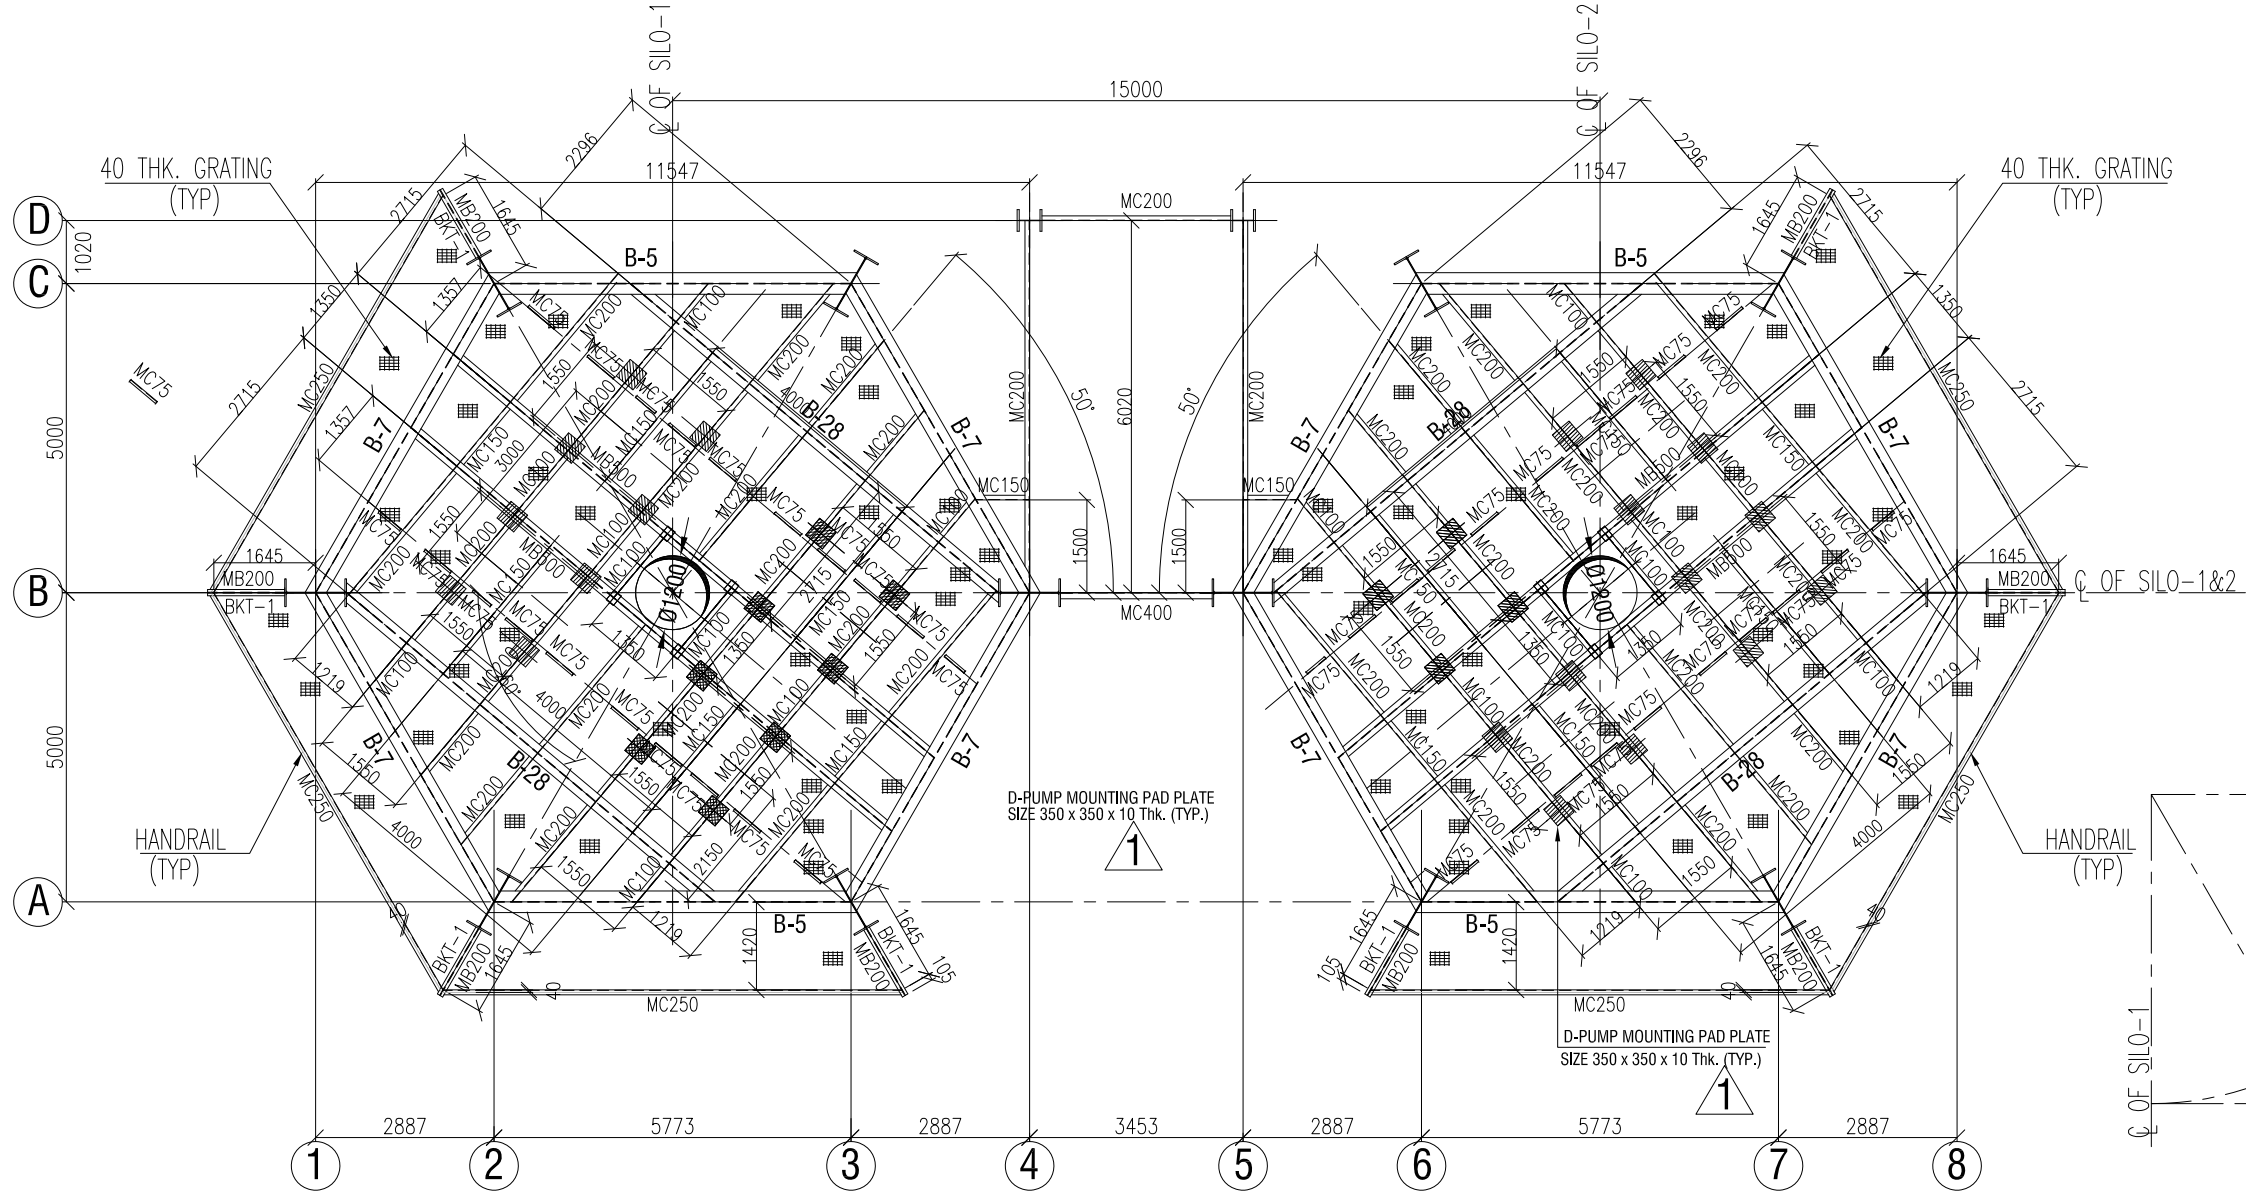


PLAN AT PLATFORM-1 EL (+) 7.000M(TOS)

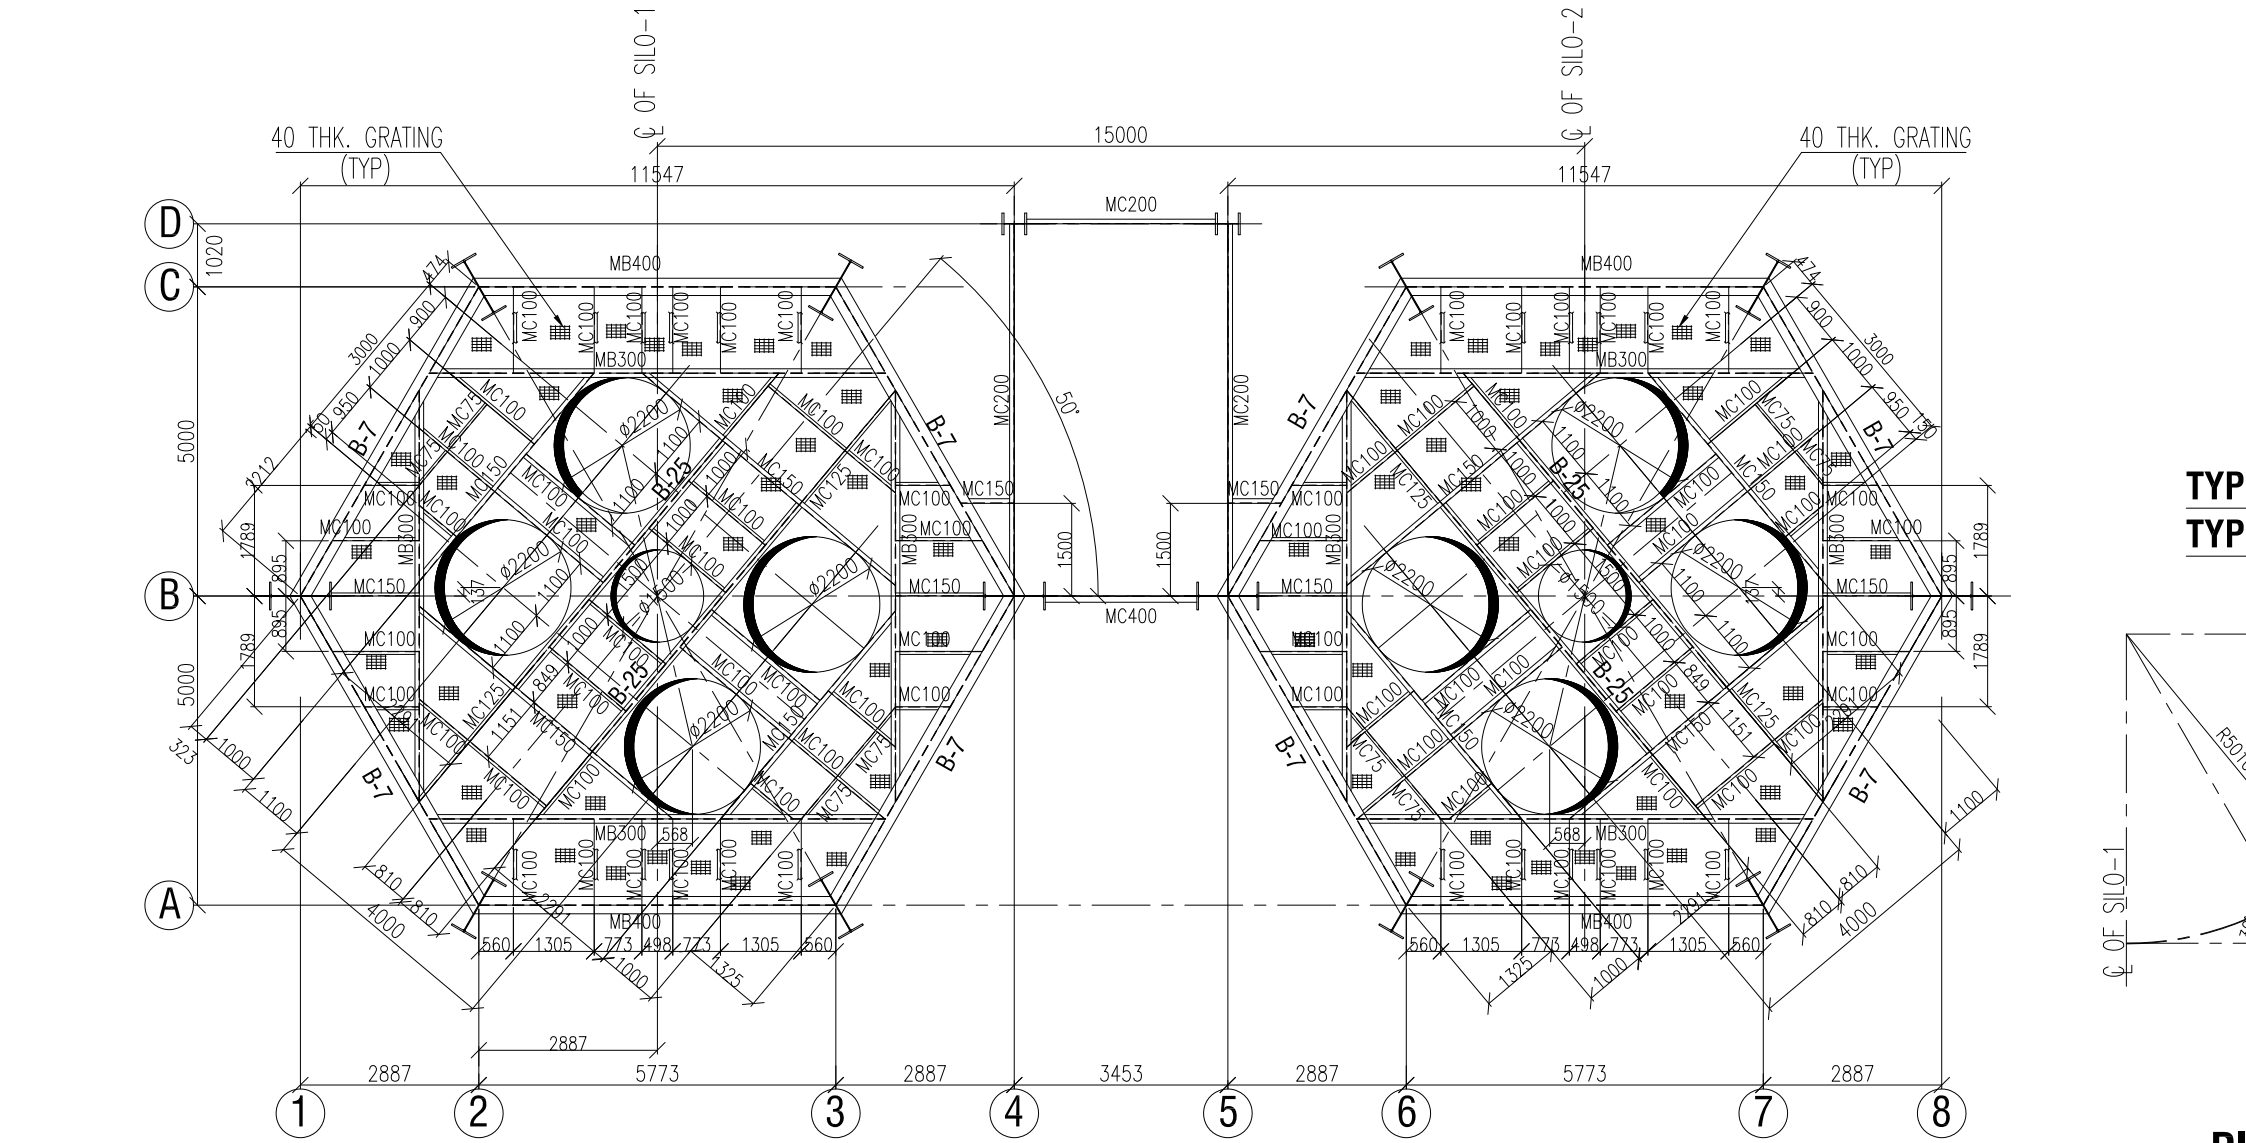


PLAN AT OPERATING PLATFORM-2 EL (+) 10.500M(TOS)

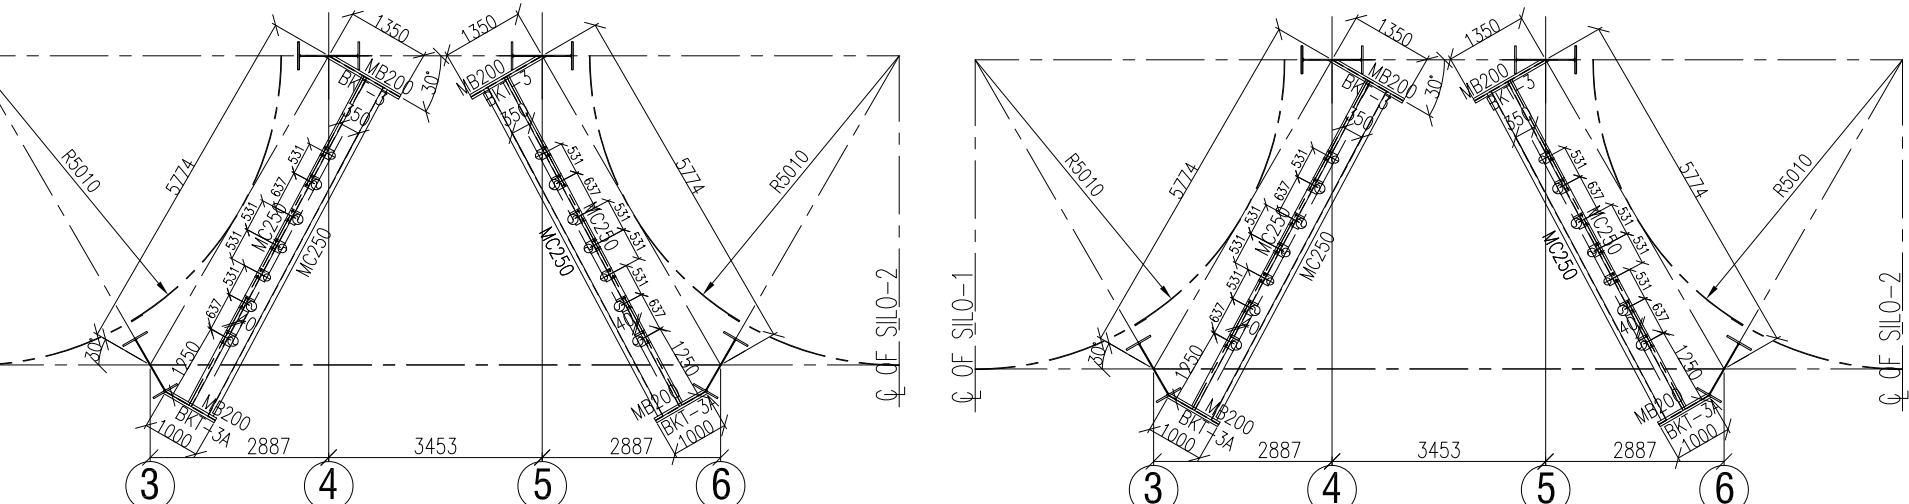


PIPE SUPPORT PLAN AT EL (+) 16.000(TOS)

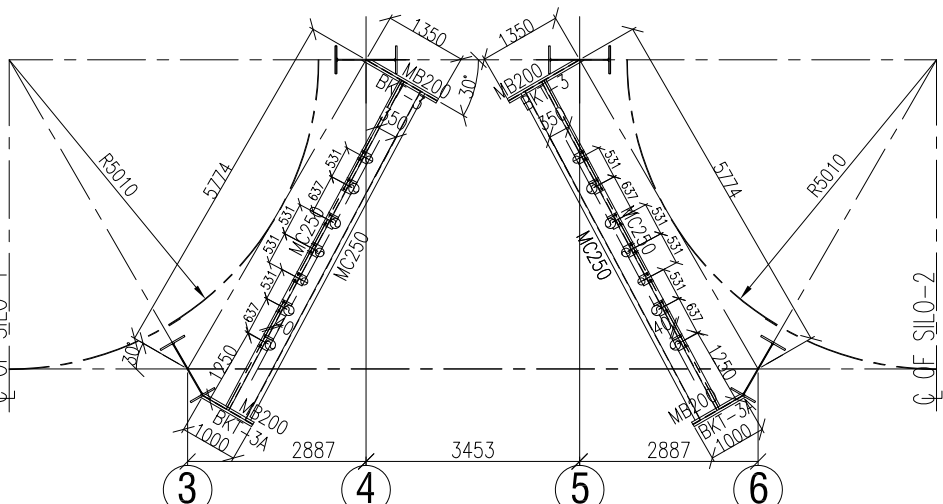


PIPE SUPPORT PLAN AT EL (+) 19.500(TOS)

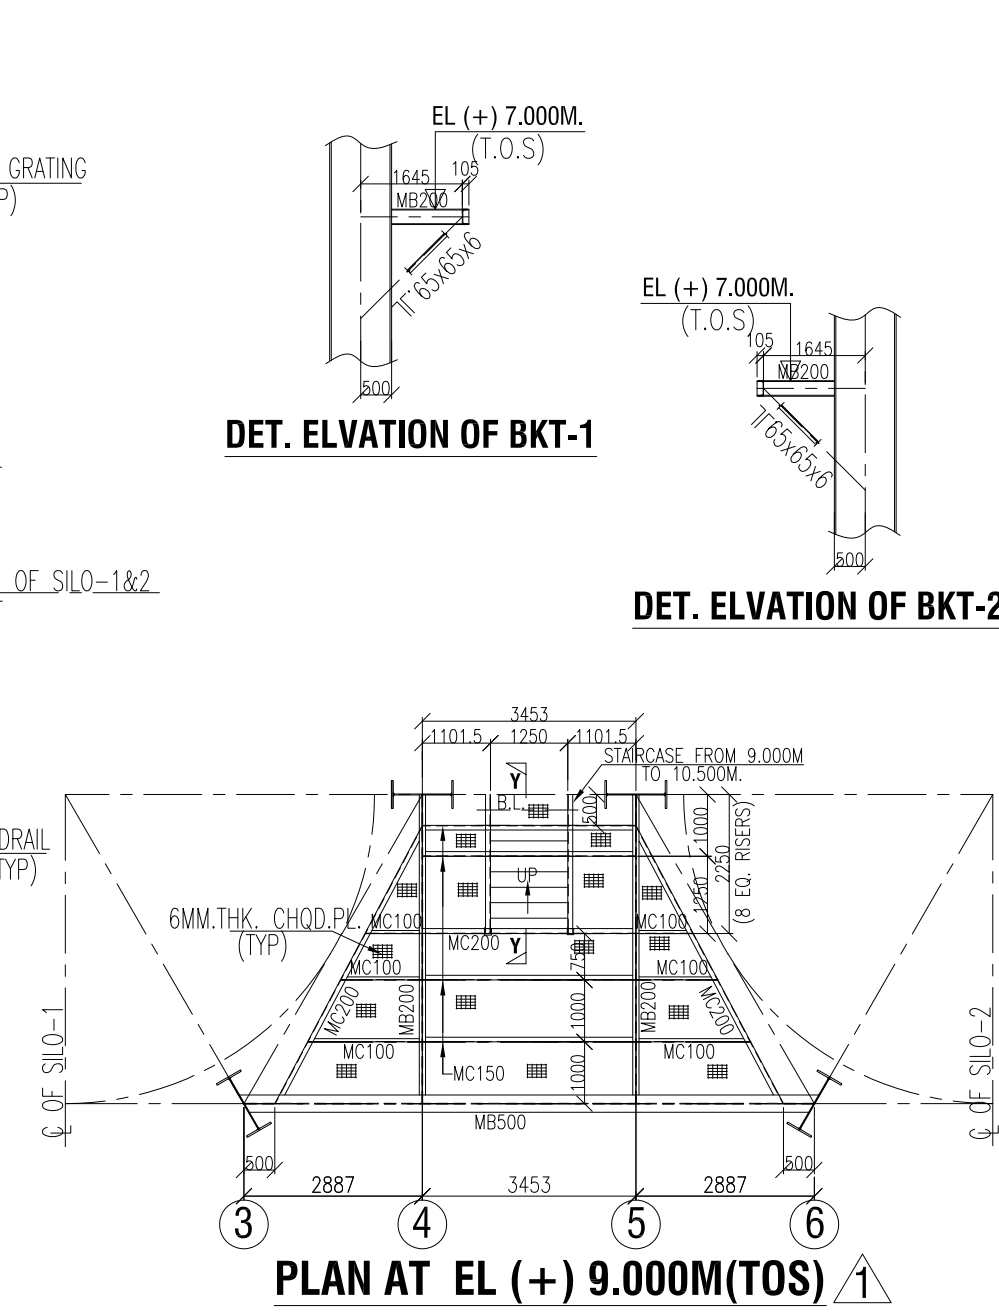


PLAN AT EL (+) 9.000M(TOS)

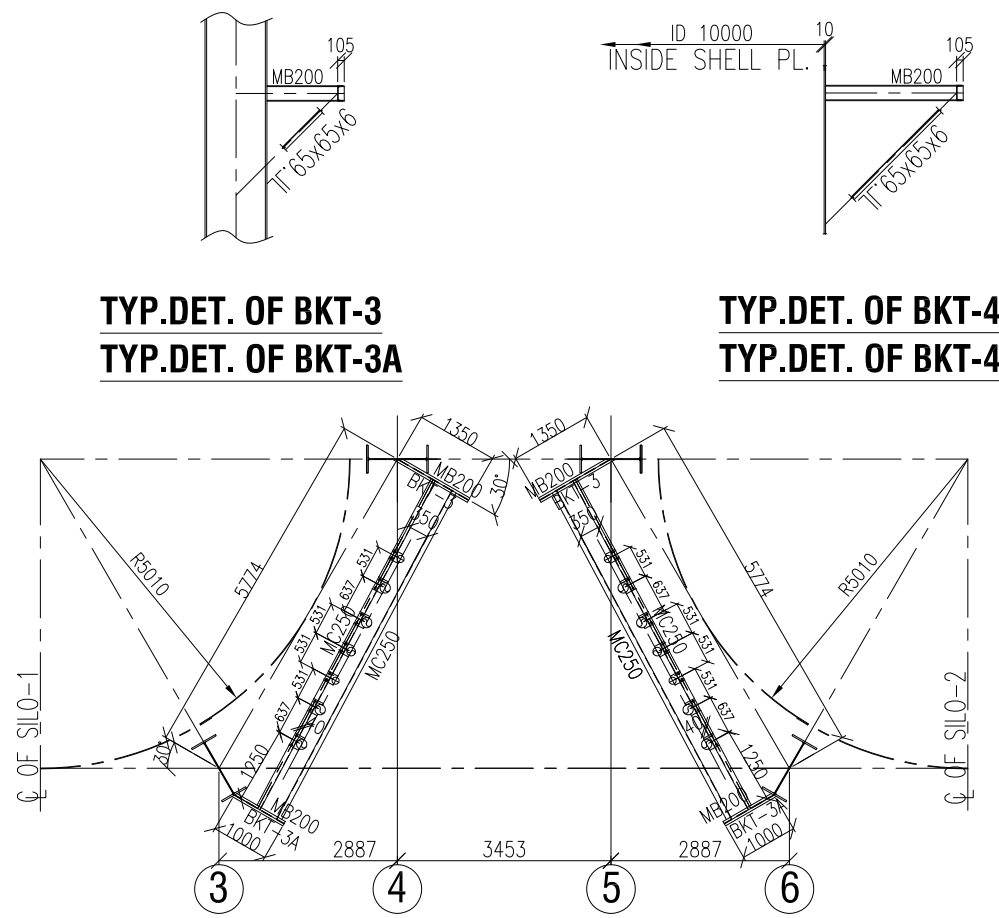


PIPE SUPPORT PLAN AT EL (+) 12.500(TOS)

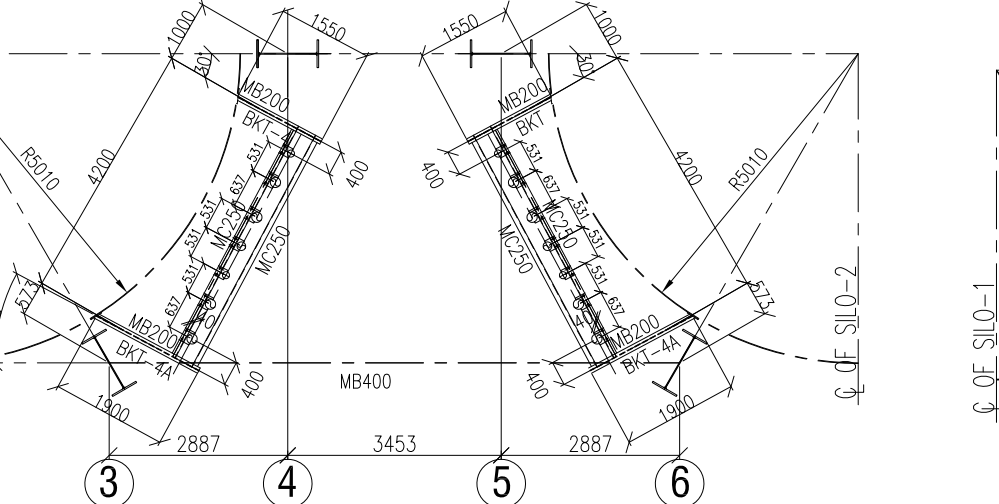


PIPE SUPPORT PLAN AT EL (+) 23.00(TOS)

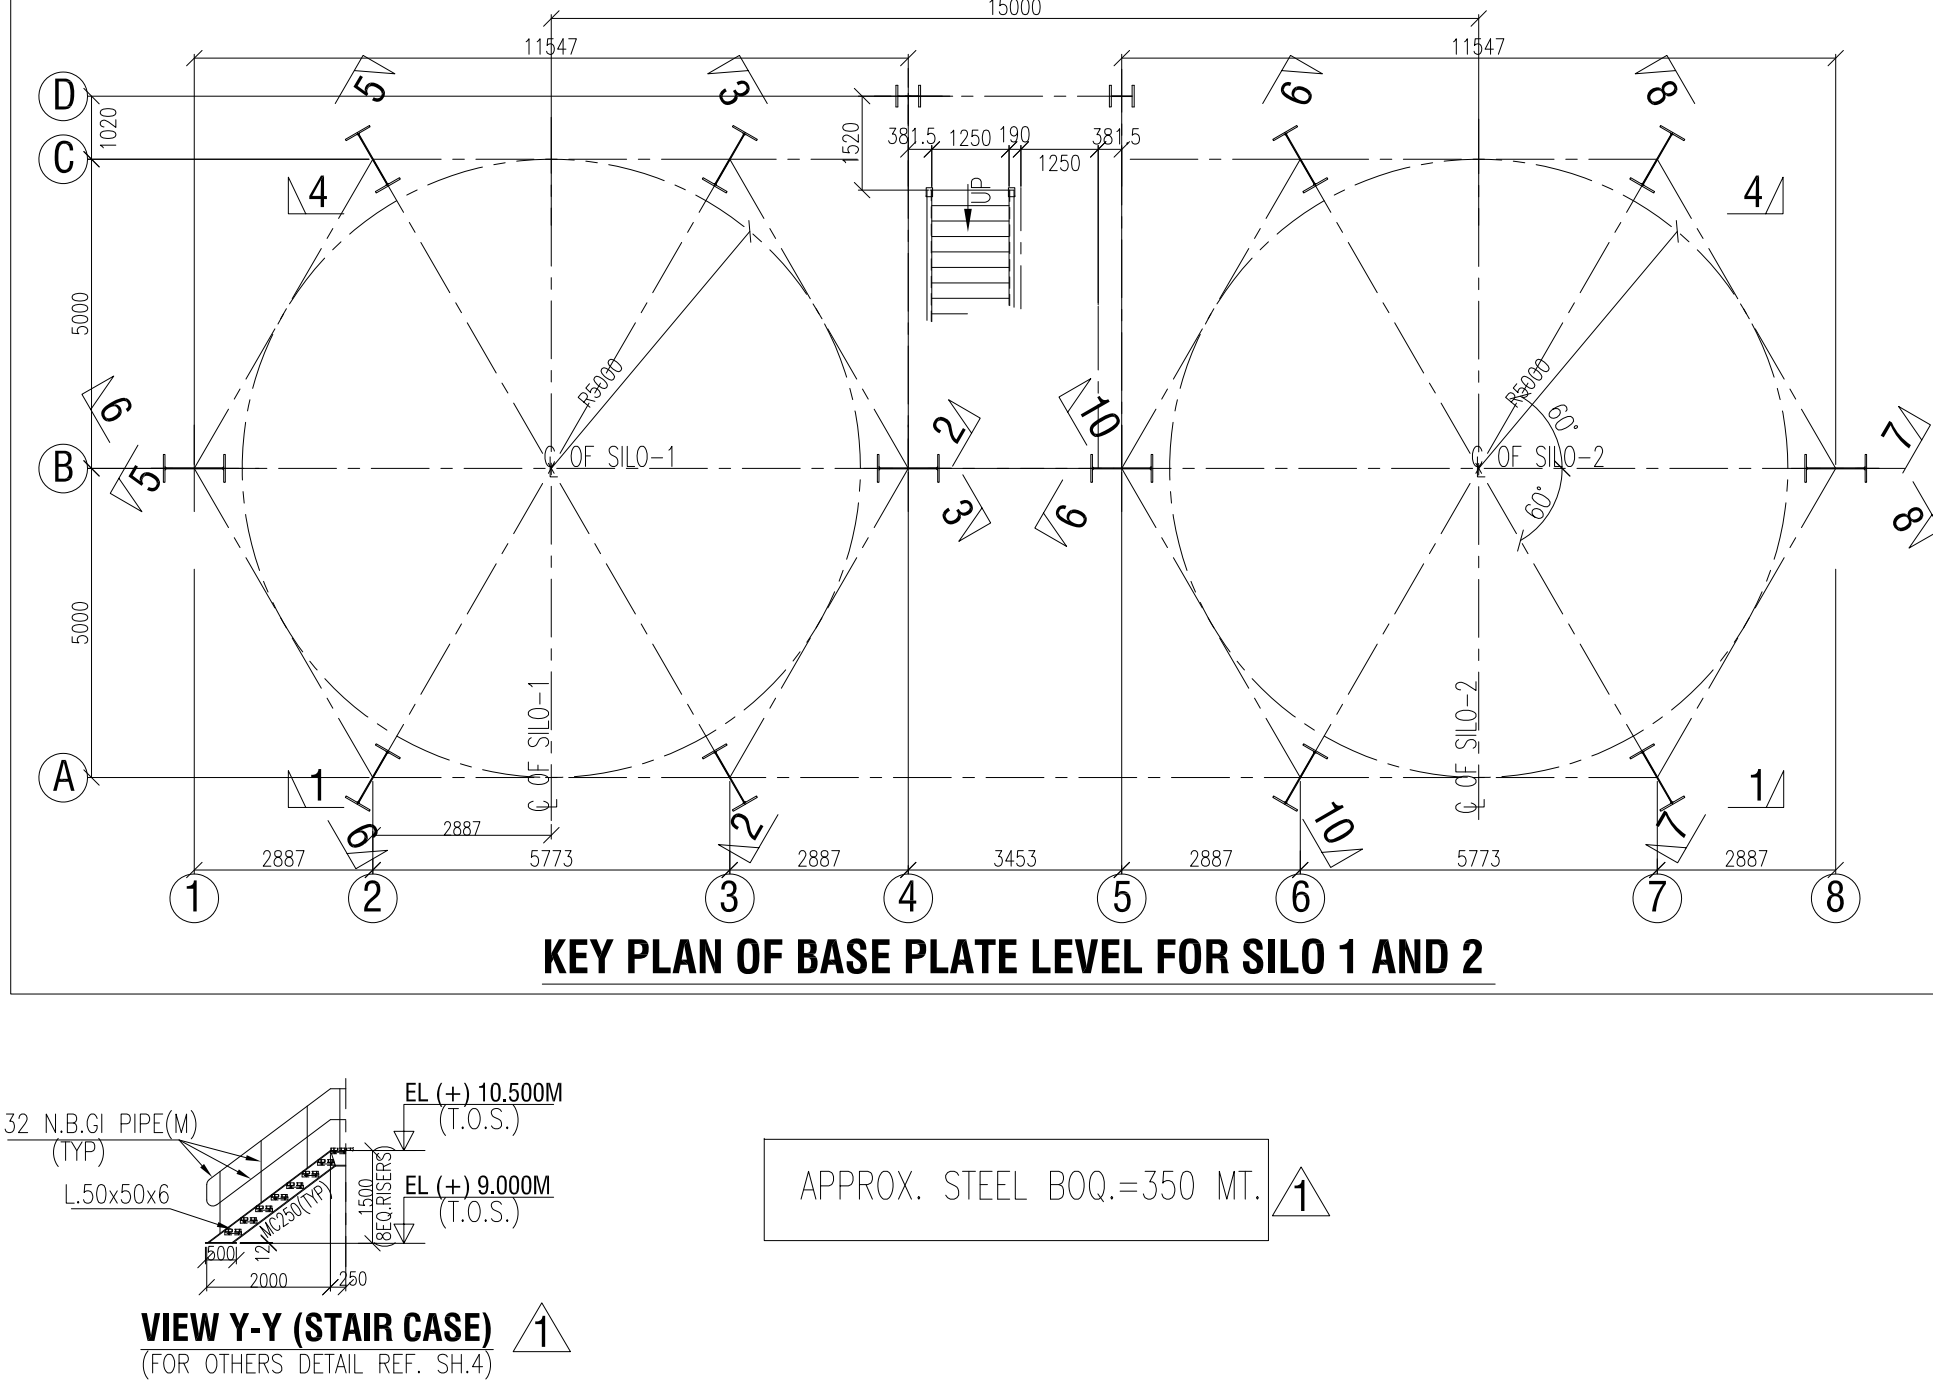


KEY PLAN OF BASE PLATE LEVEL FOR SILO 1 AND 2

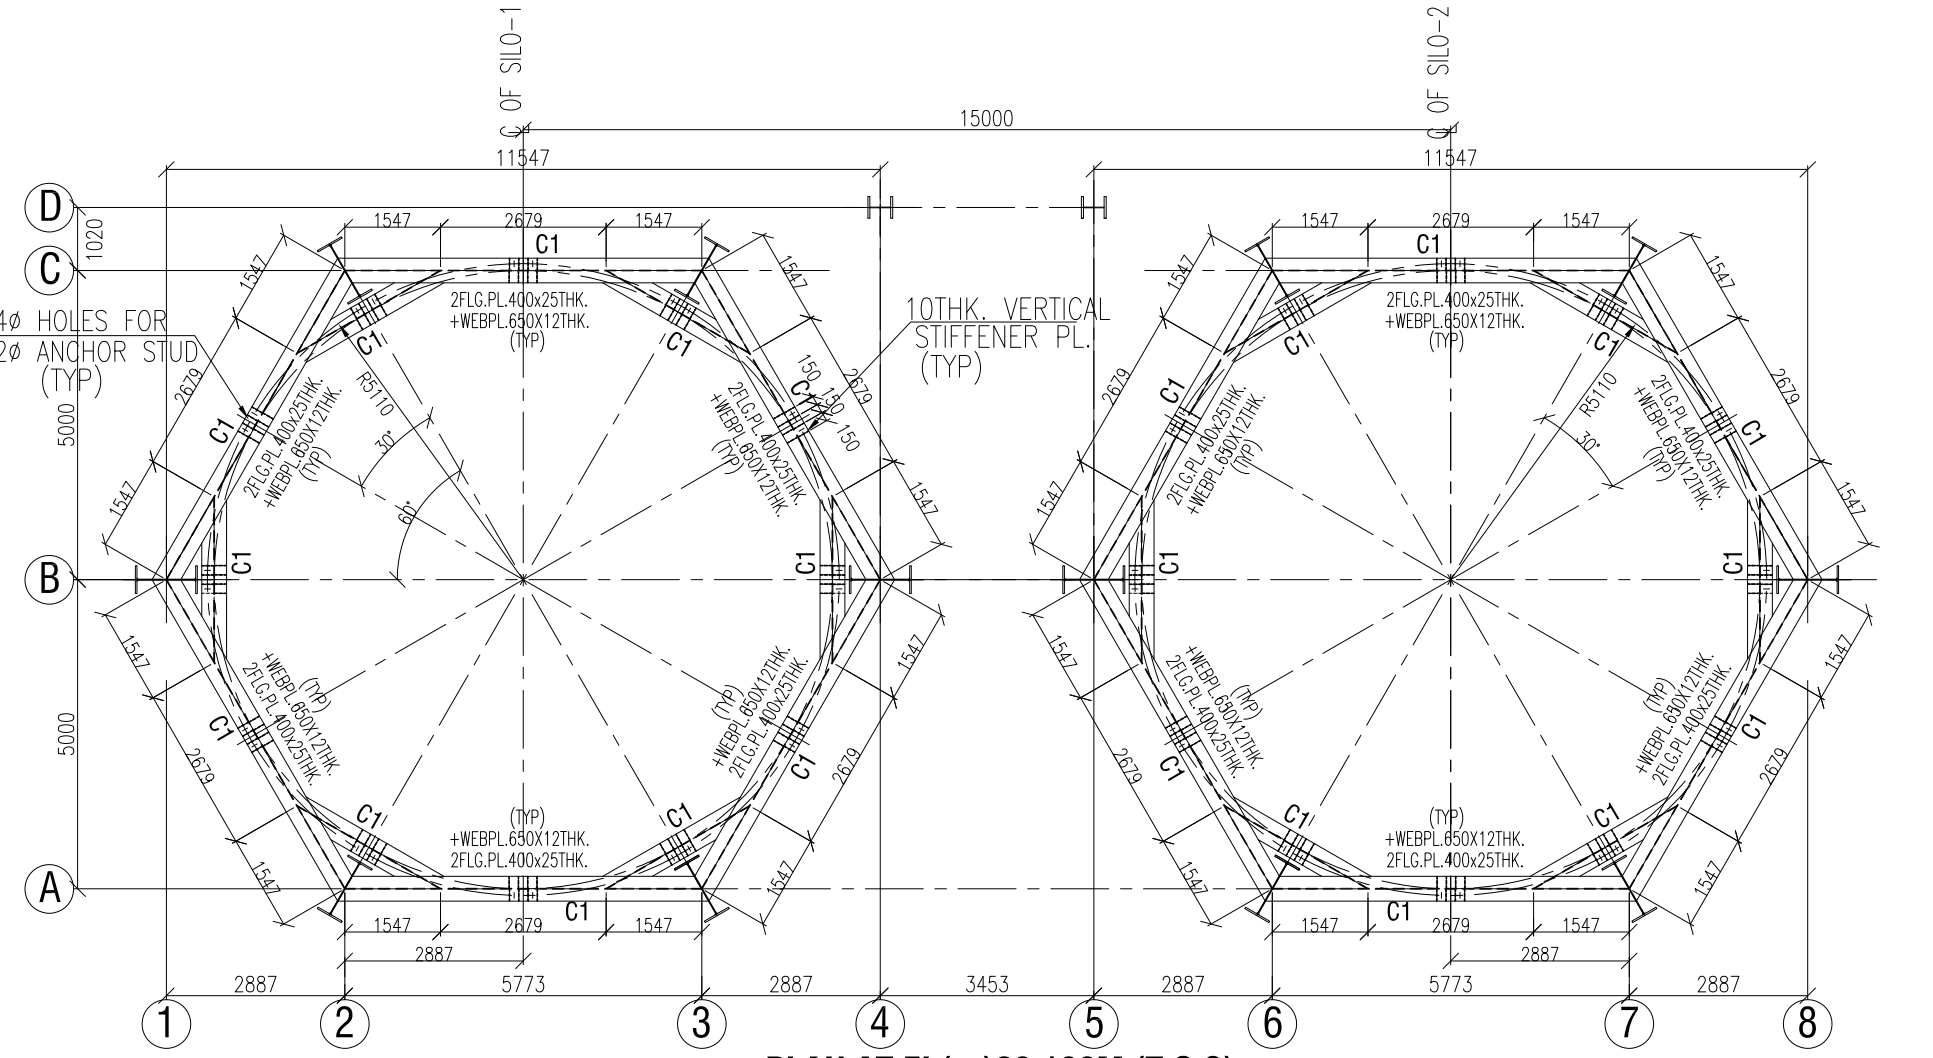


PLAN AT EL (+) 20.186M(T.O.S)

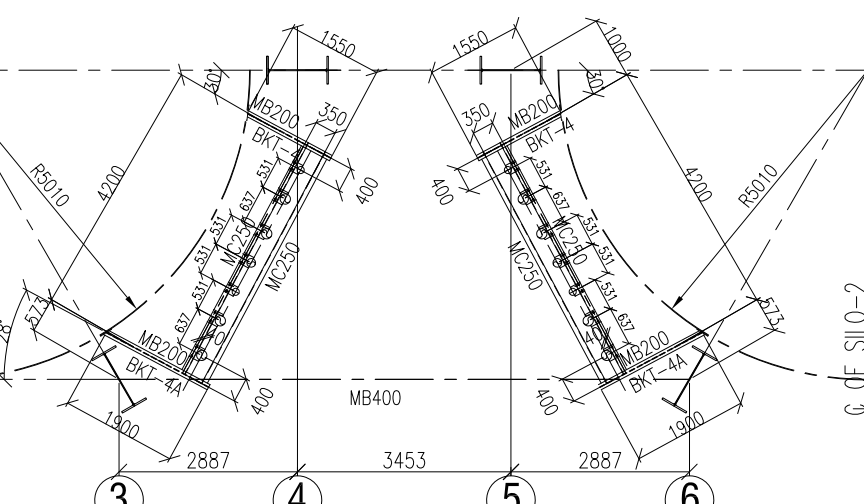

PIPE SUPPORT PLAN AT EL (+) 26.513(TOS)

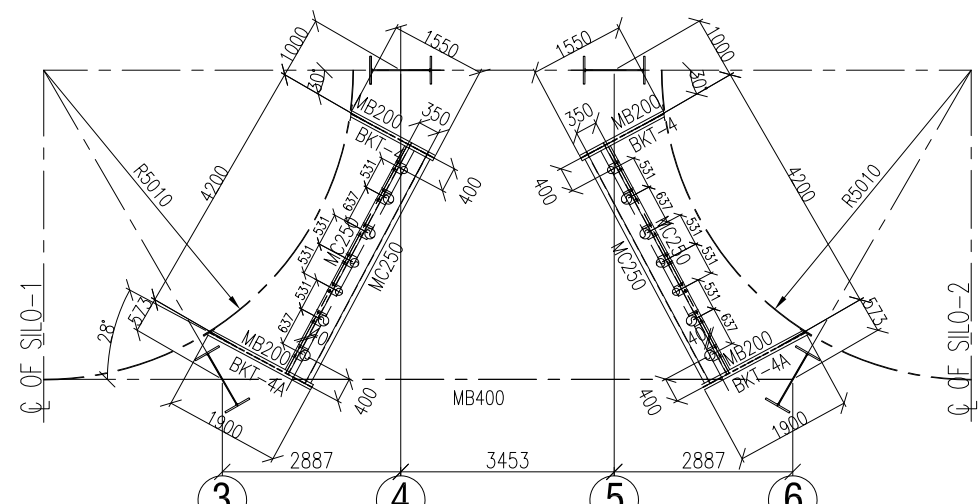

PIPE SUPPORT PLAN AT EL (+) 27.790(TOS)

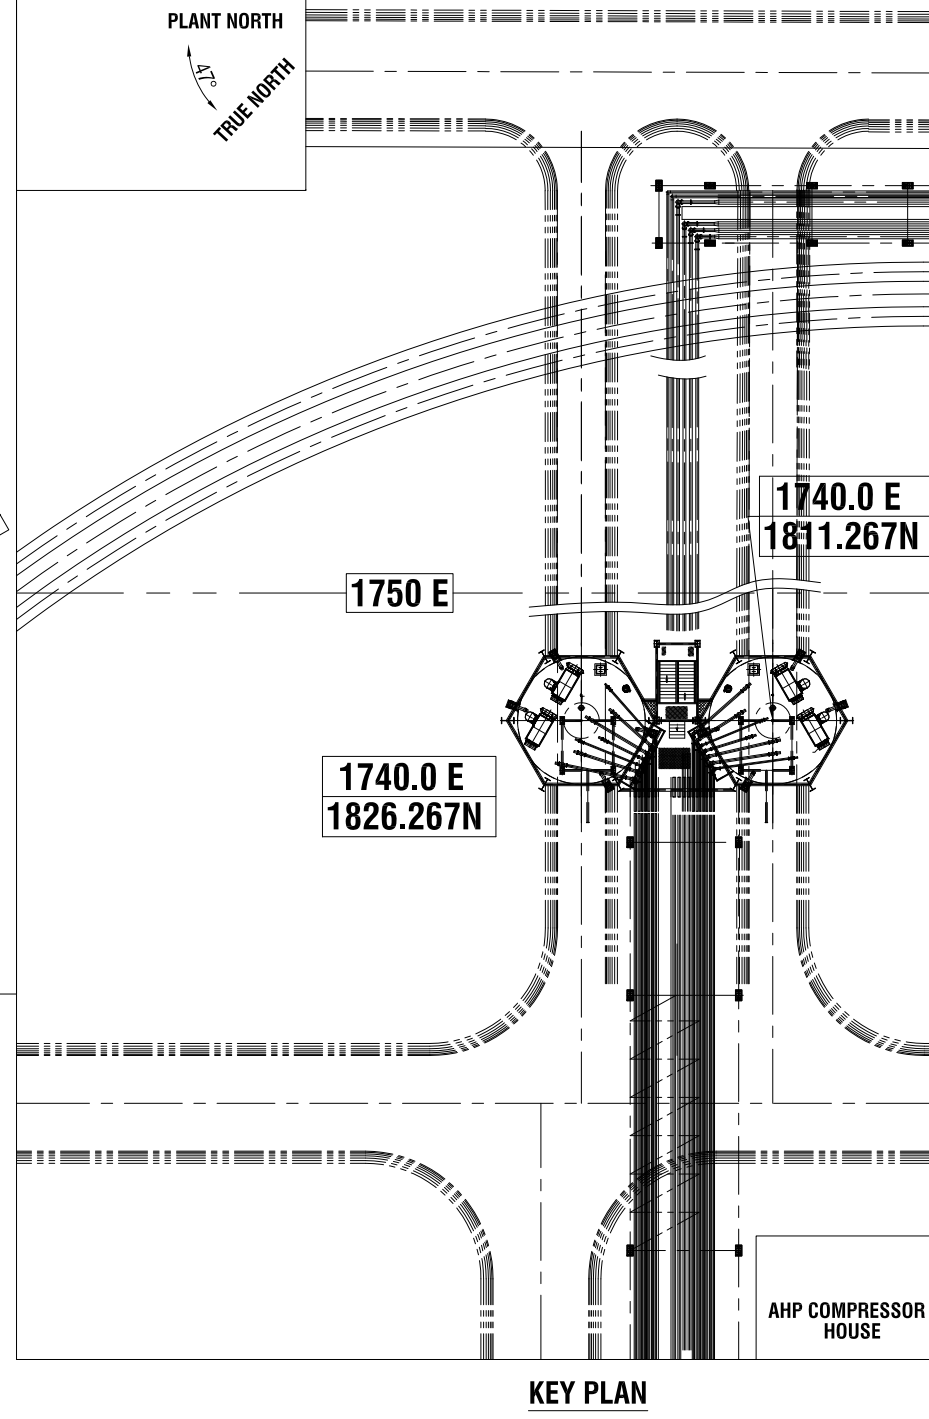

KEY PLAN


TABLE OF MEMBER SECTION	
SECTION MKD.	MEMBER
B-5	FLG.PL.350x16THK. WEB PL.468x10THK.
B-7	FLG.PL.300x16THK. WEB PL.418x8THK.
C-1	FLG.PL.400x25THK. WEB PL.650x12THK.
B-28	FLG.PL.250x25THK. WEB PL.400x10THK.
B-25	FLG.PL.120x10THK. WEB PL.180x8THK.
B-44	FLG.PL.320x16THK. WEB PL.468x8THK.
COL-1	FLG.PL.450x20THK. WEB PL.960x12THK.
COL	FLG.PL.450x25THK. WEB PL.950x16THK.
COL-5	FLG.PL.350x32THK. WEB PL.336x10THK.
COL-6	FLG.PL.375x32THK. WEB PL.336x10THK.
B21	FLG.PL.350x16THK. WEB PL.468x10THK.
B-22	FLG.PL.350x20THK. WEB PL.510x10THK.
B-24	FLG.PL.300x12THK. WEB PL.376x8THK.
B-27	FLG.PL.175x12THK. WEB PL.196x8THK.
B-29	FLG.PL.150x10THK. WEB PL.180x8THK.
B-55	FLG.PL.100x10THK. WEB PL.130x8THK.
B-66	FLG.PL.140x10THK. WEB PL.155x8THK.




NOTES:-

- ALL DIMENSIONS ARE IN m.m. AND LEVELS ARE IN METER.
- ALL WELDS ARE MINIMUM 6m.m LEG SIZE CONTINUOUS FILLET (U.O.N)
- ALL BUTT WELDS SHALL BE FULL PENETRATION.
- ALL TESTS OF WELD SHALL BE DONE AS PER APPROVED Q.A.P.
- ALL ROLLED SECTIONS SHALL BE OF GRADE DESIGNATION E250, QUALITY A, SEMI-KILLED/KILLED CONFORMING TO IS 2062. ALL STEEL PLATES SHALL BE OF GRADE DESIGNATION E250, QUALITY BR (FULLY KILLED), CONFORMING TO IS 2062. PLATES BEYOND 12mm THICKNESS AND UP TO 40mm THICKNESS SHALL BE NORMALIZED ROLLED.
- ALL ERECTION HOLES ARE 18ø MKD. FOR 16ø ERECTION BOLTS (U.N.O)
- PERMANENT BOLT SHOWN THUS
- a) GRATING : BS 4592 PART 1&2, SA/IS:2062 OR EQUIVALENT.
- b) MS PIPE HANDRAIL : BS EN 10219,BS 5395 OR EQUIVALENT.
- ALL INCLINED MEMBERS & SIZE OF GUSSET PLATE ARE TO BE CHECKED AND VERIFIED FROM ACTUAL FULL SCALE LAYOUT.

- THE WELDING SEQUENCE/PROCESS SHALL BE SO ADOPTED THAT NO ACCUMULATION OF SECONDARY WELDING STRESSES TAKES PLACE IN THE MEMBERS.
- LENGTH OF WELD SHOWN IN DRG. MIN. HOWEVER FULL CONTACT LENGTH SHOULD BE WELDED PROPERLY.
- ALL CONTACT SURFACES OF GUSSET PLATE HAVING ERECTION BOLTS SHALL BE WELDED AFTER ERECTION AND ALIGNMENT
- THIS DRAWING IN NOT BE SCALED, ONLY WRITTEN DIMENSION ARE TO BE FOLLOWED.
- IN CASE OF ANY DOUBT SEEK CLARIFICATION BEFORE EXECUTION.
- CHEQUERED PLATE/GRATING TO BE SUITABLY NOTCHED AT SITE TO SUIT ANY OBSTRUCTION WHILE LAYING.
- EL (±)0.000M CORRESPOND TO POWER HOUSE GROUND FLOOR EL. WHICH CORRESPOND RL (+) 5.600M.
- FOR MECHANICAL G.A. REFER DRG. NO: Maitree-00-ETH-LH-176047-1SG
- FOR CIVIL LOAD DATA REFER DRG. NO: Maitree-00-UET-LC-177408-1SG


1	10.12.18	LKS	MM	RS	REVISED AS PER CLIENTS COMMENTS AS MKD.
REV	DATE	DRN	CHD	APPD	DESCRIPTION/NOTE
CUSTOMER CONSULTANT: CUSTOMER/PROJECT:					
BANGLADESH-INDIA FRIENDSHIP POWER COMPANY PVT. LTD, DHAKA, BANGALADESH					
2x660 MW MAITREE STPP, RAMPAL, BANGLADESH					
M/s FICHTNER GmbH & Co KG,Stuttgart,GERMANY		EPC CONTRACTOR:		SCALE 1:1	
NAME		DATE		BHARAT HEAVY ELECTRICALS LTD.	
DRN		LKS		23.6.18	
CHD		MM		27.6.18	
APPD		RS		27.06.18	
MBPL DRAWING NO.		TITLE:		FLY ASH INTERMEDIATE SILO	
MB/C-1530/104568		SUPERSEDES		BH&E JOB NO.: IS-1-15-2004	
STATUS OF DRG.: FOR APPROVAL		SIZE- A1		PROJECT NO.: 702	
SYSTEM		ANNEX:-		DRAWING NO.: IS-0-GA-702-303-C399	
CUSTOMER DRAWING NO.:		Maitree-00-UET-LC-177408-1SG		REV.: 1	

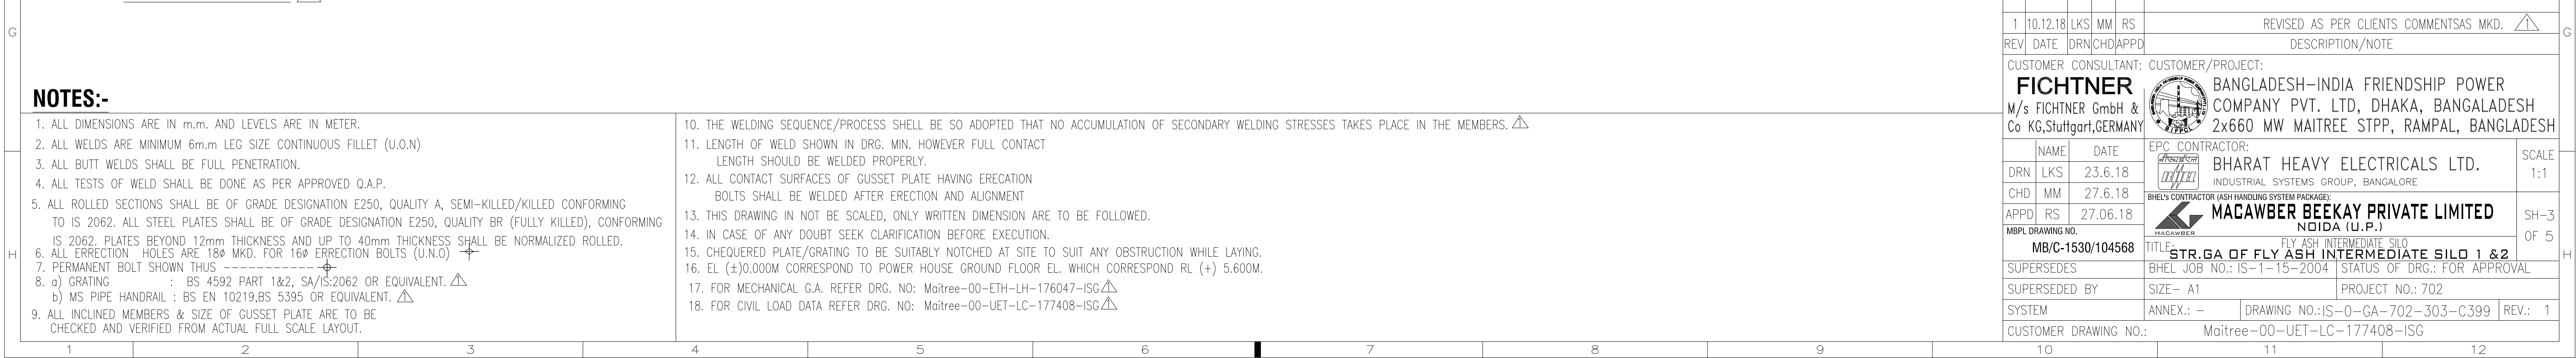

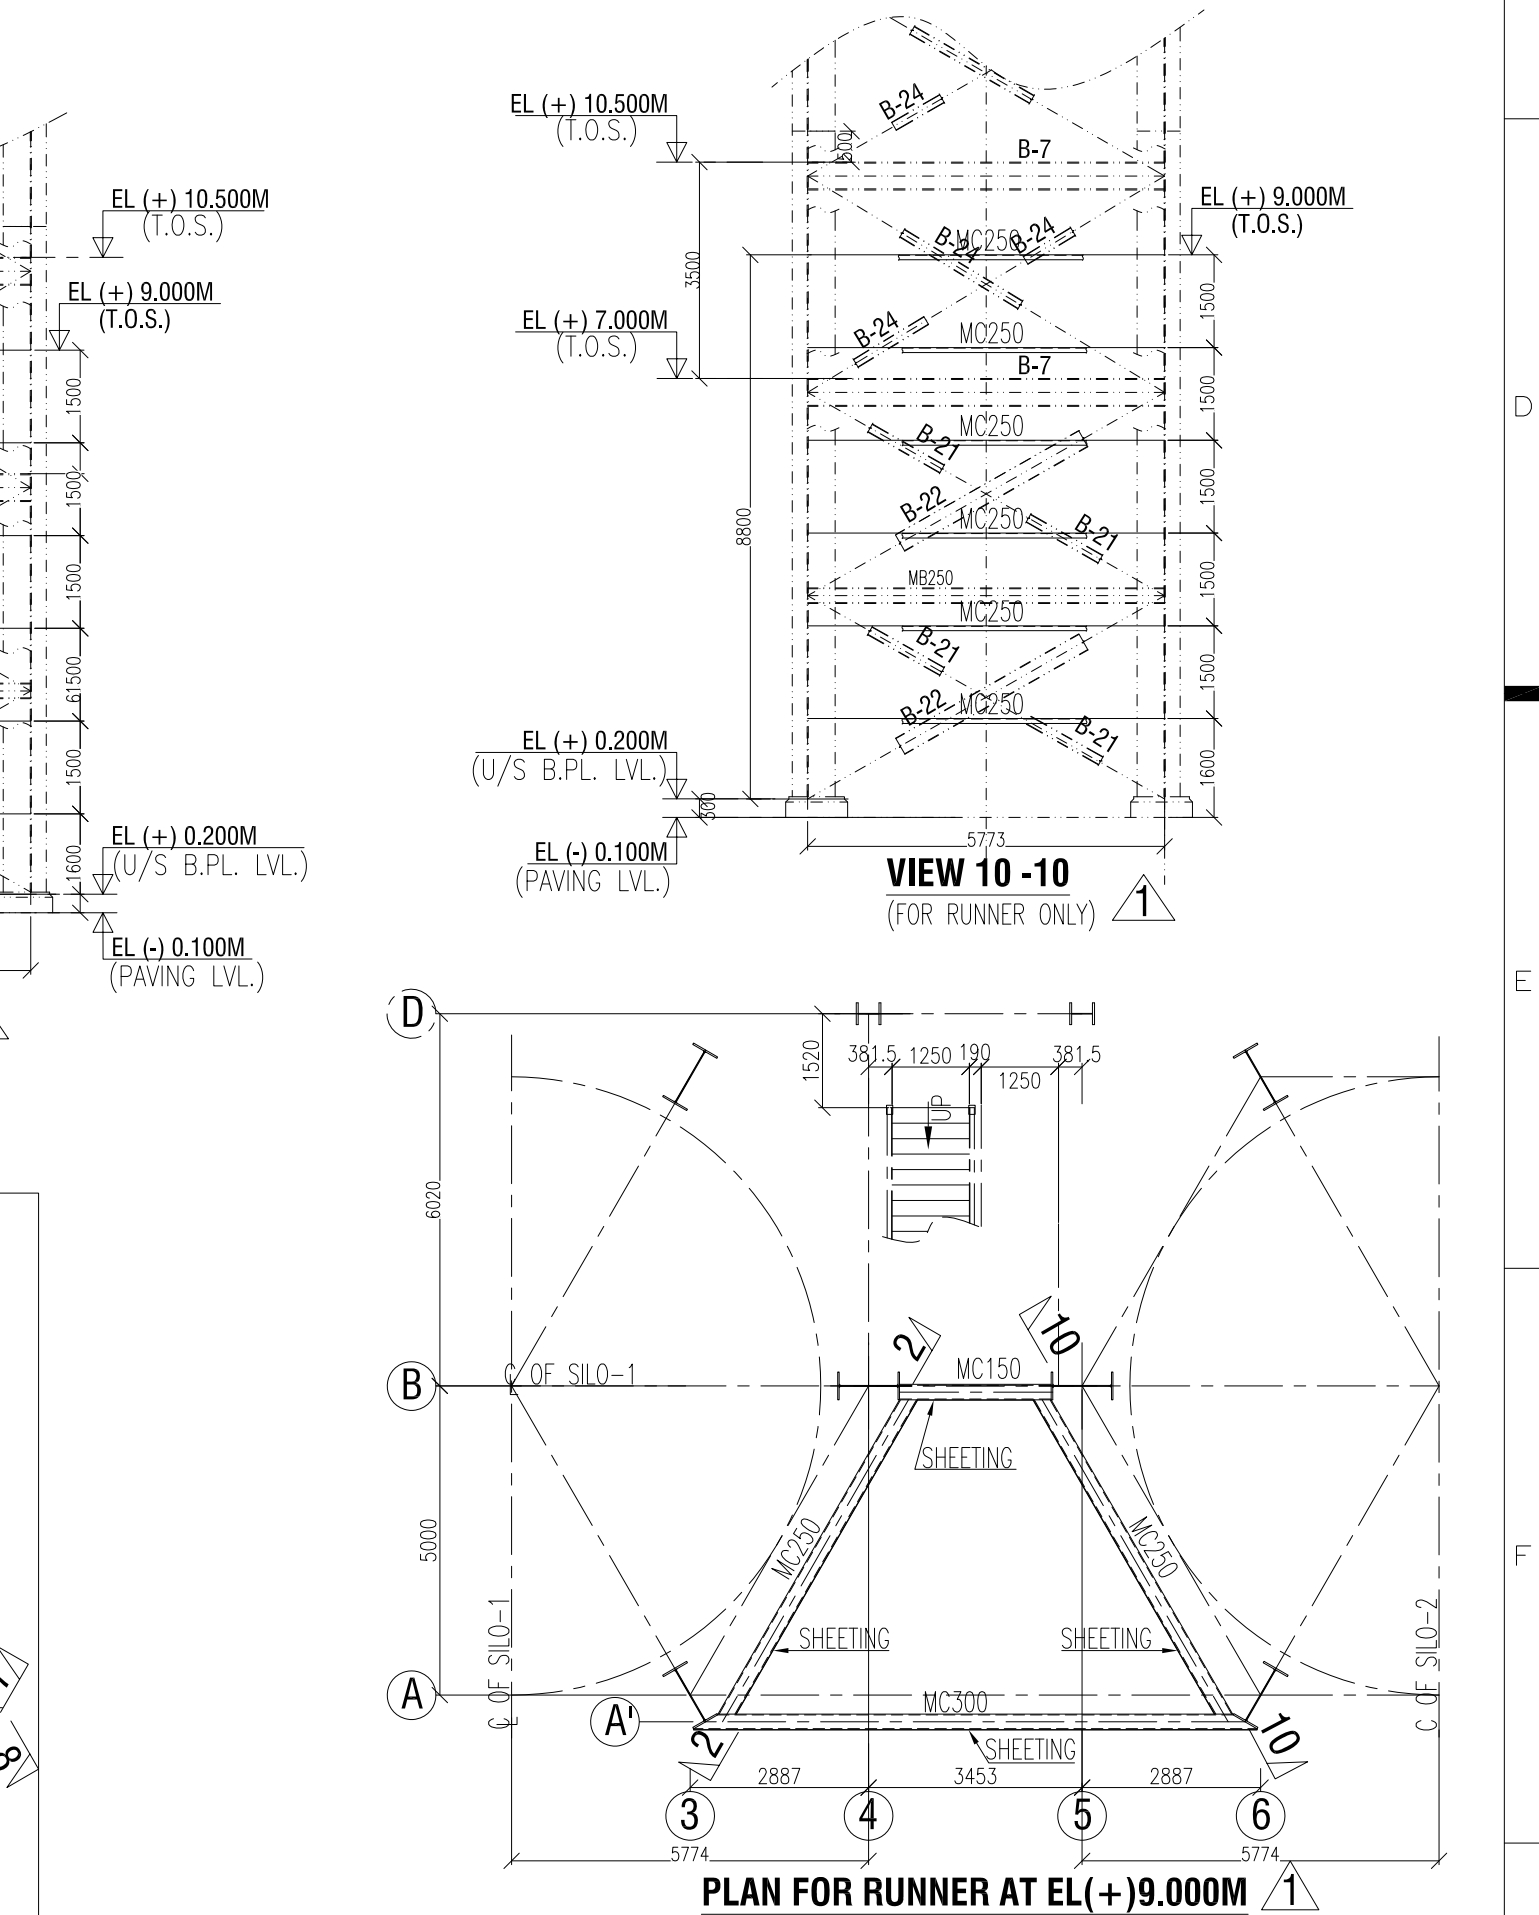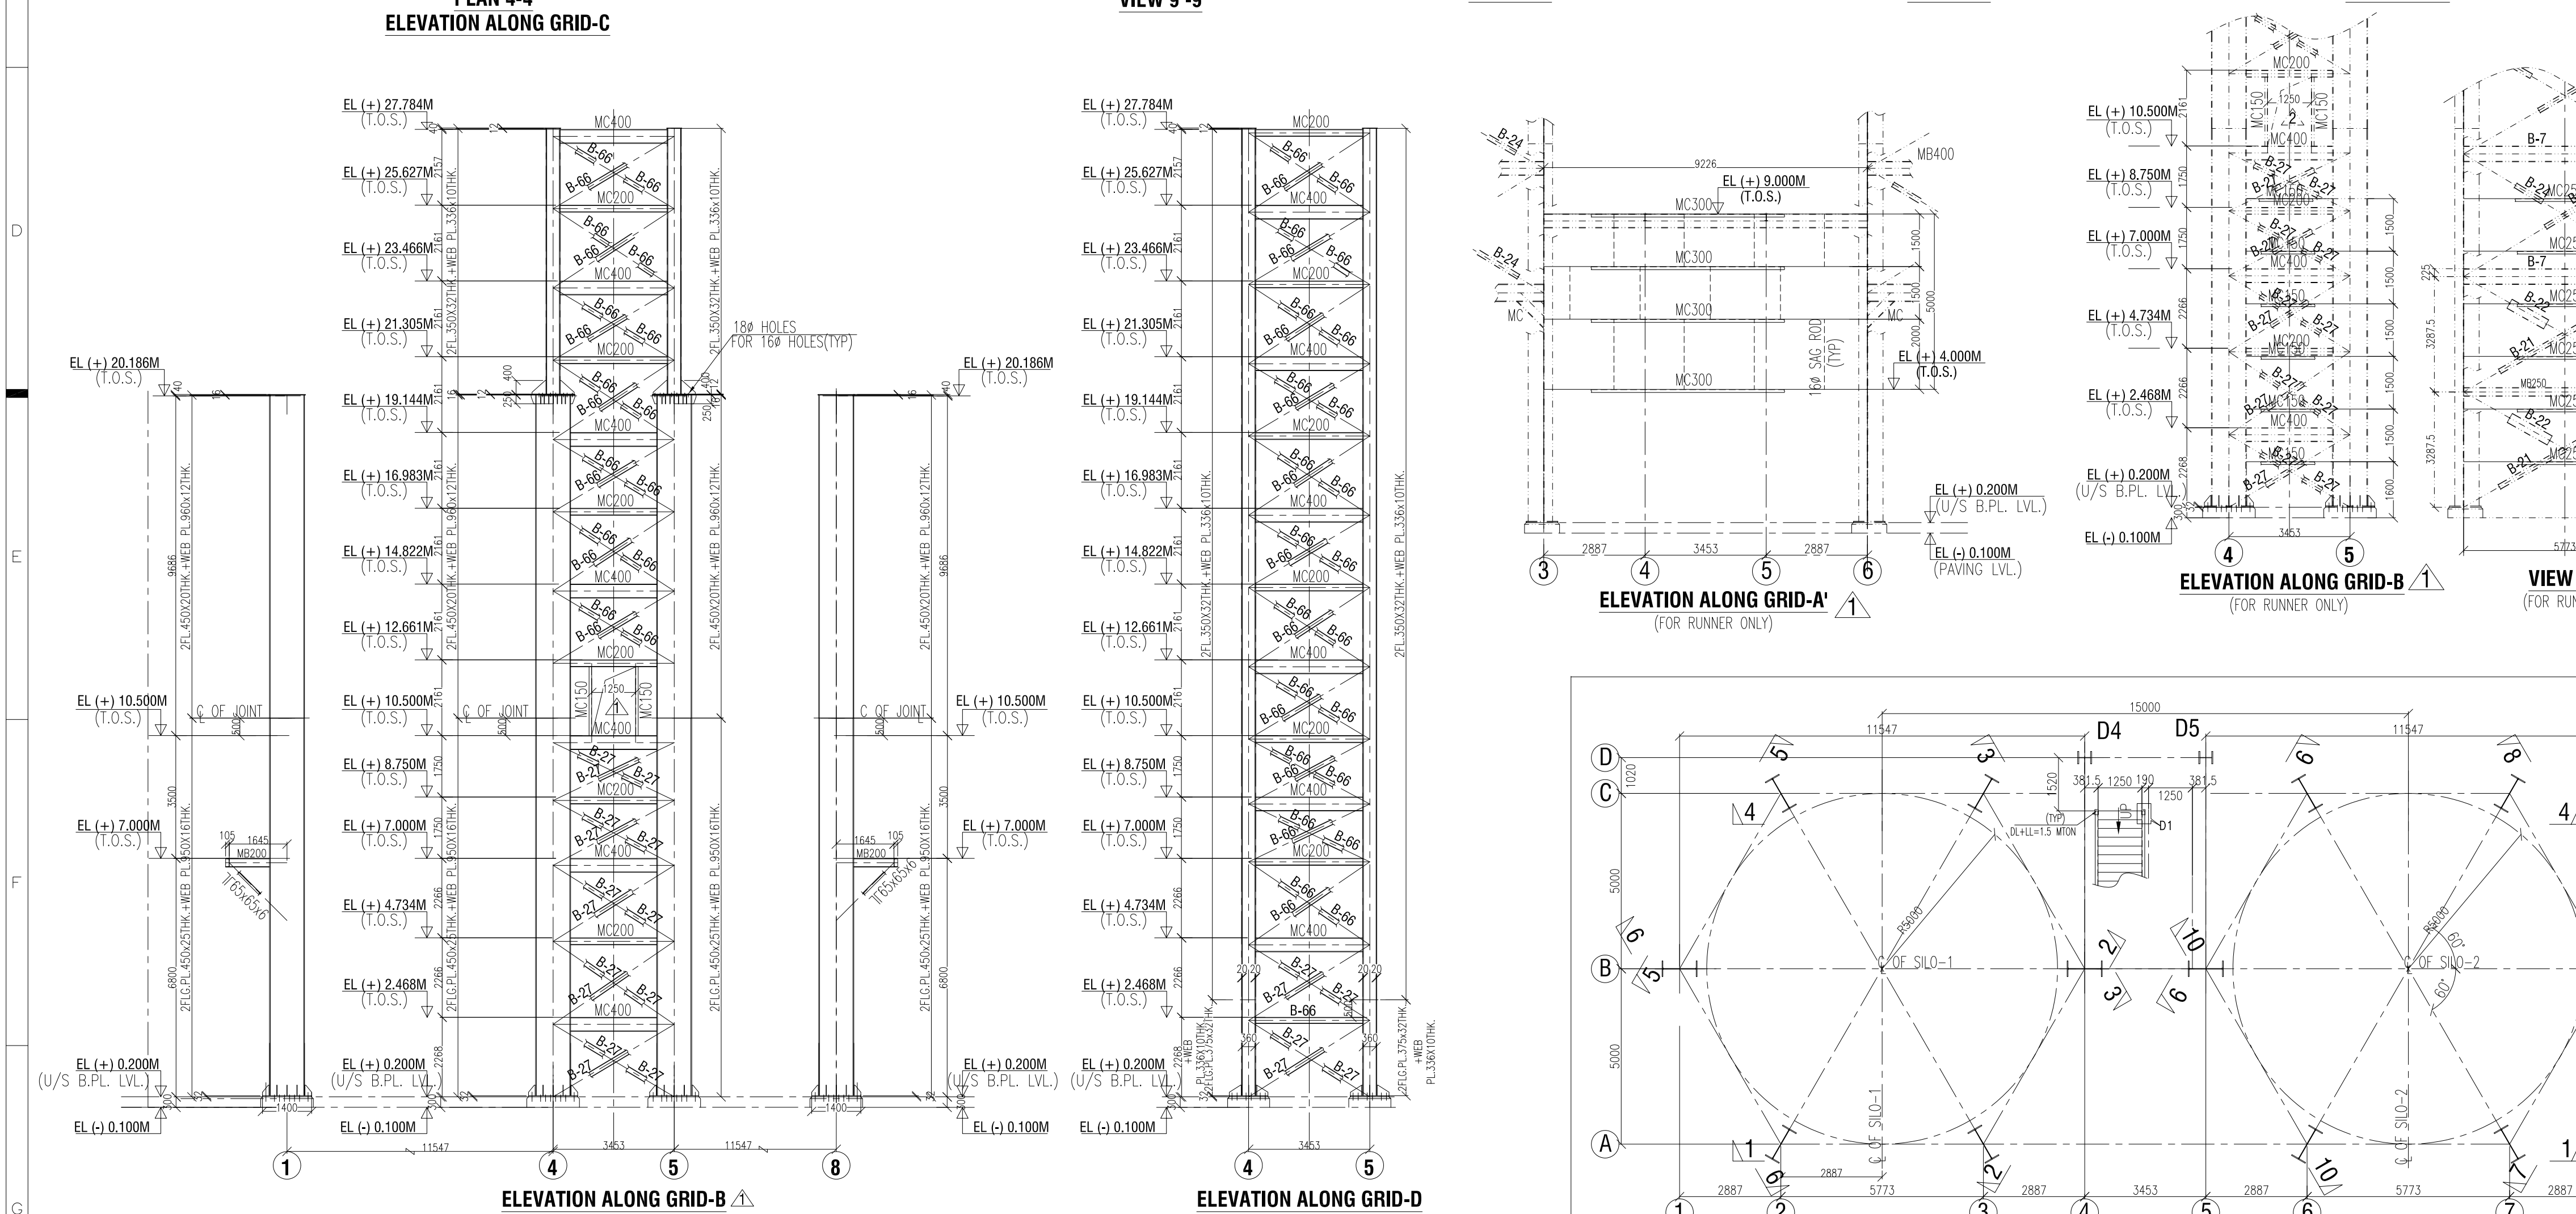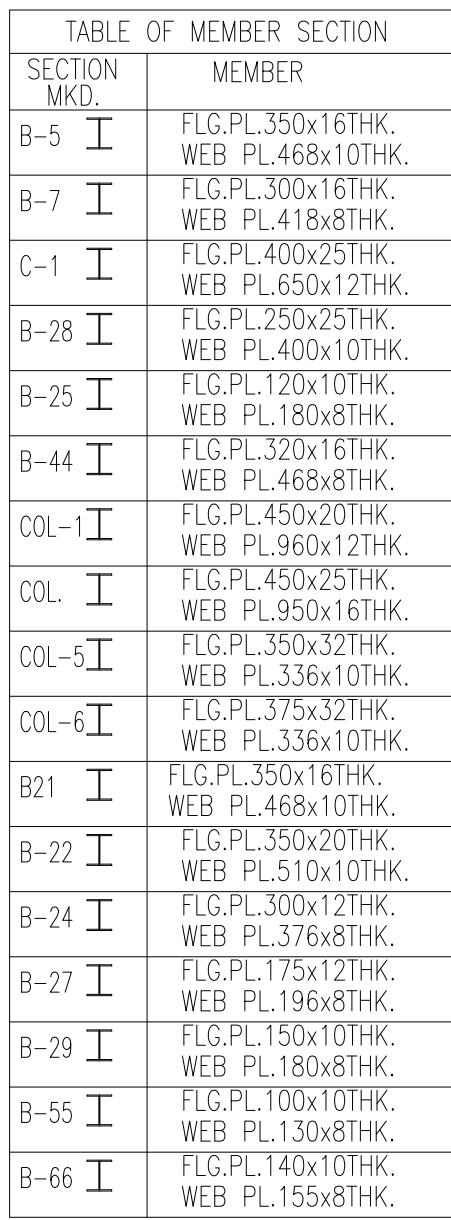

1. ALL DIMENSIONS ARE IN m.m. AND LEVELS ARE IN METER.
2. ALL WELDS ARE MINIMUM 6m.m LEG SIZE CONTINUOUS FILLET (U.O.N)
3. ALL BUTT WELDS SHALL BE FULL PENETRATION.
4. ALL TESTS OF WELD SHALL BE DONE AS PER APPROVED Q.A.P.
5. ALL ROLLED SECTIONS SHALL BE OF GRADE DESIGNATION E250, QUALITY A, SEMI-KILLED/KILLED CONFORMING TO IS 2062. ALL STEEL PLATES SHALL BE OF GRADE DESIGNATION E250, QUALITY BR (FULLY KILLED), CONFORMING TO IS 2062. PLATES BEYOND 12mm THICKNESS AND UP TO 40mm THICKNESS SHALL BE NORMALIZED ROLLED.
6. ALL ERECTION HOLES ARE 18Ø MKD. FOR 16Ø ERECTION BOLTS (U.N.O) 
7. PERMANENT BOLT SHOWN THUS ----- 
8. a) GRATING : BS 4592 PART 1&2, SA/IS:2062 OR EQUIVALENT. 
b) MS PIPE HANDRAIL : BS EN 10219, BS 5395 OR EQUIVALENT. 
9. ALL INCLINED MEMBERS & SIZE OF GUSSET PLATE ARE TO BE CHECKED AND VERIFIED FROM ACTUAL FULL SCALE LAYOUT.

10. THE WELDING SEQUENCE/PROCESS SHALL BE SO ADOPTED THAT NO ACCUMULATION OF SECONDARY WELDING STRESSES TAKES PLACE IN THE MEMBERS. 
11. LENGTH OF WELD SHOWN IN DRG. MIN. HOWEVER FULL CONTACT LENGTH SHOULD BE WELDED PROPERLY.
12. ALL CONTACT SURFACES OF GUSSET PLATE HAVING ERECTION BOLTS SHALL BE WELDED AFTER ERECTION AND ALIGNMENT
13. THIS DRAWING IN NOT BE SCALED, ONLY WRITTEN DIMENSION ARE TO BE FOLLOWED.
14. IN CASE OF ANY DOUBT SEEK CLARIFICATION BEFORE EXECUTION.
15. CHEQUERED PLATE/GRATING TO BE SUITABLY NOTCHED AT SITE TO SUIT ANY OBSTRUCTION WHILE LAYING.
16. EL (+)0.000M CORRESPOND TO POWER HOUSE GROUND FLOOR EL. WHICH CORRESPOND RL (+) 5.600M.
17. FOR MECHANICAL G.A. REFER DRG. NO: Maitree-00-ETH-LH-176047--ISG
18. FOR CIVIL LOAD DATA REFER DRG. NO: Maitree-00-UET-LC-177408--ISG

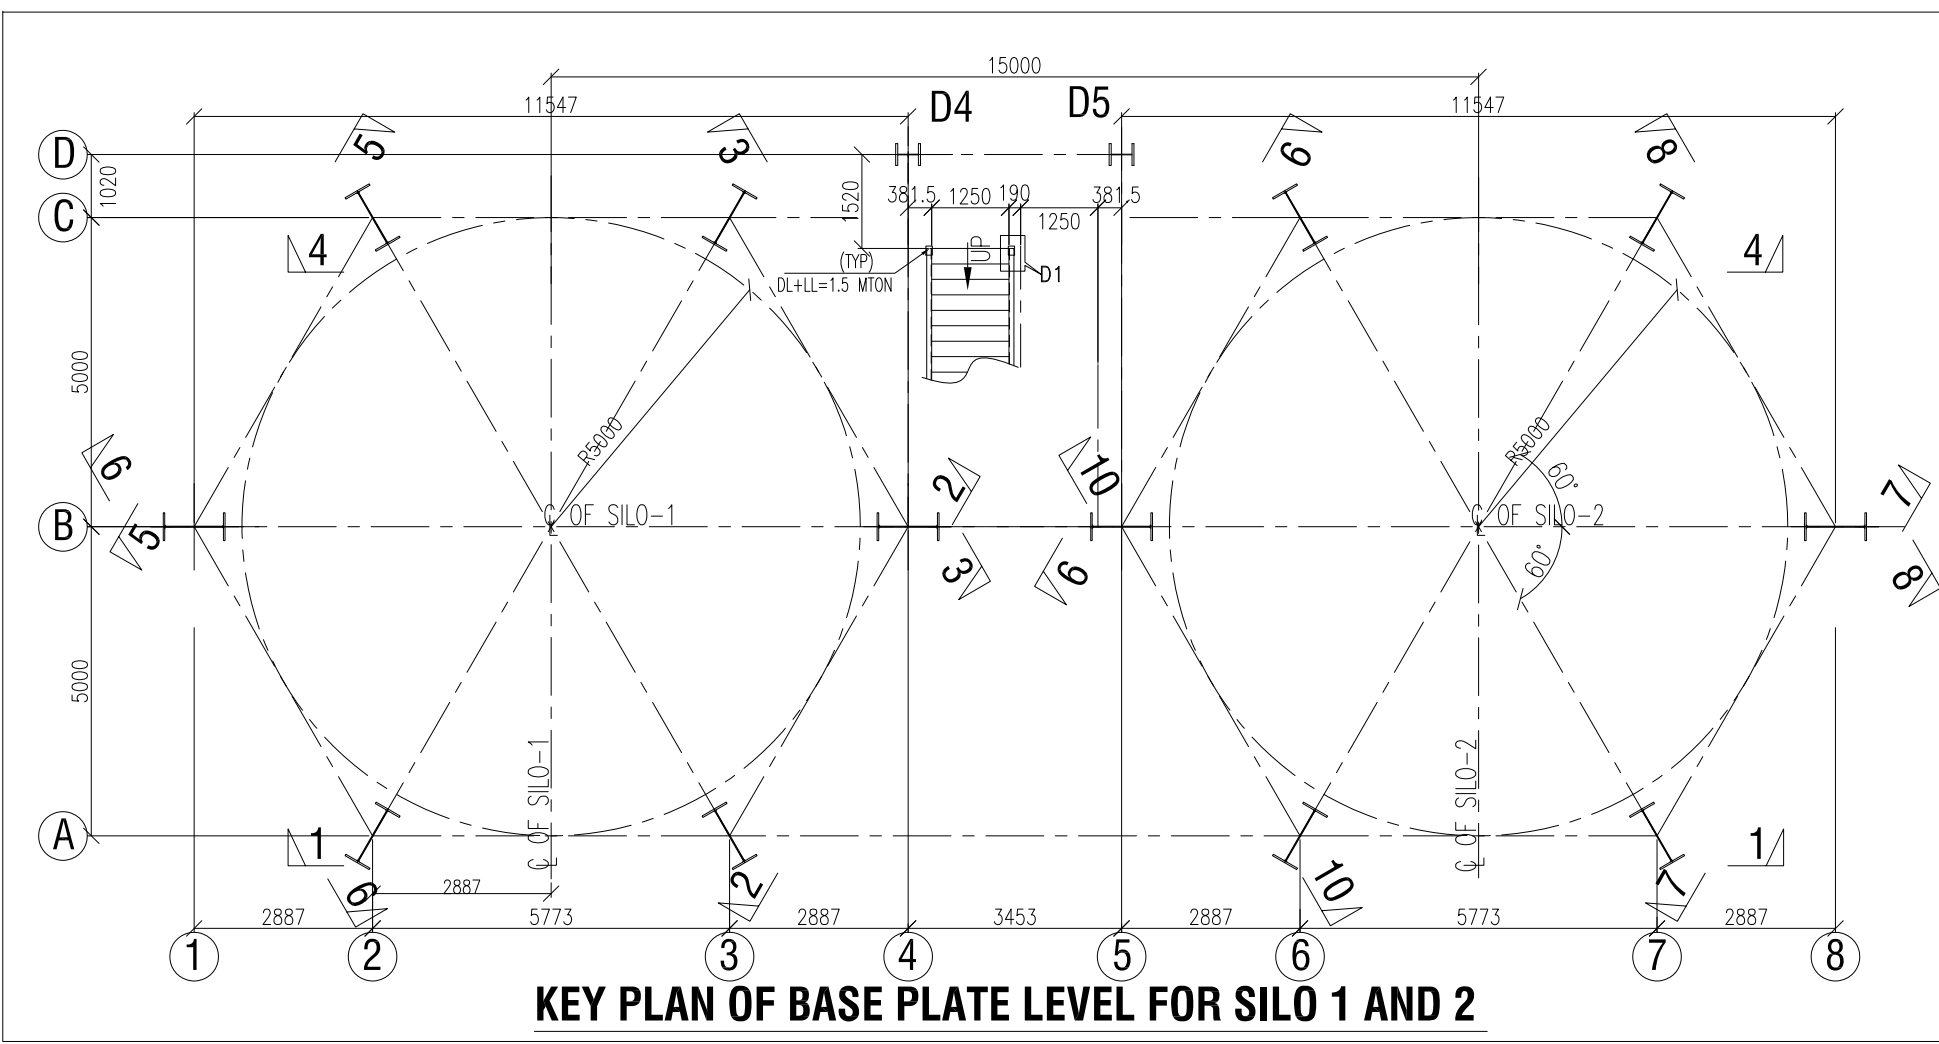[illegible]

