



BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

Page
1/*

Enquiry No	Enquiry Date	Due Date for Quotation
1801700873 - 14	04.07.2017	27.07.2017
Please quote Enquiry No, Date and due date in all correspondences. This is only a request for quotation and not an order. Bid should be submitted in two parts. 1.Techno-commercial bid (Part-I) and 2.Price bid(Part-II) in a separate sealed cover and both covers must be placed in a third cover and sealed. Our Enquiry No., Enq. date & Enq. Due date must be written on all three covers.		

Item	Description	Unit	Quantity	Delivery Quantity	Schedule Date
10	L181612486701001 SEPERATOR LEVEL CONTROL VALVE ASSEMBLY.	SET	2.000	2.00	31.03.18
20	L181612486701002 MINIMUM ECONOMISER FLOW CONTROL VALVE ASSY	SET	1.000	1.00	31.03.18
30	L181612486701003 COMMON ELECTRO HYDRAULIC CONTROL UNIT. „One (1) Common Hydraulic Unit and Electronic Control Unit for the positioning control of the two BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV)	SET	1.000	1.00	31.03.18
40	L181612486701004 SPECIAL TOOLS	SET	1.000	1.00	31.03.18
50	L181612486701005 TUBINGS AND FITTINGS	SET	1.000	1.00	31.03.18
60	L181612486701006 FILLS OF HYDRAULIC FLUID	SET	2.000	2.00	31.03.18
70	L181682498802001 COMM SPARES FOR EACH VALVE One lot of commissioning spares for each valve (Two seperator control valves , one Minimum Economiser Flow control valve)and Electro Hydraulic Power and control Kit as per SELLER'S specific recommendation	SET	1.000	1.00	31.03.18
80	L181712486701001 SEPERATOR LEVEL CONTROL VALVE ASSEMBLY.	SET	2.000	2.00	31.03.18
90	L181712486701002 MINIMUM ECONOMISER FLOW CONTROL VALVE ASSY	SET	1.000	1.00	31.03.18
100	L181712486701003 COMMON ELECTRO HYDRAULIC CONTROL UNIT. „One (1) Common Hydraulic Unit and Electronic	SET	1.000	1.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening.Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR
Sr. Engineer / Purchase
Material Management / FB
BHEL, TRICHY - 620 014
MANAGER / PURCHASE
(FOSSIL BOILERS)
Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
2/*

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017

23505

	Control Unit for the positioning control of the two BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV)				
110	L181712486701004 SPECIAL TOOLS	SET	1.000	1.00	31.03.18
120	L181712486701005 TUBINGS AND FITTINGS	SET	1.000	1.00	31.03.18
130	L181712486701006 FILLS OF HYDRAULIC FLUID	SET	2.000	2.00	31.03.18
140	L181782498802001 COMM SPARES FOR EACH VALVE One lot of commissioning spares for each valve (Two seperator control valves , one Minimum Economiser Flow control valve)and Electro Hydraulic Power and control Kit as per SELLER'S specific recommendation	SET	1.000	1.00	31.03.18
150	R00181600001 Pilot Relay for SEP LVL CV Pilot Relay as per Material code L181612486701001	SET	1.000	1.00	31.03.18
160	R00181600002 Pilot Relay for MIN ECO CV Pilot Relay as per Material code L181612486701002	SET	1.000	1.00	31.03.18
170	R00181600003 Actuator Diaphragm for SEP LVL CV Actuator Diaphragm for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
180	R00181600004 Actuator Diaphragm for MIN ECO CV Actuator Diaphragm for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
190	R00181600005 Feedback Linkage for SEP LVL CV Feedback Linkage for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
200	R00181600006 Feedback Linkage for MIN ECO CV Feedback Linkage for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
210	R00181600007 Smart Positioner for SEP LVL CV Smart Positioner for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
220	R00181600008 Smart Positioner for MIN ECO CV	NO	1.000	1.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening.Late and delayed offers are liable to be rejected.

Yours faithfully,
For **BHARAT HEAVY ELECTRICALS LIMITED**

K. UDAYA KUMAR MANAGER / PURCHASE
Sr. Engineer / Purchase (FOSSIL BOILERS)
Material Management / FB Yours faithfully,
BHEL, TRICHY - 620 014



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

Page
3/*

1801700873 / 04.07.2017

23505

Smart Positioner for MIN ECO CV as per Material code L181612486701002					
230	R00181600009	NO	1.000	1.00	31.03.18
I/P Converter for SEP LVL CV I/P Converter for SEP LVL CV as per Material code L181612486701001					
240	R00181600010	NO	1.000	1.00	31.03.18
I/P Converter for MIN ECO CV I/P Converter for MIN ECO CV as per Material code L181612486701002					
250	R00181600011	SET	1.000	1.00	31.03.18
Complete Consumables for SEP LVL CV "Complete Consumables for Valve Viz. O-ring, Gland Packing, Packing Ring, Bonnet Seal etc for SEP LVL CV as per Material code L181612486701001					
260	R00181600012	SET	1.000	1.00	31.03.18
Complete Consumables for MIN ECO CV "Complete Consumables for Valve Viz. O-ring, Gland Packing, Packing Ring, Bonnet Seal etc for MIN ECO CV as per Material code L181612486701002					
270	R00181600013	SET	2.000	2.00	31.03.18
Valve Disc for SEP LVL CV Valve Disc for SEP LVL CV as per Material code L181612486701001					
280	R00181600014	SET	2.000	2.00	31.03.18
Valve Disc for MIN ECO CV Valve Disc for MIN ECO CV as per Material code L181612486701002					
290	R00181600015	SET	2.000	2.00	31.03.18
Valve Spindle for SEP LVL CV Valve Spindle for SEP LVL CV as per Material code L181612486701001					
300	R00181600016	SET	2.000	2.00	31.03.18
Valve Spindle for MIN ECO CV Valve Spindle for MIN ECO CV as per Material code L181612486701002					
310	R00181600017	SET	2.000	2.00	31.03.18
Valve Seat for SEP LVL CV Valve Seat for SEP LVL CV as per Material code L181612486701001					
320	R00181600018	SET	2.000	2.00	31.03.18
Valve Seat for MIN ECO CV Valve Seat for MIN ECO CV as per Material code L181612486701002					
330	R00181600019	SET	2.000	2.00	31.03.18
Bush for SEP LVL CV					

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR MANAGER / PURCHASE
Sr. Engineer / Purchase (FOSSIL BOILERS)
Material Management / FB Yours faithfully,
BH&L, TRICHY - 620 014



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
4/*

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017			23505		
	Bush for SEP LVL CV as per Material code L181612486701001				
340	R00181600020	SET	2.000	2.00	31.03.18
	Bush for MIN ECO CV Bush for MIN ECO CV as per Material code L181612486701002				
350	R00181600021	SET	2.000	2.00	31.03.18
	Guide for SEP LVL CV Guide for SEP LVL CV as per Material code L181612486701001				
360	R00181600022	SET	2.000	2.00	31.03.18
	Guide for MIN ECO CV Guide for MIN ECO CV as per Material code L181612486701002				
370	R00181600023	SET	2.000	2.00	31.03.18
	Guide Bush for SEP LVL CV Guide Bush for SEP LVL CV as per Material code L181612486701001				
380	R00181600024	SET	2.000	2.00	31.03.18
	Guide Bush for MIN ECO CV Guide Bush for MIN ECO CV as per Material code L181612486701002				
390	R00181600025	SET	2.000	2.00	31.03.18
	Coupling Nut for SEP LVL CV Coupling Nut for SEP LVL CV as per Material code L181612486701001				
400	R00181600026	SET	2.000	2.00	31.03.18
	Coupling Nut for MIN ECO CV Coupling Nut for MIN ECO CV as per Material code L181612486701002				
410	R00181600027	SET	2.000	2.00	31.03.18
	Actuator Piston + Rod & Seal for SEP LVL Actuator Piston + Rod & Seal for SEP LVL CV as per Material code L181612486701001				
420	R00181600028	SET	2.000	2.00	31.03.18
	Actuator Piston + Rod & Seal for MIN ECO Actuator Piston + Rod & Seal for MIN ECO CV as per Material code L181612486701002				
430	R00181600029	SET	1.000	1.00	31.03.18
	CV stem packg & spare diaphragm for SEP Control valve stem packing and spare operator moulded rubber diaphragms for SEP LVL CV as per Material code L181612486701001				
440	R00181600030	SET	1.000	1.00	31.03.18
	CV stem packg & spare diaphragm				
The offers should reach us 30 minutes before the time of opening of tenders. The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening.Late and delayed offers are liable to be rejected.			Yours faithfully, For BHARAT HEAVY ELECTRICALS LIMITED K. UDAYA KUMAR MANAGER, PURCHASE Sr. Engineer / Purchase (FOSSIL BOILERS) Material Management / F8 BHHEL TRICHY 620 014 Yours faithfully,		



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

Page
5/*

1801700873 / 04.07.2017

23505

	for MIN Control valve stem packing and spare operator moulded rubber diaphragms for MIN ECO CV as per Material code L181612486701002				
450	R00181600031 Valve trim for SEP LVL CV "Valve trim (including cage, plug, stem, seat rings, guide bushings etc.) for SEP LVL CV as per Material code L181612486701001	SET	1.000	1.00	31.03.18
460	R00181600032 Valve trim for MIN ECO CV "Valve trim (including cage, plug, stem, seat rings, guide bushings etc.) for MIN ECO CV as per Material code L181612486701002	SET	1.000	1.00	31.03.18
470	R00181600033 Solenoid Valve for SEP LVL CV Solenoid Valve for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
480	R00181600034 Solenoid Valve for MIN ECO CV Solenoid Valve for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
490	R00181600035 Position Transmitter for SEP LVL CV Position Transmitter for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
500	R00181600036 Position Transmitter for MIN ECO CV Position Transmitter for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
510	R00181600037 Limit Switches for SEP LVL CV Limit Switches for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
520	R00181600038 Limit Switches for MIN ECO CV Limit Switches for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
530	R00181600039 Solenoid Valve Coil for SEP LVL CV Solenoid Valve Coil for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
540	R00181600040 Solenoid Valve Coil for MIN ECO	NO	1.000	1.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR MANAGER / PURCHASE
Sr. Engineer / Purchase (FOSSIL BOILERS)
Material Management / FB Yours faithfully,

TEL, TRICHY - 620 014.



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

Page
6/*

1801700873 / 04.07.2017

23505

	CV Solenoid Valve Coil for MIN ECO CV as per Material code L181612486701002				
550	R00181600041 Plunger for Sol Valves for SEP LVL CV Plunger for Sol Valves for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
560	R00181600042 Plunger for Sol Valves for MIN ECO CV Plunger for Sol Valves for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
570	R00181600043 Seat for Sol Valves for SEP LVL CV Seat for Sol Valves for SEP LVL CV as per Material code L181612486701001	NO	2.000	2.00	31.03.18
580	R00181600044 Seat for Sol Valves for MIN ECO CV Seat for Sol Valves for MIN ECO CV as per Material code L181612486701002	NO	2.000	2.00	31.03.18
590	R00181600045 Gaskets for Sol Valves for SEP LVL CV Gaskets for Sol Valves for SEP LVL CV as per Material code L181612486701001	SET	2.000	2.00	31.03.18
600	R00181600046 Gaskets for Sol Valves for MIN ECO CV Gaskets for Sol Valves for MIN ECO CV as per Material code L181612486701002	SET	2.000	2.00	31.03.18
610	R00181600047 O-Ring set for Sol Valves for SEP LVL CV O-Ring set for Sol Valves for SEP LVL CV as per Material code L181612486701001	SET	5.000	5.00	31.03.18
620	R00181600048 O-Ring set for Sol Valves for MIN ECO CV O-Ring set for Sol Valves for MIN ECO CV as per Material code L181612486701002	SET	5.000	5.00	31.03.18
630	R00181600049 Complete set of Actuator for	NO	1.000	1.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For **BHARAT HEAVY ELECTRICALS LIMITED**

K. UDAYA KUMAR
Sr Engineer / Purchase
Material Management / FB
BHEL, TRICHY - 620 014.
MANAGER / PURCHASE
(FOSSIL BOILERS)
Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
7/*

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017

23505

	SEP LVL CV Complete set of Actuator for SEP LVL CV as per Material code L181612486701001				
640	R00181600050 Complete set of Actuator for MIN ECO CV Complete set of Actuator for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
650	R00181600051 Torque Switch for Actuator for SEP LVL C Torque Switch for Actuator for SEP LVL CV as per Material code L181612486701001	NO	3.000	3.00	31.03.18
660	R00181600052 Torque Switch for Actuator for MIN ECO C Torque Switch for Actuator for MIN ECO CV as per Material code L181612486701002	NO	3.000	3.00	31.03.18
670	R00181600053 Auxiliary Contact for Actuator for SEP L Auxiliary Contact for Actuator for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
680	R00181600054 Auxiliary Contact for Actuator for MIN E Auxiliary Contact for Actuator for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
690	R00181600055 Motor for Actuator-- for SEP LVL CV Motor for Actuator-- for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
700	R00181600056 Motor for Actuator-- for MIN ECO CV Motor for Actuator-- for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
710	R00181600057 Complete Seal kit for Actuator for SEP L Complete Seal kit for Actuator for SEP LVL CV as per Material code L181612486701001	SET	1.000	1.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UNAVA KUMAR
Sr. Engineer / Purchase
Material Management / FB
BHEL, TRICHY - 620 014.
MANAGER / PURCHASE
(FOSSIL BOILERS)
Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
8/*

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017				23505	
720	R00181600058 Complete Seal kit for Actuator for MIN E Complete Seal kit for Actuator for MIN ECO CV as per Material code L181612486701002	SET	1.000	1.00	31.03.18
730	R00181600059 Compl O-Ring Set for Actuator for SEP LV Compl O-Ring Set for Actuator for SEP LVL CV as per Material code L181612486701001	SET	1.000	1.00	31.03.18
740	R00181600060 Compl O-Ring Set for Actuator for MIN EC Compl O-Ring Set for Actuator for MIN ECO CV as per Material code L181612486701002	SET	1.000	1.00	31.03.18
750	R00181600061 Electronic Card for Actuator for SEP LVL Electronic Card for Actuator for SEP LVL CV as per Material code L181612486701001	NO	1.000	1.00	31.03.18
760	R00181600062 Electronic Card for Actuator for MIN ECO Electronic Card for Actuator for MIN ECO CV as per Material code L181612486701002	NO	1.000	1.00	31.03.18
770	R00181600249 Min Eco flow control valve internals Min Eco flow control valve internals namely Valve Trim parts as per Material code L181612486701002. One Set means Complete requirement of 1 Control Valve.	SET	1.000	1.00	31.03.18
780	R00181600250 HWL flow control valve internal spares HWL flow control valve internal spares namely Valve Trim parts as per Material code L181612486701001. One Set means Complete requirement of 1 Control Valve.	SET	1.000	1.00	31.03.18
790	R00181700001 Pilot Relay for SEP LVL CV Pilot Relay as per Material code L181712486701001	SET	1.000	1.00	31.03.18
800	R00181700002 Pilot Relay for MIN ECO CV	SET	1.000	1.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For **BHARAT HEAVY ELECTRICALS LIMITED**

K. UDAYA KUMAR
Sr. Engineer / Purchase
Material Management / FB
BHEL, TRICHY - 620 014.


MANAGER / PURCHASE
(FOSSIL BOILERS)
Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
9/*

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017				23505	
	Pilot Relay as per Material code L181712486701002				
810	R00181700003	NO	1.000	1.00	31.03.18
	Actuator Diaphragm for SEP LVL CV CV Actuator Diaphragm for SEP LVL CV as per Material code L181712486701001				
820	R00181700004	NO	1.000	1.00	31.03.18
	Actuator Diaphragm for MIN ECO CV CV Actuator Diaphragm for MIN ECO CV as per Material code L181712486701002				
830	R00181700005	NO	1.000	1.00	31.03.18
	Feedback Linkage for SEP LVL CV Feedback Linkage for SEP LVL CV as per Material code L181712486701001				
840	R00181700006	NO	1.000	1.00	31.03.18
	Feedback Linkage for MIN ECO CV Feedback Linkage for MIN ECO CV as per Material code L181712486701002				
850	R00181700007	NO	1.000	1.00	31.03.18
	Smart Positioner for SEP LVL CV Smart Positioner for SEP LVL CV as per Material code L181712486701001				
860	R00181700008	NO	1.000	1.00	31.03.18
	Smart Positioner for MIN ECO CV Smart Positioner for MIN ECO CV as per Material code L181712486701002				
870	R00181700009	NO	1.000	1.00	31.03.18
	I/P Converter for SEP LVL CV I/P Converter for SEP LVL CV as per Material code L181712486701001				
880	R00181700010	NO	1.000	1.00	31.03.18
	I/P Converter for MIN ECO CV I/P Converter for MIN ECO CV as per Material code L181712486701002				
890	R00181700011	SET	1.000	1.00	31.03.18
	Complete Consumables for SEP LVL CV "Complete Consumables for Valve Viz. O-ring, Gland Packing, Packing Ring, Bonnet Seal etc for SEP LVL CV as per Material code L181712486701001				
900	R00181700012	SET	1.000	1.00	31.03.18
	Complete Consumables for MIN ECO CV "Complete Consumables for Valve Viz. O-ring, Gland Packing, Packing Ring, Bonnet Seal etc for MIN ECO CV as per Material code L181712486701002				
The offers should reach us 30 minutes before the time of opening of tenders. The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening.Late and delayed offers are liable to be rejected.					
			Yours faithfully, For BHARAT HEAVY ELECTRICALS LIMITED		
			K. VIDAYA KUMAR Sr. Engineer / Purchase Material Management / FB BHEL, TRICHY - 620 014.		
			 MANAGER / PURCHASE (FOSSIL BOILERS) Yours faithfully,		



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
10/18

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017				23505	
910	R00181700013	SET	2.000	2.00	31.03.18
	Valve Disc for SEP LVL CV Valve Disc for SEP LVL CV as per Material code L181712486701001				
920	R00181700014	SET	2.000	2.00	31.03.18
	Valve Disc for MIN ECO CV Valve Disc for MIN ECO CV as per Material code L181712486701002				
930	R00181700015	SET	2.000	2.00	31.03.18
	Valve Spindle for SEP LVL CV Valve Spindle for SEP LVL CV as per Material code L181712486701001				
940	R00181700016	SET	2.000	2.00	31.03.18
	Valve Spindle for MIN ECO CV Valve Spindle for MIN ECO CV as per Material code L181712486701002				
950	R00181700017	SET	2.000	2.00	31.03.18
	Valve Seat for SEP LVL CV Valve Seat for SEP LVL CV as per Material code L181712486701001				
960	R00181700018	SET	2.000	2.00	31.03.18
	Valve Seat for MIN ECO CV Valve Seat for MIN ECO CV as per Material code L181712486701002				
970	R00181700019	SET	2.000	2.00	31.03.18
	Bush for SEP LVL CV Bush for SEP LVL CV as per Material code L181712486701001				
980	R00181700020	SET	2.000	2.00	31.03.18
	Bush for MIN ECO CV Bush for MIN ECO CV as per Material code L181712486701002				
990	R00181700021	SET	2.000	2.00	31.03.18
	Guide for SEP LVL CV Guide for SEP LVL CV as per Material code L181712486701001				
1000	R00181700022	SET	2.000	2.00	31.03.18
	Guide for MIN ECO CV Guide for MIN ECO CV as per Material code L181712486701002				
1010	R00181700023	SET	2.000	2.00	31.03.18
	Guide Bush for SEP LVL CV Guide Bush for SEP LVL CV as per Material code L181712486701001				
1020	R00181700024	SET	2.000	2.00	31.03.18
	Guide Bush for MIN ECO CV Guide Bush for MIN ECO CV as per Material code L181712486701002				
1030	R00181700025	SET	2.000	2.00	31.03.18
	Coupling Nut for SEP LVL CV Coupling Nut for SEP LVL CV as per Material				

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For **BHARAT HEAVY ELECTRICALS LIMITED**

K. LADAYA KUMAR
Sr. Engineer / Purchase
Material Management / Fossil Boilers
BHEL, TRICHY - 620 014
Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
11/18

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017				23505	
	code L181712486701001				
1040	R00181700026 Coupling Nut for MIN ECO CV Coupling Nut for MIN ECO CV as per Material code L181712486701002	SET	2.000	2.00	31.03.18
1050	R00181700027 Actuator Piston + Rod & Seal for SEP LVL Actuator Piston + Rod & Seal for SEP LVL CV as per Material code L181712486701001	SET	2.000	2.00	31.03.18
1060	R00181700028 Actuator Piston + Rod & Seal for MIN ECO Actuator Piston + Rod & Seal for MIN ECO CV as per Material code L181712486701002	SET	2.000	2.00	31.03.18
1070	R00181700029 CV stem packg & spare diaphragm for SEP Control valve stem packing and spare operator moulded rubber diaphragms for SEP LVL CV as per Material code L181712486701001	SET	1.000	1.00	31.03.18
1080	R00181700030 CV stem packg & spare diaphragm for MIN Control valve stem packing and spare operator moulded rubber diaphragms for MIN ECO CV as per Material code L181712486701002	SET	1.000	1.00	31.03.18
1090	R00181700031 Valve trim for SEP LVL CV "Valve trim (including cage, plug, stem, seat rings, guide bushings etc.) for SEP LVL CV as per Material code L181712486701001	SET	1.000	1.00	31.03.18
1100	R00181700032 Valve trim for MIN ECO CV "Valve trim (including cage, plug, stem, seat rings, guide bushings etc.) for MIN ECO CV as per Material code L181712486701002	SET	1.000	1.00	31.03.18
1110	R00181700033 Solenoid Valve for SEP LVL CV Solenoid Valve for SEP LVL CV as per Material code L181712486701001	NO	1.000	1.00	31.03.18
1120	R00181700034 Solenoid Valve for MIN ECO CV Solenoid Valve for MIN ECO CV as per Material code L181712486701002	NO	1.000	1.00	31.03.18
1130	R00181700035	NO	1.000	1.00	31.03.18
The offers should reach us 30 minutes before the time of opening of tenders. The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening. Late and delayed offers are liable to be rejected.					
Yours faithfully, For BHARAT HEAVY ELECTRICALS LIMITED K. UDAYA KUMAR Sr. Engineer / Purchase Material Management (F&B) BHEL, TRICHY (F&B BOILERS) Yours faithfully,					



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
12/18

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017

23505

	Position Transmitter for SEP LVL CV Position Transmitter for SEP LVL CV as per Material code L181712486701001				
1140	R00181700036 Position Transmitter for MIN ECO CV Position Transmitter for MIN ECO CV as per Material code L181712486701002	NO	1.000	1.00	31.03.18
1150	R00181700037 Limit Switches for SEP LVL CV Limit Switches for SEP LVL CV as per Material code L181712486701001	NO	1.000	1.00	31.03.18
1160	R00181700038 Limit Switches for MIN ECO CV Limit Switches for MIN ECO CV as per Material code L181712486701002	NO	1.000	1.00	31.03.18
1170	R00181700039 Solenoid Valve Coil for SEP LVL CV Solenoid Valve Coil for SEP LVL CV as per Material code L181712486701001	NO	1.000	1.00	31.03.18
1180	R00181700040 Solenoid Valve Coil for MIN ECO CV Solenoid Valve Coil for MIN ECO CV as per Material code L181712486701002	NO	1.000	1.00	31.03.18
1190	R00181700041 Plunger for Sol Valves for SEP LVL CV Plunger for Sol Valves for SEP LVL CV as per Material code L181712486701001	NO	1.000	1.00	31.03.18
1200	R00181700042 Plunger for Sol Valves for MIN ECO CV Plunger for Sol Valves for MIN ECO CV as per Material code L181712486701002	NO	1.000	1.00	31.03.18
1210	R00181700043 Seat for Sol Valves for SEP LVL CV Seat for Sol Valves for SEP LVL CV as per Material code L181712486701001	NO	2.000	2.00	31.03.18
1220	R00181700044 Seat for Sol Valves for MIN ECO CV Seat for Sol Valves for MIN ECO CV as per Material code L181712486701002	NO	2.000	2.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR
Sr. Engineer / Purchase
Material Management / FB
BHEL, TRICHY - 620 014.

MANAGER / PURCHASE
(FOSSIL BOILERS)
Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
13/18

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017				23505	
1230	R00181700045	SET	2.000	2.00	31.03.18
	Gaskets for Sol Valves for SEP LVL CV Gaskets for Sol Valves for SEP LVL CV as per Material code L181712486701001				
1240	R00181700046	SET	2.000	2.00	31.03.18
	Gaskets for Sol Valves for MIN ECO CV Gaskets for Sol Valves for MIN ECO CV as per Material code L181712486701002				
1250	R00181700047	SET	5.000	5.00	31.03.18
	O-Ring set for Sol Valves for SEP LVL CV O-Ring set for Sol Valves for SEP LVL CV as per Material code L181712486701001				
1260	R00181700048	SET	5.000	5.00	31.03.18
	O-Ring set for Sol Valves for MIN ECO CV O-Ring set for Sol Valves for MIN ECO CV as per Material code L181712486701002				
1270	R00181700049	NO	1.000	1.00	31.03.18
	Complete set of Actuator for SEP LVL CV Complete set of Actuator for SEP LVL CV as per Material code L181712486701001				
1280	R00181700050	NO	1.000	1.00	31.03.18
	Complete set of Actuator for MIN ECO CV Complete set of Actuator for MIN ECO CV as per Material code L181712486701002				
1290	R00181700051	NO	3.000	3.00	31.03.18
	Torque Switch for Actuator for SEP LVL C Torque Switch for Actuator for SEP LVL CV as per Material code L181712486701001				
1300	R00181700052	NO	3.000	3.00	31.03.18
	Torque Switch for Actuator for MIN ECO C Torque Switch for Actuator for MIN ECO CV as per Material code L181712486701002				
1310	R00181700053	NO	1.000	1.00	31.03.18
	Auxiliary Contact for Actuator for SEP L Auxiliary Contact for Actuator for SEP LVL CV				

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR
Sr. Engineer / Purchase
Material Management / FB
BHEL TRICHY - 620 014.



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

Page
14/18

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

1801700873 / 04.07.2017

23505

	as per Material code L181712486701001				
1320	R00181700054 Auxiliary Contact for Actuator for MIN E Auxiliary Contact for Actuator for MIN ECO CV as per Material code L181712486701002	NO	1.000	1.00	31.03.18
1330	R00181700055 Motor for Actuator-- for SEP LVL CV Motor for Actuator-- for SEP LVL CV as per Material code L181712486701001	NO	1.000	1.00	31.03.18
1340	R00181700056 Motor for Actuator-- for MIN ECO CV Motor for Actuator-- for MIN ECO CV as per Material code L181712486701002	NO	1.000	1.00	31.03.18
1350	R00181700057 Complete Seal kit for Actuator for SEP L Complete Seal kit for Actuator for SEP LVL CV as per Material code L181712486701001	SET	1.000	1.00	31.03.18
1360	R00181700058 Complete Seal kit for Actuator for MIN E Complete Seal kit for Actuator for MIN ECO CV as per Material code L181712486701002	SET	1.000	1.00	31.03.18
1370	R00181700059 Compl O-Ring Set for Actuator for SEP LV Compl O-Ring Set for Actuator for SEP LVL CV as per Material code L181712486701001	SET	1.000	1.00	31.03.18
1380	R00181700060 Compl O-Ring Set for Actuator for MIN EC Compl O-Ring Set for Actuator for MIN ECO CV as per Material code L181712486701002	SET	1.000	1.00	31.03.18
1390	R00181700061 Electronic Card for Actuator for SEP LVL Electronic Card for Actuator for SEP LVL CV as per Material code L181712486701001	NO	1.000	1.00	31.03.18
1400	R00181700062 Electronic Card for Actuator	NO	1.000	1.00	31.03.18

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of
tenderers who have submitted their offer and who may like to be present for the tender
opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For **BHARAT HEAVY ELECTRICALS LIMITED**

K. Udaya Kumar
K. UDAYA KUMAR
Sr. Engineer / Purchase
Material Manager
BHEL, TRIPUR

MANAGER / PURCHASE
(FOSSIL BOILERS)
Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
 HIGH PRESSURE BOILER PLANT
 PURCHASE DEPARTMENT - FOSSIL BOILERS
 THIRUCHIRAPALLI - 620014
 TAMILNADU (INDIA)

Page
15/18

PHONE :0431-2574111
 GRAMS : BHARATELEC
 FAX NO: 0431-2520719
 E-mail:
 Web:

1801700873 / 04.07.2017

23505

	for MIN ECO Electronic Card for Actuator for MIN ECO CV as per Material code L181712486701002				
1410	R00181700251	SET	1.000	1.00	31.03.18
	Min Eco flow control valve internals Min Eco flow control valve internals namely Valve Trim parts as per Material code L181712486701002. 1 Set means complete requirement of 1 Control Valve.				
1420	R00181700252	SET	1.000	1.00	31.03.18
	HWL flow control valve internal spares HWL flow control valve internal spares namely Valve Trim parts as per Material code L181712486701001. 1 Set means complete requirement of 1 Control Valve.				

General Note:

- 1) Please fill up the commercial terms annexure A enclosed and submit along with the offer for evaluation.
- 2) Please give point wise confirmation to our specification and fill all the columns in the datasheet.
- 3) The offer to be submitted in two part bid system:
 - a) Technical offer with commercial terms and b) Price bid separately
- 4) Vendors are requested to quote on FOR/Destination basis including freight & insurance charges to their account.
- 5) The tender will be considered project wise package basis for evaluation & ordering.
- 6) Vendor to furnish unit weight and dimensional drawings of the valves at the time of the offer itself.
- 7) Vendor shall follow applicable painting schedule for this project.
- 8) While calculating the Quantity of Items for Commissioning spares, vendor shall round the number to the nearest higher whole number.
- 9) Suitability of Mandatory spares to the main supply shall be confirmed by vendor in the quotation.
- 10) Complete set of documents/drawing approved by Main engineering is

The offers should reach us 30 minutes before the time of opening of tenders.
 The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
 For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR
 Sr. Engineer / Purchase
 Material Management / FB
 BHEL, TRICHY - 620 014

h. by
 NAGER / PURCHASE
 FOSSIL BOILERS)
 Yours faithfully,



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
 HIGH PRESSURE BOILER PLANT
 PURCHASE DEPARTMENT - FOSSIL BOILERS
 THIRUCHIRAPALLI - 620014
 TAMILNADU (INDIA)

PHONE :0431-2574111
 GRAMS : BHARATELEC
 FAX NO: 0431-2520719
 E-mail:
 Web:

Page
 16/18

1801700873 / 04.07.2017

23505

applicable for spares supply and to be followed for the Mandatory spares also. No separate approval is required for spares.

11) Vendor to submit clear technical offer indicating the scope of supply for each items with BHEL material code and set details indicating applicable items with applicable description, Specification and quantity and also should clearly indicate not applicable items.

12) All filled up data sheets, drawings, calculations for Cv, Noise, Valve outlet velocity, Actuator sizing, Actuator wiring, vendor data sheets for Cv electrical actuator, Lift vs Cv %, hook up & JB diagram and catalogues are to be submitted along with the offer.

13) Price for Cv type test is to be quoted.

14)

KRISHNAPATANAM:

MAIN SUPPLY AND COMMISSIONING SPARES: Enquiry sl. No: 10 to 70
 To be despatched to Krishnapatanam site, Andhra Pradesh.

MANDATORY SPARES: Enquiry sl. No: 150 to 780
 To be despatched to BHEL Stores, Trichy.

VIJAYAWADA:

MAIN SUPPLY AND COMMISSIONING SPARES: Enquiry sl. No: 80 to 140
 To be despatched to Vijayawada site, Andhra Pradesh.

MANDATORY SPARES: Enquiry sl. No: 790 to 1420
 To be despatched to BHEL Stores, Trichy.

15) Vendor shall comply the Pre-qualification requirement as indicated in specification.

16) Special provision for MSME vendors are as per Annexure-A

17) Vendor have to submit all the documents duly filled in "Supplier Registration Forms" through online (available in <http://www.bheltry.co.in/>- Online Vendor Registration- Material Management). Duly filled-in Supplier Registration Forms, along with all credentials and supporting documents, Certificate of Rating from D & B (Dun & Brad) sheet or equivalent agencies (For Foreign vendors), Financial Performance / Profit & Loss Account / Balance sheet for last three years etc. (With Techno-Commercial Bid).

Availability of minimum manufacturing, handling, testing and measuring facilities, to be detailed are to be mentioned clearly. All the documents to be uploaded. Apart from Qualifying the Techno- Commercial requirements of the enquiry, BHEL has the right for spot assessment of

The offers should reach us 30 minutes before the time of opening of tenders. The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
 For **BHARAT HEAVY ELECTRICALS LIMITED**

K. UDAYA KUMAR
 Sr. Engineer / Purchase
 Material Management / FB
 BHEL, TRICHY - 620 014.

MANAGER / PURCHASE
 (FOSSIL BOILERS)
 Yours faithfully,



BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

Page
17/18

1801700873 / 04.07.2017

23505

the facilities for evaluation, approval and for registration.

18) Price Bid of the vendors will be open subjected to Techno commercial suitability and approval of vendor firm by our end customer APGENCO.

19) Vendors are requested to provide all special tools for assembly and disassembly of valves, HPU installation, accumulator charging and valve flushing etc under special tool category in Enq SI No: 40 and 110.

All the tenders may be addressed to the following address:

The Tender Opening Cell / MM
Room No: 26, Building 24, Ground Floor
Bharat Heavy Electricals Limited
TIRUCHIRAPALLI 620014

In case personal delivery of the offer, it shall be dropped into the respective box kept in Room No: 26, after duly entering the data in the system.

Offers will be accepted only up to 14.00 Hrs on the due date. Therefore, vendors shall ensure to submit the offers well before this time. All due date extension requirements should be addressed to the respective Purchase mail IDs. All the due date extension requests from vendors will be considered only up to 48 hours before the due date and time.

Vendors are requested to avoid submission of offers through e mail / fax. In case of any unavoidable situation, offers shall be sent through e mail to the following mail ID only tender_cell@bheltry.co.in.

As tenders are being opened by Common Tender Opening Cell, offer covers should be sealed with tenderer's distinctive seal and super scribed with correct Tender No. item of supply and due date of opening.

The offers will be opened at 14.30 hrs on the due date of the tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening. Late and delayed offers are liable to be rejected.

The bidder along with its associate/ collaborators/ sub-contractors/ sub-vendors/ consultants/ service providers shall strictly adhere to BHEL fraud prevention policy displayed on BHEL website <http://www.bhel.com> and shall immediately bring to the notice of BHEL management about any fraud or suspected fraud as soon as it comes to their notice.

The supplier shall submit EI/EII forms to BHEL time to time as indicated by the BHEL and in case of inordinate delay in issuing EI/EII forms, then BHEL reserves the right to deduct 5% of the value of the supplied items against which EI/EII forms pending to be issued

Enclosures:

- 1) Terms and Conditions (Annexure-A).
- 2) Pre-Qualification Requirement (Annexure -B)

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR
Sr. Engineer / Purchase
Material Management /
BHEL, TRICHY - 620 014



429-002/A

BHARAT HEAVY ELECTRICALS LIMITED

(A Government of India Undertaking)
HIGH PRESSURE BOILER PLANT
PURCHASE DEPARTMENT - FOSSIL BOILERS
THIRUCHIRAPALLI - 620014
TAMILNADU (INDIA)

PHONE :0431-2574111
GRAMS : BHARATELEC
FAX NO: 0431-2520719
E-mail:
Web:

Page
18/18

1801700873 / 04.07.2017

23505

- 3) Standard Quality Plan:SQP:SD:06/Rev 00 dt 14.09.2015
- 4) PBG format with Bank list
- 5) Price / unprice format
- 6) Specifications and Data sheets

"LD clause has to be confirmed without fail."

The offers should reach us 30 minutes before the time of opening of tenders.
The offers will be opened at 14.30 hrs on the due date of tender in the presence of tenderers who have submitted their offer and who may like to be present for the tender opening. Late and delayed offers are liable to be rejected.

Yours faithfully,
For BHARAT HEAVY ELECTRICALS LIMITED

K. UDAYA KUMAR
Sr. Engineer / Purchase
Material Management / FB
Yours faithfully,
BHEL, TRICHY - 620 014.



An ISO 9001
Company

Bharat Heavy Electricals Limited

(High Pressure Boiler Plant)
Tiruchirappalli-620 014, Tamil Nadu, India
Dept: MATERIALS MANAGEMENT/BOI

Annexure – A- Terms and Conditions

ACCEPTANCE OF TECHNO - COMMERCIAL TERMS AND CONDITIONS BY THE BIDDERS

Description of the Equipment:		Start-up System Control Valves, Commissioning Spares and Mandatory Spares
Projects		Krishnapatnam Unit # 3 (1 x800MW) Vijayawada (1 x 800MW)
BHEL Tender No. & Date		1801700873 dated 04.07.2017
Sl. No.	Terms and conditions	Vendor's confirmation
1 (a)	Technical: Supply of Start-up System Control Valves, Commissioning Spares and Mandatory Spares shall be as per Data Sheet and Specification attached with the enquiry.	
1 (b)	Inspection by Customer (APGENCO) and BHEL	
2	Firm Price: The quoted / finalised rates shall be firm till execution of the supplies. Offer with PVC clause will not be considered.	
3 (a)	Delivery term (Indigenous): The quote shall be on FOR respective project destination basis as indicated below, inclusive of Packing, forwarding, Freight & Transit Insurance also to yours account. Main and Commissioning Spares: To be despatched to Respective Project Site Mandatory Spares: To be despatched to BHEL Stores, Trichy Please quote explicitly the freight and insurance value either in % or Lumpsum. If vendor passing transit insurance under BHEL scope. Offer will be loaded 0.1064% of (Basic material value + GST + Forwarding & Packing + Freight charge).	
3(b)	Delivery term (Import): CFR Chennai port The quote shall be on CFR Chennai Port basis with freight break up details and Place of delivery –Chennai PORT OF LOADING SHOULD BE INDICATED WITHOUT FAIL. PORT OF DISCHARGE should be CHENNAI	

4 (a)	Payment terms (Indigenous): 100% direct payment after 45 days from the date of dispatch against site acknowledgement LR copy with 10% PBG. Payment terms (Imports): BHEL Payment term is 100% payment on CAD basis after 45 days from the date of receipt of documents, specified in PO, at BHEL bank. Respective bank charges to respective account with 10% PBG.	
4 (b)	Loading Criteria (Indigenous) Payment Terms: Any deviation in the BHEL payment terms will attract loading as per below. “Base rate of SBI (As applicable on the date of bid opening. Techno-commercial bid opening in case of two part bids) + 6% shall be considered for loading for the period of relaxation sought by bidders”. If the Payment term is 90% direct payment after 45 days from the date of dispatch against submission of dispatch documents and balance 10% against site acknowledgement. For this option a loading of 2% on the 90% of the offered materials value shall be made. Payment through bank is not acceptable. If still demanded by vendor, loading will be 5% on the offered material value. LC will not be operated for Indigenous vendors. Offers with payment terms as LC from indigenous vendors will be rejected.	
4(c)	Loading Criteria (Imports) : Any deviation in the above payment term (as per 4(a)) will attract loading as mentioned below. “Base rate of SBI (as applicable on the date of bid opening. Techno-commercial bid opening in case of two part bids) + 6% shall be considered for loading for the period of relaxation sought by bidders. • In the case of Usance LCs the loading will be considered @ 1.5% on the offered Value. • For LC at sight the loading will be considered @ 3.5% on the offered Value. Normally CAD at sight and Confirmed LCs are liable for rejection.	
4 (d)	Performance Bank Guarantee: BHEL require a performance Bank Guarantee to a value of 10% of supply value covering the guarantee period. The PBG shall be in BHEL format (Format attached) which is to be opened in any one of the first class India banks. All banks charges shall be to vendor account only. If still vendor offered any deviation on PBG leads to rejection of offer	
5 (a)	Liquidated damages: Delivery of the goods specified in the purchase order should be made within the time prescribed. Failure to dispatch the materials in the time as per the delivery quoted in our Purchase Order would make the supplier liable to an un-conditional LD at the rate of 0.5% of the undelivered order value per week of the delay or part thereof subject to a maximum of 10% of the total order value.	

5 (b)	Loading Criteria: LD / Penalty: Any deviation on BHEL LD / Penalty clause, loading (Basic material Value) will be applied to the extent to which it is not agreed by the bidder. If vendor agree for LD clause for Under delivered portion, than loading will be 10% on basis material cost.	
6 (a)	Guarantee / Warranty Period: Guarantee clause 24 months from the date of supply or 18 months from the date of actual put in use, whichever is earlier.	
6 (b)	Loading Criteria: Guarantee / Warranty Period: No Deviation is permitted. If still vendor offered any deviation on the Guarantee / warranty period, it may lead to rejection of offer.	
7(a)	Taxes & Duties: All Taxes, Duties, Service Taxes etc. payable as extra to the quoted price should be specifically stated in offers along with CST & TIN No / Tariff No. etc., failing which the purchaser will not be liable for payment of such Taxes and Duties. Our TIN No. 33243560005, TNGST No. 3560005, CST. No. 239383 Dt. 11-06-1991 & BHEL ECC No. AAACB4146PXM012, Assessment circle Tiruverambur.	
7 (b)	Kindly indicate the GST No of your Firm	
7 (c)	Kindly Indicate the HSN Code for enquiry serial no's	
7 (d)	Please indicate the applicable GST % (IGST)	
7 (e)	Kindly Note the BHEL GST NO : 33AAACB4146P2ZL	
8	Document Submission: Along with the offer: 1. Filled in Commercial terms and conditions to be submitted. 2. Unpriced offer shall be submitted along with details of all line items, filled data sheets, etc. 3. Any query during enquiry stage shall be replied within three days failing which offer may be rejected as non-responsive. After Purchase Order: 1. Technical datasheets & QP to be submitted for BHEL approval within 15 days from the PO date. 2. If type tests has to be conducted by vendor as per specification/QP requirements, then the same has to be conducted (at NABL accredited facility, witnessed by BHEL inspection agency) and report to be submitted for BHEL / Customer for approval. 3. Any comment in the documents by BHEL to be replied / revised (as applicable) within three days. 4. Any document submitted with deviations from enquiry/PO requirements will not be treated as document submission for LD calculation purposes. 5.	

9	Evaluation method Each Project requirement will be considered as package basis for evaluation and ordering. Package No :01 (Krishnapatnam 1 x 800 MW) Enquiry Sl. No : 10 to 70 , 150 to 780) Package No: 02 (Vijayawada 1 x 800MW) Enquiry Sl. No: 80 to 140 , 790 to 1420)	
10	Vendor shall quote as per attached price and Unpriced Schedule format only.	
11	Validity: 120 days minimum from techno commercial bid opening (Part-1)	
12	O & M manuals: BHEL require 1 sets of printed O & M manuals with 3 soft copies in CD-ROM at no cost to be sent to BHEL/ Trichy and 3 sets of printed O &M manuals to be sent along with valves directly to site.	
13	Repair & replacements: Within the guarantee period vendor has to replace / rectify the defective/ damaged items on free of cost within a reasonable time of reporting from our end.	
14	MSE VENDOR: <i>i. If L1 vendor is an MSE vendor entire project package will be ordered on L1 vendor.</i> <i>ii. If a Non MSE vendor is coming as L1, then L1 prices will be counteroffered on MSE vendor who is quoting price within the price band L1+15% and if they are agreeing purchase order will be awarded for full/complete supply of total tendered value to MSE.</i> <i>iii. If more than one MSE vendors are available in the L1+15% price band then lowest of the MSE vendor will be selected for counteroffering. If lowest MSE vendor is not accepting it will be counteroffered to the next MSE vendor in the price band and so on.</i> <i>iv. Finally if none of the MSE vendor in the price band is not accepting it will be ordered on L1 non MSE vendor.</i> MSE suppliers can avail the intended benefits only if they submit along with the offer, attested/notarized copies of either 1. EM II certificate having deemed validity (five years from the date of issue of acknowledgement in EM II) or 2. Valid NSIC certificate or EM II certificate along with CA certificate (Format enclosed) applicable for the year, certifying quantum of investment in plant and machinery within the permissible limits as per the act for relevant status (MICRO or	

	SMALL) where the deemed validity of EM II is over. <i>Date to be reckoned for determining the deemed validity will be the last date of technical bid submission (Part 1 in case of two part bid).</i> Non submission of such documents will lead to consideration of their bid at par with other bidders. No benefit shall be applicable for this enquiry, in case of any deficiency in the above required documents or in case the documents are not submitted before price bid opening. If the tender is to be submitted through e-procurement portal, then the above required documents are to be uploaded on the portal even if submitted earlier. Documents should be notarized or attested by a Gazetted officer. <i>Definitions of MSEs owned by SC/ST is under:</i> <i>In case of proprietorship firm, proprietor must be SC/ST.</i> <i>In case of partnership firm, the SC/ST partners must be holding at least 51% shares in the unit.</i> <i>In case of private limited companies, at least 51% share must be held by SC/ST promoters.</i> Authorised Offices to Issue SC/ST certificate. The caste/Tribe/Community certificate issued by the following authorities in the prescribed form for SCs/STs can be considered. - District Magistrate / Additional District Magistrate / Collector / Deputy Commissioner / Additional Deputy Commissioner / Deputy Collector / 1st class stipendiary magistrate / Sub divisional Magistrate / Taulka Magistrate / Executive magistrate / Extra Assistant commissioner. - Chief Presidency magistrate / Additional chief presidency magistrate/Presidency magistrate. - Revenue Officer not below the rank of thasildar. - Sub-Divisional officer of the area where the individual and / or his family normally resides. <i>To avail the benefits of MSE under SC/ST category, the related documents as stated above should be submitted along with tender documents.</i>	
15	Price Bids of the vendor will be opened subject to approval of Vendor / Firm for Supply of Start-up System Control Valves, Commissioning Spares and Mandatory Spares (High Press Control valve) by end Customer (APGENCO)	
16	Documents are to be submitted along with technical bid (Part-1) 01. Covering letter 02. Unpriced offer as per BHEL format 03. Filed technical specification 04. Filed BHEL Terms and condition sheet	

	05. Filed Pre-Qualification requirement (PQR) along with supporting documents 06. Catalogue's 07. MSME Documents (If applicable) 08. Vendor registration documents Documents are to be submitted along with Price bid (Part-2) 01. Priced offer as per BHEL format Note: All the pages of documents are to be signed and stamped by authorized signatory of the company.	
17	Vendor who are not registered with BHEL –Trichy for supply of Startup System control valves under item code: 24SCV as a permanent vendor, those vendors are requested to submit the vendor registration through online and submit the registration application number along all the necessary documents. (available in http://www.bheltry.co.in/- Online Vendor Registration- Material Management) Note : Vendor have to submit all the documents duly filled in "Supplier Registration Forms" through online (available in http://www.bheltry.co.in/- Online Vendor Registration- Material Management). Duly filled-in Supplier Registration Forms, along with all credentials and supporting documents, Certificate of Rating from D&B (Dun & Brad) sheet or equivalent agencies (For Foreign vendors), Financial Performance / Profit & Loss Account / Balance sheet for last three years etc. (With Techno-Commercial Bid). Availability of minimum manufacturing, handling, testing and measuring facilities, to be detailed are to be mentioned clearly. All the documents to be uploaded. Apart from Qualifying the Techno- Commercial requirements of the enquiry, BHEL has the right for spot assessment of the facilities for evaluation, approval and for registration.	

BHEL TRICHY
MM/BOI
ANNEXURE – B
Pre-Qualification requirements (PQR)

Sl.NO	Description	Vendor Confirmation
1	The bidder should have supplied control valves of Z type and of 20 inch valve size or higher with the required valve material (F11 or superior material) and rating as per this specification requirement and the same valves should have been commissioned in at least one plant of sub / super critical steam generating units with an operating pressure more than 255 kg/cm2 in similar applications mentioned in our specification and are in successful operation for a period of not less than 1 year as on the date of techno-commercial bid opening	
2	The bidder can offer and supply such equipment for this project with collaboration or valid licensing agreement for design, engineering, manufacture, supply of such equipment in India provided the collaborator meets the above proven ness criteria..	
3	The supplier has to submit either of following supporting documents meeting above mentioned pre-qualifying requirement Copy of minimum one(1) performance certificate in English from end user along with copy of related purchase order(PO) or letter of intent(LOI) or letter of award(LOA) or work order(WO) specifying that the product / equipment is running successfully for one(1) year from date of commissioning meeting pre-qualifying requirement. OR Minimum two PO/LOI/LOA/WO placed with a minimum gap of one (1) year from same purchaser meeting the minimum pre-qualifying requirement. OR Minimum one PO/LOI/LOA/WO after commissioning of first order from the same purchaser meeting the minimum pre-qualifying requirement. OR Minimum three customer's/ third party's inspection reports/ test certificates/ commissioning certificates meeting the minimum pre-qualifying requirement.	
4	BHEL may negotiate the L1 rate, if not meeting our budget/estimated cost.	
5	BHEL may re-float the tender opened, if L1 price is not the acceptable price to BHEL.	

Offers are liable for rejection, if not satisfying above pre-qualifying criteria.

(TO BE STAMPED IN ACCORDANCE WITH STAMP ACT AND THE EXPIRY DATE OF BG MUST BE AFTER 60 DAYS FROM THE DATE OF COMPLETION OF WARRANTY PERIOD)

PERFORMANCE BANK GUARANTEE

In accordance of M/s. Bharat Heavy Electricals Limited (A Government of India undertaking, a company incorporated under the Companies Act 1956 having its Registered Office at "BHEL House", SIRI Fort, New Delhi 110 049) through its High Pressure Boiler Plant Division located at Tiruverumbur, Tiruchirapalli- 620 014 (hereinafter called 'the Company') having entered into a contract withhereinafter called ' the said contractor ' which term includes 'suppliers' for the purpose of this Bond and under the terms and conditions of the contract No..... Dt Between BHEL, Trichy and as per the contract, the contractor / supplier is to furnish a performance Bank guarantee for Rs. for the due performance of the equipment to be supplied under the above referred contract and for the fulfillment of all the terms and conditions of the contract, We(indicate the name of the bank) (herein after referred to as the bank) at the request of (Contractor(s)) do here by undertake to pay the company an amount not exceeding Rs.....against any loss or damage caused to or suffered or would be caused to or suffered by the company by reason of any breach by the said contractor (s) of any of the terms and conditions contained in the said agreement.

2. We(indicate the name of the bank with full address), do hereby undertake to pay the amounts due and payable under this guarantee without any demur, merely on a demand from the Company stating that the amount claimed is due by way of loss or damage caused to or would be caused to or suffered by the Company by reason of breach by the said Contractor(s) of any of the terms and conditions contained in the said Agreement or by the reason of the contractor(s) 'failure to perform' the said agreement. Any such demand made on the Bank shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However, our liability under this guarantee shall be restricted to an amount not exceeding Rs. _____.

3. We undertake to pay unconditionally to the Company any money so demanded notwithstanding any dispute(s) raised by the Contractor in any suit, or proceedings pending before any Court or Tribunal or Arbitration or before any other authority relating thereto our liability under this present being absolute and unequivocal. The payment under this guarantee would not wait till the disputes have been decided by any Court or Tribunal or in the arbitration proceedings or by any other authority. The payment so made by us under this Bond shall be a valid discharge of liability for payment thereunder and the Contractor(s) shall have no claim against us for making such payment.

4. We.....(indicate the name of Bank), further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the performance of the said Agreement and that it shall continue to be enforceable till all the dues of the Company under or by virtue of the said Agreement have been fully paid and its claims satisfied or discharged or till _____Office / Department/ Division of the Company certifies that the terms and conditions of the said Agreement have been fully and properly carried out by the said Contractor(s) and accordingly discharges this guarantee.

5. (I) Unless a demand or claim under this guarantee is made on us in writing on or before the _____ we shall be discharged from all the liability under this guarantee thereafter. But where such claim or demand has been preferred by the Company with the Bank before the expiry of the said date, the claim shall be enforceable notwithstanding the fact that the said enforcement is effected after the said date.

(ii) For the purpose of this clause, any letter making demand on the Bank by M/s. BHEL dispatched by Registered Post with Ack.Due or by Telegram or by any Electronic media addressed to the above mentioned address of the Bank shall be deemed to be the claim / demand in writing referred to above irrespective of the fact as to whether and when the said letter reaches the Bank, as also any letter containing the said demand or claim is lodged with the bank personally.

6. We(indicate the name of Bank), further agree with the company that the Company shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said agreement or to extend time of performance by the said Contractor (s) from time to time or to postpone for any time or from time to time any of the powers exercisable by the Company against the said Contractor(s) and to forbear or enforce any of the terms and conditions relating to the said Agreement and we shall not be relieved from our liability by any reason of any such variation or extension being granted to the said Contractor(s) or for any forbearance, act or omission on the part of the company or any indulgence by the company to the said Contractor(s) or by any such matter or thing whatsoever which under the law relating would, but for this provision, have effect of not so relieving us.
7. This guarantee will not be discharged due to the change in the constitution of the Bank or the Contractor(s).
8. It shall not be necessary for the company to proceed against the contractor before proceeding against the guarantor-bank and the guarantee herein contained shall be enforceable against them notwithstanding any security, which the company may have obtained or obtain from the Contractor shall, at the time when proceedings are taken against the guarantor hereunder be outstanding or unrealised.
9. Any claim or dispute arising under the terms of this document shall only be enforced or settled in the Courts at Tiruchirapalli.
10. The guarantor hereby declare that it has power to execute this guarantee and the executant has full powers to do so on its behalf under the proper authorities granted to him/them by the guarantor.
11. We(indicate the name of Bank) lastly undertake not to revoke this guarantee during its currency except with the previous consent of the company in writing.

In witness whereof we....., (indicate the name of Bank) have hereunto setout Bank Seal the _____ day _____ month 200
BANK E-MAIL ID:
BANK PHONE NO.
BANK FAX NO:

List of Consortium Bank			
	Nationalised Bank		Nationalised Bank
1	Allahabad bank	19	Vijaya Bank
2	Andhra bank		Public Sector Banks
3	Bank of Baroda	20	IDBI
4	Canara Bank		Foreign bank
5	Corporation bank	21	CITI Bank N.A
6	Central bank	22	Deutsche Bank AG
7	Indian Bank	23	The Hongkong and Shanghai Banking Corporation Limited
8	Indian Oversea Bank	24	Standard Chartered Bank
9	Oriental bank of Commerce	25	The Royal Bank of Scotland N.V.
10	Punjab National Bank	26	J P Morgan
11	Punjab & Sindh Bank		Private bank
12	State Bank of India	27	Axis Bank
13	State Bank of Hyderabad	28	The Federal Bank Limited
14	Syndicate Bank	29	HDFC
15	State Bank of Travancore	30	Kotak Mahindra Bank
16	UCO Bank	31	ICICI
17	Union Bank of India	32	Indusind Bank
18	United Bank of India	33	Yes Bank

	BHARAT HEAVY ELECTRICALS LIMITED TIRUCHIRAPPALLI - 620 014, INDIA. QUALITY ASSURANCE DEPARTMENT	
	STANDARD QUALITY PLAN FOR CONTROL VALVES (STEAM & WATER APPLICATIONS)	
	SQP:SD:06 Rev 00	Page: 1 of 5

Prepared By Quality Assurance	VENKANNA RUPANI <i>R. Venkanna</i> 14/09/2015
--	--

Reviewed by	Signature
Quality Assurance G. PANNAGER SELVAM	<i>[Signature]</i> 14/09/15
Engineering K. SRIDHARAN	<i>[Signature]</i> 16/09/15
Materials Management/BOI K. UDAYA KUMAR	<i>[Signature]</i> 16/09/15
Quality Control R. DHARMAR	<i>[Signature]</i> 15/09/15

Rev No	Date	Approved by	Signature
00	14/09/2015	AGM / QA & BE	<i>[Signature]</i>

Record of Revisions

Rev No	Details of Revision	Remarks
00	Fresh Issue	

		MANUFACTURER'S NAME & ADDRESS: BHEL TIRUCHIRAPPALLI APPROVED SUPPLIERS		STANDARD QUALITY PLAN							QWI NO:SQP:SD:06 REV.NO.00 DATE: 14/09/2015 PAGE: 2 OF 5				
PRODUCT: CONTROL VALVES – STEAM & WATER APPLICATIONS (SH, RH SPRAY BLOCK; SB PRESSURE REDUCING; WARM KEEPING LEVEL; START-UP SYSTEM:SEPARATOR LEVEL & MINIMUM ECONOMIZER FLOW)															
SUB-SYSTEM :Steam Generator Package															
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS		
1	2	3	4	5	M	C/N	7	8	9	D*	M	C	N	11	
1.0 RAW MATERIALS & BOUGHT OUT ITEMS															
1.1	Body, Bonnet, inlet & outlet nozzles (if applicable)	Chemical & Mech Properties, Heat treatment, Hardness@	B	TC Verification	1/Heat	1/Heat	BHEL approved datasheet/ ASTM Std	BHEL approved datasheet / ASTM Std	MTC	√	P	V	V	@on Gr 91 materials only.	
		Surface quality*	B	Visual Examination	100%	100%	MSS SP 55	MSS SP 55	MTC	√	P	V	V	*on castings.	
		Internal Soundness for class rating ≥ 900 (RT/UT#)	B	TC Verification	100%	100%	ASME Sec V	RT: ASME B16.34 Appendix I/ UT: ASME B16.34 Appendix IV	MTC	√	P	V	V	#RT as per ASME B16.34; UT for forgings of dia/thick ≥50mm.	
		#Sub-Surface Soundness(MPI)	B	TC Verification	100%	100%	ASME Sec V/ ASTM E709	ASME B 16.34 Appendix II	MTC	√	P	V	V	#On accessible areas.	
1.2	Trim(Plug, Seat ring & Stem)	Chemical & Mechanical. Properties, Hardness@	B	TC Verification	1/Heat	1/Heat	BHEL approved datasheet / ASTM Std	BHEL approved datasheet / ASTM Std	MTC	√	P	V	V	@on Gr 91 materials only.	
		Stem Internal Soundness(UT#)	B	TC Verification	100%	100%	ASME Sec V/ ASTM A 388	ASME B 16.34 Appendix IV	MTC	√	P	V	V	#UT for dia/ thick ≥50mm	
1.3	Pressure retaining fasteners	Chemical, Mechanical Prop & Dimensions	B	TC Verification	1/Heat	1/Heat	BHEL approved datasheet /ASTM Std	BHEL approved datasheet /ASTM Std	MTC/ COC	√	P	V	V		
1.4	Diaphragm/ Piston Cylinder, if applicable	Surface Quality, Strength & %Elg, Hardness, *, Endurance Life, Dimensions	B	Visual & Measurement	1/ Lot 100%	1/ Lot 100%	Manufacturer's Specification 10,000 Cycles	Manufacturer's Specification No damage	COC	√	P	V	V	*property change after heat aging.	
1.5	Springs, if applicable	Chemistry, Strength, Hardness, Endurance*, Scragging, Linearity & Dimensions	B	Chemical Analysis, Compression & Load test, Measurement, Cyclic Test, Measurement	1/ Lot	1/ Lot	Manufacturer's Specification 10,000 Cycles	Manufacturer's Specification No damage	COC	√	P	V	V	*including stiffness ratio.	

LEGEND: *RECORDS IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY THE SUPPLIER IN QA DOCUMENTATION;

** M: MANUFACTURER, C: BHEL QC/BHEL AIA, N: CUSTOMER; P: PERFORM. W: WITNESS, V: VERIFICATION; CLASS: A - CRITICAL; B - MAJOR; C - MINOR;
MTC- Mill /Manufacturer's Test Certificate; IR- Inspection/Test Report; (R): Routine test; (T)/(Ts): Type test, COC: Certificate of compliance



**MANUFACTURER'S
NAME & ADDRESS:
BHEL TIRUCHIRAPPALLI
APPROVED SUPPLIERS**

STANDARD QUALITY PLAN

**PRODUCT: CONTROL VALVES – STEAM & WATER APPLICATIONS (SH, RH SPRAY
BLOCK; SB PRESSURE REDUCING; WARM KEEPING LEVEL;
START-UP SYSTEM:SEPARATOR LEVEL & MINIMUM ECONOMIZER FLOW)**

**QWI NO:SQP:SD:06
REV.NO.00 DATE: 14/09/2015
PAGE: 3 OF 5**

SUB-SYSTEM :Steam Generator Package

SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY				REMARKS
					M	C/N				M	C	N		
1	2	3	4	5	M	C/N	7	8	9	D*	** 10			11
1.6	Pressure Gauges, if applicable	Rating/Range, Performance	B	Visual, Calibration	100%	100%	Manufacturer's Specification	Manufacturer's Specification	IR/COC	√	P	V	V	
1.7	Accessories: Solenoid valve, limit switch, ALR, junction box, positioner & transmitters, etc.#	Make/rating/type; Degree of protection(as applicable)*	B	Verification	100%	100%	BHEL approved datasheet	BHEL approved datasheet	COC & Certificates *	√	P	V	V	#BHEL approved makes. *For electrical items, certificates by statutory bodies shall be furnished.
2.0	INPROCESS INSPECTION													
2.1	Welding Qualifications, if welding is involved	Procedure	B	Document Review	100%	100%	ASME Sec IX	ASME Sec IX	PQR & WPS	√	P	V	V	# ASME Sec IX for BHEL export boilers only
		Personnel #	B	Document Review	100%	100%	IBR/ ASME Sec IX#	IBR/ ASME Sec IX #	WPQ	√	P	V	V	
2.2	PWHT, if applicable	Time & Temp control	B	Review of HT Chart	100%	100%	WPS & IBR	WPS & IBR	HT Chart	√	P	V	V	
2.3	Hard faced Trims	Hardness	B	Measurement	On test samples only		BHEL approved datasheet / Mfg Std	BHEL approved datasheet / Mfg Std	Test Report	√	P	V	V	
2.4	Body, Bonnet, Plug, Seat Rings & Stems after machining	Surface quality, Dimensions including profile check	B	Visual & Measurement	100%	--	Manufacturer's Drawing	Manufacturer's Drawing	--	-	P	--	-	
2.5	Lapping*	M/c surface contact	B	Visual	1/Heat		---	Proper Physical contact	Test Report	-	P	-	-	*for rotating stem valves.
2.6	NDE on hard faced trims	Weld Soundness	B	LPI	100%	100%	ASME E165	ASME Sec VIII Div 1 Appd 8.4	Test Report	√	P	V	V	
2.7	NDE on butt weld joints	Weld Soundness	B	RT/UT	100%	100%	ASME Sec V	ASME Sec I	Test Report	√	P	V *	V	*Film Review
2.8	NDE on butt weld ends	Soundness of edges after m/c	B	LPI	100%	100%	ASME Sec V	ASME Sec VIII Div 1 Appd 8.4	Test Report	√	P	V	V	
2.9	Body & Bonnet	Leak tightness & pressure resistance	A	Hydro Test	100%	-	ASME 16.34/ ISA 75.19	No Leak	Register/ Log	--	P	-	-	
2.10	Hardness on Gr 91 welds	Hardness	B	Measurement	100%	10%	Manufacturer's standard	186-300 BHN	Test Report	√	P	W	V	

LEGEND: *RECORDS IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY THE SUPPLIER IN QA DOCUMENTATION;

**** M:** MANUFACTURER, **C:** BHEL QC/BHEL AIA, **N:** CUSTOMER, **P:** PERFORM, **W:** WITNESS, **V:** VERIFICATION; **CLASS:** A - CRITICAL; B - MAJOR; C - MINOR;

MTC: Mill /Manufacturer's Test Certificate; **IR:** Inspection/Test Report; **(R):** Routine test; **(T)/(I's):** Type test, **COC:** Certificate of compliance

		MANUFACTURER'S NAME & ADDRESS: BHEL TIRUCHIRAPPALLI APPROVED SUPPLIERS		STANDARD QUALITY PLAN							QWI NO:SQP:SD:06 REV.NO.00 DATE: 14/09/2015 PAGE: 4 OF 5			
		PRODUCT: CONTROL VALVES – STEAM & WATER APPLICATIONS (SH, RH SPRAY BLOCK; SB PRESSURE REDUCING; WARM KEEPING LEVEL; START-UP SYSTEM:SEPARATOR LEVEL & MINIMUM ECONOMIZER FLOW)												
		SUB-SYSTEM :Steam Generator Package												
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS	
1	2	3	4	5	M	C/N	7	8	9	D*	M	C	N	11
3.0 FINAL INSPECTION & TESTING														
3.1	Performance Test on assembled valves fitted with all accessories	Leak tightness & pressure resistance of Body & Bonnet joint	A	Hydro Test	100%	10%	ASME 16.34/ISA 75.19	No Leak	Test Report	√	P	W	V	IBR Form III C shall be submitted
3.2		Leak through seat	A	Seat Leak Test (Air/Hydro test)	100%	10%	FCI 70.2 /BHEL approved datasheet	FCI 70.2 /BHEL approved datasheet	Test Report	√	P	W	V	
3.3		Travel, linearity, hysteresis, valve opening & closing time, fail safe feature, functioning of all accessories.	A	Performance/ Calibration Test	100%	10%	IEC 60534-4/ BHEL approved datasheet	BHEL approved datasheet	Test Report	√	P	W	V	
3.4		Packing Tightness*	A	Packing Leak Test	100%	10%	ASME B16.34/ BHEL approved datasheet	ASME B16.34/ BHEL approved datasheet	Test Report	√	P	W	V	*can be done during hydro test (Cl 3.1)
3.5		Control valve flow Capacity# (Discharge Vs Opening)	A	Capacity Test (Cv test)	1/Type	1/Type	BHEL approved datasheet /ISA 75.02	ISA 75.11	Test Report#	√	P	V #	V	#Type test witnessed by BHEL or done at FCRI shall be submitted for review & clearance by BHEL Engg (certificate valid for 5 years).
3.6		Actuator chamber-Strength & leakage	B	Air Leak Test	100%	10%	Manufacturer's std	No leak when tested @ 1.5 times supply press or 60 psi max.	Test Report	√	P	W	V	
3.7	Actuator & Positioner	Model, SI No, Qty, Rating	B	Visual & Document Review	100%	10%	BHEL approved datasheet	BHEL approved datasheet	Test Report/ COC	√	P	W	V	
3.8	Final Inspection	Overall Dimensions*	B	Measurement	100%	10%	BHEL approved GA Drawing	BHEL approved GA Drawing	Test Report	√	P	W	V	*including OD, d1, thickness, etc.

LEGEND: *RECORDS IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY THE SUPPLIER IN QA DOCUMENTATION;
**** M:** MANUFACTURER, **C:** BHEL QC/BHEL AIA, **N:** CUSTOMER, **P:** PERFORM, **W:** WITNESS, **V:** VERIFICATION; **CLASS:** A - CRITICAL; B - MAJOR; C - MINOR;
MTC- Mill /Manufacturer's Test Certificate; **IR-** Inspection/Test Report; **(R):** Routine test; **(T)/(Ts):** Type test, **COC:** Certificate of compliance

		MANUFACTURER'S NAME & ADDRESS: BHEL TIRUCHIRAPPALLI APPROVED SUPPLIERS		STANDARD QUALITY PLAN							QWI NO:SQP:SD:06 REV.NO.00 DATE: 14/09/2015 PAGE: 5 OF 5			
				PRODUCT: CONTROL VALVES – STEAM & WATER APPLICATIONS (SH, RH SPRAY BLOCK; SB PRESSURE REDUCING; WARM KEEPING LEVEL; START-UP SYSTEM:SEPARATOR LEVEL & MINIMUM ECONOMIZER FLOW)										
				SUB-SYSTEM :Steam Generator Package										
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY			REMARKS	
1	2	3	4	5	M	C/N	7	8	9	D*	M	C	N	11
4.0	PAINTING, PRESERVATION & PACKING													
4.1	Painting	Surface Prep, Primer & finish coats & Shade, DFT	B	Visual & Measurement	100%	100%	BHEL approved painting Scheme	BHEL approved painting Scheme	Test Report	√	P	V	V	
4.2	Identification #	Marking /Name Plate & Tagging	B	Visual	100%	100%	BHEL Spec & PO	BHEL Spec & PO	Test Report	--	P	V	V	#with IBR stamp
4.3	Packing*	Cleanliness, Water-proof packing & Stability	B	Verification	100%	100%	Manufacturer's practice	Manufacturer's practice	Packing List	√	P	V	V	*with site storage & handling instructions.
4.4	Spare Parts	Parts, Type, Qty, Dimensions, etc.	B	Visual & Measurement	100%	100%	BHEL approved datasheet & PO	BHEL approved datasheet & PO	IR/COC	√	P	V	V	

Note: 1. Customer verification stages specified above shall be followed. Any witness stages shall be as specified/indicated in BHEL PO.

LEGEND: *RECORDS IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY THE SUPPLIER IN QA DOCUMENTATION;
**** M:** MANUFACTURER, **C:** BHEL, **QC/BHEL AIA,** **N:** CUSTOMER, **P:** PERFORM, **W:** WITNESS, **V:** VERIFICATION; **CLASS :** A - CRITICAL ; B - MAJOR ; C - MINOR;
MTC- Mill /Manufacturer's Test Certificate; **IR-** Inspection/Test Report; **(R):** Routine test; **(T)/(T's):** Type test, **COC:** Certificate of compliance

SUPPLY OF STARTUP SYSTEM CONTROL VALVES TO KRISHNAPATANAM 1 x 800 MW									
Enquiry Sl. No	Items Details / Description	Qty	Net Weight	Gross weight	size	Unit Rate	Total Material Cost	Sea Freight Charge	Total Value (CFR)
			Kgs	Kgs	L x B x H	Currency -Type	Currency -Type	Currency -Type	Currency -Type
10									
20									
30									
.									
70									
150									
160									
170									
.									
.									
.									
770									
780									
	CV Test Charges								
Note : 1. Vendor shall quote freight and insurance amount. Don't indicate freight & Insurance are inclusive/ Zero Value. 2. Mandatory Spares : It is requested to provide the set details for each line item of mandatory spares like Item description , Qty, Make/model , etc. 3. For NOT APPLICABLE mandatory spares for offered Model of valves , Vendors shall provide details technical explanation for not applicability.									
								TOTLA PRICE - FOB / Nearest Sea Port	
								TOTAL SEA FREIGHT CHAGES	
								TOTAL PRICE - CFR / CHENNAI PORT	

SUPPLY OF STARTUP SYSTEM CONTROL VALVES TO VIJAYAWADA 1 x 800 MW									
Enquiry Sl. No	Items Details / Description	Qty	Net Weight	Gross weight	size	Unit Rate	Total Material Cost	Sea Freight Charge	Total Value (CFR)
			Kgs	Kgs	L x B x H	Currency -Type	Currency -Type	Currency -Type	Currency -Type
80									
90									
100									
110									
.									
.									
140									
790									
800									
.									
.									
.									
1,410									
1,420									
	Cv Test Charges								
Note : 1. Vendor shall quote freight and insurance amount. Don't indicate freight & Insurance are inclusive/ Zero Value. 2. Mandatory Spares : It is requested to provide the set details for each line item of mandatory spares like Item description , Qty, Make/model , etc. 3. For NOT APPLICABLE mandatory spares for offered Model of valves , Vendors shall provide details technical explanation for not applicability.									
								TOTLA PRICE - FOB / Nearest Sea Port	
								TOTAL SEA FREIGHT CHAGES	
								TOTAL PRICE - CFR / CHENNAI PORT	

SUPPLY OF STARTUP SYSTEM CONTROL VALVES TO KRISHNAPATANAM 1 x 800 MW							
Enquiry Sl. No	Items Details	Qty	Unit Rate	Total Material Cost	IGST	Freight & Insurance Lumpsum	Total Value (FOR)
			Rs	Rs	%	Rs	Rs
10							
20							
30							
40							
50							
.							
.							
150							
160							
170							
.							
770							
780							
	CV Test Charges						

Note :

1. Vendor shall quote freight and insurance amount. Don't indicate freight & Insurance are inclusive/ Zero Value.
2. Mandatory Spares : It is requested to provide the set details for each line item of mandatory spares like Item description , Qty, Make/model , etc.
3. For NOT APPLICABLE mandatory spares for offered Model of valves , Vendors shall provide details technical explanation for not applicability.

SUPPLY OF STARTUP SYSTEM CONTROL VALVES TO VIJAYAWADA 1 x 800 MW							
Enquiry Sl. No	Items Details	Qty	Unit Rate	Total Material Cost	IGST	Freight & Insurance Lumpsum	Total Value (FOR)
			Rs	Rs	%	Rs	Rs
80							
90							
100							
.							
.							
140							
790							
800							
810							
.							
.							
1410							
1420							
	CV Test Charges						

Note :
1. Vendor shall quote freight and insurance amount. Don't indicate freight & Insurance are inclusive/ Zero Value.
2. Mandatory Spares : It is requested to provide the set details for each line item of mandatory spares like Item description , Qty, Make/model , etc.
3. For NOT APPLICABLE mandatory spares for offered Model of valves , Vendors shall provide details technical explanation for not applicability.




	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 1 OF 30	

ENGINEERING SPECIFICATION

FOR

STARTUP CONTROL VALVES

SPECIFICATION NO : BM/SCV :001

Prepared by:  A. Jai Ganesh Sr Product Engineer PE / FB (BM)	Reviewed by:  V. Gunasekaran Manager PE / FB (BM)	Approved by:  K. Sridharan Sr Manager PE / FB (BM) K. SRIDHARAN General Manager Boiler Mountings / PE (FB) BHEL, TRICHY - 620 014.
--	---	--

Revision Log					Template Form Revision No.: 00			
Revision No.	Date	Reason	Prepared		Reviewed		Approved	
			Name	Sign	Name	Sign	Name	Sign.
01	19.01.13	C&I comments	A. Jai Ganesh		Gopalan. I		K. Perisamy	
02	07.03.14	Standardization	A. Jai Ganesh		K. Sridharan		K. Perisamy	
03	30.01.17	Site Feedbacks	A. Jai Ganesh		V. Gunasekaran		K. Sridharan	

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 2 OF 30	

TABLE OF CONTENTS

1.0	PURPOSE	3
2.0	SCOPE OF WORK	3
3.0	APPLICABLE CODES & STANDARDS	6
4.0	EQUIPMENT FURNISHED BY SUPPLIER	7
5.0	TERMINAL POINTS	9
6.0	FACILITY SITE SPECIFIC DATA.....	9
7.0	DRAWINGS AND DATA BY SUPPLIER.....	10
8.0	PERFORMANCE DATA & TECHNICAL REQUIREMENTS	12
9.0	DESIGN AND CONSTRUCTION	13
10.0	SUPPLIER'S DATA SHEETS (TO BE SUBMITTED WITH THE BID)	24
11.0	EXCEPTIONS TO THE SPECIFICATION	25
12.0	APPENDIX A, CONTRACT SPECIFIC REQUIREMENTS	25

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 3 OF 30	

1.0 PURPOSE

- 1.1 This Specification defines the minimum, acceptable requirements for the design and performance of one pair of BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and one BOILER MINIMUM ECONOMIZER FLOW CONTROL VALVE (MEFCV VALVE) for a coal fired, supercritical, steam generating unit.

2.0 SCOPE OF WORK

- 2.1 Supplier shall provide equipment and components in accordance with the approved suppliers listed in this specification, unless otherwise approved by BHEL. Equipment or components not listed shall be Supplier's standard.
- 2.2 For skid mounted assemblies, all instrumentation and control wiring connections by BHEL to Supplier's equipment shall be external to the equipment on numbered terminal strips in junction boxes or electrical panels.
- 2.3 All piping furnished by the Supplier shall be provided in ISO standard sizes in nominal Metric units (DN sizes). All weld end preparations, socket weld couplings, threaded connections, flange sizes and ratings, at BHEL/Supplier terminal points shall comply with ISO standards in Metric units and also as per the data sheet.
- 2.4 Nozzles shall be prepared for connection with BHEL piping as follows:
- Welded connections 50 NB and smaller shall be socket weld couplings in accordance with the requirements of ASME B16.11.
 - Welded connections 65NB and above shall be butt weld connections. Butt weld ends shall be beveled for welding in accordance with the requirements of BHEL.
- 2.5 All flanged connections shall be supplied in accordance with the requirements of ASME B16.5.
- 2.6 All materials shall be new and in accordance with applicable ASTM specifications or with other recognized standards such as SAE. No peening, caulking or filling shall be permitted in repairing cracks, pin-holes or blow-holes. Defects in fabricated steel shall be repaired by chipping out welds to bottom of vee and rewelding.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 4 OF 30	

- 2.7 The use of asbestos or material containing asbestos shall not be permitted. The use of mercury or material containing mercury shall not be permitted. All nonmetallic materials shall be noted to BHEL for approval.
- 2.8 The equipment and materials specified are intended to be the minimum suitable for the intended service. They are not intended to limit the Supplier's responsibility for proper design and selection of equipment. It is the Supplier's responsibility to bid a complete system for the intended service and the specification is only for general guidelines. Any changes in proposed equipment or materials during design shall be approved by BHEL.
- 2.9 All quotations and attachments submitted to BHEL shall be in the English language.
- 2.10 All quotations and inquiries to BHEL shall be routed through Purchasing.
- 2.11 Parts subject to wear, corrosion, deterioration or requiring adjustment, inspection or repair shall be accessible and capable of reasonably convenient removal, replacement and repair.
- 2.12 The Supplier shall complete and submit the Supplier Data Sheets and guarantees located in Section 10.0 of this specification with the equipment offered in full conformance with the specification. The Supplier shall provide a complete written description of all omissions or exceptions to the requirements of this specification. This written description must be included in Section 11.0 EXCEPTIONS TO THE SPECIFICATION of this specification. Without the complete data sheets and the EXCEPTIONS TO THE SPECIFICATION sheets, the proposal will not be evaluated.
- 2.13 Optional equipment shall be priced separately.
- 2.14 The Supplier shall be governed by the following regulations, codes, and standards, including their latest respective addenda, amendments, and errata.

AFBMA	Antifriction Bearing Manufacturers' Association
AGMA	American Gear Manufacturers' Association
AHI	American Hydraulic Institute
AISI	American Iron and Steel Institute
ANSI	American National Standards Institute
API	American Petroleum Institute



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 5 OF 30

ASME	American Society Mechanical Engineers
ASTM	American Society Testing and Materials
AWS	American Welding Society
EIA	Electronics Industries Association
FCI	Fluid Controls Institute, Inc.
IEC	International Electro technical Commission
IEEE	Institute of Electrical and Electronics Engineers
IPCEA	International Power Cable Engineers Association
ISA	Instrumentation Society of America
MSS	Manufacturers Standardization Society of the Valve & Fittings Industry
NEMA	National Electrical Manufacturers' Association
NEC	National Electrical Code
NFPA	National Fire Protection Association
OSHA	Occupational Safety Health Act
PFI	Pipe Fitting Institute
SAMA	Scientific Apparatus Makers Association
SSPC	Steel Structures Painting Council
UL	Underwriter's Laboratories

In addition to the codes and standards specifically mentioned above for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India as well as of the locality where they will be installed, including the following:

- Bureau of Indian Standards (BIS)
- Indian Electricity Act
- Indian Electricity Rules
- Indian Explosives Act
- Indian Factories Act and State Factories Act
- Indian Boiler Regulations (IBR)
- Rules for Electrical installation by Tariff Advisory Committee (TAC).
- Any other statutory codes / standards / regulations, as may be applicable.

Unless covered otherwise by Indian codes & standards and in case nothing to the contrary is specifically mentioned elsewhere in the specifications, the latest editions of the following codes and standards shall also apply:

- American Petroleum Institute (API)
- International Organization for Standardization (ISO)
- Tubular Exchanger Manufacturer's Association (TEMA)
- American Welding Society (AWS)
- Expansion Joint Manufacturers Association (EJMA)
- Heat Exchange Institute (HEI)
- Standards of the Hydraulic Institute, U.S.A.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 6 OF 30	

Other International/ National standards such as DIN, VDI, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the Employer's approval, for which the Supplier shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases the Supplier shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word for word translation of the standard that is normally not published in English.

3.0 APPLICABLE CODES & STANDARDS

- 3.1 The valves shall comply with the applicable requirements of the latest edition of ASME B31.1, Power Piping Code.
- 3.2 Valve design in accordance with ASME B16.34.
- 3.3 The valve sizing shall be in compliance with latest edition of ISA S75.01 Hand book on Control Valves considering measures to avoid choked flow.
- 3.4 All pressure retaining parts of the valve shall be made of materials, including specific limitations on various materials, that are in full compliance with PG.-5 of ASME Code Section 1.
- 3.5 Materials
 - 3.5.1 Only materials listed and rated in B16.34 are acceptable and materials offered shall be appropriate to the design conditions listed.
- 3.6 For valves of other than US standards, the Supplier shall specify (at the time of quotation) the Codes and Standards which will be used through the manufacturing and design processes. The Codes and Standards as specified will be subject to approval by **BHEL**.
- 3.7 Reference to the above Codes and Standards shall mean the latest revision, edition and addenda effective at the date of order unless specifically stated otherwise in this specification.
- 3.8 All welders and all welding procedures welders utilized shall be qualified in accordance with ASME Section IX. When welders and welding procedures are qualified in accordance with codes other than those specified, the Supplier must take exception at the time of quotation.



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 7 OF 30

3.9 All materials shall be readily identifiable. Mill test reports shall be obtained for all pressure boundary parts. These test reports shall be available for review at the Vendor's shops. Copies of these are to be supplied to the Company, if requested, prior to ordering.

3.10 Valve Revisions

3.10.1 Supplier Changes

3.10.1.1 Supplier shall fabricate the valves based on the drawings approved by BHEL.

3.10.2 If the valve design requires modification due to Supplier error during the Supplier tests or QA inspection, the Supplier will correct the design and reflect these changes in the AS-BUILT revision of the drawings.

4.0 EQUIPMENT FURNISHED BY SUPPLIER

4.1 Two (2) BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) complete with hydraulic actuator and associated positioning controls as per this specification.

4.2 One (1) BOILER MINIMUM ECONOMIZER FLOW CONTROL VALVE (MEFCV) complete with hydraulic actuator and associated positioning controls as per this specification.

4.3 One (1) Common Hydraulic Unit and Electronic Control Unit for the positioning control of the two BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV) as per this specification.

4.4 Optional Equipment

4.4.1 The following equipment shall be proposed as an option.

- ☒ One (1) stainless steel tubing and fittings to connect all necessary hydraulic lines between the common SUPPLIER supplied Common Hydraulic Unit and the three SUPPLIER

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 8 OF 30	

supplied BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV) hydraulic actuators. Each Valve location from the common hydraulic unit shall be referred from the project specific data sheet (Annexure I).

- a) HWL1 to Hydraulic Unit - refer Annexure I
- b) HWL2 to Hydraulic Unit - refer Annexure I
- c) MEFCV to Hydraulic Unit - refer Annexure I

☒ Two (2) fills of hydraulic fluid, first for start up and second for hydraulic fluid change prior to operation.

☒ One (1) lot of special tools required for maintenance of system components. Supplier shall furnish all special tools and wrenches required for erection, calibration, servicing including instructions for their use. Tools shall be new. Tools shall be shipped to the project site in a suitable, separate container, clearly marked with the name of the equipment for which they are intended.

Following special tools are must.

- a) Flushing kit for valves.
- b) Flushing kit for Hydraulic system including the flushing device. Flushing filter, Flushing Filter elements, hose pipes & valves to be supplied as spares along with the flushing kit.
- c) N2 filling kit – Used for charging of accumulators with N2 as well as pressure checking and adjustment

☒ One (1) lot of commissioning spares for each valve per SUPPLIER'S specific recommendation.

☒ ~~One (1) lot of recommended spares for each valve per SUPPLIER'S specific recommendation for One(1) year warranty period of operation (Dealt By Spares Group)~~

☒ ~~One (1) lot of recommended spares per SUPPLIER's specific recommendation for Three (3) years of operation after final acceptance (Dealt By Spares Group)~~

☐ ~~Two (2) Two (2) BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) complete with hydraulic actuator and associated positioning controls per this specification in an angle valve body configuration in place of "Z" valve body.~~

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 9 OF 30	

- ☐ ~~One (1) BOILER MINIMUM ECONOMIZER FLOW CONTROL VALVE (MEFCV) with Hydraulic actuator utilizing the Common Hydraulic Unit in place of Electric Actuator.~~

5.0 TERMINAL POINTS

- 5.1 At all valve inlets and outlets.
- 5.2 At the terminal junction boxes on each supplied valve, the terminals in the hydraulic power unit, and the terminals in the control cabinet.

6.0 FACILITY SITE SPECIFIC DATA

Please refer to attached specifications Annexure-II for Facility Site Specific Data (if applicable) and Annexure-III for Surface Preparations and Coatings requirements(if applicable).

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 10 OF 30	

7.0 DRAWINGS AND DATA BY SUPPLIER

7.1 All drawings, calculations, specifications, bills of materials and other data submitted shall be in Metric units. Dual Dimensions are acceptable with Metric (primary) and English (in parenthesis). Metric units shall comply with the International SI System.

7.1.1 The following units are to be used:

- Temperature °C
- Pressure Kg / cm ² (g)
- Dimensions mm
- Flow kg/sec

7.2 Submitted With Quotation

- The Supplier shall provide dimensional outline drawings of the assembled unit(s). The drawings shall show overall dimensions, terminal box dimensions, mounting connections, clearances required for proper installation and maintenance shall state lifting requirements, and the weights of all major components.
- List of commissioning spares.
- List of special tools and equipment as required for assembling, complete dismantling, and maintenance of all equipment supplied,
- Performance data and curves.
- Completed Supplier Data Sheets per Section 10.0
- Any special requirements or operational limits shall be explicitly stated in each quotation.
- Field testing requirements.
- Actuator sizing calculations
- Terminal box wiring diagram
- Integrated Manufacturing and Quality Plan for BHEL's review
- Certificates as per QR and PTR requirements (applicable to Non-PMD vendor).
- Manual Cv calculation ,valve outlet velocity , noise level calculation.
- GA drawing and circuit diagram of Common Hydraulic control Unit.

7.3 Descriptions of Equipment

- A written description of the equipment being offered shall be provided with the Bid. This information shall explain details of the design, construction, control, operation and performance.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 11 OF 30	

- Consumable list including, compressed air, instrument air and electrical requirements indicating frequency of usage; intermittent or continuous.
- Experience List for valves in similar service including size, service, flow rate, pressure, temperature, and date placed in operation.

7.4 Submitted During Contract

- Detailed arrangement drawings of the assembled units including support details, flange connections, etc. All materials shall be readily identifiable on Supplier's drawings.
- Electrical wiring diagrams and connection details
- Instrument list
- Instrument data sheet(s) (ISA format or equal)
- Valve flow characteristic curve
- List of shop tests that will be conducted on the furnished equipment
- Complete set(s) of instruction, operation, maintenance, and erection manuals, quantities will be identified in the purchase order
- List of shop applied paints and protective finishes identifying compatible site applied coatings
- List of all lubricants required for the equipment operation identifying preferred acceptable substitutes
- Certification sheet for each valve containing the following information:
 - ✓ Manufacturer's Name
 - ✓ Manufacturer's serial number on the valve body
 - ✓ Flow direction arrow on the valve body
 - ✓ ASME material specification used for pressure parts including valve body and other pressure retaining parts
 - ✓ Maximum allowable pressure (design pressure), Kg / cm² (g) @ degrees C
 - ✓ Hydrostatic shell test pressure, Kg / cm² (g). Additional certification for valves manufactured to B16.34 Special Class.
 - ✓ Welding Certification: All welding on the valve has been performed using procedures and welders qualified in accordance with ASME Code Section IX.
 - ✓ Radiographs: Radiographic examination has been performed as required by ASME B16.34. One set

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 12 OF 30	

of the completed radiographs, properly identified with the respective parts, will be retained and available for inspection for a period of five (5) years.

- ✓ IBR from III C.
- ✓ Surface examination of all castings performed by magnetic particle or liquid penetrant methods to the technique and acceptance standards of ASME B16.34.
- ✓ One (1) copy of each material manufacturer's certification.
- ✓ Authorized and dated signature certifying the above information to be complete and correct.
- ✓ Operation and Maintenance Manual describing the operation of the entire system shall be supplied (both hard copies and soft copies).

8.0 PERFORMANCE DATA & TECHNICAL REQUIREMENTS

8.1 Component Design Criteria

8.1.1 Function

8.1.1.1 Separator Level Control (HWL-1 & HWL-2) Valves:

8.1.1.1.1 The separator level control valves (HWL-1 & HWL-2) are used to control the water level in the water separator during "wet" mode operation of a supercritical boiler. As the level exceeds the set point first one, then the second valve will open. The valves will throttle saturated water from boiler at high pressure to a flash tank at atmospheric pressure. The water will be flashing to steam as it exits the valves.

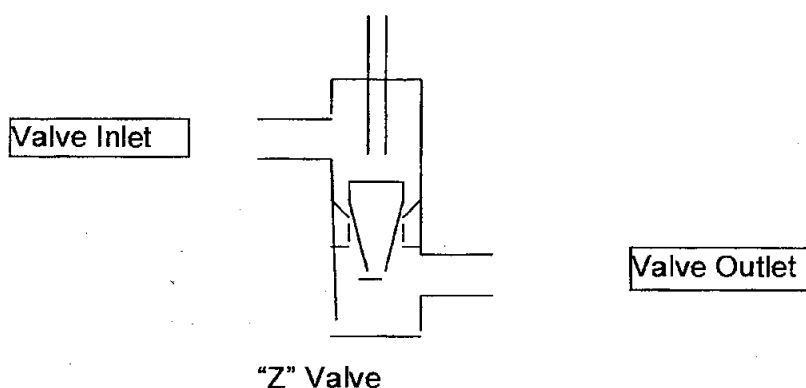
8.1.1.2 Minimum Economizer Flow Control (MEFCV) Valve:

8.1.1.2.1 The Minimum Economizer Flow control valve (MEFCV) is used to control the economizer inlet flow during start-up and low load operation. Demand for this valve is established based on measured economizer inlet flow compared to a minimum boiler flow requirement.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 13 OF 30	

9.0 DESIGN AND CONSTRUCTION

- 9.1 In general, all valves and associated accessories shall meet the applicable requirements of accepted standards and attached customer specifications.
- 9.2 Design of the valves shall meet the latest edition of ASME B16.34.
- 9.3 The valve sizing shall be in compliance with latest edition of ISA S75.01 Hand book on Control Valves considering measures to avoid choked flow.
- 9.4 The valve sizing shall be suitable for obtaining maximum flow conditions with valve opening at approximately 80% of total valve stem travel and minimum flow conditions with valve stem travel not less than 10% of total valve stem travel. All the Control Valves shall be capable of handling at least 120% of the required maximum flow. Further the valve stem travel range from minimum flow condition to maximum flow condition shall not be less than 50% of the total valve stem travel.
- 9.5 The control valve size should not be smaller than connecting line size by more than 1 step.
- 9.6 Valves shall be straight through in "Z" valve configuration. "Z" configuration has parallel inlet and outlet nozzles in two different horizontal planes.



	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 14 OF 30	

- 9.7 Valve shall be forged design.
- 9.8 Plug shall be one-piece construction either cast, forged, or machined from solid bar stock. Plugs shall be screwed and pinned to valve stems or shall be integral with the valve stems.
- 9.9 All control valves shall have stems, guide bushings, plugs, seat rings, stem lock pins, stuffing box parts and other trim parts made of stainless steel alloys and suitably hardened. Valve guide posts and bushings shall be stellite faced. Stellite faced guide posts and bushings shall be differential hardened for applications involving high pressure drop as well as for flashing and cavitation applications. **Trim material shall be 17-4 PH SS / 440C depending upon the service conditions to ensure required degree of hard facing so as to avoid erosion. However, Bidder may offer valves with body and trim materials better than specified and in such cases, Bidder shall furnish the comparison of properties including cavitation resistance, hardness, tensile strength, strain energy, corrosion resistance and erosion resistance etc. of the offered material vis-a-vis the specified material for Owner's consideration and approval..**
- 9.10 The valve model proposed should be designed to prevent cavitation, wire drawing and flashing on the downstream side of the valve and piping for operation throughout the full range under the specified conditions. For cavitation service, the trim design shall be of multistage pressure drop type to prevent cavitation occurring downstream of trim / valve.
- 9.11 Bidder shall furnish in his proposal detailed calculations to establish whether cavitation will occur or not under any operating condition for a particular application. These calculations shall be subject to Owner's review and approval and in case it is established at any stage of the contract that cavitation will occur, the Bidder shall provide anti-cavitation trim for the same at no extra price. Further the Bidder shall furnish in his proposal the detailed write up, technical literature, etc. clearly indicating as to how the occurrence of cavitation shall be prevented by the design of his offered anti-cavitation trim.
- 9.12 Bidder to furnish calculation to check whether flashing or cavitation will occur for control valve services. Control Valves shall be provided with specially designed trims (such as cage guiding valves with holes in the cage to control the location of the Vena Contracts) which are suitable for

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 15 OF 30	

withstanding high pressure drops and which minimize the adverse effects of flashing on Control Valve parts.

- 9.13 Valve sizing shall be in accordance with the latest edition of ISA Handbook on Control Valves with due consideration for the measures to avoid choked flow. Bidder shall ensure that valve outlet velocity does not exceed 8 m / sec. for liquid services, 150 m / sec. for steam services and 50% of sonic velocity for flashing services.
- 9.14 Valve outlet shall have a 5 degree downward slope to ensure proper drainage of valve outlet.
- 9.15 Valve inlet and outlet cages shall be provided if required by the indicated process conditions.
- 9.16 For valves with butt weld ends, the supplier is required to prepare weld profiles to BHEL supplied information.
- 9.17 Both the valves and their accessories shall be designed for the process and local installation environment.
- 9.18 All valves and accessories shall be suitable for outdoor service. Electrical components (actuators, limit switches, solenoid valves, positioners, controllers, etc.) shall meet the requirements of IP 65.
- 9.19 The Supplier shall provide all necessary converters, positioners, position transmitters, etc. mounted on the control valve.
- 9.20 The direction of flow shall be clearly marked on each valve.
- 9.21 Control valves, their actuators and associated ancillary equipment must be selected to suit the application, design and working conditions specified and also the environmental conditions in which they are installed. The pressure and temperature rating of valve body shall be equal or exceed the process design conditions on control valve data sheet.
- 9.22 Valves and their actuators shall be adequately rated to suit the maximum differential pressure against which they will have to work, i.e. when the valve is fully closed.
- 9.23 Valve guiding and seating systems shall be so designed that smooth control is maintained over the full operational stroke. Design should be such that it eliminates vibration.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 16 OF 30	

9.24 Valve's gland packing material shall be grafoil or graphite for all the valves.

9.25 The end for all the Control Valves shall be matched to the corresponding details for the piping on which the valve is installed. **All necessary expanders/reducers are to be supplied by the vendor to match the pipe sizes.**

9.26 The boiler water system will be acid cleaned at site using a 1 to 1.5% (by weight) inhibited hydrofluoric acid. The valve internals must be capable of withstanding hydrofluoric acid without getting damaged.

9.27 The Leakage Class of separator level control valves (HWL-1 & HWL-2) and for Minimum economizer flow control valve (MEFCV) is to be Class-V or better as per FCI 70.2.

9.28 Hydraulic Valve Actuators

9.28.1 The separator level control valves (HWL-1 & HWL-2) shall be supplied with an Hydraulic actuator capable of a quick full stroke closing time of 3 sec against closing loads. Normal full stroke opening/closing time shall be 12 sec. The Hydraulic actuator for the minimum economizer flow control valve (MEFCV) full stroke opening/closing time shall be 12 sec.

9.28.2 The Hydraulic actuator shall be sized to operate against the process maximum differential pressure.

9.28.3 A mechanical position indicator shall be provided on the actuator.

9.28.4 The actuator shall be equipped with a hydraulic positioning valve to convert a 4 –20 mADC signal from the DCS to a hydraulic signal.

9.28.5 The actuator shall be furnished with a 4 –20 mADC valve position feedback signal.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 17 OF 30	

- 9.28.6 The actuators for the HWL valves only shall be equipped with a safety quick closing system. The safety control system shall be activated by a signal (dry contact) from the DCS supplied by others. The safety control system shall be independent of other control device. The safety control system shall be capable of closing the valve with normal control system devices unavailable.

9.29 Hydraulic Unit and Electronic Control Unit (HWL-1, HWL-2 & MEFCV)

- 9.29.1 All control valves (HWL-1, HWL-2 & MEFCV) shall be supplied with a Hydraulic Unit and Electronic Control Unit. The hydraulic power unit serves to supply the necessary pressurized hydraulic fluid to the Hydraulic actuators. A common hydraulic power unit may be used for multiple Hydraulic Valve Actuators. The hydraulic power unit shall be equipped with an accumulator to maintain adequate pressure during peak operating requirements. The hydraulic pumps shall be designed for the required pressure and mean oil consumption.
- 9.29.2 The hydraulic power unit shall be equipped with redundant motor-pump units with motor starters mounted in the Electronic Control Units. Each pump set shall be equipped with the necessary charging valve, check valves, filters, pressure reducing valves, pressure relief valves, and instrumentation required for operation of the hydraulic power unit.
- 9.29.3 The hydraulic power unit shall be equipped with an oil tank sized for the entire volume of oil. A tank air breather filter shall be furnished.
- 9.29.4 The hydraulic power unit shall be equipped with an accumulator sized to deliver the oil flow at required pressure for all conditions. The accumulator shall be equipped with a pressure gauge.
- 9.29.5 The Electronic Control Unit cabinet shall be a free standing IP 65 rated with front and rear access doors to be installed outdoors. The control cabinet shall contain processors or controllers and I/O necessary for valve positioning, hydraulic



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 18 OF 30

unit control and interface between the Hydraulic Unit / Electronic Control Unit and customer supplied DCS.

- 9.29.6 In addition to the following signal exchanges, if additional signals are envisaged as per vendor's design, then the same have to be terminated in the respective terminal boxes/junction boxes.

HWL-1 Position Demand (from DCS)	4-20 mA DC
HWL-1 Valve Position feedback (to DCS)	4-20 mA DC
HWL-1 Position Failure (to DCS)	Dry Contact
HWL-1 Quick Closing (from DCS)	Dry Contact
HWL-1 Valve Opened (to DCS)	Dry Contact
HWL-1 Valve Closed (to DCS)	Dry Contact

HWL-2 Position Demand (from DCS)	4-20 mA DC
HWL-2 Valve Position feedback (to DCS)	4-20 mA DC
HWL-2 Position Failure (to DCS)	Dry Contact
HWL-2 Quick Closing (from DCS)	Dry Contact
HWL-2 Valve Opened (to DCS)	Dry Contact
HWL-2 Valve Closed (to DCS)	Dry Contact

MEFCV Position Demand (from DCS)	4-20 mA DC
MEFCV Valve Position feedback (to DCS)	4-20 mA DC
MEFCV Position Failure (to DCS)	Dry Contact
MEFCV Opened (to DCS)	Dry Contact
MEFCV Closed (to DCS)	Dry Contact

Hydraulic Power Unit On (from DCS)	Dry Contact
Hydraulic Power Unit Off (from DCS)	Dry Contact
Hydraulic Power Unit Pressure too low (to DCS)	Dry Contact
Hydraulic Power Unit Auto (to DCS)	Dry Contact
Hydraulic Power Unit Alarm (to DCS)	Dry Contact
Hydraulic Power Unit Fault (to DCS)	Dry Contact

- 9.29.7 415 V, 3 Ø, AC Power supply feeder will be provided for the hydraulic power pack. 240 V, AC Power supply feeder will be provided. It is vendor's responsibility to further distribute the same to different points and further derivation of various control supplies/power supplies.

- 9.29.8 Vendor to offer the latest version of control system/positioners with additional features.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 19 OF 30	

- 9.29.9 The offered Hydraulic Power Unit and the Control system/panels shall be suitable for outdoor applications.
- 9.29.10 All Cables (Power cables/Control Cables/Instrumentation cables) run between various equipment supplied vendor, shall be in vendor's scope. These cables shall be laid in conduits/cable trays.
- 9.29.11 All Cables (Power cables/Control Cables/Instrumentation cables) interfaced with various equipment supplied by the vendor, have to be terminated by using suitable Double compression, flame proof/weather proof, Brass with Nickel plated cable glands.
- 9.29.12 Vendor to provide suitable cable glands for all interfacing cables from/to DCS. Cable sizes will be indicated during engineering stage.
- 9.29.13 Test Certificates and Calibration Certifications shall be provided for all Instruments and Motors as applicable.

9.30 Valve Selection Criteria

- 9.30.1 The control valves, actuators and actuator hydraulic systems shall be sized based on the valve data sheets. These data sheets shall be filled in and submitted with the bid and with the first submittal of valve drawings.
- 9.30.2 The Supplier shall meet all process conditions shown on the data sheet or shall notify BHEL of any deviations. All deviations must be approved by BHEL before manufacture of the valve.
- 9.30.3 The Supplier shall guarantee total sound levels on Supplier furnished equipment shall not exceed 85 dB(A). Sound pressure level at all conditions shall not be greater than 85 dBA when measured at 1.0 meter downstream of the valve and 1.0 meter away from the pipe. The noise abatement shall be obtained by valve body, trim design and piping arrangement and not by the use of silencers.
- 9.30.4 The bidder has to submit calculated noise levels (dBA) for the operating conditions specified in the datasheet.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 20 OF 30	

9.31 Test and Examinations

9.32.1 All valves shall be tested in accordance with the quality assurance program agreed between the Owner and the Contractor, which shall meet the requirements of IBR and other applicable codes. The BHEL Approved Quality Plan is to be followed. The tests shall include but not limited to the following bidder shall submit a manufacturing quality plan along with the offer for BHEL / QA review and approval.

- 1) Material, mechanical and chemical test shall be performed in a manner as specified in the relevant codes.
- 2) Non-destructive examination shall be performed as per ASME-B-16.34 (Steel Valves).
- 3) 100% radio graphic test on casings of all valves having rating of 600 lbs or above; magnetic particles / dye penetrant examination on all internal and external machined surfaces and 100% ultra sonic testing of forgings and bars (of size 40 mm and above) of all valves with rating of 600 lbs or above shall be performed as per ASME B16.34.
- 4) The material test certificates (correlated to melt number) shall be furnished by the vendor for identification and correlation.
- 5) The butt-welding end of all valves, dye-penetrant test as per ASTM E165 shall be carried out on 100% of the valves and the result shall show no defects.
- 6) 100% MPI shall be done on base/body casing with pressure rating 1500 class and above in line with ASME B16.34.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 21 OF 30	

7) Hydrostatic Test

Valves shall be subjected to hydrostatic shell test in accordance with ASME-B16.34 prior to seat leakage test. If the valves are reworked on the pressure parts for any reason after hydrostatic test, they must be retested. Valves shall be hydrostatically tested in Manufacturer's Works in accordance with code requirements. All hydrostatic testing and inspection shall be completed before any paint is applied to valve body. Certificates of inspection shall be executed in accordance with the latest codes and required codes shall be forwarded to the Engineer. All gaskets used for test shall be of the same material and design as specified for the finished product. Where mechanical gasket joints are broken following tests, new gaskets shall be furnished with the equipment, and the joints shall be retested.

8) Leakage Test

Valve closure test and seat leakage tests shall be performed in accordance with ASME -B16.34 and as per applicable Leakage Class. The leakage from packing shall be zero or bubble tight.

9) Functional Tests

The fully assembled or completed valves including the actuators control devices and accessories shall be functionally tested to demonstrate the operability and response time of the valve and the actuator. This may be done by cycling the valves 3 or 4 times from open to close position. The same controller can be used to test each valve. These tests shall also include the verification of control valve operation features such as stay put operation, fail to open, fail to close on signal failure etc. in line with the specification requirements.

10) Cv Test (If applicable)

Cv test shall be carried out as type test on each size type and design of the valves as per ISA-75.02 standard and the test reports, shall be furnished for Owner's approval.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 22 OF 30	

9.32 Additional requirements

1. Machined surfaces shall be suitably protected.
2. Valve ends shall be protected by means of metallic covers/polythene caps/rubber and protectors to prevent damage to ends & also to avoid foreign material entering the valve while shipment & storage.
3. All valves shall be packed suitably in wooden cases in order to avoid damage during transit and also during storage at site.
4. Valve tag nos. shall also be incorporated in all the dispatch documents.
5. All unpainted surfaces shall be protected with a rust preventive, which can be removed by solvent washing. The use of grease or oil other than light grade mineral oil for corrosion protection is prohibited.
6. Paint specifications are to be submitted for purchaser's review with bid.
7. All exposed machined surfaces shall be coated with suitable rust preventative coating prior to shipment.(two coats of primer of thickness 35 microns)
8. The seller shall adequately crate, block, anchor and protect equipment as required to prevent damage during overseas shipment and outdoor storage for a period of one (1) year at the site.
9. All threaded connections, bores shall be plugged or capped with standard pipe plugs or caps.
10. List of commissioning spares shall be quoted if applicable.
11. List of recommended spares for 5 years trouble free operation of valves shall be quoted.
12. Recommended list of special tools and equipment (required for assembling, complete dismantling and maintenance of all equipment supplied) to be provided and also to be supplied along with valve.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 23 OF 30	

13. One spare filter element each to be supplied for the SS filter provided in the Hydraulic Control Unit.
14. Drain valve for the oil tank, vent air breather, and isolation lines in the oil supply lines are to be necessarily provided.
15. Mechanical oil level indicator has to be extended through full height of the tank. (0 % to 100 %)
16. Man hole to be provided in the Oil tank in order to provide means to access the internals of the oil tank and for maintenance.
17. Oil tank internals surface should not be painted.
18. Vendor to provide isolation valves in the pressure and return lines (oil lines) to carry out maintenance activities in the oil line and also in the fail safe manifold & control manifold.
19. Vendor to supply welding type socket fittings in the entire hydraulic pipes joint.
20. Vendor to provide a provision to indicate the accumulator pressure in local as well as in remote.
21. Hydraulic fluid /oil cooler is to be provided.

9.33

The vendors to quote for ERECTION & COMMISSIONING SUPPORT (optional)for Supervision of erection and commissioning of this valves , the seller should depute one commissioning engineer to the site and he shall stay there for a maximum of 7 days (for each unit ie per customer number) extending full support to site people in the initial operation of the valves .All the expenses like to & fro charges, incidentals, boarding & lodging at site are to be borne by the valve vendor

The Vendors to submit an Optional price for providing training to our personnel at the works of Valve manufacturer for 2 man month period .

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 24 OF 30	

Our personnel will make their own Travel / Lodging / Boarding arrangements . Depending upon the actual duration of training man months availed, the payment will be proportionately reduced on the vendor quoted amount (if period is lesser than 2 man months).

9.34 Evaluations

9.34.1 Bids will be analyzed, not only to determine conformity to the requirements of this Specification, but also to evaluate any features of design, construction, and guaranteed performance of the equipment offered which would result in a higher or lower capital, operating, or maintenance cost to BHEL.

9.34.2 Nothing in this specification shall be construed to relieve the vendor from his responsibility. This specification covers briefly the requirements of the system. It is the responsibility of the vendor to take care of other basic and essential requirements. In case of any discrepancy in the contents expressed in the specification, vendor shall include all items required for completeness of the system even if it is not specified explicitly in this specification.

10.0 SUPPLIER'S DATA SHEETS (TO BE SUBMITTED WITH THE BID)

10.1 Valve Data Sheets

10.1.1 All data to be in Metric units. The Supplier shall fill in the valve data sheets for each valve. The operating conditions furnished for MEFCV is preliminary only. Final operating conditions can be informed only after the boiler recirculation pump operating conditions are finalized, which can happen even after the placement of this PO. This may/may not affect the selected Cv for MEFCV. The vendor to accommodate these changes in the operating conditions and offer the valve which meets all the specification requirements without any price implication to BHEL.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 25 OF 30	

10.2 Guarantees

CUSTOMER NAME	
PROPOSAL NUMBER	
SUPPLIER NAME	

The Supplier shall clearly state at the time of quotation all performance guarantees specific to the equipment offered.

11.0 EXCEPTIONS TO THE SPECIFICATION

CUSTOMER NAME	
PROPOSAL NUMBER	
SUPPLIER NAME	

I have confirmed to Sections 1.0 through 10.0 and Appendix A except as specifically noted as follows:

12.0 APPENDIX A, CONTRACT SPECIFIC REQUIREMENTS

Please refer the attached, Annexure I - Valve Datasheets and project specific data sheets.

SPECIFICATION FOR STARTUP CONTROL VALVES

0 	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: SCV_MAIN SPEC	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 00	DATE: -01.02.17
		PAGE NO : 27 OF 30	

ACTUATOR SIZING PRESSURE : 298.1 kg/cm² (g)
 BODY DESIGN: PRESSURE / TEMPERATURE : 298.1 kg/cm² (g) / 375°C
 TEST PRESSURE : 2 x Design Pressure

IBR FORM - III C : REQUIRED

TOTAL WEIGHT (VALVE+ACTUATOR+ACCESSORIES) : Kgs.

Valves should be directly weld able to connecting pipe without the use of Reducers. ONLY GLOBE "Z" VALVES ACCEPTABLE.

PART - A (TO BE FILLED UP BY PURCHASER)			PART - B (TO BE FILLED UP BY BIDDER)	
ACCESSORIES	ELECTRO HYDRAULIC POSITIONER POSITION LIMIT SWITCH POSITION TRANSMITTER SOLENOID VALVE E/H CONVERTER JUNCTION BOX HAND PUMP LOCAL POSITION INDICATOR HYDRAULIC POWER UNIT (COMMON FOR HWL AND MEFCV) ELECTRONIC CONTROL UNIT (COMMON FOR HWL AND MEFCV)	REQUIRED REQUIRED REQUIRED NOT REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED		
ELECTRO HYDRAULIC POSITIONER	MANUFACTURER & MODEL No. ENCLOSURE CLASS INPUT SIGNAL OUTPUT SIGNAL INCREASE IN SIGNAL	IP-65 4 - 20 mA TO SUIT ACTUATOR TO OPEN / TO CLOSE		
LIMIT SWITCH	MANUFACTURER & MODEL No. OPEN: INT: CLOSE CONTACT TYPE RATING (AC/DC) ENCLOSURE CLASS	1 No. FOR OPEN & 1 No. FOR CLOSE DPDT 2 NO + 2 NC 5A 240V, AC and 0.2A, 220V, DC IP65 / NEMA 4		
POSITION TRANSMITTER	MANUFACTURER & MODEL No. TYPE SUPPLY OUTPUT RATING ACCURACY ENCLOSURE CLASS	LVDT 2 WIRE TYPE 24V DC 4 - 20 mA / 0-100 Ohms +/- 1% FS IP65 / NEMA 4		
HAND PUMP	ORIENTATION	SIDE MOUNTED		
JUNCTION BOX	No. OF WAYS SIZE CABLE GLANDS: (SIZE / QNTY) ENCLOSURE CLASS	THIRTY SIX REQUIRED REQUIRED IP65 / NEMA 4		
E/H CONVERTER	INPUT SIGNAL : POWER SUPPLY SPLIT RANGE ENCLOSURE CLASS	4 - 20mA, DC / 24V, DC YES / NO // YES / NO IP65 / NEMA 4		
SIGN.: NAME: DATE:	PREPARED BY P. RAVIRAJA 01/02/17	CHECKED BY K. JAI GANESH 01/02/17	APPROVED BY K. SRIVIDHARAN 01/02/17	VENDOR SEAL SIGN.: NAME: DATE:

K. SRIVIDHARAN
 Dy. General Manager
 Boiler Mountings (PE & FB)
 BHEL, TRIPURA
 721 004



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: SCV_MAIN SPEC

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 00

DATE: -01.02.17

PAGE NO : 28 OF 30

Customer No: 1816

Tag Nos.: HAG 31AA301

Qty.: 1 Nos. / BOILER

MINIMUM ECONOMISER FLOW CONTROL VALVE DATA SHEET

PART – A
(TO BE FILLED UP BY PURCHASER)

PART - B
(TO BE FILLED UP BY
BIDDER)

GENERAL	PROJECT SERVICE LOCATION DUTY PIPE SIZE (inlet / outlet) PIPE MATERIAL (inlet / outlet) MEDIUM	KRISHNAPATNAM-3 (1X800 MW) MEFCV OUTDOOR MODULATING D 323.90x45/ D 323.90x45 SA106 Gr.C/ SA106 Gr.C FEED WATER	
BODY	MODEL No. TYPE OF BODY : GUIDING : No. OF PORTS BODY SIZE: PORT SIZE: DESIGN CV BODY RATING (ASME) END CONNECTION & RATING (ASME) BODY MATERIAL PACKING MATERIAL BONNET TYPE TRIM FORM TRIM MATERIAL: SEAT / PLUG : CAGE / STEM BALANCED / UNBALANCED FLOW VALVE OUTLET VELOCITY REQUIRED LEAKAGE CLASS NOISE LEVEL (dBA) VALVE LIFT mm ANTICAVITATION TRIM	"Z" BUTT WELDED; STYLE-P, d1 = 245.15mm SA105 GRAFOIL FLOW TO CLOSE < 8 m/s V OR BETTER LESS THAN 85 dBA	
ELECTRO HYDRAULIC ACTUATOR	MODEL No. & SIZE CLOSE AT: OPEN AT (Kg/cm ² (g)) SHUT OFF DIFFERENTIAL STEM OREINTATION MANUAL OVERRIDE TRAVEL TIME FOR OPEN TO CLOSE, CLOSE TO OPEN, TRIP VALVE POSN. ON SIGNAL (4-20mA) FAILURE VALVE POSN. ON SUPPLY FAILURE	YES ≤12 Secs / ≤12 Secs / ≤3 secs STAYPUT STAYPUT	
PERFORMANCE OF VALVE	LINEARITY HYSTERISIS SENSITIVITY ACCURACY (OVERALL)	± 2% ± 1% ± 0.5% ± 2%	

SERVICE CONDITIONS

[illegible]

0	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: SCV_MAIN SPEC	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 00	DATE: -01.02.17
		PAGE NO : 29 OF 30	

ACTUATOR SIZING PRESSURE : 323.5 kg/cm² (g)
 BODY DESIGN: PRESSURE / TEMPERATURE : 323.5 kg/cm² (g) / 348°C
 TEST PRESSURE : 2 x Design Pressure

IBR FORM – III C : REQUIRED

TOTAL WEIGHT (VALVE+ACTUATOR+ACCESSORIES) : Kgs.

Valves should be directly weldable to connecting pipe without the use of Reducers. ONLY GLOBE "Z" VALVES ACCEPTABLE.

PART – A (TO BE FILLED UP BY PURCHASER)			PART – B (TO BE FILLED UP BY BIDDER)	
ACCESSORIES	ELECTRO HYDRAULIC POSITIONER POSITION LIMIT SWITCH POSITION TRANSMITTER SOLENOID VALVE E/H CONVERTER JUNCTION BOX HAND WHEEL (SIDE MOUNTED) LOCAL POSITION INDICATOR HYDRAULIC POWER UNIT(COMMON FOR HWL AND MEFCV) ELECTRONIC CONTROL UNIT (COMMON FOR HWL AND MEFCV)	REQUIRED REQUIRED REQUIRED NOT REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED		
ELECTRO HYDRAULIC POSITIONER	MANUFACTURER & MODEL No. ENCLOSURE CLASS INPUT SIGNAL OUTPUT SIGNAL INCREASE IN SIGNAL	IP-65 4 - 20 mA TO SUIT ACTUATOR TO OPEN / TO CLOSE		
LIMIT SWITCH	MANUFACTURER & MODEL No. OPEN: INT: CLOSE CONTACT TYPE RATING (AC/DC) ENCLOSURE CLASS	1 No. FOR OPEN & 1 No. FOR CLOSE DPDT 2 NO + 2 NC 5A 240V, AC and 0.2A, 220V, DC IP65 / NEMA 4		
POSITION TRANSMITTER	MANUFACTURER & MODEL No. TYPE SUPPLY OUTPUT RATING ACCURACY ENCLOSURE CLASS	LVDT 2 WIRE TYPE 24V DC 4 – 20 mA / 0-100 Ohms +/- 1% FS IP65 / NEMA 4		
HANDWHEEL	ORIENTATION	SIDE MOUNTED		
JUNCTION BOX	No. OF WAYS SIZE CABLE GLANDS: (SIZE / QNTY) ENCLOSURE CLASS	THIRTY SIX REQUIRED REQUIRED IP65 / NEMA 4		
E/H CONVERTER	INPUT SIGNAL : POWER SUPPLY SPLIT RANGE ENCLOSURE CLASS	4 – 20mA, DC / 24V, DC YES / NO // YES / NO IP65 / NEMA 4		
SIGN.: NAME: DATE:	PREPARED BY P. RAVIRAJA 	CHECKED BY A. JAI GANESH 	APPROVED BY K. SRIDHARAN General Manager	VENDOR SEAL SIGN.: NAME: DATE:

Boiler Mountings/PE (FB)
 BHEL, TISCO - 751 004

0 	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: SCV_MAIN SPEC	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 00	DATE: -01.02.17
		PAGE NO : 30 OF 30	

Project Specific Data :

One (1) stainless steel tubing and fittings to connect all necessary hydraulic line between the common SUPPLIER supplied Common Hydraulic Unit and the three SUPPLIER supplied BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV) hydraulic actuators. Each Valve location from the common hydraulic unit is as follows.

- a) HWL1 to Hydraulic Unit - 50 in m.
- b) HWL2 to Hydraulic Unit - 50 in m.
- c) MEFCV to Hydraulic Unit - 60 in m.




	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 1 OF 30	

ENGINEERING SPECIFICATION

FOR

STARTUP CONTROL VALVES

SPECIFICATION NO : BM/SCV :001

Prepared by:  A. Jai Ganesh Sr Product Engineer PE / FB (BM)	Reviewed by:  V. Gunasekaran Manager PE / FB (BM)	Approved by:  K. Sridharan K. SRIDHARAN Sr Manager Dy. General Manager Boiler Mountings / PE (FB) BH&EL, TRICHY - 620 014.
--	---	---

Revision Log					Template Form Revision No.: 00			
Revision No.	Date	Reason	Prepared		Reviewed		Approved	
			Name	Sign	Name	Sign	Name	Sign.
01	19.01.13	C&I comments	A. Jai Ganesh		Gopalan. I		K. Perisamy	
02	07.03.14	Standardization	A. Jai Ganesh		K. Sridharan		K. Perisamy	
03	30.01.17	Site Feedbacks	A. Jai Ganesh		V. Gunasekaran		K. Sridharan	

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 2 OF 30	

TABLE OF CONTENTS

1.0	PURPOSE	3
2.0	SCOPE OF WORK	3
3.0	APPLICABLE CODES & STANDARDS	6
4.0	EQUIPMENT FURNISHED BY SUPPLIER	7
5.0	TERMINAL POINTS	9
6.0	FACILITY SITE SPECIFIC DATA.....	9
7.0	DRAWINGS AND DATA BY SUPPLIER.....	10
8.0	PERFORMANCE DATA & TECHNICAL REQUIREMENTS	12
9.0	DESIGN AND CONSTRUCTION.....	13
10.0	SUPPLIER'S DATA SHEETS (TO BE SUBMITTED WITH THE BID)	24
11.0	EXCEPTIONS TO THE SPECIFICATION	25
12.0	APPENDIX A, CONTRACT SPECIFIC REQUIREMENTS	25

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 3 OF 30	

1.0 PURPOSE

- 1.1 This Specification defines the minimum, acceptable requirements for the design and performance of one pair of BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and one BOILER MINIMUM ECONOMIZER FLOW CONTROL VALVE (MEFCV VALVE) for a coal fired, supercritical, steam generating unit.

2.0 SCOPE OF WORK

- 2.1 Supplier shall provide equipment and components in accordance with the approved suppliers listed in this specification, unless otherwise approved by BHEL. Equipment or components not listed shall be Supplier's standard.
- 2.2 For skid mounted assemblies, all instrumentation and control wiring connections by BHEL to Supplier's equipment shall be external to the equipment on numbered terminal strips in junction boxes or electrical panels.
- 2.3 All piping furnished by the Supplier shall be provided in ISO standard sizes in nominal Metric units (DN sizes). All weld end preparations, socket weld couplings, threaded connections, flange sizes and ratings, at BHEL/Supplier terminal points shall comply with ISO standards in Metric units and also as per the data sheet.
- 2.4 Nozzles shall be prepared for connection with BHEL piping as follows:
- Welded connections 50 NB and smaller shall be socket weld couplings in accordance with the requirements of ASME B16.11.
 - Welded connections 65NB and above shall be butt weld connections. Butt weld ends shall be beveled for welding in accordance with the requirements of BHEL.
- 2.5 All flanged connections shall be supplied in accordance with the requirements of ASME B16.5.
- 2.6 All materials shall be new and in accordance with applicable ASTM specifications or with other recognized standards such as SAE. No peening, caulking or filling shall be permitted in repairing cracks, pin-holes or blow-holes. Defects in fabricated steel shall be repaired by chipping out welds to bottom of vee and rewelding.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 4 OF 30	

- 2.7 The use of asbestos or material containing asbestos shall not be permitted. The use of mercury or material containing mercury shall not be permitted. All nonmetallic materials shall be noted to BHEL for approval.
- 2.8 The equipment and materials specified are intended to be the minimum suitable for the intended service. They are not intended to limit the Supplier's responsibility for proper design and selection of equipment. It is the Supplier's responsibility to bid a complete system for the intended service and the specification is only for general guidelines. Any changes in proposed equipment or materials during design shall be approved by BHEL.
- 2.9 All quotations and attachments submitted to BHEL shall be in the English language.
- 2.10 All quotations and inquiries to BHEL shall be routed through Purchasing.
- 2.11 Parts subject to wear, corrosion, deterioration or requiring adjustment, inspection or repair shall be accessible and capable of reasonably convenient removal, replacement and repair.
- 2.12 The Supplier shall complete and submit the Supplier Data Sheets and guarantees located in Section 10.0 of this specification with the equipment offered in full conformance with the specification. The Supplier shall provide a complete written description of all omissions or exceptions to the requirements of this specification. This written description must be included in Section 11.0 EXCEPTIONS TO THE SPECIFICATION of this specification. Without the complete data sheets and the EXCEPTIONS TO THE SPECIFICATION sheets, the proposal will not be evaluated.
- 2.13 Optional equipment shall be priced separately.
- 2.14 The Supplier shall be governed by the following regulations, codes, and standards, including their latest respective addenda, amendments, and errata.

AFBMA	Antifriction Bearing Manufacturers' Association
AGMA	American Gear Manufacturers' Association
AHI	American Hydraulic Institute
AISI	American Iron and Steel Institute
ANSI	American National Standards Institute
API	American Petroleum Institute



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 5 OF 30

ASME	American Society Mechanical Engineers
ASTM	American Society Testing and Materials
AWS	American Welding Society
EIA	Electronics Industries Association
FCI	Fluid Controls Institute, Inc.
IEC	International Electro technical Commission
IEEE	Institute of Electrical and Electronics Engineers
IPCEA	International Power Cable Engineers Association
ISA	Instrumentation Society of America
MSS	Manufacturers Standardization Society of the Valve & Fittings Industry
NEMA	National Electrical Manufacturers' Association
NEC	National Electrical Code
NFPA	National Fire Protection Association
OSHA	Occupational Safety Health Act
PFI	Pipe Fitting Institute
SAMA	Scientific Apparatus Makers Association
SSPC	Steel Structures Painting Council
UL	Underwriter's Laboratories

In addition to the codes and standards specifically mentioned above for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India as well as of the locality where they will be installed, including the following:

- Bureau of Indian Standards (BIS)
- Indian Electricity Act
- Indian Electricity Rules
- Indian Explosives Act
- Indian Factories Act and State Factories Act
- Indian Boiler Regulations (IBR)
- Rules for Electrical installation by Tariff Advisory Committee (TAC).
- Any other statutory codes / standards / regulations, as may be applicable.

Unless covered otherwise by Indian codes & standards and in case nothing to the contrary is specifically mentioned elsewhere in the specifications, the latest editions of the following codes and standards shall also apply:

- American Petroleum Institute (API)
- International Organization for Standardization (ISO)
- Tubular Exchanger Manufacturer's Association (TEMA)
- American Welding Society (AWS)
- Expansion Joint Manufacturers Association (EJMA)
- Heat Exchange Institute (HEI)
- Standards of the Hydraulic Institute, U.S.A.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 6 OF 30	

Other International/ National standards such as DIN, VDI, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the Employer's approval, for which the Supplier shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases the Supplier shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word for word translation of the standard that is normally not published in English.

3.0 APPLICABLE CODES & STANDARDS

- 3.1 The valves shall comply with the applicable requirements of the latest edition of ASME B31.1, Power Piping Code.
- 3.2 Valve design in accordance with ASME B16.34.
- 3.3 The valve sizing shall be in compliance with latest edition of ISA S75.01 Hand book on Control Valves considering measures to avoid choked flow.
- 3.4 All pressure retaining parts of the valve shall be made of materials, including specific limitations on various materials, that are in full compliance with PG.-5 of ASME Code Section 1.
- 3.5 Materials
 - 3.5.1 Only materials listed and rated in B16.34 are acceptable and materials offered shall be appropriate to the design conditions listed.
- 3.6 For valves of other than US standards, the Supplier shall specify (at the time of quotation) the Codes and Standards which will be used through the manufacturing and design processes. The Codes and Standards as specified will be subject to approval by BHEL.
- 3.7 Reference to the above Codes and Standards shall mean the latest revision, edition and addenda effective at the date of order unless specifically stated otherwise in this specification.
- 3.8 All welders and all welding procedures welders utilized shall be qualified in accordance with ASME Section IX. When welders and welding procedures are qualified in accordance with codes other than those specified, the Supplier must take exception at the time of quotation.



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 7 OF 30

3.9 All materials shall be readily identifiable. Mill test reports shall be obtained for all pressure boundary parts. These test reports shall be available for review at the Vendor's shops. Copies of these are to be supplied to the Company, if requested, prior to ordering.

3.10 Valve Revisions

3.10.1 Supplier Changes

3.10.1.1 Supplier shall fabricate the valves based on the drawings approved by BHEL.

3.10.2 If the valve design requires modification due to Supplier error during the Supplier tests or QA inspection, the Supplier will correct the design and reflect these changes in the AS-BUILT revision of the drawings.

4.0 EQUIPMENT FURNISHED BY SUPPLIER

4.1 Two (2) BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) complete with hydraulic actuator and associated positioning controls as per this specification.

4.2 One (1) BOILER MINIMUM ECONOMIZER FLOW CONTROL VALVE (MEFCV) complete with hydraulic actuator and associated positioning controls as per this specification.

4.3 One (1) Common Hydraulic Unit and Electronic Control Unit for the positioning control of the two BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV) as per this specification.

4.4 Optional Equipment

4.4.1 The following equipment shall be proposed as an option.

- ☒ One (1) stainless steel tubing and fittings to connect all necessary hydraulic lines between the common SUPPLIER supplied Common Hydraulic Unit and the three SUPPLIER



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 8 OF 30

supplied BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV) hydraulic actuators. Each Valve location from the common hydraulic unit shall be referred from the project specific data sheet (Annexure I).

- a) HWL1 to Hydraulic Unit - refer Annexure I
- b) HWL2 to Hydraulic Unit - refer Annexure I
- c) MEFCV to Hydraulic Unit - refer Annexure I

☒ Two (2) fills of hydraulic fluid, first for start up and second for hydraulic fluid change prior to operation.

☒ One (1) lot of special tools required for maintenance of system components. Supplier shall furnish all special tools and wrenches required for erection, calibration, servicing including instructions for their use. Tools shall be new. Tools shall be shipped to the project site in a suitable, separate container, clearly marked with the name of the equipment for which they are intended.

Following special tools are must.

- a) Flushing kit for valves.
- b) Flushing kit for Hydraulic system including the flushing device. Flushing filter, Flushing Filter elements, hose pipes & valves to be supplied as spares along with the flushing kit.
- c) N2 filling kit – Used for charging of accumulators with N2 as well as pressure checking and adjustment

☒ One (1) lot of commissioning spares for each valve per SUPPLIER'S specific recommendation.

☒ ~~One (1) lot of recommended spares for each valve per SUPPLIER'S specific recommendation for One(1) year warranty period of operation (Dealt By Spares Group)~~

☒ ~~One (1) lot of recommended spares per SUPPLIER's specific recommendation for Three (3) years of operation after final acceptance (Dealt By Spares Group)~~

☐ ~~Two (2) Two (2) BOILER SEPARATOR LEVEL CONTROL VALVES (HWL 1, HWL 2 VALVES) complete with hydraulic actuator and associated positioning controls per this specification in an angle valve body configuration in place of "Z" valve body.~~



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 9 OF 30

☐ ~~One (1) BOILER MINIMUM ECONOMIZER FLOW
CONTROL VALVE (MEFCV) with Hydraulic actuator utilizing
the Common Hydraulic Unit in place of Electric Actuator.~~

5.0 TERMINAL POINTS

5.1 At all valve inlets and outlets.

5.2 At the terminal junction boxes on each supplied valve, the terminals in the hydraulic power unit, and the terminals in the control cabinet.

6.0 FACILITY SITE SPECIFIC DATA

Please refer to attached specifications Annexure-II for Facility Site Specific Data (if applicable) and Annexure-III for Surface Preparations and Coatings requirements(if applicable).

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 10 OF 30	

7.0 DRAWINGS AND DATA BY SUPPLIER

7.1 All drawings, calculations, specifications, bills of materials and other data submitted shall be in Metric units. Dual Dimensions are acceptable with Metric (primary) and English (in parenthesis). Metric units shall comply with the International SI System.

7.1.1 The following units are to be used:

- Temperature °C
- Pressure Kg / cm² (g)
- Dimensions mm
- Flow kg/sec

7.2 Submitted With Quotation

- The Supplier shall provide dimensional outline drawings of the assembled unit(s). The drawings shall show overall dimensions, terminal box dimensions, mounting connections, clearances required for proper installation and maintenance shall state lifting requirements, and the weights of all major components.
- List of commissioning spares.
- List of special tools and equipment as required for assembling, complete dismantling, and maintenance of all equipment supplied,
- Performance data and curves.
- Completed Supplier Data Sheets per Section 10.0
- Any special requirements or operational limits shall be explicitly stated in each quotation.
- Field testing requirements.
- Actuator sizing calculations
- Terminal box wiring diagram
- Integrated Manufacturing and Quality Plan for BHEL's review
- Certificates as per QR and PTR requirements (applicable to Non-PMD vendor).
- Manual Cv calculation ,valve outlet velocity , noise level calculation.
- GA drawing and circuit diagram of Common Hydraulic control Unit.

7.3 Descriptions of Equipment

- A written description of the equipment being offered shall be provided with the Bid. This information shall explain details of the design, construction, control, operation and performance.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 11 OF 30	

- Consumable list including, compressed air, instrument air and electrical requirements indicating frequency of usage; intermittent or continuous.
- Experience List for valves in similar service including size, service, flow rate, pressure, temperature, and date placed in operation.

7.4 Submitted During Contract

- Detailed arrangement drawings of the assembled units including support details, flange connections, etc. All materials shall be readily identifiable on Supplier's drawings.
- Electrical wiring diagrams and connection details
- Instrument list
- Instrument data sheet(s) (ISA format or equal)
- Valve flow characteristic curve
- List of shop tests that will be conducted on the furnished equipment
- Complete set(s) of instruction, operation, maintenance, and erection manuals, quantities will be identified in the purchase order
- List of shop applied paints and protective finishes identifying compatible site applied coatings
- List of all lubricants required for the equipment operation identifying preferred acceptable substitutes
- Certification sheet for each valve containing the following information:
 - ✓ Manufacturer's Name
 - ✓ Manufacturer's serial number on the valve body
 - ✓ Flow direction arrow on the valve body
 - ✓ ASME material specification used for pressure parts including valve body and other pressure retaining parts
 - ✓ Maximum allowable pressure (design pressure), Kg / cm² (g) @ degrees C
 - ✓ Hydrostatic shell test pressure, Kg / cm² (g). Additional certification for valves manufactured to B16.34 Special Class.
 - ✓ Welding Certification: All welding on the valve has been performed using procedures and welders qualified in accordance with ASME Code Section IX.
 - ✓ Radiographs: Radiographic examination has been performed as required by ASME B16.34. One set

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 12 OF 30	

of the completed radiographs, properly identified with the respective parts, will be retained and available for inspection for a period of five (5) years.

- ✓ IBR from III C.
- ✓ Surface examination of all castings performed by magnetic particle or liquid penetrant methods to the technique and acceptance standards of ASME B16.34.
- ✓ One (1) copy of each material manufacturer's certification.
- ✓ Authorized and dated signature certifying the above information to be complete and correct.
- ✓ Operation and Maintenance Manual describing the operation of the entire system shall be supplied (both hard copies and soft copies).

8.0 PERFORMANCE DATA & TECHNICAL REQUIREMENTS

8.1 Component Design Criteria

8.1.1 Function

8.1.1.1 Separator Level Control (HWL-1 & HWL-2) Valves:

8.1.1.1.1 The separator level control valves (HWL-1 & HWL-2) are used to control the water level in the water separator during "wet" mode operation of a supercritical boiler. As the level exceeds the set point first one, then the second valve will open. The valves will throttle saturated water from boiler at high pressure to a flash tank at atmospheric pressure. The water will be flashing to steam as it exits the valves.

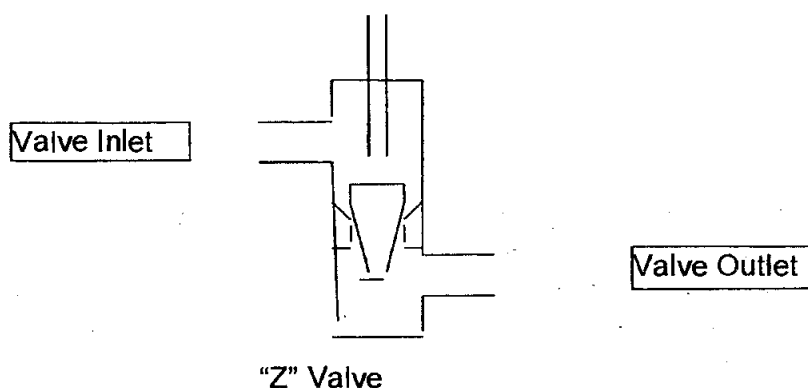
8.1.1.2 Minimum Economizer Flow Control (MEFCV) Valve:

8.1.1.2.1 The Minimum Economizer Flow control valve (MEFCV) is used to control the economizer inlet flow during start-up and low load operation. Demand for this valve is established based on measured economizer inlet flow compared to a minimum boiler flow requirement.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 13 OF 30	

9.0 DESIGN AND CONSTRUCTION

- 9.1 In general, all valves and associated accessories shall meet the applicable requirements of accepted standards and attached customer specifications.
- 9.2 Design of the valves shall meet the latest edition of ASME B16.34.
- 9.3 The valve sizing shall be in compliance with latest edition of ISA S75.01 Hand book on Control Valves considering measures to avoid choked flow.
- 9.4 The valve sizing shall be suitable for obtaining maximum flow conditions with valve opening at approximately 80% of total valve stem travel and minimum flow conditions with valve stem travel not less than 10% of total valve stem travel. All the Control Valves shall be capable of handling at least 120% of the required maximum flow. Further the valve stem travel range from minimum flow condition to maximum flow condition shall not be less than 50% of the total valve stem travel.
- 9.5 The control valve size should not be smaller than connecting line size by more than 1 step.
- 9.6 Valves shall be straight through in "Z" valve configuration. "Z" configuration has parallel inlet and outlet nozzles in two different horizontal planes.



	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 14 OF 30	

- 9.7 Valve shall be forged design.
- 9.8 Plug shall be one-piece construction either cast, forged, or machined from solid bar stock. Plugs shall be screwed and pinned to valve stems or shall be integral with the valve stems.
- 9.9 All control valves shall have stems, guide bushings, plugs, seat rings, stem lock pins, stuffing box parts and other trim parts made of stainless steel alloys and suitably hardened. Valve guide posts and bushings shall be stellite faced. Stellite faced guide posts and bushings shall be differential hardened for applications involving high pressure drop as well as for flashing and cavitation applications. **Trim material shall be 17-4 PH SS / 440C depending upon the service conditions to ensure required degree of hard facing so as to avoid erosion. However, Bidder may offer valves with body and trim materials better than specified and in such cases, Bidder shall furnish the comparison of properties including cavitation resistance, hardness, tensile strength, strain energy, corrosion resistance and erosion resistance etc. of the offered material vis-a-vis the specified material for Owner's consideration and approval.**
- 9.10 The valve model proposed should be designed to prevent cavitation, wire drawing and flashing on the downstream side of the valve and piping for operation throughout the full range under the specified conditions. For cavitation service, the trim design shall be of multistage pressure drop type to prevent cavitation occurring downstream of trim / valve.
- 9.11 Bidder shall furnish in his proposal detailed calculations to establish whether cavitation will occur or not under any operating condition for a particular application. These calculations shall be subject to Owner's review and approval and in case it is established at any stage of the contract that cavitation will occur, the Bidder shall provide anti-cavitation trim for the same at no extra price. Further the Bidder shall furnish in his proposal the detailed write up, technical literature, etc. clearly indicating as to how the occurrence of cavitation shall be prevented by the design of his offered anti-cavitation trim.
- 9.12 Bidder to furnish calculation to check whether flashing or cavitation will occur for control valve services. Control Valves shall be provided with specially designed trims (such as cage guiding valves with holes in the cage to control the location of the Vena Contracts) which are suitable for

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 15 OF 30	

withstanding high pressure drops and which minimize the adverse effects of flashing on Control Valve parts.

- 9.13 Valve sizing shall be in accordance with the latest edition of ISA Handbook on Control Valves with due consideration for the measures to avoid choked flow. Bidder shall ensure that valve outlet velocity does not exceed 8 m / sec. for liquid services, 150 m / sec. for steam services and 50% of sonic velocity for flashing services.
- 9.14 Valve outlet shall have a 5 degree downward slope to ensure proper drainage of valve outlet.
- 9.15 Valve inlet and outlet cages shall be provided if required by the indicated process conditions.
- 9.16 For valves with butt weld ends, the supplier is required to prepare weld profiles to BHEL supplied information.
- 9.17 Both the valves and their accessories shall be designed for the process and local installation environment.
- 9.18 All valves and accessories shall be suitable for outdoor service. Electrical components (actuators, limit switches, solenoid valves, positioners, controllers, etc.) shall meet the requirements of IP 65.
- 9.19 The Supplier shall provide all necessary converters, positioners, position transmitters, etc. mounted on the control valve.
- 9.20 The direction of flow shall be clearly marked on each valve.
- 9.21 Control valves, their actuators and associated ancillary equipment must be selected to suit the application, design and working conditions specified and also the environmental conditions in which they are installed. The pressure and temperature rating of valve body shall be equal or exceed the process design conditions on control valve data sheet.
- 9.22 Valves and their actuators shall be adequately rated to suit the maximum differential pressure against which they will have to work, i.e. when the valve is fully closed.
- 9.23 Valve guiding and seating systems shall be so designed that smooth control is maintained over the full operational stroke. Design should be such that it eliminates vibration.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 16 OF 30	

9.24 Valve's gland packing material shall be grafoil or graphite for all the valves.

9.25 The end for all the Control Valves shall be matched to the corresponding details for the piping on which the valve is installed. **All necessary expanders/reducers are to be supplied by the vendor to match the pipe sizes.**

9.26 The boiler water system will be acid cleaned at site using a 1 to 1.5% (by weight) inhibited hydrofluoric acid. The valve internals must be capable of withstanding hydrofluoric acid without getting damaged.

9.27 The Leakage Class of separator level control valves (HWL-1 & HWL-2) and for Minimum economizer flow control valve (MEFCV) is to be Class-V or better as per FCI 70.2.

9.28 Hydraulic Valve Actuators

9.28.1 The separator level control valves (HWL-1 & HWL-2) shall be supplied with an Hydraulic actuator capable of a quick full stroke closing time of 3 sec against closing loads. Normal full stroke opening/closing time shall be 12 sec. The Hydraulic actuator for the minimum economizer flow control valve (MEFCV) full stroke opening/closing time shall be 12 sec.

9.28.2 The Hydraulic actuator shall be sized to operate against the process maximum differential pressure.

9.28.3 A mechanical position indicator shall be provided on the actuator.

9.28.4 The actuator shall be equipped with a hydraulic positioning valve to convert a 4 –20 mADC signal from the DCS to a hydraulic signal.

9.28.5 The actuator shall be furnished with a 4 –20 mADC valve position feedback signal.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 17 OF 30	

- 9.28.6 The actuators for the HWL valves only shall be equipped with a safety quick closing system. The safety control system shall be activated by a signal (dry contact) from the DCS supplied by others. The safety control system shall be independent of other control device. The safety control system shall be capable of closing the valve with normal control system devices unavailable.

9.29 Hydraulic Unit and Electronic Control Unit (HWL-1, HWL-2 & MEFCV)

- 9.29.1 All control valves (HWL-1, HWL-2 & MEFCV) shall be supplied with a Hydraulic Unit and Electronic Control Unit. The hydraulic power unit serves to supply the necessary pressurized hydraulic fluid to the Hydraulic actuators. A common hydraulic power unit may be used for multiple Hydraulic Valve Actuators. The hydraulic power unit shall be equipped with an accumulator to maintain adequate pressure during peak operating requirements. The hydraulic pumps shall be designed for the required pressure and mean oil consumption.
- 9.29.2 The hydraulic power unit shall be equipped with redundant motor-pump units with motor starters mounted in the Electronic Control Units. Each pump set shall be equipped with the necessary charging valve, check valves, filters, pressure reducing valves, pressure relief valves, and instrumentation required for operation of the hydraulic power unit.
- 9.29.3 The hydraulic power unit shall be equipped with an oil tank sized for the entire volume of oil. A tank air breather filter shall be furnished.
- 9.29.4 The hydraulic power unit shall be equipped with an accumulator sized to deliver the oil flow at required pressure for all conditions. The accumulator shall be equipped with a pressure gauge.
- 9.29.5 The Electronic Control Unit cabinet shall be a free standing IP 65 rated with front and rear access doors to be installed outdoors. The control cabinet shall contain processors or controllers and I/O necessary for valve positioning, hydraulic

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 18 OF 30	

unit control and interface between the Hydraulic Unit / Electronic Control Unit and customer supplied DCS.

- 9.29.6 In addition to the following signal exchanges, if additional signals are envisaged as per vendor's design, then the same have to be terminated in the respective terminal boxes/junction boxes.

HWL-1 Position Demand (from DCS)	4-20 mA DC
HWL-1 Valve Position feedback (to DCS)	4-20 mA DC
HWL-1 Position Failure (to DCS)	Dry Contact
HWL-1 Quick Closing (from DCS)	Dry Contact
HWL-1 Valve Opened (to DCS)	Dry Contact
HWL-1 Valve Closed (to DCS)	Dry Contact

HWL-2 Position Demand (from DCS)	4-20 mA DC
HWL-2 Valve Position feedback (to DCS)	4-20 mA DC
HWL-2 Position Failure (to DCS)	Dry Contact
HWL-2 Quick Closing (from DCS)	Dry Contact
HWL-2 Valve Opened (to DCS)	Dry Contact
HWL-2 Valve Closed (to DCS)	Dry Contact

MEFCV Position Demand (from DCS)	4-20 mA DC
MEFCV Valve Position feedback (to DCS)	4-20 mA DC
MEFCV Position Failure (to DCS)	Dry Contact
MEFCV Opened (to DCS)	Dry Contact
MEFCV Closed (to DCS)	Dry Contact

Hydraulic Power Unit On (from DCS)	Dry Contact
Hydraulic Power Unit Off (from DCS)	Dry Contact
Hydraulic Power Unit Pressure too low (to DCS)	Dry Contact
Hydraulic Power Unit Auto (to DCS)	Dry Contact
Hydraulic Power Unit Alarm (to DCS)	Dry Contact
Hydraulic Power Unit Fault (to DCS)	Dry Contact

- 9.29.7 415 V, 3 Ø, AC Power supply feeder will be provided for the hydraulic power pack. 240 V, AC Power supply feeder will be provided. It is vendor's responsibility to further distribute the same to different points and further derivation of various control supplies/power supplies.

- 9.29.8 Vendor to offer the latest version of control system/positioners with additional features.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 19 OF 30	

- 9.29.9 The offered Hydraulic Power Unit and the Control system/panels shall be suitable for outdoor applications.
- 9.29.10 All Cables (Power cables/Control Cables/Instrumentation cables) run between various equipment supplied vendor, shall be in vendor's scope. These cables shall be laid in conduits/cable trays.
- 9.29.11 All Cables (Power cables/Control Cables/Instrumentation cables) interfaced with various equipment supplied by the vendor, have to be terminated by using suitable Double compression, flame proof/weather proof, Brass with Nickel plated cable glands.
- 9.29.12 Vendor to provide suitable cable glands for all interfacing cables from/to DCS. Cable sizes will be indicated during engineering stage.
- 9.29.13 Test Certificates and Calibration Certifications shall be provided for all Instruments and Motors as applicable.

9.30 Valve Selection Criteria

- 9.30.1 The control valves, actuators and actuator hydraulic systems shall be sized based on the valve data sheets. These data sheets shall be filled in and submitted with the bid and with the first submittal of valve drawings.
- 9.30.2 The Supplier shall meet all process conditions shown on the data sheet or shall notify BHEL of any deviations. All deviations must be approved by BHEL before manufacture of the valve.
- 9.30.3 The Supplier shall guarantee total sound levels on Supplier furnished equipment shall not exceed 85 dB(A). Sound pressure level at all conditions shall not be greater than 85 dBA when measured at 1.0 meter downstream of the valve and 1.0 meter away from the pipe. The noise abatement shall be obtained by valve body, trim design and piping arrangement and not by the use of silencers.
- 9.30.4 The bidder has to submit calculated noise levels (dBA) for the operating conditions specified in the datasheet.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 20 OF 30	

9.31 Test and Examinations

9.32.1 All valves shall be tested in accordance with the quality assurance program agreed between the Owner and the Contractor, which shall meet the requirements of IBR and other applicable codes. The BHEL Approved Quality Plan is to be followed. The tests shall include but not limited to the following bidder shall submit a manufacturing quality plan along with the offer for BHEL / QA review and approval.

- 1) Material, mechanical and chemical test shall be performed in a manner as specified in the relevant codes.
- 2) Non-destructive examination shall be performed as per ASME-B-16.34 (Steel Valves).
- 3) 100% radio graphic test on casings of all valves having rating of 600 lbs or above; magnetic particles / dye penetrant examination on all internal and external machined surfaces and 100% ultra sonic testing of forgings and bars (of size 40 mm and above) of all valves with rating of 600 lbs or above shall be performed as per ASME B16.34.
- 4) The material test certificates (correlated to melt number) shall be furnished by the vendor for identification and correlation.
- 5) The butt-welding end of all valves, dye-penetrant test as per ASTM E165 shall be carried out on 100% of the valves and the result shall show no defects.
- 6) 100% MPI shall be done on base/body casing with pressure rating 1500 class and above in line with ASME B16.34.



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 21 OF 30

7) Hydrostatic Test

Valves shall be subjected to hydrostatic shell test in accordance with ASME-B16.34 prior to seat leakage test. If the valves are reworked on the pressure parts for any reason after hydrostatic test, they must be retested. Valves shall be hydrostatically tested in Manufacturer's Works in accordance with code requirements. All hydrostatic testing and inspection shall be completed before any paint is applied to valve body. Certificates of inspection shall be executed in accordance with the latest codes and required codes shall be forwarded to the Engineer. All gaskets used for test shall be of the same material and design as specified for the finished product. Where mechanical gasket joints are broken following tests, new gaskets shall be furnished with the equipment, and the joints shall be retested.

8) Leakage Test

Valve closure test and seat leakage tests shall be performed in accordance with ASME -B16.34 and as per applicable Leakage Class. The leakage from packing shall be zero or bubble tight.

9) Functional Tests

The fully assembled or completed valves including the actuators control devices and accessories shall be functionally tested to demonstrate the operability and response time of the valve and the actuator. This may be done by cycling the valves 3 or 4 times from open to close position. The same controller can be used to test each valve. These tests shall also include the verification of control valve operation features such as stay put operation, fail to open, fail to close on signal failure etc. in line with the specification requirements.

10) Cv Test (If applicable)

Cv test shall be carried out as type test on each size type and design of the valves as per ISA-75.02 standard and the test reports, shall be furnished for Owner's approval.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 22 OF 30	

9.32 Additional requirements

1. Machined surfaces shall be suitably protected.
2. Valve ends shall be protected by means of metallic covers/polythene caps/rubber and protectors to prevent damage to ends & also to avoid foreign material entering the valve while shipment & storage.
3. All valves shall be packed suitably in wooden cases in order to avoid damage during transit and also during storage at site.
4. Valve tag nos. shall also be incorporated in all the dispatch documents.
5. All unpainted surfaces shall be protected with a rust preventive, which can be removed by solvent washing. The use of grease or oil other than light grade mineral oil for corrosion protection is prohibited.
6. Paint specifications are to be submitted for purchaser's review with bid.
7. All exposed machined surfaces shall be coated with suitable rust preventative coating prior to shipment.(two coats of primer of thickness 35 microns)
8. The seller shall adequately crate, block, anchor and protect equipment as required to prevent damage during overseas shipment and outdoor storage for a period of one (1) year at the site.
9. All threaded connections, bores shall be plugged or capped with standard pipe plugs or caps.
10. List of commissioning spares shall be quoted if applicable.
11. List of recommended spares for 5 years trouble free operation of valves shall be quoted.
12. Recommended list of special tools and equipment (required for assembling, complete dismantling and maintenance of all equipment supplied) to be provided and also to be supplied along with valve.



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: BM/SCV :001

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 03

DATE: -30.01.17

PAGE NO : 23 OF 30

13. One spare filter element each to be supplied for the SS filter provided in the Hydraulic Control Unit.
14. Drain valve for the oil tank, vent air breather, and isolation lines in the oil supply lines are to be necessarily provided.
15. Mechanical oil level indicator has to be extended through full height of the tank. (0 % to 100 %)
16. Man hole to be provided in the Oil tank in order to provide means to access the internals of the oil tank and for maintenance.
17. Oil tank internals surface should not be painted.
18. Vendor to provide isolation valves in the pressure and return lines (oil lines) to carry out maintenance activities in the oil line and also in the fail safe manifold & control manifold.
19. Vendor to supply welding type socket fittings in the entire hydraulic pipes joint.
20. Vendor to provide a provision to indicate the accumulator pressure in local as well as in remote.
21. Hydraulic fluid /oil cooler is to be provided.

9.33

The vendors to quote for ERECTION & COMMISSIONING SUPPORT (optional)for Supervision of erection and commissioning of this valves , the seller should depute one commissioning engineer to the site and he shall stay there for a maximum of 7 days (for each unit ie per customer number) extending full support to site people in the initial operation of the valves .All the expenses like to & fro charges, incidentals, boarding & lodging at site are to be borne by the valve vendor

The Vendors to submit an Optional price for providing training to our personnel at the works of Valve manufacturer for 2 man month period .

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 24 OF 30	

Our personnel will make their own Travel / Lodging / Boarding arrangements . Depending upon the actual duration of training man months availed, the payment will be proportionately reduced on the vendor quoted amount (if period is lesser than 2 man months).

9.34 Evaluations

9.34.1 Bids will be analyzed, not only to determine conformity to the requirements of this Specification, but also to evaluate any features of design, construction, and guaranteed performance of the equipment offered which would result in a higher or lower capital, operating, or maintenance cost to BHEL.

9.34.2 Nothing in this specification shall be construed to relieve the vendor from his responsibility. This specification covers briefly the requirements of the system. It is the responsibility of the vendor to take care of other basic and essential requirements. In case of any discrepancy in the contents expressed in the specification, vendor shall include all items required for completeness of the system even if it is not specified explicitly in this specification.

10.0 SUPPLIER'S DATA SHEETS (TO BE SUBMITTED WITH THE BID)

10.1 Valve Data Sheets

10.1.1 All data to be in Metric units. The Supplier shall fill in the valve data sheets for each valve. The operating conditions furnished for MEFCV is preliminary only. Final operating conditions can be informed only after the boiler recirculation pump operating conditions are finalized, which can happen even after the placement of this PO. This may/may not affect the selected Cv for MEFCV. The vendor to accommodate these changes in the operating conditions and offer the valve which meets all the specification requirements without any price implication to BHEL.

	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: BM/SCV :001	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 03	DATE: -30.01.17
		PAGE NO : 25 OF 30	

10.2 Guarantees

CUSTOMER NAME	
PROPOSAL NUMBER	
SUPPLIER NAME	

The Supplier shall clearly state at the time of quotation all performance guarantees specific to the equipment offered.

11.0 EXCEPTIONS TO THE SPECIFICATION

CUSTOMER NAME	
PROPOSAL NUMBER	
SUPPLIER NAME	

I have confirmed to Sections 1.0 through 10.0 and Appendix A except as specifically noted as follows:

12.0 APPENDIX A, CONTRACT SPECIFIC REQUIREMENTS

Please refer the attached, Annexure I - Valve Datasheets and project specific data sheets.



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: SCV_MAIN SPEC

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 00

DATE: - 01.02.17

PAGE NO : 26 OF 30

ANNEXURE-I

Customer No: 1817

Tag Nos.: HAG15AA301/302

Qty.: 2 Nos. / BOILER

SEPERATOR LEVEL CONTROL VALVE DATA SHEET

PART - A

(TO BE FILLED UP BY PURCHASER)

PART - B

(TO BE FILLED UP BY
BIDDER)

GENERAL	PROJECT SERVICE LOCATION DUTY PIPE SIZE (inlet / outlet) PIPE MATERIAL (inlet / outlet) MEDIUM	VIJAYAWADA-8 (1X800 MW) HWL 1 & 2 OUTDOOR MODULATING D 508x70.00/ D508X70.00 SA106 Gr.C/ SA106 Gr.C FEED WATER	
BODY	MODEL No. TYPE OF BODY: GUIDING: No. OF PORTS BODY SIZE: PORT SIZE: DESIGN CV BODY RATING (ASME) END CONNECTION BODY MATERIAL PACKING MATERIAL BONNET TYPE TRIM FORM TRIM MATERIAL: SEAT / PLUG : CAGE / STEM BALANCED / UNBALANCED FLOW VALVE OUTLET VELOCITY REQUIRED LEAKAGE CLASS NOISE LEVEL (dBA) VALVE LIFT mm ANTI FLASHING TRIM	Z type INLET : BUTT WELD; STYLE-P, d1 = 385.5 mm OUTLET: BUTT WELD; STYLE-P, d1 = 384.5 mm F11 GRAFOIL/GRAPHITE FLOW TO CLOSE < 50% Sonic Velocity V OR BETTER LESS THAN 85 dBA	
ELECTRO HYDRAULIC ACTUATOR	MODEL No. & SIZE CLOSE AT: OPEN AT (Kg/cm ² (g)) SHUT OFF DIFFERENTIAL STEM OREINTATION MANUAL OVERRIDE TRAVEL TIME FOR OPEN TO CLDSE, CLOSE TO OPEN, TRIP VALVE POSN. ON SIGNAL (4-20mA) FAILURE VALVE POSN. ON FLUID SUPPLY FAILURE	YES <12 Secs / <12 Secs / <3 secs FAIL TD CLOSE FAIL TO CLOSE	
PERFORMANCE OF VALVE	LINEARITY HYSTERISIS SENSITIVITY ACCURACY (OVERALL)	± 2% ± 1% ± 0.5% ± 2%	

SERVICE CONDITIONS

Sl. No.	LOAD	No of valve Operating	FLOW PER VALVE Kg/sec	INLET PR. kg/cm ² (g)	OUTLET PR. kg/cm ² (g)	INLET TEMP (°C)	Sp. Gravity	Calc. Cv	Valve Lift %	Valve outlet velocity	Noise Level dBA
01.	Cold Start Min water	1	34.5	5.6	0.0	37.8					
02.	Cold start Min OT flow	1	241.3	5.2	0.0	37.8					
03.	Cold Start Swell flow	2	189.6	4.4	0.0	100.0					
04.	Hot start 130 bar Min OT flow	1	241.3	144.6	0.0	336.6					
05.	Hot start 160 bar swell flow	2	189.6	143.6	0.0	336.6					
06.	Hot Start 160 bar Min water flow	1	34.5	165.5	0.0	347.3					



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: SCV_MAIN SPEC

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 00

DATE: - 01.02.17

PAGE NO : 27 OF 30

ACTUATOR SIZING PRESSURE : 298.1 kg/cm² (g)
BODY DESIGN: PRESSURE / TEMPERATURE : 298.1 kg/cm² (g) / 375°C
TEST PRESSURE : 2 x Design Pressure

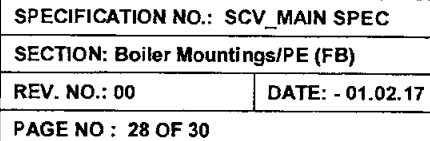
IBR FORM - III C : REQUIRED

TOTAL WEIGHT (VALVE+ACTUATOR+ACCESSORIES) : Kgs.

Valves should be directly weld able to connecting pipe without the use of Reducers. ONLY GLOBE "Z" VALVES ACCEPTABLE.

PART - A (TO BE FILLED UP BY PURCHASER)			PART - B (TO BE FILLED UP BY BIDDER)	
ACCESSORIES	ELECTRO HYDRAULIC POSITIONER POSITION LIMIT SWITCH POSITION TRANSMITTER SOLENOID VALVE E/H CONVERTER JUNCTION BOX HAND PUMP LOCAL POSITION INDICATOR HYDRAULIC POWER UNIT(COMMON FOR HWL AND MEFCV) ELECTRONIC CONTROL UNIT (COMMON FOR HWL AND MEFCV)	REQUIRED REQUIRED REQUIRED NOT REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED REQUIRED		
ELECTRO HYDRAULIC POSITIONER	MANUFACTURER & MODEL No. ENCLOSURE CLASS INPUT SIGNAL OUTPUT SIGNAL INCREASE IN SIGNAL	IP-65 4 - 20 mA TO SUIT ACTUATOR TO OPEN / TO CLOSE		
LIMIT SWITCH	MANUFACTURER & MODEL No. OPEN: INT: CLOSE CONTACT TYPE RATING (AC/DC) ENCLOSURE CLASS	1 No. FOR OPEN & 1 No. FOR CLOSE DPDT 2 NO + 2 NC 5A 240V, AC and 0.2A, 220V, DC IP65 / NEMA 4		
POSITION TRANSMITTER	MANUFACTURER & MODEL No. TYPE SUPPLY OUTPUT RATING ACCURACY ENCLOSURE CLASS	LVDT 2 WIRE TYPE 24V DC 4 - 20 mA / 0-100 Ohms +- 1% FS IP65 / NEMA 4		
HAND PUMP	ORIENTATION	SIDE MOUNTED		
JUNCTION BOX	No. OF WAYS SIZE CABLE GLANDS: (SIZE / QNTY) ENCLOSURE CLASS	THIRTY SIX REQUIRED REQUIRED IP65 / NEMA 4		
E/H CONVERTER	INPUT SIGNAL : POWER SUPPLY SPLIT RANGE ENCLOSURE CLASS	4 - 20mA, DC / 24V, DC YES / NO // YES / NO IP65 / NEMA 4		
SIGN. : NAME : DATE :	PREPARED BY P. RAVIRAJ 01/02/17	CHECKED BY A. JAI GANESH 01/02/17	APPROVED BY K. SRIDHARAN 01/02/17	VENDOR SEAL SIGN.: NAME: QATE:

K. SRIDHARAN
Dy. General Manager
Boiler Mountings/PE (FB)
BHEL, TRICHY - 621 014.

[illegible]



SPECIFICATION FOR STARTUP CONTROL VALVES

SPECIFICATION NO.: SCV_MAIN SPEC

SECTION: Boiler Mountings/PE (FB)

REV. NO.: 00

DATE: - 01.02.17

PAGE NO : 29 OF 30

ACTUATOR SIZING PRESSURE : 323.5 kg/cm² (g)
BODY DESIGN: PRESSURE / TEMPERATURE : 323.5 kg/cm² (g) / 348°C
TEST PRESSURE : 2 x Design Pressure

IBR FORM - III C : REQUIRED

TOTAL WEIGHT (VALVE+ACTUATOR+ACCESSORIES) : Kgs.

Valves should be directly weldable to connecting pipe without the use of Reducers. ONLY GLOBE "Z" VALVES ACCEPTABLE.

PART - A (TO BE FILLED UP BY PURCHASER)			PART - B (TO BE FILLED UP BY BIDDER)	
ACCESSORIES	ELECTRO HYDRAULIC POSITIONER	REQUIRED		
	POSITION LIMIT SWITCH	REQUIRED		
	POSITION TRANSMITTER	REQUIRED		
	SOLENOID VALVE	NOT REQUIRED		
	E/H CONVERTER	REQUIRED		
	JUNCTION BOX	REQUIRED		
	HAND WHEEL (SIDE MOUNTED)	REQUIRED		
	LOCAL POSITION INDICATOR	REQUIRED		
	HYDRAULIC POWER UNIT(COMMON FOR HWL AND MEFCV)	REQUIRED		
	ELECTRONIC CONTROL UNIT (COMMON FOR HWL AND MEFCV)	REQUIRED		
ELECTRO HYDRAULIC POSITIONER	MANUFACTURER & MODEL No.	IP-65		
	ENCLOSURE CLASS	4 - 20 mA		
	INPUT SIGNAL	TO SUIT ACTUATOR		
	OUTPUT SIGNAL	TO OPEN / TO CLOSE		
	INCREASE IN SIGNAL			
LIMIT SWITCH	MANUFACTURER & MODEL No.	1 No. FOR OPEN & 1 No. FOR CLOSE		
	OPEN: INT: CLOSE	DPDT 2 NO + 2 NC		
	CONTACT TYPE	5A 240V, AC and 0.2A, 220V, DC		
	RATING (AC/DC)	IP65 / NEMA 4		
	ENCLOSURE CLASS			
POSITION TRANSMITTER	MANUFACTURER & MODEL No.	LVDT 2 WIRE TYPE		
	TYPE	24V DC		
	SUPPLY	4 - 20 mA / 0-100 Ohms		
	OUTPUT RATING	+/- 1% FS		
	ACCURACY	IP65 / NEMA 4		
	ENCLOSURE CLASS			
HANDWHEEL	ORIENTATION	SIDE MOUNTED		
JUNCTION BOX	No. OF WAYS	THIRTY SIX		
	SIZE	REQUIRED		
	CABLE GLANDS: (SIZE / QNTY)	REQUIRED		
	ENCLOSURE CLASS	IP65 / NEMA 4		
E/H CONVERTER	INPUT SIGNAL : POWER SUPPLY	4 - 20mA, DC / 24V, DC		
	SPLIT RANGE	YES / NO // YES / NO		
	ENCLOSURE CLASS	IP65 / NEMA 4		
SIGN : NAME : DATE :	PREPARED BY P. RAVIRAJA 01/02/17	CHECKED BY A. JAI GANESH 01/02/17	APPROVED BY A. SRIVIDHARAN 01/02/17	VENDOR SEAL SIGN : NAME : DATE :

K. Srinivasan
General Manager
Boiler Mountings / PE (FB)
BHEL, TIRUCHY - 620 015

0 	SPECIFICATION FOR STARTUP CONTROL VALVES	SPECIFICATION NO.: SCV_MAIN SPEC	
		SECTION: Boiler Mountings/PE (FB)	
		REV. NO.: 00	DATE: -01.02.17
		PAGE NO : 30 OF 30	

Project Specific Data :

One (1) stainless steel tubing and fittings to connect all necessary hydraulic line between the common SUPPLIER supplied Common Hydraulic Unit and the three SUPPLIER supplied BOILER SEPARATOR LEVEL CONTROL VALVES (HWL-1, HWL-2 VALVES) and Minimum Economizer Flow Control Valve (MEFCV) hydraulic actuators. Each Valve location from the common hydraulic unit is as follows.

- a) HWL1 to Hydraulic Unit - 50 in m.
- b) HWL2 to Hydraulic Unit - 50 in m.
- c) MEFCV to Hydraulic Unit - 60 in m.