



BHARAT HEAVY ELECTRICALS LIMITED

TRANSMISSION BUSINESS HVDC ENGINEERING & SYSTEMS

COPYRIGHT AND CONFIDENTIALITY
The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD.
It must not be used directly or indirectly in anyway detrimental to the interest of the company

DOCUMENT No.	TB-409-510-002	Rev. No.	00	Prepared	Checked	Approved		
TYPE OF DOC.	TECHNICAL SPECIFICATION	SIGN						
TITLE	765kV Current Transformer	NAME	NS	SKS	AG			
		DATE	27/12/19	27/12/19	27/12/19			
		GROUP	HVDC	W.O. No	Awaited			
CUSTOMER	Fatehgarh-II Transco Limited - A 100% wholly owned subsidiary of Power Grid Corporation of India Limited							
PROJECT	Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route							
NOA NO.	FTL/765kV/SS02/NOAI/2(I) For Supply of Goods Contract Dated 05-11-19 & FTL/765kV/SS02/NOAII/2(II) For Supply of Service Contract Dated 05-11-2019							
Station	Fatehgarh-2, Rajasthan and Bhadla-2, Rajasthan							
CONTENTS								
Section	Description	No of Sheets						
1	Scope, Bill of Quantity, Specific Technical Requirement	5						
2	Equipment Specification	1+34						
3	Project Details and General Technical Requirements	1+59						
4	Guaranteed Technical Particulars	3						
5	Checklist	3						
Rev No.	Date	Altered	Checked	Approved	REVISION DETAILS			
Distribution				To	HVDC	TBMM	TBQM	Vendor
				Copies	1	1	1	4



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00

SECTION-1

Scope, Bill of Quantity, Specific Technical Requirements

1.1 Scope

This technical specification covers the requirements of design, engineering, manufacturing, assembly, stage testing, inspection, testing before supply, documentation, packing and loading at works and transportation to site of **765 kV Current Transformer** along with its accessories and fixing hardware as mentioned in this section and in various other sections of this specification

The equipment is required for the following project:

Name of the customer : **Fatehgarh-II Transco Limited - A 100% wholly owned subsidiary of Power Grid Corporation of India Limited**

Name of the project : **Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route**

Site : **Fatehgarh-2, Rajasthan & Bhadla-2, Rajasthan**

***Note: The terms used in this specification namely, “Employer” refers to PowerGrid , “POWERGRID” refers to BHEL/POWERGRID, “Contractor” refers to Bidder, “GTR” refers to “section-3”.**

In case of any conflict among the various sections of this specification, the order of precedence shall be section 1, section 2 & the section 3.



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

1.2 Bill of Quantities

1.2.1 Main Supply:

S. No.	Item Description	Unit	Quantity	
			Fatehgarh 2	Bhadla 2
1	SUPPLY- CURRENT TRANSFORMER : 765KV, 40KA FOR 1S, 25MM/KV CREEPAGE, 3000A 120% EXTENDED RATING 6 CORE SINGLE PHASE CURRENT TRANSFORMER	Nos.	12	12

Note –

1. The above quantities may vary $\pm 10\%$.
2. Hardware (Nut, Bolts & Washers) for mounting CT on structure – 1 Set for each CT shall be provided by the Bidder.
3. Marshalling box for a set of three (3) CTs shall be provided by BHEL, TBG.
4. 765kV CT shall be with Polymer insulator.
5. If SF6 gas filled CT is offered , it shall be with suitable SF6 gas density monitoring device with NO & NC contacts for remote annunciation and tripping in case of SF6 gas leakage.
6. Terminal connectors are not in bidder's scope of supply.
7. Bidder shall supply 2 Nos oil sampling device for every 20 Nos. of oil filled CT supplied, with a minimum of 2 Nos oil sampling device for each substation.

1.3 Specific Technical Requirements

1.3.1 Technical Parameters - 765kV Current Transformer

S. No.	Description	Unit	765kV System	
			Fatehgarh 2	Bhadla 2
1	Rated voltage, Um	kVrms	800	
2	Rated frequency	Hz	50	
3	No. of Poles	Nos.	1	
4	Design ambient temperature	°C	50	
5	Rated Primary Current	A	3000	
6	Rated extended primary current	%	120	
7	Rated short time thermal withstand current	kA	40kA for 1 Sec	
8	Rated dynamic current	kAp	100	
9	Temperature rise over design ambient temperature	°C	As per IEC	



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

S. No.	Description	Unit	765kV System	
			Fatehgarh 2	Bhadla 2
10	Rated Insulation levels			
a)	Full wave impulse withstand voltage (1.2/50 microsecond)			
i)	between line terminals and ground	kVpeak	±2100	
b)	Switching impulse withstand voltage (250/2500 microsecond) (dry and wet)			
i)	between line terminals and ground	kVpeak	± 1550	
c)	One minute power frequency dry withstand voltage (dry and wet)			
i)	between line terminals and ground	kVrms	975 (dry only)	
d)	One minute power frequency withstand voltage between secondary terminals & earth	kVrms	5	
11	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz at	microvolts	2500 at 508 kV rms	
12	Minimum Corona extinction voltage	kVrms	508	
13	Seismic acceleration (Horizontal)	g	0.3	
14	Partial Discharge	pC	As per IEC	
15	Number of terminals	Nos.	All terminals of control circuits are to be wired up to marshaling box plus 20% spare terminals evenly distributed on all TBs.	
16	Minimum Creepage distance	mm	20000	
17	System neutral earthing	NA	Effectively Earthed	

For other parameters, refer respective section 2 for the applicable voltage class of CTs.

1.3.2 Technical Qualifying Requirement

Technical requirements for 765kV Air Insulated Switchgear (AIS) Equipment – Current Transformer:

- The manufacturer(s) whose 765kV Current Transformer are offered, must have, manufactured, type tested (as per IEC/IS or equivalent standard) and supplied 715kV or higher voltage class Current Transformer, which are in satisfactory operation# for at least two (2) years as on the date of NOA i.e. 05 Nov 2019.
- Alternatively, the manufacturer, who have established manufacturing and testing facilities in India for the offered Current Transformers and not meeting the



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

requirement stipulated in (i) above, can also be considered provided that

- a. 715 kV or higher Voltage class Current Transformers must have been manufactured in the above Indian works & type tested (as per IEC/IS standard) and supplied as on the date of NOA i.e. 05 Nov 2019.
- b. Manufacturer shall furnish performance guarantee for an amount of 10% of the ex-works cost of the Current Transformers* and this performance guarantee shall be in addition to the contract performance guarantee to be submitted by the Manufacturer, if specified elsewhere in commercial terms and conditions.

Notes:

#: satisfactory operation means certificate issued by the Employer/Utility certifying the operation without any adverse remark.

*: voltage class of respective equipment as applicable.

1.3.3 Type Tests

- i. All equipment being supplied shall conform to type tests as per technical specification and shall be subject to routine tests in accordance with requirements stipulated under respective sections.
- ii. The reports for all type tests as per technical specification shall be furnished by the Bidder along with equipment / material drawings. However, type test reports of similar equipments/ material already accepted in POWERGRID shall be applicable for all projects with similar requirement. The type tests conducted earlier should have either been conducted in accredited laboratory (accredited based on ISO / IEC Guide 25 / 17025 or EN 45001 by the national accreditation body of the country where laboratory is located) or witnessed by POWERGRID or representative authorized by POWERGRID or Utility or representative of accredited test lab.

Unless otherwise specified elsewhere, the type test reports submitted shall be of the tests conducted on or after 05-Nov-2009. In case the test reports are of the test conducted earlier than 05-Nov-2009, the bidder shall repeat these test(s) at no extra cost to the BHEL/Employer.

Further, in the event of any discrepancy in the test reports i.e. any test report not acceptable due to any design/manufacturing changes or due to non-compliance with the requirement stipulated in the Technical Specification or any/all type tests not carried out, same shall be carried out without any additional cost implication to the BHEL/Employer.



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

The Bidder shall intimate the Employer/BHEL the detailed program about the type tests atleast two (2) weeks in advance in case of domestic supplies & six (6) weeks in advance in case of foreign supplies.

- iii. The Employer reserves the right to witness any or all the type tests. The Employer shall bear all expenses for deputation of Employer's representative(s) for witnessing the type tests.
- iv. The list of makes of various items, for which Type test reports are not required to be submitted are specified in Compendium of Vendors (COV).

1.3.4 Quality Plan

Bidder should have POWERGRID approved and valid SMQP by the date of technical bid opening.

1.3.5 Deviations

The bidder shall list all the deviation from the specification separately. Offers without specific deviation will be deemed to be totally in compliance with the specification and NO DEVIATION on any account will be entertained at a later date.



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

SECTION-2

Refer Customer Technical Specification, Section: “Switchgear-INST C/ENGG/SPEC/SWGR/R11, JAN 2017”.

MODEL TECHNICAL SPECIFICATION
SECTION-SWITCHGEAR-INST
(INSTRUMENT TRANSFORMERS)
(REV. NO. 11)

Following are the major changes made in the Technical specification, Section-Switchgear-INST, Rev. 11:

Clause No.	Major Modification
1.	New IEC-61869 referred. IEC-60044 is superseded by IEC-61869
2.	245kV and above rating CT are acceptable with Polymer Insulator
3.	Cantilever strength for 72.5kV Instrument Transformer specified
4.	Live Tank CT shall be preferably of Bar primary design with SS Bellow
5.	Type test & Special test requirements mentioned in line with IEC-61869
6.	DGA sampling after commissioning elaborated
7.	Requirement of Oil sampling device added
8.	Defect liability clause added for actions required in case of defects observed during warrantee period
9.	Protection class of CT mentioned as “PX class” in line with IEC-61869

Note: The above is the list of major changes with respect to previous revision (Rev. 10). However, the bidders are advised to read the entire section/chapter for other changes and quote accordingly.

SECTION-SWITCHGEAR-INST
INSTRUMENT TRANSFORMERS

CONTENTS

Clause.No.	Description	Page No.
1.0	General	4
2.0	Constructional Features	4
3.0	Current Transformers	6
4.0	Voltage Transformers	8
5.0	Terminal Connectors	9
6.0	Tests	10
7.0	Mandatory Spares	12
8.0	Technical Parameters	13
9.0	Pre-Commissioning tests	13
10.0	Defect Liability	14
Table-IA	Requirements of 800 kV CVT	15
Table-IB	Requirements of 420 kV VT	16
Table-IC	Requirements of 245 kV VT	17
Table-ID	Requirements of 145 kV VT	18
Table-IE	Requirements of 72.5 kV VT	19
Table-IIA	Requirements of 800 kV CT	20
Table-IIB	Requirements of 420 kV CT	21
Table-IIC	Requirements of 245 kV CT	22
Table-IID	Requirements of 145 kV CT-800A	23
Table-IIE	Requirements of 145 kV CT-600A	24
Table-IIF	Requirements for 72.5 kV CT	25
Annexure-I	Technical Parameters of CT	26
Annexure-II	Technical Parameters of CVT/IVT	28
Annexure-III	Wiring diagram for CT	30
Annexure-IV	Wiring diagram for CVT	32
Annexure-V	Actions required in case of defects observed during the warrantee period	34

SECTION-SWITCHGEAR-INST

INSTRUMENT TRANSFORMERS

1.0 GENERAL:

- 1.1 The instrument transformers and accessories shall conform to the latest version of the standards specified below except to the extent explicitly modified in this specification and shall be in accordance with the requirements in Section-GTR.

Current Transformers (CT): IEC: **61869-1 & 61869-2** or IS: 2705 **Part-1 to 4**

Capacitive Voltage Transformers (CVT): IEC: **61869-1, 61869-5 & IEC-60358 or IS-3156 Part-1 to 4**

Inductive Voltage Transformers (IVT): IEC: **61869-1 & 61869-3 or IS-3156 Part-1 to 3**

- 1.2 The instrument transformers shall be designed for use in geographic and meteorological conditions as given in Section-GTR **and Section-Project**.

2.0 CONSTRUCTION FEATURES:

The features and constructional details of instrument transformers shall be in accordance with requirements stipulated hereunder:

- a) Instrument transformers of **800kV/420kV/245kV/145kV/72.5 kV** class, shall be oil filled/SF₆ gas filled, suitable for outdoor service and upright mounting on steel structures. **245kV, 420kV and 800kV** CT shall be with polymer insulator.
- b) Bushings/Insulators shall conform to requirements stipulated in Section-GTR. The bushing/insulator for CT shall be one piece without any metallic flange joint.
- c) Oil filling and drain plugs, oil sight glass shall be provided for CT & IVT. Oil sight glass shall be provided for electromagnetic unit of CVT. ***The Instrument transformer shall have cantilever strength of not less than 500 kg, 500 kg, 350 kg, 350 kg and 250 kg respectively for 800kV, 420kV, 245kV, 145kV and 72.5kV Instrument Transformers.*** For CVT/IVT with polymer housing, the cantilever strength shall not be less than 150kg. Oil filling and drain plugs are not required for SF₆ gas filled CT/IVT.
- d) Instruments transformers shall be hermetically sealed units. The details of the arrangements made for the sealing of instrument transformers shall be furnish during detailed engineering.

- e) Polarity marks shall indelibly be marked on each instrument transformer and at the lead terminals at the associated terminal block.
- f) SF₆ gas filled CT/IVT shall be provided with a suitable SF₆ gas density monitoring device, with NO/NC contacts to facilitate the remote annunciation and tripping in case of SF₆ gas leakage. Provisions shall be made for online gas filling. Suitable rupture disc shall be provided to prevent explosion.
- g) The instrument transformers shall be complete with its terminal box and a common marshalling box for a set of 3 instrument transformers.
- h) The external surface of instrument transformer, if made of steel, shall be hot dip galvanized or painted as per Section-GTR. External surface of aluminum can have natural finish.
- i) The impregnation details alongwith tests/checks to ensure successful completion of impregnation cycle shall be furnished for approval.

2.2 **Terminal box/Marshalling Box:**

Terminal box/**Marshalling Box** shall conform to the requirements of Section-GTR.

2.3 **Insulating Oil/Gas:**

- a) Insulating oil to be used for instrument transformers shall be of EHV grade and shall conform to IS-335/IEC-60296 (required for first filling). Non-PCB based synthetic insulating oil conforming to IEC 60867 **shall** be used in the capacitor units of CVT.
- b) The SF₆ gas shall comply with IEC-60376, 60376A, 60376B & **IEC-60480** and shall be suitable in all respects for use in the switchgear under operating conditions.

2.4 **Name Plate:**

Name plate shall conform to the requirements of IEC incorporating the year of manufacture. The rated current & extended current rating in case of current transformers and rated voltage, voltage factor & **intermediate voltage** in case of voltage transformers shall be clearly indicated on the name plate.

3.0 **CURRENT TRANSFORMERS:**

- a) Current transformers shall have single primary either ring type or hair pin type and suitably designed for bringing out the secondary terminals

in a weather proof (IP-55) terminal box at the bottom. PF **(Tan delta)** terminal for measurement of tan delta and capacitance of the unit shall be provided. These secondary terminals shall be terminated to stud type non disconnecting terminal blocks inside the terminal box.

In case of inverted type **(Live Tank)** current transformers, the manufacturer shall meet following additional requirements:

- (i) **The primary conductor shall preferably be of bar type meeting the desired characteristics.**
 - (ii) The secondaries shall be totally encased in metallic shielding providing a uniform equipotential surface for even electric field distribution.
 - (ii) The lowest part of the insulation assembly **i.e. insulation at neck** shall be properly secured to avoid any risk of damage due to transportation stresses.
 - (iii) The upper part of insulation assembly resting on primary bar shall be properly secured to avoid any damage during transportation due to relative movement between insulation assembly & top dome.
 - (iv) **Bellows made of stainless steel shall be used at the top for hermetic sealing of CT.**
 - (v) Bidder/Manufacturer shall recommend whether any special storage facility is required for spare CT.
- b) Different ratios specified shall be achieved by secondary taps only and primary reconnection shall not be accepted.
 - c) Core lamination shall be of cold rolled grain oriented silicon steel or other equivalent alloys. μ metal or nano-crystalline core can also be used for metering cores.
 - d) The expansion chamber at the top of the porcelain insulators should be suitable for expansion of oil.
 - e) Facilities shall be provided at terminal blocks in the marshalling box for star delta formation, short circuiting and grounding of CT secondary terminals.
 - f) Current Transformer's guaranteed burdens and accuracy class are to be intended as simultaneous for all cores.
 - g) The rated extended currents for 800kV and 420kV class Current transformers shall be as given below:

Tap Ratio	800kV, 3000A	400kV, 3000A
	Rated extended currents in % of rated current	
500/1	200	200
1000/1	---	---
2000/1	180	180
3000/1	120 (200 for 15 min)	120

- h) The secondary winding shall be rated for 2A continuously.

Further, the intermediate tapping at 3000-2000 of metering core of 3000 A rated 400kV and 800kV CTs shall be suitable for using as 1000/1 ratio **also**. The Auxiliary reactor, **if used**, as referred at wiring diagram No.0000-000-T-E-L-028 shall be suitable for connecting to the selected taps. The requirements of 3000A CTs are given at TABLE II-A.

For 245/145/72.5kV class CTs, the rated extended primary current shall be 120% (or 150% if applicable) on all cores of the CTs.

- h) For 800/420/245/145/72.5kV Current Transformer, characteristics shall be such as to provide satisfactory performance of burdens ranging from 25% to 100% of rated burden over a range of 5% to 120% (or specified rated extended current whichever is higher) of rated current in case of metering CTs and up to the accuracy limit factor/knee point voltage in case of relaying CTs.
- i) The current transformer shall be suitable for horizontal transportation. It shall be ensured that the CT is able to withstand all the stresses imposed on it while transporting and there shall be no damage in transit. The Contractor shall submit the details of packing **and transportation** design to the Employer for review.
- j) For 800kV CTs, the instrument security factor at all ratios shall be less than ten (10) for metering core. For 420/245/145/72.5kV CTs, the instrument security factor at all ratios shall be less than five (5) for metering core. If any auxiliary CTs/reactor are used in the current transformers then all parameters specified shall have to be met treating auxiliary CTs as an integral part of the current transformer. The auxiliary CTs/reactor shall preferably be inbuilt construction of the CTs. In case these are to be mounted separately these shall be mounted in the central marshalling box suitably wired upto the terminal blocks.
- k) The wiring diagram plate for the interconnections of the three single phase CTs shall be provided inside the marshalling box. A typical

wiring diagram no. 0000-000-T-E-L-028 (Sh.1 & 2) is enclosed herewith at Annexure-III of this specification.

- l) The Current Transformers should be suitable for mounting on lattice structure (for 800 kV) or pipe structure (for 420 kV and below) to be provided by the Contractor in accordance with stipulations of Section-Project/**Section-Structures**.
- m) The CT shall be designed so as to achieve the minimum risks of explosion in service. Bidder/Manufacturer shall bring out in his offer, the measures taken to achieve this.
- n) 800/420/245/145kV Current Transformers shall be suitable for high speed auto reclosing.

4.0 VOLTAGE TRANSFORMERS:

- a) 800/420/245/145kV Voltage Transformers shall be capacitor voltage divider type with electromagnetic units and shall be suitable for carrier coupling.
- b) Voltage transformers secondaries shall be protected by HRC cartridge type fuses or MCBs for all the windings. In addition, fuses/MCBs shall be provided for the protection and metering windings for fuse monitoring scheme. The secondary terminals of the VTs shall be terminated to the stud type non-disconnecting terminal blocks in the individual phase secondary boxes via the fuse/MCBs.
- c) CVTs shall be suitable for high frequency (HF) coupling required for power line carrier communication. Carrier signal must be prevented from flowing into potential transformer (EMU) circuit by means of a RF choke/reactor suitable for effectively blocking the carrier signals over the entire carrier frequency range i.e. 40 to 500 KHz. H.F. terminal of the CVT shall be brought out through a suitable bushing and shall be easily accessible for connection to the coupling filters of the carrier communication equipment, when utilized. Further, earthing link with fastener to be provided for HF terminal.
- d) The electromagnetic unit comprising compensating reactor, intermediate transformer and protective and damping devices should have separate terminal box with all the secondary terminals brought out.
- e) The damping device, which should be permanently connected to one of the secondary windings, should be capable of suppressing the ferroresonance oscillations.
- f) The accuracy of 0.2 on secondary III for all CVTs/IVTs should be maintained through out the entire burden range upto 50 VA on all the windings without any adjustments during operation.

- g) **The Voltage Transformers shall be suitable for mounting on lattice structure (for 800kV) or Pipe structure (for 420kV and below) to be provided by the Contractor in accordance with stipulations of Section-Project/Section-Structures.**
- h) It should be ensured that access to secondary terminals is without any danger of access to high voltage circuit.
- i) A protective surge arrester shall be provided, if required, to prevent breakdown of insulation by incoming surges and to limit abnormal rise of terminal voltage of shunt capacitor/primary winding, tuning reactor/RF choke etc. due to short circuit in transformer secondaries. **Alternate arrangement shall also be acceptable.**
- j) The wiring diagram for the interconnection of the three single phase CVTs/IVTs shall be provided inside the marshalling box in such a manner that it does not deteriorate with time. Wiring diagram no.: 0000-000-T-E-L-029 enclosed herewith at Annexure-IV **of this specification shall be followed.**

5.0 TERMINAL CONNECTORS:

The terminal connectors shall meet the requirements as given in Section-GTR **and technical parameters for the respective equipment as per Annexure-I and Annexure-II of this specification.**

6.0 TESTS:

6.1 In accordance with the requirements in Section-GTR, Current Transformer and Voltage Transformer should have been type tested and shall be subjected to routine tests in accordance with **relevant IEC.**

6.2 The test reports of type tests, **as applicable, as per IEC-61869-2 for CT, IEC-61869-5/IEC-60358 for CVT, and IEC-61869-3 for IVT** and following additional tests shall be submitted for the Employer's review. **The type tests for which the procedure is under consideration as per abovesaid IEC is not required to be considered.**

a) Current Transformers (CT):

- i) Corona test as per Annexure-A of Section-GTR **for 420kV and above voltage rating.**
- ii) RIV test as per IEC-61869 or as per Annexure-A of Section-GTR **for 145kV and above voltage rating. However, RIV level shall be as specified at Annexure-II of this specification.**

- iii) Seismic withstand test as per Annexure-B of Section-GTR **or IEC-62271-2 (with Seismic acceleration requirement as per Annexure-I of this specification/Section-Project) for 145kV and above voltage rating.**
- iv) Thermal stability test, i.e. application of rated voltage and rated extended thermal current simultaneously by synthetic test circuit **for 145kV and above voltage rating** (not applicable for SF₆ filled CT).
- v) Thermal co-efficient test i.e. measurement of tan-delta as a function of temperature (at ambient and between 80°C & 90°C) and voltage (at 0.3, 0.7, 1.0 and 1.1 U_m/√3) **for 145kV and above voltage rating** (not applicable for SF₆ filled CT).
- vi) Multiple chopped impulse test (not applicable for SF₆ filled CT) with the application of 600 chopped impulses **for 145kV and above voltage rating.**
- vii) **Transmitted over voltage test for 145kV and above voltage rating**
- viii) **Mechanical test (with minimum Cantilever load as per clause no. 2.1.c) for 145kV and above voltage rating**
- ix) **Internal Arc fault test for 145kV and above voltage rating** (not applicable for CT with Polymer Insulator)
- x) **Enclosure tightness test at low & high temperature for SF₆ filled CT of 145kV and above voltage rating**
- xi) **Gas dew point test for SF₆ filled CT**
- xii) **Corrosion test for 145kV and above voltage rating**

b) Capacitive Voltage Transformers (CVT):

- i) High frequency capacitance and equivalent series resistance measurement (as per IEC-60358)
- ii) Seismic withstand test (as per Annexure-B of Section-GTR) **or IEC-62271-2 (with Seismic acceleration requirement as per Annexure-II of this specification/Section-Project) for 145kV and above voltage class.**
- iii) Stray capacitance and stray conductance measurement of the low voltage terminal (as per IEC-60358)

- iv) Corona test as per Annexure-A of Section-GTR for 420kV and above voltage rating.
 - v) RIV test as per IEC-61869 or as per Annexure-A of Section-GTR for 145kV and above voltage rating. However, RIV level shall be as specified at Annexure-II of this specification.
 - vi) Transmitted over voltage test for 145kV and above voltage rating
 - vii) Mechanical test (with minimum Cantilever load as per clause no. 2.1.c) for 72.5kV and above voltage rating
 - viii) Determination of Temperature coefficient for 145kV and above voltage rating
 - ix) Tightness design test of capacitor units for 145kV and above voltage rating
 - x) Corrosion test for 145kV and above voltage rating
- c) Inductive Voltage Transformers (IVT):
- i) Seismic withstand test (as per Annexure-B of Section-GTR) *or* IEC-62271-2 (with Seismic acceleration requirement as per Annexure-II of this specification/Section-Project) for 145kV and above voltage rating.
 - ii) Corona test as per Annexure-A of Section-GTR for 420kV and above voltage rating.
 - ii) RIV test as per IEC-61869 or as per Annexure-A of Section-GTR for 145kV and above voltage rating. However, RIV level shall be as specified at Annexure-II of this specification.
 - iii) Multiple chopped impulse test with application of 600 chopped impulses for 145kV and above voltage rating (not applicable for SF₆ filled CT).
 - iv) Transmitted over voltage test for 145kV and above voltage rating
 - v) Mechanical test (with minimum Cantilever load as per clause no. 2.1.c) for 72.5kV and above voltage rating
 - vi) Enclosure tightness test at low & high temperature for SF₆ filled CT of 145kV and above voltage rating
 - vii) Gas dew point test for SF₆ filled CT

viii) Corrosion test for 145kV and above voltage rating

ix) Measurement of Capacitance and Dielectric dissipation factor for 145kV and above voltage rating

6.3 The current and voltage transformer shall be subjected to the following routine tests in addition to routine tests as per **relevant** IEC:-

a) CURRENT TRANSFORMERS:

ROUTINE TESTS:

For Oil filled CT:

- i) Measurement of Capacitance.
- ii) Oil leakage test.
- iii) Measurement of tan delta at 0.3, 0.7, 1.0 and 1.1 Um/ $\sqrt{3}$.

For SF₆ filled CT:

- i) Dew point measurement
- ii) SF₆ alarm/ lockout check.
- iii) SF₆ gas leakage test: Gas leakage rate shall be maintained within 0.2% per annum.

b) VOLTAGE TRANSFORMERS:

Routine tests on CVT/IVT shall be done in line with IEC-61869-3/61869-5.

7.0 MANDATORY SPARES:

Bidder shall include in his proposal mandatory spares as mentioned in the Bidding Documents.

8.0 MAJOR TECHNICAL PARAMETERS:

Major technical parameters for 800kV/420kV/245kV/145kV/72.5kV Instrument Transformers are enclosed at Annexure-I and Annexure-II to this specification.

9.0 PRE-COMMISSIONING TESTS

9.1 An indicative list of tests is given below. Contractor shall perform any additional test based on specialties of the items as per the field Q.P./Instructions of the equipment Supplier or Employer without any extra cost to the Employer. **The Contractor shall arrange all instruments**

required for conducting these tests alongwith calibration certificates at his own cost.

9.2 Current Transformers

- (a) Insulation Resistance Test for primary and secondary
- (b) Polarity test
- (c) Ratio identification test - checking of all ratios on all cores by primary injection of current
- (d) Dielectric test of oil (wherever applicable)
- (e) Magnetizing characteristics test
- (f) Tan delta and capacitance measurement
- (g) Secondary winding resistance measurement
- (h) Contact resistance measurement (wherever possible/accessible)
- (i) Test for SF₆ (for SF₆ filled CTs) – Dew point measurement, SF₆ alarm/lockout check
- (j) DGA test of oil

Dissolved Gas Analysis (DGA) shall be carried out twice within the first year of service, first within the first month of commissioning/charging and second between six months to one year from the date of commissioning/charging.

CTs/IVTs must have adequate provision for taking oil samples from the bottom of the CT/IVT without exposure to atmosphere. Manufacturer shall recommend the frequency at which oil samples should be taken and norms for various gases in oil after being in operation for different durations. ~~Bidder~~/Manufacturer should also indicate the total quantity of oil which can be withdrawn from CT for gas analysis before refilling or further treatment of CT becomes necessary.

Bidder shall supply 2 nos. oil sampling device for every 20 nos. oil filled CT supplied with a minimum of 2 nos. oil sampling device for each substation.

9.3 Inductive Voltage Transformers/Capacitive Voltage Transformers

- (a) Insulation Resistance test for primary (if applicable) and secondary winding
- (b) Polarity test
- (c) Ratio test
- (d) Dielectric test of oil (wherever applicable)

- (e) Tan delta and capacitance measurement of individual capacitor stacks
- (f) Secondary winding resistance measurement

For pre-commissioning procedures and formats for Current Transformers, Doc.No.: CF/CT/04/R-4 dtd-01.04.2013 and for Voltage Transformers, CF/CVT/05/R-4 dtd-01.04.2011 under POWERGRID document no. D-2-01-03-01-04 will be the reference document. **This document will be available at respective sites and shall be referred by the contractor.**

10.0 Defect Liability

The actions required to be taken by contractor in case of defects observed in CT/CVT of ratings 145kV & above during the warranty period (defect liability period) shall be as per enclosed Annexure-V of this specification. Further, the replaced/repared/refurbished equipment (or part of equipment) shall have Two (2) years warranty without prejudice to contractual warranty period (defect liability period).

TABLE - IA
REQUIREMENTS OF 800 KV CAPACITIVE VOLTAGE TRANSFORMER

S.No.	PARTICULAR			
1.	Rated primary voltage (kV rms)	800		
2.	Type	Single phase Capacitor VT		
3.	No. of secondaries	3		
4.	Rated voltage factor	1.2 continuous		
		1.5 - 30 seconds		
5.	Phase angle error	± 10 minutes (For metering core)		
6.	Capacitance (pf)	4400/8800* (+10% /- 5%)		
7.	Core details	Core-1	Core-2	Core-3
	a) Voltage Ratio	$\frac{765/0.11}{\sqrt{3} \sqrt{3}}$	$\frac{765/0.11}{\sqrt{3} \sqrt{3}}$	$\frac{765/0.11}{\sqrt{3} \sqrt{3}}$
	b) Application	Protection	Protection	Metering
	c) Accuracy	0.5&3P	0.5&3P	0.2
	d) Min. Output burden (VA)	50	50	50

* Capacitance value shall be as specified in BPS.

TABLE - IB
REQUIREMENTS OF 420 KV VOLTAGE TRANSFORMER

S.No.	PARTICULAR			
1.	Rated primary voltage (kV rms)	420		
2.	Type	Single phase Electromagnetic or Capacitor VT		
3.	No. of secondaries	3		
4.	Rated voltage factor	1.2 continuous 1.5 - 30 seconds		
5.	Phase angle error	± 10 minutes (For metering core)		
6.	Capacitance (pf) (for CVT)	4400/8800* (+10% / - 5%)		
7.	Core details	Core-1	Core-2	Core-3
	a) Voltage Ratio	$\frac{400/0.11}{\sqrt{3} \sqrt{3}}$	$\frac{400/0.11}{\sqrt{3} \sqrt{3}}$	$\frac{400/0.11}{\sqrt{3} \sqrt{3}}$
	b) Application	Protec- tion	Protec- tion	Meter- ing
	c) Accuracy	0.5&3P	0.5&3P	0.2
	d) Min. Output burden (VA)	50	50	50

* Capacitance value shall be as specified in BPS.

TABLE - IC
REQUIREMENTS OF 245 KV VOLTAGE TRANSFORMER

S.No.	PARTICULAR	
1.	Rated primary voltage (kV rms)	245
2.	Type	Single phase Electromagnetic or Capacitor VT
3.	No. of secondaries	3 cores
4.	Rated voltage factor	1.2 continuous 1.5 - 30 seconds
5.	Phase angle error	± 10 minutes (For metering core)
6.	Capacitance (pf) (for CVT)	4400/8800* (+10% / - 5%)
7.	Core details	Core-1 Core-2 Core-3
	a) Voltage Ratio	$\frac{220/0.11}{\sqrt{3} \sqrt{3}} \quad \frac{220/0.11}{\sqrt{3} \sqrt{3}} \quad \frac{220/0.11}{\sqrt{3} \sqrt{3}}$
	b) Application	Protec- tion Protec- tion Meter- ing
	c) Accuracy	3P 3P 0.2
	d) Min. Output burden (VA)	50 50 50

* Capacitance value shall be as specified in BPS.

TABLE - ID
REQUIREMENTS OF 145 KV VOLTAGE TRANSFORMER

S.No.	PARTICULAR	
1.	Rated primary voltage (kV rms)	145
2.	Type	Single phase Electromagnetic or Capacitor VT
3.	No. of secondaries	3 cores
4.	Rated voltage factor	1.2 continuous 1.5 - 30 seconds
5.	Phase angle error	± 10 minutes (For metering core)
6.	Capacitance (pf) (for CVT)	8800 (+ 10% / -5%)
7.	Core details	Core-1 Core-2 Core-3
	a) Voltage Ratio	$\frac{132/0.11}{\sqrt{3} \sqrt{3}}$ $\frac{132/0.11}{\sqrt{3} \sqrt{3}}$ $\frac{132/0.11}{\sqrt{3} \sqrt{3}}$
	b) Application	Protec- tion Protec- tion Meter- ing
	c) Accuracy	3P 3P 0.2
	d) Min. Output burden (VA)	50 50 50

TABLE - IE
REQUIREMENTS OF 72.5 KV VOLTAGE TRANSFORMER

S.No.	PARTICULAR		
1.	Rated primary voltage (kV rms)	72.5	
2.	Type	Single phase Electro-magnetic or Capacitive VT	
3.	No. of secondaries	2 cores	
4.	Rated Voltage Factor	1.2 continuous 1.5 – 30 seconds	
5.	Phase angle error	+ 20 minutes (For metering core)	
6.	Core details	Core-1	Core-2
	a) Voltage ratio	For 66 kV feeder application $66/\sqrt{3} / 0.11/\sqrt{3}$ $66/\sqrt{3} / 0.11/\sqrt{3}$	
		For tertiary loading (of ICT) application $33/\sqrt{3} / 0.11/\sqrt{3}$ $33/\sqrt{3} / 0.11/\sqrt{3}$	
	b) Application	Protection	Metering
	c) Accuracy	3P	0.5
	d) Output Burden (VA) (minimum)	10	10

TABLE-IIA

REQUIREMENTS FOR 800 KV CURRENT TRANSFORMER

No. of Cores.	Core No.	Application	Current Ratio	Output Burden (VA)	Accuracy Class	Min. Knee Pt. Voltage (Vk)	Max. CT Sec. wdg. Resistance (in Ω)	Max. Excit. Current at Vk (in mA)
6	1	BUS DIFF. CHECK	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	2.	BUS DIFF. MAIN	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	3.	METERING	3000/ 2000/ 500/1	20	0.2S	-	-	-
				20	0.2S	-	-	-
				20	0.2S	-	-	-
	4.	METERING	3000/ 2000/ 500/1	20	0.2S	-	-	-
				20	0.2S	-	-	-
				20	0.2S	-	-	-
	5.	TRANSF DIFF./ LINE PROTN.	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	6	LINE PROTN/LBB PROTN.	3000- 2000- 500/1	-	PX	3000/ 2000 500	15/10/2.5	20 on 3000/1 Tap,30 on 2000/1 Tap,120 on 500/1 Tap

Note: 1. Protection cores shall be of accuracy class PX as per IEC 61869.
2. Metering Core shall be of accuracy class 0.2S as per IEC: 61869

TABLE-IIB**REQUIREMENTS FOR 420 KV CURRENT TRANSFORMER**

No. of cores	Core No.	Application	Ratio	Output Burden	Accuracy Class	Min. Knee Pt. Voltage (Vk)	Max. CT Sec. wdg. Resistance (in Ω)	Max. Excit. Current at Vk (in mA)
6	1	BUS DIFF. CHECK	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	2.	BUS DIFF. MAIN	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	3.	METERING	3000/ 2000/ 500/1	20 20 20	0.2S 0.2S 0.2S	- - -		- - -
	4.	METERING	3000/ 2000/ 500/1	20 20 20	0.2S 0.2S 0.2S	- - -		- - -
	5.	TRANS. BACK UP/LINE PROTN.	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap
	6.	TRANS. DIFF. /LINE PROTN.	3000/ 2000/ 500/1	-	PX	3000/ 2000/ 500	15/10/2.5	20 on 3000/1 TAP; 30 on 2000/1; 120 on 500/1 tap

Note: 1. Protection cores shall be of accuracy class PX as per IEC 61869.

2. Metering Core shall be of accuracy class 0.2S as per IEC: 61869

TABLE - IIC
REQUIREMENTS FOR 245 KV CURRENT TRANSFORMER

No.of Cores	Core No.	Appli-cation	Current ratio	Output burden (VA)	Accuracy class	Min. knee pt.volt-age (Vk)	Max. CT sec.wdg. resist-ance(ohms)	Max. Excit-ation cur-rent at Vk (in mA)
5	1	BUS DIFF CHECK	1600-800/1	-	PX	1600/800	8/4	25 on 1600/1 Tap; 50 on 800/1 Tap
	2	BUS DIFF MAIN	1600-800/1	-	PX	1600/800	8/4	25 on 1600/1 Tap; 50 on 800/1 Tap
	3	METERING	1600-800/1	20	0.2S	-	-	-
	4	TRANS. BACK UP/LINE PROTN.	1600-800/1	-	PX	1600/800	8/4	25 on 1600/1 Tap; 50 on 800/1 Tap
	5	TRANS. DIFF/LINE PROTN	1600-800/1	-	PX	1600/800	8/4	25 on 1600/1 Tap; 50 on 800/1 Tap

Note: 1. Protection cores shall be of accuracy class PX as per IEC 61869.
2. Metering Core shall be of accuracy class 0.2S as per IEC: 61869

TABLE - IID**REQUIREMENTS FOR 145 KV CURRENT TRANSFORMER**

No.of Cores	Core No.	Appli-cation	Current ratio	Output burden (VA)	Accuracy class	Min. knee pt.volt-age Vk	Max. CT sec.wdg. resist-ance(ohms)	Max. Excit-ation cur-rent at Vk (in mA)
5	1	BUS DIFF CHECK	800-400/1	-	PX	800/400	8/4	25 on 800/1 Tap; 50 on 400/1 Tap
	2	BUS DIFF MAIN	800-400/1	-	PX	800/400	8/4	25 on 800/1 Tap; 50 on 400/1 Tap
	3	METERING	800-400/1	20	0.2S	-	-	-
	4	TRANS. BACK UP/LINE PROTN.	800-400/1	-	PX	800/400	8/4	25 on 800/1 Tap; 50 on 400/1 Tap
	5	TRANS. DIFF/LINE PROTN	800-400/1	-	PX	800/400	8/4	25 on 800/1 Tap; 50 on 400/1 Tap

Note: 1. Protection cores shall be of accuracy class PX as per IEC 61869.

2. Metering Core shall be of accuracy class 0.2S as per IEC: 61869

TABLE – IIE

REQUIREMENTS FOR 145 kV CURRENT TRANSFORMER

No.of Cores	Core No.	Appli- cation	Current ratio	Output burden (VA)	Accuracy class	Min. knee pt.volt- age Vk	Max. CT sec.wdg. resist- ance(ohms)	Max. Excit- ation cur- rent at Vk (in mA)
5	1	BUS DIFF CHECK	600-300/1	-	PX	600/300	6/3	30 on 600/1 Tap; 60 on 300/1 Tap
	2	BUS DIFF MAIN	600-300/1	-	PX	600/300	6/3	30 on 600/1 Tap; on 300/1 Tap
	3	METERING	300-150/1	20	0.2S	-	-	-
	4	TRANS. BACK UP/LINE PROTN.	600-300/1	-	PX	600/300	6/3	30 on 600/1 Tap; 60 on 300/1 Tap
	5	TRANS. DIFF/LINE PROTN	600-300/1	-	PX	600/300	6/3	30 on 600/1 Tap; 60 on 300/1 Tap

Note: 1. Protection cores shall be of accuracy class PX as per IEC 61869.
2. Metering Core shall be of accuracy class 0.2S as per IEC: 61869

TABLE – IIF

**REQUIREMENTS FOR 72.5 kV CURRENT TRANSFORMER
(FOR TERTIARY LOADING OF ICT)**

No. of Cores	Core No.	Application	Current Ratio	Output burden (VA)	Accuracy class & ALF
2	1	O/C & E/F	50/1	10	5P10
	2	Metering	50/1	10	0.5

Annexure-I

MAJOR TECHNICAL PARAMETERS FOR CT

S. No.	Description	765kV system	400kV system	220kV system	132 kV system	66 kV System (for Tertiary loading)
1	Rated voltage, U _m (kVrms)	800	420	245	145	72.5
2	Rated frequency (Hz)	50	50	50	50	50
3	No. of Poles	1	1	1	1	1
4	Design ambient temperature (°C)	50	50	50	50	50
5	Rated Primary Current (A)	3000	3000	1600	800/600	50
6	Rated extended primary current	120%	120%	120%/150%	120%/150 %	120%
7	Rated short time thermal withstand current	40kA/50kA (as applicable) for 1 sec	40kA/50kA/63kA (as applicable) for 1 sec	40kA/50kA (as applicable) for 1 sec	31.5kA for 1sec	25kA for 3sec
8	Rated dynamic current	100kAp/125kAp (as applicable)	100kAp/125kAp/ 157.5kAp (as applicable)	100kAp/125kAp (as applicable)	80kAp	63kAp
9	Temperature rise over design ambient temperature	As per IEC				
10	Rated Insulation levels					
a)	Full wave impulse withstand voltage (1.2/50 microsecond)					
i)	between line terminals and ground(kVpeak)	±2100	±1425	±1050	±650	±325
b)	Switching impulse withstand voltage (250/2500 microsecond) (dry and wet)					
i)	between line terminals and ground (kVpeak)	± 1550	± 1050	-NA-	-NA-	-NA-
c)	One minute power frequency dry withstand voltage (dry and wet)					
i)	between line terminals and ground (kVrms)	975 (dry only)	630 (dry only)	460	275	140
d)	One minute power frequency withstand voltage between secondary terminals & earth (kVrms)	5kV				

S. No.	Description	765kV system	400kV system	220kV system	132 kV system	66 kV System (for Tertiary loading)
11	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz at (microvolts)	2500 at 508 kV rms	1000 at 266kV rms	1000 at 156kV rms	500 at 92kV rms	-NA-
12	Minimum Corona extinction voltage (kVrms)	508	320	-NA-	-NA-	-NA-
13	Seismic acceleration (Horizontal)	0.3g	0.3g	0.3g	0.3g	-NA-
14	Partial Discharge	As per IEC	As per IEC	As per IEC	As per IEC	As per IEC
15	Number of terminals	All terminals of control circuits are to be wired up to marshaling box plus 20% spare terminals evenly distributed on all TBs.				
16	Minimum Creepage distance (mm) *	20000	10500	6125	3625	1813
17	System neutral earthing	Effectively Earthed				

*The values indicated are for specific creepage of 25mm/kV. In case of specific creepage of 31mm/kV is specified, the Minimum Creepage distance values shall be considered proportionately.

For other parameters, refer respective Table for the applicable voltage class of CTs.

Annexure-II

MAJOR TECHNICAL PARAMETERS FOR CVT/IVT


S. No.	Description	765kV system	400kV system	220kV system	132 kV system	66 kV System (for tertiary loading)
1	Type (CVT/IVT)	CVT	CVT/IVT	CVT/IVT	CVT/IVT	CVT/IVT
2	Rated voltage, U _m (kVrms)	800	420	245	145	72.5
3	Rated frequency (Hz)	50	50	50	50	50
4	No. of Poles	1	1	1	1	1
5	Design ambient temperature (°C)	50	50	50	50	50
6	System fault level (kA)	40kA/50kA (as applicable) for 1 sec	40kA/50kA/63kA (as applicable) for 1 sec	40kA/50kA (as applicable) for 1 sec	31.5kA for 1sec	25kA for 3sec
6	Standard reference range of frequencies for which the accuracies are valid	96% to 102% for protection and 99% to 101% for measurement				
7	High frequency capacitance for entire carrier frequency range (for CVT only)	Within 80% to 150% of rated capacitance				-
8	Equivalent series resistance over entire carrier frequency range (for CVT)	Less than 40 Ohms				-
9	Stray capacitance and stray conductance of HF terminal over entire carrier frequency range (for CVT)	As per IEC-60358				-
10	Temperature rise over design ambient temperature	As per IEC				
11	Rated Insulation levels					
a)	Full wave impulse withstand voltage (1.2/50 microsecond)					
i)	between line terminals and ground (kVpeak)	±2100	±1425	±1050	±650	±325
b)	Switching impulse withstand voltage (250/2500 microsecond) (dry and wet)					

S. No.	Description	765kV system	400kV system	220kV system	132 kV system	66 kV System (for tertiary loading)
i)	between line terminals and ground (kVpeak)	± 1550	± 1050	-NA-	-NA-	-NA-
c)	One minute power frequency dry withstand voltage (dry and wet)					
i)	between line terminals and ground (kVrms)	975 (dry only)	630 (dry only)	460	275	140
d)	One minute power frequency withstand voltage between secondary terminals & earth					
i)	between LV (HF) terminal and earth terminal (kVrms)	10kVrms for exposed terminals and 4kVrms for terminals enclosed in a weather proof box				
ii)	For secondary winding	3kVrms				
11	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz at (microvolts)	2500 at 508 kV rms	1000 at 266kV rms	1000 at 156kV rms	500 at 92kV rms	-NA-
12	Minimum Corona extinction voltage (kVrms)	508	320	-NA-	-NA-	-NA-
13	Seismic acceleration (Horizontal)	0.3g	0.3g	0.3g	0.3g	-NA-
14	Partial Discharge	As per IEC	As per IEC	As per IEC	As per IEC	As per IEC
15	Number of terminals	All terminals of control circuits are to be wired up to marshaling box plus 20% spare terminals evenly distributed on all TBs.				
16	Rated Total Thermal Burden (VA)	300 VA (100VA/winding)				20VA
17	System neutral earthing	Effectively Earthed				
	Minimum Creepage distance (mm) *	20000	10500	6125	3625	1813

*The values indicated are for specific creepage of 25mm/kV. In case of specific creepage of 31mm/kV is specified, the Minimum Creepage distance values shall be considered proportionately.

For other parameters, refer respective Table for the applicable voltage class of CVTs/IVTs.

Annexure-III: Wiring Diagram of CT

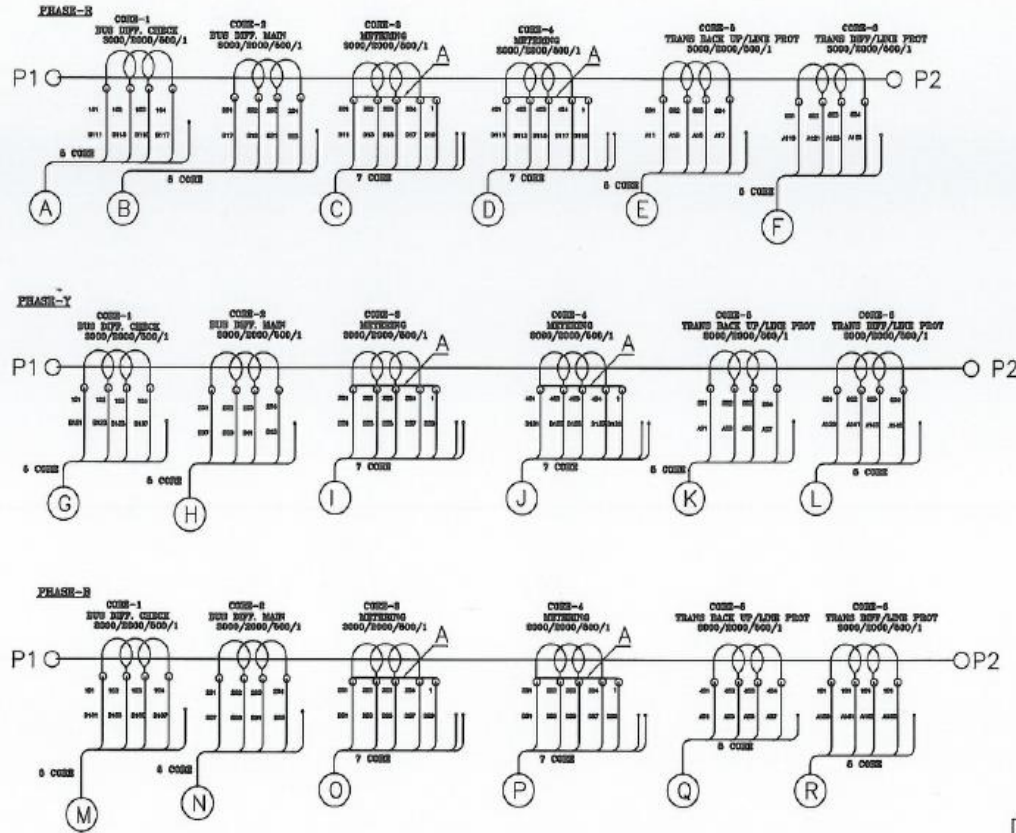


NOTE

1. INTERPOLE CABLING (A) TO (R) 2.5 SQ.MM STRANDED FLEXIBLE ARMoured COPPER CABLE OF 1100V GRADE (FROM CT SEC TO MARSHALLING BOX).


FOR TENDER PURPOSE ONLY

POWER GRID CORPORATION OF INDIA LIMITED (A Government of India Enterprise)	
PROJECT :	STANDARD
TITLE:	WIRING DIAGRAM OF MARSHALLING BOX FOR 786KV/400KV CT
DRAWN	Drawing No.: 0000-000-7-R-1-003 PAGE 1 OF 5
	REV. 1


Annexure-III: Wiring Diagram of CT

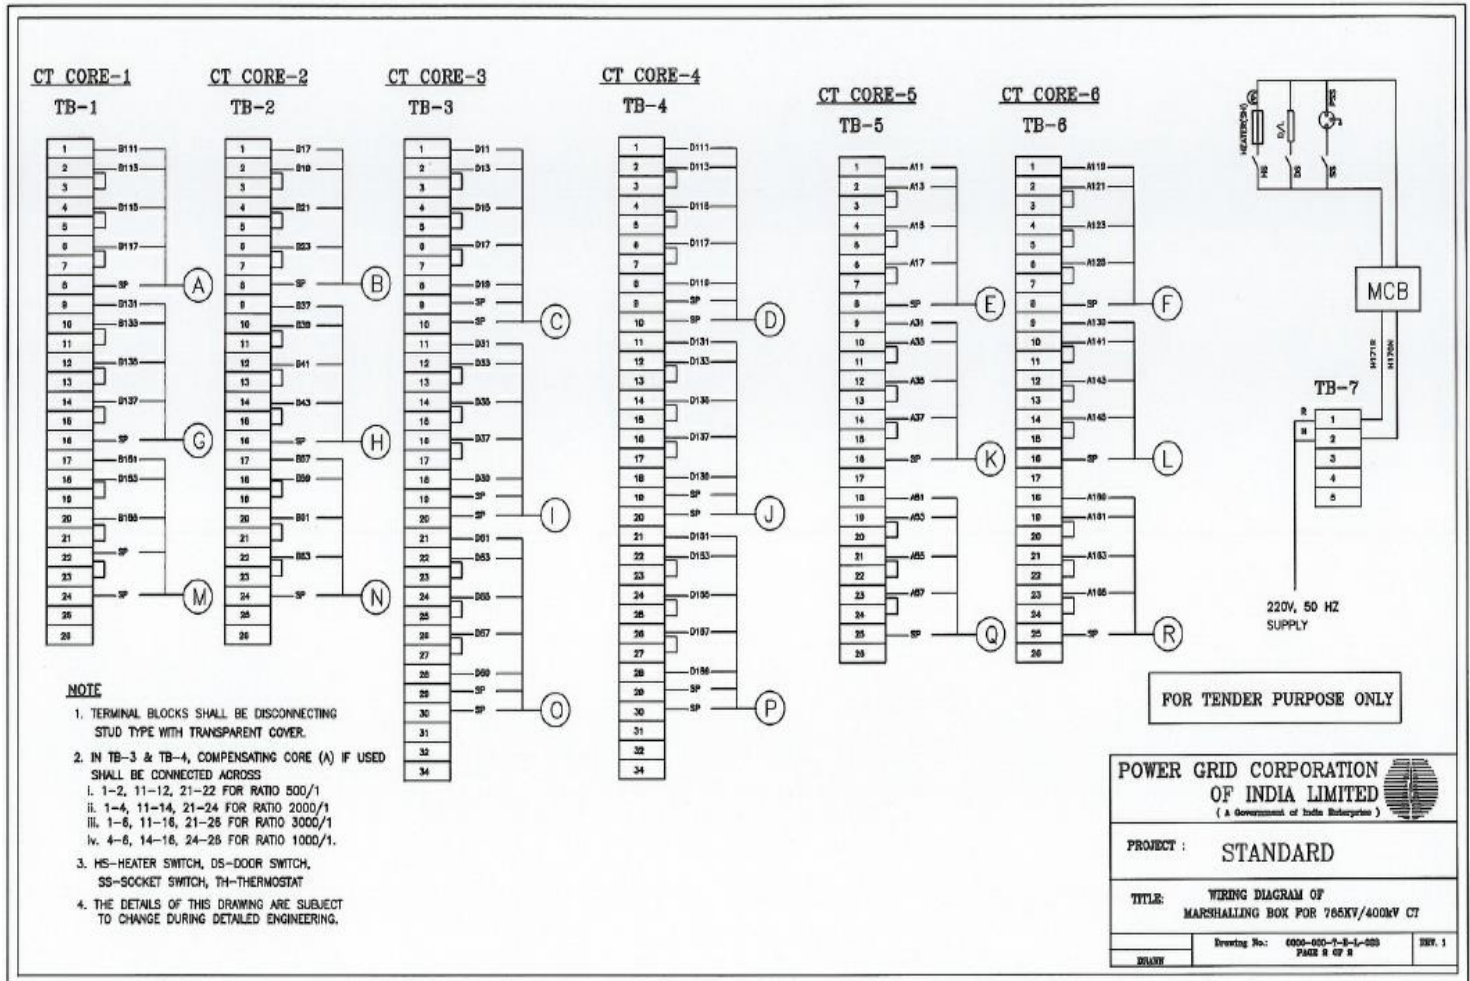

Annexure-IV: Wiring Diagram of VT

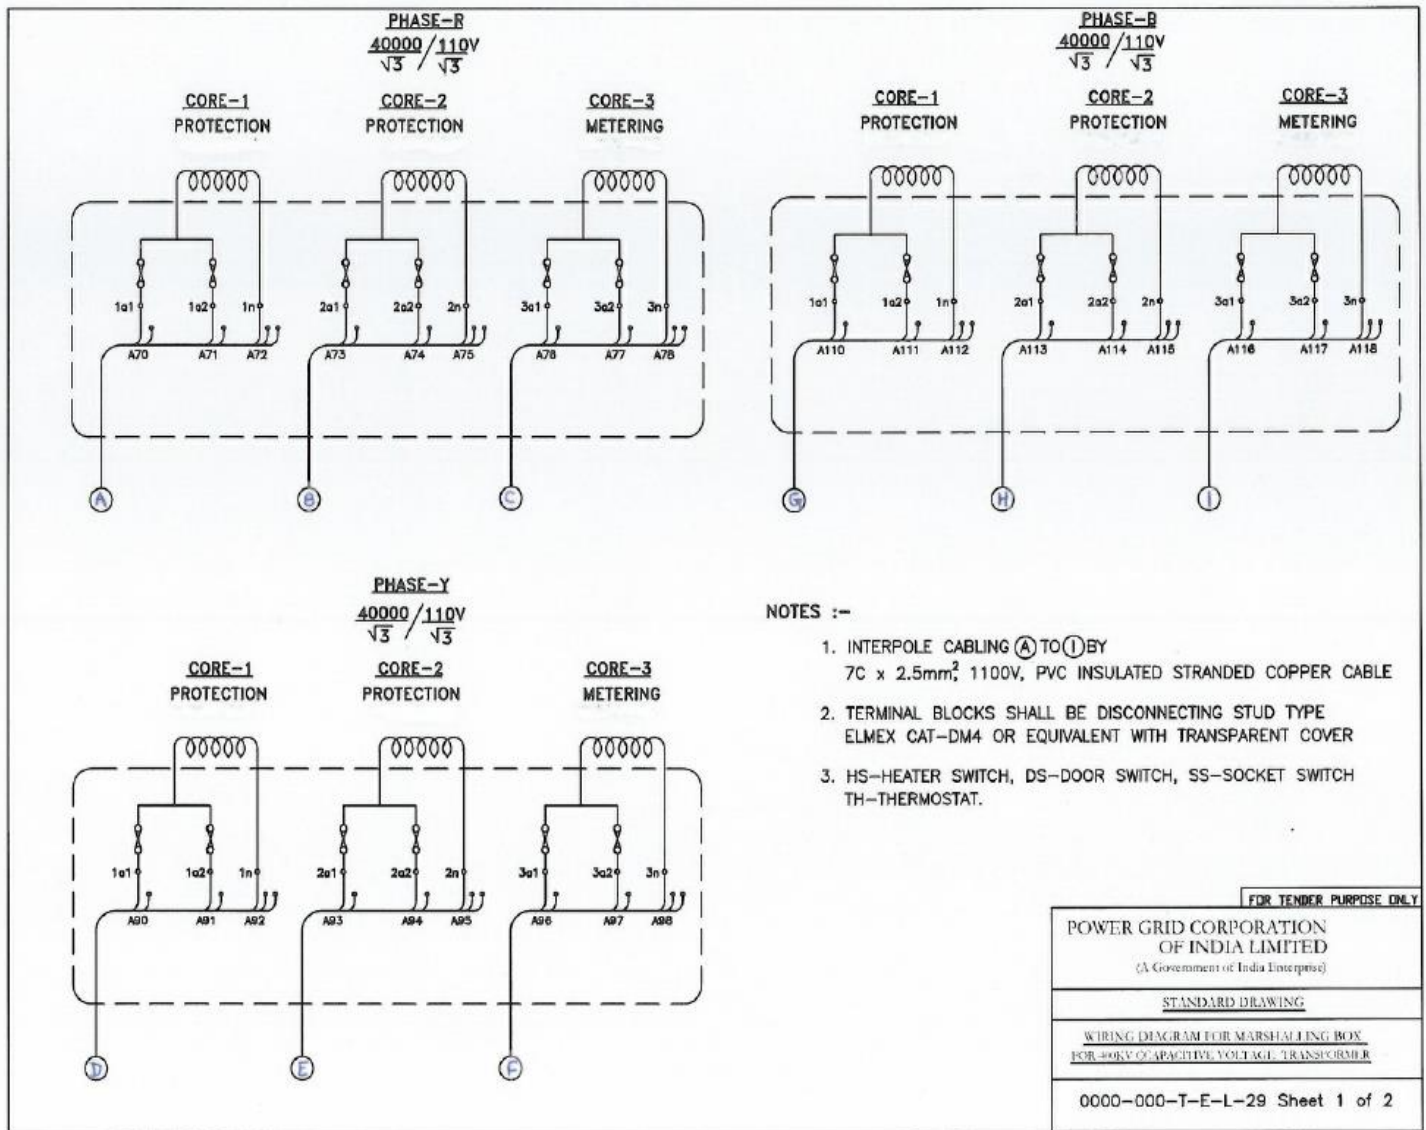

Annexure-IV: Wiring Diagram of VT

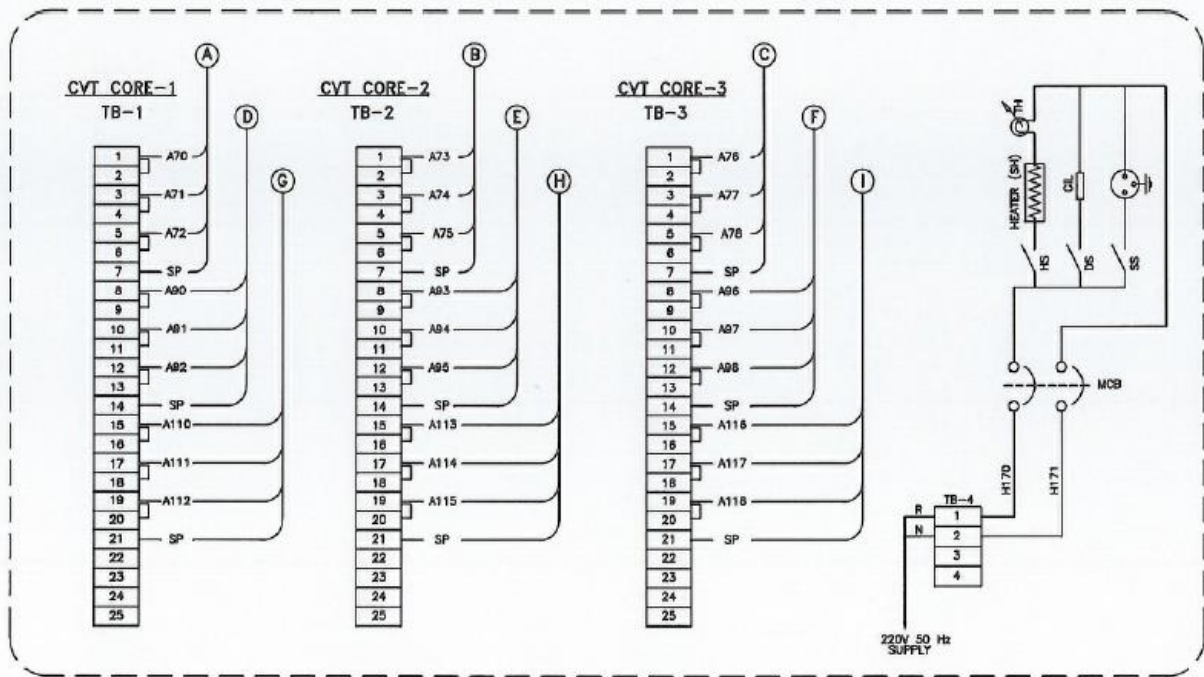

CVT MARSHALLING BOX

NOTES :-

1. INTERPOLE CABLING (A) TO (I) BY
7C x 2.5mm, 1100V, PVC INSULATED STRANDED COPPER CABLE
2. TERMINAL BLOCKS SHALL BE DISCONNECTING STUD TYPE
ELMEX CAT-DM4 OR EQUIVALENT WITH TRANSPARENT COVER
3. HS-HEATER SWITCH, DS-DOOR SWITCH, SS-SOCKET SWITCH
TH-THERMOSTAT.

FOR TENDER PURPOSE ONLY

POWER GRID CORPORATION
OF INDIA LIMITED
(A Government of India Enterprise)

STANDARD DRAWING

WIRING DIAGRAM FOR MARSHALLING BOX
FOR 400KV CAPACITIVE VOLTAGE TRANSFORMER

0000-000-T-E-L-29 Sheet 2 of 2

Annexure-V: Actions required in case of defects observed during warrantee period

Equipment	Nature of problem	Corrective measures to be taken by contractor
CT (Oil filled)	DGA Violation H ₂ > 300 ppm C ₂ H ₂ > 2 ppm	CT to be refurbished or replaced
CT (SF ₆ filled)	a) SF ₆ gas leakage b) High Dew point of SF ₆ gas (> -36 deg C at atm press)	a) Repair/ replacement b) Re-processing of gas and replacement of Gas in case of no improvement
CT (Oil filled)	Violation of Tan delta Tan Delta: >0.5%(during pre-commissioning) >0.7% (in operation) or change w.r.t. to previous year value > 0.1%	Replacement of CT
CT & CVT	- Oil leakage - Low Oil level - Sec winding problem leading to open/ short circuit, saturation etc	Replacement or repair as per repair procedure approved by QA.
CVT	Secondary voltage drift: Upto ± 0.5 volts Healthy a) ± 0.5 or beyond	a) CVT to be replaced

***Replaced/Repaired/Refurbished Equipment (or part of equipment) shall have 2 years warranty without prejudice to contractual warranty period.**



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

SECTION-3

Refer document

General Technical Requirements: TB-409-316-000 Rev 00.



BHARAT HEAVY ELECTRICALS LIMITED
TRANSMISSION BUSINESS HVDC & SYSTEMS

COPYRIGHT AND CONFIDENTIALITY

The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD.

It must not be used directly or indirectly in anyway detrimental to the interest of the company

DOCUMENT No.	TB-409-316-000	Rev. No.	00	Prepared	Checked	Approved		
TYPE OF DOC.	TECHNICAL SPECIFICATION			SIGN	312000			
TITLE GENERAL TECHNICAL REQUIREMENTS-SECTION 3				NAME	NS	SKS	AG	
				DATE	18.12.19	18.12.19	18.12.19	
				GROUP	HVDC	W.O. No	Awaited	
CUSTOMER	Powergrid Corporation of India Ltd. (POWERGRID)							
PROJECT	Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route							
NOA NO.	FTL/765kV/SS02/NOAI/2(I) For Supply of Goods Contract Dated 05-11-19 & FTL/765kV/SS02/NOAII/2(II) For Supply of Service Contract Dated 05-11-2019							
Station	Fatehgarh-2, Rajasthan and Bhadla-2, Rajasthan							
S.No.	Description					Sheet		
1	General Technical Requirements – Site Information					1		
2	General Technical Requirements					2-30		
3	Annexure -A					2 Sheets		
4	Annexure -B					1 Sheets		
5	Annexure -C					23 Sheets		
6	Annexure -G					3 Sheets		
Rev No.	Date	Altered	Checked	Approved	REVISION DETAILS			
Distribution				To	HVDC	TBMM	TBQM	Supplier
				Copies	1	1	1	4



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

GENERAL TECHNICAL REQUIREMENTS-SECTION 3

Site Information

S.No.	Particular	Details
a)	Owner	Fatehgarh-II Transco Limited- a 100% wholly owned subsidiary of Power Grid Corporation of India Limited
b)	Customer	Fatehgarh-II Transco Limited- a 100% wholly owned subsidiary of Power Grid Corporation of India Limited
c)	Project Title	Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
d)	Location	Fatehgarh-2, Rajasthan Bhadla-2, Rajasthan
e)	Transport Facilities	Road/Train Nearest Rail Head For Fatehgarh-2: Fatehgarh Nearest Rail Head For Bhadla-2: Nokha
SITE CONDITIONS		
a)	Max. ambient air temp.	50°C
b)	Min. ambient air temp.	0°C
c)	Max. design ambient temp.	50°C
d)	Design reference temp.	50°C
e)	Average Humidity	Max. 100%
f)	Special corrosion conditions	No
g)	Solar Radiation	1.2kW/sqmtr
h)	Atmospheric UV radiation	High
i)	Altitude above sea level	Less than 1000 meter above mean sea level (MSL)
j)	Pollution Severity	High Pollution level
k)	Seismic Zone	As per IS 1893 but not less than 0.3g horizontal
WIND DATA		
	Wind velocity	As per IS-875
	Average No. of thunderstorm days per annum	As per IS
Main Electrical Parameters:		
	Fault Levels:	765kV: 40kA for 1 sec
	Creepage Distance	25mm/kV for All Equipment i.e BPI/Bushings, CB, Isolator, CT, CVT, LA, WT, NCT etc. 31mm/kV for string insulators



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

GENERAL TECHNICAL REQUIREMENTS-SECTION 3

INDEX

Clause No.	Item	Page No.
1.0	Foreword	4
2.0	General Requirement	4
3.0	Standards	5
4.0	Services to be performed by the Equipment being furnished	6
5.0	Engineering Data and Drawings	7
6.0	Material/Workmanship	10
7.0	Design Improvements/Coordination	12
8.0	Quality Assurance Programme	13
9.0	Type Testing & Clearance Certificates	19
10.0	Deleted.	20
11.0	Packaging & Protection	20
12.0	Finishing of Metal Surfaces	20
13.0	Deleted	22
14.0	Tools	22
15.0	Auxiliary Supply	23
16.0	Support Structure	23
17.0	Clamps and Connectors including Terminal Connectors	23
18.0	Control Cabinets, Junction Boxes, Terminal Boxes & Marshalling Boxes for Outdoor Equipment	25
19.0	Deleted	26
20.0	Terminal Blocks and Wiring	26
21.0	Lamps and Sockets	27
22.0	Bushings, Hollow Column Insulators, Support Insulators	28
23.0	Motors	29
Annexure-A	Corona and Radio Interference Voltage (RIV) Test	2 sheets
Annexure-B	Seismic Withstand Test Procedure	1 sheet
Annexure-C	List of General Standards and Codes	23 sheets
Annexure-G	MQP & Inspection Level Requirement	3 sheets



GENERAL TECHNICAL REQUIREMENTS-SECTION 3

1.0 FOREWORD

The provisions under this section are intended to supplement requirements for the materials, equipments and services covered under other sections of tender documents and are not exclusive.

The Supplier shall note that the standards mentioned herein are not mutually exclusive or complete in themselves, but are intended to complement each other, with minimum repetition, to define the requirements of the Specification. In the event of a conflict between requirements of any two clauses of the Specification/ documents or requirements of different codes/ standards specified, the more stringent requirement as per the interpretation of the owner shall apply, unless confirmed otherwise by the owner in writing based on a written request from the Supplier.

In case of conflicting requirements between this document (General Technical Requirement Section 3) and equipment specification (Section 1 & Section 2), equipment specification shall prevail.

When specific requirements stipulated in the Specification exceed or change those required by the applicable standards, the stipulations of the Specification shall take precedence.

Unless specifically agreed to by the Purchaser prior to Award of Contract, the Work shall be in accordance with the standards indicated and the requirements of the Specification. The Supplier shall be held responsible for any deviation.

In case of conflict between the various standards, the decision of owner shall be binding & final.

2.0 GENERAL REQUIREMENT

The following words and expressions shall have the meanings hereby assigned to them throughout this document

"Employer/Owner" means Power Grid Corporation of India Ltd.

"Purchaser" means Bharat Heavy Electricals Limited

"Supplier/Manufacturer/Bidder" means the person or persons, firm or company assigned to execute the works as defined by the scope of supply, described here.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

"Specification" refers to this document.

The supplier should be approved by Power Grid. If not, it is the responsibility of the vendor to be assessed and approved by Power Grid, before placement of order by BHEL. Any cost involved in vendor assessment/approval must be borne by the vendor himself.

- 2.1 The Supplier/Manufacturer shall furnish catalogues, engineering data, technical information, design documents, drawings etc., fully in conformity with the technical specification during detailed engineering.
- 2.2 It is recognised that the Bidder may have standardised on the use of certain components, materials, processes or procedures different from those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered provided such proposals meet the specified designs, standard and performance requirements and are acceptable to Employer.
- 2.3 Wherever a material or article is specified or defined by the name of a particular brand, Manufacturer or Vendor, the specific name mentioned shall be understood as establishing type, function and quality and not as limiting competition.
- 2.4 Equipment furnished shall be complete in every respect with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or needed for erection, completion and safe operation of the equipment as required by applicable codes though they may not have been specifically detailed in the Technical Specifications unless included in the list of exclusions. Materials and components which are minor in nature and incidental to the requirement but not specifically stated in the specification, which are necessary for commissioning and satisfactory operation of the switchyard/ substation unless specifically excluded shall be deemed to be included in the scope of the specification and shall be supplied without any extra cost. All similar standard components/parts of similar standard equipment provided, shall be inter-changeable with one another.
- 2.5 Deleted.
- 2.6 Deleted.

3.0 STANDARDS

- 3.1 The works covered by the specification shall be designed, engineered, manufactured, built, tested and commissioned in accordance with the Acts, Rules, Laws and Regulations of India.
- 3.2 The equipment to be furnished under this specification shall conform to latest issue with all amendments (as on the originally scheduled date of bid opening) of standard specified under Annexure-C of this section, unless specifically mentioned in the specification.
- 3.3 The Bidder shall note that standards mentioned in the specification are not mutually exclusive or complete in themselves, but intended to compliment each other.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 3.4 The Bidder shall also note that list of standards presented in this specification is not complete. Whenever necessary the list of standards shall be considered in conjunction with specific IS/IEC.
- 3.5 When the specific requirements stipulated in the specifications exceed or differ than those required by the applicable standards, the stipulation of the specification shall take precedence.
- 3.6 Other internationally accepted standards which ensure equivalent or better performance than that specified in the standards specified under Annexure-C/individual sections for various equipments shall also, be accepted, however the salient points of difference shall be clearly brought out during detailed engineering along with English language version of such standard. The equipment conforming to standards other than specified under Annexure-C/ individual sections for various equipments shall be subject to Employer's approval.

4.0 SERVICES TO BE PERFORMED BY THE EQUIPMENT BEING FURNISHED

- 4.1 The 800kV system is being designed to limit the switching surge over voltage of 1.9 p.u. and the power frequency over voltage of 1.4 p.u. The equipment furnished under this specification shall perform all its functions and operate satisfactorily without showing undue strain, restrike etc under such over voltage conditions.
- 4.2 All equipments shall also perform satisfactorily under various other electrical, electromechanical and meteorological conditions of the site of installation.
- 4.3 All equipment shall be able to withstand all external and internal mechanical, thermal and electromechanical forces due to various factors like wind load, temperature variation, ice & snow, (wherever applicable) short circuit etc for the equipment.
- 4.4 The bidder shall design terminal connectors of the equipment taking into account various forces that are required to withstand.
- 4.5 The equipment shall also comply to the following:
- a) To facilitate erection of equipment, all items to be assembled at site shall be "match marked".
- b) All piping, if any between equipment control cabinet/operating mechanism to marshalling box of the equipment, shall bear proper identification to facilitate the connection at site.

4.6 System Parameter

765kV, 400kV & 220kV System

SL No	Description of parameters	765kV System
1.	System operating voltage	765kV
2.	Maximum operating voltage of the system (rms)	800kV
3.	Rated frequency	50HZ
4.	No. of phase	3
5.	Rated Insulation levels	
i)	Full wave impulse withstand voltage (1.2/50	2100kVp



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

	microsec.)	
ii)	Switching impulse withstand voltage (250/2500 micro sec.) dry and wet	1550kVp
iii)	One minute power frequency dry withstand voltage (rms)	830kV
SL No	Description of parameters	765kV System
iv)	One minute power frequency dry and wet withstand voltage (rms)	-
6.	Corona extinction voltage	508 kV
7.	Max. radio interference voltage for frequency between 0.5 MHz and 2 MHz	2500 μ V at 508 kV rms
8.	Minimum creepage distance - for Equipment other than Insulator string	20000 mm
	Minimum creepage distance - for Insulator String	24800 mm
9	Min. clearances	
i.	Phase to phase	7600mm (for conductor conductor configuration) 9400mm (for rod-conductor configuration)
ii.	Phase to earth	4900mm (for conductor structure) 6400mm (for rod- structure)
iii.	Sectional clearances	10300 mm
10.	Rated short circuit current for 1 sec. duration	40kA
11.	System neutral earthing	Effectively earthed

Notes:

1. The above parameters are applicable for installations up to an altitude of 1000m above mean sea level. For altitude exceeding 1000m, necessary altitude correction factor shall be applicable as per relevant IEC.
2. The insulation and RIV levels of the equipments shall be as per values given in the Technical Specification of respective equipment.
3. Corona and radio interference voltage test and seismic withstand test procedures for equipments shall be in line with the procedure given at **Annexure-A** and **Annexure-B** respectively.

5.0 ENGINEERING DATA AND DRAWINGS

5.1 Deleted.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 5.2 The Bidder shall submit 4 (four) sets of drawings/ design documents /data / detailed bill of quantity and 1 (one) set of test reports for the approval of the Employer. The bidder shall also submit the softcopy of the above documents in addition to hardcopy.

5.3 Drawings

- 5.3.1 All drawings submitted by the Bidder shall be in sufficient detail to indicate the type, size, arrangement, material description, Bill of Materials, weight of each component, break-up for packing and shipment, dimensions, internal & the external connections, fixing arrangement required and any other information specifically requested in the specifications.
- 5.3.2 Drawings submitted by the Bidder shall be clearly marked with the name of the Employer, the unit designation, the specifications title, the specification number and the name of the Project. POWERGRID has standardized a large number of drawings/documents of various make including type test reports which can be used for all projects having similar requirements and in such cases no project specific approval (except for list of applicable drawings along with type test reports) is required. However, distribution copies of standard drawings/documents shall be submitted as per provision of the contract. All titles, noting, markings and writings on the drawing shall be in English. All the dimensions should be in SI units.
- 5.3.3 The review of these data by the Employer will cover only general conformance of the data to the specifications and documents, interfaces with the equipment provided under the specifications, external connections and of the dimensions which might affect substation layout. This review by the Employer may not indicate a thorough review of all dimensions, quantities and details of the equipment, materials, any devices or items indicated or the accuracy of the information submitted. This review and/or approval by the Employer shall not be considered by the Bidder, as limiting any of his responsibilities and liabilities for mistakes and deviations from the requirements, specified under these specifications and documents.
- 5.5 All manufacturing and fabrication work in connection with the equipment prior to the approval of the drawings shall be at the Bidder's risk. The Bidder may make any changes in the design which are necessary to make the equipment conform to the provisions and intent of the Contract and such changes will again be subject to approval by the Employer. Approval of Bidder's drawing or work by the Employer shall not relieve the bidder of any of his responsibilities and liabilities under the Contract.
- 5.6 All engineering data submitted by the Bidder after final process including review and approval by the Employer shall form part of the Contract Document and the entire works performed under these specifications shall be performed in strict conformity, unless otherwise expressly requested by the Employer in Writing.

5.7 Approval Procedure

The following schedule shall be followed generally for approval and for providing final documentation.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

i) Approval/comments/ by Employer on initial submission	As per schedule
ii) Resubmission (whenever required)	As per contract
iii) Approval or comments	As per contract
iv) Furnishing of distribution copies (2 hard copies to each substation and one scanned copy (pdf format)	2 weeks from the date of approval
v) Furnishing of distribution copies of test reports (a) Type test reports (one scanned softcopy in pdf format to each substation plus one for corporate centre & one hardcopy per substation)	2 weeks from the date of final approval
(b) Routine Test Reports (one copy for each substation)	-do-
vi) Furnishing of instruction/ operation manuals (2 copies per substation and one softcopy (pdf format) for corporate centre & per substation)	On completion of Engineering
(vii) As built drawings (two sets of hardcopy per substation & one softcopy (pdf format) for corporate centre & per substation)	On completion of entire works

NOTE :

(1) The bidder may please note that all resubmissions must incorporate all comments given in the earlier submission by the Employer or adequate justification for not incorporating the same must be submitted failing which the submission of documents is likely to be returned.

(2) All drawings should be submitted in softcopy form, however substation design drawings like SLD, GA, all layouts etc. shall also be submitted in AutoCAD Version. SLD, GA & layout drawings shall be submitted for the entire substation in case of substation extension also.

(3) The instruction Manuals shall contain full details of drawings of all equipment being supplied under this contract, their exploded diagrams with complete instructions for storage, handling,



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

erection, commissioning, testing, operation, trouble shooting, servicing and overhauling procedures.

(4) If after the commissioning and initial operation of the substation, the instruction manuals require any modifications/additions/changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Bidder to the Employer.

(5) The Bidder shall furnish to the Employer catalogues of spare parts.

(6) All As-built drawings/documents shall be certified by site indicating the changes before final submission.

6.0 MATERIAL/ WORKMANSHIP

6.1 General Requirement

- 6.1.1 Where the specification does not contain references to workmanship, equipment, materials and components of the covered equipment, it is essential that the same must be new, of highest grade of the best quality of their kind, conforming to best engineering practice and suitable for the purpose for which they are intended.
- 6.1.2 In case where the equipment, materials or components are indicated in the specification as "similar" to any special standard, the Employer shall decide upon the question of similarity. When required by the specification or when required by the Employer the Bidder shall submit, for approval, all the information concerning the materials or components to be used in manufacture. Machinery, equipment, materials and components supplied, installed or used without such approval shall run the risk of subsequent rejection, it is to be understood that the cost as well as the time delay associated with the rejection shall be borne by the Bidder.
- 6.1.3 The design of the Works shall be such that installation, future expansions, replacements and general maintenance may be undertaken with a minimum of time and expenses. Each component shall be designed to be consistent with its duty and suitable factors of safety, subject to mutual agreements. All joints and fastenings shall be devised, constructed and documented so that the component parts shall be accurately positioned and restrained to fulfil their required function. In general, screw threads shall be standard metric threads. The use of other thread forms will only be permitted when prior approval has been obtained from the Employer.
- 6.1.4 Whenever possible, all similar part of the Works shall be made to gauge and shall also be made interchangeable with similar parts. All spare parts shall also be interchangeable and shall be made of the same materials and workmanship as the corresponding parts of the Equipment supplied under the Specification. Where feasible, common component units shall be employed in different pieces of equipment in order to minimize spare parts stocking requirements. All equipment of the same type and rating shall be physically and electrically interchangeable.
- 6.1.5 Deleted.
- 6.1.6 The Bidder shall apply oil and grease of the proper specification to suit the machinery, as is necessary for the installation of the equipment. Lubricants used for installation purposes shall be



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

drained out and the system flushed through where necessary for applying the lubricant required for operation. The Bidder shall apply all operational lubricants to the equipment installed by him.

- 6.1.7 All oil, grease and other consumables used in the Works/Equipment shall be purchased in India unless the Bidder has any special requirement for the specific application of a type of oil or grease not available in India. If such is the case, he shall declare in the proposal, where such oil or grease is available. He shall help Employer in establishing equivalent Indian make and Indian Bidder. The same shall be applicable to other consumables too.

6.2 Provisions For Exposure to Hot and Humid climate

Outdoor equipment supplied under the specification shall be suitable for service and storage under tropical conditions of high temperature, high humidity, heavy rainfall and environment favourable to the growth of fungi and mildew. The indoor equipments located in non-air conditioned areas shall also be of same type.

6.2.1 Space Heaters

- 6.2.1.1 The heaters shall be suitable for continuous operation at 240V as supply voltage. On-off switch and fuse shall be provided.
- 6.2.1.2 One or more adequately rated thermostatically connected heaters shall be supplied to prevent condensation in any compartment. The heaters shall be installed in the compartment and electrical connections shall be made sufficiently away from below the heaters to minimize deterioration of supply wire insulation. The heaters shall be suitable to maintain the compartment temperature to prevent condensation.

6.2.2 FUNGI STATIC VARNISH

Besides the space heaters, special moisture and fungus resistant varnish shall be applied on parts which may be subjected or predisposed to the formation of fungi due to the presence or deposit of nutrient substances. The varnish shall not be applied to any surface of part where the treatment will interfere with the operation or performance of the equipment. Such surfaces or parts shall be protected against the application of the varnish.

6.2.3 Ventilation opening

Wherever ventilation is provided, the compartments shall have ventilation openings with fine wire mesh of brass to prevent the entry of insects and to reduce to a minimum the entry of dirt and dust.

6.2.4 Degree of Protection

The enclosures of the Control Cabinets, Junction boxes and Marshalling Boxes, panels etc. to be installed shall comply with following degree of protection as detailed here under:

- a) Installed out door: IP- 55
- b) Installed indoor in air conditioned area: IP-31
- c) Installed in covered area: IP-52



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

d) Installed indoor in non-air conditioned area where possibility of entry of water is limited: IP-41.

e) For LT Switchgear (AC & DC distribution Boards): IP-52

The degree of protection shall be in accordance with IS:13947 (Part-I)/IEC-60947 (Part-I)/IS 12063/IEC-60529. Type test report for IP-55 or higher degree of protection test, shall be submitted for approval.

6.3 RATING PLATES, NAME PLATES AND LABELS

6.3.1 Each main and auxiliary item of substation is to have permanently attached to it in a conspicuous position a rating plate of non-corrosive material upon which is to be engraved manufacturer's name, year of manufacture, equipment name, type or serial number together with details of the loading conditions under which the item of substation in question has been designed to operate, and such diagram plates as may be required by the Employer. The rating plate of each equipment shall be according to IEC requirement.

6.3.2 All such nameplates, instruction plates, rating plates of transformers, reactors, CB, CT, CVT, SA, Isolators, C & R panels and PLCC equipments shall be bilingual with Hindi inscription first followed by English. Alternatively two separate plates one with Hindi and the other with English inscriptions may be provided.

6.4 FIRST FILL OF CONSUMABLES, OIL AND LUBRICANTS

All the first fill of consumables such as oils, lubricants, filling compounds, touch up paints, soldering/brazing material for all copper piping of circuit breakers and essential chemicals etc. which will be required to put the equipment covered under the scope of the specifications, into operation, shall be furnished by the Bidder unless specifically excluded under the exclusions in these specifications and documents.

7.0 DESIGN IMPROVEMENTS / COORDINATION

7.1 Deleted.

7.2 Deleted.

7.3 The Bidder shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic design requirements are detailed out in this Specification. The design of various components, sub-assemblies and assemblies shall be so done that it facilitates easy field assembly and maintenance.

7.4 The Bidder has to coordinate designs and terminations with the agencies (if any) who are Consultants/Bidder for the Employer. The names of agencies shall be intimated to the successful bidders.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 7.5 The Bidder will be called upon to attend design co-ordination meetings with the Engineer, other Bidder's and the Consultants of the Employer (if any) during the period of Contract. The Bidder shall attend such meetings at his own cost at POWERGRID Corporate Centre, Gurgaon (Haryana) or at mutually agreed venue as and when required and fully cooperate with such persons and agencies involved during those discussions.

8.0 QUALITY ASSURANCE PROGRAMME

- 8.1 To ensure that the equipment and services under the scope of this Contract, whether manufactured or performed within the Bidder's Works or at his Sub-Bidder's premises or at the Employer's site or at any other place of Work as applicable, are in accordance with the specifications, the Bidder shall ensure suitable quality assurance programme to control such activities at all points necessary. A quality assurance programme of the Bidder shall be in line with ISO requirements & shall generally cover the following:

- a) The organisation structure for the management and implementation of the proposed quality assurance programme.
- b) System for Document and Data Control.
- c) Qualification and Experience data of Bidder's key personnel.
- d) The procedure for purchases of materials, parts, components and selection of sub- Bidder's services including vendor analysis, source inspection, incoming raw material inspection, verification of material purchases etc.
- e) System for shop manufacturing and site erection controls including process controls, fabrication and assembly control.
- f) System for Control of non-conforming products including deviation dispositioning, if any and system for corrective and preventive actions based on the feedback received from the Customers and also internally documented system for Customer complaints.
- g) Inspection and test procedure both for manufacture and field activities.
- h) System for Control of calibration of testing and measuring equipment and the indication of calibration status on the instruments.
- i) System for indication and appraisal of inspection status.
- j) System of Internal Quality Audits, Management review and initiation of corrective and Preventive actions based on the above.
- k) System for authorising release of manufactured product to the Employer.
- l) System for maintenance of records.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

m) System for handling, storage and delivery.

n) A quality plan detailing out the specific quality control measures and procedure adopted for controlling the quality characteristics relevant to each item of equipment furnished and /or service rendered.

o) System for various field activities i.e. unloading, receipt at site, proper storage, erection, testing and commissioning of various equipment and maintenance of records. In this regard, the Employer has already prepared Standard Field Quality Plan for transmission line/substation equipments as applicable, Civil/erection Works which is required to be followed for associated works.

The Employer or his duly authorised representative reserves the right to carry out quality audit and quality surveillance of the system and procedure of the Bidder/his vendor's quality management and control activities.

8.2 Quality Assurance Documents

The Bidder shall ensure availability of the following Quality Assurance Documents:

i) All Non-Destructive Examination procedures, stress relief and weld repair procedure actually used during fabrication, and reports including radiography interpretation reports.

ii) Welder and welding operator qualification certificates.

iii) Welder's identification list, welding operator's qualification procedure and welding identification symbols.

iv) Raw Material test reports on components as specified by the specification and in the quality plan.

v) The Manufacturing Quality Plan (MQP) indicating Customer Inspection Points (CIPs) at various stages of manufacturing and methods used to verify that the inspection and testing points in the quality plan were performed satisfactorily.

vi) Factory test results for testing required as per applicable quality plan/technical specifications/GTP/Drawings etc.

vii) Stress relief time temperature charts/oil impregnation time temperature charts, wherever applicable.

8.3 INSPECTION, TESTING & INSPECTION CERTIFICATE

8.3.1 Bidder shall procure bought out items from sub-vendors as per the list in "Compendium of Vendors" available on POWERGRID web-site www.powergridindia.com after ensuring compliance to the requirements/conditions mentioned therein. Bidder shall explore first the possibilities of procuring the bought out items from POWERGRID approved existing vendors. In case of their



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

unavailability / non-response, Bidder may approach POWERGRID for additional sub-vendor approval. In that case, the assessment report of proposed sub vendor by Bidder along with the enclosures as per Annexure-F shall be submitted within 60 days of the award. The proposal shall be reviewed and approval will be accorded based on the verification of the document submitted and/or after the physical assessment of the works as the case may be. The physical assessment conducted by POWERGRID, if required, shall be on chargeable basis. Charges shall be as per the POWERGRID norms prevailing at that time, which shall be intimated by POWERGRID separately. If proposal for sub-vendor is submitted after 60 days, the Bidder's proposal normally will not be considered for current LOA. However, POWERGRID may process the case for developing more vendors for referred items, if found relevant. In all cases, It is the responsibility of the Bidder that Project activities do not suffer on account of delay in approval/non approval of a new sub-vendor.

The responsibility and the basis of inspection for various items & equipment is placed at Annexure-G along with the requirement of MQP (Manufacturing Quality Plan), ITP(Inspection & Test Plan), FAT(Factory Acceptance Test) which should be valid & POWERGRID approved and Level of inspection envisaged against each item.

Bidder shall ensure that order for items where MQP/ITP/FAT is required will be placed only on vendors having valid MQP/ITP/FAT and where the supplier's MQP/ITP/FAT is either not valid or has not been approved by POWERGRID, MQP shall be generally submitted as per POWERGRID format before placing order.

Items not covered under MQP/ITP/FAT shall be offered for inspection as per POWERGRID LOA/technical Specifications/POWERGRID approved data sheets/POWERGRID approved drawings and relevant Indian/International standards. Inspection Levels: For implementation of projects in a time bound manner and to avoid any delay in deputation of POWERGRID or its authorized representative, involvement of POWERGRID for inspection of various items / equipment will be based on the level below:

Level –I: Bidder to raise all inspection calls and review the report of tests carried out by the manufacturer, on his own, as per applicable standards/ POWERGRID specification, and submit to concerned POWERGRID inspection office/Inspection Engineer. CIP/MICC will be issued by POWERGRID based on review of test reports/certificates of manufacturers.

Level – II: Bidder to raise all inspection calls and carry out the inspection on behalf of POWERGRID on the proposed date of inspection as per applicable standards/specification. However, in case POWERGRID wishes to associate itself during inspection, the same would be intimated to Bidder and CIP/MICC will be issued by POWERGRID. Else, Bidder would submit their test reports/certificates to POWERGRID. CIP/MICC will be issued by POWERGRID based on review of test reports/certificates.

Level - III: Bidder to raise inspection calls for both, stage (as applicable) & final inspection and carry out the stage inspections (if applicable) on behalf of POWERGRID on the proposed date of inspection as per applicable standards/specification. However, in case POWERGRID wishes to associate itself during stage inspection, the same would be intimated to Bidder and CIP will be issued by POWERGRID. Else, Bidder would submit the test reports / certificates of stage inspection after their own review and CIP will be issued by POWERGRID based on review of test



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

reports / certificates. Final inspection will be carried out by POWERGRID and CIP/MICC will be issued by POWERGRID.

Level – IV: Bidder to raise inspection calls for both, stage (as applicable) & final inspections. POWERGRID will carry out the inspection for both stage & final inspection as per applicable standards/specification and CIP/MICC will be issued by POWERGRID.

- 8.3.2 Bidder shall ensure that to implement the above inspection levels, particularly for the quality control and inspection at sub-vendor's works, they would depute sufficient qualified & experienced manpower in their Quality Control and Inspection department. Further, to assure quality of construction, Bidder shall have a separate workforce having appropriate qualification & experience and deploy suitable tools and plant for maintaining quality requirement during construction in line with applicable Field Quality Plan (FQP).
- 8.3.3 The Employer, his duly authorised representative and/or outside inspection agency acting on behalf of the Employer shall have at all reasonable times access to the Bidder's premises or Works and shall have the power at all reasonable times to ensure that proper Quality Management practices / norms are adhered to, inspect and examine the materials & workmanship of the Works, to carry out Quality/Surveillance Audit during manufacture or erection and if part of the Works is being manufactured or assembled at other premises or works. The Bidder shall obtain for the Employer and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Bidder's own premises or works. The item/equipment, if found unsatisfactory with respect to workmanship or material is liable to be rejected. The observations for improvements during product/ process inspection by POWERGRID shall be recorded in Quality Improvement Register (available & maintained at works) for review & timely compliance of observations.
- 8.3.4 Bidder shall submit inspection calls over internet through POWERGRID website. The required vendor code and password to enable raising inspection call will be furnished to the main Bidder within 30 days of award of contract on submission of documents by Bidder. After raising the inspection calls, Bidder shall then proceed as per the message of that particular call which is available on the message board.
- 8.3.5 The Employer reserves the right to witness any or all type, acceptance and routine tests specified for which the Bidder shall give the Employer/Inspector Twenty one (21) days written notice of any material being ready for testing for each stage of testing as identified in the approved quality plan as customer inspection point(CIP) for indigenous inspections. All inspection calls for overseas material shall be given at least forty five (45) days in advance. Such tests shall be to the Bidder's account except for the expenses of the Inspection Engineer. The Employer/inspector, unless witnessing of the tests is waived by Employer, will attend such tests within Twenty one (21) days of the date of which the equipment is notified as being ready for test/inspection, failing which the Bidder may proceed with the test which shall be deemed to have been made in the Inspector's presence and he shall forthwith forward to the Inspector three copies of tests, duly certified. Bidder shall ensure, before giving notice for type test, that all drawings and quality plans have been got approved. The equipment shall be dispatched to site only after approval of Routine and Acceptance test results and Issuance of Dispatch Clearance in writing by the Employer. CIP/Material Inspection clearance certificate (MICC) shall be issued by the Employer after inspection of the equipment or review of test reports as applicable. Employer may waive off the



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

presence of Employer's inspecting engineer. In that case test will be carried out as per approved QP and test certificate will be furnished by the supplier for approval. CIP/MICC will be issued only after review and approval of the test reports.

- 8.3.6 Bidder shall generally offer material for inspection as per supply bar chart approved by POWERGRID and not before 30 days from schedule indicated in the bar chart. In case Bidder offers material(s) for inspection prior to 30 days from the scheduled date with necessary approval of POWERGRID, POWERGRID shall inspect the material and issue CIP only. However, in such an exceptional case, MICC shall be issued only as per provision of original / revised approved supply schedule.
- 8.3.7 Bidder shall minimize the number of inspection calls by offering optimum quantities in each inspection call at the respective manufacturer's works.
- 8.3.8 Bidder shall inspect the material themselves and only after they are fully convinced about the Quality, they shall offer the material for POWERGRID inspection and shall also ensure that relevant portion of LOA/NOA, approved drawing and data sheets along with applicable Quality Plans are available at the works of Bidder or their Sub-vendor before the material is offered for inspection.
- 8.3.9 Bidder shall ensure that material which has been cleared for dispatch after inspection will be dispatched within 30 days in case of domestic supplies and within 60 days in case of Off-shore supplies from the date of issuance of CIP. Material which is not dispatched within stipulated time as above will be reoffered for POWERGRID inspection or specific approval of POWERGRID QA&I shall be obtained for delayed dispatch.
- 8.3.10 The Employer or IE shall give notice in writing to the Bidder, of any objection either to conformance to any drawings or to any equipment and workmanship which in his opinion is not in accordance with the Contract. The Bidder shall give due consideration to such objections and shall either make the modifications that may be necessary to meet the said objections or shall confirm in writing to the Employer/Inspection Engineer giving reasons therein, that no modifications are necessary to comply with the Contract.
- 8.3.11 All Test Reports and documents to be submitted in English during final inspection of equipment by POWERGRID or as and when required for submission.
- 8.3.12 When the factory tests have been completed at the Bidder's or Sub-Bidder's works, the Employer/Inspection Engineer (IE) shall issue a certificate to this effect within fifteen (15) days after completion of tests & submission of documents by Bidder/manufacturer but if the tests are not witnessed by the Employer/IE, the certificate shall be issued within fifteen (15) days of receipt of the Bidder's Test certificate by the Employer/IE. Bidder shall, on completion of all tests, submit test reports within Ten (10) days to POWERGRID IE. Failure of the Employer/IE to issue such a certificate shall not prevent the Bidder from proceeding with the Works. The completion of these tests or the issue of the certificate shall not bind the Employer to accept the equipment should, it, on further tests after erection, be found not to comply with the Contract.
- 8.3.13 In all cases, where the Contract provides for tests whether at the premises or works of the Bidder or of any Sub- Bidder, the Bidder, except where otherwise specified, shall provide free of charge



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

such items as labour, materials, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Employer/Inspector or his authorised representative to carry out effectively such tests of the equipment in accordance with the Contract and shall give facilities to the Employer/Inspection Engineer or to his authorised representative to accomplish testing.

- 8.3.14 The inspection and acceptance by Employer and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Bidder in respect of the agreed quality assurance programme forming a part of the Contract, or if such equipment is found to be defective at a later stage.
- 8.3.15 The Employer will have the right of having at his own expenses any other test(s) of reasonable nature carried out at Bidder's premises or at site or in any other place in addition of aforesaid type and routine tests, to satisfy that the material comply with the specification.
- 8.3.16 The Employer reserves the right for getting any additional field tests conducted on the completely assembled equipment at site to satisfy that material complies with specifications.
- 8.3.17 Rework/ Re-engineering, if any, on any item/equipment shall be carried out only after mutual discussions and in accordance with mutually agreed procedure. Bidder shall submit Joint Inspection Report of equipments under Re-Work/Re-Engineering alongwith procedure for the same to POWERGRID for approval, before taking up the Re-Work/Re-Engineering, failing which POWERGRID reserves the right to reject the equipment.
- 8.3.18 Bidder may establish a field test Laboratory to execute Civil Construction testing requirements at site with the condition that all testing equipment shall be calibrated from POWERGRID approved accredited Testing laboratories, with calibration certificates kept available at site and all testing personnel employed in the Field Testing Laboratories to be qualified and experienced Engineers or testing to be carried out at POWERGRID approved Third Party Laboratories.
- 8.3.19 Bidder shall ensure that all possible steps are taken to avoid damages to the equipment during transport, storage and erection.
- 8.3.20 Bidder shall implement additional stringent quality checks and preparation during installation of GIS at site (if applicable) as per POWERGRID approved guidelines/Technical specifications.
- 8.3.21 Bidder shall ensure commissioning of all CSDs along with Circuit Breakers wherever applicable.
- 8.3.22 For EHV transformers/reactors:

Insulation oil shall be as per POWERGRID Technical specifications and same grade shall be used for impregnation of the active part & testing at the works of Transformer/Reactor Manufacturer and as well as for filling the Transformer/Reactors at site. Bidder to ensure that windings for Transformer/Reactors are made in air conditioned environment. Core-coil assembly shall be performed in positive pressurized dust controlled environment. Dust measurements shall be monitored regularly at Transformer / Reactor Manufacturer works. Bidder shall ensure that respective civil foundations & Fire walls for Transformer/Reactors units to be commissioned, shall be made ready at concerned sites before receipt of Transformer/Reactors units. All the requisite material for Neutral & Delta Bus formation required for charging of complete bank of



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

765KV class 1-ph Transformer/Reactor units shall be made available at the concerned sites before receipt of the Transformer/Reactor units at site.

- 8.3.23 The Employer reserves the right to increase or decrease their involvement in inspections at Bidder's Works or at his Sub-Bidder's premises or at the Employer's site or at any other place of Work based on performance of Bidder/sub-Bidder.

9.0 TYPE TESTING & CLEARANCE CERTIFICATE

- 9.1 All equipment being supplied shall conform to type tests as per technical specification and shall be subject to routine tests in accordance with requirements stipulated under respective sections.
- 9.2 The reports for all type tests as per technical specification shall be furnished by the Bidder alongwith equipment / material drawings. However, type test reports of similar equipments/ material already accepted in POWERGRID shall be applicable for all projects with similar requirement. The type tests conducted earlier should have either been conducted in accredited laboratory (accredited based on ISO / IEC Guide 25 / 17025 or EN 45001 by the national accreditation body of the country where laboratory is located) or witnessed by POWERGRID or representative authorized by POWERGRID or Utility or representative of accredited test lab.

Unless otherwise specified elsewhere, the type test reports submitted shall be of the tests conducted on or after 05-Nov-2009. In case the test reports are of the test conducted earlier than 05-Nov-2009, the bidder shall repeat these test(s) at no extra cost to the BHEL/Employer.

Further, in the event of any discrepancy in the test reports i.e. any test report not acceptable due to any design/manufacturing changes or due to non-compliance with the requirement stipulated in the Technical Specification or any/all type tests not carried out, same shall be carried out without any additional cost implication to the BHEL/Employer.

The Bidder shall intimate the Employer the detailed program about the type tests atleast two (2) weeks in advance in case of domestic supplies & six (6) weeks in advance in case of foreign supplies.

- 9.3 The Employer intends to repeat those type tests which are indicated in the price schedule and the same shall be payable as per provision of contract. The price of conducting type tests shall be included in Bid price and break up of these shall be given in the relevant schedule of Bid Proposal Sheets. These Type test charges would be considered in bid evaluation. In case Bidder does not indicate charges for any of the type tests or does not mention the name of any test in the price schedules, it will be presumed that the particular test has been offered free of charge. Further, in case any Bidder indicates that he shall not carry out a particular test, his offer shall be considered incomplete and shall be liable to be rejected. The Employer reserves the right to waive the repeating of type tests partly or fully and in case of waiver, test charges for the same shall not be payable.
- 9.4 The Employer reserves the right to witness any or all the type tests. The Employer shall bear all expenses for deputation of Employer's representative(s) for witnessing the type tests.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 9.5 The list of makes of various items, for which Type test reports are not required to be submitted are specified in Compendium of Vendors (COV).

10.0 Deleted.

11.0 PACKAGING & PROTECTION

- 11.1 All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. On request of the Employer, the Bidder shall also submit packing details/associated drawing for any equipment/material under his scope of supply, to facilitate the Employer to repack any equipment/material at a later date, in case the need arises. While packing all the materials, the limitation from the point of view of availability of Railway wagon sizes in India should be taken into account. The Bidder shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Bidder. Employer takes no responsibility of the availability of the wagons.
- 11.2 All coated surfaces shall be protected against abrasion, impact, discolouration and any other damages. All exposed threaded portions shall be suitably protected with either a metallic or a non-metallic protecting device. All ends of all valves and pipings and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage.

12.0 FINISHING OF METAL SURFACES

- 12.1 All metal surfaces shall be subjected to treatment for anti-corrosion protection. All ferrous surfaces for external use unless otherwise stated elsewhere in the specification or specifically agreed, shall be hot-dip galvanized after fabrication. All steel conductors including those used for earthing/grounding (above ground level) shall also be galvanized according to IS: 2629.

12.2 HOT DIP GALVANISING

- 12.2.1 The minimum weight of the zinc coating shall be 610 gm/sq.m and minimum average thickness of coating shall be 86 microns for all items having thickness 6mm and above. For items lower than 6mm thickness requirement of coating thickness shall be as per relevant ASTM. For surface which shall be embedded in concrete, the zinc coating shall be 610 gm/sq.m minimum.
- 12.2.2 The galvanized surfaces shall consist of a continuous and uniform thick coating of zinc, firmly adhering to the surface of steel. The finished surface shall be clean and smooth and shall be free from defects like discoloured patches, bare spots, unevenness of coating, spelter which is loosely attached to the steel globules, spiky deposits, blistered surface, flaking or peeling off, etc. The presence of any of these defects noticed on visual or microscopic inspection shall render the material liable to rejection.
- 12.2.3 After galvanizing, no drilling or welding shall be performed on the galvanized parts of the equipment excepting that nuts may be threaded after galvanizing. Sodium dichromate or alternate approved treatment shall be provided to avoid formation of white rust after hot dip galvanization.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 12.2.4 The galvanized steel shall be subjected to four numbers of one minute dips in copper sulphate solution as per IS-2633.
- 12.2.5 Sharp edges with radii less than 2.5 mm shall be able to withstand four immersions of the Standard Preece test. All other coatings shall withstand six immersions. The following galvanizing tests should essentially be performed as per relevant Indian Standards.
- Coating thickness
 - Uniformity of zinc
 - Adhesion test
 - Mass of zinc coating
- 12.2.6 Galvanised material must be transported properly to ensure that galvanised surfaces are not damaged during transit. Application of touch-up zinc rich paint at site shall be allowed with approval of Engineer Incharge.

12.3 PAINTING

- 12.3.1 All sheet steel work shall be degreased, pickled, phosphated in accordance with the IS- 6005 "Code of practice for phosphating iron and sheet". All surfaces, which will not be easily accessible after shop assembly, shall beforehand be treated and protected for the life of the equipment. The surfaces, which are to be finished painted after installation or require corrosion protection until installation, shall be shop painted with at least two coats of primer. Oil, grease, dirt and swarf shall be thoroughly removed by emulsion cleaning. Rust and scale shall be removed by pickling with dilute acid followed by washing with running water, rinsing with slightly alkaline hot water and drying.
- 12.3.2 After phosphating, thorough rinsing shall be carried out with clean water followed by final rinsing with dilute dichromate solution and oven drying. The phosphate coating shall be sealed with application of two coats of ready mixed, stoving type zinc chromate primer. The first coat may be "flash dried" while the second coat shall be stoved.
- 12.3.3 After application of the primer, two coats of finishing synthetic enamel paint shall be applied, each coat followed by stoving. The second finishing coat shall be applied after inspection of first coat of painting.
- 12.3.4 The exterior and interior colour of the paint in case of new substations shall preferably be RAL 7032 for all equipment, marshalling boxes, junction boxes, control cabinets, panels etc. unless specifically mentioned under respective sections of the equipments. Glossy white colour inside the equipments /boards /panels/junction boxes is also acceptable. The exterior colour for panels shall be matching with the existing panels in case of extension of a substation. Each coat of primer and finishing paint shall be of slightly different shade to enable inspection of the painting. A small quantity of finishing paint shall be supplied for minor touching up required at site after installation of the equipments.
- 12.3.5 In case the bidder proposes to follow his own standard surface finish and protection procedures or any other established painting procedures, like electrostatic painting etc., the procedure shall be submitted during detailed engineering for Employer's review & approval.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

12.3.6 The colour scheme as given below shall be followed for Fire Protection and Air Conditioning systems

S.No.	PIPE LINE	Base colour	Band colour
Fire Protection System			
1	Hydrant and Emulsifier system pipeline	FIRE RED	-
2	Emulsifier system detection line – water	FIRE RED	Sea Green
3	Emulsifier system detection line –Air	FIRE RED	Sky Blue
4	Pylon support pipes	FIRE RED	-
Air Conditioning Plant			
5	Refrigerant gas pipeline – at compressor suction	Canary Yellow	-
6	Refrigerant gas pipeline – at compressor discharge	Canary Yellow	Red
7	Refrigerant liquid pipeline	Dark Admiralty Green	-
8	Chilled water pipeline	Sea Green	-
9	Condenser water pipeline	Sea Green	Dark Blue

The direction of flow shall be marked by → (arrow) in black colour.



Base Colour Direction of flow Band Colour

12.3.7 For aluminium casted surfaces, the surface shall be with smooth finish. Further, in case of aluminium enclosures, the surface shall be coated with powder (coating thickness of 60 microns) after surface preparation for painting. For stainless steel surfaces, no painting is envisaged.

13.0 Deleted

14.0 TOOLS

14.1 Deleted

14.2 SPECIAL TOOLS AND TACKLES

The bidder shall supply all special tools and tackles required for Operation and maintenance of equipment. The special tools and tackles shall only cover items which are specifically required for the equipment offered and are proprietary in nature. The list of special tools and tackles, if any, shall be finalized during detail engineering and the same shall be supplied without any additional cost implication to the Employer.

14.3 Deleted

15.0 AUXILIARY SUPPLY



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 15.1 The auxiliary power for station supply, including the equipment drive, cooling system of any equipment, air-conditioning, lighting etc shall be designed for the specified Parameters as under. The DC supply for the instrumentation and PLCC system shall also conform the parameters as indicated in the following table:

Normal Voltage	Variation in Voltage	Frequency in HZ	Phase/Wire	Neutral connection
415V	±10%	50 ± 5%	3/4 Wire	Solidly Earthed.
240V	±10%	50 ± 5%	1/2 Wire	Solidly Earthed.
220V	190V to 240V	DC	Isolated 2 wire System	-
110V	95V to 120V	DC	Isolated 2 wire System	-
48V	--	DC	2 wire system (+) earthed	-

Combined variation of voltage and frequency shall be limited to + 10%.

16.0 SUPPORT STRUCTURE

- 16.1 The equipment support structures shall be suitable for equipment connections at the first level i.e 14.0 meter, 8.0 meter, 5.9 meter and 4.6 meter from plinth level for 765kV, 400kV, 220kV and 132kV substations respectively. All equipment support structures shall be supplied alongwith brackets, angles, stools etc. for attaching the operating mechanism, control cabinets & marshalling box (wherever applicable) etc.
- 16.2 The minimum vertical distance from the bottom of the lowest porcelain part of the bushing, porcelain enclosures or supporting insulators to the bottom of the equipment base, where it rests on the foundation pad shall be 2.55 metres.

17.0 CLAMPS AND CONNECTORS INCLUDING TERMINAL CONNECTORS

- 17.1 All power clamps and connectors shall conform to IS: 5561 or other equivalent international standard and shall be made of materials listed below:

S.No.	Description	Materials
a)	For connecting ACSR conductors/AAC conductors/ Aluminium tube	Aluminum alloy casting, conforming to designation A6 of IS:617 and all test shall conform to IS:617
b)	For connecting equipment terminals mad of copper with ACSR conductors/AAC conductors/ Aluminium tube	Bimetallic connectors made from aluminum alloy casting, conforming to designation A6 of IS:617 with 2mm thick bimetallic liner/strip and all test shall conform to IS:617
c)	For connecting G.I	Galvanised mild steel shield wire
d)	Bolts, nuts & plain washers	Electro-galvanised for sizes below M12, for others hot dip galvanised.
e)	Spring washers	Electro-galvanised mild steel suitable for atleast service condition-3 as per IS:1573



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 17.2 Necessary clamps and connectors shall be supplied for all equipment and connections. If corona rings are required to meet these requirements they shall be considered as part of that equipment and included in the scope of work.
- 17.3 Where copper to aluminum connections are required, bi-metallic clamps shall be used, which shall be properly designed to ensure that any deterioration of the connection is kept to a minimum and restricted to parts which are not current carrying or subjected to stress.
- 17.4 Low voltage connectors, grounding connectors and accessories for grounding all equipment as specified in each particular case, are also included in the scope of Work.
- 17.5 No current carrying part of any clamp shall be less than 10 mm thick. All ferrous parts shall be hot dip galvanised. Copper alloy liner/strip of minimum 2 mm thickness shall be cast integral with aluminum body or 2 mm thick bi-metallic liner/strips shall be provided for Bi-metallic clamps.
- 17.6 All casting shall be free from blow holes, surface blisters, cracks and cavities. All sharp edges and corners shall be blurred and rounded off.
- 17.7 Flexible connectors, braids or laminated straps made for the terminal clamps for bus posts shall be suitable for both expansion or through (fixed/sliding) type connection of IPS AL tube as required. In both the cases the clamp height (top of the mounting pad to centre line of the tube) should be same.
- 17.8 Current carrying parts (500A and above) of the clamp/connector shall be provided with minimum four numbers of bolts preferably for 132kV & above.
- 17.9 All current carrying parts shall be designed and manufactured to have minimum contact resistance.
- 17.10 Power Clamps and connectors shall be designed to control corona as per requirement.
- 17.11 Tests**
- Clamps and connectors should be type tested as per IS: 5561 and shall also be subjected to routine tests as per IS: 5561. Following type test reports shall be submitted for approval. Type test once conducted shall hold good. The requirement of test conducted within last ten years, shall not be applicable.
- i) Temperature rise test (maximum temperature rise allowed is 35°C over 50°C ambient)
- ii) Short time current test
- iii) Corona (dry) [for 400kV and above] and RIV (dry) test [for 132kV and above voltage level clamps]
- iv) Resistance test and tensile test
- 18.0 CONTROL CABINETS, JUNCTION BOXES, TERMINAL BOXES & MARSHALLING BOXES FOR OUTDOOR EQUIPMENT**



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 18.1 All types of boxes, cabinets etc. shall generally conform to & be tested in accordance with IS-5039/IS-8623, IEC-60439, as applicable, and the clauses given below:
- 18.2 Control cabinets, junction boxes, Marshalling boxes & terminal boxes shall be made of stainless steel of atleast 1.5 mm thick or aluminum enclosure of atleast 1.6 mm thick and shall be dust, water and vermin proof. Stainless steel used shall be of grade SS304 or better. The box shall be properly braced to prevent wobbling. There shall be sufficient reinforcement to provide level surfaces, resistance to vibrations and rigidity during transportation and installation. In case of aluminium enclosed box the thickness of aluminum shall be such that it provides adequate rigidity and long life as comparable with sheet steel of specified thickness.
- 18.3 A canopy and sealing arrangements for operating rods shall be provided in marshalling boxes / Control cabinets to prevent ingress of rain water.
- 18.4 Cabinet/boxes shall be provided with double hinged doors with padlocking arrangements. The distance between two hinges shall be adequate to ensure uniform sealing pressure against atmosphere.
- 18.5 All doors, removable covers and plates shall be gasketed all around with suitably profiled EPDM/Neoprene/PU gaskets. The gasket shall be tested in accordance with approved quality plan, IS:11149 and IS:3400. Ventilating Louvers, if provided, shall have screen and filters. The screen shall be fine wire mesh made of brass.
- Further, the gasketing arrangement shall be such that gaskets are pasted in slots (in door fabrication/gasket itself) in order to prevent ingress of dust and moisture inside the panels so that no internal rusting occurs in panels during the operation of the equipment.
- 18.6 All boxes/cabinets shall be designed for the entry of cables by means of weather proof and dust-proof connections. Boxes and cabinets shall be designed with generous clearances to avoid interference between the wiring entering from below and any terminal blocks or accessories mounted within the box or cabinet. Suitable cable gland plate above the base of the marshalling kiosk/box shall be provided for this purpose along with the proper blanking plates. Necessary number of cable glands shall be supplied and fitted on this gland plate. Gland plate shall have provision for some future glands to be provided later, if required. The Nickel plated glands shall be dust proof, screw on & double compression type and made of brass. The gland shall have provision for securing armour of the cable separately and shall be provided with earthing tag. The glands shall conform to BS:6121.
- 18.7 A 240V, single phase, 50 Hz, 15 amp AC plug and socket shall be provided in the cabinet with ON-OFF switch for connection of hand lamps. Plug and socket shall be of industrial grade.
- 18.8 LED based illumination of minimum 9 watts shall be provided. The switching of the fittings shall be controlled by the door switch.

For junction boxes of smaller sizes such as lighting junction box, manual operated earth switch mechanism box etc., plug socket, heater and illumination is not required to be provided.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 18.9 All control switches shall be of MCB/rotary switch type and Toggle/piano switches shall not be accepted.
- 18.10 Earthing of the cabinet shall be ensured by providing two separate earthing pads. The earth wire shall be terminated on to the earthing pad and secured by the use of self etching washer. Earthing of hinged door shall be done by using a separate earth wire.
- 18.11 The bay marshalling kiosks shall be provided with danger plate and a diagram showing the numbering/connection/feruling by pasting the same on the inside of the door.
- 18.12 The following routine tests alongwith the routine tests as per IS:5039 shall also be conducted:
i) Check for wiring
ii) Visual and dimension check
- 18.13 The enclosure of bay marshalling kiosk, junction box, terminal box and control cabinets shall conform to IP-55 as per IS:13947 including application of 2KV rms for 1 (one) minute, insulation resistance and functional test after IP-55 test.
- 19.0 DELETED**
- 20.0 TERMINAL BLOCKS AND WIRING**
- 20.1 Control and instrument leads from the switchboards or from other equipment will be brought to terminal boxes or control cabinets in conduits. All interphase and external connections to equipment or to control cubicles will be made through terminal blocks.
- 20.2 Terminal blocks shall be 650V grade and have continuous rating to carry the maximum expected current on the terminals and non-breakable type. These shall be of moulded piece, complete with insulated barriers, stud type terminals, washers, nuts and lock nuts. Screw clamp, overall insulated, insertion type, rail mounted terminals can be used in place of stud type terminals. But the terminal blocks shall be non-disconnecting stud type except for the secondary junction boxes of Current Transformer and Voltage Transformer.
- 20.3 Terminal blocks for current transformer and voltage transformer secondary leads shall be provided with test links and isolating facilities. The current transformer secondary leads shall also be provided with short circuiting and earthing facilities.
- 20.4 The terminal shall be such that maximum contact area is achieved when a cable is terminated. The terminal shall have a locking characteristic to prevent cable from escaping from the terminal clamp unless it is done intentionally.
- 20.5 The conducting part in contact with cable shall preferably be tinned or silver plated however Nickel plated copper or zinc plated steel shall also be acceptable.
- 20.6 The terminal blocks shall be of extensible design, multilayer terminal arrangement is not allowed in any junction box (Common MB, Individual MB, JB etc.). There should be sufficient space at both sides of terminals so that ferrule number of wires / TB numbers are clearly visible during wire removal or insertion.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 20.7 The terminal blocks shall have locking arrangement to prevent its escape from the mounting rails.
- 20.8 The terminal blocks shall be fully enclosed with removable covers of transparent, non-deteriorating type plastic material. Insulating barriers shall be provided between the terminal blocks. These barriers shall not hinder the operator from carrying out the wiring without removing the barriers.
- 20.9 Unless otherwise specified terminal blocks shall be suitable for connecting the following conductors on each side.
- a) All circuits except Minimum of two of 2.5 sq mm CT/PT circuits copper flexible.
 - b) All CT/PT circuits Minimum of 4 nos. of 2.5 sq mm copper flexible.
- 20.10 The arrangements shall be in such a manner so that it is possible to safely connect or disconnect terminals on live circuits and replace fuse links when the cabinet is live.
- 20.11 Atleast 20 % spare terminals shall be provided on each panel/cubicle/box and these spare terminals shall be uniformly distributed on all terminals rows.
- 20.12 There shall be a minimum clearance of 250 mm between the First/bottom row of terminal block and the associated cable gland plate for outdoor ground mounted marshalling box and the clearance between two rows of terminal blocks shall be a minimum of 150 mm.
- 20.13 The Bidder shall furnish all wire, conduits and terminals for the necessary interphase electrical connections (where applicable) as well as between phases and common terminal boxes or control cabinets. For equipments rated for 400 kV and above the wiring required in these items shall be run in metallic ducts or shielded cables in order to avoid surge over-voltages either transferred through the equipment or due to transients induced from the EHV circuits.
- 20.14 All input and output terminals of each control cubicle shall be tested for surge withstand capability in accordance with the relevant IEC Publications, in both longitudinal and transverse modes. The Bidder shall also provide all necessary filtering, surge protection, interface relays and any other measures necessary to achieve an impulse withstand level at the cable interfaces of the equipment.
- 21.0 LAMPS & SOCKETS**
- 21.1 Lamps & Sockets**
All lamps shall use a socket base as per IS-1258, except in the case of signal lamps. All sockets (convenience outlets) shall be suitable to accept both 5 Amp & 15 Amp pin round Standard Indian plugs. They shall be switched sockets with shutters.
- 21.2 Hand Lamp:**
A 240 Volts, single Phase, 50 Hz AC plug point shall be provided in the interior of each cubicle with ON-OFF Switch for connection of hand lamps.
- 21.3 Switches and Fuses:**



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

- 21.3.1 Each panel shall be provided with necessary arrangements for receiving, distributing, isolating and fusing of DC and AC supplies for various control, signalling, lighting and space heater circuits. The incoming and sub-circuits shall be separately provided with miniature circuit breaker / switch fuse units. Selection of the main and Sub-circuit fuse ratings shall be such as to ensure selective clearance of sub-circuit faults. Potential circuits for relaying and metering shall be protected by HRC fuses.
- 21.3.2 All fuses shall be of HRC cartridge type conforming to IS: 9228 mounted on plug-in type fuse bases. Miniature circuit breakers with thermal protection and alarm contacts will also be accepted. All accessible live connection to fuse bases shall be adequately shrouded. Fuses shall have operation indicators for indicating blown fuse condition. Fuse carrier base shall have imprints of the fuse rating and voltage.
- 22.0 Bushings, Hollow Column Insulators, Support Insulators:**
- 22.1 Bushings shall be manufactured and tested in accordance with IS:2099 & IEC-60137 while hollow column insulators shall be manufactured and tested in accordance with IEC-62155/IS:5621. The support insulators shall be manufactured and tested as per IS:2544/IEC-60168 and IEC-60273. The insulators shall also conform to IEC-60815 as applicable. The bidder may also offer composite hollow insulators, conforming to IEC-61462.
- 22.2 Support insulators, bushings and hollow column insulators shall be manufactured from high quality porcelain. Porcelain used shall be homogeneous, free from laminations, cavities and other flaws or imperfections that might affect the mechanical or dielectric quality and shall be thoroughly vitrified tough and impervious to moisture.
- 22.3 Glazing of the porcelain shall be uniform brown in colour, free from blisters, burrs and similar other defects.
- 22.4 Support insulators/bushings/hollow column insulators shall be designed to have ample insulation, mechanical strength and rigidity for the conditions under which they will be used.
- 22.5 When operating at normal rated voltage there shall be no electric discharge between the conductors and bushing which would cause corrosion or injury to conductors, insulators or supports by the formation of substances produced by chemical action. No radio interference shall be caused by the insulators/bushings when operating at the normal rated voltage.
- 22.6 Bushing porcelain shall be robust and capable of withstanding the internal pressures likely to occur in service. The design and location of clamps and the shape and the strength of the porcelain flange securing the bushing to the tank shall be such that there is no risk of fracture. All portions of the assembled porcelain enclosures and supports other than gaskets, which may in any way be exposed to the atmosphere shall be composed of completely non hygroscopic material such as metal or glazed porcelain.
- 22.7 All iron parts shall be hot dip galvanised and all joints shall be air tight. Surface of joints shall be trued up porcelain parts by grinding and metal parts by machining. Insulator /bushing design shall be such as to ensure a uniform compressive pressure on the joints.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

22.8 Tests

In bushing, hollow column insulators and support insulators shall conform to type tests and shall be subjected to routine tests in accordance with IS:2099 & IS:2544 & IS:5621.

22.9 Deleted

23.0 MOTORS

Motors shall be "Squirrel Cage" three phase induction motors of sufficient size capable of satisfactory operation for the application and duty as required for the driven equipment and shall be subjected to routine tests as per applicable standards. The motors shall be of approved make.

23.1 Enclosures

a) Motors to be installed outdoor without enclosure shall have hose proof enclosure equivalent to IP-55 as per IS: 4691. For motors to be installed indoor i.e. inside a box, the motor enclosure, shall be dust proof equivalent to IP-44 as per IS: 4691.

b) Two independent earthing points shall be provided on opposite sides of the motor for bolted connection of earthing conductor.

c) Motors shall have drain plugs so located that they will drain water resulting from condensation or other causes from all pockets in the motor casing.

d) Motors weighing more than 25 Kg. shall be provided with eyebolts, lugs or other means to facilitate lifting.

23.2 Operational Features

a) Continuous motor rating (name plate rating) shall be at least ten (10) percent above the maximum load demand of the driven equipment at design duty point and the motor shall not be over loaded at any operating point of driven equipment that will rise in service.

b) Motor shall be capable at giving rated output without reduction in the expected life span when operated continuously in the system having the particulars as given in Clause 15.0 of this Section.

23.3 Starting Requirements:

a) All induction motors shall be suitable for full voltage direct-on-line starting. These shall be capable of starting and accelerating to the rated speed alongwith the driven equipment without exceeding the acceptable winding temperature even when the supply voltage drops down to 80% of the rated voltage.

b) Motors shall be capable of withstanding the electrodynamic stresses and heating imposed if it is started at a voltage of 110% of the rated value.

c) The locked rotor current shall not exceed six (6) times the rated full load current for all motors, subject to tolerance as given in IS:325.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route
General Technical Requirements- Section 3
Doc. No. : TB-409-316-000 Rev 00

d) Motors when started with the driven equipment imposing full starting torque under the supply voltage conditions specified under Clause 15.0 shall be capable of withstanding atleast two successive starts from cold condition at room temperature and one start from hot condition without injurious heating of winding. The motors shall also be suitable for three equally spread starts per hour under the above referred supply condition.

e) The locked rotor withstand time under hot condition at 110% of rated voltage shall be more than starting time with the driven equipment of minimum permissible voltage by at least two seconds or 15% of the accelerating time whichever is greater. In case it is not possible to meet the above requirement, the Bidder shall offer centrifugal type speed switch mounted on the motor shaft which shall remain closed for speed lower than 20% and open for speeds above 20% of the rated speed. The speed switch shall be capable of withstanding 120% of the rated speed in either direction of rotation.

23.4 Running Requirements:

- a) The maximum permissible temperature rise over the ambient temperature of 50 degree C shall be within the limits specified in IS: 325 (for 3-phase induction motors) after adjustment due to increased ambient temperature specified.
- b) The double amplitude of motor vibration shall be within the limits specified in IS: 4729. Vibration shall also be within the limits specified by the relevant standard for the driven equipment when measured at the motor bearings.
- c) All the induction motors shall be capable of running at 80% of rated voltage for a period of 5 minutes with rated load commencing from hot condition.

23.5 TESTING AND COMMISSIONING

An indicative list of tests is given below. Bidder shall perform any additional test based on specialities of the items as per the field Q.P./Instructions of the equipment Bidder or Employer without any extra cost to the Employer. The Bidder shall arrange all instruments required for conducting these tests along with calibration certificates and shall furnish the list of instruments to the Employer for approval.

- (a) Insulation resistance.
- (b) Phase sequence and proper direction of rotation.
- (c) Any motor operating incorrectly shall be checked to determine the cause and the conditions corrected.

CORONA AND RADIO INTERFERENCE VOLTAGE (RIV) TEST

1. General

Unless otherwise stipulated, all equipment together with its associated connectors, where applicable, shall be tested for external corona (for 400kV & above) both by observing the voltage level for the extinction of visible corona under falling power frequency voltage and by measurement of radio interference voltage (RIV) for 132kV and above.

2. Test Levels:

The test voltage levels for measurement of external RIV and for corona extinction voltage are listed under the relevant clauses of the specification.

3. Test Methods for RIV:

3.1 RIV tests shall be made according to measuring circuit as per International Special-Committee on Radio Interference (CISPR) Publication 16-1(1993) Part -1. The measuring circuit shall preferably be tuned to frequency with 10% of 0.5 Mhz but other frequencies in the range of 0.5 MHz to 2 MHz may be used, the measuring frequency being recorded. The results shall be in microvolts.

3.2 Alternatively, RIV tests shall be carried out in accordance with relevant IEC of respective equipment or NEMA standard Publication No. 107-1964.

3.3 In measurement of, RIV, temporary additional external corona shielding may be provided. In measurements of RIV only standard fittings of identical type supplied with the equipment and a simulation of the connections as used in the actual installation will be permitted in the vicinity within 3.5 meters of terminals.

3.4 Ambient noise shall be measured before and after each series of tests to ensure that there is no variation in ambient noise level. If variation is present, the lowest ambient noise level will form basis for the measurements. RIV levels shall be measured at increasing and decreasing voltages of 85%, 100%, and 110% of the specified RIV test voltage for all equipment unless otherwise specified. The specified RIV test voltage for 765kV, 400 kV, 220 KV is listed in the detailed specification together with maximum permissible RIV level in microvolts.

3.5 The metering instruments shall be as per CISPR recommendation or equivalent device so long as it has been used by other testing authorities.

3.6 The RIV measurement may be made with a noise meter. A calibration procedure of the frequency to which noise meter shall be tuned shall establish the ratio of voltage at the high voltage terminal to voltage read by noise meter.

4. Test Methods for Visible Corona

The purpose of this test is to determine the corona extinction voltage of apparatus, connectors etc. The test shall be carried out in the same manner as RIV test described above with the exception that RIV measurements are not required during test and a search technique shall be used near the onset and extinction voltage, when the test voltage is raised and lowered to determine their precise values. The test voltage shall be raised to 110% of specified corona extinction voltage and maintained there for five minutes. In case corona inception does not take place at 110%, test shall be stopped, otherwise test shall be continued and the voltage will then be decreased slowly until

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)

ANNEXURE-A

all visible corona disappears. The procedure shall be repeated at least 4 times with corona inception and extinction voltage recorded each time. The corona extinction voltage for purposes of determining compliance with the specification shall be the lowest of the four values at which visible corona (negative or positive polarity) disappears. Photographs with laboratory in complete darkness shall be taken under test conditions, at all voltage steps i.e. 85%, 100%, and 110%. Additional photographs shall be taken at corona inception and extinction voltages. At least two views shall be photographed in each case using Panchromatic film with an ASA daylight rating of 400 with an exposure of two minutes at a lens aperture of f/5.6 or equivalent. The photographic process shall be such that prints are available for inspection and comparison with conditions as determined from direct observation. Photographs shall be taken from above and below the level of connector so as to show corona on bushing, insulators and all parts of energised connectors. The photographs shall be framed such that test object essentially, fills the frame with no cut-off.

For recording purpose, modern devices utilizing UV recording methods such as image intensifier may also be used.

- 4.1 The test shall be recorded on each photograph. Additional photograph shall be taken from each camera position with lights on to show the relative position of test object to facilitate precise corona location from the photographic evidence.
- 4.2 In addition to photographs of the test object preferably four photographs shall be taken of the complete test assembly showing relative positions of all the test equipment and test objects. These four photographs shall be taken from four points equally spaced around the test arrangement to show its features from all sides. Drawings of the laboratory and test set up locations shall be provided to indicate camera positions and angles. The precise location of camera shall be approved by Employer's inspector, after determining the best camera locations by trial energisation of test object at a voltage which results in corona.
- 4.3 The test to determine the visible corona extinction voltage need not be carried out simultaneously with test to determine RIV levels.
- 4.4 However, both test shall be carried out with the same test set up and as little time duration between tests as possible. No modification on treatment of the sample between tests will be allowed. Simultaneous RIV and visible corona extinction voltage testing may be permitted at the discretion of Employer's inspector if, in his opinion, it will not prejudice other test.

5. Test Records:

In addition to the information previously mentioned and the requirements specified as per CISPR or NEMA 107-1964 the following data shall be included in test report:

- a) Background noise before and after test.
- b) Detailed procedure of application of test voltage.
- c) Measurements of RIV levels expressed in micro volts at each level.
- d) Results and observations with regard to location and type of interference sources detected at each step.
- e) Test voltage shall be recorded when measured RIV passes through 100 microvolts in each direction.
- f) Onset and extinction of visual corona for each of the four tests required shall be recorded.

SEISMIC WITHSTAND TEST PROCEDURE

The seismic withstanding test on the complete equipment (for 132kV and above) shall be carried out alongwith supporting structure.

The Bidder shall arrange to transport the structure from his Contractor's premises/ POWERGRID sites for the purpose of seismic withstand test only.

The seismic level specified shall be applied at the base of the structure. The accelerometers shall be provided at the Terminal Pad of the equipment and any other point as agreed by the Employer. The seismic test shall be carried out in all possible combinations of the equipment. The seismic test procedure shall be furnished for approval of the Employer.

The frequency range for the earthquake spectra shall be as per IEC-6227-300.

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C****LIST OF GENERAL STANDARDS AND CODES**

CODES	TITLE
--	India Electricity Rules
--	Indian Electricity Act
--	Indian Electricity (Supply) Act
--	Indian Factories Act
IS-5	Colors for Ready Mixed Paints and Enamels
IS-335	New Insulating Oils
IS-617	Aluminium and Aluminium Alloy Ingots and Castings for General Engineering Purposes
IS-1448 (P1 to P 145)	Methods of Test for Petroleum and its Products
IS-2071 (P1 to P3)	Methods of High Voltage Testing
IS-12063	Classification of degrees of protection provided by enclosures of electrical equipment
IS-2165 ; P1:1997, P2:1983	Insulation Coordination
IS-3043	Code of Practice for Earthing
IS-6103	Method of Test for Specific Resistance (Resistivity) of Electrical Insulating Liquids
IS-6104	Method of Test for Interfacial Tension of Oil against Water by the Ring Method
IS-6262	Method of test for Power factor & Dielectric Constant of Electrical Insulating Liquids
IS-6792	Method for determination of electric strength of insulating oils
IS-5578	Guide for marking of insulated conductors
IS-11353	Guide for uniform system of marking & identification of conductors & apparatus terminals.
IS-8263	Methods for Radio Interference Test on High voltage Insulators
IS-9224 (Part 1,2&4)	Low Voltage Fuses
IEC-60060 (Part 1 to P4)	High Voltage Test Techniques
IEC 60068	Environmental Test
IEC-60117	Graphical Symbols
IEC-60156	Method for the Determination of the Electrical Strength of Insulation Oils
IEC-60270	Partial Discharge Measurements
IEC-60376	Specification and Acceptance of New Sulphur Hexafluoride
IEC-60437	Radio Interference Test on High Voltage Insulators
IEC-60507	Artificial Pollution Tests on High Voltage Insulators to be used on AC Systems
IEC-62271-1	Common Specification for High Voltage Switchgear & Control gear Standards
IEC-60815	Guide for the Selection of Insulators in respect of Polluted Conditions

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IEC-60865 (P1 & P2)	Short Circuit Current - Calculation of effects
ANSI-C.1/NFPA.70	National Electrical Code
ANSI-C37.90A	Guide for Surge Withstand Capability (SWC) Tests
ANSI-C63.21, C63.3	Specification for Electromagnetic Noise and Field Strength Instrumentation 10 KHz to 1 GHZ
C36.4ANSI-C68.1	Techniquet for Dielectric Tests
ANSI-C76.1/EEE21	Standard General Requirements and Test Procedure for Outdoor Apparatus Bushings
ANSI-SI-4	Specification for Sound Level Meters
ANSI-Y32-2/C337.2	Drawing Symbols
ANSI-Z55.11	Gray Finishes for Industrial Apparatus and Equipment No. 61 Light Gray
NEMA-107T	Methods of Measurements of RIV of High Voltage Apparatus
NEMA-ICS-II	General Standards for Industrial Control and Systems Part ICSI-109
CISPR-1	Specification for CISPR Radio Interference Measuring Apparatus for the frequency range 0.15 MHz to 30 MHz
CSA-Z299.1-1978h	Quality Assurance Program Requirements
CSA-Z299.2-1979h	Quality Control Program Requirements
CSA-Z299.3-1979h	Quality Verification Program Requirements
CSA-Z299.4-1979h	Inspection Program Requirements
TRANSFORMERS AND REACTORS	
IS:10028 (Part 2 & 3)	Code of practice for selection, installation & maintenance of Transformers (P1:1993), (P2:1991), (P3:1991)
IS-2026 (P1 to P4)	Power Transformers
IS-3347 (part 1 to Part 8)	Dimensions for Porcelain transformer Bushings for use in lightly polluted atmospheres
IS-3639	Fittings and Accessories for Power Transformers
IS-6600	Guide for Loading of oil immersed Transformers
IEC-60076 (Part 1 to 5)	Power Transformers
IEC-60214	On-Load Tap-Changers
IEC-60289	Reactors
IEC- 60354	Loading Guide for Oil - Immersed power transformers
IEC-60076-10	Determination of Transformer and Reactor Sound Levels
ANSI-C571280	General requirements for Distribution, Power and Regulating Transformers
ANSI-C571290	Test Code for Distribution, Power and Regulation Transformers
ANSI-C5716	Terminology & Test Code for Current Limiting Reactors
ANSI-C5721	Requirements, Terminology and Test Code for Shunt Reactors Rated Over 500 KVA
ANSI-C5792	Guide for Loading Oil-Immersed Power Transformers upto and including 100 MVA with 55 deg C or 65 deg C Winding Rise

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
ANSI-CG,IEEE-4	Standard Techniques for High Voltage Testing
IEC 60076	Power transformers
IEC 60076-1	Part 1: General
IEC 60076-2	Part 2: Temperature rise
IEC 60076-3	Part 3: Insulation levels, dielectric tests and external clearances in air
IEC 60076-4	Part 4: Guide to the lightning impulse and switching impulse testing - Power transformers and reactors
IEC 60076-3-1	Part 3-1: Insulation Levels and Dielectric Tests –External Clearances in Air
IEC 60076-5	Part 5: Ability to withstand short circuit
IEC 60076-6	Part 6: Reactors
IEC 60076-7	Part 7: Loading guide for oil-immersed power transformers
IEC 60076-8	Part 8: Application guide
IEC 60076-10	Part 10: Determination of sound levels
IEC 60076-10-1	Part 10-1: Determination of sound levels - Application guide
IEC 60076-11	Part 11: Dry-type transformers
IEC 60076-12	Part 12: Loading guide for dry-type power transformers
IEC 60076-13	Part 13: Self-protected liquid-filled transformers
IEC 60076-14	Part 14: Design and application of liquid-immersed power transformers using high-temperature insulation materials
IEC 60076-15	Part 15: Gas-filled power transformers
IEC 60076-16	Part 16: Transformers for wind turbine applications
IEC 60076-18	Part 18: Measurement of frequency response
IEC 60076-19	Part 19: Rules for the determination of uncertainties in the measurement of losses in power transformers and reactors
IEC 60076-21	Part 21: Standard requirements, terminology, and test code for step-voltage regulators
IEC 60044, BS 3938	Current transformers
IEC 60050	International Electrotechnical Vocabulary
IEC 60050(421)	International Electrotechnical vocabulary- Chapter 421 : Power Transformers and Reactors
IEC 60060	High Voltage test techniques
IEC 60060-1	General definitions and test requirements
IEC 60060-2	Measuring systems
IEC 60071	Insulation co-ordination
IEC 60071-1	Part 1: Definitions, principles and rules
IEC 60071-2	Part 2 : Application guide
IEC 60137	Bushing for alternating voltage above 1000V
IEC 60214	On-Load Tap changers
IEC 255-21-3	Relays vibration

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IEC 60270	Partial discharge measurements
IEC 60296	Specification for Unused Mineral Oil for Transformers and Switchgear
IEC 60422	Supervision and Maintenance guide for Mineral Insulating Oil in Electrical Equipment
IEC 60475	Method of Sampling Liquid dielectrics
IEC 60529	Classification of Degrees of Protection provided by Enclosures
IEC 60542	Application Guide for On-Load Tap-Changers
IEC 60567	Guide for the Sampling of Gases and of Oil from Oil-filled Electrical Equipment for the Analysis of Free and Dissolved Gases
IEC 60651	Sound Level Meters
IEC 61083	Digital Recorders and Software for High Voltage Impulse testing
IEC 61083-1	Part 1: Requirements for digital recorders in high voltage impulse tests
IEC 61083-2	Part 2: Evaluation of software used for the determination of the parameters of impulse waveforms
CISPR 16	Specification for radio disturbance and immunity measuring apparatus
CISPR 16-1	Radio disturbance and immunity measuring apparatus
CISPR-18	Radio Interference Characteristics of Power Lines and High Voltage Equipment
ISO 9001	Quality system-Model for Quality Assurance in Design /development
Cigre Publication 202	Guidelines for conducting design reviews for transformers 100 MVA and 123 kV and above. August 2002-Cigre Working Group 12.22
WG 12-15	Guide for Customers Specifications for Transformers 100 MVA and 123 kV and above
WG 12 19	Short Circuit Performance of Transformers.
BS-4360	Specification for weldable structural steel
BS-5135	Specification for arc welding of carbon and carbon manganese steels
BS-5500	Specification for unfired fusion welded pressure vessels
IS-3618	Specification for phosphate treatment of iron & steel for protection against corrosion
IS-6005	Code of practice for phosphating of Iron and Steel
ISO-8501	Preparation of steel surface before application of Paints and related product
IEC-60599	Mineral oil impregnated electrical equipment in service – guide to the interpretation of dissolved and free gases analysis
IS-10593	Method of evaluating the analysis of gases in oil filled electrical equipment in service
IS-2099	Bushings for alternating voltages above 1000 volts

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IS-3347 Part I to 8	Dimension for porcelain transformer bushing
DIN-42530	Bushing up to 1000kV from 250A-5000A for liquid filled Transformer
IS-2026 Part 1 to 5	Power transformer
IS-4691	Degrees of protection provided by enclosure for rotating electrical machinery
IEC-60034-5	Degrees of protection provided by integral design of rotating electrical machines(IP Code) classification
IS:325 / IEC -60034	Performance of cooling fan / oil pump motor
IS-13947 part 1 to 5	Specification for low voltage switchgear and control gear
IS:3400	Methods of test for vulcanised rubber
IS:7016 part 1 to 14	Methods of test for coated and treated fabrics
IS:803	Code of practice for design, fabrication and erection of vertical mild steel cylindrical welded oil storage tanks.
IS:3637	Gas operated Relays
IS:335	New Insulating oils – Specification
IEC-62271-203	Gas insulated metal enclosed switchgear for rated voltage above 52kV
IEC-61639	Direct connection between power transformers and gas-insulated metal enclosed switchgear for rated voltages of 52.5 kV and above.
IS:3400 / BS 903 / IS:7016	Air cell (Flexible Air Separator)
IEC 60529 / IP : 55	Degree of protection for cooler control cabinet , MOLG, Cooling fan , oil pump, Buchholz Relay
IEC 60529 / IP : 56	Degree of protection for Pressure Relief Device
IEC 60529 / IP : 43	Degree of protection for Remote tap Changer cubicle (RTCC)
CIRCUIT BREAKERS	
IEC-62271-100	High-voltage switchgear and control gear - Part 100: Alternating current circuit-breakers
IEC-62271-101	High-voltage switchgear and control gear - Part 101: Synthetic testing
IEC-62155	Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1000 V
IEC-62271-110	High-voltage switchgear and control gear - Part 110: Inductive load switching
IEC-62271-109	High-voltage switchgear and control gear - Part 110: Inductive load switching
CURRENT TRANSFORMERS, VOLTAGE TRANSFORMERS AND COUPLING CAPACITOR VOLTAGE TRANSFORMERS	
IS-2705- (P1 to P4)	Current Transformers

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IS:3156- (P1 to P4)	Voltage Transformers
IS-4379	Identification of the Contents of Industrial Gas Cylinders
IEC-61869 (Part-1)	Instrument transformers - Part 1: General requirements
IEC-61869 (Part-2)	Instrument transformers - Part 2: Additional requirements for current transformers
IEC-61869 (Part-3)	Instrument transformers - Part 3: Additional requirements for inductive voltage transformers
IEC-61869 (Part-4)	Instrument transformers - Part 4: Additional requirements for combined transformers
IEC-61869 (Part-5)	Instrument transformers - Part 5: Additional requirements for capacitor voltage transformers
IEC-61869 (Part-6)	Instrument transformers - Part 6: Additional general requirements for low-power instrument transformers
IEC-61869 (Part-9)	Instrument transformers - Part 9: Digital interface for instrument transformers
IEC-61869 (Part-102)	Instrument transformers - Part 102: Ferroresonance oscillations in substations with inductive voltage transformers
IEC-61869 (Part-103)	Instrument transformers - The use of instrument transformers for power quality measurement
BUSHING	
IS-2099	Bushings for Alternating Voltages above 1000V
IEC-60137	Insulated Bushings for Alternating Voltages above 1000V
SURGE ARRESTERS	
IS-3070 (PART2)	Lightning arresters for alternating current systems : Metal oxide lightning arrestors without gaps
IEC-60099-4	Metal oxide surge arrestors without gaps
IEC-60099-5	Selection and application recommendation
ANSI-C62.1	IEE Standards for S A for AC Power Circuits
NEMA-LA 1	Surge Arresters
CUBICLES AND PANELS & OTHER RELATED EQUIPMENTS	
IS-722, IS-1248	Electrical relays for power system
IS-3231, 3231 (P-3)	Protection
IS:5039	Distributed pillars for Voltages not Exceeding 1000 Volts
IEC-60068.2.2	Basic environmental testing procedures Part 2: Test B: Dry heat
IEC-60529	Degree of Protection provided by enclosures
IEC-60947-4-1	Low voltage switchgear and control gear
IEC-61095	Electromechanical Contactors for household and similar purposes
IEC-60439 (P1 & 2)	Low Voltage Switchgear and control gear assemblies
ANSI-C37.20	Switchgear Assemblies, including metal enclosed bus
ANSI-C37.50	Test Procedures for Low Voltage Alternating Current Power

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
	Circuit Breakers
ANSI-C39	Electric Measuring instrument
ANSI-C83	Components for Electric Equipment
IS: 8623: (Part I to 3)	Specification for Switchgear & Control Assemblies
NEMA-AB	Moulded Case Circuit and Systems
NEMA-CS	Industrial Controls and Systems
NEMA-PB-1	Panel Boards
NEMA-SG-5	Low voltage Power Circuit breakers
NEMA-SG-3	Power Switchgear Assemblies
NEMA-SG-6	Power switching Equipment
NEMA-5E-3	Motor Control Centers
1248 (P1 to P9)	Direct acting indicating analogue electrical measuring instruments & their accessories
Disconnecting switches	
IEC-62271-102	High-voltage switchgear and control gear - Part 102: Alternating current disconnectors and earthing switches
IEC-60265 (Part 1 & 2)	High Voltage switches
ANSI-C37.32	Schedule of preferred Ratings, Manufacturing Specifications and Application Guide for high voltage Air Switches, Bus supports and switch accessories
ANSI-C37.34	Test Code for high voltage air switches
NEMA-SG6	Power switching equipment
PLCC and line traps	
IS-8792	Line traps for AC power system
IS-8793	Methods of tests for line traps
IS-8997	Coupling devices for PLC systems
IS-8998	Methods of test for coupling devices for PLC systems
IEC-60353	Line traps for A.C. power systems
IEC-60481	Coupling Devices for power line carrier systems
IEC-60495	Single sideboard power line carrier terminals
IEC-60683	Planning of (single Side-Band) power line carrier systems
CIGRE	Teleprotection report by Committee 34 & 35
CIGRE	Guide on power line carrier 1979
CCIR	International Radio Consultative Committee
CCITT	International Telegraph & Telephone Consultative Committee
EIA	Electric Industries Association
Protection and control equipment	
IEC-60051: (P1 to P9)	Recommendations for Direct Acting indicating analogue electrical measuring instruments and their accessories
IEC-60255 (Part 1 to 23)	Electrical relays
IEC-60297 (P1 to P4)	Dimensions of mechanical structures of the 482.6mm (19 inches)

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
	series
IEC-60359	Expression of the performance of electrical & electronic measuring equipment
IEC-60387	Symbols for Alternating-Current Electricity meters
IEC-60447	Man machine interface (MMI) - Actuating principles
IEC-60521	Class 0.5, 1 and 2 alternating current watt hour metres
IEC-60547	Modular plug-in Unit and standard 19-inch rack mounting unit based on NIM Standard (for electronic nuclear instruments)
ANSI-81	Screw threads
ANSI-B18	Bolts and Nuts
ANSI-C37.1	Relays, Station Controls etc
ANSI-C37.2	Manual and automatic station control, supervisory and associated telemetering equipment
ANSI-C37.2	Relays and relay systems associated with electric power apparatus
ANSI-C39.1	Requirements for electrical analog indicating instruments
MOTORS	
IS-325	Three phase induction motors
IS-4691	Degree of protection provided by enclosure for rotating electrical machinery
IEC-60034 (P1 to P19:)	Rotating electrical machines
IEC-Document 2	Three phase induction motors
(Central Office) NEMA-MGI	Motors and Generators
Electronic equipment and components	
MIL-21B, MIL-833 & MIL-2750	Environmental testing
EC-60068 (P1 to P5)	Printed boards
IEC-60326 (P1 to P2)	Material and workmanship standards
IS-1363 (P1 to P3)	Hexagon head bolts, screws and nuts of product grade C
IS-1364 (P1 to P5)	Hexagon head bolts, screws and nuts of products grades A and B
IS-3138	Hexagonal Bolts and Nuts (M42 to M150)
ISO-898	Fasteners: Bolts, screws and studs
ASTM	Specification and tests for materials
Clamps & connectors	
IS-5561	Electric power connectors
NEMA-CC1	Electric Power connectors for sub station
NEMA-CC 3	Connectors for Use between aluminium or aluminum-Copper Overhead Conductors
Bus hardware and insulators	
IS: 2121	Fittings for Aluminum and steel cored Al conductors for overhead

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
	power lines
IS-731	Porcelain insulators for overhead power lines with a nominal voltage greater than 1000 V
IS-2486 (P1 to P4)	Insulator fittings for overhead power lines with a nominal voltage greater than 1000 V
IEC-60120	Dimensions of Ball and Socket Couplings of string insulator units
IEC-60137	Insulated bushings for alternating voltages above 1000 V
IEC-60168	Tests on indoor and outdoor post insulators of ceramic material or glass for Systems with Nominal Voltages Greater than 1000 V
IEC-62155	Hollow pressurized and unpressurized ceramic and glass insulators for use in electrical equipment with rated voltages greater than 1 000 V
IEC-60273	Characteristics of indoor and outdoor post insulators for systems with nominal voltages greater than 1000V
IEC-61462	Pressurized and un-pressurized insulator for use in electrical equipment with rated voltage greater than 1000V – Definitions, Test methods, acceptance criteria and design recommendations
IEC-60305	Insulators for overhead lines with nominal voltage above 1000V-ceramic or glass insulator units for ac systems Characteristics of String Insulator Units of the cap and pin type
IEC-60372 (1984)	Locking devices for ball and socket couplings of string insulator units : dimensions and tests
IEC-60383 (P1 and P2)	Insulators for overhead lines with a nominal voltage above 1000 V
IEC-60433	Characteristics of string insulator units of the long rod type
IEC-60471	Dimensions of Clevis and tongue couplings of string insulator units
ANSI-C29	Wet process porcelain insulators
ANSI-C29.1	Test methods for electrical power insulators
ANSI-C92.2	For insulators, wet-process porcelain and toughened glass suspension type
ANSI-C29.8	For wet-process porcelain insulators apparatus, post-type
ANSI-G.8	Iron and steel hardware
CISPR-7B	Recommendations of the CISPR, tolerances of form and of Position, Part 1
ASTM A-153	Zinc Coating (Hot-Dip) on iron and steel hardware
Strain and rigid bus-conductor	
IS-2678	Dimensions & tolerances for Wrought Aluminum and Aluminum Alloys drawn round tube
IS-5082	Wrought Aluminum and Aluminum Alloy Bars. Rods, Tubes and Sections for Electrical purposes
ASTM-B 230-82	Aluminum 1350 H19 Wire for electrical purposes

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
ASTM-B 231-81	Concentric - lay - stranded, aluminum 1350 conductors
ASTM-B 221	Aluminum - Alloy extruded bar, rod, wire, shape
ASTM-B 236-83	Aluminum bars for electrical purpose (Bus-bars)
ASTM-B 317-83	Aluminum-Alloy extruded bar, rod, pipe and structural shapes for electrical purposes (Bus Conductors)
Batteries	
IS:1651	Stationary Cells and Batteries, Lead-Acid Type (with Tubular Positive Plates)
IS:1652	Stationary Cells and Batteries, Lead-Acid Type (with Plante Positive Plates)
IS:1146	Rubber and Plastic Containers for Lead-Acid Storage Batteries
IS:6071	Synthetic Separators for Lead-Acid Batteries
IS:266	Specification for Sulphuric Acid
IS:1069	Specification for Water for Storage Batteries
IS:3116	Specification for Sealing Compound for Lead-Acid Batteries
IS:1248	Indicating Instruments
IS:10918	Vented type nickel Cadmium Batteries
IEC:60896-21&22	Lead Acid Batteries Valve Regulated types – Methods of Tests & Requirements
IEC: 60623	Vented type nickel Cadmium Batteries
IEC:60622	Secondary Cells & Batteries – Sealed Ni-Cd rechargeable single cell
IEC:60623	Secondary Cells & Batteries – Vented Ni-Cd rechargeable single cell
IEC:60896-11	Stationary Lead Acid Batteries – Vented Type – General requirements & method of tests
IEEE-485	Recommended practices for sizing of Lead Acid Batteries
IEEE-1115	Sizing of Ni-Cd Batteries
IEEE-1187	Recommended practices for design & installation of VRLA Batteries
IEEE-1188	Recommended practices for design & installation of VRLA Batteries
IEEE-1189	Guide for selection of VRLA Batteries
Battery Charger	
IS:3895	Mono-crystalline Semiconductor Rectifier Cells and Stacks
IS:4540	Mono-crystalline Semiconductor Rectifier Assemblies and Equipment
IS:6619	Safety Code for Semiconductor Rectifier Equipment
IS:2026	Power Transformers
IS:2959	AC Contactors for Voltages not Exceeding 1000 Volts

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IS:1248	Indicating Instruments
IS:2208	HRC Fuses
IS:13947 (Part-3)	Air break switches, air break disconnectors & fuse combination units for voltage not exceeding 1000V AC or 1200V DC
IS:2147	Degree of protection provided by enclosures for low voltage switchgear and control gear
IS:6005	Code of practice for phosphating of Iron and Steel
IS:3231	Electrical relays for power system protection
IS:3842	Electrical relay for AC Systems
IS:5	Colours for ready mix paint
IEEE-484	Recommended Design for installation design and installation of large lead storage batteries for generating stations and substations
IEEE-485	Sizing large lead storage batteries for generating stations and substations
Wires and cables	
ASTMD-2863	Measuring the minimum oxygen concentration to support candle like combustion of plastics (oxygen index)
IS-694	PVC insulated cables for working voltages upto and including 1100 Volts
IS-1255	Code of practice for installation and maintenance of power cables, upto and including 33 kV rating
IS-1554 (P1 and P2)	PVC insulated (heavy duty) electric cables (part 1) for working voltage upto and including 1100 V Part (2) for working voltage from 3.3 kV upto and including 11kV
IS:1753	Aluminium conductor for insulated cables
IS:2982	Copper Conductor in insulated cables
IS-3961 (P1 to P5)	Recommended current ratings for cables
IS-3975	Mild steel wires, formed wires and tapes for armouring of cables
IS-5831	PVC insulating and sheath of electric cables
IS-6380	Elastometric insulating and sheath of electric cables
IS-7098	Cross linked polyethylene insulated PVC sheathed cables for working voltage upto and including 1100 volts
IS-7098	Cross-linked polyethyle insulated PVC sheathed cables for working voltage from 3.3kV upto and including 33 kV
IS-8130	Conductors for insulated electrical cables and flexible cords
IS-1753	Aluminum Conductors for insulated cables
IS-10418	Specification for drums for electric cables
IEC-60096 (part 0 to p4)	Radio Frequency cables
IEC-60183	Guide to the Selection of High Voltage Cables
IEC-60189 (P1 to P7)	Low frequency cables and wires with PVC insulation and PVC sheath

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IEC-60227 (P1 to P7)	Polyvinyl Chloride insulated cables of rated voltages up to and including 450/750V
IEC-60228	Conductors of insulated cables
IEC-60230	Impulse tests on cables and their accessories
IEC-60287 (P1 to P3)	Calculation of the continuous current rating of cables (100% load factor)
IEC-60304	Standard colours for insulation for low-frequency cables and wires
IEC-60331	Fire resisting characteristics of Electric cables
IEC-60332 (P1 to P3)	Tests on electric cables under fire conditions
IEC-60502	Extruded solid dielectric insulated power cables for rated voltages from 1 kV upto to 30 kV
IEC-754 (P1 and P2)	Tests on gases evolved during combustion of electric cables
AIR conditioning and ventilation	
IS-659	Safety code for air conditioning
IS-660	Safety code for Mechanical Refrigeration
ARI:520	Standard for Positive Displacement Refrigeration Compressor and Condensing Units
IS:4503	Shell and tube type heat exchanger
ASHRAE-24	Method of testing for rating of liquid coolers
ANSI-B-31.5	Refrigeration Piping
IS:2062	Steel for general structural purposes
IS:655	Specification for Metal Air Dust
IS:277	Specification for Galvanised Steel Sheets
IS-737	Specification for Wrought Aluminium and Aluminium Sheet & Strip
IS-1079	Hot rolled cast steel sheet & strip
IS-3588	Specification for Electrical Axial Flow Fans
IS-2312	Propeller Type AC Ventilation Fans
BS-848	Methods of Performance Test for Fans
BS-6540 Part-I	Air Filters used in Air Conditioning and General Ventilation
BS-3928	Sodium Flame Test for Air Filters (Other than for Air Supply to I.C. Engines and Compressors)
US-PED-2098	Method of cold DOP & hot DOP test
MIL-STD-282	DOP smoke penetration method
ASHRAE-52	Air cleaning device used in general ventilation for removing particle matter
IS:3069	Glossary of Terms, Symbols and Units Relating to Thermal Insulation Materials
IS:4671	Expanded Polystyrene for Thermal Insulation Purposes
IS:8183	Bonded Mineral Wool
IS:3346	Evaluation of Thermal Conductivity properties by means of

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
	guarded hot plate method
ASTM-C-591-69	Standard specification for rigid preformed cellular urethane thermal insulation
IS:4894	Centrifugal Fans
BS:848	Method of Performance Test for Centrifugal Fans
IS:325	Induction motors, three-phase
IS:4722	Rotating electrical machines
IS:1231	Three phase foot mounted Induction motors, dimensions of
IS:2233	Designations of types of construction and mounting arrangements of rotating electrical machines
IS:2254	Vertical shaft motors for pumps, dimensions of
IS:7816	Guide for testing insulation resistance of rotating machines
IS:4029	Guide for testing three phase induction motors
IS: 4729	Rotating electrical machines, vibration of, Measurement and evaluation of
IS:4691	Degree of protection provided by enclosures for rotating electrical machinery
IS:7572	Guide for testing single-phase ac motors
IS:2148	Flame proof enclosure for electrical apparatus
BS:4999(Part-51)	Noise levels
Galvanizing	
IS-209	Zinc Ingot
IS-2629	Recommended Practice for Hot-Dip galvanizing on iron and steel
IS-2633	Methods for testing uniformity of coating of zinc coated articles
ASTM-A-123	Specification for zinc (Hot Galvanizing) Coatings, on products Fabricated from rolled, pressed and forged steel shapes, plates, bars and strips
ASTM-A-121-77	Zinc-coated (Galvanized) steel barbed wire
Painting	
IS-6005	Code of practice for phosphating of iron and steel
ANSI-Z551	Gray finishes for industrial apparatus and equipment
SSPEC	Steel structure painting council
Fire protection system	
--	Fire protection manual issued by tariff advisory committee (TAC) of India
HORIZONTAL CENTRIFUGAL PUMPS	
IS:1520	Horizontal centrifugal pumps for clear, cold and fresh water
IS:9137	Code for acceptance test for centrifugal & axial pumps
IS:5120	Technical requirement – Rotodynamic special purpose pumps
API-610	Centrifugal pumps for general services Hydraulic Institutes Standards

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
BS:599	Methods of testing pumps
PTC-8.2	Power Test Codes - Centrifugal pumps
DIESEL ENGINES	
IS:10000	Methods of tests for internal combustion engines
IS:10002	Specification for performance requirements for constant speed compression ignition engines for general purposes (above 20 kW)
BS:5514	The performance of reciprocating compression ignition (Diesel) engines, utilizing liquid fuel only, for general purposes
ISO:3046	Reciprocating internal combustion engines performance
IS:554	Dimensions for pipe threads where pressure tight joints are required on threads
ASME Power Test Code	Internal combustion engine PTC-17
--	Codes of Diesel Engine Manufacturer's Association, USA
PIPING VALVES & SPECIALITIES	
IS:636	Non percolating flexible fire-fighting delivery hose
IS:638	Sheet rubber jointing and rubber inserting jointing
IS:778	Gun metal gate, globe and check valves for general purpose
IS:780	Sluice valves for water works purposes (50 to 300 mm)
IS:901	Couplings, double male and double female instantaneous pattern for fire fighting
IS:902	Suction hose couplings for fire-fighting purposes
IS:903	Fire hose delivery couplings branch pipe nozzles and nozzle spanner
IS:1538	Cast iron fittings for pressure pipes for water, gas and sewage
IS:1903	Ball valve (horizontal plunger type) including floats for water supply purposes
IS:2062	SP for weldable structural steel
IS:2379	Colour Code for the identification of pipelines
IS:2643	Dimensions of pipe threads for fastening purposes
IS:2685	Code of Practice for selection, installation and maintenance of sluice valves
IS:2906	Sluice valves for water-works purposes (350 to 1200 mm size)
IS:3582	Basket strainers for fire-fighting purposes (cylindrical type)
IS:3589	Electrically welded steel pipes for water, gas and sewage (150 to 2000 mm nominal diameter)
IS:4038	Foot valves for water works purposes
IS:4927	Unlined flax canvas hose for fire fighting
IS:5290	Landing valves (internal hydrant)
IS:5312 (Part-I)	Swing check type reflex (non-return) valves
IS:5306	Code of practice for fire extinguishing installations and equipment on premises

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
Part-I	Hydrant systems, hose reels and foam inlets
Part-II	Sprinkler systems
BS:5150	Specification for cast iron gate valves
MOTORS & ANNUNCIATION PANELS	
IS:325	Three phase induction motors
IS:900	Code of practice for installation and maintenance of induction motors
IS:996	Single phase small AC and universal electric motors
IS:1231	Dimensions of three phase foot mounted induction motors
IS:2148	Flame proof enclosure of electrical apparatus
IS:2223	Dimensions of flange mounted AC induction motors
IS:2253	Designations for types of construction and mounting arrangements of rotating electrical machines
IS:2254	Dimensions of vertical shaft motors for pumps
IS:3202	Code of practice for climate proofing of electrical equipment
IS:4029	Guide for testing three phase induction motors
IS:4691	Degree of protection provided by enclosure for rotating electrical machinery
IS:4722	Rotating electrical machines
IS:4729	Measurement and evaluation of vibration of rotating electrical machines
IS:5572	Classification of hazardous areas for electrical (Part-I) installations (Areas having gases and vapours)
IS:6362	Designation of methods of cooling for rotating electrical machines
IS:6381	Construction and testing of electrical apparatus with type of protection 'e'
IS:7816	Guide for testing insulation for rotating machine
IS:4064	Air break switches
IEC DOCUMENT 2 (Control Office) 432	Three Phase Induction Motor
VDE 0530 Part I/66	Three Phase Induction Motor
IS:9224 (Part-II)	HRC Fuses
IS:6875	Push Button and Control Switches
IS:694	PVC Insulated cables
IS:1248	Indicating instruments
IS:375	Auxiliary wiring & busbar markings
IS:2147	Degree of protection
IS:5	Colour Relay and timers
IS:2959	Contactors
PG Test Procedures	

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
NFPA-13	Standard for the installation of sprinkler system
NFPA-15	Standard for water spray fixed system for the fire protection
NFPA-12A	Standard for Halong 1301 Fire Extinguishing System
NFPA-72E	Standard on Automatic Fire Detectors
--	Fire Protection Manual by TAC (Latest Edition)
NFPA-12	Standard on Carbon dioxide extinguisher systems
IS:3034	Fire of industrial building
--	Electrical generating and distributing stations code of practice
IS:2878	CO2 (Carbon dioxide) Type Extinguisher
IS:2171	DC (Dry Chemical Powder) type
IS:940	Pressurised Water Type
D.G. SET	
IS:10002	Specification for performance requirements for constant speed compression ignition (diesel engine) for general purposes
IS:10000	Method of tests for internal combustion engines
IS:4722	Rotating electrical machines-specification
IS:12063	Degree of protection provided by enclosures
IS:12065	Permissible limit of noise levels for rotating electrical machines
--	Indian Explosive Act 1932
Steel structures	
IS-228 (1992)	Method of Chemical Analysis of pig iron, cast iron and plain carbon and low alloy steels.
IS-802 (P1 to 3)	Code of practice for use of structural steel in overhead transmission line towers
IS-806	Code of practice for use of steel tubes in general building construction
IS-808	Dimensions for hot rolled steel beam, column channel and angle sections
IS-814	Covered electrodes for manual arc welding of carbon of carbon manganese steel
IS-816	Code of Practice for use of metal arc welding for general construction in Mild steel
IS-817	Code of practice for training and testing of metal arc welders. Part 1 : Manual Metal arc welding
IS-875 (P1 to P4)	Code of practice for design loads (other than earthquake) for buildings and structures
IS-1161	Steel tubes for structural purposes
IS-1182	Recommended practice for radiographic examination of fusion welded butt joints in steel plates
IS-1363 (P1 to P3)	Hexagonal head bolts, screws & nuts of products grade C
IS-1364	Hexagon head bolts, screws and nuts of product grades A and B
IS-1367 (P1 to P18)	Technical supply condition for threaded steel fasteners

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IS-1599	Methods for bend test
IS-1608	Method for tensile testing of steel products
IS-1893	Criteria for earthquake resistant design of structures
IS-1978	Line Pipe
IS-2062	Steel for general structural purposes
IS-2595	Code of practice for Radiographic testing
IS-3063	Single coil rectangular section spring washers for bolts, nuts and screws
IS-3664	Code of practice for ultrasonic pulse echo testing by contact and immersion methods
IS-7205	Safety code for erection of structural steel work
IS-9595	Recommendations for metal arc welding of carbon and carbon manganese steels
ANSI-B18.2.1	Inch series square and Hexagonal bolts and screws
ANSI-B18.2.2	Square and hexagonal nuts
ANSI-G8.14	Round head bolts
ASTM-A6	Specification for General Requirements for rolled steel plates, shapes, sheet piling and bars of structural use
ASTM-A36	Specifications of structural steel
ASTM-A47	Specification for malleable iron castings
ASTM-A143	Practice for safeguarding against embilement of Hot Galvanized structural steel products and procedure for detaching embrilement
ASTM-A242	Specification for high strength low alloy structural steel
ASTM-A283	Specification for low and intermediate tensile strength carbon steel plates of structural quality
ASTM-A394	Specification for Galvanized steel transmission tower bolts and nuts
ASTM-441	Specification for High strength low alloy structural manganese vanadium steel
ASTM-A572	Specification for High strength low alloy colombium-Vanadium steel of structural quality
AWS D1-0	Code for welding in building construction welding inspection
AWS D1-1	Structural welding code
AISC	American institute of steel construction
NEMA-CG1	Manufactured graphite electrodes
Piping and pressure vessels	
IS-1239 (Part 1 and 2)	Mild steel tubes, tubulars and other wrought steel fittings
IS -3589	Seamless Electrically welded steel pipes for water, gas and sewage
IS-6392	Steel pipe flanges
ASME	Boiler and pressure vessel code

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
ASTM-A120	Specification for pipe steel, black and hot dipped, zinc-coated (Galvanized) welded and seamless steel pipe for ordinary use
ASTM-A53	Specification for pipe, steel, black, and hot-dipped, zinc coated welded and seamless
ASTM-A106	Seamless carbon steel pipe for high temperature service
ASTM-A284	Low and intermediate tensile strength carbon-silicon steel plates for machine parts and general construction
ASTM-A234	Pipe fittings of wrought carbon steel and alloy steel for moderate and elevated temperatures
ASTM-S181	Specification for forgings, carbon steel for general purpose piping
ASTM-A105	Forgings, carbon steel for piping components
ASTM-A307	Carbon steel externally threaded standard fasteners
ASTM-A193	Alloy steel and stainless steel bolting materials for high temperature service
ASTM-A345	Flat rolled electrical steel for magnetic applications
ASTM-A197	Cupola malleable iron
ANSI-B2.1	Pipe threads (Except dry seal)
ANSI-B16.1	Cast iron pipe flanges and flanged fitting. Class 25, 125, 250 and 800
ANSI-B16.1	Malleable iron threaded fittings, class 150 and 300
ANSI-B16.5	Pipe flanges and flanged fittings, steel nickel alloy and other special alloys
ANSI-B16.9	Factory-made wrought steel butt welding fittings
ANSI-B16.11	Forged steel fittings, socket-welding and threaded
ANSI-B16.14	Ferrous pipe plug, bushings and locknuts with pipe threads
ANSI-B16.25	Butt welding ends
ANSI-B18.1.1	Fire hose couplings screw thread
ANSI-B18.2.1	Inch series square and hexagonal bolts and screws
ANSI-B18.2.2	Square and hexagonal nuts
ANSI-B18.21.1	Lock washers
ANSI-B18.21.2	Plain washers
ANSI-B31.1	Power piping
ANSI-B36.10	Welded and seamless wrought steel pipe
ANSI-B36.9	Stainless steel pipe
Other civil works standards	
IS-269	33 grade ordinary portland cement
IS-2721	Galvanized steel chain link fence fabric
IS-278	Galvanized steel barbed wire for fencing
IS-383	Coarse and fine aggregates from natural sources for concrete
IS-432 (P1 and P2)	Mild steel and medium tensile steel bars and hard-drawn steel wire for concrete reinforcement

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IS-456	Code of practice for plain and reinforced concrete
IS-516	Method of test for strength of concrete
IS-800	Code of practice for general construction in steel
IS-806	Steel tubes for structural purposes
IS-1172	Basic requirements for water supply, drainage and sanitation
IS-1199	Methods of sampling and analysis of concrete
IS-1566	Hard-drawn steel wire fabric for concrete reinforcement
IS-1742	Code of Practice for Building drainage
IS-1785	Plain hard-drawn steel wire for pre-stressed concrete
IS-1786	High strength deformed Steel Bars and wires for concrete reinforcement
IS-1811	Methods of sampling Foundry sands
IS-1893	Criteria for earthquake resistant design of structures
IS-2062	Steel for general structural purposes
IS-2064	Selection, installation and maintenance of sanitary appliances-code of practices
IS-2065	Code of practice for water supply in buildings
IS-2090	High tension steel bars used in pre-stressed concrete
IS-2140	Standard Galvanized steel wire for fencing
IS-2470 (P1 & P2)	Code of practice for installation of septic tanks
IS-2514	Concrete vibrating tables
IS-2645	Integral cement waterproofing compounds
IS-3025 (Part 1 to Part 48)	Methods of sampling and test (Physical and chemical) for water and waste water
IS-4091	Code of practice for design and construction of foundations for transmission line towers and poles
IS-4111 (Part 1 to P5)	Code of practice for ancillary structures in sewerage system
IS-4990	Plywood for concrete shuttering work
IS-5600	Sewage and drainage pumps
National building code of India 1970	
USBR E12	Earth Manual by United States Department of the interior Bureau of Reclamation
ASTM-A392-81	Zinc/Coated steel chain link fence fabric
ASTM-D1557-80	test for moisture-density relation of soils using 10-lb (4.5 kg) rammer 18-in. (457 mm) Drop
ASTM-D1586(1967)	Penetration Test and Split-Barrel Sampling of Soils
ASTM-D2049-69	Test Method for Relative Density of Cohesionless Soils
ASTM-D2435	Test method for Unconsolidated, (1982) Undrained Strengths of Cohesive Soils in Triaxial Compression
BS-5075	Specification for accelerating Part I Admixtures, Retarding Admixtures and Water Reducing Admixtures

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
CPWD	Latest CPWD specifications
ACSR MOOSE CONDUCTOR	
IS:6745 BS:443-1969	Methods for Determination of Mass of zinc coating on zinc coated Iron and Steel Articles
IS:8263	Methods for Radio Interference
IEC:437-1973 NEMA:107-1964 CISPR	Test on High Voltage Insulators
IS:209, BS:3436-1961	Zinc Ingot
IS:398 Part - V IEC:209-1966	Aluminum Conductors for Overhead Transmission Purposes
BS:215(Part-II), IEC:209-1966	Aluminium Conductors galvanized steel reinforced extra high voltage (400 kV and above)
IS:1778, BS:1559-1949	Reels and Drums for Bare Conductors
IS:1521, ISO/R89-1959	Method for Tensile Testing of steel wire
IS:2629	Recommended practice for Hot dip Galvanising on Iron and Steel
IS:2633	Method for Testing Uniformity of coating of zinc Coated Articles
IS:4826/ ASTMA-472-729	Hot dip galvanised coatings on round steel wires
GALVANISED STEEL EARTHWIRE	
IS:1521, ISO/R:89-1959	Method for Tensile Testing of Steel Wire
IS:1778	Reels and Drums for Bare Conductors
IS:2629	Recommended practice for Hot Dip Galvanising on Iron and Steel
IS:2633	Methods for testing Uniformity of Coating of Zinc Coated Articles
IS:4826/ ASTM: A 475-72a BS:443-1969	Hot dip Galvanised Coatings on Round Steel Wires
IS:6745/ BS:443-1969	Method for Determination of mass of Zinc Coating on Zinc coated Iron and Steel Articles.
IS:209/ BS:3463-1961	Zinc ingot
IS:398 (Pt. I to P5:1992)/ BS:215 (Part-II)	Aluminum Conductors for overhead transmission purposes
Lighting Fixtures and Accessories	
IS:1913	General and safety requirements for electric lighting fittings
IS:3528	Water proof electric lighting fittings
IS:4012	Dust proof electric lighting fittings
IS:4013	Dust tight proof electric lighting fittings
IS:10322	Industrial lighting fittings with metal reflectors
IS:10322	Industrial lighting fittings with plastic reflectors
IS:2206	Well glass lighting fittings for use under ground in mines (non-

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
	flameproof type)
IS:10322	Specification for flood light
IS:10322	Specification for decorative lighting outfits
IS:10322	Luminaries for street lighting
IS:2418	Tubular fluorescent lamps
IS:9900	High pressure mercury vapour lamps
IS:1258	Specification for Bayonet lamp fluorescent lamp
IS:3323	Bi-pin lamp holder tubular fluorescent lamps
IS:1534	Ballasts for use in fluorescent lighting fittings. (Part-I)
IS:1569	Capacitors for use in fluorescent lighting fittings
IS:2215	Starters for fluorescent lamps
IS:3324	Holders for starters for tubular fluorescent lamps
IS:418	GLS lamps
IS:3553	Water tight electric fittings
IS:2713	Tubular steel poles
IS:280	MS wire for general engg. Purposes
Conduits, Accessories and Junction Boxes	
IS:9537	Rigid steel conduits for electrical wiring
IS:3480	Flexible steel conduits for electrical wiring
IS:2667	Fittings for rigid steel conduits for electrical wiring
IS:3837	Accessories for rigid steel conduits for electrical wiring
IS:4649	Adaptors for flexible steel conduits
IS:5133	Steel and Cast Iron Boxes
IS:2629	Hot dip galvanising of Iron & Steel
Lighting Panels	
IS:13947	LV Switchgear and Control gear(Part 1 to 5)
IS:8828	Circuit breakers for over current protection for house hold and similar installations
IS:5	Ready mix paints
IS:2551	Danger notice plates
IS:2705	Current transformers
IS:9224	HRC Cartridge fuse links for voltage above 650V(Part-2)
IS:5082	Wrought aluminium and Al. alloys, bars, rods, tubes and sections for electrical purposes
IS:8623	Factory built Assemblies of Switchgear and Control Gear for voltages upto and including 1000V AC and 1200V DC
IS:1248	Direct Acting electrical indicating instruments
Electrical Installation	
IS:1293	3 pin plug
IS:371	Two to three ceiling roses

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**ANNEXURE-C**

CODES	TITLE
IS:3854	Switches for domestic and similar purposes
IS:5216	Guide for safety procedures and practices in electrical work
IS:732	Code of practice for electrical wiring installation (system voltage not exceeding 650 Volts.)
IS:3043	Code of practice for earthing
IS:3646	Code of practice of interior illumination part II & III
IS:1944	Code of practice for lighting of public through fares
IS:5571	Guide for selection of electrical equipment for hazardous areas
IS:800	Code of practice for use of structural steel in general building construction
IS:2633	Methods of Testing uniformity of coating on zinc coated articles
IS:6005	Code of practice for phosphating iron and steel
	INDIAN ELECTRICITY ACT
	INDIAN ELECTRICITY RULES
LT SWITCHGEAR	
IS:8623 (Part-I)	Specification for low voltage switchgear and control gear assemblies
IS:13947 (Part-I)	Specification for low voltage switchgear and control gear, Part 1 General Rules
IS:13947 (part-2)	Specification for low voltage switchgear and control gear, Part 2 circuit breakers
IS:13947 (part-3)	Specification for low voltage switchgear and control gear. Part 3 Switches, Disconnectors, Switch-disconnectors and fuse combination units
IS:13947 (part-4)	Specification for low voltage switchgear and control gear. Part 4 Contactors and motors starters
IS:13947 (part-5)	Specification for low voltage switchgear and control gear. Part 5 Control-circuit devices and switching elements
IS:13947 (part-6)	Specification for low voltage switchgear and control gear. Part 6 Multiple function switching devices
IS:13947 (part-7)	Specification for low voltage switchgear and control gear. Part 7 Ancillary equipments
IS:12063	Degree of protection provided by enclosures
IS:2705	Current Transformers
IS:3156	Voltage Transformers
IS:3231	Electrical relays for power system protection
IS:1248	Electrical indicating instruments
IS:722	AC Electricity meters
IS:5578	Guide for Marking of insulated conductors of apparatus terminals
IS:13703 (part 1)	Low voltage fuses for voltage not exceeding 1000V AC or 1500V DC Part 1 General Requirements
IS:13703 (part 2)	Low voltage fuses for voltage not exceeding 1000V AC or 1500V DC Part 2 Fuses for use of authorized persons

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)

ANNEXURE-C

CODES	TITLE
IS:6005	Code of practice of phosphating iron and steel
IS:5082	Wrought Aluminum and Aluminum alloys for electrical purposes
IS:2633	Hot dip galvanising

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**Annexure-G****MQP & INSPECTION LEVEL REQUIREMENT**

Sl. No.	Item / Equipment	Requirement of MQP/ITP/FAT	Inspection Level
1 A	Transformer /Reactor	Yes	IV
1 B	Circuit Breakers	Yes	IV
2	Current transformer	Yes	IV
3	Capacitive voltage transformers/Potential transformer	Yes	IV
4	Isolators	Yes	IV
5	Lightening Arrestors	Yes	III
6	Line Trap	Yes	III
7	Control & Relay Panels	Yes	III
8	Power Cables	Yes	III
9	Control Cables	Yes	III
10	LT Switchgear & ACDB/DCDB/MLDB/ELDB/ Lighting Panels	Yes	III
11	Fire protection system		
11-A	Panels, Deluge valve, Hydro pneumatic tank.	No	III
11-B	Strainers, extinguishers, MS/GI pipes, Pumps, motors, air compressor, and other valves, Diesel Engines	No	II
11-C	Others	No	I
12	Insulator (Disc, Long Rod, Solid Core)	Yes	IV
13	Conductor	Yes	IV
14	Clamps & Connectors (including equipment connectors)	Yes	III
15	Junction Box / Lighting Switch Boards / Bay MB/Telecom Equipment Cabinet	No	II
16	Cable lugs	No	I
17	Lighting Fixtures ,Lamps & fans	No	I
18	Switches	No	I
19	Conduits	No	I
20	Lighting Poles	No	II
21	MS/GI /PVC Pipes for cable trenches and lighting	No	I
22	Hume Pipes	No	I
23	Galvanized Cable trays	No	II
24	MS/ GI Flat and earthing material	No	II
25	MS Round for Earthmat (40mm dia)	No	I
26	Lighting Earthwire	No	I
27	Aluminium Tube & Busbar materials	No	II
28	Outdoor Receptacle	No	I
29	Nut / Bolts / Spring Washers (Gr 5.6/5)	No	II
30	LT Transformer	Yes	III
31	Battery	No	II
32	Battery Charger	Yes	III

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)**Annexure-G**

Sl. No.	Item / Equipment	Requirement of MQP/ITP/FAT	Inspection Level
33	D. G. Set	No	II
34	Split A.C/window A.C.	No	I
35	Substation Automation system	No	III
36	Telephone wires	No	I
37	Telephone sockets	No	I
38	Aluminium ladder	No	I
39	Occupancy sensors for control of lighting	No	I
40	Sub Station Structure (lattice/pipe type)	Yes	III
41	HG fuse	No	II
42	PLCC equipment Viz PLCC Terminal ,Carrier equipment, Protection Coupler , Coupling Device but excluding EPAX / HF Cable/ SDH Equipment	Yes	III
43	HF Cable / GPS Clock	No	I
44	EPAX	No	I
45	Cable Glands / Joints /Clamps/ Termination	No	I
46	Video Monitoring System	No	II
47	Controller for switching	No	IV
48	Solar based street lighting pole including solar panel as per technical specification	No	III
49	Event Logger	No	III
50	Lighting transformers	Yes	II
51	String Hardware	Yes	IV
52	Test Equipment	No	I *
53	GS Earthwire	Yes	IV
54	Oil Storage Tank	Yes	III
55	Insulating Oil	No	III
56	Flow sensitive conservator isolation valve	No	II **
57	On-Line insulating oil drying system	No	II **
58	On line DGA & Moisture Analyzer	No	II **
59	WAMS-(PMU & Accessories)	Yes	III
60	FO Cable	Yes	III
61	Re-rollers of MS/HT Angle Section and galvanized tower parts.	Yes	IV
62	Hardware fittings & Earthwire Accessories	Yes	IV
63	OPGW & H/W	Yes	III
64	Bolts & Nuts Gr up to 5.6/5	Yes	II
65	Bolts & Nuts of Gr 8.8 / 8	Yes	IV
66	D-shackle/ Hanger / Links	Yes	IV
67	Danger Plate /Phase Plate / Number Plate / Circuit plate	No	I
68	Pipe Type & Counter Poise Earthing	No	II
69	Spring Washer	No	II
70	ACD & Barbed wire for ACD/Bird guard	No	II

SECTION-GENERAL TECHNICAL REQUIREMENTS (GTR)

Annexure-G

Sl. No.	Item / Equipment	Requirement of MQP/ITP/FAT	Inspection Level
71	Span Marker & Obstruction Light	No	III
72	GIS including spares	Yes	IV
73	GIS Bus Duct	Yes	IV
74	GIS Bushing	Yes	IV
75	SF6 Gas processing Unit	No	II
76	Partial Discharge Monitoring System	No	II
77	STATCOM including Valve, valve base electronics, DC capacitor, series reactor and all accessories	Yes	IV
78	Mechanically switched Reactor bank (3-ph) including all accessories (MSR Branches)	Yes	IV
80	Mechanically switched Capacitor bank (3-ph) including all accessories (MSC Branches)	Yes	IV
81	Pass Harmonic filters	Yes	IV
82	Valve cooling system	Yes	III
	FODP including pigtail	No	II
	Radio link Telecom	Yes	III
	Hardware Fittings for Fibre Optic approach cable	Yes	III
	SDH Equipments (ADM), PDH, Primary Multiplexer	Yes	IV
	Drop & Insert Multiplexer	Yes	IV
	DACS	Yes	IV
	Main Distribution Frame	No	I
	HDPE Pipe	No	II
	NMS, TMN	Yes	IV
	Synchronization Equipment	No	Level-I
93	HT Capacitor	Yes	IV
94	PLC Capacitor	Yes	III
95	48V DCPS	Yes	III
96	Nitrogen Injection system	Yes	III
97	Foundation/Anchor bolts	Yes	III
98	EOT crane/Lift	No	II
99	Optical Signal Column	No	II
100	Maintenance Platform	No	II
101	Spark Gap	Yes	III
102	Thyristor Valve	Yes	III
103	DC current & voltage measuring device	ITP	III
104	Furniture	No	I

Note:

- * MICC for test and measuring equipment shall be issued only after actual verification/demonstration of satisfactory performance at site.
- ** Though level-2 items, CIP can be issued also on review of TCs and visual inspection of these items.



Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00

SECTION-4

GUARANTEED AND TECHNICAL PARTICULARS FOR 765kV CURRENT TRANSFORMER

CURRENT TRANSFORMER

1. Name and address of manufacturer
2. Manufacture's type designation
3. Standards applicable
4. Type of CT (Live or Dead Tank)
5. Rated frequency (Hertz)
6. Rated voltage U_r (KV_{rms})
7. Rated current
 - i) Rated continuous normal current (A)
 - ii) Rated extended primary Current (A)
8. Short time thermal current withstand for 1 sec. (KA).
9. Dynamic current withstand (KA_{peak}).
10. 1.2/50 micro second impulse withstand voltage (KV_{peak})



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

- | | |
|----|---|
| 11 | 250/2500 micro second switching surge withstand voltage (dry & wet) (kVp) |
| 12 | One minute dry and wet power frequency withstand voltage (kVrms) |
| 13 | No. of Primary winding |
| 14 | No. of cores per CT |
| 15 | Current Ratio (for all cores) |
| 16 | Output Burden for all cores |
| 17 | Accuracy class |
| 18 | Knee point voltage (V) at different taps |
| 19 | Secondary winding resistance at different ratios (for all cores) |
| 20 | Maximum exciting current at knee point voltage at different ratios (for all cores) (mA) |
| 21 | Instrument security factor at different ratios for metering cores |
| 22 | Radio interference voltage at $1.1 U_r/(\sqrt{3})$ at 1.0 MHz (μ Volts) |
| 23 | Conona extinction voltage (KVrms) |



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

- | | |
|----|---|
| 24 | Partial discharge level
(pico coulombs) |
| 25 | Standard to which oil
conforms generally |
| 26 | Total weight (kg) |
| 27 | Confirm whether similar
equipment are type tested |
| 28 | Maximum exciting current at
knee point voltage at different
ratios (for all cores) (mA) |



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii)765kV
Bhadla-2 (PG) S/s Extension under Transmission System
Associated With LTA applications from Rajasthan SEZ
Part-B (Rajasthan SEZ Part-B Project) through Tariff
Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

**SECTION-5
Checklist for Current Transformer
CHECK LIST FOR INFORMATION TO BE FURNISHED WITH OFFER**

SNo.	Parameters	Data	YES/NO	Remarks
1.	Manufacturer's type designation	Bidder to furnish in Remarks.		
2.	Type of CT			
	a) Insulation (As per clause 2.3 of section-II)	i. SF6	YES/NO	
		ii. Oil	YES/NO	
	b) Installation	Outdoor	YES	
	c) Mounting	Upright mounting on steel structure	YES	
	d) Tank design	i. Live tank	YES/NO	
		ii. Dead tank	YES/NO	
3.	Standards Applicable	Latest version of IEC-61869-1 & 61869-2 or IS-2705 Part 1 to 4	YES	
4.	Rated Voltage (kV rms)	765KV	YES	
5.	Rated Primary Current	3000A with 120% Extended current	YES	
6.	Rated short time thermal withstand current	40KA for 1 Sec	YES	
7.	Rated dynamic current	100kAp /125kAp as applicable	YES	
8.	Max. Temperature rise over design ambient temperature	As per IEC	YES	
9.	Full wave impulse withstand voltage (1.2/50microsecond) between line terminals and ground (kV Peak)	± 2100	YES	
10.	Switching impulse withstand voltage (250/2500microsecond)(dry and wet) between line terminals and ground (kV Peak)	± 1550	YES	



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

11.	One minute power frequency dry withstand voltage (dry and wet) between line terminals and ground (kV Peak)	975 (dry only)	YES	
12.	One minute power frequency withstand voltage between secondary terminals and earth (kV rms)	5kV	YES	
13.	Max. radio interference voltage for frequency between 0.5MHz and 2MHz at (Micro volts)	2500 at 508kVrms	YES	
14.	Minimum Corona extinction voltage (kVrms)	508	YES	
15.	Seismic acceleration (Horizontal)	0.3g	YES	
16.	Minimum Creepage distance (mm)	20000	YES	
17.	System neutral earthing	Effectively earthed	YES	
18.	CT Core details	complies to requirement under Table –IIA of TS Section-2	YES	
19.	CT Insulator	Polymer insulator	YES	
20.	CT shall have cantilever strength not less than-	500kG	YES	
21.	Offered CT has been provided with oil filling and drain plugs, Oil sight glass		YES	
22.	If SF6 gas filled CT is offered	Suitable SF6 gas density monitoring device with NO/NC contacts to facilitate remote annunciation and tripping in case of SF6 gas leakage.	YES	
		Provision for online gas filling	YES	
		Suitable rupture disc to prevent explosion provided.	YES	
		SF6 gas shall comply with IEC-	YES	



**Substation Package - SS02 for (i) 765kV Fatehgarh-2 (PG) S/S Extension and (ii) 765kV Bhadla-2 (PG) S/s Extension under Transmission System Associated With LTA applications from Rajasthan SEZ Part-B (Rajasthan SEZ Part-B Project) through Tariff Based Competitive Bidding (TBCB) Route.
765kV Current Transformer
Doc. No. : TB-409-510-002 Rev 00**

		60376, 60376A, 60376B & IEC-60480		
23.	If Oil filled CT is offered	Insulating oil shall be of EHV grade and conforms to IS-335, IEC-60296 (required for First filling) .		
24.	Secondary terminal box	As per Section –III	YES	
25.	In case of inverted (Live tank) type	Bellows made of stainless steel shall be used at the top for hermetic sealing of CT.	YES	
26.	Offered CTs shall be with necessary mounting hardwares for mounting on steel structures.		YES	
27.	Terminal connectors are not in scope of bidder		YES	
28.	Test requirement	As per clause 6.0 & 9.0 of Section-II and clause 9.0 of Section –III	YES	
29.	Compliance to Defect liability requirement	As per Clause 10.0 of Section –II	YES	
30.	Bidder shall supply 2No. Oil sampling device for each substation namely Fatehgarh II and Bhadla II.		YES	
31.	Documentary proof against technical qualifying requirement under clause 1.3.2 of Section –I	Attached along with offer.	YES	
32.	Bidder to confirm if Powergrid approved drawings, MQP/ Previous Powergrid approval for the offered CTs are available for approval extension.	If Yes , bidder shall submit the powergrid approval letters along with offer .	YES	

Date:

Signature of the authorized representative of Bidder and
Company Seal