

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

SECTION-XII

TECHNICAL SPECIFICATIONS FOR SCREW PUMPS

01.00.00 GENERAL

This section covers general requirement of design, construction features, manufacture, inspection and performance testing of screw / gear pump for water, oily water, fuel oil and sludge applications.

2.00.00 CODES AND STANDARDS

The equipment supplied shall comply with the latest applicable Indian Standards listed below. Other national standards are acceptable provided they are established to be equal or superior to the Indian Standards mentioned herewith.

IS : 5120. 1977	Technical requirements of rotodynamic purpose pumps
BS : 599. 1966	Method of testing for pumps
HIS	Hydraulic Institute Standards, USA
API: 676. 1980	Positive Displacement Pumps - Rotary
VDMA 24284. 1970	Positive Displacement Pumps - Code for Acceptance
	Test
IS: 210.1993	Grey Iron Castings
IS : 2062, 1992	Steel for general structural purposes
ANSI B16.5	Pipe flanges and flanged fittings
ASME Sec II	Engineering
	Materials

03.00.00 TECHNICAL REQUIREMENTS

03.01.00 Design & Performance Requirements

DEVELOPMENT CONSULTANTS
(e-PCT-TS-K-02-2014-15-V-IIIC-Sec-XII.doc)

V.III-C/S-XII: 1

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

- 03.01.01 The pump shall be horizontal, rotary, positive displacement type with gear or screw as rotary element.
- 03.01.02 The pump shall be capable of developing the required total head at rated flow under continuous operation. The maximum efficiency of the pump shall be within $\pm 10\%$ of rated flow.
- 03.01.03 Pumps of a particular category shall be identical and shall be suitable for parallel operation with equal load sharing. Components of identical pumps shall be Interchangeable.
- 03.01.04 Pumps shall run smoothly without undue noise and vibration. The noise level at a distance of 1 m from the equipment shall not exceed 85 dBA.
- 03.01.05 The pumps shall be suitable to handle fluid of characteristics as indicated in technical data sheet.
- 03.01.06 The pumps shall be suitable to handle the specified fluid for the complete range of operating conditions. The pump capacity shall be selected based on lowest possible viscosity and driving motor power shall be selected based on highest possible viscosity.
- 03.01.07 Each pump shall be connected to its drive motor directly and shall be mounted on a common base plate. The pump set along with drives shall be designed to permit rapid and economical maintenance.
- 03.01.08 All pumps shall be provided with suitable mechanical seals of proven design and material.
- 03.01.09 The supplier shall assume full responsibility in the operation of pump and motor as a unit.
- 03.02.00 Construction Requirements
- 03.02.01 Pump Casing
Casing and supports shall be designed to have sufficient strength and rigidity to prevent any adverse effect on internal clearances and to limit change of alignment to 50 micrometers at the coupling

flange caused by the worst combination of pressure, torque or allowable piping stress.

Pump casing shall be provided with a vent connection along with piping, fittings & valves unless pump is self-venting by the arrangement of nozzles. Casing drain, as required, shall be provided complete with drain valves, piping and plugs. It shall be provided with a connection for suction and discharge pressure gauge as standard feature.

Jacket for cooling or heating shall be provided, if specified in technical particulars. Passages shall not open into casing joints.

Inlet and outlet connections shall be flanged. Flanges shall be raised face and shall conform to ANSI B 16.5. Counter flanges with necessary bolts, nuts, gasket etc. shall be supplied along with the pump.

03.02.02 Rotating Elements

Rotating parts shall be properly aligned. Rotor and shaft shall be stiff enough to prevent contact between the rotor bodies and the casing. It shall be of material that have wear, corrosion and erosion resistance compatible with the application.

03.02.03 Mechanical Seals

The Pumps shall generally be employed with mechanical seals, which shall be arranged that replacement of seal should be possible with minimum downtime. T sealing faces should be highly lapped surfaces of materials known for their frictional coefficient and resistance to corrosion against the liquid being pumped

The seal end plate or rotating cover and bolting shall be designed to retain the SI with sufficient rigidity to prevent distortion that might impair seal operation. T stationary seal member shall be positively retained to prevent its rotation. For 1 seals under vacuum service, the seal design must ensure sealing against atmospheric pressure even when the pumps are not operating.

If seal flushing and cooling is provided by the pumped fluid, the pump supplier shall ensure that sufficient flow reaches the primary seal faces to provide for cooling and maintenance of a stable film at

the seal faces.

03.02.04 Stuffing Box

Stuffing box, if provided, should permit replacement of packing without removing any part other than the gland. Asbestos shall not be used as a packing material.

Stuffing Boxes of packed ring construction type preferably to accommodate five rings of packing (minimum four rings of packing) plus a lantern ring shall be provided wherever specified. Packed ring stuffing boxes shall be properly lubricated and sealed as per service requirements and manufacturer's standards. If external gland sealing is required, it shall be done from the pump discharge. The Bidder shall provide the necessary piping valves, fittings etc. or the gland sealing connection.

03.02.05 Bearing

Heavy duty antifriction bearings, adequately designed for the type of service specified in the technical data sheet and for long, trouble free operation shall be furnished.

The bearings offered shall be capable of taking both the radial and axial thrust coming into play during operation. Antifriction bearings shall be designed for a rated life of either 25000 hours with continuous operation at rated conditions or 16000 hours at maximum axial and radial loads and rated speed.

Proper lubricating arrangement for the bearings shall be provided. The design shall be such that the bearing lubricating element does not contaminate the liquid pumped. Where there is a possibility of liquid entering the bearings suitable arrangement in the form of deflectors or any other suitable arrangement must be provided ahead of bearing assembly.

Bearings shall be easily accessible without disturbing the pump assembly. A drain plug shall be provided at the bottom of each bearing housing.

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

03.02.06 Pump & Motor shaft Coupling

The pump and motor shafts shall be connected with an adequately sized flexible coupling of proven design with a spacer to facilitate dismantling of the pump without disturbing the motor. Necessary coupling guards shall also be provided.

03.02.07 Base plate

A common base plate for the pump and motor shall be provided. The base plate shall be of fabricated steel (minimum 6 mm thickness) and of rigid construction suitably ribbed and reinforced. Base plate and pump supports shall be constructed and the piping unit so mounted as to minimize misalignment caused by mechanical forces such as normal piping strain, internal differential thermal expansion and hydraulic piping thrust. The base plate shall be suitably drilled for the anchor bolts. The base plate shall have drip pan and suitable draining arrangement.

03.02.08 Relief Valve

To protect against damage due to accidental closure of discharge valve, each pump shall be provided with a relief valve of adequate capacity,

Relief valve shall be able to handle the pump rated capacity when fully open, at a pressure not more than 10 percent above the set pressure.

03.02.09 Material of Construction

The material of construction of various components shall be as indicated in technical particulars. These are to be considered as minimum requirement and it is the responsibility of supplier to select and offer proper material of construction for the required service,

03.02.10 Assembly and Dismantling

Assembly and dismantling of each pump with drive motor shall be possible without disturbing the grouted base plate or alignment.

03.02.11 Drive Motor

The motor shall be sized to meet the maximum specified operating conditions. including external gear and/or coupling losses. Continuous Motor rating (at 50 ° C ambient) shall be atleast ten percent (10%) above the maximum load demand of the pump in the entire operating range including the run out condition to take care of the system frequency & voltage variation.

The enclosure of motor shall comply various requirements of flame proof construction as per IS-2148 and degree of protection shall be as per IP-55.

Other design and construction features of the drive motor shall be as specified, elsewhere, under Standard Electrical Specifications.

4.00.00 TESTS

Material test certificates from recognized laboratories shall be furnished for review\for various components.

Following are the minimum shop and site tests to be conducted by the supplier:

4.01.00 Shop Tests

4.01.01 Hydrostatic Test

Pressure containing parts, including cooling and heating jackets, shall be test hydrostatically with liquid at a minimum of 1.5 times the maximum allowable working pressure but at not less than 1.38 bar gauge.

Tests shall be maintained for a sufficient period of time to permit complete examination of parts under pressure. The hydrostatic test shall be considered satisfactorily when no leaks are observed for a minimum of 30 minutes.

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

4.01.02 Mechanical Balancing

All rotating components of the pumps shall be subjected to static and dynamic balancing at shop as per ISO 1940. The dynamic balancing shall be done at or near the operating speed and the supplier shall furnish its acceptance norms for approval before conducting the test.

4.01.03 Non-destructive Testing

Non-destructive testing of the pump components shall be conducted in accordance with relevant standards. Prior to testing, the test procedure and repair procedure shall be submitted for approval. All components subjected to testing shall be identified and only those which are tested successfully shall be used for the manufacture of final product. All test results shall be submitted by the supplier for approval

All cast iron parts shall be tested in accordance with IS - 210. Test bars shall be cast or physical tests from the same ladle of metal as the casting they represent.

Steel forgings used in pump shall be tested for both physical properties and chemical composition. steel forgings shall be ultrasonically tested.

4.01.04 Performance Testing

All pumps shall be performance tested at the Manufacturer's Works as per testing code. The test shall be conducted to determine the following characteristics:

- a) Speed
- b) Discharge Pressure
- c) Suction Pressure
- d) Capacity
- e) Power

The test shall be conducted preferably with the tested job motor.

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

04.02.02 Noise and vibration shall be measured during the performance testing, for reference purposes.
For pumps operating in parallel, the load sharing should not vary by more than 5%.

The pumps showing any abnormal behaviour during the performance testing or the pumps as required shall be stripped down for a thorough examination after the performance test. The performance test report shall be prepared by the supplier and submitted for approval, before despatch of the pumps.

04.02.00 Site Tests

04.02.01 After installation, the pumps supplied shall be operated to prove satisfactory performance as individual equipment as well as a system. The noise and vibration level of the pumps shall be measured and it should be within the design values. For pumps operating in parallel, the load sharing should not vary by more than 5%. If performance at site is found to be unsatisfactory, then the supplier shall rectify or replace the equipment.

04.02.03 Test Procedure Instruments

The test procedures to be followed and instruments to be used for testing shall be subject to the approval. All instruments to be used for stage and performance testing shall be calibrated at reputed third party laboratories.

SECTION: VIII**TECHNICAL SPECIFICATION
FOR
PIPING, FITTINGS & VALVES****1.00.00 INTENT OF SPECIFICATION**

This specification covers the design, manufacturing, inspection, shop testing, erection, testing and commissioning at site of all the piping, fittings, valves and all other accessories as specified and as further required.

2. 00.00 SCOPE

The items & materials to be supplied shall include but not be limited to the following:

- 2. 01.00 Pipes, bends, elbows, tees, branches laterals, crosses, reducing unions, couplings, cap, expansion joints, flanges, blank flanges, saddles, shoes, sampling connections etc. necessary for making a reliable piping system.
- 2. 02.00 Gaskets, ring joint, backing rings, jointing material etc. as required.
- 2. 03.00 Instrument tapping connection, stub and thermowells.
- 2. 04.00 Supply and machining work of flanges, pipe spools and matching pipes to connect flow measuring orifice nozzles etc., pressure accumulators as necessary.
- 2. 05.00 Valves and Isolation Gates, to start/stop and control / regulate flow.
- 2. 06.00 Strainers.
- 2. 07.00 Anchor blocks (for buried / over ground piping), support brackets, clamps, support trestles, hangers, vibration dampener etc. for the piping under the scope of contract.
- 2. 08.00 Bolts, nuts, fasteners as required for interconnecting piping, valves and fitting as well as for terminal points.
- 2. 09.00 Steel for pipe supports and embedded steel. Also pipe supports and necessary embedment required to be embedded in concrete for underground / above ground pipes.
- 2. 10.00 Painting, anti-corrosive coatings, etc. inside and outside of pipes as necessary and as specified.
- 2. 11.00 All embedded parts required for all tanks/water retaining structures made of RCC including puddle pipes shall be supplied by the Bidder.

3. 00.00 **CODE & STANDARDS**

The design, manufacture, fabrication shop testing & inspection, erection, testing and commissioning of piping fittings and valves shall conform to the latest revisions of the following Indian / International codes / standards and other applicable statutory codes / ordinances, rules, regulations as well as safety codes, in addition to other codes / standards if any as addressed elsewhere in the Tender Specification.

Other National / International Standards may also be considered acceptable (subject to specific approval by Purchaser) with reference to any specific situation / requirement provided they are recognized to be equivalent or superior to the Standards as stipulated in the Tender Specification.

ANSI	-	B 16.5	:	Steel pipe flanges and flanged fittings.
ANSI	-	B 16.9	:	Wrought steel Butt welding fittings
ANSI	-	B 16.11	:	Forged steel socket welding and screwed fittings
ANSI	-	B 16.21	:	Non Metallic Gaskets for Pipe Flanges
ANSI	-	B 16.25	:	Butt welding ends
ANSI	-	B 16.28	:	Wrought Steel Butt Welding short radius elbows and returns
ANSI	-	B 31.1	:	Power Piping code.
ANSI	-	B 36.10	:	Welded & seamless wrought steel pipe
ANSI	-	B 36.19	:	Stainless steel pipe
API	-	5L	:	Specification for Line Pipe
ASME	-	Section II		Ferrous Materials Specification
ASTM	-	A 53	:	Seamless carbon steel.
ASTM	-	A 106	:	Grade C Seamless carbon steel pipe.
ASTM	-	F441 / F441M - 09	:	Standard Specification for Chlorinated Poly(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules 40 and 80
ASTM	-	F439 - 11	:	Standard Specification for Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic Pipe Fittings, Schedule 80

AWWA	-	C-203	:	Coal tar protective coatings and linings for steel water pipe lines - Enamel and Tape - Hot Applied
AWWA	-	C-208	:	Dimensions for Steel Water pipe fittings
AWWA	-	C-504	:	Standard for butterfly valve.
BS	-	1868	:	Specification for steel check valves (flanged and butt-welding ends) for the petroleum, petrochemical and allied industries
BS	-	5158	:	Specification for cast iron plug valves
BS	-	5353	:	Specification for steel plug valves
BS EN	-	593	:	Industrial valves. Metallic butterfly valves
BS EN	-	1796	:	Plastics piping systems for water supply with or without pressure. Glass-reinforced thermosetting plastics (GRP) based on unsaturated polyester resin (UP)
BS EN	-	13397	:	Industrial valves. Diaphragm valves made of metallic materials
BS EN	-	13789	:	Industrial valves. Cast iron globe valves
BS EN	-	14364	:	Plastics piping systems for drainage and sewerage with or without pressure. Glass-reinforced thermosetting plastics (GRP) based on unsaturated polyester resin (UP). Specifications for pipes, fittings and joints
BS EN ISO	-	16138	:	Industrial valves. Diaphragm valves of thermoplastics materials
DIN	-	16966	:	Glass fibre reinforced polyester resin (UP-GRP) pipe fittings and joint assemblies - Requirements for and testing of bushes, flanges, and flanged and laminated joints
IS	-	210	:	Grey Iron Castings
IS	-	318	:	Leaded Tin Bronze Ingots and Castings
IS	-	458	:	Precast Concrete Pipes (with and without reinforcement).
IS	-	554	:	Pipe Threads where Pressure Tight-Joints are made on the Threads – Dimensions, Tolerances and Designation.

IS	-	778	:	Copper Alloy Gate, Globe and Check Valves for Waterworks Purposes.
IS	-	783	:	Code of Practice for Laying of Concrete Pipes.
IS	-	1239 Part 1	:	Steel Tubes, Tubulars and other Wrought Steel Fittings - Specification Part 1 Steel Tubes
IS	-	1239 Part 2	:	Specification Steel Tubes, Tubulars and other Steel Fittings Part 2 Steel Sockets Tubular and other Steel Pipe Fittings
IS	-	1363	:	Hexagon Head Bolts, Screws and Nuts of Product Grade C.
IS	-	1364	:	Hexagon Head Bolts, Screws and Nuts of Product Grades A and B.
IS	-	1367	:	Technical Supply Conditions for Threaded Steel Fasteners.
IS	-	1536	:	Indian Standard for Centrifugally Cast (Spun) Iron Pressure Pipes for Water, Gas and Sewage.
IS	-	1537	:	Vertically Cast Iron Pressure Pipes for Water Gas and Sewage.
IS	-	1538	:	Cast Iron Fittings for Pressure Pipes for Water, Gas and Sewage.
IS	-	1703	:	Water Fittings - Copper Alloy Float Valves (Horizontal Plunger type)
IS	-	1879	:	Malleable Cast Iron Fittings
IS	-	2016	:	Plain washers
IS	-	2062	:	Hot Rolled Low, Medium and High Tensile Structural Steel.
IS	-	2629	:	Recommended practice for Hot dip galvanising of iron and steel
IS	-	2633	:	Method for testing uniformity of coating on zinc coated articles.
IS	-	2379	:	Colour Code for Identification of Pipe Lines.

IS	-	2685	:	Code of Practice for Selection, Installation and Maintenance of Sluice Valves.
IS	-	2712	:	Gaskets and Packings- Compressed Asbestos Fibre Jointing.
IS	-	2825	:	Code for Unfired Pressure Vessels.
IS	-	3006	:	Chemically Resistant Glazed Stoneware Pipes and Fittings.
IS	-	3042	:	Single Faced Sluice Gates (200 to 1200 mm size).
IS	-	3114	:	Code of Practice for Laying of Cast Iron Pipes.
IS	-	3589	:	Steel Pipes for Water and Sewage (168.3 to 2540 mm Outside Diameter).
IS	-	4038	:	Foot Valves for Waterworks Purposes.
IS	-	4682 (Part I)	:	Code of practice for lining of vessels and equipment for chemical - rubber lining.
IS	-	4736	:	Hot-dip Zinc Coatings on Mild Steel Tubes.
IS	-	4984	:	High Density Polyethylene Pipes for Potable Water Supplies.
IS :	-	4985	:	Unplasticized PVC Pipes for Potable Water Supplies.
IS :	-	5312	:	Swing Check Type Reflux (non-return) Valves for Water Works Purpose.
IS :	-	5822	:	Code of practice for laying of electrically welded steel pipes for Water supply.
IS :	-	8062	:	Code of practice for cathodic protection (Part-II) of steel structure
IS :	-	10221	:	Code of practice for coating and wrapping of underground mild steel pipes
IS :	-	14846	:	Sluice Valve for Water Works Purposes (50 to 1200 mm Size).

4. 00.00 **DESIGN, MANUFACTURE, FABRICATION AND ERECTION**

4.01.00 The piping system, fittings and accessories supplied shall conform to high standards of engineering, design, workmanship and be capable of performing in continuous commercial operation in a manner acceptable to Purchaser.

4.02.00 All the piping systems, fittings and accessories supplied under this package shall be designed to operate without replacement and with normal maintenance for a plant service life of 25 years and shall withstand the operating parameter fluctuations and cycle variations which can be normally expected during this period.

4.03.00 Material of construction for pipes under different services shall be as below:

Service	Recommended Material of Construction
River Water	Carbon Steel
Clarified Water	Carbon Steel
Filtered Water	Carbon Steel (inside rubber lined)
Degassed Water	Carbon Steel (inside rubber lined)
Demineralised Water	Carbon Steel (inside rubber lined)
Service Air	Galvanized Steel
Instrument Air	Stainless Steel (schedule 40)
Potable Water	Galvanized Steel
Chlorine (liquid under pressure)	Seamless Carbon Steel (schedule 80)
Chlorine (dry gaseous under pressure)	Seamless Carbon Steel (schedule 80)
Chlorine under vacuum	CPVC (schedule 80)
Chlorine in water	CPVC (schedule 80) / Carbon Steel (inside rubber lined)
Sodium Hydroxide Solution	CPVC (schedule 80) / Carbon Steel (inside rubber lined)
Alum Solution	CPVC (schedule 80) / Carbon Steel (inside rubber lined)

Service	Recommended Material of Construction
Lime Solution	Galvanized Steel
Polyelectrolyte Solution	CPVC (schedule 80) / Carbon Steel (inside rubber lined)
Hydrochloric Acid (concentrated)	Carbon Steel (inside rubber lined)
Hydrochloric Acid (dilute)	Carbon Steel (inside rubber lined)
Sodium Hydroxide (concentrated)	Carbon Steel (inside rubber lined)
Sodium Hydroxide (dilute)	Carbon Steel (inside rubber lined)
Sulfuric Acid Solution (concentrated)	Carbon Steel
Sulfuric Acid Solution (dilute)	Carbon Steel (inside rubber lined)
Scale Inhibitor Solution	Stainless Steel (schedule 40) / CPVC (schedule 80)
Corrosion Inhibitor Solution	Stainless Steel (schedule 40) / CPVC (schedule 80)
Biocide Solution	Stainless Steel (schedule 40) / CPVC (schedule 80)
Filter Backwash Wastewater	Carbon Steel
Ammonia Solution	Seamless Stainless Steel (304 grade)
Hydrazine Solution	Seamless Stainless Steel (304 grade)
Oxygen Line	Aluminum
Crude Condensate	Carbon Steel (inside rubber lined)
Treated Condensate	Carbon Steel (inside rubber lined)
Demineralized Water with ion exchange resins	Stainless Steel (304 grade)
Non Oily Sludge	Cast Iron (underground) Carbon Steel (overground)
Neutralized Wastewater	Carbon Steel (inside rubber lined)

Cooling Tower Blowdown	Carbon Steel
Boiler Blowdown	Carbon Steel
Crude Oily Wastewater	Seamless Carbon Steel
Treated Oily Wastewater	Seamless Carbon Steel
Rainfall Runoff	Carbon Steel
Equalized Wastewater	Carbon Steel
Oily Sludge	Seamless Carbon Steel

The portion of pipe lines at the downstream of isolation valves, conveying flushing water shall be of the material & type same as those of the pipelines which are being flushed.

4.04.00 Material & Dimensional Standards for Piping and Fittings

4.04.01 The welded Carbon Steel Pipes shall conform to the following codes / standards:

Pipes	Material Code / Standard	Dimension Code / Standard
50 mm NB and below	Mild Steel, ERW, IS-1239 Part-1 / ASTM-A 53 Grade B (Welded), Type-E, Schedule 80.	IS-1239 Part-1. Plain ends for Socket Welding.
65 mm to 150 mm NB	Mild Steel, ERW, IS-1239 Part-1 / ASTM-A 53 Grade B (Welded), Type-E, Schedule 40.	IS-1239 Part-1. Bevelled ends for Butt Welding.
200 mm to 450 mm NB	Mild Steel, ERW, IS-3589 Grade Fe 410 / ASTM-A 53 Grade B (Welded), Type-E, Schedule 40.	IS-3589. Bevelled ends for Butt Welding.
500 mm NB and above	Rolled and Butt Welded from IS-2062 Grade A plates or SA-285 Grade C or Equivalent (subject to approval by Purchaser). / Spiral Welded pipes.	IS-3589. Bevelled ends for Butt Welding.

Elbows (R=1.5 D)	Material Code / Standard	Dimension Code / Standard
50 mm NB and below	Forged carbon steel from ASME-SA 105 / Carbon Steel to IS-1239 Part-2 (Heavy grade).	SW ends to ANSI-B 16.11 (3000#) / IS-1239 Part-2.
65 mm to 150 mm NB	ASME-SA 234 Grade WPB / Carbon Steel to IS-1239 Part-2 (Heavy grade).	BW ends to ANSI-B 16.9 / IS-1239 Part-2.
200 mm to 350 mm NB	ASME SA-234 Grade WPB	BW ends to ANSI-B 16.9 / IS-1239 Part-2.
Mitre Bends (R=1.5 D)	Material Code / Standard	Dimension Code / Standard
400 mm NB and above	Fabricated from parent pipe.	ANSI-B 31.1 / AWWA-C 208. 90° - 3 cut, 4 piece constructions. 45° - 2 cut, 3 piece constructions.
Tees	Material Code / Standard	Dimension Code / Standard
50 mm NB & below	Forged Carbon Steel to ASME-SA 105 / ASME-SA 234 Grade WPB / Carbon Steel to IS-1239 Part-2 (Heavy grade).	SW ends to ANSI-B 16.11 (3000#) / IS-1239 Part-2.
65 mm to 150 mm NB	ASME-SA 234 Grade WPB / Carbon Steel IS-1239 Part-2 (Heavy grade).	BW ends to ANSI-B 16.9 / IS-1239 Part-2.
200 mm NB and above	ASME-SA 234 Grade WPB / Fabricated from parent pipe.(set in / set on type).	ANSI-B 16.9
Reducers	Material Code / Standard	Dimension Code / Standard
50 mm NB & below	Forged carbon steel to ASME-SA 105 / ASME-SA 234 Grade WPB / Carbon Steel to IS-1239 Part-2 (Heavy grade).	SW ends to ANSI-B 16.11 (3000#) / IS-1239 Part-2.
65 mm to 150 mm NB	ASME-SA 234 Grade WPB / Carbon Steel to IS-1239 Part-2 (Heavy grade).	BW ends to ANSI-B 16.9 / IS-1239 Part-2.

200 mm NB and above	ASME-SA 234 Grade WPB / Fabricated from parent pipe.(set in / set on type)	ANSI-B 16.9
Slip On Flanges / Blind Flanges	Material Code / Standard	Dimension Code / Standard
All sizes	IS-226 / IS-2062 Grade A / ASME-SA 105 / ASTM-A 216 Grade WCB. Flanges shall be either machined or forged from plate / casting.	Dimensions / Drilling as per ANSI-B 16.5, Pressure rating 150# / 300# or otherwise as applicable, generally Flat face.
Bolts & Nuts	Material Code / Standard	Dimension Code / Standard
All sizes	IS -1367 CI 4.6 for bolts IS-1367 CI 4 for nuts	IS -1367
Gaskets	Material Code / Standard	Dimension Code / Standard
All sizes	3 mm thick wire reinforced rubber. Material shall contain no asbestos.	ANSI-B 16.21.

- 4.04.02 Seamless Carbon Steel Pipe shall conform to ASTM-A 106 Grade C (Schedule 80) / ASTM-A 53 / API 5L. Fittings shall conform to applicable codes / standards and be in conformity with the code / standard for the parent pipe.
- 4.04.03 Galvanized Steel Pipes and Fittings shall conform to the clause 4.02.01 above and be galvanized to IS-4736. Ends of all fittings will however be screwed as per IS-554. Mitre Bends shall not be used. Pipe joints shall be screwed for lower size and flanged for higher size. No hot work on G.I. pipes shall be done. Flanges shall be screwed and hot dipped galvanized.
- 4.04.04 Pipes and Fittings which shall be rubber lined, need to conform the clause 4.02.01 above. The inside surfaces of the items shall be completely debanded and made suitable for lining. The items will be inside rubber lined with 3 mm thick (minimum) natural rubber in two layers as per IS-4682. Flanges shall be flat face as per ANSI-B 16.5 and full face rubber lined. Pipe to Pipe joint will be flanged only. For small size fittings, SS-316 fittings shall be used if rubber lined carbon steel fittings are not available.
- 4.04.05 Stainless Steel Pipe shall conform to ASTM-A 312 of specified grade (Schedule 40) with dimensions as per ANSI-B 16.39. Fittings shall conform to applicable codes / standards and be in conformity with the code / standard for the parent pipe. Mitre Bends shall not be used. Elbows / Tees / Reducers shall be of Forged Stainless Steel (ASME-SA 182) with SW ends to ANSI-B 16.11 (3000#).

- 4.04.06 Cast Iron pipes shall conform to IS-1536. Fittings shall conform to applicable codes / standards and be in conformity with the code / standard for the parent pipe.
- 4.04.07 PVC Pipes shall conform to IS-4984 Class 4. Fittings shall conform to applicable codes / standards and be in conformity with the code / standard for the parent pipe.
- 4.04.08 High density Polyethylene Pipes shall conform to IS-4984 Class 5. Fittings shall conform to applicable codes / standards and be in conformity with the code / standard for the parent pipe.
- 4.04.09 CPVC pipe (Schedule 80) shall be produced from compounds which conform to and are specified in ASTM-D 1784. CPVC Pipe shall be manufactured in strict compliance with ASTM-F 441. Pressure-Rated CPVC Pipe shall be manufactured in strict compliance with ASTM-F 442. All CPVC piping shall be manufactured from NSF approved compounds and NSF Listed for potable water use. CPVC Fittings (Schedule 80) shall be as per ASTM-F 437 and F 439.
- 4.04.10 Pipe lines carrying water, chemicals, air etc. shall be sized generally based on the following ranges of velocities. However pipe size if any for any particular service is addressed in the Tender Drawings / Data Sheets, the selected size for the applicable service shall not be less than the specified size.

Pipe Size	Velocity in m/sec		
	Below 50 mm	50 mm - 150 mm	200 mm & above
Pump Suction for Water		1.2 - 1.5	1.2 - 1.8
Pump Discharge for Water	1.2 - 1.8	1.8 - 2.4	2.1 - 2.5
Header		1.5 - 2.4	2.1 - 2.4
Compressed air below 2 Kg/cm ² (g)	15 - 20	20 - 30	25 - 35
Compressed air 2 Kg/cm ² & above	20 - 30	25 - 40	35 - 45
Suction to compressor/ Blowers		7 - 8	
Pump Suction for Chemical Solution	1.0 - 1.2	1.1 - 1.3	
Pump Discharge for Chemical Solution	1.2 - 1.4	1.3 - 1.5	

- 4.05.00 Pipe line under gravity flow shall be restricted to a flow velocity of 1 m/sec generally. Channels under gravity flow shall be sized for a maximum flow velocity of 0.6 m/sec.

- 4.06.00 The following " C" Value shall be used in WILLIAM & HAZEN formula for calculating the friction loss in piping and fittings.

i)	Carbon Steel Pipe	:	100
ii)	C.I Pipe	:	100
iii)	Carbon Steel Pipe (inside rubber lined)	:	120
iv)	PVC / HDPE / GRP / CPVC pipes	:	140

For calculating the pump head, atleast 10% margin shall be taken over the pipe friction losses.

- 4.07.00 Piping Layout

- 4.07.01 Piping shall be grouped together as far as practicable and routed to present a neat appearance and orientation. All piping shall generally be installed perpendicular or parallel to the major equipment, building structure and floor. Pipe routing shall be such as to provide sufficient clearance for removal and maintenance of equipment, easy access to valves, instruments and other accessories. The piping shall not encroach on the withdrawal space of other equipment. Piping shall be routed to avoid interferences with other pipes, hangers, structures, equipment electrical trays, HVAC ducts etc. Convenient supporting points, adequate flexibility for thermal expansion and neat appearance shall be considered in piping layout work.

- 4.07.02 Provision shall be made while preparing piping layout to accommodate all system accessories such as valves/ expansion bellows/instrument stubs/instruments/ specialties as per P&ID.

- 4.07.03 All local instruments on the pipeline shall be located such that the reading can be observed without inconvenience.

- 4.07.04 Overhead indoor piping shall have a vertical clearance of minimum 3.0 m above finished floor level of working areas / walkways. Overhead outdoor piping shall have a vertical clearance of minimum 4.0 m above finished ground level and minimum 7.5 m above finished road level unless addressed otherwise elsewhere in this specification. When several pipe lines are laid parallel, flanged joints must be staggered. Welded and flanged joints should as far as possible located at one third span from supports. If the support is situated right under the welded joints this joint must be reinforced with a strap. Flanged and welded joints must be avoided in the middle of the span. Valves should be located in such a manner so as to ensure their convenient operation from the floor or the nearest platform.

- 4.07.05 In specific cases (subject to instruction by Purchaser for any site specific reason), pipes may be routed overground on RCC pedestals with bottom of pipes minimum 300 mm above finished ground level.

- 4.07.06 Pipe, when specifically addressed, shall be laid in trenches or buried. All buried pipes in general shall be laid with the top of the pipe 1.2 m to 1.5 m below the finished ground level unless mentioned otherwise. Full length of buried piping shall be provided with 100 mm thick sand bed.

- 4.07.07 Openings provided to accommodate pipelines must be closed with bricks and mortar with 10 mm to 12 mm clearance between brick work and pipe. The clear space must

be filled with felt or approved filling compound. The details of wall sealing arrangement shall be approved by Purchaser.

4.07.08 Drains shall be provided at low points and at pockets in piping such that complete drainage of system is possible. Vent connections shall be provided at high points where air or gas pockets may occur. Vent for use during hydrostatic test shall be plugged after the completion of the test. Vents shall not be less than 15 mm size. Plugs / cocks required for vent/drain system shall form part of the piping system and shall be supplied by Bidder as per finalized flow diagram. All vent valves & drain valves shall be arranged with easy reach of operation. All pipelines shall be given proper slope towards the drain points.

4.07.09 To facilitate dismantling of piping at the valves and equipment, break up flange/unions shall be provided. The location shall be decided as per the system requirement during detailed engineering.

4.08.00 Line Joints

Line Joints shall be envisaged as follows:

CS and SS pipes	:	Welded (socket welded for 50 mm NB & below & butt welded for 65 mm NB and above)
Galvanized Pipes	:	Screwed
Rubberlined Pipes	:	Flanged

4.08.01 Welded joints

For making welded joints (socket weld or butt weld) the welding shall be performed by manual shielded metal arc process. Any welder employed for carrying out welding shall be qualified as per ASME-Section IX for the type of joints to be welded. Jointing by butt weld or socket weld shall depend upon the respective piping material specification.

For Stainless Steel piping atleast the root run shall be welded with Tungsten Inert Gas (TIG).

Butt welding edge preparation shall be done as per ANSI-B 16.25.

All welding electrodes and welding rods including special ones, if any shall be furnished by the Bidder.

4.08.02 Screwed joints

Threading of pipes shall be carried out after bending, heat treatment etc. If not possible, threading may be done prior to these operations but proper care should be taken to protect them from damage. Threads shall be to ANSI-B 2.1 (taper) NPT / IS 554, unless specified otherwise.

Teflon tapes shall be used to seal screwed joints and it shall be applied to the male threads only. Threaded parts shall be wiped clean of oil or grease (with appropriate

solvent if necessary) and dried before applying the sealant. Pipe ends shall be reamed or filed out to size of bore and all chips shall be removed. Screwed flanges shall be attached by screwing the pipe through the flange and the pipe as well as the flange shall be refaced accurately.

4.08.03 Flanged joints

All flanges and flange drilling shall be to ANSI-B 16.5 of applicable pressure/temperature class. However in case of interface with the pipe of Purchaser, the flange/interconnection details shall be designed to match the applicable interface piping and concerned details.

When weld neck or socket weld flanges are used, their bore must be made the same as that of the pipe being welded to. Socket welded or threaded flanges may be used, with the appropriate piping system for connection of pipe to the flanged equipment.

Drilling of flanges on piping must match with the drilling of flanges on the valves /equipments to which the piping is to be connected.

While fitting the mating flanges, care shall be taken to properly align the pipes and to check the flanges to trueness so that the faces of the flanges can be pulled up together without producing any stress on the adjacent pipes and equipment flanges.

Flanges shall be generally Slip-On / Blind Flat Face type. The packing ring or gasket of the flanged joint shall be of full face type. Flanged joints shall not be buried.

4.08.04 With reference to maintenance for carbon steel pipes, three piece socket welded unions for sizes 50 mm NB and below shall be used. For higher sizes, flanged joints shall be used.

4.09.00 Fabrication of Pipes

4.09.01 General Requirements

The Bidder shall prepare necessary fabrication drawings based on approved piping layouts.

Flanges and their contact surfaces shall be concentric with the pipe axis and shall be accurately machined and drilled true to template.

Where welded pipe and fittings are used, the longitudinal weld seams of adjoining sections shall be staggered by 90 degree.

Prefabrication shall be carried out in the fabrication shop to ensure quality of work and to minimize work on the field.

Where fabricated reducers have been specified, they shall be fabricated from parent pipes by the 'cut and shut' method.

All bends, tees and reducers shall be fabricated as per the latest edition of power piping code, ANSI-B 31.1 or approved equivalent. Reinforcement wherever required, shall be provided.

Only shop fabricated mitre bends or mitre fittings shall be acceptable. Mitre bends will not be accepted for steel pipes of 350 NB and below. For sizes 400 mm NB and above, the mitre bends shall conform to BS-534.

For easy handling & removal of equipment, valves etc. and for maintenance purpose, break up flanges shall be provided for 65 mm NB and above. For flanged joints of 50 mm NB and below, suitable type of compression flexible coupling shall be provided.

4.09.02 Rolled and Welded /Spiral Welded Pipes

Pipes of larger diameter shall be fabricated from steel plates conforming to IS-2062 by rolling and welding or spiral welded pipes shall be used.

Where pipe lengths need to be erected before the circumferential joints is welded, the pipe ends at these joints shall be beveled so that the top half is welded mostly from outside and the bottom half mostly from inside of pipe.

Beveled (single V / double V) ends shall be provided for butt welding as per Welding Procedure Specification.

4.09.03 Fabrication of flanges for large diameter pipes (sizes 600 mm NB and above)

Flanges fabricated from plates shall conform to AWWA-C 207 / BS-4504 / ANSI-B 16.47.

All welds in fabricated flanges shall be subjected to 10% radiographic examination.

Flanges shall be flat faced machined to 10 microns surface finish. Back face of the flanges shall also be machined to 25 microns surface finish.

Inspection holes shall be provided at suitable locations for pipes 800 mm NB and above as required for periodic observations and inspection purposes.

4.09.04 Rubber Lined Pipes

All rubber lined pipes shall be seamless or bead removed ERW pipes. Inside surface of the pipes shall be completely cleaned and made suitable for lining.

All rubber lined pipes shall have flanged joints. Pipes shall be welded with flanges before rubber lining.

For rubber lined pipe, natural rubber lining should be applied in two (2) layers on the inside surface of pipes, giving a total thickness not less than 3 mm. Surface hardness of rubber lining shall be 65 ± 5 Shore A class.

4.09.05 Welding

Welding shall be carried out by manual shielded metal arc and Tungsten Inert Gas

Welding process. Electrodes used shall be of Purchaser approved make. Electrodes shall be kept dry and electrode containers shall be protected against moisture. Electrodes that show sign of deterioration or damage shall not be used. Automatic or semiautomatic welding shall be done with the specific approval of Purchaser.

The Bidder shall submit procedures for welding, stress relieving, dye penetrant testing radiography etc. for prior approval of the Purchaser.

Weld shall not be made in pipe bends.

4.10.00 Supports for Overground Pipe

4.10.01 Complete supporting system for the pipe line shall be designed, fabricated and supplied by the Bidder. Inside the building, the overhead portion of the pipe line may be supported from the building structures. No support shall be taken from the brick wall. Outdoor pipes shall run on steel trestles wherever required. All the steel structure for the pipe rack and the supporting posts/trestles along with all necessary hangers, clamps, connecting steel, fixing bolts, nuts etc. shall be supplied and erected by the Bidder.

4.10.02 Hangers and supports shall be capable of carrying the sum of all concurrently acting loads. They shall be designed to provide the required supporting effects and allow pipe line movements as necessary. All guides, anchors, braces, dampener, expansion joint and structural steel to be attached to the building/structure, trenches etc. shall be provided. Type of hangers and components for all piping shall be selected and approval obtained from the Purchaser.

4.10.03 The supports shall meet the general guidelines indicated in the following code / standards:

MSS-SP 58	:	Pipe hangers & supports - Materials, design and manufacture.
MSS-SP 69	:	Pipe hangers & supports Selection and application.
ANSI-B 31.1	:	Power Piping Codes

4.10.04 Bidder shall locate, design, fabricate, supply and erect all supports, restraints and anchors required for supporting of over ground portion of piping under this contract

4.10.05 Support drawings for piping shall be got approved from the Purchaser. BOM for each support shall also be submitted.

4.10.06 All material for supports shall be of tested quality.

4.10.07 All structural steel required for supports shall be provided by the Bidder at no extra cost to the Purchaser.

4.10.08 All pipe supporting element, guides, sliding support, beams, channel section, attachment to supports, beam clamps etc. shall be provided by the Bidder.

4.10.09 Support locations will be shown in the layout drawing to be submitted by the Bidder.

4.10.10 Fabrication, supply and installation of brackets, pipe shoes, saddles etc. shall be

- included in the scope of Bidder and the same shall be carried out as per approved drawings.
- 4.10.11 If an outdoor saddle support is assumed to permit sliding movement of piping over the support, consideration shall be given in selection of supporting material at the interface so that no rust formation takes place and the actual sliding movement is feasible in practice.
- 4.10.12 All pipe supports shall be designed to fully sustain the pipe in normal operating position, allow free and ample expansion or contraction except where anchored and prevent excessive stress.
- 4.10.13 Sway braces, cushioned clamps or other vibration control equipment shall be used in order to prevent unwanted movements of the piping due to vibration, shock or other causes. These shall be of such design as to protect piping against these movements regardless of direction.
- 4.10.14 The supports shall be so interspaced as to minimize sagging of the pipes and to keep them within permissible limits where pipes are full with the conveying media.
- 4.10.15 All piping supports shall be designed to avoid interference with other piping hangers, electrical conduits equipment and structures etc.
- 4.10.16 Saddles, supports etc. shall be capable of carrying the sum of all concurrent acting loads and shall be fabricated from plates/pipes sections conforming to SA 53 / IS-2062 or equivalent. They shall be designed to provide the requirement of supporting effects and allow pipe line movements as necessary. The structural work shall be as per IS-800 / BS-4360.
- 4.10.17 The maximum spans of the supports of straight lengths shall not exceed the recommended values indicated in ANSI-B 31.1. The spans shall be suitably reduced considering the following:
- a) Point loads due to valves and specialties, branch lines etc.
 - b) Pipe bends
 - c) Structural Steel beams.
 - d) Facilities for maintenance of flanged joints.
 - e) Minimum loads on equipment.
- 4.10.18 All vertical lines shall be properly supported on the vertical run and additionally provided with adequate number of lateral-restraints where the length of vertical run exceeds 5M.
- 4.10.19 At all sliding surfaces of restraints and supports Bidder shall provide a teflon lining to minimize sliding friction.
- 4.10.20 Pipe clamps shall have a minimum thickness of 5 mm for indoor piping and 6 mm for outdoor piping.
- 4.11.00 Erection

- 4.11.01 The Bidder shall coordinate the erection of the piping system as required with the erection schedule of other concerned systems. The sequence of work shall be carefully planned to minimize interference with other groups working in the same area. The actual sequence to be followed shall be to the approval of Purchaser who may at any time, direct the Bidder to reschedule his work as per the status of work site
- 4.11.02 Prior to making interface connections with equipment / system supplied by others, the Bidder shall obtain the approval of the concerned authority.
- 4.11.03 All workmanship shall be accomplished using accepted methods and procedures of the highest recognized fabrication and erection code / standards. Workmanship not conforming to the intent of this specification shall be liable to rejection by the Purchaser at any time, during the progress of work. The Bidder shall correct the workmanship immediately at no extra cost to the Purchaser.
- 4.11.04 The Bidder shall make all interface joints of the piping system, covered under this specification at the connecting points with equipment/piping supplied by others.
- 4.11.05 It is the responsibility of the Bidder to ensure correct orientation of all valves, instrument stubs etc. in line with final piping drawings.
- 4.11.06 The Bidder shall utilize the existing structures if any, to support the piping as far as practicable. All auxiliary steels required shall be supplied by the Bidder.
- 4.11.07 Before performing any welding, all corrosion products, dust, grease and other foreign material shall be cleaned from the surfaces to be joined.
- 4.11.08 Piping on both sides of the joint shall be adequately supported during all welding. Temporary supports, if used shall be so designed that no stress due to pipe weight comes on the joints during the joining.
- 4.11.09 All pipes shall be located and laid in accordance with the approved layout drawings. No deviation will be allowed unless written consent is issued by Purchaser in specific case(s).
- 4.11.10 Before laying the pipes, the coordinates and levels of the pipes shall be checked by the Bidder. Any discrepancies between the execution and approved drawings shall be brought to the notice of the Purchaser and corrections shall be carried out as per his instructions.
- 4.11.11 During erection of piping, the Bidder shall provide proper number and size of bolts and nuts as per drawings and specification. The Bidder shall provide approved quality of grease mixed with graphite powder thoroughly on all the bolts, nuts and washers immediately after erection and when the flange joints are dismantled for flushing, testing and alignment of equipment etc. to prevent rusting of nuts, bolts and gaskets. The grease and graphite powder shall be supplied by the Bidder
- 4.12.00 Cleaning and Flushing
- The exterior and interior surface of all piping shall be thoroughly cleaned of all sand, mill scale, grease, oils, dirt and other foreign materials. After cleaning, the interior surfaces of all piping shall be thoroughly blown dry and protected with a completely

water soluble preventive coating.

Flange faces shall be coated with an easily removable rust preventive coating.

Machined surface shall be coated with rust preventive paint. The paint shall be consumable in the welding process.

4.13.00 Pipes and Fittings if any, coming under purview of IBR, should meet its requirements and getting the approval from IBR in respect of the same shall be under the scope of the Bidder.

4.14.00 Valves & Isolation Gates

Valves will be used to start/stop or control flow.

All valves, shall be suitable for service conditions i.e. flow, temperature and pressure under which they are required. The valves shall be of standard pressure rating as per the applicable code/ standard. The pressure rating of diaphragm valves shall be selected considering the maximum expected operating differential pressure. Sample valves will be used in sample collection lines.

Gates will be primarily used for isolation of flow in open channels although these should be capable of throttling the flow too.

For location and type of Valves / Isolation Gates, Bidder need to refer to the P&I drawings enclosed with this specification.

4.14.01 Sluice / Gate Valves (for river water / clarified water / filtered water / similar application)

Sluice / Gate valve shall conform to IS-14846 PN1.6 minimum. Stem, seat ring and wedge facing ring shall be of stainless steel construction. Other parts shall be as per IS-14846. Valves shall be of outside screw and rising stem type. Ends will be flanged and compatible with ANSI-B 16.5 Cl. 150 (minimum) piping flanges.

Sluice / Gate valves for sizes 50 mm NB and below shall conform to IS-778 Class-2 / ANSI-B 16.34 straight, rising stem; with outside screw.

Sluice / Gate valves shall be provided with the following accessories in addition to the standard items.

- a) Hand wheel
- b) Gear Reduction Unit Operator for valves 250 mm NB and above.
- c) Bypass valve for valve of sizes 300 mm NB and above.
- d) Draining / Flushing arrangement wherever required.
- e) Arrow indicating flow direction.
- f) Position indicator.

Sluice / Gate Valves shall be provided with back seating bush to facilitate gland renewal during full open condition.

For lower sizes, the gate valves will be screwed bonnet with outside screw rising stem as per IS-778. The material of construction will be gun metal body, with brass stem and trim. Ends will be screwed to ANSI-B 2.1.

Gate valve on galvanized iron pipe shall be gun metal construction as per IS-778 Class 2. Ends will be screwed to ANSI-B 2.1.

4.14.02 Butterfly Valves (for river water / clarified water / filtered water / similar application)

Butterfly valves shall be of double flanged or lugged wafer type of low leakage rate conforming to AWWA-C 504 class 150 (min.) or BS-5155 PN 10 / class 150 (minimum)

The various components of butterfly valves shall be of the following:

i)	Body	:	Cast Iron – ASTM-A 48 Cl.40; BS-1452 Grade220 SG Iron – BS-2789. Cast Iron IS-210 Grade FG 260 Cast Steel – ASTM-A 216 Grade WCB; BS- 1504 or Equivalent grade (subject to approval by Purchaser).
ii)	Disc	:	Cast Iron – ASTM-A 48 Cl.40; BS-1452 Grade220 SG Iron – BS-2789. Cast Iron IS-210 Grade FG 260 Cast Steel – ASTM-A 216 Grade WCB; BS-1504 or Equivalent grade (subject to approval by Purchaser).
iii)	Shaft	:	ASTM-A 296 Grade CF 8M / AISI 316; AISI-420; BS-970 Grade 316; BS-970 Grade 420 S45.
iv)	Seat rings	:	Nitrile rubber, EPDM (Ethylene propylene rubber), Hypalon.

Butterfly valves shall be fitted with sleeve type bearing such as PTFE. Valves of size 350 mm NB and above shall be provided with one or two thrust bearings to hold the disc securely in the centre of valve seat without hydraulic or external axial shaft loads. Sleeve and other bearings fitted into the valves body shall be of self lubricated materials that do not have any effect on the fluid handled and other components of the valves.

All the butterfly valves shall be provided with Hand wheel or lever/wrench operated as per the requirements.

The use of lever operators shall be limited to valves requiring a maximum of 90 degree stem rotation from full open to full closed position. For lever/wrench operated valves, means shall be provided for positively holding the disc in not less than three intermediate positions

For larger sizes i.e. 150 mm NB and above, hand wheel shall be provided.

Manually operated valves shall be provided with reduction gear unit for valves of size 250 mm NB and above. Valve provided with motorised or pneumatic actuator shall be provided with a hand wheel for manual operation.

All the valves shall be equipped with adjustable mechanical stop-limiting devices to prevent over travel of the valve disc in the open and closed positions. The valve operators (Handwheel or Gear reduction unit or Motor actuator etc.) shall be designed as per applicable International Standard.

All the butterfly valves shall be provided with an indicator to show the position of the disc.

Ends will be flanged and compatible with ANSI-B 16.5 Cl. 150 (minimum) piping flanges.

4.14.03 Butterfly Valves (for decaionized water / deanionized water / demineralized water / desalinated water / similar application)

The butterfly valves shall conform to the requirements addressed under Cl. No. 4.14.02 above along with the requirements delineated below:

- a) Body shall be lined (minimum 3 mm) with natural rubber, ebonite, polypropylene or PVDF.
- b) Disc shall be either lined with PVDF, polypropylene, or natural rubber or shall conform to ASME-SA 479 Grade 316.

4.14.04 Ball Valves (for river water / clarified water / filtered water / similar application)

Ball valves may be used for sizes 40 mm NB and below. Ball valves shall conform to the following technical specifications:

a)	Design Standard	BS:5351
b)	Type	Screwed / Welded / Flanged ends; Full Bore: Split Body & Seat supported construction
c)	Material of Construction	
	Body	Carbon Steel to ASME-216 WCB / Cast Iron to IS-210 Grade 220 or better.
	Ball	Stainless steel ASME-SA 479 Grade 316 or 410.
	Seat ring	PTFE
	Stem	Stainless steel ASME-SA 479 Grade 304 or 316 or 410.
	Seats	Nitrile rubber; PTFE

- d) Valves shall be designed to be directly operable by a wrench / hand lever.

- e) Suitable stops shall be provided for both the fully open & close condition.
- f) All the valves shall be provided with an indicator for showing the position of the ball port.
- g) Ends will be flanged and compatible with ANSI-B 16.5 Cl. 150 (minimum) piping flanges

4.14.05 Globe Valves (for river water / clarified water / filtered water / similar application)

Globe valves shall conform to the following technical specifications:

For sizes 50 mm NB and below

- i) Design Standard : IS-778 Class-2 / BS-1873
- ii) Type : Straight, rising stem, with outside screw.
- iii) Material of Construction

i)	Body, Bonnet, Stuffing Box & seat rings	Leaded Tin Bronze conforming IS-318 Grade 2
ii)	Stem	Stainless Steel, AISI-316
iii)	Disc	IS-318 Grade 2/AISI-316

Note: However, valves in the flushing water lines shall be of type and material specified for the chemicals which are being flushed by the line.

For sizes above 50 mm NB

- i) Design Standard : BS-13789 PN 10 (minimum).
- ii) Type : Double Flanged or wafer body, outside screw and rising stem type.
- iii) Material of construction

a)	Body	: Cast iron: IS-210 Grade FG260 / BS-1452 Grade14.
b)	Stem	: Stainless steel AISI-410 / 13% chrome steel.
c)	Disc	: Cast iron IS-210 Grade 260 / BS-1452 Grade 14.

d)	Packing	:	PTFE
e)	Seat & seat rings	:	13% chromium steel
f)	Gland & gland nut	:	AISI-420
g)	Hand wheel	:	Cast Iron or Malleable Iron

- iv) Back seat shall be provided on the stem or on the disc.
- v) Renewable disc assembly shall consist of disc holder, disc, disc guide, check nut and disc retaining nut with washer.
- vi) Disc of globe valve may be provided with renewable rubber seating ring.
- vii) Handwheels shall be marked with the word. OPEN or SHUT with arrow to indicate direction of opening or closing.

Ends will be flanged and compatible with ANSI-B 16.5 Cl. 150 (minimum) piping flanges

Globe valve on galvanized iron pipe shall be gun metal construction as per IS-778 class 2. Ends will be screwed to ANSI-B 2.1.

Note: However, valves in the flushing water lines shall be of type and material specified for the chemicals which is being flushed by the line.

4.14.06 Diaphragm Valves (for river water / clarified water / filtered water / similar application)

Metallic Unlined Diaphragm valves (manual / auto as specified elsewhere in this specification) may be used for isolation purposes.

The Metallic Unlined Diaphragm valves shall conform to the requirements addressed under Cl. No. 4.14.07 below except the requirements with reference to lining for body and integral flanges.

4.14.07 Diaphragm Valves (for decationized water / deanionized water / demineralized water / desalinated water / dilute and concentrated acidic solution / dilute and concentrated alkaline solution / similar application)

Metallic Diaphragm valves (manual / auto as specified elsewhere in this specification) may be used for isolation purposes.

The metallic diaphragm valves shall conform to the following requirements.

- a) Design Standard : BS EN-13397 or Equivalent (subject to approval by Purchaser) of required

- rating/class. (minimum rating of valves should be PN 10).
- b) Type : Flanged and lined body ends, sealed bonnet, weir pattern, tight shut off type.
- c) **Material of Construction**
- Body/Bonnet : Cast Iron IS-210 Grade FG.260 or Equivalent (subject to approval by Purchaser).
Cast steel ASTM-A 216 Grade WCB.
- Body lining : Soft Natural rubber - 3 mm thick as per IS-4682 (hardness 85-90 on shore A), Ebonite polypropylene, PVDF.
- Diaphragm : Reinforced rubber, Hypalon
- Handwheel : Cast Iron
- Compressor : Stainless Steel
- Stem & Bush : Stainless Steel
- d) Ends will be flanged and compatible with ANSI-B 16.5 Cl. 150 (min.) piping flanges, full face rubber lined and shall be cast / integral with the body.
- e) Handwheels shall be marked with the direction of closure.
- f) Valves shall be provided with a position indicator to show the open and closed condition.
- h) Valves provided with pneumatic actuators shall be provided with a handwheel for manual operation. The valves operators shall be designed as per applicable International Standard.
- i) The testing of valves will be as per BS EN-13397 and rubber lining will be tested as per IS-4682.

Note: For valves which may come in contact with concentrated acid/ alkali, the material of construction of diaphragm shall be as follows:

Diaphragm shall be of reinforced Teflon, EPDM for acid services and reinforced Neoprene / Hypalon for alkali services.

Use of Nonmetallic Diaphragm Valves for any specific / critical application shall be subject to approval by Purchaser and shall conform to the requirements of BS EN ISO 16138 - Industrial valves. Diaphragm valves of thermoplastics materials.

4.14.08 Plug Valves (for lime solution / sludge / similar application)

The plug valves shall conform to the following requirements.

a)	Design Standard	BS-5158 or Equivalent (subject to approval by Purchaser)
b)	Type	Flanged and non lubricated, regular pattern, plug valves.
c)	Material of Construction	
	Body	Cast Iron IS-210 Grade FG 260 or Equivalent (subject to approval by Purchaser)
	Plug	Stainless Steel AISI-316
	Body Sleeve or Seat	PTFE
	Seat	PTFE
	Gland	AISI-304 / AISI-316
	Cover	Cast Steel ASTM-A 216 Grade WCB
	Gland Nut	AISI-304 / AISI-316

- d) Valves shall be operated by permanently fitted wrench or Hand lever. Wrench shall be mounted so that they are parallel to the valve bore axis when the valve is in fully open condition.
- e) All valves shall be provided with an indicator for the position of the plug part.
- f) Suitable stops shall be provided for the fully open and fully closed positions of the valve.
- g) Valves of size of 250 mm NB and above shall be provided with a suitable reduction gear unit.
- h) Ends will be flanged and compatible with AISI-16.5 Cl. 150 (minimum) piping flanges.

4.14.09 Non Return or Check Valve (for river water / clarified water / filtered water / similar application)

Non return valves shall be of swing check (reflux) type or dual plate type.

The valves shall conform to the following specifications.

- i) Design Standard : IS-5312, BS-1868, BS-5153, API-594 / API-60 or equivalent (subject to approval by Purchaser)
- ii) Type : Swing check Type and Flanged ends.
- iii) Material of Construction:

a)	Body & Cover Hinge Disk/Door	Cast iron IS-210 Grade FG 260 / Cast Iron BS-1452 Grade 220 or equivalent (subject to approval by Purchaser)
b)	Hinge Pin and Door / Disc Pin	Cast steel ASTM-A 216 Grade WCB High tensile Brass IS-320 HT 2 or BS-2872 equivalent (subject to approval by Purchaser)
c)	Disc facing ring	Stainless steel
d)	Body Seat ring	Stainless steel
e)	Bearing bushes	Leaded Tin Bronze IS-318 Grade 2
f)	Bolts	Carbon Steel

Ends will be flanged and compatible with ANSI-B 16.5 Cl. 150 (minimum) piping flanges. .

Body shall be permanently marked with an "arrow" inscription indicating the direction of motion of the fluid for all the check valves.

For sizes 50 mm NB and below, check valves shall be gun metal body swing type as per IS-778. Ends will be screwed type to ANSI-B 2.1.

4.14.10

Non Return Valve (for decationized water / deanionized water / demineralized water / desalinated water / dilute and concentrated acidic solution / dilute and concentrated alkaline solution / similar application)

The valves shall conform to Cl. No. 4.09.00 above along with the following requirements:

- The body, cover & Disc shall be lined with natural Rubber, PTFE or Viton. The Hinge, Hinge Pin & Disc Pin shall be coated with PVDF, or suitable elastomer. The bearing bushes shall be PTFE or Equivalent (subject to approval by Purchaser) material (subject to approval by Purchaser). Bolting shall be of stainless steel. In the absence of lining/coating, the complete valve shall be of stainless steel construction (AISI-316).
- For only acid services Non- Return valves shall be of lined construction & Flap type.
- For alkali services, the complete valve shall be stainless steel construction (AISI-316) or of lined construction as specified above.

4.14.11

Valves for Sampling / Instrument Isolation Service

Each sampling valve / instrument isolation valve shall be full bore ball type.

Ball valves shall conform to the requirements stipulated under Cl.4.04.00 above. However, Body material shall be Stainless Steel (AISI-316).

4.14.12 Valves for Air Service

For Air services globe valves or Ball valves may be used for sizes 50 mm NB and below.

For sizes higher than 50 mm NB, either Butterfly valve or Ball valves shall be used.

Globe valves shall generally conform to Cl. 4.05. 00 above.

Ball valves shall conform to the requirements stipulated in Cl.4.04.00 above. However, Body material shall be leaded Tin Bronze (IS-318 Grade2) or stainless steel (AISI-304 / 316).

Butterfly valves shall conform to the Cl.4.03.05 to 4.03.09 of this section. However, the body & Disc shall be either cast iron lined with elastomer such as PVDF or PTFE or stainless steel construction (AISI-304 / 316).

4.14.13 Safety / Relief Valves

The safety valves / relief valves at the downstream of positive displacement type metering pumps shall be of the standard type manufactured by the pump manufacturer and the material of construction shall suit to the fluid handled.

4.14.14 Valves for Resin Transfer Line

In resin transfer line two way eccentric plug valve shall be used. The valves, shall have type 316 stainless steel body and bearings, resilient faced plug and flanged ends.

4.14.15 Isolation Gates

Design standard for gates shall be IS-3042 or Equivalent (subject to approval by Purchaser).

The gates shall be rectangular or square sluice, rising spindle type conforming to class-1 of IS-3042.

Material of Construction

i.	Frame and Door	Cast Iron IS-210 Grade 20
ii.	Spindles, bolts & nuts	M.S. to IS-2062
iii.	Face & seat rings	Gun metal (as per IS-3042).

All the parts of gates shall be applied with the coats of heavy duty bitumastic paint.

Each of the gates shall be provided with handwheel, and a position indicator.

The gates for DM plant drains shall be rubber lined to a minimum thickness of 4.5 mm.

4.15.00 Strainers
4.15.01 Basket Strainers

- a) Basket strainers of simplex design shall have the following materials of construction for raw/clarified/filtered water application.

i.	Body	Fabricated mild steel : IS-2062 (Tested quality)
ii.	Strainers	Wire shall be stainless steel (AISI:316 18 BWG 30 mesh suitably reinforced. Reinforcement material shall also be of stainless steel construction.
iii.	Drain Plug / Nuts	Gun metal

- b) Inside and outside of basket body shall be protected with one coat of high build zinc phosphate primer and three coats of Chlorinated rubber paint to a total thickness of 200 microns.
- c) Suitable Vent and drain valves shall be provided for the strainers.
- d) Screen (strainer) flow area shall be at least four times pipe sectional area. Flow area in any portion of Basket strainer assembly shall not be less than the pipe cross sectional area.
- e) Pressure drop in clean condition shall not be more than 1.0 mwc at full flow.
- f) Basket Strainer shall be provided with lifting lugs and suitable mounting arrangement.
- g) For DM water service, body shall be rubber lined to minimum 4.5 mm thickness (soft rubber of shore Hardness $65 \pm 5^\circ\text{A}$).

4.15.02 Y-Type Strainer

- a) Y-Type strainer for water application shall be constructed of following materials:

i.	Body	Cast Iron IS-210 Grade FG 260
ii.	Strainers	Wires of stainless steel AISI-316, 18 BWG 30 mesh suitably reinforced. Reinforcement material shall also be of stainless steel construction.
iii.	Drain Plug / Nuts	Gun metal (threaded construction)

- b) Y-Type strainers shall also conform to Cl. 4.15.01 (b), (c), (d), (e) and (f).
- c) Body of the Y-type strainers of alkali, and demineralised water shall be of Cast Iron (IS-210 Grade FG 260) and lined with soft or hard rubber to a thickness of 3 mm.

- d) For acid services, apart from the rubber lined body material, the screen material, shall be Polypropylene or HDPE wire cloth of suitable mesh and thickness.

4.16.00 Resin Traps

The resin traps for the Ion exchange vessels shall be provided for the collection of Ion exchange resin shall conform to the following:

- 4.16.01 The body shall be of mild steel (IS-2062) and lined internally with rubber (Hard/Soft rubber), Saran or polypropylene. The internals (rod and screen) for all resin traps shall be of AISI-316 construction. All screen components shall be welded at each intersection of wire and support rod for good strength, Resin traps screen opening shall not exceed 120 percent of the associated process vessel under drain/backwash collection header nozzle screen opening and shall be suitably selected to retain even the minimum size of the resin selected for the process.

- 4.16.02 The resin traps shall be provided with a draining arrangement with a valve for collection of trapped resins. Resin trap body shall have lifting lug for easy handling during maintenance/erection.

4.17.00 General Requirements for Valves, Gates, Strainers and Resin traps

- 4.17.01 All the items shall be suitable for service conditions i.e. flow, temperature and pressure to which they may be subjected to.

- 4.17.02 All the items shall be of proven design for the duty conditions and the Bidder or manufacturer shall have sufficient experience in using the above equipment in water treatment application in the plants supplied earlier by them.

- 4.17.03 In case Purchaser desires, the experience list/feedback from the users shall be made available to Purchaser for any or all the equipments during the detailed engineering phase.

- 4.17.04 Valves will be used to start/stop or control flow. Gates will be primarily used for isolation of flow in open channels although these should be capable of throttling the flow too. Sample valves will be used in sample collection lines.

- 4.17.05 All valves shall be suitable for service conditions i.e. flow, temperature and pressure under which they are required. All the valves shall be of standard pressure rating of the applicable design code / standard. Non standard pressure rating shall not be accepted. The pressure and temperature rating of the valve shall not be less than the maximum expected pressure and temperature plus 5% additional margin of the system in which valves are proposed to be installed.

- 4.17.06 Valves pressure classes, sizes, types, body materials, and end preparation shall generally be as described herein, unless mentioned otherwise elsewhere in Bid Specification. All valves shall conform to the requirements of the governing codes, and the requirements specified.

- 4.17.07 Valves (including safety, relief and control valves) body materials shall be compatible with the piping with which they are used. If the body material is not of the same type as the material of the connecting pipe work, the valves shall be fitted with suitable welding nozzles to avoid dissimilar butt welds at site.

- 4.17.08 Each modulating control valve shall be provided with isolation valves. Manual bypass valve shall be provided for each modulating control valve to achieve safe and reliable manual operation.
- 4.17.09 All the actuators of the valves shall be designed to handle the maximum expected pressure differential across the valves and to overcome friction forces and unbalance forces due to the flow through valve.
- 4.17.10 Valve bodies and bonnets shall be designed to support the valve operators (handwheel, gear, or motor) with the valve in any position without external support.
- 4.17.11 Valve ends and size limitations are as follows:
- 50mm NB and smaller valves - Class 800 minimum with socket weld ends. (For instruments connections/ isolation valves screwed ends may be acceptable)
 - 65mm NB and larger size valves - Class 150 minimum (butt-weld ends or flanged or wafer style).
 - Flanged steel butterfly valves - 750mm and larger size; pressure class per AWWA / BS-5155.
- 4.17.12 Gate, globe and angle valves shall be outside stem and yoke construction.
- 4.17.13 Valves sizes 65 mm NB and larger shall have a non-rising handwheel.
- 4.17.14 All the actuator operated valves shall be fitted with handwheel for manual operation. The pneumatic actuators shall be selected based on the available air pressure and operating air pressure (maximum and minimum). The supporting calculations for selection of actuators shall be furnished for Purchaser's approval before finalization of all the actuators.
- 4.17.15 Valves coming under the purview of IBR if any shall meet its requirements and the approval of the same shall be obtained by the Bidder.
- 4.17.16 Sizes of the valves shall be same as that of the interconnected pipe sizes except for the control valves.
- 4.17.17 The various items shall be installed such so that they are easily approachable for the operating and maintenance personnel. All valves shall be accessible without chain pulls, as far as possible. Generally Valves shall be located about 1.2 meter to 1.5 meter from the operating platform and also they shall not be located below the ground level such as beneath the trenches etc. In such cases, extended spindle shall be provided with chain operating from operating floor. Valves which are installed below the ground floor shall be provided with a floor mounted pedestal at the top of the operating floor. Valves which are installed below the ground floor shall be provided with a floor mounted pedestal at the top of the operating floor. The position indicator for such valves shall be also provided along with the stand.
- 4.17.18 All valves shall be provided with hand wheels. Wherever necessary, chain operator shall be provided so that the valve may be operated from the ground floor.
- 4.17.19 All valves shall be provided with cast heat marks on casting of Body and Bonnet.

- 4.17.20 Whenever screwed valves will be installed in a pipe line, it will always be followed by screwed three piece union of same material as that of pipe.
- 4.17.21 Short pieces used for welding of different pipe fittings and valves shall not be less than 80 mm in length.
- 4.17.22 However valves which are provided (in the buried pipe line) with a valves chamber shall have manual operator/Handwheel inside the valve chamber. The valve chamber shall be provided with built in ladders/staircases and sufficient operating space within the chamber shall also be provided for easy operation of such valves.
- 4.17.23 All the valves, strainers, resin traps etc. shall be provided with external painting as that of the interconnected piping as specified in Clause 3.03.14 above. However, surfaces such as Stainless Steel, aluminium, copper, brass, bronze and other non-ferrous materials shall not be painted. No paint or filter shall be applied until all repairs, hydrostatic tests and final shop inspections are completed, but shall be applied prior to shipment.
- 4.18.00 Rubber Expansion Joint
- 4.18.01 The inner cover (i.e. the tube) and also the outer cover shall be made up of natural or synthetic rubber of adequate thickness. The carcass between the tube and the cover shall be made up of high quality cotton and rayon cord having suitable number of plies and impregnated with rubber or synthetic compounds. Moreover, to ensure adequate strength, reinforcements consisting of metal rings embedded in the carcass, shall be provided.
- 4.18.02 In all cases, the expansion joints shall be integral flanges at both ends complete with split retaining rings.
- 4.18.03 Each of the expansion joint shall be provided with adequate number of limit rod assemblies which shall be tightened after erection of the entire suction branch of the pumps, in order to avoid transmittal of undue pressure thrust on to the pump foundation. Each of these limit rod assemblies shall consist of a long bolt and two connecting plates which are, in turn securely bolted to opposite flanges. Each plate is to be drilled with three holes, two for bolting to the flange, the third for passage of the stretcher belt. Rubber washers backed with metal washer shall be placed under the head of the bolt and under the nut.
- 4.19.00 Protective Lining and Painting
- The supply and application of Protective Lining and Painting with reference to Piping, Fittings and Valves need to be as per **Sub Section: Section-XIII of V.III-C– Technical Specification for Protective Lining and Painting**, attached herewith.
- 5.00.00 **TESTS AND INSPECTION**
- 5.01.00 Tests & Inspection for Pipes and Fittings
- 5.01.01 Shop Tests
- Shop test shall include all tests to be carried out at supplier's work, works of sub

suppliers and at works where raw materials supplied for manufacture of equipment are produced. The supplier shall carryout a comprehensive inspection and testing program during manufacture at works. Necessary Manufacturing and Field Quality Plans shall be prepared by supplier and submitted for approval by Purchaser for all checks conducted on raw materials, fabrication etc.

Calibrated instruments required for measuring / testing of pipes shall be arranged by manufacturer at their works during inspection.

Purchaser shall be given full access to all tests. The manufacturer shall inform Purchaser of the testing well in advance so that Purchaser at own option may witness the test.

All the test certificates and reports shall be submitted to Purchaser for approval.

All the mechanical and chemical tests including optional tests if any as per the applicable codes / standards shall be carried out and the test certificates for the same shall be submitted for approval by Purchaser. Material Certificate shall be furnished for each grade / lot of pipes. All material test certificates shall carry material specification, size, class, length, chemical composition, physical properties and heat number or other acceptable reference to enable correlation of the certificate with the pipe. IBR / CCE / TAC approval certificates / any other statutory approval certificates as required shall be furnished.

Welding procedure and welder performance qualifications shall be carried out. Mechanical and chemical tests shall be carried out as per code. Spot radiography check shall be carried out for all butt welds. D.P.T shall be carried out for all root run welds. Segmented flanges exceeding 30 mm thickness shall be stress relieved. Tensile test, eddy current test, bend test, flattening test and dimensional checks as per applicable code shall be carried out.

All rubber lining is to be subjected to the following tests as per IS-4682 Part I:

- a) Adhesion test.
- b) Tests to check resistance to bleeding.
- c) Measurement of thickness of lining.
- d) Shore hardness test.
- e) Spark test at High voltage 5 KV / mm of thickness.

Galvanizing shall be carried out as per IS-4736 / IS-2629 and tested as per IS-2633 / BS- 729. The test shall include weight of coating, uniformity of thickness and adhesion test.

All pipes and fittings shall be subjected to hydraulic tests as per applicable code / standard. When rubber lined, hydraulic tests shall be carried out before and after rubber lining.

Buried pipes where wrapping and coating is done, material for wrapping and coating shall be tested as per applicable code. Procedure for wrapping and coating and its testing shall be submitted for approval by Purchaser. Entire wrapping and coating shall be checked for thickness and Holiday test. Peel test shall be done to ensure

proper bonding of coating to surface.

5.01.02 Site Test

Hydraulic tests of the piping system at 1.5 times the design pressure or twice the working pressure whichever is higher shall be carried out for a period of minimum 30 minutes. However, if the Code / standard of supplied piping specifies more stringent requirements than the above criteria, then the hydraulic tests shall be conducted as per the applicable piping code / standard.

Pneumatic tests shall be carried out for all pressure piping that shall not be subjected to water filling.

The Bidder shall make all temporary closures/connections as required for hydro-static/pneumatic testing and clean/remove the same after successful completion of the test.

The procedure for hydro test and pneumatic test shall be submitted by the Bidder for review and approval by Purchaser.

All tests as indicated in FQP approved by Purchaser shall also be carried out.

5.02.00 Tests & Inspection for Valves / Gates / Strainers

5.02.01 Shop Tests

Chemical composition of all material, castings, forgings, etc. shall be tested for various components of the valves, gates, strainers and test certificates shall be submitted for approval by Purchaser.

Mechanical tests including optional tests if any shall be performed as per the applicable code / standard and the test certificates for the same shall be submitted for approval by Purchaser. The performance requirements of the valves shall also be tested as per the applicable code / standard.

Elastomer wherever coated or lined for the valves shall be tested for the corrosion resistance against the medium for which those are selected as per applicable code / standard and the test certificates shall be furnished for approval by Purchaser.

Rubber lining on Valves / Gates / Strainers / Resin Traps shall be checked in accordance with IS-4682 Part I including Spark Testing at high voltage (5 KV/mm of thickness).

All the valves shall be hydraulically tested for the body, seat, back seat and all valves shall be pneumatically tested for seat as per the applicable code / standard to which these are designed irrespective of the working pressure for which valves are selected.

Wherever specifically required, pressure drop across each type and each size of the valve at various flows shall be conducted, and test reports shall be submitted for approval by Purchaser. Type test report for this test (if already carried out by the manufacturer) may be submitted to fulfill this requirement.

Gates shall be tested against leakage and strength as required in the code / standard.

Strainer shall be hydraulically tested its strength and the pressure drop across the strainer assembly shall be verified at design flow for clean condition.

5.02.02 Site Tests

All valves, gates, resin traps, strainers and other fittings after erection at site shall be tested to hydraulic test pressure of two times the operating pressure or 1.5 times the maximum allowable pressure whichever is higher for a period of 120 minutes.

All valves / gates (Manual / Automatic) shall be operated throughout 100% of the travel manually and as well as from control panel and these should function without any trouble whatsoever.



TITLE:
4 X 270 MW BHADRADRI TPS

SPECIFICATION NO. PE-TS-411-164-A001

**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT**

REV. NO. 00

DATE : 24/07/2017

SUB-SECTION IIB

GENERAL TECHNICAL REQUIREMENTS (ELECTRICAL)

**GENERAL TECHNICAL REQUIREMENTS
FOR LV MOTORS**

SL.NO.	PARAMETERS	REQUIREMENTS
1	CODE ANS STANDARDS	IS-325, IS-12615, IEC-60034
2	SERVICE CONDITIONS	Hot, Humid and Tropical Atmosphere highly polluted.
3	TYPE AND RATING	General purpose, Constant speed, Squirrel cage, Three/Single phase, Induction type, Continuous duty, motor name-plate rating at 50°C shall have at least 15% margin
4	EFFICIENCY CLASS	IE3 (As per latest BIS notification)
5	RUNNING REQUIREMENT	(a) Motor shall run continuously at rated output over the entire range of 415V$\pm$10% voltage and 50Hz$\pm$3% to -5% frequency variations. (b) The motor shall be capable of operating satisfactorily at full load for 5 minutes without injurious heating with 75% rated voltage at motor terminals. (c) The motor shall be designed to withstand momentary overload of 60% of full load torque for 15 second without any damage.
6	STARTING CURRENT	(a) Motor shall be designed for direct online starting at full voltage. Breakaway starting current as percentage of full load current for various motor rating shall not exceed 600% subject to IS tolerance of plus 20%. (b) The motor shall be capable of withstanding the stresses imposed if started at 110% rated voltage. (c) Motor shall start with rated load and accelerate to full speed with 80% rated voltage at motor terminals. (d) Two hot starts in succession with motor initially at normal running temperature. (e) The motors shall be designed to withstand 120% of rated speed for 2 minutes without any mechanical damage.
7	LOCKED ROTOR WITHSTAND TIME	(a) Under hot condition at 110% rated voltage shall be more than motor starting time by at least 3 seconds for motors up to 20 seconds starting time and by 5 seconds for motor with more than 20 seconds starting time at minimum permissible voltage of 80% rated voltage. (b) Hot thermal withstand curve shall have a margin of at least 10% over the full load current of the motor to permit relay setting utilising motor rated capacity.
8	ENCLOSURE	All motor enclosures for outdoor, semi-outdoor & indoor application shall conform to the degree of protection IP-55. Motor for outdoor or semi-outdoor service shall be of weather-proof construction with canopy.
9	COOLING	The motor shall be self ventilated type, either totally enclosed fan cooled IC 411(TEFC), totally enclosed tube ventilated IC 511(TETV) or closed air circuit air-cooled IC 611(CACA).
10	WINDING AND INSULATION	(a) All insulated winding shall be of copper. (b) Class F insulation but limited to class B temperature rise. (c) Windings shall be impregnated to make them non-hygroscopic and oil resistant.
11	TROPICAL PROTECTION	(a) All motors shall have fungus protection involving special treatment of insulation and metal against fungus, insects and corrosion. (b) All fittings and hardwares shall be corrosion resistant.

**GENERAL TECHNICAL REQUIREMENTS
FOR LV MOTORS**

12	SPACE HEATERS	All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz.
13	BEARINGS	(a) Motor shall be provided with antifriction bearings, unless sleeve bearings are required by the motor application. Bearings shall be rated for minimum service life of 40,000Hrs. (b) Vertical shaft motors shall be provided with thrust and guide bearings. Thrust bearing of tilting pad type is preferred. (c) Bearings shall be provided with seals to prevent leakage of lubricant or entrance of foreign matters like dirt, water etc. into the bearing area. (d) Grease lubricated bearings shall be pre-lubricated and shall have provisions for in-service positive lubrication with drains to guard against over lubrication. LT motors 15kW and above shall be provided with external greasing arrangement. (e) Bearings shall be insulated as required to prevent shaft current and resultant bearing damage.
14	MOTOR TERMINAL BOX	(a) Motor terminal box shall be detachable type and located in accordance with Indian Standards clearing the motor base- plate/ foundation. (b) Terminal box shall be capable of being turned 360 Deg. in steps of 90 degree for LV motors unless otherwise approved. (c) The terminal box shall be split type with removable cover with access to connections and shall have the same degree of protection as motor. (d) Terminals shall be stud or lead wire type, substantially constructed and thoroughly insulated from the frame (e) The terminals shall be clearly identified by phase markings, with corresponding direction of rotation marked on the non-driving end of the motor. (f) The terminal box shall be capable of withstanding maximum system fault current for a duration of 0.25 sec. (g) Motor terminal box shall be furnished with suitable cable lugs and double compression brass glands to match with cable used. (h) Degree of protection for terminal boxes shall be IP 55 as per IS 4691. (i) unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end. (j) Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or U W & V respectively.
15	MINIMUM PHASE TO PHASE & PHASE TO EARTH CLEARANCE FOR 415V	25 mm
16	GROUNDING	(a) The frame of each motor shall be provided with two separate and distinct grounding pads complete with tapped hole, GI bolts and washer to accommodate Flat ground conductor (as defined in Datasheet A). (b) The cable terminal box shall have a separate grounding pad.
17	RATING PLATE	In addition to the minimum information required by IS, the following information shall be shown on motor rating plate : (a) Temperature rise in Deg.C under rated condition and method of measurement. (b) Degree of protection.

**GENERAL TECHNICAL REQUIREMENTS
FOR LV MOTORS**

		(c) Bearing identification no. and recommended lubricant.
18	DRAIN PLUG	Motor shall have drain plugs so located that they will drain the water, resulting from the condensation or other causes from all pockets of the motor casing.
19	LIFTING PROVISIONS	Motor weighing 20 Kg. or more shall be provided with eyebolt or other adequate provision of lifting.
20	PAINTING	Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions subject to Customer's approval during detailed engineering.
21	TESTS	All motors shall be subjected to Type tests & routine tests as per IS: 325 and approved quality plan.
22	DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT	DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT a) OGA drawing showing the position of terminal boxes, earthing connections etc. b) Arrangement drawing of terminal boxes. c) Characteristic curves: (To be given for motor above 55 kW unless otherwise specified in Data Sheet). i) Current vs. time at rated voltage and minimum starting voltage. ii) Speed vs. time at rated voltage and minimum starting voltage. iii) Torque vs. speed at rated voltage and minimum voltage. For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling. iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.



TITLE:
4 X 270 MW BHADRADRI TPS

**TECHNICAL SPECIFICATION FOR
EFFLUENT TREATMENT PLANT**

SPECIFICATION NO. PE-TS-411-164-A001

REV. NO. 00 DATE : 24/07/2017

SUB-SECTION IIC

GENERAL TECHNICAL REQUIREMENTS (CONTROL & INSTRUMENTATION)



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.:

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

PLC SPECIFICATION

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 1	OF 11

1. SCOPE

This specification covers the Design, Manufacture, Assembly, Inspection and Testing at manufacturer's works, proper packing and delivery to site, erection & commissioning, site acceptance test of the PLC Control & Monitoring System comprising PLC Control panel/Remote I/O panel (housing Processors, I/O cards, power supply packs etc.), Operator workstations(OWS), Printers, Annunciation system, UPS, cables and all other equipment and accessories required for completeness of the system as mentioned in different sections of this specification.

2. GENERAL

- 2.1. The offered PLC shall be of Industrial Grade and from Original Equipment manufacturer (OEM).
- 2.2. The PLC shall perform protection logic, interlock and sequential control functions such as binary logic operation, set/reset operation, timers, counters, logic blocks, math functions, input quality checking engineering unit conversion, Boolean functions & PID control (Analog logic function) etc.
- 2.3. The system shall be redundant in processor, power supply and communication interfaces unless otherwise specified. The control of all drives and equipment shall be effected through the keyboard/mouse / panel mounted push button / control switches as per Data sheets-A&B. The system shall include self-diagnostic features not limited to the following:-
 - Memory Faults, both PROM and EPROM
 - Processor Faults
 - Communication Faults
 - I/O interface or address faults
 - Voltage signal discrepancy on input and output
 - Power supply faults
 - Output loop check
 - Channel level diagnostics such as fault monitoring, contact bounce filtering etc.
 - Failure of main or I/O processor
- 2.4. The system shall have facility for connecting to Main Plant's Distributed control system (DCS) using hardware/software interface for two-way transfer of signals.
- 2.5. The mimic shall be displayed on the OWS screen and may also be provided on the control desk/panel (as per Datasheet).
- 2.6. In case OWS is provided, HMI functions like trends, curves, bar charts, historical storage of data, logs and reports etc. shall be provided in addition to Plant schematics. The necessary catalogue / literature elaborating the features of HMI shall be supplied along with the bid.
- 2.7. It shall be possible to use the same OWS as programming station.
- 2.8. The PLC system shall be sized to meet process/system requirements as per the approved P&IDs and Control write-up.
- 2.9. The PLC system shall be designed to ensure that no single device failure should result in failure of any other device.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 2	OF 11

- 2.10. Signal multiplication where required shall be done in PLC. Use of relays for multiplication of contacts (for control, monitoring and alarm) is not acceptable. The control/ monitoring components on the control panel/ desk shall be driven through I/O modules.
- 2.11. Bidder shall provide all software on CDs along with required software licenses .The original CDs of installed operating & application software shall be maintained by bidder. Software modification and up gradation (as & when required) shall also be covered under the vendor scope without any cost implication.
- 2.12. PLC programming console shall be provided with industry proven antivirus software with perpetual license (free version not acceptable).

3. TECHNICAL REQUIREMENTS

Details of various PLC system components shall be inclusive of but not limited to the following:

3.1. CODES AND STANDARDS

- 3.1.1. The equipment covered under this specification shall meet the requirements of latest edition of all applicable codes and standards like ANSI, NEMA, IEEE, IEC, NEC & IS.
- 3.1.2. PLC shall conform to IEC: 61131
- 3.1.3. The offered PLC shall comply with safety standards as per Data sheet-A&B.

3.2. CONTROL PANEL

- 3.2.1. PLC control panel shall be freestanding type with provision for mimic display, push-button stations, control switches, indicating lamps, metering instruments like Indicators, ammeters etc. and facia windows for critical alarms.
- 3.2.2. The salient features of construction shall be:
- Sheet material: Cold rolled sheet steel
Frame thickness: Not less than 3.0mm
Enclosure thickness: Not less than 2.5 mm for load bearing sections (mounted with instruments) and not less than 1.6 mm for others
Gland plate thickness: 3.0mm
Base channel: ISMC 100 with anti-vibration mounting & foundation bolts.
- 3.2.3. Each panel shall be identified by a name plate, which shall be of non-rusting metal or three ply lamicold, with engraved lettering.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 3	OF 11

- 3.2.4. Vendor shall indicate earthing details along with bid.
- 3.2.5. 25 x 6 mm Copper ground bus to be provided for each panel.
- 3.2.6. 240V AC single phase, thermostatically controlled space heaters shall be provided. Each free standing panel shall have a door switch operated fluorescent lamp and a 240V AC plug point.
- 3.2.7. Painting treatment shall be as per IS: 6005. Two coats of lead oxide primer shall be followed by powder coating. Paint shade shall be as specified in the "Data sheet for PLC system"-Data Sheet-A&B. Project specific paint shade, if applicable, shall be followed.
- 3.2.8. Panel internal wiring shall be as per NEC and NEMA standard.
- 3.2.9. TB points in terminal block shall be cage clamp type/screw type.
- 3.2.10. The annunciation system shall be facia window type, driven by the PLC. Audible alarm, Acknowledge, Reset and lamp test facility shall be provided as per ISA sequence – S18.1, M.

3.3. PROCESSORS

- 3.3.1. The microprocessors shall be 32 bit, and Hot redundant.
- 3.3.2. Hot redundancy: PLC shall be provided with two processors (Main processing unit and memories) one for normal operation and one as hot standby. In case of failure of working processor, there shall be an appropriate alarm and simultaneously the hot standby processor shall take over the complete operation automatically. This transfer from main processor to standby processor shall be bump less and shall not cause any disturbance whatsoever. In the event of both processors failing, the system shall revert to fail safe mode. It shall be possible to keep any of the processor as master and other as standby.
- 3.3.3. An authorized forcing facility shall be provided for changing the status of inputs and outputs, timers and flags to facilitate fault finding and other testing requirements.
- 3.3.4. The standby processor shall be updated automatically in line with the changes made in the working processor.
- 3.3.5. In the event of any replacement of the processor, synchronization of the replaced processor shall be automatic upon live insertion.
- 3.3.6. The cycle time for input scanning, execution of logics, overheads and output scan shall not exceed 120 m sec.
- 3.3.7. The processor & memory shall be loaded up to 50% at normal conditions and maximum up to 60% under worst loading conditions.
- 3.3.8. The memories shall be field expandable. Memory capacity shall be sufficient for complete system operation and have a capability for at least 20% expansion in future.
- 3.3.9. Memory shall be non-volatile, preferably EEPROM type. However, in case volatile memory is provided, battery backup shall be provided for a minimum of three months to keep the stored program intact. Battery drain indication shall be provided at least 1 week before the battery gets drained and same shall be annunciated in OWS.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 4	OF 11

3.4. INPUT / OUTPUT Modules

3.4.1. Input/output card assignments shall be modular i.e. no single card shall be assigned with more than one drive of a particular sub-system. The maximum number of channels per I/O module shall be as follows.

- Analog Input Module: 16
- Analog Output Module: 16
- Binary Input Module: 32
- Binary Output Module: 32
- Analog Input/output combined: 16
- Binary Input/output combined: 32

3.4.2. On line module replacement (hot swappable): All modules cards shall have quick disconnect terminations allowing for card replacement without disconnection of external wiring and without switching off the power supply.

3.4.3. Each I/O shall be protected against the reversal of polarity of the power voltage to I/O.

3.4.4. 10% spare capacity shall be ensured in each card channel assignment. Overall minimum 20% spare channels shall be provided.

3.4.5. Output command to MCC/Switchgear shall be through coupling relays, whose mounting location shall be as per "Data sheet A & B for PLC System". In case coupling relays are located in PLC Panel, the same shall be in PLC vendor's scope of supply.

3.4.6. Status feedback from MCC shall be in the form of potential free contact.

3.5. DATA BUS/ I/O BUS

3.5.1. The Data bus connecting PLC and HMI work stations shall be TCP/IP on Ethernet.

3.5.2. The Data bus and I/O bus communication medium shall be twisted pair shield copper conductor for indoor locations and those areas not subjected to induced signals. Repeaters/signal amplifiers shall not be used. Copper conductor cable used shall be Category-5 or better. The communication medium shall be Fibre optic cable in the event any portion of communication cable run is in outdoor or where distances are beyond 500 meters.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 5	OF 11

3.6. OPERATOR WORK STATION (OWS)

3.6.1. The OWS and Keyboard shall be desktop mounted and shall be used for controlling, monitoring and programming function.

3.6.2. Colour CRT(s) with keyboard and mouse shall be as per Data Sheet-A&B. CRT shall have graphic display facility.

3.6.3. The OWS shall be with Windows based operating system having necessary Engineering/Configuring software.

3.6.4 Specification of OWS

(a) CPU

- | | |
|---------------------------|--|
| 1. Processor | 32 Bit or better |
| 2. Main Memory | Min. 1 GB and expandable to at least 4 GB |
| 3. Hard drive | Min 40 GB |
| 4. Floppy drive | 3.5", 1.44 MB |
| 5. Removable bulk storage | DVD (R/RW) |
| 6. Graphic memory | Min. 16 MB |
| 7. Auto controller | 16 bit or better |
| 8. Operating system | Window XP or better |
| 9. Communication ports | 2 serial, 1 parallel, 8 Nos. USB, Dual 100 MB Ethernet |
| 10. Expansion slot | 3 Nos. or more |

(b) Monitor

- | | |
|-------------------------|---|
| 1. Type | LCD colour monitor (TFT based) |
| 2. Screen diagonal | 22" (approx.) flat |
| 3. Display | XGA or better |
| 4. Degree of Protection | IP-30 |
| 5. External controls | Brightness, Contrast, Horizontal/vertical amplification & shift |
| 6. Power supply | 240 VAC, 50 Hz, 1 phase |
| 7. Version | Industrial grade |

(c) Keyboard & Mouse

- | | |
|--------------------|---|
| 1. Type | Flat spill membrane or positive depression type ASCII |
| 2. Life expectancy | 50 Million cycles per key |
| 3. Version | Industrial |
| 4. Mouse | Optical |

3.7. PRINTER

Printers shall be provided as per Data Sheet-A&B.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 6	OF 11

3.8. COMMUNICATION WITH PLANT DCS/ THIRD PARTY SYSTEM

- 3.8.1. The PLC system shall be provided with hardwired/serial interface for communication with plant DCS. Hardwired outputs from PLC shall be isolated. Necessary isolators shall be part of PLC.
- 3.8.2. Serial communication to / from DCS where provided shall be engineered to ensure that signal communication time from / to DCS shall not exceed 1 seconds for control / feedback.
- 3.8.3. Serial communication to DCS shall be OPC (Data access 2.0), Ethernet based TCP/IP Protocol. Alternatively the serial communication shall be MODBUS protocol on RS 485 network.
- 3.8.4. Data transmitted from PLC to DCS shall include all information necessary for the DCS graphic displays to monitor and control the process equipment and PLC. Such data may include pertinent analog and digital status information, interlock, alarms and maintenance conditions. Data transmitted from DCS to the PLC shall include necessary signals to provide operator control interface from DCS for the process/ equipment being controlled by PLC.
- 3.8.5. Bidder to include 'Light interface units, converters, Ethernet switch, accessories etc. at both ends viz PLC and DCS for connectivity to other system. The bidder's terminal point shall be Ethernet port in case of copper medium connection to DCS or LIU in case of Fiber optic medium for connectivity with plant DCS. In case distance between PLC & DCS is greater than 1.8 Km, single mode of optical fiber cable with compatible accessories shall be used. For distance less than 1.8 Km multimode optical fiber ports shall be used.

3.9. POWER SUPPLY Scheme

- 3.9.1. PLC Panel and I/O Cabinets: PLC system shall be provided with 2x100% UPS fed from Two Nos. redundant 415V, 3-ph feeders, as per the scheme PE-SD-999-145-001, sh-08 of 08. Each UPS shall have 30 minutes back up. Input feeder failure shall be monitored in the PLC system. Necessary redundant power pack and transformers shall be provided (in the PLC panel) to derive the power supply for control desk, PLC panel and input / output cabinets etc
- 3.9.2. Remote I/O panels: Similar power supply arrangement as for PLC panels shall be provided if it is not possible to extend the power cable form UPS of PLC panels.
- 3.9.3. Each OWS and associated HMI peripherals shall be provided with a feeder from Either one of the UPS

4. DRAWING/DOCUMENT AND DATA TO BE FURNISHED AFTER AWARD OF THE CONTRACT:

4.1. For Approval:

- PLC system configuration drawing along with functional write-up.
- Input/output signal list.
- BOM of PLC
- List of PLC controlled devices
- Control panel/control desk GA drawings.
- Control desk/panel component layout drawing.
- Control panel/control desk Foundation detail and cutout drawings.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 7	OF 11

- Power distribution scheme.
- Block logic diagrams/ Ladder diagram mimic.
- Annunciation list.
- PLC control room layout drawing.
- List of soft signal exchange with Plant DCS.
- List of mandatory spares.
- UPS load calculation details.
- Quality plan
- FAT
- Data Sheet-C
- CRT display
- Power supply scheme for PLC system, HMI & peripherals, Remote I/O etc.

4.2. For Information:

- Cable schedule and cable interconnection drawing(in BHEL approved format)
 - Between Field and PLC
 - Between Field and MCC
 - Between MCC and PLC
- Electronic earthing requirements.
- Panel Heat dissipation data
- Product/component catalogues.
- Operation & Maintenance Manual on CDs.
- Softcopy of Final/As-built drawings on CDs.
- Calculation for Processor, Memory & Data bus loading

The above list is the minimum requirements. Additional documents/calculations required shall be finalized during contract stage.

5. DRAWINGS AND DOCUMENTS TO BE SUBMITTED ALONG WITH THE BID

- Proposed PLC system configuration drawing with write-up
- Product catalogues and specifications for PLC as well as HMI application.
- Proposed power supply schemes for PLC system, peripherals, and Remote I/O panels.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 8	OF 11

6. TESTING AND INSPECTION

- 6.1. The bidder shall adopt suitable quality assurance program to ensure that the equipments offered will meet the specification requirements in full.
- 6.2. BHEL's standard Quality Plan for PLC is enclosed with the specification. The bidder shall furnish his acceptance to BHEL's QP and submit the signed and stamped copy of QP along with the offer.
- 6.3. The complete PLC system, including all instrument and devices shall be subjected to standard factory tests (i.e. Type Tests and Routine Tests) as per relevant IS, NEMA, IEEE, IEC.
- 6.4. Factory Acceptance Test-FAT (Functional Tests) shall be performed prior to shipment and Owner/Purchaser shall be notified 15 days before the schedules dates of the test.
- 6.5. The certificates for following type tests, as per IEC Standard, shall be submitted: -
 - Surge protection test as per IEC-225-4
 - Dry heat test as per IEC-68-2-2
 - Damp Heat test as per IEC-68-2-3
 - Vibration Heat test as per IEC-68-2-6
 - Electrostatic discharge test as per IEC-801-2 or equivalent
 - Radio frequency Immunity test as per IEC-801-6 or equivalent
 - Electromagnetic Immunity test as per IEC-801-3 or equivalent

7. SPARES AND CONSUMABLES

7.1. Commissioning Spares and consumables

The bidder shall supply all commissioning spares and consumables 'as required' during Start-up, as part of the main equipment supply.

7.2. Mandatory Spares

The bidder shall offer along with main offer, the Mandatory Spares as specified elsewhere in the specification. The Mandatory Spares offered shall be of the same make and type as the main equipment.

7.3. Recommended Spares

The bidder shall furnish a list of Recommended Spares indicating the normal service expectancy period and frequency of replacement; quantities recommended for 3 years operation along with unit rate against each item to enable BHEL/BHEL's Customer to place a separate order later, if required.

7.4. Special Tools & Tackles

The bidder shall supply all Special Tools & Tackles 'as required' during Start-up and further maintenance of the system, as part of the main equipment supply.

7.5. Spares, Service support

Bidder shall provide availability of spares and service support for minimum 15 years after guarantee period.

	TITLE: SPECIFICATION FOR PROGRAMMABLE LOGIC CONTROLLER SYSTEM	SPECIFICATION NO. PES-145-36	
		VOLUME II-B	
		SECTION D	
		REV. NO. 03	DATE: 18.03.2014
		SHEET 9	OF 11

8. MARKING AND PACKING

8.1. Marking:

A stainless steel name-plate shall be permanently fixed on each equipment giving its Tag/serial Number and salient technical specification.

8.2. Packing:

All equipment/materials shall be suitably packed and protected for the entire period of dispatch, storage and erection against impact, abrasion, corrosion, incidental damage due to vermin, sunlight, high temperature, rain, moisture, humidity, dust, sea-water spray (where applicable) as well as rough handling and delays in transit and storage in open.

9. PERFORMANCE AND GUARANTEE

The PLC system shall be guaranteed to meet the performance requirement as specified and also for trouble-free continuous operation for 12 months from the date of commissioning or 18 months from the date of delivery at site whichever is later unless specified otherwise in Vol-II B Section - B or Section - C.

10. APPLICABLE DATA SHEET FORMS

This document shall be read with the following data sheet forms :

- Data Sheet A & B for PLC system - PE-DC-999-145-I036-1
- Data Sheet C for PLC system - PE-DC-999-145-I036-2



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

PLC DATA SHEET

	DATA SHEET FOR PLC SYSTEM		SPECIFICATION NO.: PE-TS-411-	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 04.03.2015
			SHEET 1	OF 1
Data Sheet No.:				
Data Sheet A&B				
DATA SHEET – A FOR PLC SYSTEM (TO BE FILLED BY PURCHASER)			DATA SHEET – B FOR PLC SYSTEM (TO BE FILLED BY BIDDER)	
GENERAL	PROJECT	4X 270 MW BHADRADRI TPS		
	SERVICE			
	QUANTITY	☐ UNITISED ☒ COMMON		
	LOCATION	☒ INDOOR ☐ OUTDOOR ☒ AC ☐ NON-AC*		
PLC EQUIPMENT	MAKE / MODEL NO.	BIDDER TO INDICATE		
	PROCESSOR	REDUNDANT WITH HOT STANDBY		
	DATA BUS (HMI)	☐ COPPER WIRE ☐ FIBRE OPTIC		
	DATA BUS (I/O - CPU)	☐ COPPER WIRE ☐ FIBRE OPTIC		
	DATA BUS (REMOTE I/O - CPU)	☐ COPPER WIRE ☐ FIBRE OPTIC		
	FIELD CONTACTS INTERROGATION VOLTAGE	☒ 24 V DC ☐ 48 V DC ☐ 110 V AC		
	LOCATION OF COUPLING RELAYS	☐ MCC ☒ PLC PANEL		
	DESKTOP OWS QUANTITY	☐ ONE ☐ TWO ☐ _____ ☒ DESKTOP VERSION ☐ SERVER VERSION ☐ WORK STATION VERSION REQUIREMENT OF OWS IN CCR ☐ YES ☐ NO QUANTITY _____		
	DESKTOP MONITOR TYPE	☐ 19" ☒ 24" TFT/CRT MONITOR ☐ GIU ☐ OTHERS		
	PRINTER	INKJET ☐ A3 ___ NOS ☐ A4 ___ NOS LASER B/W ☐ A3 ___ NOS ☐ A4 ___ NOS COLOR INKJET ☐ A3 ___ NOS ☐ A4 ___ NOS COLOR LASER ☒ A3_1_NOS ☐ A4 ___ NOS		
PROGRAMMING / CONFIGURATION FACILITY	A) ☐ HAND HELD ☒ LAPTOP B) ENGINEERING SOFTWARE ☐ ONE OWS ☐ ALL OWS ☐ LAPTOP			
SAFETY STANDARD	☐ SIL-3 ☐ SIL-2 ☒ NIL			
	COMPUTER FURNITURE	BOQ ☒ YES ☐ NO INDUSTRIAL GRADE ☒ YES ☐ NO		
SPARE LIST	SPARE LIST	☐ START UP & COMMISSIONING ☒ MANDATORY SPARE ☐ RECOMMENDED		
	SPARE LIST ATTACHED	☒ YES ☐ NO		
REDUNDANCY	CPU	☒ YES ☐ NO		
	POWER SUPPLY	☒ YES ☐ NO		
	COMMUNICATION	☒ YES ☐ NO		
	I/O CARD	☐ YES ☐ NO		
	OTHER ELECTRONICS	☐ YES ☐ NO		
		As per vendor practice		

	DATA SHEET FOR PLC SYSTEM		SPECIFICATION NO.: PE-TS-411-	
			VOLUME II B	
			SECTION D	
			REV. NO. 00	DATE: 04.03.2015
			SHEET 1	OF 1
Data Sheet No.:				
Data Sheet A&B				
DATA SHEET – A FOR PLC SYSTEM (TO BE FILLED BY PURCHASER)			DATA SHEET – B FOR PLC SYSTEM (TO BE FILLED BY BIDDER)	
No. of CHANNELS PER CARD	ANALOG INPUT	☒ 8 NOs ☐ 16 NOs		
	ANALOG OUTPUT	☒ 8 NOs ☐ 16 NOs		
	BINARY INPUT	☒ 16 NOs ☐ 32 NOs		
	BINARY OUTPUT	☒ 16 NOs ☐ 32 NOs		
	RTD**	4 NOs		
	THERMOCOUPLE**	8 NOs		
	ELECTRONIC CARD ISOLATION	☐ GALVANIC ☐ OPTICAL ☐ OTHER		
PANEL	QUANTITY	BIDDER TO INDICATE		
	CLASS OF PROTECTION(Refer Location of PLC)	☒ IP-42		
	REMOTE I/O PANEL	☒ YES ☐ NO AC REQUIREMENT ☒ YES ☐ NO		
	COLOUR#	RAL 7032		
	BACK-UP DESK	☐ YES ☒ NO		
	MIMIC	☐ YES ☒ NO IF YES, THEN ☐ PANEL MOUNTED GUI ☐ ACRYLIC		
	CONTROL HARDWARE	☐ PB ☐ INDICATORS ☒ FACIAS 25 Nos. ☐ OTHERS		
	CONFORMAL COATING	☐ YES ☒ NO		
COMMUNICATION WITH OTHER SYSTEM	HARDWIRED	☒ YES ☐ NO		
	PURPOSE	☐ CONTROL ☒ MONITORING		
	MEDIUM	☐ UTP ☒ FIBRE OPTIC ☐ OTHERS		
	TIME SYNCHRONIZATION SIGNAL FORMAT	☐ PULSE ☐ RS-485 ☒ IRIG-B ☐ NTP		
	SOFTLINK	☐ MODBUS ☒ OPC IF MODBUS THEN ☐ RS-485 ☐ ETHERNET		
	SERIAL LINK	COMMUNICATION PORT TYPE _____		
POWER SUPPLY INPUT FEEDER	PLC PANEL	BIDDER TO INDICATE LOAD DATA		
	REMOTE I/O PANEL	BIDDER TO INDICATE LOAD DATA		
POWER SUPPLY	SOURCE \$\$	☒ UPS(INDUSTRIAL GRADE) ☐ 24V DC CHARGER		
	BATTERY TYPE	☐ Ni-Cd ☒ LEAD ACID ☐ OTHERS		
	BACK-UP TIME	☐ 30 MINS ☒ 60 MINS ☐ OTHERS		
	BATTERY CONFIGURATION	☐ 1X100% ☒ 2X100% ☐ 2X50%		As per MAX philosophy
CUSTOMER TRAINING	TRAINING	☒ REQUIRED ☐ NOT REQUIRED		
	NO OF DAYS	3 DAYS		
	LOCATION	☐ VENDOR'S WORK ☐ PROJECT SITE ☐ OTHERS		

*IF THE LOCATION IS INDOOR, KINDLY SPECIFY IF PLC PANEL IS PLACED IN AC OR NON-AC ENVIRONMENT.

**SHALL NOT BE APPLICABLE IF TEMPERATURE TRANSMITTERS ARE ENVISAGED.

PROJECT SPECIFIC PAINT SHADES, IF APPLICABLE TO BE USED.

\$\$ CHECK & REPLACE WITH MAIN UPS SLD IF POWER SUPPLY IS NOT APPROVED BY CUSTOMER.



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

PLC Quality Plan

 PEM :: C&I		STANDARD QUALITY PLAN FOR PROGRAMMABLE LOGIC CONTROLLER										QUALITY PLAN NO.: PE-QP-999-145-1036			
												VOLUME IIB			
												SECTION D			
												REV. NO. 01 DATE: 24.08.2007			
												SHEET 1 OF 8			
Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records P	Agency \$			Remarks			
1.0	Materials /Components														
1.1	Panels & Control Desks	Physical Inspection for Dimensions, Painting, Cutouts, Lifting / Locking Arrangements, Components, Drawing Pocket, Mounting accessories, Plinth & AV Pads, Cable Gland Plates, Hardwares, Hinges, Louvers & Filters, Fans & Panel Lamps	MA Visua	I	100%	Contract specifications, Approved GA Drawings, BOQ	As per ref documents. No physical damage.	BHEL Quality Inspection Report.	3/2 2		1				
1.2	Power Supply/Packs, Battery charger, Transformer, UPS.	Physical Inspection Physical Damages Dimensions Mounting Accessories	MA Visua	I	100%	Contract specifications, BOQ.	As per reference documents, Test Report	BHEL Quality Inspection Report.	3/2 2		1				
1.3	Indicating Lamp, Annunciator, Meters, Transducers, Signal Converters, Instruments, Single Loop Controllers	Physical Verification Physical Damages Dimensions Accessories	MA Visua	I	100%	Contract specifications, BOQ.	As per ref documents No physical damage. Test/ Calibration report.	BHEL Quality Inspection Report	3/2 2		1				
1.4	PLC processors, I/O modules, Power Supply modules, Communication modules, Mounting Racks, Ethernet	Physical Inspection - Identification Labels - Physical Damages - Quantity - Spare Capacity	MA Visua	I	100%	Product Catalogue, Data sheets, Approved Configuration diagram, BOQ	As per ref documents. Test Certificates	BHEL Quality Inspection Report.	3/2 2		1				

LEGEND: * CR - Critical characteristics
 MA - Major characteristics
 MI - Minor characteristics

\$ P - Agency Performing the Test.
 W - Agency Witnessing the Test.
 V - Agency Verifying the Test.

1 - BHEL
 2 - Vendor
 3 - Sub-vendor

 PEM :: C&I	STANDARD QUALITY PLAN FOR PROGRAMMABLE LOGIC CONTROLLER										QUALITY PLAN NO.: PE-QP-999-145-1036			
											VOLUME IIB			
											SECTION D			
											REV. NO. 01 DATE: 24.08.2007			
											SHEET 3 OF 8			
Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency \$			Remarks		
										W	V			

2.0 Assembly												
2.1	Functional Test for HMI/OWS devices such as Monitors, Keyboards, Mouse, Printers etc.	Operation	MA	Functional	100%	Approved Configuration Diagram & BOQ and FAT	Correct Operation of interconnected Devices of HMI system.	BHEL Quality Inspection Report.	2 1		1	
2.2	Hardware Functional Verification.	Physical arrangement, Wiring check & labeling, Continuity Checking, IR & HV test	MA	Visual/ Electrical	100%	Approved GA Drawing, Panel Wiring Diagram, IR & HV as per relevant International standard	Test Certification	BHEL Quality Inspection Report.	2 2		1	
2.3	Powering Up	Healthiness of all the modules/equipment, associated with Powering of PLC system	MA	Visual /Electrical	100%	Approved power supply scheme	All equipment to be healthy on power ON	BHEL Quality Inspection Report.	2 1		1	
2.4	Burn in test for PLC modules	Healthiness of PLC modules on Continuous Energisation, Temperature maintenance	MA	Visual/ Electrical	100% F	AT Procedure	Test certification as per FAT	BHEL Quality Inspection Report.	2 2		1	

LEGEND: * CR - Critical characteristics
 MA - Major characteristics
 MI - Minor characteristics

\$ P W V
 - Agency Performing the Test.
 - Agency Witnessing the Test.
 - Agency Verifying the Test.

1 - BHEL
 2 - Vendor
 3 - Sub-vendor

 PEM :: C&I	STANDARD QUALITY PLAN FOR PROGRAMMABLE LOGIC CONTROLLER										QUALITY PLAN NO.: PE-QP-999-145-1036			
											VOLUME IIB			
											SECTION D			
											REV. NO. 01 DATE: 24.08.2007			
											SHEET 4 OF 8			
Sl. No.	Component / operation	Characteristics Checked	* Category	Type/Method of Check	Extent of Check	Reference documents	Acceptance Norms	Format of Records	Agency \$			Remarks		
										W	V			

3.0	Factory Acceptance Test (FAT)											
3.1	Input Output Functional Verification	I/O configuration, I/O operation	MA	Visual/ Electrical	100%	FAT Procedure	AS per FAT	BHEL Quality Inspection Report.	2 1		1	
3.2	Processor Verification	Processor configuration, Powering up, standby operation (as applicable) and Loading	MA	Visual	100%	FAT Procedure	AS per FAT	BHEL Quality Inspection Report.	2 1		1	
3.3	Power Supply Module Verification	Redundancy Operation	MA	Electrical	100%	FAT Procedure	AS per FAT	BHEL Quality Inspection Report.	2 1		1	
3.4	Communication System Verification	Redundancy operation of Communication System, Measurement of Response Time, Communication with third party system	MA	Electrical	100%	FAT Procedure	AS per FAT	BHEL Quality Inspection Report.	2 1		1	
3.5	Diagnostic Verification	Self Diagnostic features of PLC system	MA	Visual	100%	FAT Procedure	AS per FAT	BHEL Quality Inspection Report.	2 1		1	
3.6	Control Panel/Desk Verification	Operation of PLC driven annunciation system, Mosaic, Push buttons & selector switches, Indicating lamps	MA	Visual	100%	FAT Procedure	AS per FAT	BHEL Quality Inspection Report.	2 1		1	
3.7	Software Verification	(i) Control Logics (ii) Engineering Features (iii) HMI Features	MA	Visual	100%	FAT Procedure	AS per FAT	BHEL Quality Inspection Report.	2 1		1	

LEGEND: * CR - Critical characteristics
 MA - Major characteristics
 MI - Minor characteristics

\$ P - Agency Performing the Test.
 W - Agency Witnessing the Test.
 V - Agency Verifying the Test.

1 - BHEL
 2 - Vendor
 3 - Sub-vendor

**STANDARD QUALITY PLAN
FOR
PROGRAMMABLE LOGIC CONTROLLER**

QUALITY PLAN NO.: PE-QP-999-145-I036		
SPECIFICATION NO. PE-TS-411-164-A001		
VOLUME 1		
SECTION D		
REV. NO. 01	DATE: 24.08.2007	
SHEET 5	OF	8

FACTORY ACCEPTANCE TEST (FAT) PROCEDURE

This document covers procedure to conduct/witness PLC system functional tests in order to demonstrate conformity to purchase specifications and related engineering documents. The test shall be conducted at the system suppliers works. The system supplier shall conduct all functional tests before commencing FAT and test results shall be made available during FAT. Vendor must furnish following relevant drawings, duly approved by BHEL Engineering, for reference during FAT.

- a) Technical Specification of PLC.
- b) PLC System Configuration
- c) General Assembly Drawings.
- d) Panel Wiring Diagrams.
- e) Bill of Quantity for PLC System.
- f) Logic Diagram.
- g) HMI Schematics.
- h) Input / Output List.

Further the vendor shall furnish applicable product specification, datasheets, catalogues, test-certificates, and internal inspection records to enable FAT. Vendor shall also submit, [to the inspecting agency](#), his standard test procedure, for clauses given below; where vendor's standard practice has been referred.

APPLICABLE TEST PROCEDURE:

1. Input/Output Functional Verification.

Check for correctness of addressing of racks, slots and I/O modules as per applicable PLC configuration diagram. Appropriate signal generators shall be used to simulate Inputs and outputs to check operation and SCAN time. [Check online replacement of cards, processors, power supply etc.](#)

2. Processor Verification

PLC Configuration drawing to be referred for ascertaining

- i) Redundancy

STANDARD QUALITY PLAN FOR PROGRAMMABLE LOGIC CONTROLLER

QUALITY PLAN NO.: PE-QP-999-145-I036 ___		
VOLUME IIB		
SECTION D		
REV. NO. 00	DATE: 23.03.2005	
SHEET 6	OF	8

ii) Type (Hot or Cold)

Both the processors are to be checked for healthiness in case of redundant configuration as per vendor's standard practice. In case of hot redundancy, switchover of control from primary processor to standby processor shall be demonstrated for uninterrupted control and data processing as per vendor's standard practice. Switchover shall be witnessed, by manual power off or resetting the Primary CPU or simulating failure of primary processor. Checking should be by witnessing the lighting up of Processor's LEDs as per manufacturer's product standard.

Vendor shall demonstrate, as per Vendor's standard practice, adequate Loading (Spare Capacity) of Processors, as mentioned in contract specs. This shall be done, by simulating worst load operation of fully integrated PLC system.

3. Power Supply Module Verification

Check if PSM is in redundant mode as per specification. Check the healthiness of power supply from both the modules' lamp indication/measurement. Simulate failure of one PSM and verify that standby PSM has taken over without any interruption.

4. Communication System Verification

Communication system has to be in line with approved PLC Configuration Diagram. Verify that both the communication buses are intact and connected. Communication between PLC processors, I/O rack, OWS etc. is to be checked through simulation of input data. Simulate the bus failure by disconnection of working bus. Check that the communication continues without interruption or loss of data.

Following response times are to be demonstrated as per vendor's standard practice for conformance to contract specifications:

1. Screen update time
2. I/O scan time
3. SOE resolution time
4. Data transfer time with third party system using Communication Protocol as per Contract specification and as per quantum of data as per approved signal exchange list.

5. Diagnostic Verification

Product Catalogue/Literature shall be referred for checking of all diagnostic features. Hardware failure to be simulated by removing an I/O

STANDARD QUALITY PLAN FOR PROGRAMMABLE LOGIC CONTROLLER

QUALITY PLAN NO.: PE-QP-999-145-I036 _____			
71	VOLUME IIB		
1	SECTION D		
REV. NO. 00		DATE: 23.03.2005	
SHEET 7		OF	8

6. Control Panel /Desk Verification

- i) PLC driven annunciation system should be checked by alarm signal simulation.
- ii) Push Button and selector switch operation should be checked by verification of corresponding change of status of Data Base point.
- iii) Indicating lamp / MIMIC should be checked by corresponding Data Base point simulation.

7. Software Verification

- i). Control Logics:– Software switches, lamps and Analog sources shall be used for simulation of field conditions .Control logics shall be checked for its correct functionality as per approved logic schemes
- ii). Engineering features:-
 - a) Online changing of parameters, set points.
 - b) Online modification in Control Logic Diagrams.
 - c) Online configuration of Graphics, Trends, Logs, HSR.
- iii). HMI features:-
Check for configuration & operation of Graphics, Trends, Logs, HSR and Alarms, in the form of Displays and Printouts, by simulation of Inputs as per approved documents.

8. Burn in Elevated Temperature test

Electronic equipments shall be subjected to Burn in elevated temperature test as per the procedure detailed below:

- a) (i) PLC modules are kept at 50 Deg c under continuous energized condition for 48 hours.

**STANDARD QUALITY PLAN
FOR
PROGRAMMABLE LOGIC CONTROLLER**

QUALITY PLAN NO.: PE-QP-999-145-I036		
VOLUME IIB		
SECTION D		
REV. NO. 00 23.03.2005	DATE:	
SHEET 8	OF	8

ii) 48 hours test period shall be divided into 4 equal time segments of 12 hours duration each. For every 12 hours duration segment, after lapse of first 11 hours 110% of nominal voltage shall be applied to the panel under test for a period of 30 minutes followed by application of 90% of nominal voltage for the next 30 minutes.

b) Assembled Panels with complete wiring shall be kept under continuous energized condition for 120 hours at ambient temperature. Temperature rise in panels should be below 10 Deg C above ambient.



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

ACTUATOR SPECIFICATION

VOLUME: V-A

SECTION-III

**TECHNICAL SPECIFICATION
FOR
ELECTRIC MOTOR ACTUATORS**

1.00.00 SCOPE

- 1.01.00 This Section covers the general requirements of Electric Motor Actuators for valves/dampers.
- 1.02.00 All electric motor actuators shall be furnished in accordance with this general specification and the accompanying driven equipment specification. All the electrical actuators shall be INTEGRAL type only.

2.00.00 STANDARDS

- 2.01.00 All electrical equipment shall conform to the latest applicable IS, ANSI and NEMA Standards, except when stated otherwise herein or in driven equipment specification.
- 2.02.00 Major standards, which shall be followed, are listed below. Other applicable Indian Standards for any component part even if not covered in the listed standards shall also be followed
- i) IS -9334
- ii) IS-325

3.00.00 SERVICE CONDITIONS

- 3.01.00 The actuator shall be suitable for operation in hot, humid and tropical atmosphere, highly polluted at places with coal dust and/or fly ash.
- 3.02.00 Unless otherwise noted, electrical equipment/system design shall be based on the service conditions and auxiliary power supply given in the general specification.
- 3.03.00 For actuator motor installed outdoor and exposed to direct sun rays, the effect of solar heat shall be considered in the determination of the design ambient temperature.

4.00.00 RATING

- 4.01.00 For isolating service, the actuator shall be rated for three successive open-close operation of the valve/damper or 15 minutes, whichever is longer.
- 4.02.00 For regulating service, the actuator shall be suitably time-rated for the duty cycle involved with necessary number of starts per hour, but in no case less than 150 starts per hour.

5.00.00 PERFORMANCE

The actuator shall meet the following performance requirements:

- 5.01.00 Open and close the valve completely and make leak-tight valve closure without jamming.
- 5.02.00 Attain full speed operation before valve load is encountered and imparts an unseating blow to start the valve in motion (hammer blow effect).
- 5.03.00 Operate the valve stem at standard stem speed and shall function against design differential pressure across the valve seat.
- 5.04.00 The motor reduction gearing shall be sufficient to lock the shaft when the motor is de-energised and prevent drift from torque switch spring pressure.
- 5.05.00 The entire mechanism shall withstand shock resulting from closing with improper setting of limit switches or from lodging of foreign matter under the valve seat.

6.00.00 SPECIFIC REQUIREMENT

6.01.00 Construction

- 6.01.01 The actuator shall essentially comprise the drive motor, torque/ limit switches, gear train, clutch, hand wheel, position indicator/ transmitter, in-built thermostat for over load protection, space heater and internal wiring.
- 6.01.02 The actuator enclosure shall be totally enclosed, dust tight, weather-proof suitable for outdoor use without necessity of any canopy. Degree of protection of enclosure for motor actuator shall be IP-65.
- 6.01.03 All electrical equipment, accessories and wiring shall be provided with tropical finish to prevent fungus growth.
- 6.01.04 The actuator shall be designed for mounting in any position without any lubricant leakage or operating difficulty.

6.02.00 Motor

- 6.02.01 The drive motor shall be three phase, squirrel cage, induction machine with minimum class B insulation and IPW-55 enclosure, designed for high torque and reversing service. Canopy shall be provided for outdoor service.
- 6.02.02 The motor shall be designed for full voltage direct on-line start, with starting current limited to 6 times full-load current.
- 6.02.03 The motor shall be capable of starting at 85 percent of rated voltage and running at 80 percent of rated voltage at rated torque and 85 percent rated voltage at 33 percent excess rated torque for a period of 5 minutes each.
- 6.02.04 Motor leads shall be terminated in the limit switch compartment.
- 6.02.05 Motor actuators for valves/dampers shall be with integral starter with 3phase/3wire, 415V AC and operable from remote.

- 6.02.06 Earthing terminals shall be provided on either side of the motor.
- 6.03.00 **Limit Switches**
- Each actuator shall be provided with following limit switches: -
- 6.03.01 2 torque limit switches, one for each direction of travel, self-locking, adjustable torque type.
- 6.03.02 4 end-of-travel limit switches, two for each direction of travel.
- 6.03.03 2 position limit switches, one for each direction of travel, each adjustable at any position from fully open to fully closed positions of the valve/damper.
- 6.03.04 Each limit switch shall have 2 NO + 2 NC potential free contacts. Contact rating shall be 5A at 240V A.C. or 0.5A at 220V D.C.
- 6.04.00 **Hand Wheel**
- Each actuator shall be provided with a hand wheel for emergency manual operation. The hand wheel shall de-clutch automatically when the motor is energized.
- 6.05.00 **Position Indicator/Transmitter**
- The actuator shall have:
- 6.05.01 One (1) built-in local position indicator for 0-100% travel.
- 6.05.02 One (1) position transmitter, 4-20 mA current signal as position feedback, for remote indicator.
- 6.06.00 **Space Heater**
- A space heater shall be included in the limit switch compartment suitable for 240V, 1 phase, 50 Hz supply.
- 6.07.00 **Wiring**
- All electrical devices shall be wired up to and terminated in a terminal box. All wiring shall be done with 1100 V grade fire resistance PVC insulated stranded copper conductor of not less than 2.5 Sq.mm cross section. All wiring shall be identified at both ends with ferrules. All the electrical actuators shall have uniform wiring.
- 6.08.00 **Terminal Box**
- The terminal box shall be weather proof, with removable front cover and cable glands for cable connection. The terminal shall be suitable for connection of 2.5 Sq.mm copper conductor.
- 7.00.00 **ACCESSORIES**

As required for the driven equipment, the actuator shall be furnished with starting equipment mounted on the actuator. This shall include:

- 7.01.00 One (1) triple pole MCCB
- 7.02.00 One (1) reversing starter with mechanically interlocked contactors, 3 thermal overload relays, 2 NO + 2 NC auxiliary contacts for each contactor.
- 7.03.00 One (1) remote-local selector switch.
- 7.04.00 CLOSE-STOP-OPEN oil tight push buttons with indication lights.
- 7.05.00 415/240 V control transformer with primary & secondary fuses.

8.00.00 TEST

The actuator and all components thereof shall be subject to tests as per relevant Standards. In addition, if any special test is called for in equipment specification, the same shall be performed.

9.00.00 DRAWINGS, DATA & MANUALS

- 9.01.00 Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.02.00 To be submitted with Bid

Data sheet for each type of actuator shall be furnished along with internal wiring diagram, suggested control schematic and torque limit switch contact development and manufacturer's catalogues. Drawings, Data & Manuals shall be submitted in triplicate with the bid and in quantities and procedures as specified in General Conditions of Contract and/or elsewhere in the specification for approval and subsequent distribution after the issue of 'Letter of Intent'.

9.03.00 To be submitted for Owner / Purchaser's Approval and Distribution

All relevant drawings and data pertaining to the equipment like GTP, GA drawing, foundation plan, BOM, control & schematics, QAP, etc. shall be submitted by the Bidder for approval of Owner/Owner's consultant. Also refer clause no. 1.19.02(u) of Section-I of Volume – V-A : Technical Specifications for Electrical Equipment & Accessories.

ANNEXURE-A

DESIGN DATA

1.0 AUXILIARY POWER SUPPLY

S	upply	Description	Consumer
	L.V. Supply (i)	415V, 3Ø, 3W, 50 Hz Effectively earthed	u Motors above 0.2kW pto less than 175kW.
		Fault level 50 kA symm. for 1 sec.	
	(ii)	240V AC/415V AC	Motors upto 0.2kW.
		240V, 1Ø, 2W, 50 Hz effectively earthed	o Lighting, Space heat- ing , A.C supply for Contr- l & protective devices.
	D.C. Supply	220V, 2W, unearthed	& D.C. alarm, control protective devices
		Fault level 25* kA. for 1 sec.	

* Indicative only, the actual value will be decided by the Bidder, after substantiating the same by calculation.

2.0 RANGE OF VARIATION

A.C. Supply :

V	oltage	:	± 10%
	Frequency	:	+3% to -5%.
	Combined Volt + frequency	:	10% (absolute sum)

During starting of large motor, the voltage may drop to 80% of the rated voltage for a period of 60 seconds. All electrical equipment while running shall successfully ride over such period without affecting system performance.

D.C. Supply :

Voltage	:	187 to 242
---------	---	------------



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

Actuator Data Sheet

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR		SPECIFICATION NO.: PE-SS-411-145-I007	
			VOLUME	
			SECTION	
			REV. NO. 00	DATE: 14.11.14
			SHEET 1	OF 3
Data Sheet A & B				
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	

350

GENERAL*	* PROJECT	4X270 MW BHADRADRI TPS		
	OFFER REFERENCE			
	* TAG NO. SERVICE			
	* DUTY	☒ ON / OFF REQUIRED ☒ INCHING (AS REQUIRED)		
	* LINE SIZE (inlet/outlet): MATERIAL			
	* VALVE TYPE	☐ GLOBE ☐ GATE ☐ REG. GLOBE ☐ BUTTERFLY		
	* OPENING / CLOSING TIME			
	* WORKING PRESSURE			
	AMBIENT CONDITION	SHALL BE SUITABLE FOR CONTINUOUS OPERATION UNDER AN AMBIENT TEMP. OF 0-55 DEG C AND RELATIVE HUMIDITY OF 0-95%		
	VALVE SEAT TEST PRESS	BIDDER TO SPECIFY		
	REQUIRED VALVE TORQUE	BIDDER TO SPECIFY		
	ACTUATOR RATED TORQUE	BIDDER TO SPECIFY		
CONSTRUCTION AND SIZING	MECHANICAL POSITION INDICATOR	TO BE PROVIDED FOR 0-100% TRAVEL		
	BEARINGS	DOUBLE SHIELDED, GREASE LUBRICATED ANTI-FRICTION.		
	GEAR TRAIN FOR LIMIT SWITCH/TORQUE SWITCH OPERATION	METAL (NOT FIBRE GEARS). SELF-LOCKING TO PREVENT DRIFT UNDER TORQUE SWITCH SPRING PRESSURE WHEN MOTOR IS DE-ENERGIZED.		
	SIZING	OPEN/CLOSE AT RATED SPEED AGAINST DESIGNED DIFFERENTIAL PRESSURE AT 85% OF RATED VOLTAGE. FOR ISOLATING SERVICE THREE SUCCESSIVE OPEN-CLOSE OPERATIONS OR 15 MINS. WHICHEVER IS HIGHER. FOR INCHING(REGULATING) SERVICE 150 STARTS/HR MINIMUM		
HANDWHEEL	* REQUIRED	☒ YES ☐ NO		
	* ORIENTATION	☐ TOP MOUNTED ☐ SIDE MOUNTED		
	TO DISENGAGE AUTOMATICALLY DURING MOTOR OPERATION.			
ELECTRIC ACTUATOR	ACTUATOR MAKE/MODEL	BIDDER TO SPECIFY		
	MOTOR MAKE / MODEL / TYPE / RATING (KW)	BIDDER TO SPECIFY		
	MOTOR TYPE	SQUIRREL CAGE INDUCTION MOTOR, STARTING CURRENT LIMITED TO SIX TIMES THE RATED CURRENT.		
	ACTUATOR APPLICABLE WIRING DIAGRAM	☒ ENCLOSED (BIDDER TO CONFIRM) A: ☒ DRG. NO. 3-V-MISC-24227 R00 B: ☐ DRG. NO. 3-V-MISC-24550 R00 C: ☐ DRG. NO. 3-V-MISC-24283 R00 D: ☐ DRG. NO. 4-V-MISC-90271 R11		
	COLOUR SHADE	☒ BLUE (RAL 5012) ENAMEL ☐		
	SHAFT RPM	BIDDER TO SPECIFY		
	OLR SET VALUE	BIDDER TO SPECIFY		
	STARTING / FULL LOAD CURRENT	BIDDER TO SPECIFY		
	NO. OF REV FOR FULL TRAVEL	BIDDER TO SPECIFY		
	@ PWR SUPP TO MTR / STARTER	415V, 3PH, AC		
	@ CONTROL VOLTAGE REQUIREMENT	TO BE DERIVED INTERNALLY		
	@ ENCLOSURE CLASS OF MOTOR	☐ IP 65 ☒ IP 67 ☐ FLAME PROOF ☐ IP 55, TOTALLY ENCL, SELF VENTILATED.		
	@ INSULATION CLASS	☐ CLASS-B ☒ CLASS-F (TEMP. RISE LIMITED TO CLASS B)		
	@ WINDING TEMP PROTECTION	☒ THERMOSTAT (3 Nos., 1 IN EACH PHASE) ☐ -----		

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR	SPECIFICATION NO.: PE-SS-411-145-I007	
		VOLUME	
		SECTION	
		REV. NO. 00	DATE: 14.11.14
		SHEET 2	OF 3
Data Sheet A & B			
DATA SHEET-A (TO BE FILLED BY PURCHASER)		DATA SHEET-B (TO BE FILLED-UP BY BIDDER)	

350

	SINGLE PHASE / WRONG PHASE SEQUENCE PROTECTION	REQUIRED	
INTEGRAL STARTER	INTEGRAL STARTER	☒ REQUIRED ☐ NOT REQUIRED	
	TYPE OF SWITCHING DEVICE	☒ CONTACTORS ☐ THYRISTORS	
	TYPE	☒ CONVENTIONAL ☐ SMART (NON-INTRUSIVE)	
	STEP DOWN CONT. TRANSFORMER	☒ REQUIRED	
	OPEN / CLOSE PB	☒ REQUIRED ☐ NOT REQUIRED	
	STOP PB	☒ REQUIRED ☐ NOT REQUIRED	
	INDICATING LAMPS	☒ REQUIRED ☐ NOT REQUIRED	
	LOCAL REMOTE S/S	☒ REQUIRED ☐ NOT REQUIRED	
	STATUS CONTACTS FOR MONITORING	☒ REQUIRED ☐ NOT REQUIRED	
		INTEGRAL STARTER DISTURBED SIGNAL	REQUIRED (O/L RELAY OPERATED, CONT./POWER SUPPLY FAILED, S/S IN LOCAL, TORQUE SWITCH OPTD. MID WAY)
INTERPOSING RELAY (Applicable for integral Starter)	INTERPOSING RELAYS	REQUIRED	
	INTERPOSING RELAY (QUANTITY)	☐ 2 NOs. ☒ 3 NOs.	
	DRIVING VOLTAGE	☒ 20.5 – 24V DC ☐ _____ V DC	
	DRIVING CURRENT	☒ 125mA MAX ☐ _____ mA MAX	
	LOAD RESISTANCE	☒ > 192 ohms - <25 k ohms ☐ > _____ ohms - < _____ ohms	
TORQUE SWITCH	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN / CLOSE	☒ 1 No. ☐ 2Nos. / ☒ 1 No. ☐ 2Nos	
	CONTACT TYPE	2 NO + 2 NC	
	RATING	5A 240V AC AND 0.5A 220V DC	
	CALIBRATED KNOBS(OPEN&CLOSE TS)	REQUIRED FOR SETTING DESIRED TORQUE	
	ACCURACY	+3% OF SET VALUE	
LIMIT SWITCH	MFR & MODEL NO.	BIDDER TO SPECIFY	
	OPEN : INT : CLOSE	☒ 1 No ☐ 2 Nos. 2 Nos. (ADJ.) ☒ 1 No. ☐ 2Nos.	
	CONTACT TYPE	2 NO + 2 NC	
	RATING (AC / DC)	5A 240V AC AND 0.5A 220V DC	

	SPECIFICATION FOR MOTORISED VALVE ACTUATOR	SPECIFICATION NO.: PE-SS-411-145-I007	
		VOLUME	
		SECTION	
		REV. NO. 00	DATE: 14.11.14
		SHEET 3	OF 3
Data Sheet A & B			
DATA SHEET-A (TO BE FILLED BY PURCHASER)			DATA SHEET-B (TO BE FILLED-UP BY BIDDER)

350


POSITION TRANSMITTER	POSITION TRANSMITTER (For inching duty)	☒ REQUIRED ☐ NOT REQUIRED		
	MFR & MODEL NO.	BIDDER TO SPECIFY		
	TYPE	☒ ELECTRONIC (2 WIRE) R/I CONVERTER ☐ ELECTRONIC (2 WIRE) CONTACTLESS		
	SUPPLY	☒ 24V DC ☐		
	OUTPUT	☒ 4-20mA		
	ACCURACY	$\pm 1\%$ FS		
SPACE HEATER	@SPACE HEATER	REQUIRED		
	@ POWER SUPPLY			
	@ RATING	415v, 3PH, AC FOR RATING > 0.2KW; SINGLE PHASE FOR RATING < 0.2KW		
TERMINAL BOX	MOTOR TERMINAL BOX	REQUIRED		
	ACTUATOR TERMINAL BOX	REQUIRED		
	ENCL CLASS MTR T.B. / ACTUATOR T.B.	@ ☒ IP 67 @ ☐	☒ IP67 ☐	
	@ EARTHING TERMINAL	REQUIRED		
	PLUG & SOCKET(9 PIN) (FOR COMMD, LS/TS FEED BACK, PoT)	☐ REQUIRED ☒ NOT REQUIRED ☐ 2 NOS. ☐		
CABLE GLANDS	@ POWER CABLE GLAND	SIZE:--DURING DETAIL ENGINEERING		
	@ SPACE HEATER CABLE GLAND	SIZE: 2C x 2.5 sq. mm		
	OTHER CONTROL CABLE GLANDS-1	INSTRUMENT CABLE SIZE FOR ON/OFF DUTY VALVES SHALL BE 8PX0.5 SQMM - ONE CABLE GLAND OF OD SIZE 20 MM. INSTRUMENT CABLE SIZE FOR INCHING DUTY TYPE VALVES SHALL HAVE TWO NO. CABLES (ONE NO. 8PX0.5 SQMM AND 2ND 2PX0.5 SQMM) - TWO NO. GLANDS OF OD SIZES 20 MM & 15 MM.		
	OTHER CONTROL CABLE GLANDS-2			
WEIGHT	TOTAL WEIGHT (ACTUATOR + ACCESSORIES)	BIDDER TO SPECIFY		_____ Kg.

NOTES:

- SCOPE:** DESIGN, MANUFACTURE, INSPECTION, TESTING AND DELIVERY TO SITE OF ELECTRIC ACTUATOR FOR INCHING OR OPEN / CLOSE DUTY.
- CODES & STANDARDS:** DESIGN AND MATERIALS USED SHALL COMPLY WITH THE RELEVANT LATEST NATIONAL AND INTERNATIONAL STANDARD. AS A MINIMUM, THE FOLLOWING STANDARDS SHALL BE COMPLIED WITH:
IS-9334, IS-2147, IS-2148, IS-325, IS-2959, IS-4691 AND IS-4722
- TEMPERATURE RISE SHALL BE RESTRICTED TO 70 DEG. C FOR AMBIENT TEMPERATURE OF 50 DEG C.
- CABLE GLANDS OF DOUBLE COMPRESSION TYPE, BRASS MATERIAL SHALL BE PROVIDED.
- THE TORQUE SWITCHES SHALL BE PROVIDED WITH MECHANICAL LATCHING DEVICE TO PREVENT OPERATION WHEN UNSEATING FROM THE END POSITIONS. THE LATCHING DEVICE SHALL UNLATCH AS SOON AS THE VALVE LEAVES THE END POSITION. IF SUCH PROVISION IS NOT POSSIBLE, THE TORQUE SWITCHES SHALL BE BYPASSED BY END-POSITION LIMIT SWITCHES WHICH OPENS ON VALVE LEAVING END POSITION. THESE LIMIT SWITCHES ARE ADDITIONAL TO THE NUMBER OF LIMIT SWITCHES SPECIFIED ELSEWHERE.
- THE MOTOR SHALL OPERATE SATISFACTORILY UNDER THE +/- 10% SUPPLY VOLTAGE VARIATION AT RATED FREQUENCY, -5% TO +3% VARIATION IN FREQUENCY AT RATED SUPPLY VOLTAGE, SIMULTANEOUS VARIATION IN VOLTAGE & FREQUENCY THE SUM OF ABSOLUTE PERCENTAGE NOT EXCEEDING 10%.
- THE MOTOR SHALL BE SUITABLE FOR DIRECT ON LINE STARTING.

NOTES* = TO BE FILLED BY MPL (LEAD AGENCY). @ = TO BE FILLED BY ES

DRAWING NO. 7227-CSIW-A-E

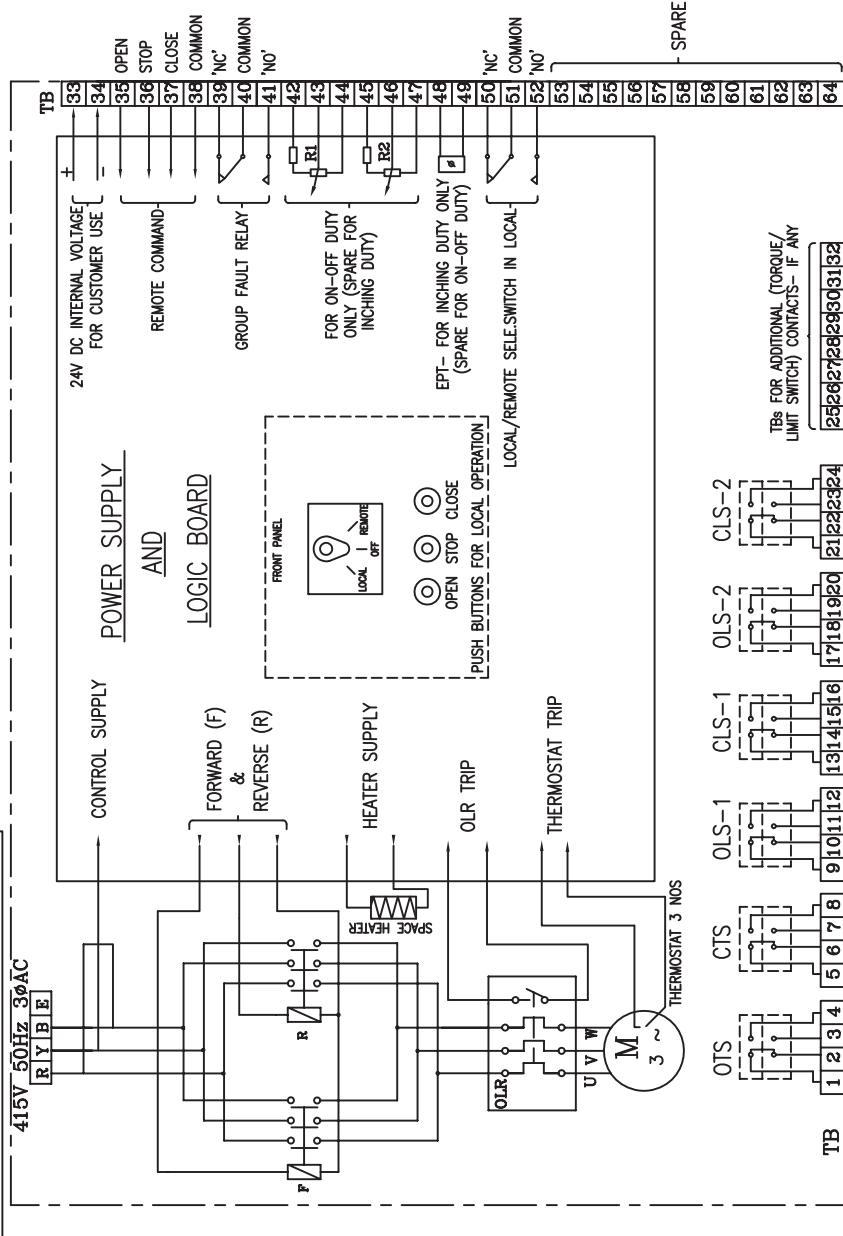

SWITCH TERMINALS FOR CUSTOMER USE

NOTE:-

1. ALL TORQUE AND LIMIT SWITCHES (OTS, CTS, OLS1&2, CLS1&2) ARE WITH 2NO+2NC CONTACTS '1NO+1NC' IS TERMINATED IN TBS 1-24, REMAINING CONTACTS ARE FOR INTERNAL USE. ANY SPARE CONTACTS WHICH ARE NOT USED INTERNALLY ARE TO BE TERMINATED IN TBS 25-32
2. CTS - TORQUE SWITCHES FOR CW ROTATION (CLOSE)
3. OTS - TORQUE SWITCHES FOR CCW ROTATION (OPEN)
4. OLS-1, OLS-2 - LIMIT SWITCHES FOR POSITION OPEN
5. CLS-1, CLS-2 - LIMIT SWITCHES FOR POSITION CLOSE
6. EPT - ELECTRONIC POSITION TRANSMITTER (Contactless, FOR INCHING DUTY)
7. R1-R2-POTENTIOMETER 2 x 100 OHMS (FOR ON-OFF DUTY)
8. FOR COMMANDS & EPT EITHER INTERNALLY GENERATED 24 VDC OR EXTERNAL SUPPLY OF 24VDC CAN BE USED
9. M - MOTOR 3Φ 415V 50 Hz AC SUPPLY

CONTACT DEVELOPMENT DIAGRAM

OTS	1-2	OPEN AT OVER TORQUE DURING OPENING TRAVEL			
	3-4	CLOSE AT OVER TORQUE DURING OPENING TRAVEL			
CTS	5-6	OPEN AT OVER TORQUE DURING CLOSING TRAVEL			
	7-8	CLOSE AT OVER TORQUE DURING CLOSING TRAVEL			
OLS-1	9-10				
	11-12				
CLS-1	13-14				
	15-16				
OLS-2	17-18				
	19-20				
CLS-2	21-22				
	23-24				
SWITCH	TERMINAL NO.	FULL OPEN	INTERMEDIATE	b	FULL CLOSE

————	INDICATES CONTACT CLOSED
-----	INDICATES CONTACT OPEN

CONTACT RATING: 5A AT 250V AC & 0.5A AT 220V DC

SETTING PROCEDURE OF POSITION LIMIT AND TORQUE SWITCH					
VALVES	OPEN			CLOSE	
	MAIN	BACK UP	MAIN	BACK UP	
GATE VALVE OF 100 mm AND ABOVE IN 1500 CL AND ABOVE RATINGS	OLS	OTS *	CLS	CTS	
ALL OTHER GATE & GLOBE VALVES	OLS	OTS *	CTS	#	
# - CLS NOT TO BE CONNECTED IN TRIP CIRCUIT					
* - BYPASS OTS FOR INITIAL 5% OF TRAVEL (FOR GATE VALVES ONLY)					

TYPE OF PRODUCT ELECTRICAL VALVE ACTUATORS (AC) WITH INTEGRAL STARTERS
OR NAME OF CUSTOMER/PROJECT (DRAWN FOR INTERMEDIATE POSITION OF VALVES)

		BHARAT HEAVY ELECTRICALS LTD., UNIT: HIGH PRESSURE BOILER PLANT. TIRUCHIRAPPALLI-620014.					DRN		NAME N.P.ESWAR	SIGN N.P	DATE 07.10.04	NO.OF VAR.	
365-121		DEPT		VL	SCALE		WEIGHT (KG)		CHD	D.DINAKARAN	D.D	07.10.04	
		CODE						APPD		K.ARUNACHALAM	K.A	07.10.04	
REFERENCE INFORMATION													NO.OF ITEMS
TITLE WIRING DIAGRAM (TERMINAL PLAN) FOR ACTUATOR WITH INTEGRAL STARTER							CARD CODE U 01		DRAWING NO. 3-V-MISC-24227				REV 0



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015


SHEET

OF

Drive Control Philosophy

PLC INTERFACE FOR BIDIRECTIONAL DRIVE(WITH INTEGRAL STARTER)

THIS IS A PART OF TECHNICAL SPECIFICATION NO. PE-TS-411-164-001

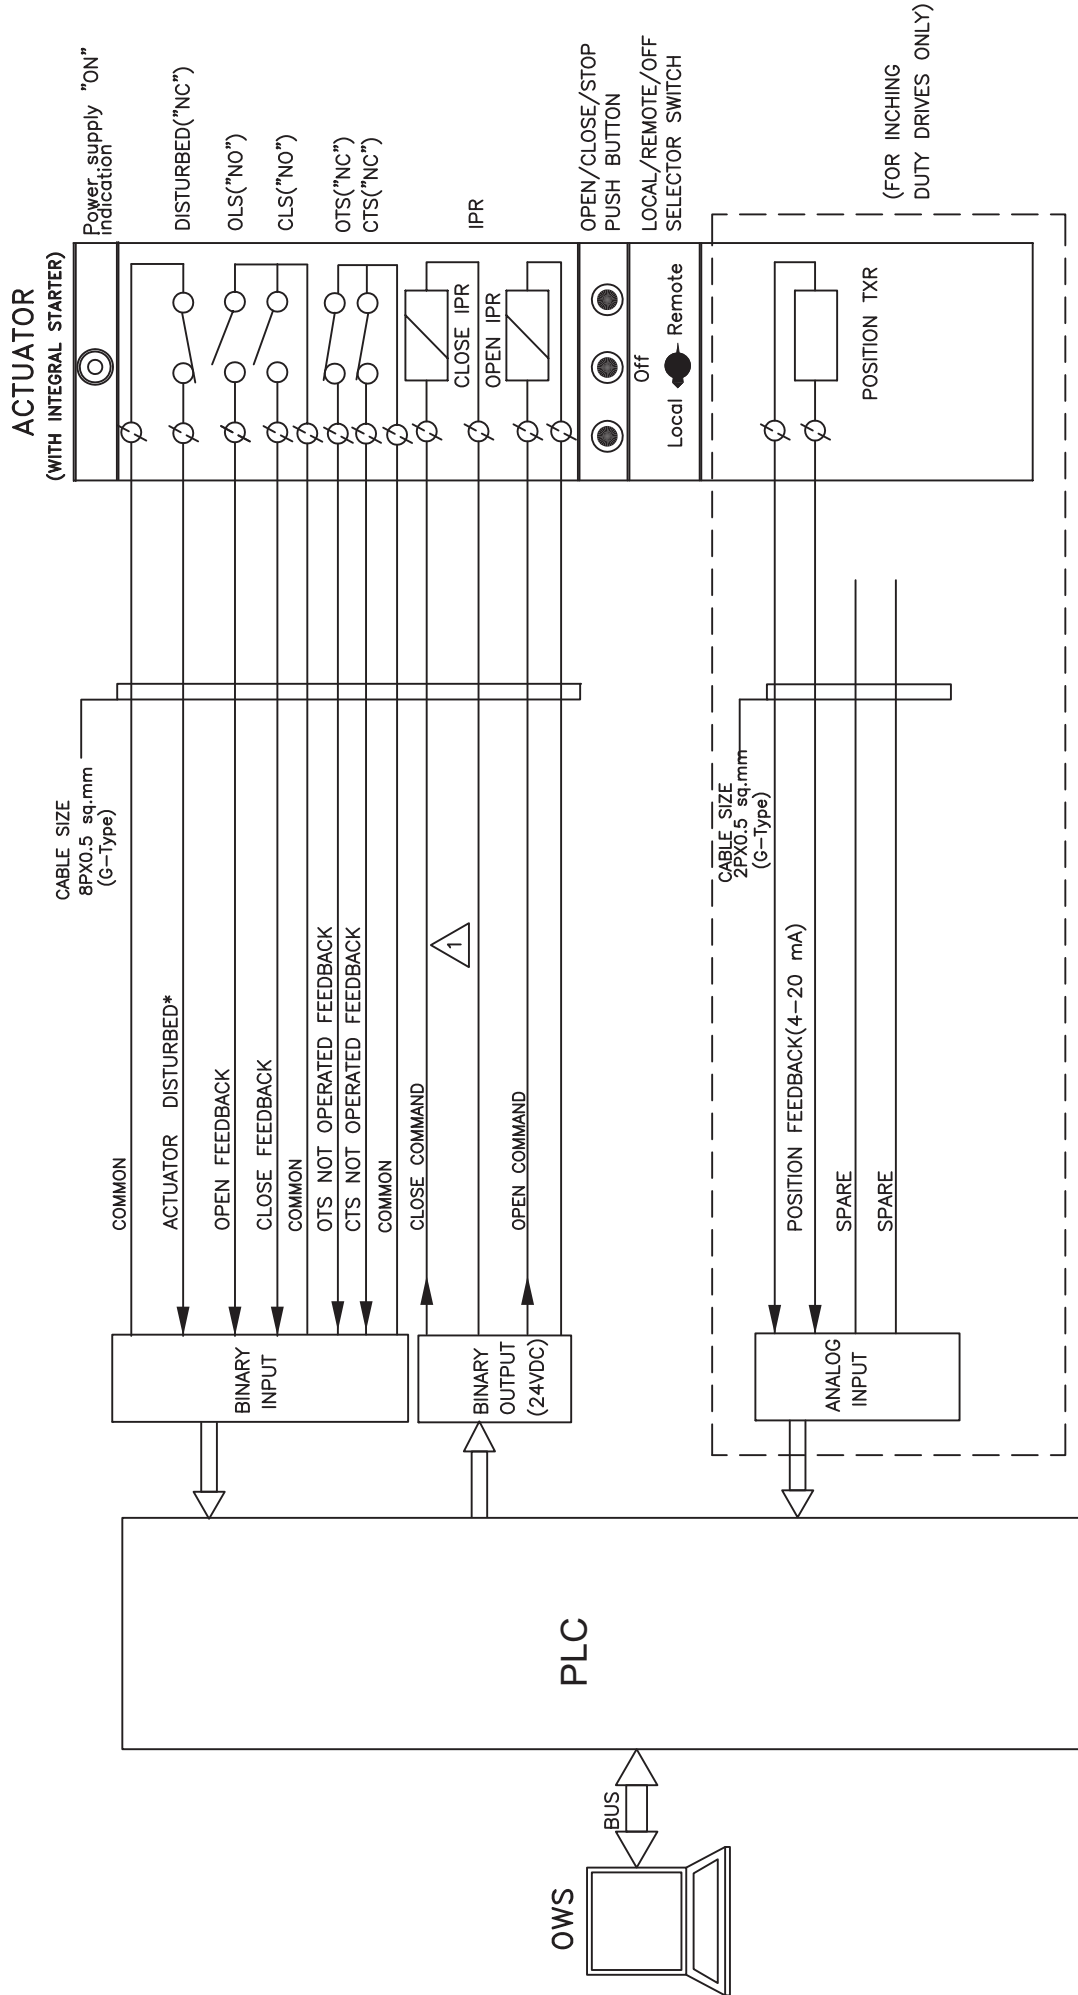

NOTE:

- * DISTURBED= Loss of Power supply (1 Phase/3 Phase)/
- Loss of control supply/ Motor thermostat trip/
- Thermal over load/
- Local/Off/Remote Sel. switch in local or off mode/
- Stop PB optd.




PROJECT: 4 X 270 MW BHADRADRI TPS

TITLE
PLC INTERFACE FOR
BIDIRECTIONAL DRIVE


DRG.NO.	PE-DM-411-145-1002
DATE	06.02.2015
REV.NO.	01
SHT	7 OF 11

PLC INTERFACE FOR UNIDIRECTIONAL LT DRIVE

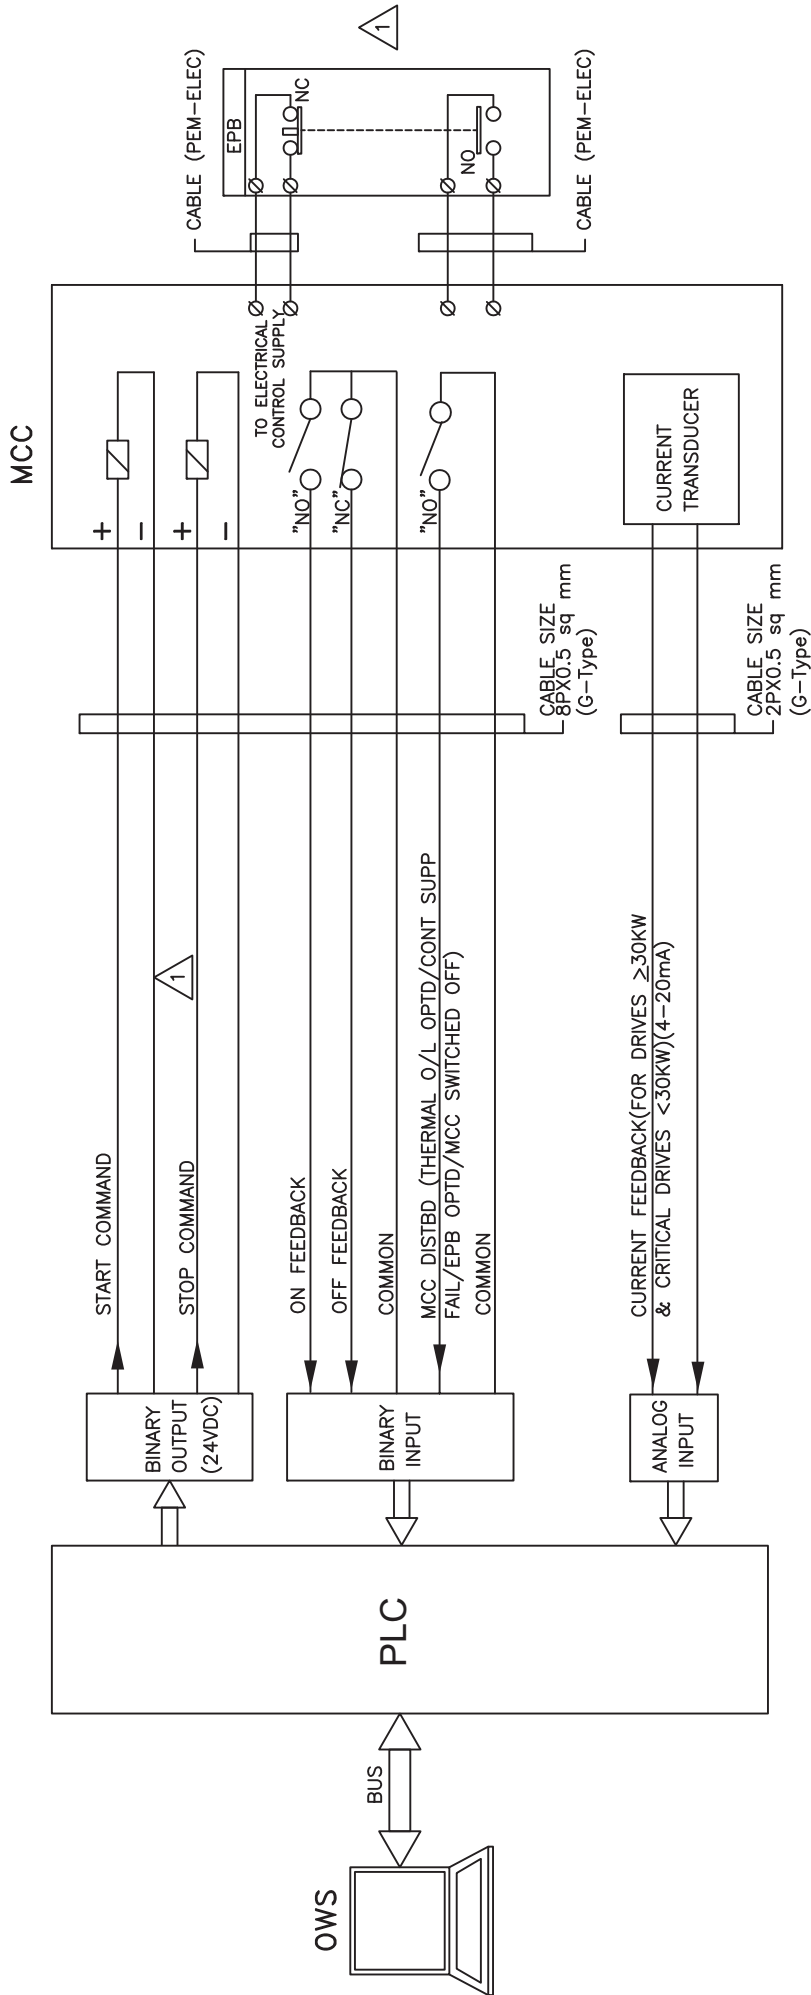

	PROJECT: 4 X 270 MW BHADRADRI TPS		DRG.NO.	PE-DM-411-145-I002
			DATE	06.02.2015
	TITLE PLC INTERFACE FOR UNIDIRECTIONAL LT DRIVE		REV.NO.	01
			SHT	8 OF 11


PLC INTERFACE FOR SOLENOID DRIVE
(24V DC / 240V AC UPS)

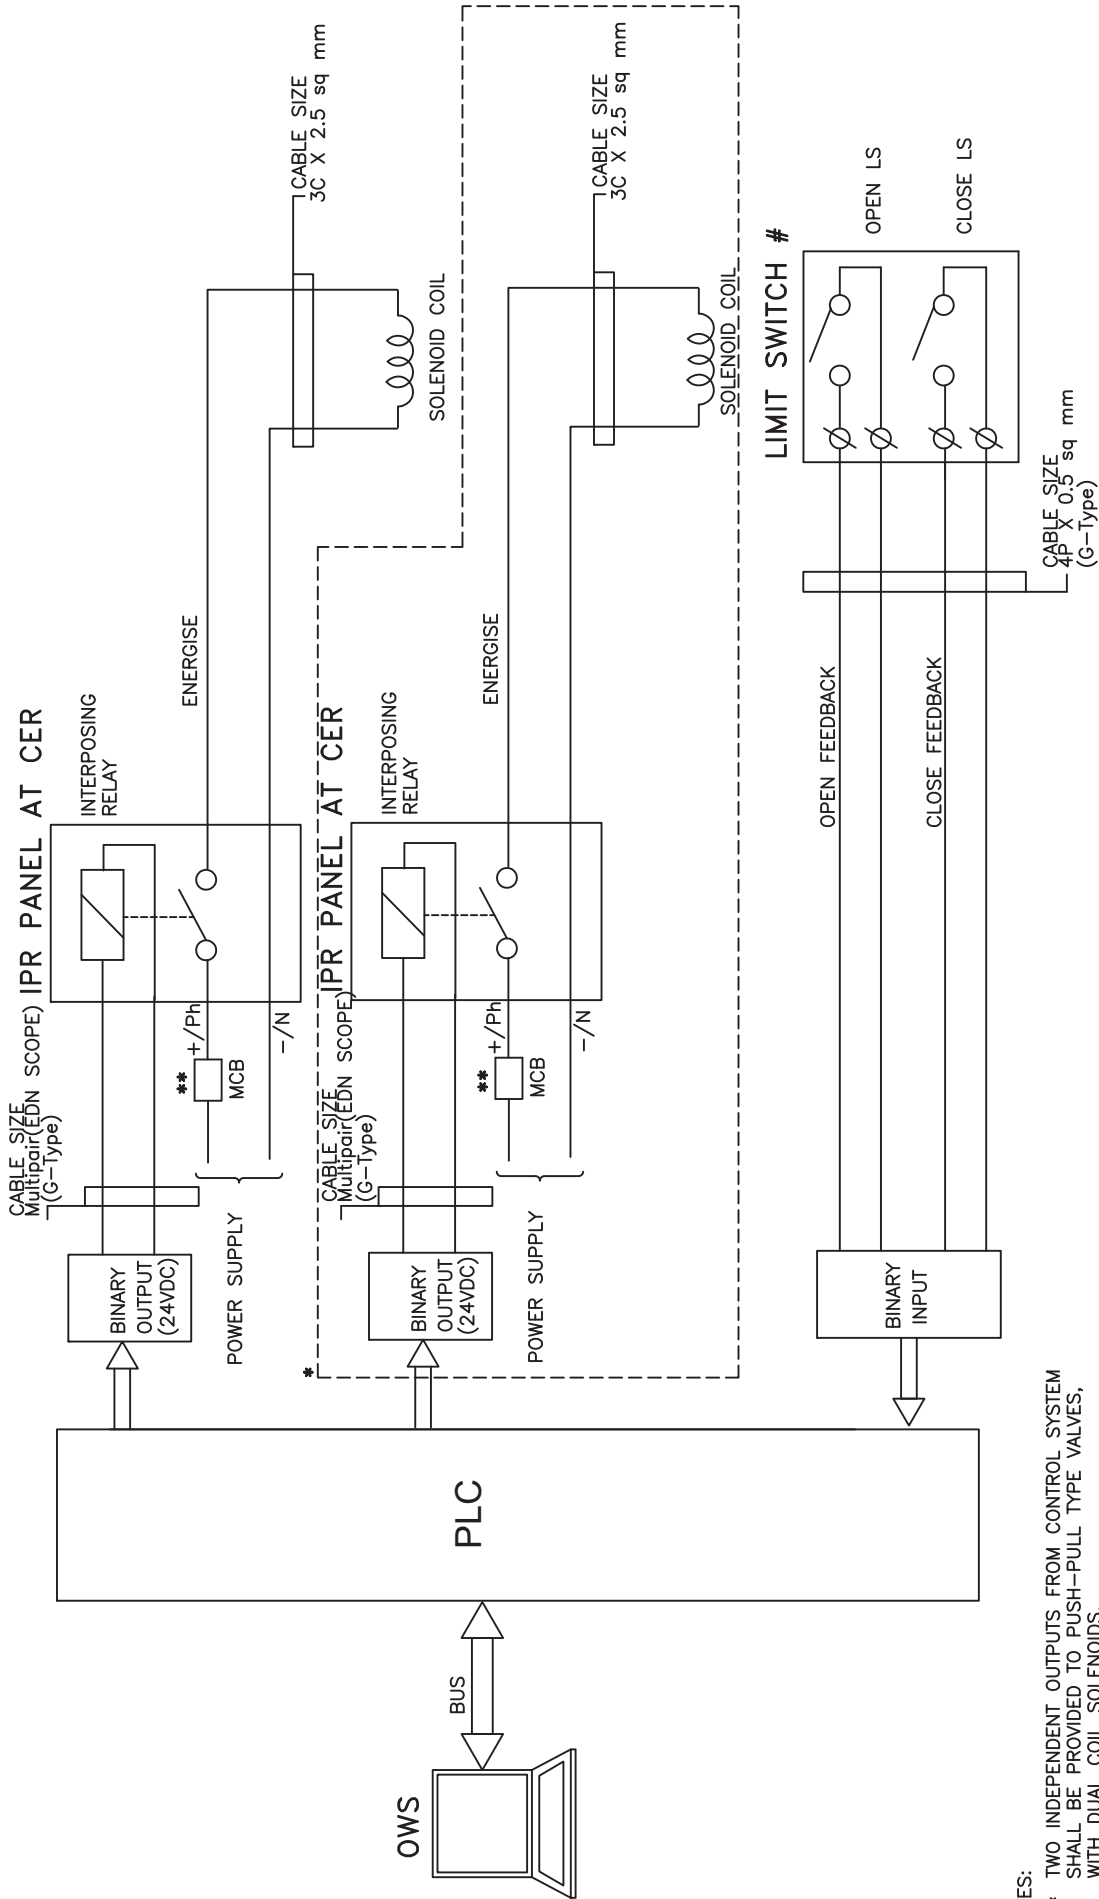

- NOTES:
- * TWO INDEPENDENT OUTPUTS FROM CONTROL SYSTEM SHALL BE PROVIDED TO PUSH-PULL TYPE VALVES, WITH DUAL COIL SOLENOIDS.
 - ** MCB SHALL BE PROVIDED FOR EACH SOLENOID
 - # FOR ON/OFF TYPE, SOLENOID ACTUATED CONTROL VALVE.


	PROJECT: 4 X 270 MW BHADRADRI TPS		DRG.NO.	PE-DW-411-145-I002
	TITLE PLC INTERFACE FOR SOLENOID DRIVE		DATE	18.11.2014
			REV.NO.	00
			SHT	9 OF 11

PLC INTERFACE FOR HT/LT UNIDIRECTIONAL DRIVES(BREAKER OPERATED)

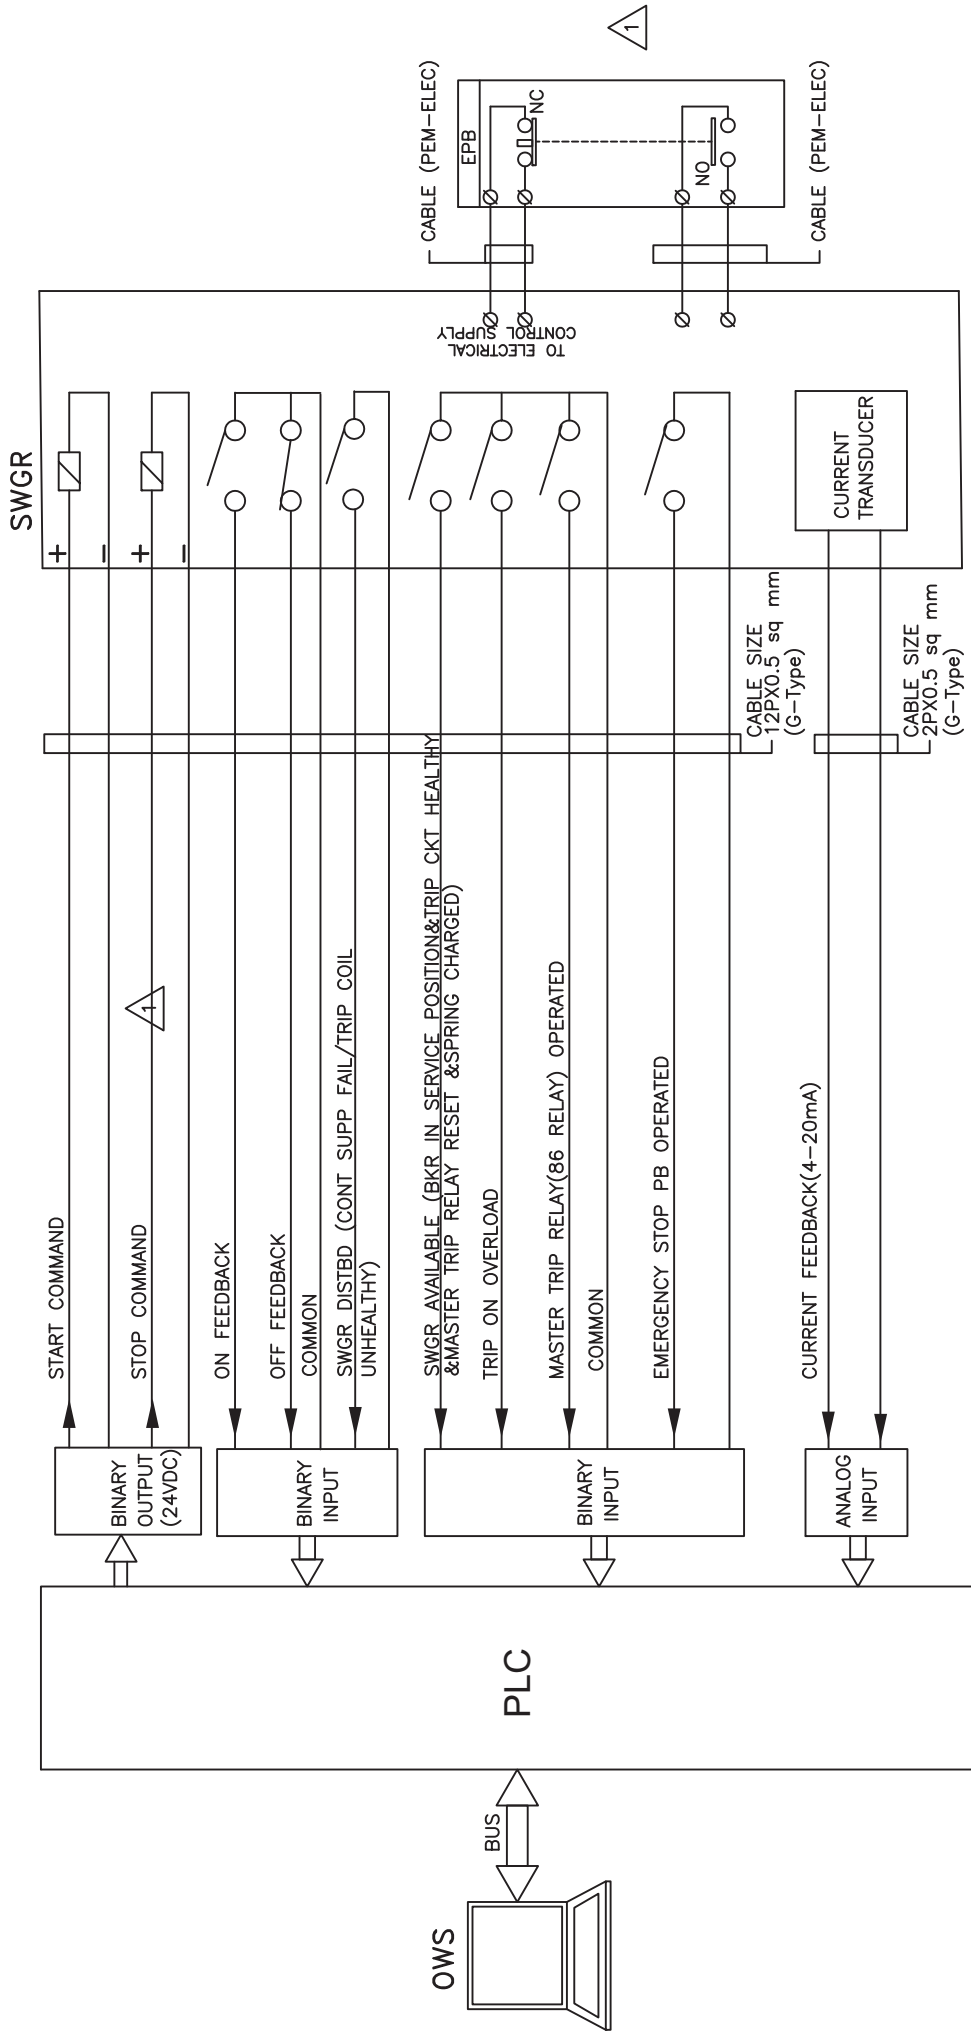

	PROJECT: 4 X 270 MW BHADRADRI TPS		DRG.NO.	PE-DM-411-145-I002
	TITLE PLC INTERFACE FOR UNIDIRECTIONAL HT DRIVE		DATE	06.02.2015
			REV.NO.	01
			SHT	10 OF 11

PLC INTERFACE FOR ANALOG DRIVE

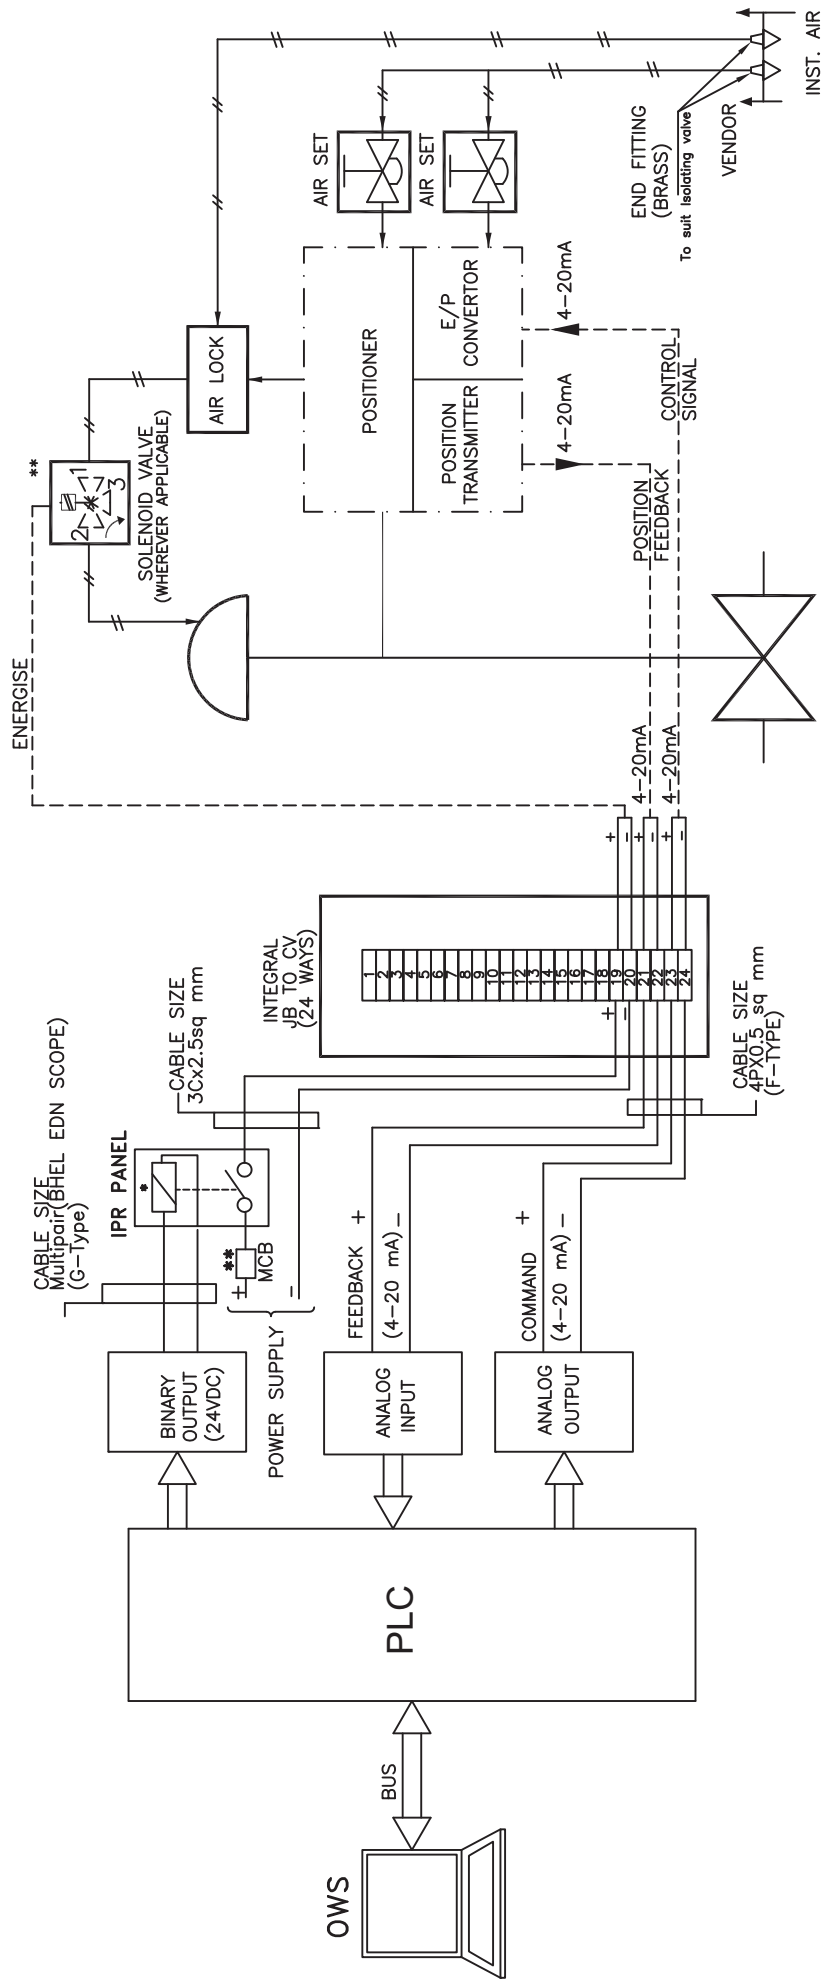

NOTES:

* APPLICABLE TO VALVES WHERE PROTECTION OPEN/CLOSE ACTION FOR CONTROL DEMAND OVERRIDING IS REQUIRED.

** MCB SHALL BE PROVIDED FOR EACH SOLENOID



PROJECT: 4 X 270 MW BHADRADRI TPS

TITLE
TYPICAL HOOK-UP DIAGRAM
ANALOG DRIVE(WITH SMART POSITIONER)

DRG.NO.	PE-DM-411-145-I002
DATE	18.11.2014
REV.NO.	00
SHT	11 OF 11



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.


00

DATE : 19.03.2015

SHEET

OF

UPS SCHEME

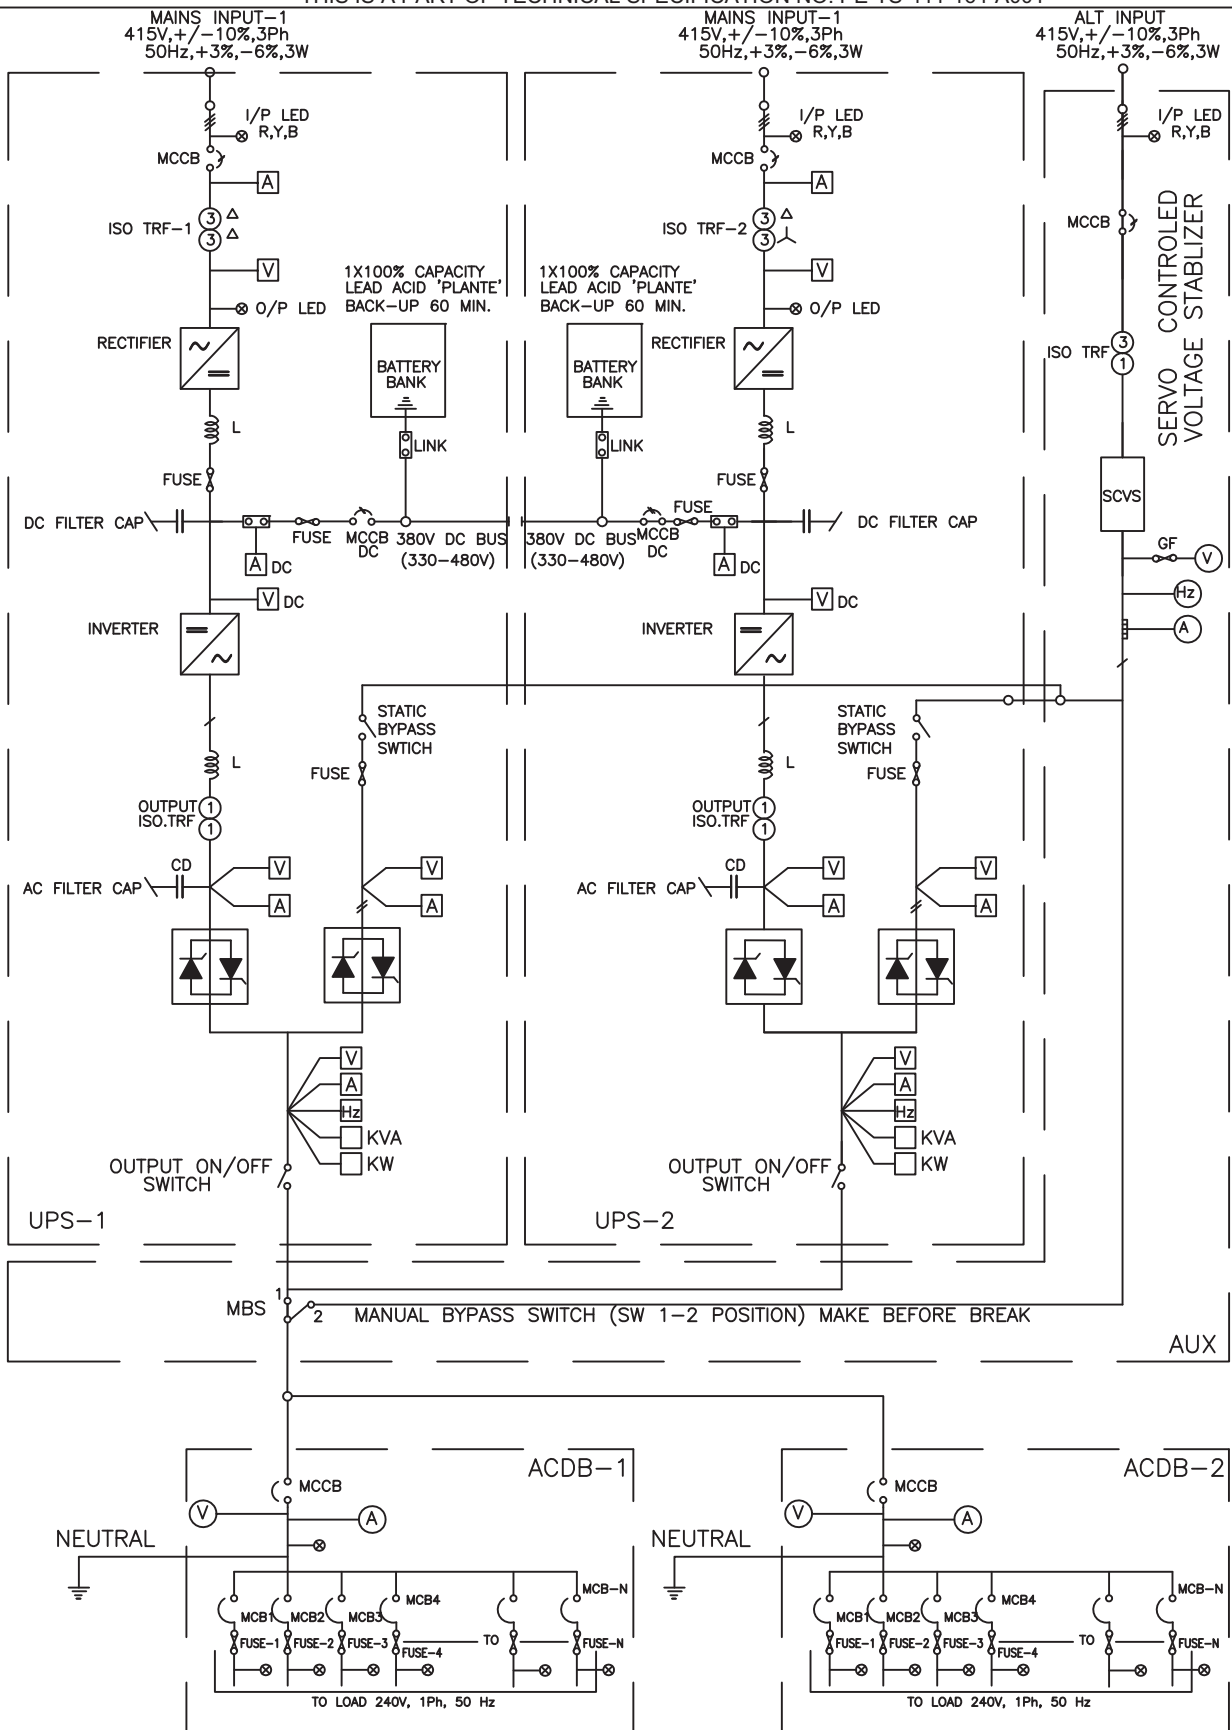

4 X 270 MW BHADRADRI TPS

TITLE:—

UPS SINGLE LINE DIAGRAM

DRG.
No.

PE-DM-411-145-I900

REV.
No.

02

DATE

01.07.2015

SHEET

11 OF 11



Technical specification for
CONTROL & INSTRUMENTATION

4 X 270 MW BHADRADRI TPS

SPEC NO.: **PE-TS-411-145-I**

VOLUME

SECTION

REV. NO.

00

DATE : 19.03.2015

SHEET

OF

INSTRUMENTATION DATA SHEET

1.00.00 SPECIFICATION FOR ELECTRONIC TRANSMITTERS
1.01.00 PRESSURE TRANSMITTER

- | | | | |
|-----|---------------------|---|---|
| 1. | Working Principle | : | Smart (HART Compatible) |
| 2. | Type | : | Microprocessor based, 2 – Wire |
| 3. | Output Signal | : | 4-20 mA DC along with superimposed digital signal |
| 4. | Measuring Element | : | Capsule / Diaphragm |
| 5. | Element material | : | SS-316 (Stainless Steel) or better |
| 6. | Static Pressure | : | 150 % of maximum span continuously, without affecting the calibration |
| 7. | Turn-down ratio | : | 100: 1 |
| 8. | Span and Zero | : | Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span |
| 9. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 10. | Output Indicator | : | LCD (Integral indicator of 5 digit display) |
| 11. | Nameplate | : | Tag number, service engraved in SS tag plate |
| 12. | Body | : | SS |
| 13. | Operating Voltage | : | 24V DC |
| 14. | Load | : | 600 Ohms (min.) at 24 Volts D.C. |
| 15. | Ambient Temperature | : | 0 - 50 °C |
| 16. | Performance: | : | |
| | i. Accuracy | | ± 0.075% of Span or better |

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

- ii. Repeatability : $\pm 0.05\%$ of Span or better
17. Sealing/Isolation : Extended diaphragm (Silicon oil/ Fluorolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications
18. Accessories :
- a. Universal mounting bracket suitable for 2" pipe mounting
 - b. High tensile carbon steel U-bolts
 - c. Siphon for steam and hot water services
 - d. 1/2" NPT 2-valve stainless steel manifold, constructed from SS316 bar stock
 - e. Companion flange with nuts, bolts and gaskets
 - f. 1/2" NPT cable gland
 - g. Handheld calibrator
19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

Notes: For primary air/ secondary air/ flue gas applications, DP type transmitters shall be provided for pressure measurement.
LVDT type is not acceptable.

1.02.00 DIFFERENTIAL PRESSURE TRANSMITTER / FLOW TRANSMITTER

1. Working Principle : Smart (HART Compatible)
2. Type : Microprocessor based, 2 – Wire
3. Output Signal : 4-20 mA DC along with superimposed digital signal
4. Measuring Element : Capsule / Diaphragm

- | | | | |
|-----|---------------------|---|---|
| 5. | Element material | : | SS-316 (Stainless Steel) or better |
| 6. | Static Pressure | : | 150 % of maximum span continuously, without affecting the calibration |
| 7. | Turn-down ratio | : | 100: 1 |
| 8. | Span and Zero | : | Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span |
| 9. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 10. | Output Indicator | : | LCD (Integral indicator of 5 digit display) |
| 11. | Nameplate | : | Tag number, service engraved in SS tag plate |
| 12. | Body | : | SS |
| 13. | Operating Voltage | : | 24V DC |
| 14. | Load | : | 600 Ohms (min.) at 24 Volts D.C. |
| 15. | Ambient Temperature | : | 0 - 50 °C |
| 16. | Performance: | | |
| | i. Accuracy | : | ± 0.075% of Span or better |
| | ii. Repeatability | : | ± 0.05% of Span or better |
| 17. | Sealing/Isolation | : | Extended diaphragm (Silicon oil/ Fluorolub filled) with 5 meters SS armoured capillary for corrosive/viscous/solid bearing or slurry type fluid applications |
| 18. | Accessories | : | a. Universal mounting bracket suitable for 2" pipe mounting

b. High tensile carbon steel U-bolts |

- c. Siphon for steam and hot water services
- d. ½" NPT 5-valve stainless steel manifold, constructed from SS316 bar stock
- e. Companion flange with nuts, bolts and gaskets
- f. ½" NPT cable gland
- g. Handheld calibrator

19. Adjustment/Calibration/ Maintenance : From handheld calibrator/ HART management system

1.03.00 Displacer Type Level Transmitters

- 1. Type : Smart (HART Compatible)
- 2. Stages of operation : Continuous
- 3. Material :
- 4. i. Displacer SS-316
- 5. ii. Suspension wire SS-316
- 6. iii. Torque tube housing SS
- 7. iv. Torque tube Inconel
- 8. v. Displacer chamber SS
- 9. vi. Transmitter Housing SS
- 10. Operating Voltage : 24 V DC
- 11. Transmission : Microprocessor based, 2-wire
- 12. Output Signal : 4-20 mA DC along with superimposed digital signal
- 13. Static / overload : Maximum static pressure without

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

	pressure		permanent deformation or loss of accuracy
14.	Turn-down ratio	:	10 : 1 or better
15.	Zero & Span	:	Continuous, tamper proof, remote as well locally adjustable with zero elevation and suppression by 100% of span
16.	Enclosure Class	:	IP-65
17.	Output Indicator	:	LCD type (Integral indicator of 5 digit display)
18.	Nameplate	:	Tag number and Service engraved in stainless steel tag plate
19.	Ambient Temperature	:	0 - 50 °C
20.	Load Impedance	:	600 Ohms at 24 Volts (minimum)
21.	Process Connection	:	2" Flanged
22.	Performance - Accuracy	:	± 0.075 % of span or better
23.	Accessories	:	a) Counter Flange, nuts, bolts, gaskets etc b) Weights for 5 point calibration of instruments c) Vent and drain plugs d) ½" NPT Glands e) Handheld calibrator
24.	Preferred Features	:	a) Test plug connection and cutout terminals physically separated from other electronics b) Electronic Damping facility (adjustable)
25.	Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system

26. Applications : During detail engineering on Owner's approval

1.04.00 MASS FLOW METER

1.04.01 SENSOR

1. Measuring Principle : Coriolis Mass flow
2. Primary Element : Flow Tube of 316SS or better
3. Heating Arrangement : Integral
4. Temperature Control : For heavy fuel oil application
5. Process Connection : Flanged of rating as per process requirement
6. Drain : Self-draining facility
7. Enclosure : Stainless steel
8. Accessories : Counter flanges, Mounting nuts, bolts, gaskets etc.

1.04.02 TRANSMITTER

1. Measured quantities : Mass Flow rate, Total Mass Flow, Density
2. Input Signal Processing : Smart (HART compatible)
3. Display : LCD
4. Output : 2 nos. isolated output of 4-20mA DC selectable from four measured quantities
5. Load : < 750 ohms
6. Power supply : 240V AC, 50 Hz

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

- | | | | |
|-----|---|---|---|
| 7. | Turn Down | : | 100:1 |
| 8. | Accuracy | : | ± 0.2 % of measured value |
| 9. | Housing | : | IP 65 (Explosion proof) |
| 10. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 11. | Accessories | : | a) Handheld calibrator
b) Mounting U-bolts, nuts, bolts, prefab cable etc
c) $\frac{1}{2}$ "NPT cable gland |
| 12. | Adjustment/Calibration/
/Maintenance | : | From handheld calibrator/ HART management system |
| 13. | Applications | : | Fuel Oil service |

1.05.00 RADAR TYPE LEVEL MEASUREMENT

- | | | | |
|----|---------------------------|---|---|
| 1. | Type | : | Smart (HART Compatible) |
| 2. | Antenna | : | Co axial / guided wave radar /Overspill protection |
| 3. | Principle | : | TDR (Time Domain Reflectometry) |
| 4. | Communication | : | Two wire 4-20mA DC with HART |
| 5. | Environmental temperature | : | 0 – 50 °C |
| 6. | Enclosure | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 7. | Calibration | : | a) Self calibration with internal reference
b) Zero & Span calibration |
| 8. | Process Connection | : | External cage mounting
Flanged /screwed |
| 9. | Electronic Housing | : | Epoxy painted Die-Cast aluminium |

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

		alloy	
10.	Antenna / Flange assembly	:	316 SS or Hest alloy (as required)
11.	Power supply	:	24 V DC
12.	Output Indicator	:	LCD
13.	Accuracy	:	5 mm or 0.1% of probe length
14.	Accessories	:	a) Handheld calibrator
		:	b) Counter Flange, nuts, bolts, gaskets etc
		:	c) ½"NPT cable gland
		:	d) SS Nameplate
15.	Adjustment/Calibration/ Maintenance	:	From handheld calibrator/ HART management system
16.	Applications	:	Vessels under vacuum or low pressure applications, solid levels
1.06.00	ULTRASONIC LEVEL TRANSMITTER		
1.	Type	:	Microprocessor based, 2-wire, Smart (HART Compatible)
2.	Operating Principle	:	Detection of reflected ultrasonic pulse
3.	Output Signal	:	4-20 mA DC along with superimposed digital signal
4.	Operating frequency	:	10 KHz to 50 KHz (typical)
5.	Display	:	LCD
6.	Temperature Compensation	:	Built in –Programmable
7.	Power supply	:	24 V DC
8.	Enclosure	:	SS, IP-65 (Explosion proof for NEC Class-1, Division 1 area)

- | | | |
|---|---|---|
| 9. Zero & Span | : | Continuous, tamper proof, remote as well locally adjustable. It shall be possible to calibrate the instrument without any level in the sump/ tank |
| 10. Accuracy & Repeatability | : | 0.15 % of span or better |
| 11. Resolution | : | 0.1 % of span |
| 12. Operating temp. | : | Transmitter- 500 C and Sensor - 800 C |
| 13. MOC Sensor | : | SS-316/Body- PVC and Face – Polyurethane |
| 14. Mounting | : | 4" Flanged/ 2" NPT for sensor and Transmitter on panel |
| 15. Accessories | : | <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 20px;">a)</div> <div>Handheld calibrator</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 20px;">b)</div> <div>Weather canopy for protection from direct sunlight and direct rain</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 20px;">c)</div> <div>½"NPT cable gland</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 20px;">d)</div> <div>All mounting hardware (SS-316), Prefab cable</div> </div> <div style="margin-top: 10px;"> <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 20px;">e)</div> <div>SS Nameplate</div> </div> </div> </div> </div></div> |
| 16. Diagnosis | : | On-line |
| 17. Status Indication | : | Power On, HI, HI-HI, Lo, LO-LO, Fault |
| 18. Output Contacts | : | 2 SPDT, 230V, 5A |
| 19. Adjustment/Calibration/ Maintenance | : | From handheld calibrator/ HART management system |
| 20. Applications | : | Coal Bunker, Water Service etc. |

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**
**EPC Bid Document
e-PCT/TS/K/02/2014-15**
1.07.00 ULTRASONIC FLOW TRANSMITTER

- | | | |
|--|---|---|
| 1. Type | : | Ultrasonic – Clamp On |
| 2. Accuracy | : | +/- 1 % of reading |
| 3. Repeatability | : | +/- 0.3 % of reading |
| 4. Rangeability | : | 400 : 1 |
| 5. Output Signal | : | 4-20 mA DC with HART |
| 6. Measured Parameter | : | Volumetric flow, Totalized flow and flow Velocity |
| 7. Display | : | LCD with internal Key Pad (Flow rate & Totalization) |
| 8. Power Supply | : | 24 V DC (2 Wire) |
| 9. Enclosure | : | SS (IP- 68 – Submersible) |
| 10. Mounting | : | SS Chain or Strap |
| 11. Accessories | | <ol style="list-style-type: none"> 1. Handheld calibrator 2. ½"NPT cable gland 3. Transducer cable 4. All mounting hardware (SS-316) 5. SS Nameplate |
| 12. Adjustment/Calibration/ /Maintenance | : | From handheld calibrator/ HART management system |
| 13. Applications | : | Plant water service |

Note: Multi-path insertion type (minimum 4 path) Ultrasonic Flow meter shall be provided for Raw water/ Cooling Water flow measurements.

~~**2.00.00 HART HAND HELD CALIBRATOR**~~

~~Hand held calibrators (5 nos. for each type) shall be provided for adjustment/ calibration/maintenance of the HART compatible~~

~~transmitters. The hand held calibrator shall be suitable for all types of transmitters supplied in the package. If one type of hand held type calibrator is not suitable for communicating with all types of transmitters then separate hand held calibrator will be provided.~~

3.00.00 PROCESS ACTUATED SWITCHES

3.01.00 PRESSURE SWITCH

1. Type :
 - i. Piston for high pressure application
 - ii. Bellow / Diaphragm for low pressure application
2. Sensing element : SS-316.
material All other wetted part SS316
3. Case Material : SS
4. Setter Scale : Black graduation on white linear scale.
Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure
6. Adjustments :
 - a) Internal Set Point
 - b) Differential adjustment
7. End Connection : 1/2" NPT bottom connected
8. Switch configuration : Two SPDT (240V, 5A AC/220V, 0.5A DC)
9. Switch Type : Snap acting, shock & vibration proof
10. Terminal Block : Suitable for full ring lugs
11. Enclosure Class : IP-65 (Explosion proof for NEC Class-1, Division 1 area)
12. Performance :
 - a) Repeat accuracy $\pm 1.0\%$
 - b) Accuracy of Setting Indication of $\pm 1.5\%$
13. Ambient temperature : 0 – 50 Deg.C

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

-
14. Nameplate : Tag number, service engraved in SS tag plate
15. Accessories : a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary for corrosive/ viscous/ solid bearing or slurry type fluid applications
b) Snubbers for pulsating fluid applications
c) Siphons for steam and hot water services
d) Retention ring and screws for surface mounting
e) 1/2" NPT 2 Valve SS-316 barstock manifold
f) 1/2" NPT cable gland
16. Applications : During Detail Engineering on Owner's approval

3.02.00 DIFFERENTIAL PRESSURE SWITCH

1. Type : i. Piston for high pressure application
ii. Bellow / Diaphragm for low pressure application
2. Sensing element : SS-316.
material All other wetted part SS316
3. Case Material : SS
4. Setter Scale : Black graduation on white linear scale. Graduation 0-100% with red pointer for set points
5. Over range : 150 % of maximum pressure

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

-
- | | | | |
|-----|----------------------|---|---|
| 6. | Adjustments | : | a) Internal Set Point |
| | | : | b) Differential adjustment |
| 7. | End Connection | : | 1/2" NPT bottom/ back connected |
| 8. | Switch configuration | : | Two SPDT (240V, 5A AC/220V, 0.5A DC) |
| 9. | Switch Type | : | Snap acting, shock & vibration proof |
| 10. | Terminal Block | : | Suitable for full ring lugs |
| 11. | Enclosure Class | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 12. | Performance | : | a) Repeat accuracy $\pm 1.0\%$
b) Accuracy of Setting Indication of $\pm 1.5\%$ |
| 13. | Ambient temperature | : | 0 – 50 Deg.C |
| 14. | Nameplate | : | Tag number, service engraved in SS tag plate |
| 15. | Accessories | : | a) Silicon oil/ Fluorolub filled Remote diaphragm seal with SS-316 capillary Diaphragm seals for corrosive/ viscous/ solid bearing or slurry type fluid applications
b) Snubbers for pulsating fluid applications
c) Siphons for steam and hot water services
d) Retention ring and screws for surface mounting
e) 1/2" NPT 5 Valve SS-316 barstock manifold
f) 1/2" NPT cable gland |
| 16. | Applications | : | During Detail Engineering on Owner's |

approval

3.03.00 LEVEL SWITCH

3.03.01 FLOAT OPERATED

- | | | | |
|-----|----------------------------|---|---|
| 1. | Float material | : | SS-316 |
| 2. | Wetted parts | : | SS-316 |
| 3. | Float chamber | : | Stainless steel/Carbon steel, construction welded |
| 4. | Float chamber mounting | : | Side mounted |
| 5. | Fluid connection | : | Side – Side |
| 6. | Fluid connection size | : | 1" ANSI RF Flange (rubber line, if required) |
| 7. | Drain | : | ½ inch NPT with Plug |
| 8. | Pressure rating of chamber | : | Minimum 1.5 times of design pressure |
| 9. | Repeatability | : | +/- 1.5 mm or better |
| 10. | Switch housing | : | Stainless Steel |
| 11. | Switch housing type | : | IP- 65 |
| 12. | Type of switch | : | Snap acting magnetically operated hermetically sealed |
| 13. | Switch configuration | : | 2 SPDT (5A, 240 V AC, 0.5A, 220V DC) |
| 14. | Accessories | : | <div style="display: flex; align-items: flex-start;"> <div style="margin-right: 20px;">a)</div> <div>Counter flange, nuts & bolts, suitable gasket etc.</div> </div> <div style="display: flex; align-items: flex-start; margin-top: 10px;"> <div style="margin-right: 20px;">b)</div> <div>Steel globe type drain valve</div> </div> <div style="display: flex; align-items: flex-start; margin-top: 10px;"> <div style="margin-right: 20px;">c)</div> <div>½"NPT cable gland</div> </div> |

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

d) Stainless steel nameplate with alpha-numeric engraved for service and tag

15. Application : During Detail Engineering on Owner's approval

3.04.00 FLOW SWITCH

1. Type : Paddle /Piston/Disk
2. Wetted part material : Stainless steel or Hastelloy for acidic application
3. End connection :
 - a) Threaded upto 1" line size with integral Tee
 - b) Flanged for line size > 1 ½"
4. Enclosure material : Stainless Steel
5. Enclosure class : IP 65
6. Switch configuration : 2 SPDT (5A, 240 V AC, 0.5A, 220V DC)
7. Repeatability : 2%
8. Cable connection : ½"NPTF
9. Accessories :
 - a) Tee, Counter flange, nuts & bolts, suitable gasket etc
 - b) ½"NPT cable gland
 - c) Stainless steel nameplate with alpha-numeric engraved for service and tag

3.05.00 RF LEVEL SWITCH

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

-
- | | | |
|-----------------------------|---|--|
| 1. Type | : | RADIO FREQUENCY |
| Sensing probe | | |
| 2. Material | : | SS-316 |
| 3. Mounting | : | Threaded |
| Application | | |
| 4. Temperature | : | 250°C (Max.) |
| Electronic Controller | | |
| 5. Input Supply Voltage | : | 240V AC $\pm$ 10%, 50 Hz. |
| 6. Relay Output | : | 2 SPDT (240V AC, 5A) |
| 7. Ambient Temperature | : | 50 °C |
| 8. Enclosure Protection | : | IP-66 |
| 9. Enclosure Housing | : | SS |
| | | Normal Level |
| | | Power On |
| 10. Local LED Indication | : | Alarm Level |
| | | Probe Healthy |
| 11. Switching Repeatability | : | $\pm$ 0.5% |
| | | Co-axial cable for probe connection to |
| | | controller |
| 12. Accessories | : | SS Tag plate |
| | | ½" NPT Cable Glands |
| 13. Application | : | Solid level |

3.06.00 CONDUCTIVITY TYPE LEVEL SWITCH

- | | | |
|------------------|---|-----------------------------|
| 1. Type | : | Conductivity discrimination |
| 2. Probe MOC | : | SS-316 |
| 3. Mounting | : | Flanged on external cage |
| Application | | |
| 4. Temperature | : | 250°C (Max.) |
| 5. Test Pressure | : | Two times rated pressure |

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

6. Input Supply Voltage	:	240V AC $\pm$ 10%, 50 Hz.
7. Input	:	Four independent channel with selectable switching threshold for water conductivity
8. Relay Output	:	2 SPDT (240V AC, 5A)
9. Ambient Temperature	:	50 °C
10. Enclosure Protection	:	IP-65 (Explosion proof for NEC Class-1, Division-1 area)
11. Enclosure Housing	:	SS HI,LO, HIGH-HIGH, LOW-LOW
12. Local LED Indication	:	Power Fault
13. Accessories	:	a) Interconnecting cable from probe to electronics b) Mounting accessories c) External cage d) Washer & Gasket e) ½" NPT Cable Glands f) SS Tag Plate
14. Application	:	During Detail Engineering on Owner's approval

3.07.00	TEMPERATURE SWITCH	
1. Type	:	Bimetallic or gas filled
2. Sensing Element Material	:	SS-316
3. Bulb Material	:	SS-316
4. Capillary	:	Stainless Steel armored

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

-
- | | | | |
|-----|-----------------------|---|--|
| 5. | Movement Material | : | Stainless Steel |
| 6. | Case material | : | Stainless Steel with neoprene gasket and clear glass where applicable cover conforming to IP-65. (Explosion proof for NEC Class-1, Division 1 area). |
| 7.. | Scale | : | Black graduation on white linear scale. Graduation 0-100% with red pointer for set points |
| 8. | Over range Protection | : | 120 % |
| 9. | Instrument connection | : | Bottom |
| 10. | Switch configuration | : | Two SPDT (240V, 5A AC/220V, 0.5A DC) |
| 11. | Switch type | : | Snap acting, shock and vibration-proof |
| 12. | Adjustability | : | Internal Set point adjustable over span range |
| 13. | Compensation | : | a) Capillary compensation with invar wire throughout the capillary length
b) Case compensation |
| 14. | Performance | | |
| | a) Scale Accuracy | : | ± 1.0 % of full scale |
| | b) Repeatability | : | < 0.5 % of full range |
| | c) Response time | : | Less than 40 seconds with thermowell |
| 15. | Capillary length | : | 5 meters (minimum) for local mounting/15 meters for local panel mounting |
| 16. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |
| 17. | Accessories | : | Mounting accessories, 1/2" NPT cable gland |
| 18. | Applications | : | During Detail Engineering on Owner's |

approval

4.00.00 LOCAL INSTRUMENTS
4.01.00 PRESSURE GAUGE AND DIFFERENTIAL PRESSURE GAUGE

- | | | |
|--------------------------|---|--|
| 1. Type | : | Bourdon/Bellows/Diaphragm |
| 2. Sensing & Socket | : | SS-316 |
| 3. Movement Material | : | SS-316 |
| 4. Case Material | : | Stainless steel. IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 5. Dial Size | : | Generally 150 mm |
| 6. Scale | : | Black lettering on white in 270 O arc. |
| 7. Window | : | Shatterproof glass |
| 8. Range Selection | : | Normal process pressure: 50~70 % of range |
| 9. Over-range Protection | : | 125% of maximum range by internal stop. External stop at zero |
| 10. Adjustment | : | For Zero adjustment (Micrometer screw external)
For Range adjustment (Micrometer screw internal). |
| 11. Element Connection | : | Argon welding |
| 12. Process Connection | : | 1/2" NPT (M) Bottom for local, back for panel mounting |
| 13. Performance | : | Accuracy of ± 1.0 % of span or better |
| 14. Operating ambient | : | 0 - 50 °C |
| 15. Safety Feature | : | Blow out disc /diaphragm at the back |
| 16. Accessories | : | a) Snubbers for pulsating fluid application.discharge
b) Stainless steel Diaphragm seals |

for corrosive/ viscous/ solid
bearing or slurry type fluid
applications

c) 3-Way SS316 Gauge cock for
pressure gauges

d) 5-valve SS316 manifold from
barstock for differential pressure
gauge

e) Siphons for steam and hot
water services

17. Nameplate : Tag number, service engraved in
stainless steel tag plate

4.02.00 LEVEL INDICATOR (FLOAT & BOARD TYPE)

- | | | |
|-------------------------------|---|---|
| 1. Type | : | Float and Board |
| 2. Float Material | : | SS-316 |
| 3. Float Cable | : | SS-316 |
| 4. Indicator Assembly | : | Epoxy painted Aluminium |
| 5. Guide wire spring assembly | : | SS-316 (2 Nos.) |
| 6. Guide Wire Anchor | : | SS-316 |
| | | Anodized Aluminium with engraved marking (Minimum graduation 10mm), |
| 7. Scale Board | : | mounting brackets and suitable hardware required as per tank height |
| 8. Elbow Assembly | : | Anodized Aluminium |
| 9. Flanges | : | RF , ANSI 150 , SS (3 Nos.) |
| 10. Accuracy | : | ± 10 mm or better |
| 11. Accessories | : | All mounting accessories including counter flange, nuts & bolts, suitable |

gasket etc. as applicable, SS Tag plate

4.03.00 GAUGE GLASS

- | | | | |
|----|----------------------------------|---|---|
| 1. | Type | : | Reflex /Transparent |
| 2. | Material | | |
| | Glass | : | Toughened borosilicate resistant to thermal shock |
| | Body Material | : | Carbon Steel Stainless Steel |
| | Enclosure | : | IP-65 (Explosion proof for NEC Class-1, Division 1 area) |
| 3. | Integral cocks & valves/Fittings | : | i. SS 316 |
| | | | Rubber lined corrosion resistant |
| 4. | | : | ii. stainless steel (for DM/RO service) |
| 5. | Vessel Connection | : | ANSI Flanged SS316 |
| 6. | Accessories | : | i. Integral cocks |
| | | | ii. Drain Valves |
| | | | iii. Companion Flanges, Bolts, nuts, gaskets, SS Tag plate |
| | | | iv. Illuminating lamps, Mica shield as required |
| | | | v. Calibrated scale |
| 7. | Pressure rating | : | Twice the maximum working pressure |
| 8. | Temperature | : | 300 °C |
| | | | For larger lengths (greater than 1200mm), additional gauge glasses shall be provided with minimum of 50 mm overlap. |
| 9. | Other details | : | |

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

-
- 4.04.00 SLIGHT GLASS
1. Type : Flap-type.
 2. End connection : Screwed / Flanged
 3. Material
 - a) Body : SS- 304
 - b) Cover plate : SS- 304
 - c) Indicator : SS- 316
 4. Sight Glass : Toughened Borosilicate
 5. Gasket : Neoprene
 6. Bolts & Nuts : High tensile steel.
 7. Hydraulic Test Pressure : 1.5 times maximum working pressure
 8. Accessories : Companion Flanges, Bolts, nuts, gaskets as required, SS Tag plate.
- 4.05.00 ROTAMETER
1. Type : ON-LINE for line upto and including 50 mm NB.
: Borosilicate BY-PASS for line size above 50 NB
 2. Metering tube : Toughened Borosilicate
 3. Float : SS-316
 4. End fittings : SS-316
 5. Packing material : Teflon / PTFE
 6. Casing : Stainless Steel
 7. Gland Rings : Stainless Steel
/Followers/ Other wetted parts
 8. Orifice Plate : Stainless Steel (for bypass type)
 9. Operating Temperature : 0-50 Deg. c

- | | | |
|------------------------|---|--|
| 10. Test Pressure | : | 200% of maximum operating pressure |
| 11. Scale | : | 250 mm nominal length |
| 12. Graduation | : | Direct reading |
| 13. Process Connection | : | Flanged (RF) to line size as per ANSI standards (150#) |
| 14. Tapping | : | D & D/2 |
| 15. Accuracy | : | +/- 2% of full scale reading |
| 16. Reproducibility | : | Within 0.5% of instantaneous reading |
| 17. Accessories | : | SS Tag Plate, orifice plate |

5.00.00 **TEMPERATURE ELEMENTS & ACCESSORIES**

5.01.00 RESISTANCE TEMPERATURE DETECTOR

- | | | |
|----------------------------------|---|--|
| 1. Type | : | Platinum (Duplex), Ungrounded |
| 2. Platinum (Duplex), Ungrounded | : | 100 ohm at 0 °C |
| 3. Base | : | Wound on ceramic (anti-inductive) |
| 4. Wiring | : | 3 Wire |
| 5. Protecting Tube | | |
| a) O.D. | : | 6 mm |
| b) Material | : | SS-316, Seamless |
| c) Filling | : | Magnesium oxide (Purity above 99.4%). |
| 6. Response time | : | a) 15 sec. (bare).
b) 30 sec. (with thermowell) |
| 7. Calibration | : | DIN 43760 |
| 8. Accuracy | : | ± 0.5% |
| 9. Head | | |
| a) Type | : | IP-65 universal screwed type |

- b) Material : Stainless Steel
- c) Terminal blocks : Nickel plated Brass-screw type / silver plated
- d) Cable connection : ½" NPT gland and grommet
- e) Others : Terminal head cover with SS chain and suitable gasket.

Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).

- Adjustable nipple-union-nipple [1/2" Sch 80 X ½" NPT] with thermowell connection
- 10. Accessories :
 - a)
 - b) Compression fittings/unions
 - Flanges etc. (for flanged connections only)
 - c)
 - Thermowell (As specified below)
 - d)
- 11. Thermowell connection : ½" NPT (M) or 150 RF Flanged
- Tag number, service engraved in
- 12. Nameplate : stainless steel tag plate

Note: The specifications for RTDs of winding/ bearing of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However, the type of RTD shall be Pt-100.

5.02.00 THERMOCOUPLES

1. Type :
 - a) 16 SWG wire of Chromel Alumel) (Type-K)
 - b) Duplex
 - c) Ungrounded
2. Protecting Tube
 - a) O.D. : 6 mm
 - b) Material : SS-316, Seamless
 - c) Filling : Magnesium oxide (Purity above 99.4%).
3. Response time :
 - a) < 20 seconds for measurement
 - b) < 10 seconds for control
4. Accuracy : $\pm 1.1^{\circ}\text{C}$ up to 300°C & 0.4% of measured temperature range above 300°C
5. Head
 - a) Type : IP-65 universal screwed type
 - b) Material : Stainless Steel
 - c) Terminal blocks : Nickel plated Brass-screw type / silver plated
 - d) Cable connection : $\frac{1}{2}$ " NPT gland and grommet
6. Others : Terminal head cover with SS chain and suitable gasket.

Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable).

- | | | | |
|----|-----------------------|---|---|
| 7. | Accessories | : | a) Adjustable nipple-union-nipple [1/2" Sch 80 X 1/2" NPT] with thermowell connection
b) Compression fittings/unions
c) Flanges etc. (for flanged connections only)
d) Thermowell (As specified below) |
| 8. | Thermowell connection | : | 1/2" NPT (M) or 150 RF Flanged |
| 9. | Nameplate | : | Tag number, service engraved in stainless steel tag plate |

5.03.00 TEMPERATURE GAUGE

- | | | | |
|----|-----------------------------|---|--|
| 1. | Type | : | Expansion type (Liquid filled system) |
| 2. | Sensing Element Material | : | Bourdon – SS-316 |
| 3. | Bulb and Capillary Material | : | SS-316 |
| 4. | Capillary Tubing | : | Inner sheath - solid drawn Material
copper tube
Outer sheath - PVC tube |
| 5. | Movement Materials | : | Stainless Steel / Direct Bourdon tip connection to pointer spindle |
| 6. | Case Material | : | Stainless Steel stove enameled, black finish, threaded bezel ring, clear glass |

		cover conforming to IP 65.
7.	Dial size	: 150 mm
8.	Scale	: Black lettering on white background in 270 Deg.C arc
9.	Over range protection	: 125 percent of FSD
10.	Capillary Glanding	: 1/2" NPT(M) x compression fitting (SS) to suit capillary
11.	Instrument Connection	: Bottom connection for local mounting, back connection for panel mounting
12.	Process Connection	: 1/2" NPT (M) or 150 RF Flanged
13.	Extension Neck Length	: 50 mm
14.	Compensation	: a) Capillary compensation
15.		: b) Case compensation
16.	Performance	: a) Accuracy : + /- 1.0 percent of full scale Deflection
		: b) Repeatability : Less than 0.5 percent of full range
		: c) Response time: 15 seconds (max.).
17.	Capillary length	: 3.0 meters (local) / 15.0 metres (local panel)
18.	Other features	: Shatter proof glass
19.	Nameplate	: Tag number, service engraved in stainless steel tag plate
20.	Accessories	: SS316 Thermowell
5.04.00	THERMOWELL	
1.	Material	: SS-316
2.	Manufacture	: Drilled from bar stock, Hex Head, Tapered design (As per ASME PTC 19.3)

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

- | | | | |
|-----|------------------------|---|---|
| 3. | Process connection | : | M33x2 |
| 4. | Certification | : | Not applicable |
| 5. | Bore concentricity | : | +5% of wall thickness |
| 6. | Identification mark | : | Tag number punched on head |
| 7. | Surface treatment | : | Polish after machining |
| 8. | Element connection | : | ½" NPT (M) or 150 RF Flanged |
| 9. | Head | : | Hex |
| 10. | Length of the hex head | : | 31.75 mm (min.) |
| 11. | Accessories | : | SS Plug and chain for test thermo wells
SS Nameplate, Flange with companion
flange & all required accessories for
flanged connections. |

Note: Wake frequency calculations shall be furnished for all thermowells for approval.

Thermowells shall be designed such that the resonant frequency is above the exciting frequencies generated by vortex shedding in the process fluid.

5.05.00 METAL TEMPERATURE THERMOCOUPLE

- | | | | |
|----|----------------------------|---|---|
| 1. | Measuring medium | : | Metal temperature |
| 2. | Type | : | Chromel Alumel (Type-K)
Duplex, Ungrounded |
| 3. | Insulation | : | Mineral Insulation Magnesium Oxide |
| 4. | Wire gauge | : | 16 AWG |
| 5. | Protective sheath | : | SS |
| 6. | Protective sheath diameter | : | 8 mm O.D. |
| 7. | Characteristics | : | Special limits of error as in ANSI thermocouple MC 96.01 |
| 8. | Accessories | : | ½" BSP SS sliding end connector, weld pad, clamps of heat resistant steel |

Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS
EPC Bid Document
e-PCT/TS/K/02/2014-15

- | | | | |
|----|----------------|---|-----------------------------|
| 1. | Type | : | Hydrometer Type |
| 2. | Mounting | : | On line |
| 3. | Accuracy | : | +/- 2% of range |
| 4. | Scale | : | Black letter on white scale |
| 5. | End connection | : | PVC flange |

9.06.00 DENSITY/ CONCENTRATION METER

- | | | | |
|----|--------------------|---|---|
| 1. | Wetted Part | | Stainless Steel |
| 2. | Enclosure | | Stainless Steel (IP-65) |
| 3. | Power Supply | | 24 V DC |
| 4. | Output signal | : | 4-20 mA DC (isolated) into 600 ohms |
| 5. | Accuracy | | ±0.001 g/cc |
| 6. | Indication | : | LCD display |
| 7. | Temp. Compensation | : | Integral |
| 8. | Accessories | | Mounting hardware, integral amplifier
(if required), cable glands, tag plate
etc. |

10.00.00 SOLENOID VALVES

- | | | | |
|----|---------------------|---|--------------------------------------|
| 1. | Operating Principle | : | Electromagnetic (noiseless) |
| 2. | Coil voltage rating | : | 240 V AC /24 V DC (as required) |
| 3. | Ways | : | 2/3/4 way |
| 4. | Port size | : | 1/4" NPT all ports |
| 5. | Body | : | SS bar stock |
| | Trim | : | SS-316 |
| 6. | Duty | : | Suitable for continuous energization |
| 7. | Sealing | : | Airtight and leak proof |
| 8. | Ambient Temperature | : | 0 - 50 ° C |

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**

**EPC Bid Document
e-PCT/TS/K/02/2014-15**

-
- | | | | |
|-----|-------------------|---|--|
| 9. | Fluid Temperature | : | 0-150 ° C (approx.) |
| 10. | Coil Enclosure | : | Stainless Steel |
| 11. | Insulation | : | Class-H |
| 12. | Coil Casing | : | IP-65 (Explosion proof for NEC Class-1, Division-1 area) |
| 13. | Mounting | : | On pipe or on panel |
| 14. | Cable Connection | : | ½" NPT |
| 15. | Accessories | : | Cable glands, SS Tag plate |

**Telangana State Power Generation Corporation Ltd.
1x800 MW Kothagudem TPS**
**EPC Bid Document
e-PCT/TS/K/02/2014-15**

5.01.00 Alarms shall be available in the local monitor in the dry room for each unit covering the entire SWAS system, with repeat facility in DDCMIS.

6.00.00 **ANALYZERS**

All Analyzers shall be of microprocessor based design. The general technical specification of the analyzers is provided in this section. Bidder in his offer shall indicate the sample flow requirement of each analyzer and the total quantity of cooling water required for the system.

6.01.00 **CONDUCTIVITY ANALYZER**

A. Sensor

1. Type of Cell : Flow thru'
2. Conductivity Range : As per process
3. Cell Constant : 0.01 / 0.1 / 1.0 depeding upon range
4. Temp. Compensation : Manual and Automatic (Integral) 0-100°C
5. Process Connection : Screwed
6. Wetted Parts : Electrodes-SS 316L/ Insulators KYNAR/ Viton
7. Pressure Rating : 10 kg/cm²
8. Accessories : Vessel (SS 316) with ½" NPT connection
9. Cable : Upto transmitter in flexible conduct

B. Transmitter

1. Type : Microprocessor based, Single stream
2. Mounting : 2" pipe
3. Protection Class : IP-65 or better
4. Output : 4-20 mA DC (isolated)
5. Display : Digital Display in Engineering Unit, Alarm Status.
6. Zero/Span Adjustment : Front Panel Membrane type Keyboard

DEVELOPMENT CONSULTANTS
(e-PCT-TS-K-02-2014-15_V-VI_S VI_SS M.DOC)

V VI/S-VI/SS-M: 8