

BHARTIYA RAIL BIJLEE COMPANY LIMITED
(A JOINT VENTURE BETWEEN NTPC AND INDIAN RAILWAYS)

4x250 MW NABINAGAR TPP

TECHNICAL SPECIFICATION

FOR

GYPSUM DEWATERING SYSTEM
(VACUUM BELT FILTER TYPE)

SPECIFICATION NO.: PE-TS-463-571-A101



BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
PROJECT ENGINEERING INSTITUTE BUILDING
SECTOR-16A, PLOT NO. 25, NOIDA, INDIA

	4x250 MW NABINAGAR TPP		SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM		SECTION	
			REV. 00	
			SHEET : 1 OF 2	
TECHNICAL SPECIFICATION				

CONTENTS**SECTION - I**

SUB-SECTIONS	TITLE		Page No.
Sub-Section-A	INTENT OF SPECIFICATION		2-4
Sub-Section-B	PROJECT INFORMATION		5-29
Sub-Section-C	TECHNICAL SPECIFICATIONS		
	Sub Section-C1	SPECIFIC TECHNICAL REQUIREMENT	30-48
	Sub Section-C2	CUSTOMER SPECIFICATION	49-159
		C2 - A PROJECT SPECIFIC GENERAL REQUIREMENTS INCLUDING:	
		FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	
		GENERAL TECHNICAL REQUIREMENT	
		QUALITY ASSURANCE	
		DRAWINGS / DOCUMENTS SUBMISSION PROCEDURE	
		C2 - B PAINTING SPECIFICATION	
	Sub Section-C3	TECHNICAL SPECIFICATION (ELECTRICAL PORTION)	160-210
	Sub Section-C4	TECHNICAL SPECIFICATION (C&I PORTION)	211-390
Sub Section-D	ANNEXURE-I	LIST OF MAKES OF SUB-VENDOR ITEMS	391
	ANNEXURE-II	MANDATORY SPARE LIST	392-397
	ANNEXURE-III	INSPECTION AND TESTING, QUALITY PLAN	398-418
	ANNEXURE-IV	INPUT DRAWINGS (PID/ MECHANICAL LAYOUT DRAWINGS SHOWING LOCATION OF EQUIPMENT/ PLOT PLAN)	419-435
	ANNEXURE-V	MASTER DRAWING LIST WITH SCHEDULE OF SUBMISSION	436-441
	ANNEXURE-VI	PACKING PROCEDURE	442-445
	ANNEXURE-VII	SEA-WORTHY PACKING PROCEDURE	446-498
	ANNEXURE-VIII	PIPE & VALVE MATERIAL SPECIFICATION	499-504

SECTION - II

SUB SECTIONS	TITLE	Page No.
Sub Section-1	STANDARD TECHNICAL REQUIREMENTS	505-510



4x250 MW NABINAGAR TPP

SPECIFICATION No: PE-TS-463-571-A101

GYPSUM DEWATERING SYSTEM

SECTION

REV. 00

TECHNICAL SPECIFICATION

SHEET : 2 OF 2

SECTION - III

SUB SECTIONS	TITLE	Page No.
Annexure-1	LIST OF DOCUMENTS TO BE SUBMITTED WITH BID	511
Annexure-2	COMPLIANCE CUM CONFIRMATION CERTIFICATE	512-513
Annexure-3	PRE BID CLARIFICATION SCHEDULE	514
Annexure-4	DEVIATION SHEET (COST OF WITHDRAWAL)	515
Annexure-5	SCHEDULE OF GUARANTEES	516-517
Annexure-6	LIST OF MAKES OF SUB VENDOR ITEMS	518
Annexure-7	LIST OF TOOLS & TACKLES	519
Annexure-8	EQUIPMENT DATA SHEET/ SCHEDULE (TO BE FILLED BY BIDDER)	520-527
Annexure-9	LIST OF COMMISSIONING SPARES	528



4x250 MW NABINAGAR TPP

SPECIFICATION No: PE-TS-463-571-A101

GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION

SECTION: I

REV. 00

SECTION - I



4x250 MW NABINAGAR TPP
GYPSUM DEWATERING SYSTEM
TECHNICAL SPECIFICATION

INTENT OF SPECIFICATION

SPECIFICATION No: PE-TS-463-571-A101

SECTION : I

Sub Section: A

REV. 00

SHEET 1 OF 3

SECTION-I
SUB-SECTION-A
INTENT OF SPECIFICATION

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION INTENT OF SPECIFICATION	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		Sub Section: A	
		REV. 00	
		SHEET 2 OF 3	

1.0

INTENT OF SPECIFICATION

1.1

The specification covers Supply part, Services part and Mandatory Spares comprising of design (i.e. Preparation and submission of drawing /documents including “As Built” drawings and O&M manuals), engineering, manufacture, fabrication, assembly, inspection / testing at vendor's & sub-vendor's works, painting, maintenance tools & tackles, , first fill and top-up of lubricants & consumables, mandatory spares along with spares for erection, start-up and commissioning, forwarding, proper packing, shipment and delivery at site, assembly AND Services part covers **supervision services** for erection & commissioning, trial run at site and carrying out Performance guarantee tests at site, training of customer/ client O&M staff covering all aspects of the GDS-Operation & Maintenance (6 days) at Site, training of customer's personnel at manufacturer's works (6 mandays including lodging and boarding) & handover in flawless condition of the package to the customer complete with all accessories for the total scope defined as per BHEL NIT & tender technical specification, amendment & agreements till placement of order for Flue Gas Desulphurization (FGD) plant of **4x250 MW Nabinagar TPP, Aurangabad, Bihar** of M/s Bhartiya Rail Bijlee Company Limited (BRBCL).

1.2

There are four (4) units of each 250 MW and each unit is envisaged with one (1) FGD system. Two (02) Sets of Gypsum Dewatering system (1 working + 1 standby) common for all four units shall be provided.

1.3

The contractor shall be responsible for providing all material, equipment & services, which are required to fulfil the intent of ensuring operability, maintainability, reliability and complete safety of the complete work covered under this specification, irrespective of whether it has been specifically listed herein or not. Omission of specific reference to any component / accessory necessary for proper performance of the equipment shall not relieve the contractor of the responsibility of providing such facilities to complete the supply, erection and commissioning, performance and guarantee/demonstration testing of **GYPSUM DEWATERING SYSTEM**.

1.4

The Bidder shall offer only proven design, which meets the Provenness criteria indicated in the NIT. Necessary documentary evidences shall be submitted along with the bid. If bidder doesn't meet the specified provenness criteria, their bid may not be considered for further evaluation.

1.5

It is not the intent to specify herein all the details of design and manufacture. However, the equipment shall conform in all respects to the highest standards of design, engineering and workmanship and shall be capable of performing the required duties in a manner acceptable to the purchaser who will interpret the meaning of drawings and specifications and shall be entitled to reject any work or material which in his judgement is not in full accordance.

1.6

The extent of supply under the contract includes all items shown in the drawings, notwithstanding the fact that such items may have been omitted from the specification or schedules. Similarly, the extent of supply also includes all items mentioned in the specification and /or schedules, notwithstanding the fact that such items may have been omitted in the drawing. Similarly, the extent of supply also includes all items required for completion of the system for its safe, efficient, reliable and trouble free operation and maintenance shall also be in supplier's scope unless specifically excluded and notwithstanding that they may have been omitted in drawings / specifications or schedules.

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION INTENT OF SPECIFICATION	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		Sub Section: A	
		REV. 00	
		SHEET 3 OF 3	

1.7

The general term and conditions, instructions to tenderers and other attachment(s) referred to elsewhere are made part of the tender specification. The equipment materials and works covered by this specification is subject to the compliance to all attachments referred to in the specification. The bidder shall be responsible for and governed by all requirements stipulated herein.

1.8

While all efforts have been made to make the specification requirement complete & unambiguous, it shall be bidders' responsibility to ask for missing information, ensure completeness of specification, to bring out any contradictory / conflicting requirement in different sections of the specification and within a section itself to the notice of BHEL and to seek any clarification on specification requirement in the format enclosed under Section-III of the specification **within 10 days of receipt of tender documents**. In absence of any such clarification(s), in case of any contradictory requirement, the more stringent requirement as per interpretation of Purchaser / Customer shall prevail and shall be complied by the bidder without any commercial implication on account of the same. Further, in case of any missing information in the specification not brought out by the prospective bidders as part of pre-bid clarification, the same shall be furnished by Purchaser/ Customer as and when brought to their notice either by the bidder or by purchaser/ customer themselves. However, such requirements shall be binding on the successful bidder without any commercial & delivery implication.

1.9

The bidder's offer shall not carry any section like clarification, interpretations and /or assumptions.

1.10

Deviations, if any, should be very clearly brought out clause by clause along with cost of withdrawal in the enclosed schedule (in Section -III); otherwise, it will be presumed that the vendor's offer is strictly in line with NIT specification. If no cost of withdrawal is given against the deviation, it will be presumed that deviation can be withdrawn without any cost to BHEL/it's customer.

1.11

In the event of any conflict between the requirements of two clauses of this specification & requirements of different codes/standards and between respective clauses of sub-section C & sub-section D, more stringent clause as per the interpretation of the owner shall apply.

1.12

In case, all the above requirements are not complied with, the offer may be considered as incomplete and would become liable for rejection.

1.13

For definition of words like Contractor, bidder, supplier, vendor, Customer/ Purchaser / Employer, consultant, please refer relevant clause of General Conditions of Contract (GCC).

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM PROJECT INFORMATION	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		Sub Section : B	
		REV. 00	

SECTION: I

SUB-SECTION: B

PROJECT INFORMATION



SUB-SECTION-II-A11

PROJECT INFORMATION- NABINAGAR 4X250 MW

**LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(1A)-2**

CLAUSE NO.	PROJECT INFORMATION		
1.00.00	BACKGROUND Details of proposed Stage / Units Project name : Nabinagar TPP No. of Units x capacity : 4 x 250 MW Project setting up by : NTPC(FOR BHARTIYA RAIL BIJLEE COMPANY LTD.) The SG with ESP package and TG package of the subject project is being executed by M/s. BHEL.		
1.01.00	LOCATION AND APPROACH Project Location : (i) Place : Nabinagar : (ii) District : Aurangabad : (iii) State : Bihar Latitude and Longitude of project location : North : 24 deg. 42' 30" (N) East : 84 deg. 05' 36" (E) Nearest Railway station : Dehri-On-Sone Distance of project location from the Railway station : 30 KM (Approx.) Nearest MajorTown : Aurangabad Distance of the town from the Project site : 50 KM Nearest CommercialAirport : Gaya Distance of airport from the project site : 100 KM Nearest Highway : National Highway-2 Distance from nearest highway point to the site : 25 KM Vicinity plan : Vicinity plan of the project enclosed at Annexure-I. Any other information : Further to the information given in this sub-section, Bidders are advised to visit the project site and collect data on local site conditions.		
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP
			PAGE 1 OF 29

CLAUSE NO.	PROJECT INFORMATION		
1.02.00	LAND REQUIREMENT Total area of land acquired for the project : 1700 Acres Any other information : Approximately 1700 acres of land has been identified near Dhundhua village for the Plant, Township and Ash Disposal Area. In principle commitment for the availability of land for Plant, Township and Ash Disposal Area has been obtained from Revenue Department, Govt. of Bihar vide letter dated 29.3.2003. Further, Central Coalfields Ltd., (CCL) vide their letter dated 29.05.03 have indicated that Central Mine Planning & Design Institute Ltd (CMPDI) have confirmed that plant location along with its other allied infrastructure are not coming on coal bearing area.		
1.03.00	WATER Nearest Water Source : The project site is located near the river Sone which is the only source of water for the project. Therefore, the make up water requirement for the project is proposed to be drawn from the pondage created by Indrapuri Barrage, which is about 3 kms from the proposed site. Proposed water requirement for the Stage : 60 Cusec Proposed source / arrangement to the meet the water requirement : The project site is located near the river Sone which is the only source of water for the project. Therefore, the make up water requirement for the project is proposed to be drawn from the pondage created by Indrapuri Barrage, which is about 3 kms. from the proposed site. The make up water requirement for the project operating on cooling towers is about 4300 cubic m/hr with ash water recirculation system and about 5900 cubic m/hr. with once through ash water system. Water Resource Department, Govt. of Bihar, accorded in-principle clearance of 60 cusecs of consumptive water from upstream of Indrapuri Barrage vide their letter dated 06.03.03.		
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP PAGE 2 OF 29

CLAUSE NO.	PROJECT INFORMATION			
1.04.00	COAL and WATER, Utility details: (i) Coal Quality Parameters and Fuel Oil Characteristics Source:Pachra and Pachra south blocks in North Karanpura coalfields Requirement: 5 MTPA The Coal quality parameters and Fuel Oil Characteristics are enclosed at Table-1, & Table-2A & 2B of this Sub-Section. Water data (ii) Process water: Process water quality based on COC in Table-3. (iii) Clarified water: Clarified water quality is indicated in Table-3. (iv) DM water for Equipment cooling water system. DM water quality is indicated in Table-4.			
1.05.00	Steam Generator and ESP data: refer Table-5			
1.06.00	Drawings are enclosed as per Table-6 for initial overview to the Bidder.			
2.00.00	NOT USED			
3.00.00	RAILWAY SIDING For bringing the equipment and material to the power house through rail, railway siding is proposed to be constructed from nearest railway station.			
4.00.00	METEOROLOGICAL DATA Meteorological data of the nearest observatory Dehri station is enclosed as Annexure-II to this subsection.			
5.00.00	CRITERIA FOR EARTHQUAKE RESISTANT DESIGN OF STRUCTURES AND EQUIPMENT All structures and equipment shall be designed for seismic forces adopting the site specific seismic information provided in this document and using the other provisions in accordance with IS:1893 (Part 1 to Part 4). Pending finalization of Part 5 of IS:1893, provisions of part 1 shall be read along with the relevant clauses of IS:1893:1984, for embankments. A site specific seismic study has been conducted for the project site. The peak ground horizontal acceleration for the project site, the site specific acceleration spectral coefficients (in units of gravity acceleration 'g') in the horizontal direction for			
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP
PAGE 3 OF 29				

CLAUSE NO.	PROJECT INFORMATION											
	the various damping values and the multiplying factor (to be used over the spectral coefficients) for evaluating the design acceleration spectra are as given at Appendix-I. Vertical acceleration spectral values shall be taken as 2/3rd of the corresponding horizontal values. The site specific design acceleration spectra shall be used in place of the response acceleration spectra, given at figure-2 in IS:1893 (Part 1) and Annex B of IS:1893 (Part 4). The site specific acceleration spectra along with multiplying factors specified in Appendix-I includes the effect of the seismic environment of the site, the importance factor related to the structures and the response reduction factor. Hence, the design spectra do not require any further consideration of the zone factor (Z), the importance factor (I) and response reduction factor (R) as used in the IS:1893 (Part 1 to Part 4). Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: <table><tr><td>Steel structures</td><td>2%</td></tr><tr><td>Reinforced Concrete structures</td><td>5%</td></tr><tr><td>Reinforced Concrete Stacks</td><td>3%</td></tr><tr><td>Steel stacks</td><td>2%</td></tr></table> Method of Analysis Since most structures in a power plant are irregular in shape and have irregular distribution of mass and stiffness, dynamic analysis for obtaining the design seismic forces shall be carried out using the response spectrum method. The number of vibration modes used in the analysis should be such that the sum total of modal masses of all modes considered is at least 90 percent of the total seismic mass and shall also meet requirements of IS:1893 (Part 1). Modal combination of the peak response quantities shall be performed as per Complete Quadratic Combination (CQC) method or by an acceptable alternative as per IS:1893 (Part 1). In general, seismic analysis shall be performed for the three orthogonal (two principal horizontal and one vertical) components of earthquake motion. The seismic response from the three components shall be combined as specified in IS:1893 (Part 1).				Steel structures	2%	Reinforced Concrete structures	5%	Reinforced Concrete Stacks	3%	Steel stacks	2%
Steel structures	2%											
Reinforced Concrete structures	5%											
Reinforced Concrete Stacks	3%											
Steel stacks	2%											
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 4 OF 29									

CLAUSE NO.	PROJECT INFORMATION	
	The spectral acceleration coefficient shall get restricted to the peak spectral value if the fundamental natural period of the structure falls to the left of the peak in the spectral acceleration curve. For buildings, if the design base shear (V_B) obtained from modal combination is less than the base shear ($\bar{V}_B$) computed using the approximate fundamental period (T_a) given in IS:1893:Part 1 and using site specific acceleration spectra with appropriate multiplying factor, the response quantities (e.g. member forces, displacements, storey forces, storey shears and base reactions) shall be enhanced in the ratio of $\bar{V}_B / V_B$. However, no reduction is permitted if $\bar{V}_B$ is less than V_B. For regular buildings less than 12m in height, design seismic base shear and its distribution to different floor levels along the height of the building may be carried out as specified under clause 7.5, 7.6 & 7.7 of IS:1893 (Part 1) and using site specific design acceleration spectra. The design horizontal acceleration spectrum value (A_h) shall be computed for the fundamental natural period as per clause 7.6 of IS:1893 (Part 1) using site specific spectral acceleration coefficients with appropriate multiplying factor given in Appendix-I. Design/Detailing for Ductility for Structures The site specific design acceleration spectra is a reduced spectra and has an in-built allowance for ductility. Structures shall be engineered and detailed in accordance with relevant Indian/International standards to achieve ductility.	
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP
		PAGE 5 OF 29

CLAUSE NO.	PROJECT INFORMATION	एनटीपीसी NTPC	
	APPENDIX – I <u>SITE SPECIFIC SEISMIC PARAMETERS FOR DESIGN OF STRUCTURES AND EQUIPMENT</u> The various site specific seismic parameters for the project site shall be as follows: 1) Peak ground horizontal acceleration : 0.16g 2) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') to obtain the design acceleration spectra a) for ordinary moment resisting steel frames designed and detailed as per IS:800 : 0.04 b) for braced steel frames designed and detailed as per IS:800 : 0.03 c) For special moment resisting RC frames designed and detailed as per IS:456 and IS:13920 : 0.024 d) for RCC chimney : 0.08 e) for Liquid retaining tanks : 0.048 f) for Steel chimney, Absorber tower : 0.06 g) for design of structures not covered under 2 (a) to 2 (f) above and under 3 below : 0.04 3) Multiplying factor to be applied to the site specific horizontal acceleration spectral coefficients (in units of gravity acceleration 'g') for design of equipment and structures where inelastic action is not relevant or not permitted : 0.08 Note: g = Acceleration due to gravity The horizontal seismic acceleration spectral coefficients are furnished in subsequent pages.		
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP
			PAGE 6 OF 29

CLAUSE NO.	PROJECT INFORMATION				
	APPENDIX – I				
	HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS In units of 'g' for New Nabinagar project				
	Time Period (Sec)	Damping Factor (as a percentage of critical damping)			
		2%	3%	5%	
	0.000	1.000	1.000	1.000	
	0.030	1.000	1.000	1.000	
	0.050	1.750	1.607	1.443	
	0.100	3.737	3.060	2.374	
	0.104	3.904	3.174	2.443	
	0.123	3.904	3.401	2.753	
	0.150	3.904	3.401	2.753	
	0.200	3.904	3.401	2.753	
	0.250	3.904	3.401	2.753	
	0.300	3.904	3.401	2.753	
	0.350	3.904	3.401	2.753	
	0.400	3.904	3.401	2.753	
	0.450	3.904	3.401	2.753	
	0.500	3.904	3.401	2.753	
	0.516	3.904	3.401	2.753	
	0.550	3.662	3.401	2.753	
	0.600	3.357	3.142	2.753	
	0.607	3.320	3.105	2.753	
	0.670	3.006	2.813	2.493	
	0.700	2.877	2.693	2.386	
	0.750	2.685	2.513	2.227	
	0.800	2.518	2.356	2.088	
	0.850	2.369	2.218	1.965	
	0.900	2.238	2.094	1.856	
	0.950	2.120	1.984	1.758	
	1.000	2.014	1.885	1.670	
	1.050	1.918	1.795	1.590	
	1.100	1.831	1.714	1.518	
	1.150	1.751	1.639	1.452	
1.200	1.678	1.571	1.392		
1.250	1.611	1.508	1.336		
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	
PAGE 7 OF 29					

CLAUSE NO.	PROJECT INFORMATION				एनटीपीसी NTPC
	APPENDIX – I				
	HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS				
	In units of 'g' for New Nabinagar project				
	Time Period	Damping Factor (as a percentage of critical damping)			
	(Sec)	2%	3%	5%	
	1.300	1.549	1.450	1.285	
	1.350	1.492	1.396	1.237	
	1.400	1.439	1.346	1.193	
	1.450	1.389	1.300	1.152	
	1.500	1.343	1.257	1.113	
	1.550	1.299	1.216	1.077	
	1.600	1.259	1.178	1.044	
	1.650	1.221	1.142	1.012	
	1.700	1.185	1.109	0.982	
	1.750	1.151	1.077	0.954	
	1.800	1.119	1.047	0.928	
	1.850	1.089	1.019	0.903	
	1.900	1.060	0.992	0.879	
	1.950	1.033	0.967	0.856	
	2.000	1.007	0.943	0.835	
	2.050	0.982	0.920	0.815	
	2.100	0.959	0.898	0.795	
	2.150	0.937	0.877	0.777	
	2.200	0.915	0.857	0.759	
	2.250	0.895	0.838	0.742	
	2.300	0.876	0.820	0.726	
	2.350	0.857	0.802	0.711	
	2.400	0.839	0.785	0.696	
	2.450	0.822	0.769	0.682	
	2.500	0.806	0.754	0.668	
	2.550	0.790	0.739	0.655	
	2.600	0.775	0.725	0.642	
	2.650	0.760	0.711	0.630	
2.700	0.746	0.698	0.619		
2.750	0.732	0.685	0.607		
2.800	0.719	0.673	0.596		
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	
PAGE 8 OF 29					

CLAUSE NO.

PROJECT INFORMATION

APPENDIX – I			
HORIZONTAL SEISMIC ACCELERATION SPECTRAL COEFFICIENTS			
In units of 'g' for New Nabinagar project			
Time Period	Damping Factor (as a percentage of critical damping)		
(Sec)	2%	3%	5%
2.850	0.707	0.661	0.586
2.900	0.694	0.650	0.576
2.950	0.683	0.639	0.566
3.000	0.671	0.628	0.557
3.050	0.660	0.618	0.548
3.100	0.650	0.608	0.539
3.150	0.639	0.598	0.530
3.200	0.629	0.589	0.522
3.250	0.620	0.580	0.514
3.300	0.610	0.571	0.506
3.350	0.601	0.563	0.499
3.400	0.592	0.554	0.491
3.450	0.584	0.546	0.484
3.500	0.575	0.539	0.477
3.550	0.567	0.531	0.470
3.600	0.559	0.524	0.464
3.650	0.552	0.516	0.458
3.700	0.544	0.509	0.451
3.750	0.537	0.503	0.445
3.800	0.530	0.496	0.439
3.825	0.527	0.493	0.437
3.850	0.523	0.490	0.434
3.900	0.516	0.483	0.428
3.950	0.510	0.477	0.423
4.000	0.504	0.471	0.418

LOT-IA PROJECTS
FLUE GAS DE-SULPHURIZATION (FGD)
SYSTEM PACKAGE

TECHNICAL SPECIFICATIONS
SECTION-VI, PART-A
BID DOCUMENT NO.: CS-0011-109(1A)-2

SUB-SECTION-II-A11
PROJECT INFORMATION
NABINAGAR TPP

PAGE
9 OF 29

CLAUSE NO.	PROJECT INFORMATION										
6.00.00	<u>CRITERIA FOR WIND RESISTANT DESIGN OF STRUCTURES AND EQUIPMENT</u>										
	All structures shall be designed for wind forces in accordance with IS:875 (Part-3) and as specified in this document. See Annexure – B for site specific information. Along wind forces shall generally be computed by the Peak (i.e. 3 second gust) Wind Speed method as defined in the standard. Along wind forces on slender and wind sensitive structures and structural elements shall also be computed, for dynamic effects, using the Gust Factor or Gust Effectiveness Factor Method as defined in the standard. The structures shall be designed for the higher of the forces obtained from Gust Factor method and the Peak Wind Speed method. Analysis for dynamic effects of wind must be undertaken for any structure which has a height to minimum lateral dimension ratio greater than “5” and/or if the fundamental frequency of the structure is less than 1 Hz. Susceptibility of structures to across-wind forces, galloping, flutter, ovaling etc. should be examined and designed/detailed accordingly following the recommendations of IS:875(Part-3) and other relevant Indian standards. It should be estimated if size and relative position of other structures are likely to enhance the wind loading on the structure under consideration. Enhancement factor, if necessary, shall suitably be estimated and applied to the wind loading to account for the interference effects. Damping in Structures The damping factor (as a percentage of critical damping) to be adopted shall not be more than as indicated below for: <table><tr><td>a) Welded steel structures</td><td>: 1.0%</td></tr><tr><td>b) Bolted steel structures</td><td>: 2.0%</td></tr><tr><td>c) Reinforced concrete structures</td><td>: 1.6%</td></tr><tr><td>d) Steel stacks</td><td>: As per IS:6533 & CICIND Model Code whichever is more critical.</td></tr></table>				a) Welded steel structures	: 1.0%	b) Bolted steel structures	: 2.0%	c) Reinforced concrete structures	: 1.6%	d) Steel stacks
a) Welded steel structures	: 1.0%										
b) Bolted steel structures	: 2.0%										
c) Reinforced concrete structures	: 1.6%										
d) Steel stacks	: As per IS:6533 & CICIND Model Code whichever is more critical.										
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 10 OF 29							

CLAUSE NO.	PROJECT INFORMATION
	 ANNEXURE-B <u>SITE SPECIFIC DESIGN PARAMETERS</u> The various design parameters, as defined in IS: 875 (Part-3), to be adopted for the project site shall be as follows: a) The basic wind speed "V_b" at ten metres above the mean ground level : 47 metres/second b) The risk coefficient "K_1" : 1.07 c) Category of terrain : Category-2 7.00.0 FOUNDATION SYSTEM AND GEOTECHNICAL DATA 7.00.01 Geotechnical data and foundation system for the respective project are enclosed at annexure-III. The corresponding bore logs are enclosed at annexure-IV. 7.00.02 The available soil data is of vicinity of proposed structures, therefore, bidder shall carryout his own detailed soil investigation for facilities under this package and shall be as per the scheme approved by owner. The scheme for geotechnical investigation shall be as given at Clause 7.07.00 and shall be approved by owner before execution. Geotechnical investigation work shall got executed by the Contractor through the agencies as mentioned in Clause No. 7.07.03. However, no time extension shall be given on account of soil investigation carried out by the Bidder. The geotechnical investigation report shall be prepared with detailed recommendations regarding type of foundation and allowable bearing pressure for various structures/ facilities and other soil parameters. The report shall be submitted for Owner's approval prior to commencement of design of foundation. 7.00.03 The Bidder should note that nothing extra whatsoever on account of variation between soil data collected by Owner and that found by the Bidder during geotechnical investigation by him or during execution of works, shall be payable. 7.00.04 Tank Foundations a) The tanks shall rest on flexible tank pad foundation, resting on sand with concrete ring wall to retain sand. Base of the concrete ring wall shall not rest on the expansive soil, if any. b) Entire loose/ soft soil inside the concrete ring wall shall be removed and shall be filled with sand. Sand for filling shall be clean and well graded conforming to IS 383 with grading Zone I to III. c) Sand shall be spread in layers not exceeding 30cm compacted thickness over the area. Each layer shall be uniformly compacted by mechanical means like plate vibrators, small vibratory rollers, etc to achieve a relative density of not less than 80%. d) Other requirements of tank foundations shall be as per IS 803 and as specified elsewhere in the specifications.
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2
SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 11 OF 29

CLAUSE NO.	PROJECT INFORMATION			
7.02.00	Foundation System The requirements for the foundation system to be adopted are as given in subsequent clauses. Depending upon the depth of competent strata/stratum, type of structures, functional requirement of facility, extent of cutting / filling, suitable foundation, open or pile shall be adopted with approval of owner.			
7.02.01	General Requirements a) All structures/equipment shall be supported either on suitable open foundations (isolated, combined, raft) or pile foundations depending on type of structures/facilities, sub-strata, topography etc. b) The roads, ground floor slabs, trenches, pipe pedestals, channels/drain and staircase foundation with foundation loading intensity less than 4 T / M2 may be supported on open / shallow foundations resting on virgin / controlled compacted filled up soil. c) No other foundation (other than as mentioned in (b) above) shall rest on the filled up ground / soil. d) No foundation shall rest on the black cotton soil. e) Before execution of work the bidder shall ensure that there is no obstruction to underground/overground facilities like sewer lines, pipe lines etc. Any such damage and remedial/ rectification measures shall be at the contractors cost. f) Bidder shall also ensure that there is no damage to existing nearby foundations and the foundations pertaining to this package are not placed at shallower depth than the nearby foundations. If required depth of foundation is deeper than the existing foundations, proper protection shall be provided to existing foundations. g) All foundations shall be designed in accordance with relevant parts of the latest revisions of Indian Standards. h) The water table for design purpose shall be considered at Finished Ground Level. i) A combination of open and pile foundations shall not be permitted under the same equipment / structure / building. j) Foundation for equipments on ground floor For equipments of static weight upto 1.5 T, the equipment may be supported on the ground floor slab by locally thickening the slab. Thickening of the ground floor slab shall be done upto an extent of about 0.6 m beyond the plan area of the equipment on all the sides. Further, the load intensity below the equipment shall be limited to 4T/m2. Other requirements of floor slab and compaction below the floor slab shall be adhered, as specified elsewhere in the specifications. For equipment of static weight more than 1.5 T, the equipment foundation shall be taken to the founding level or shall be built up with PCC from the level as mentioned in the Table 1. The pedestal of equipment foundation or the foundation Block shall be isolated from the adjoining floor slab by providing bitumen impregnated fiber board of minimum 50 mm thick, conforming to IS: 1838 all around the equipment pedestal for the full depth of the floor slab.			
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 12 OF 29

CLAUSE NO.	PROJECT INFORMATION			
7.02.02	Open Foundations In case open foundations are adopted, following shall be adhered to. a) The minimum width of foundation shall be 1.0 m. b) Minimum depth of foundation shall be 1.0m below Ground Level. c) It shall be ensured that all foundations of a particular structure/ buildings/ facility shall rest on one bearing stratum. d) Wherever the intended bearing sub-strata is virgin soil stratum but the actual stratum encountered during foundation excavation consists of filled up soil at founding level, under such cases either the foundation shall be lowered completely into the virgin stratum or the filled up soil upto the virgin layers shall be removed and built up through PCC (1:4:8) up to designed foundation level.			
7.02.03	Pile Foundations – (a.) In case piles are adopted, following shall be adhered to : i) The pile foundation shall be of RCC, Cast-in-situ bored piles as per IS:2911. Pile boring shall be done using Rotary Hydraulic Rigs/conventional tripod rig. Two stage flushing of pile bore shall be ensured by airlift technique duly approved by the Employer. If required, temporary or permanent MS liner may be provided for piling. ii) The minimum diameter of pile shall be 600 mm. The allowable load capacity of the pile in different modes (vertical compression, lateral and pullout) shall be as per approved geotechnical report & as enclosed in relevant annexure: iii) Only straight shaft piles shall be used. Minimum cast length of pile above cutoff level shall be 1.0 m. iv) The contractor shall furnish design of piles (in terms of rated capacity, length, diameter, termination criteria to locate the founding level for construction of pile in terms of measurable parameter, reinforcement for job as well as test piles, pile load test arrangement, locations of initial test piles etc.) for Engineer's approval. v) The piling work shall be carried out in accordance with IS:2911 (Relevant part) and accepted construction methodology. The construction methodology shall be submitted by the Contractor for Engineer's approval. vi) Number of initial load tests to be performed for each diameter and rated capacity of pile shall be subject to minimum as under. Vertical Lateral Minimum of 2 Nos. in each mode. Uplift vii) The initial pile load test shall be conducted with test load upto three times the estimated pile capacity. In case of vertical compression test (initial test) the method of loading shall be cyclic as per IS:2911 (relevant part).			
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 13 OF 29

CLAUSE NO.	PROJECT INFORMATION			
	viii) ix) x) xi) xii) xiii)	Load test shall be conducted at pile Cut-off Level (COL). If the water table is above the COL the test pit shall be kept dry throughout the test period by suitable de-watering methods. Alternatively the vertical load test may be conducted at a level higher than COL. In such a case, an annular space shall be created to remove the effect of skin friction above COL by providing an outer casing of suitable diameter larger than the pile diameter. Number of routine pile load tests to be performed for each diameter/allowable capacity of pile shall be as under : i) Vertical : 0.5% of the total number of piles provided. ii) Lateral : 0.5% of the total number of piles provided. The routine tests on piles shall be conducted upto test load of one and half times the allowable pile capacity. Piles for routine load tests shall be approved by the Employer. In case, routine pile load test shows that the pile has not achieved the desired capacity or pile(s) have been rejected due to any other reason, then the Contractor shall install additional pile(s) as required and the pile cap design shall accordingly be reviewed and modified, if required. Testing of piles and interpretation of pile load test results shall be carried out as per IS:2911 (Part-4). Contractor shall ensure that all the measuring equipment and instruments are properly calibrated at a reputed laboratory / institute prior to their use. Settlement / movement of the pile top shall be made by Linear Variable Differential Transducers (LVDT) having a least count of 0.01mm. The test load on initial test piles shall be applied by means of reaction from anchor piles / rock anchors alone or combination of anchor piles / rock anchors and kentledge with concrete blocks.		
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 14 OF 29

CLAUSE NO.	PROJECT INFORMATION			
	xiv) Low Strain Pile Integrity test shall be conducted on all test piles and job piles. This test shall be used to identify the routine load test and not intended to replace the use of static load test. This test is limited to assess the imperfection of the pile shaft and shall be undertaken by an independent specialist agency to be approved by Engineering department of Owner. The test equipment shall be of TNO or PDI make or equivalent. The process shall confirm to ASTM. xv) High Strain Dynamic Load Test may be carried out for routine load testing of working piles. However, at least two numbers of static routine vertical load tests shall be carried out on pile on which high strain dynamic load test has already been carried out for establishing the correlation between the two tests. In case of discrepancy if any between dynamic and static vertical load tests, then additional static routine vertical load tests shall be conducted as decided by the Engineer and the results of static routine vertical load shall prevail. Number of routine vertical pile load tests as per clause 7.02.03 (ix) shall be total of static routine vertical load test and high strain dynamic load tests. The procedure to carryout the test shall be submitted to the Engineer. The test and equipment shall conform to ASTM D4945-00. The test shall be conducted by an experienced independent test agency approved by the owner. Field data shall be submitted to the site engineer and shall include force velocity curves, pile capacity, simulated static load test curve, net and total pile displacement, pile integrity. A (Case pile wave analysis) CAPWAP or equivalent software analysis shall be conducted on the field data for correct capacity estimation and to evaluate end bearing and skin friction components of the pile. xvi) From load considerations, single pile may be used under a column/tower. In that case, pile shall be connected with tie beams at pile cut off level in both directions. xvii) Contribution of frictional resistance of filled up soil if any, shall not be considered for computation of frictional resistance of piles. xviii) Reinforcement for job piles shall be designed as following: (a) Compression + bending piles: For these piles, the allowable safe pile capacities in compression and bending shall be considered. (b) Tension + bending piles: For these piles, the actual pile forces to be considered. However, maximum 3 types of combinations for varying percentage of tension capacity + bending case may be designed & adopted by contractor for the entire scope of work under this package.			
7.03.00	Special Requirements			
7.03.01	Details of treatment for foundations / underground structures required to counteract soil / water chemical environment shall be as per detailed geotechnical investigation to be carried			
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP
PAGE 15 OF 29				

CLAUSE NO.	PROJECT INFORMATION			
	out by contractor. Contractor shall carry out chemical analysis during detailed geotechnical investigation and required treatment shall be provided accordingly.			
7.04.00	Excavation, Filling and Dewatering			
7.04.01	For excavation works, comprehensive dewatering with well point or deep wells arrangement if required, shall be adopted. Scheme for dewatering and design with all computations and back up data for dewatering shall be submitted for the owner's information. The water table shall be maintained at 0.5m below the founding depth.			
7.04.02	Excavation for shallow foundations shall be covered with PCC immediately after reaching the founding level. In case of any local loosening of soil or any loose pockets are encountered at founding level during excavation the same shall be removed and compensated by PCC M7.5. The final layer of about 300 mm thickness above the founding level shall be excavated by suitable means, so as to avoid disturbance to founding stratum.			
7.04.03	Backfilling around foundations, pipes, trenches, sumps, pits, plinths, etc. shall be carried out with approved material in layers not exceeding 300 mm compacted thickness (higher thickness of layers upto 500mm with heavy mechanical compacting equipment) and each layer shall be compacted to 90% of standard proctor density for cohesive soils and to 80% of relative density for non-cohesive soils			
	Rock pieces having size less than 150 mm and interstices filled with soil may be used for backfilling around foundation, plinths etc. and shall be compacted to minimum of 85% of original stack of material after filling the interstices.			
7.04.04	Founding level for trenches/channels shall be decided as per functional requirement. The bottom of excavation shall be properly compacted prior to casting of bottom slab of trenches / channels.			
7.04.05	CBR tests for pavement/road design shall be carried out by the Contractor after earth filling (if applicable) has been completed upto the formation level.			
7.04.06	The contractor shall take all necessary measures during excavation to prevent the hazards of falling or sliding of material or article from any bank or side of such excavation which is more than one and a half meter above the footing by providing adequate piling, shoring, bracing etc. against such bank or sides.			
	Adequate and suitable warning signs shall be put up at conspicuous places at the excavation work to prevent any persons or vehicles falling into the excavation trench. No worker should be allowed to work where he may be stuck or endangered by excavation machinery or collapse of excavations or trenches.			
7.05.00	EXCAVATION IN ROCK			
	Excavation in rock shall be carried out by mechanical means and if blasting is required for founding of some of the structures under this package, control blasting only shall be carried out.			
7.05.01	Controlled blasting shall be done by a specialised agency duly approved by Engineer. All controlled blasting shall be done by using time delay detonators (i.e. excel type).			
7.05.02	a) Contractor shall engage an agency expert in blasting such as, NIRM (National Institute of Rock Mechanics), CMPDIL, Central Institute of Mining and Fuel Research Dhanbad, Dept. of Mining of Govt. Institutions etc. to design detailed blasting scheme and get the same approved from Engineer before carrying out the blasting			
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP
PAGE 16 OF 29				

CLAUSE NO.	PROJECT INFORMATION			
	operation. All blasting shall be done as per the approved blasting scheme & initial blasting operations shall be done under the supervision & guidance of the representative of the blasting expert. b) All the statutory laws, (Explosives Act etc.) rules, regulations, Indian Standards, etc. pertaining to the acquisition, transport, storage, handling and use of explosives, etc. shall be strictly followed. c) The Contractor shall obtain Licenses from Competent Authorities for undertaking blasting work as well as for procuring, transporting to site and storing the explosives as per explosives act. The Contractor shall be responsible for the safe transport, use, custody and proper accounting of the explosive Materials. d) The Contractor shall be responsible and liable for any accident and injury / damage which may occur to any person or property of the project or public on account of any operations connected with the storage, transportation, handling or use of explosive and blasting operations.			
7.06.00	Sheeting & Shoring The contractor shall ascertain for himself the nature of materials to be excavated and difficulties, if any, likely to be encountered in excavation while executing the work. Sheet piling, sheeting and shoring, bracing and maintaining suitable slopes, drainage, etc. shall be provided and installed by the Contractor, to the satisfaction of the Engineer.			
7.07.00	Geotechnical Investigation The Contractor shall carry out detailed geotechnical investigation in the areas under his scope for establishing the sub-surface conditions and to decide type of foundations for the structures envisaged, construction methods, any special requirements/treatment called for remedial measures for sub-soil/ foundations etc. in view of soft sub-soils, aggressive sub-soils and water, expansive/swelling soils etc. prior to commencement of detailed design/drawings. The Contractor shall obtain the approval for the field testing scheme proposed by him from the Owner before undertaking the geotechnical investigation work.			
7.07.01.00	Scheme of geotechnical Investigation			
7.07.02.01	Field test shall include but not be limited to the following: Boreholes, Standard Penetration Test (SPT), Dynamic Cone Penetration Test (DCPT), collection of disturbed samples (DS) and undisturbed soil samples (UDS), Trial Pits (TP), Plate Load Tests (PLT), Electrical Resistivity Test (ERT), In situ field permeability tests, collection of water samples, etc.			
7.07.02.02	The diameter of borehole shall be minimum 150 mm in soil and 76 mm in rock. The diameter of UDS sampler shall be 100 mm minimum. Core drilling in rock shall be done by using hydraulically feed rotary drill & double tube core barrel with diamond bit.			
7.07.02.03	The minimum tests are indicated in Clause No. 7.08.00. Adequate number of tests shall be conducted up to sufficient depth for complete determination of subsoil conditions. The depth of boreholes shall be as specified in Appendix A. SPT shall be carried out in all types of soil deposits and in all rock formations with core recovery up to 20%, met within a borehole. This test shall be conducted at every 3.0 m interval or at change of strata, up to the final depth. SPT 'N' of 100 and above shall be referred as refusal. UDS shall be collected at every 3.0 m interval or at change of strata up to depth of borehole. UDS may be replaced by additional SPT, if SPT'N' value in the strata is above 50.			
7.07.02.04	Laboratory tests shall be done as per relevant IS codes. The laboratory tests, not be limited to the following shall be conducted on disturbed and undisturbed soil samples, rock samples & water samples collected during field investigations in sufficient numbers.			
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP
PAGE 17 OF 29				

Page 24 of 528

CLAUSE NO.	PROJECT INFORMATION				
	2	Crusher House	Minimum 2 Nos.	Depth of boreholes shall be 25m to 35m.	boreholes shall be as mentioned in column "Depth of Borehole" or 5m continuous in rock with RQD > 25% whichever is earlier.
	3	Gypsum and Lime storage area	Minimum 10 Nos.	Depth of boreholes shall be 15m to 25m	
	4	Other Structure/Facility	Minimum 2 Nos. boreholes under each area / facility	15 to 20 m	
	5	Chimney	Minimum 2 Nos.	30 to 35m	
	b) Other Field Tests (Minimum)				
	1	Cyclic Plate Load Test (CPLT)	3nos	Test Depth from 2 to 4 m	
	2	Trial Pit (TP)	5 Nos.	Depth - 3 m	
	3	In Situ Permeability Test In Boreholes	In minimum 3 Nos. of boreholes	Tests shall be conducted at depths of 1.0m, 3.0m, 5.0m, 8.0m and 12.0m.	
	4	ERT	Minimum 10 Nos.		
	• Depth and location of Boreholes and other field tests (PLT, ERT, field permeability tests etc.) shall be approved by Owner before execution of geotechnical investigation work. • Investigation in any other building / structure / facilities / trestles which are not mentioned above shall also be carried out, if required, by the bidder for the facilities under his scope.				
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 19 OF 29

CLAUSE NO.	PROJECT INFORMATION	एनटीपीसी NTPC																							
	Annexure-III SOIL DATA AND FOUNDATION SYSTEM Employer has carried out geotechnical investigation in the areas near to this package. Logs of representative boreholes to be used for bidder's information in the vicinity of proposed area are enclosed with this Annexure-II. The bidder is required to carry out geotechnical investigation as per the clause no. 7.07.00 and ascertain the pile capacity and bearing capacity. The onus of correct assessment / interpretation and understanding of the existing subsoil condition / data is on the Bidder. Ground water table is encountered at a depth of about 11.0 to 13.0m below natural ground level (NGL) at the time of investigation. Fluctuation may occur in ground water table due to seasonal variation. The natural ground level is varying as per enclosed contour/spot level drawing. a) The foundation system to be adopted for different structures shall be as given in Table – i below Table – i: Net Allowable Bearing Pressure <table><tr><th>STRUCTURE</th><th>TYPE OF FOUNDATION TO BE ADOPTED</th></tr><tr><td>FGD and related structures</td><td>Open/Piles</td></tr></table> b) During design the Allowable Bearing Pressure shall be as furnished in Table-ii. Bidder is required to carry out geotechnical investigation in this area. The allowable bearing pressure shall be adopted after approval of geotechnical investigation report by owner. However, the maximum allowable bearing pressure shall be as per the approved geotechnical report and shall be limited to the values as furnished in Table-ii. Table – ii: Net Allowable Bearing Pressure <table><tr><th rowspan="3">Structure</th><th rowspan="3">Founding Level in RL</th><th colspan="3">Net Allowable Bearing Pressure T/m²</th></tr><tr><th colspan="2">Isolated / Strip</th><th rowspan="2">Rafts (width > 6m) for 75mm settlement</th></tr><tr><th>width upto 6 m for 25mm settlement</th><th>Width upto 6m for 40mm settlement</th></tr><tr><td rowspan="2">FGD and related structures</td><td>2.5 m below NGL</td><td>8.0</td><td>9.0</td><td>10.0</td></tr><tr><td>3.5 m</td><td>10.0</td><td>12.0</td><td>14.0</td></tr></table>	STRUCTURE	TYPE OF FOUNDATION TO BE ADOPTED	FGD and related structures	Open/Piles	Structure	Founding Level in RL	Net Allowable Bearing Pressure T/m ²			Isolated / Strip		Rafts (width > 6m) for 75mm settlement	width upto 6 m for 25mm settlement	Width upto 6m for 40mm settlement	FGD and related structures	2.5 m below NGL	8.0	9.0	10.0	3.5 m	10.0	12.0	14.0	
STRUCTURE	TYPE OF FOUNDATION TO BE ADOPTED																								
FGD and related structures	Open/Piles																								
Structure	Founding Level in RL	Net Allowable Bearing Pressure T/m ²																							
		Isolated / Strip		Rafts (width > 6m) for 75mm settlement																					
		width upto 6 m for 25mm settlement	Width upto 6m for 40mm settlement																						
FGD and related structures	2.5 m below NGL	8.0	9.0	10.0																					
	3.5 m	10.0	12.0	14.0																					
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 20 OF 29																						

CLAUSE NO.	PROJECT INFORMATION					
		below NGL				
		4.5 m below NGL	12.0	15.0	17.0	
	The net allowable bearing pressure higher than above mentioned values shall not be permitted. At intermediate levels the bearing capacity shall be same as the net allowable bearing pressure corresponding to the immediate shallower level mentioned above.					
	c) Permissible Settlement of Foundations: For open foundations, the total permissible settlement and differential settlement shall be governed by IS: 1904 and from functional requirements whichever is more stringent. However, total settlement shall be restricted to the following:					
	Isolated, Strip & Raft (Mill foundations/machine foundation)		25 mm			
Isolated & Strip (Other than Mill foundations/machine foundation)		40 mm				
Raft (widths greater than 6 m) (Other than Mill foundations/machine foundation)		75 mm				
In case the total permissible settlement is to be restricted to less than as above specified from functional requirements, then the net allowable bearing pressure shall be reduced after review in consultation with Engineer.						
d)	The diameter of pile, minimum length and maximum allowable capacity of piles shall be as given below:					
Area/ Location		Pile Diameter (mm)	Minimum Length of Bored Pile Below Cut-off Level (m)	Safe Load Capacity in		
				Vertical Comp. (MT)	Pullout (MT)	Lateral (MT)
FGD and related structures		600	18.0	140.0	45.0	7.0
		760	19.0	250	75.0	12.5
- Cut off Level (COL) is assumed at 3.0 m below FGL (RL(+) 127.0m). If the COL is shallower than the assumed COL, then the length of the pile shall be increased accordingly.						
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP		PAGE 21 OF 29

CLAUSE NO.	PROJECT INFORMATION																						
e)	The criteria for Pile Termination (founding level) shall be as given below: The termination level of the pile shall be decided based on the following criterion i) Minimum length of the pile below COL (cut off level) shall be as specified above ii) The minimum pile length for each group of piles shall be determined based on the nearest borelog. Pile shall be socketed into yellowish weathered sand stone. A socketing length of four (4) times the diameter of the pile into rock with rock core recovery $\geq 20\%$ shall be ensured for 600 mm & 760 mm dia piles. For pile termination, SPT 'N' values shall be used from the nearby borelog data. The boreholes are in the bidder's scope and shall be conducted as per the enclosed scheme. iii) However, in no case the length of pile shall be less than the minimum length determined as in (i) or (ii) above whichever is longer, for that pile group.																						
g)	Special Requirements: i) Chemicals in ground water and subsoil, as observed during investigation are: <table><tr><th>Chemical</th><th>SO₃</th><th>Chlorides</th><th>pH</th></tr><tr><td>Ground Water</td><td>18 to 30 ppm</td><td>50-82 ppm</td><td>7.26 – 7.44</td></tr><tr><td>Sub-soil</td><td>0.011 to 0.023 %</td><td>0.02 to 0.064 %</td><td>7.3 – 7.62</td></tr></table> ii) In view of the above, the following shall be adopted. <table><tr><td>Cement Type</td><td>As specified elsewhere in the specifications</td></tr><tr><td>Concrete Grade</td><td>As specified elsewhere in the specifications</td></tr><tr><td>Type of Reinforcement</td><td>As specified elsewhere in the specifications</td></tr><tr><td>Cover to Reinforcement</td><td>As specified elsewhere in the specifications</td></tr></table>	Chemical	SO ₃	Chlorides	pH	Ground Water	18 to 30 ppm	50-82 ppm	7.26 – 7.44	Sub-soil	0.011 to 0.023 %	0.02 to 0.064 %	7.3 – 7.62	Cement Type	As specified elsewhere in the specifications	Concrete Grade	As specified elsewhere in the specifications	Type of Reinforcement	As specified elsewhere in the specifications	Cover to Reinforcement	As specified elsewhere in the specifications		
Chemical	SO ₃	Chlorides	pH																				
Ground Water	18 to 30 ppm	50-82 ppm	7.26 – 7.44																				
Sub-soil	0.011 to 0.023 %	0.02 to 0.064 %	7.3 – 7.62																				
Cement Type	As specified elsewhere in the specifications																						
Concrete Grade	As specified elsewhere in the specifications																						
Type of Reinforcement	As specified elsewhere in the specifications																						
Cover to Reinforcement	As specified elsewhere in the specifications																						

LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 22 OF 29
---	---	--	------------------

CLAUSE NO.	PROJECT INFORMATION			एनडीपीसी NTPC
	Table-3			
	DESIGN CLARIFIED WATER ANALYSIS			
	S.No	Constituent	As	mg/l (except pH & turbidity)
	1.	Calcium	CaCO ₃	131
	2.	Magnesium	CaCO ₃	52
	3.	Sodium + Potassium	CaCO ₃	65
	4.	Total Cations	CaCO ₃	248
	5.	Chloride	CaCO ₃	20
	6.	Sulphate	CaCO ₃	93
	7.	Nitrate	CaCO ₃	10
	8.	Alkalinity	CaCO ₃	125
	9.	Total Anions	CaCO ₃	248
	10.	Iron(total)	Fe	0.3
	11.	Total Silica	SiO ₂	22
	12.	pH value	---	7.0-8.2
13.	Turbidity	NTU	10	
Note: Clarified water is used for CW system as make up & the CW system is expected to operate at about 5.0 – 5.5 Cycles of Concentration (COC) with suitable chemical treatment program using acid, scale & corrosion inhibitor dosing. As CW blow down water is tapped from CW system, the water quality of CW blow down shall accordingly be arrived by the bidder.				
Table-4				
ANALYSIS OF DM WATER				
Sl.No.	Characteristics	Value		
1.	Silica (Max.)	0.02 ppm as SiO ₂		
2.	Iron as Fe	Nil		
3.	Total hardness	Nil		
4.	pH value	6.8 to 7.2		
5.	Conductivity	Not more than 0.1 µs/cm		
LOT-IA PROJECTS FLUE GAS DE-SULPHURIZATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-II-A11 PROJECT INFORMATION NABINAGAR TPP	PAGE 27 OF 29

	4x250 MW NABINAGAR TPP GYP SUM DEWATERING SYSTEM TECHNICAL SPECIFICATION	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		Sub Section : C	
		REV. 00	

SECTION: I

SUB SECTION: C

TECHNICAL SPECIFICATION

	4x250 MW NABINAGAR TPP	SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM	SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 1 OF 18	
	TECHNICAL SPECIFICATION		
	SPECIFIC TECHNICAL REQUIREMENT		

SECTION: I

SUB-SECTION: C 1

SPECIFIC TECHNICAL REQUIREMENT

	4x250 MW NABINAGAR TPP		SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SECTION : I	
			SUB-SECTION : C1	
			REV. 00	
			SHEET 2 OF 18	

1.1	FUNCTION
------------	-----------------

The purpose of the specification is to provide complete Gypsum Dewatering System (GDS) for 4x250 MW NABINAGAR TPP, under the scope of this tender.

1.2	TECHNICAL INFORMATION
------------	------------------------------

1.2.1	Quantity of Gypsum De-Watering System	Two (2) Set (one working + one standby)
1.2.2	Capacity of the Gypsum De-Watering System	33.8 Tones per hour (wet cake) minimum at outlet of Vacuum Belt Filter for each Belt Filter
1.2.3	Moisture content	10% (Max)
1.2.4	Gypsum purity	≥ 90% (SHALL BE ENSURED BY BHEL)
1.2.5	Chloride content	< 100 ppm

2.1	SCOPE OF SUPPLY & SERVICES
------------	---------------------------------------

The specification covers Supply part, Services part and Mandatory spares comprising of design (i.e. Preparation and submission of drawing /documents including “As Built” drawings and O&M manuals), engineering, manufacture, fabrication, assembly, inspection / testing at vendor's & sub-vendor's works, painting, maintenance tools & tackles, first fill and top-up of lubricants & consumables, mandatory spares along with spares for erection, start-up and commissioning, forwarding, proper packing, shipment and delivery at site, assembly AND services part covers **supervision services for** erection & commissioning, trial run at site and carrying out Performance guarantee tests at site, training of customer/ client O&M staff covering all aspects of the GDS- Operation & Maintenance, Troubleshooting etc., training of customer/ client O&M staff covering all aspects of the GDS- Operation & Maintenance (6 days) at Site, training of customer at manufacturer's works (6 mandays including lodging and boarding) & handover in flawless condition of the package to the customer complete with all accessories

Design: Broadly includes basic engineering, detail engineering, preparation and submission of engineering drawings/calculations/datasheets/quality assurance documents/field quality plans, storage instructions, commissioning procedures, Erection & assembly Drawings, operation & maintenance manuals, performance guarantee test procedures and assisting BHEL in obtaining time bound approval from customer.

Supply: Broadly includes manufacturing/fabrication, shop floor testing, stage inspections, final inspections, painting, packing & forwarding.

Services: Broadly includes supervision services for erection & commissioning, trial run at site and carrying out Performance guarantee tests at site, training of customer/ client O&M staff covering all aspects of the GDS- Operation & Maintenance (6 days) at Site, training of customer at manufacturer's works (6 mandays including lodging and boarding) & handover in flawless condition of the package to the customer.

2.1.1 The scope of supply for Gypsum Dewatering System shall include but not limited to the following:

- 2.1.1.1 Primary hydro cyclone: Two (2) sets
- Hydrocyclone clusters
 - Anchor bolts, nuts and washers

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 3 OF 18	

iii.

Flanges for inlet and overflow

iv.

A variety size of vortex finders for the entire hydro cyclone

v.

Accessory piping within the skid

vi.

Piping, valves, instruments as per the terminal points defined elsewhere in the specification

2.1.1.2

Secondary hydro cyclone: Two (2) sets

i.

Hydrocyclone clusters

ii.

Anchor bolts, nuts and washers

iii.

Flanges for inlet and overflow

iv.

A variety size of vortex finders for the entire hydro cyclone

v.

Accessory piping within the skid

vi.

Piping, valves, instruments as per the terminal points defined elsewhere in the specification

2.1.1.3

Vacuum belt filters complete with Accessories including discharge chute up to the gypsum conveyor skirt board, driving motors (IE3) inverter duty with VFD and inverter panel: Two (2) numbers

2.1.1.4

Vacuum receivers with Anchor bolts, nuts and washers: Two (2) numbers

Filtrate extraction pumps (4 nos., 2 nos./receiver tank: 1 working + 1 stand by) shall be provided. Refer Scheme No. PE-FEP-00 for the typical Scheme of the arrangement The extraction system of the filtrate complete with pumps, valves, instruments and accessories along with associated supports, fasteners, gaskets etc. with drive (IE3 motor). Also, bidder to include all connection bolts/nuts/washers for installation. Required instruments and any safety device shall be supplied.

Bidder to include the same in the P&ID scheme and submit the same for the approval of BHEL/BRBCL.

2.1.1.5

Vacuum pumps with drive (IE3 motor), all connection bolts/nuts/washers for installation, required instruments and any safety device: Two (2) numbers

Bidder to consider the requirement of the vertical seal water sump pumps (2 nos., 1 working + 1 stand by) in his scope for pumping the water expended from the Vacuum pump(s) to the Cake Wash Tank(s).

Civil work of the sump shall be in BHEL scope and inputs shall be provided by the bidder.

The system shall be complete with pumps, valves, instruments and accessories along with associated supports, fasteners, gaskets etc. with drive (IE3 motor). Also, bidder to include all connection bolts/nuts/washers for installation. Required instruments and any safety device shall be supplied.

Bidder to include the same in the P&ID scheme and submit the same for the approval of BHEL/BRBCL.

2.1.1.6

Vent fan including enclosure and its arrangement: Two (2) numbers

	4x250 MW NABINAGAR TPP	SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 4 OF 18	
2.1.1.7 Complete arrangement for cloth and cake washing (excluding tanks & their Instruments), pumps with motors (IE3), associated piping, valves, spray nozzles & accessories: One (1) set* Two (2) nos. of belt filter wash tanks and Two (2) nos. cake washing tanks are envisaged for both the belt filters as per drawing no. 0270-109-PVM-F-020 (Sheet 7-10 of 15). Each tank shall be provided with 2 nos. (1 working + 1 standby) of wash pumps. Suitable arrangement for the washing of belt filter cloth and gypsum cake including piping/ valves/ instruments etc. shall be provided by the bidder. The Scope of supply of Wash tank(s) with inlet/outlet nozzle is in BHEL scope. Instrumentation on tank(s) is excluded from the bidder scope. Inlet piping along with associated instruments/ valves from process water and clarified water Terminal points (TP) to the tanks inlet nozzles, Process water and clarified water Outlet piping from the tanks outlet nozzles for cake wash and belt wash comprising of the wash pumps, their motors (IE3) along with associated instruments/ valves etc. shall be in the bidder scope. However, bidder scope shall be limited to the Engineering as per clause 2.1.1.9 (ii) (g) of this sub-section for the overflow and drain of the tanks. 2.1.1.8 Coupling with guards, wherever applicable: One (1) set* 2.1.1.9 Piping, Valves and accessories (i) Complete engineering and supply of interconnected piping (slurry, air and water pipes) along with valves, rubber lining (wherever applicable, shall be supplied in erectable condition i.e., no rubber lining to be done at Site), instruments, valves, supports, gaskets, fasteners and accessories which is integral to Gypsum Dewatering System – One (1) set* which is broadly defined below: a. Slurry piping from Primary hydro cyclones underflow to Vacuum Belt Filters b. Filtrate piping from Vacuum belt filters to Vacuum receivers and further up to the extraction pumps discharge. c. Air piping from vacuum receivers to vacuum pumps to atmosphere d. Vacuum pumps seal water / drain water pipes to/ from wash tanks. Supply of seal water to vacuum pump shall be provided through clarified water pump as specified in P & ID. Seal water drain from vacuum pump shall be collected in sump pit and shall be routed back to clarified water tank through seal water sump pump. As mentioned at clause 2.1.1.5 above. e. Process water and clarified water piping from TP outside building to wash tanks. f. Instrument air piping from TP outside building up to equipment related to the system (ii) Scope of below-mentioned interconnected piping (slurry, air and water pipes) along with valves, rubber lining (wherever applicable), instruments, valves, supports, gaskets, fasteners and accessories which is non-integral to Gypsum dewatering system is limited to engineering only and supply shall be made by BHEL. Engineering includes layout & routing of pipes, preparation of isometric drawing and BOQ: a. Primary hydro cyclone feed tank outlet to the inlet flange of Primary hydro cyclones along with recirculation piping to feed tank			

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 5 OF 18	

b. Primary hydro cyclones over flow to Inlet of secondary hydro cyclone feed tank

c. Secondary hydro cyclone feed tank outlet to inlet flange of secondary hydro cyclones along with recirculation piping to feed tank

d. Secondary hydro cyclones underflow to filtrate tank

e. Secondary hydro cyclones overflow to inlet flange of wastewater tank

f. receiver drain through filtrate extraction pumps (bidder scope) to Filtrate tank and other associated drain of vacuum belt filters to filtrate tank Vacuum

g. overflow and drain piping of cake wash tanks and cloth wash tanks.

2.1.1.10 Instruments/Valves for the entire gypsum dewatering system including integral piping as defined at 2.1.1.9 above (minimum requirement for each gypsum dewatering system is given in the P&ID): One (1) set*

2.1.1.11 Electric common including but not limited to

i. Local control panel, if required

ii. LV, HT Motors (as applicable)

iii. Junction Box

iv. Instruments

v. Push buttons

2.1.1.12 Expansion Joints at suction and discharge of each pump/other equipment, as applicable: One (1) Set*

2.1.1.13 All motors shall be provided with suitable double compression cable gland.

Bidder shall provide cable glands and lugs for all equipment in his scope. Cables shall be terminated using double compression type cable glands and solder less crimping type tinned copper cable lugs.

Bidder shall provide junction box. The Junction box shall have provision for installing glands of suitable size on the bottom of the box.

2.1.1.14 Control System: Control system shall be DDCMIS/ DCS, which shall be BHEL scope. Each equipment shall be furnished with required instrumentation and electrical accessory devices mounted and connected to a junction box.

2.1.1.15 **SIGNALS**

2.1.1.15.1 Alarm Signal:

a) Bearing temperature high

2.1.1.15.2 Interlock signal:

a) Belt filter wash tank level low

b) Cake wash tank level low

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 6 OF 18	
Bearing Temperature Transmitter for initiating alarm during when “Bearing temperature high” shall be supplied by Bidder. Bearing temperature transmitter shall be provided with local display also. Bearing temperature transmitter (with 2V3 logic) shall be provided for HT motors (> 200 KW) at both the driving and non-Driving ends. Similarly, Vibration transmitters (with 2V3 logic) for measuring vibration in X & Y axis have to be provided for at the driving and Non-driving end for HT Motors.			
2.1.1.16 Lubricants & Consumables: All the first fill and one year’s toppings requirements of consumables such as grease, oil, lubricants, servo fluids etc. which will be required to put the equipment covered under the scope of specifications into successful commissioning/initial operation and to establish completion to facilities should be provided by contractor/supplier. Refer Clause 7.0 of this sub-section for details.			
2.1.1.17 Painting and rust prevention during shipment and construction.			
2.1.1.18 Seaworthy packing & forwarding to project site. Refer project information specified elsewhere in the specification. This is applicable where the equipment is coming through sea route. Otherwise, packing specification of equipment of Indian origin will be followed.			
2.1.2 Services to be provided by the bidder: (i) Detailed Erection and commissioning procedure shall be submitted by successful bidder for carrying out the erection and commissioning at site by BHEL. (ii) Supervision for Erection & Commissioning, trial run at site (iii) Performance guarantee tests at site & handover in flawless condition of the package to the customer (iv) Training of customer/ client O&M staff covering all aspects of the GDS- Operation & Maintenance (6 days) at Site (v) Training of customer at manufacturer’s works (6 man-days) including lodging and boarding) (vi) Visits shall be planned by BHEL site team and prior intimation shall be sent to supplier for visit to site for supervision services. Bidder shall be informed at least 10 days in advance for the requirement of visit at site. Visiting team shall consist of one or two expert of bidder as deemed necessary by them.			
2.1.3 Mandatory spares as defined as Annexure-II, Sub Section-D of Section I.			
2.1.4 Recommended spare parts list to be furnished (is not part of scope of supply)			
2.1.5 Any other items required not covered above but required for the completeness of the system; it shall be included in the offer and shall be supplied by the Bidder/supplier. Bidder shall refer to the P&ID enclosed in Annexure-IV, Sub-Section-D of Section-I for the items under the bidder’s scope. All the items indicated in the P&ID are minimal requirements.			
Wherever () is marked, one (1) set means complete requirement for both the gypsum dewatering system.			

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 7 OF 18	

2.2 PROCESS DESCRIPTION	
1.	Common gypsum dewatering system is envisaged for all four units. The dewatering system shall receive the gypsum slurry from Primary Hydro cyclone feed pumps (BHEL Scope). Gypsum dewatering system shall be suitable for handling slurry from all four FGD units. Two sets of primary hydrocyclone (1W+1S) with accessories shall be in vendor scope. Primary hydrocyclone underflow shall be taken to Vacuum Belt Filter (VBF) inlet.
2.	The overflow from the primary sets of hydro-cyclone shall be taken to a secondary hydro-cyclone feed tank (BHEL Scope). Secondary Hydro cyclone feed pumps (BHEL Scope) shall transfer the slurry from tanks to secondary hydro cyclone. Two sets of Secondary hydro cyclones (1 working+1 stand by) and its accessories shall be in vendor scope.
3.	The underflow from the secondary hydro-cyclone shall be taken to the filtrate water tank. The over flow from the secondary hydro-cyclone shall be taken to a waste water storage tank.
4.	Two nos. of belt filter wash tanks & Two nos. of cake wash tanks along with rubber lining (BHEL Scope) are envisaged for both the belt filters. Each tank shall be provided with 2 nos. of pumps of suitable requirement.

2.3 TERMINAL POINTS	
1.	Primary hydro cyclone feed slurry will be provided by BHEL at the inlet flange of the primary hydro cyclone.
2.	Primary hydro cyclone overflow launder outlet flange. Further piping by BHEL to secondary hydrocyclone feed tank.
3.	Secondary hydro cyclone feed slurry will be provided by BHEL at the inlet flange of secondary hydro cyclone.
4.	Secondary hydro cyclone underflow launder outlet flange and overflow launder outlet flange. Further piping by BHEL to waste water and filtrate tank.
5.	Outlet at filtrate extraction pumps discharge expansion joints and TP near VBF for other drain of such as cloth wash, dyke drain etc.
6.	Process water, Clarified water & instrument air will be provided at one location, located at 5 m from building boundary. Further piping from terminal point to GDS system utilities are in bidder's scope.
7.	Discharge of Gypsum through discharge chute onto the gypsum belt conveyor is in bidder's scope. Please refer enclosed P&IDs, typical layout & preliminary elevation drawing of GDS building for the details in the scope.

2.4 For Electrical scope, refer Electrical specification (Sub-section- C3 of Section-I).

2.5 For Control & Instrumentation (C&I) scope, refer C&I specification (Sub-section- C4 of Section-I).

3.0 CODES & STANDARDS AND OTHER REQUIREMENTS	
3.1	In addition to the codes and standards specifically mentioned in the relevant technical specifications for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India as well as of the locality where they will be installed, including the following: a) Indian Electricity Act b) Indian Electricity Rules c) Indian Explosives Act

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 8 OF 18	

d) Indian Factories Act and State Factories Act

e) Indian Boiler Regulations (IBR)

f) Regulations of the Central Pollution Control Board, India

g) Regulations of the Ministry of Environment & Forest (MoEF), Government of India

h) Pollution Control Regulations of Department of Environment, Government of India

i) State Pollution Control Board.

(j.) Rules for Electrical installation by Tariff Advisory Committee (TAC).

(k.) Building and other construction workers (Regulation of Employment and Conditions of services) Act, 1996

(l.) Building and other construction workers (Regulation of Employment and Conditions of services) Central Rules, 1998

(m.) Explosive Rules, 1983

(n.) Petroleum Act, 1984

(o.) Petroleum Rules, 1976,

(p.) Gas Cylinder Rules, 1981

(q.) Static and Mobile Pressure Vessels (Unified) Rules, 1981

(r.) Workmen's Compensation Act, 1923

(s.) Workmen's Compensation Rules, 1924

(t.) Safety Rules for Construction and Erection

(u.) Safety Policy

(v.) Any other statutory codes / standards / regulations, as may be applicable.

3.2 Unless covered otherwise in the specifications, the latest editions (as applicable as on date of bid opening), of the codes and standards given below shall also apply:

a) Bureau of Indian standards (BIS)

b) Japanese Industrial Standards (JIS)

c) American National Standards Institute (ANSI)

d) American Society of Testing and Materials (ASTM)

e) American Society of Mechanical Engineers (ASME)

f) American Petroleum Institute (API)

g) Standards of the Hydraulic Institute, U.S.A.

h) International Organization for Standardization (ISO)

i) Tubular Exchanger Manufacturer's Association (TEMA)

j) American Welding Society (AWS)

k) National Electrical Manufacturers Association (NEMA)

l) National Fire Protection Association (NFPA)

m) International Electro-Technical Commission (IEC)

n) Expansion Joint Manufacturers Association (EJMA)

o) Heat Exchange Institute (HEI)

p) IEEE standard

q) JEC standard

3.3 Other International/ National standards such as DIN, VDI, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the BHEL Customer's approval, for which the bidder shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases, the bidder shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word-to-word translation of the standard that is normally not published in English.

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 9 OF 18	

- 3.4 Two (2) English language copies of all national and international codes and/or standards used in the design of the plant and equipment shall be provided by the Contractor to the Employer within two calendar months from the date of the Notification of Award.
- 3.5 In case of any change in codes, standards & regulations between the date of bid opening and the date when vendors proceed with fabrication, the BHEL shall have the option to incorporate the changed requirements or to retain the original standard. It shall be the responsibility of the Contractor to bring to the notice of BHEL such changes and advise BHEL of the resulting effect.
- 3.6 All items of equipment shall comply with the stipulations of Inspectorate of Factories and other statutory bodies of Government of India and Chief Electrical Inspectorate of the State in which the plant site is located, wherever applicable. Wherever required, the successful bidder has to obtain the necessary approvals from statutory authorities and other concerned agencies. All cost on these accounts shall be borne by the successful Bidder.

4.0	DETAILED TECHNICAL SPECIFICATION
4.1	DETAILED SPECIFICATION
4.1.1	Bidder shall supply two stage gypsum dewatering system consisting of primary hydro cyclones, vacuum belt filters (VBF) and secondary hydro cyclones for dewatering of gypsum from absorber to less than 10% moisture at the design capacity specified elsewhere in the specification.
4.1.2	Bidder shall supply 2x100% gypsum dewatering system with each stream sized to dewater 33.8 TPH (Wet cake) at outlet of VBF produced by the all four FGD units operating at design point. All other stipulations with respect to sizing and design of the dewatering system, auxiliaries and other systems shall be in line with this specification.
4.2	Hydro-cyclones
4.2.1	Two (2) sets of primary hydro cyclones are envisaged, each set shall be sized to dewater the gypsum slurry produced by the unit operating at design point.
4.2.2	Each set of primary hydro-cyclone shall be provided with 10% spare hydro-cyclones. The capacity defined in the previous clause shall be met with spare hydro-cyclones out of service.
4.2.3	The primary hydro-cyclone shall be installed directly above the belt filters. The overflow of the primary hydro-cyclones shall be taken to secondary hydro-cyclone feed.
4.2.4	Two (2) sets of secondary hydro cyclones are to be installed, each set shall be sized to dewater the gypsum slurry produced by all four FGD units operating at design point.
4.2.5	Both primary and secondary hydro-cyclones shall be of modular construction. It shall be possible to remove and replace individual hydro-cyclone with the set in service. Individual isolation valve shall be provided for each hydro-cyclone for this purpose.
4.2.6	The hydro-cyclone shall be of proven design and shall be provided with replaceable rubber lining. The feed chamber, overflow and underflow chamber shall be made of carbon steel of adequate thickness with a rubber lining of minimum 12 mm thickness. Liners shall have a minimum wear life of not less than 7000 hours .
4.2.7	All Hydro Cyclones clusters shall be made of polyurethane or urethane material only.
4.3	Vacuum Belt Filters
4.3.1	Two (2) numbers of vacuum belt filters each of capacity 33.8 TPH (Wet cake) at the outlet of each VBF are envisaged. Each vacuum belt filter shall be sized to meet the following requirements, all occurring together, with an inlet solid concentration of not more than

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 10 OF 18	

	45% or outlet of hydro-cyclones whichever is minimum: ▪ Outlet Moisture: 10% (maximum) ▪ Gypsum Purity: 90% (minimum) (SHALL BE ENSURED BY BHEL) ▪ Chloride content: < 100 ppm
4.3.2	The Vacuum Belt Filters shall have the following characteristics: a) Very rigid frame and rolls, no deformation whatsoever may occur. b) All rolls shall be installed perfectly horizontally c) There shall be no vacuum under the slurry deposition zone. d) Deposit thickness control and directional stability control e) The slurry shall be put on the belt in counter current relative to the rotation of the band. f) The vacuum chambers shall be easily opened for inspection and cleaning.
4.3.3	The vacuum belt filter shall be proven design in operation for similar capacities. The filter cloth shall be polyester or polypropylene as per the proven design of the supplier and shall be guaranteed for a minimum life of not less than 7000 hours .
4.3.4	The complete frame of the filter and all parts in contact with gypsum shall be made of corrosion resistant material or shall be provided with corrosion resistant liners of proven design.
4.3.5	In case, the contractor offers a design with an underlying belt for carrying the filter cloth, the same shall be endless, factory vulcanized rubber belts. The belt shrouds and the sealing belts shall provide a leak tight arrangement to prevent overflow of gypsum slurry. The sealing belt shall have minimum life of not less than 7000 hours .
4.3.6	The vacuum box shall ensure tight sealing with the belt/cloth and shall be of proven design.
4.3.7	The belt filter shall have an automatic cloth tracking mechanism and shall be provided with all required instrumentation as per the bidder’s proven practice. The belt filter shall have an automatic cloth tensioning mechanism. Pull chord switches shall be provided for each vacuum belt filter. Four (04) no.’s of Belt sway switches shall be provided for each vacuum belt filter. Cake thickness sensors with double redundancy shall be provided for each vacuum belt filter which shall control the speed of the vacuum belt filter in turn.
4.3.8	Differential Pressure indicator shall be provided at the discharge line of Belt filter wash Pump for each vacuum Belt filter. Flow indicator shall be provided for cloth washing line of each vacuum belt filter. Flow indicator shall be provided for cake washing line of each vacuum belt filter as per P&ID enclosed.
4.3.9	The filter shall be provided with minimum 2 stages of cake washing for removing impurities in the gypsum. One stage of cloth washing arrangement shall also be provided.
4.3.10	The filtrate from gypsum slurry and from cake washing shall be taken to a separate vacuum receiver tank(s) as per the proven practice of the supplier. Each belt filter shall have an independent vacuum pump.
4.3.11	Gypsum cake from each belt filter shall be discharged through a hopper onto belt conveyor being provided by the Employer.
4.3.12	A 2 m (min.) wide platform shall be provided around each belt filter for easy approach & maintenance. The elevation of discharge point of vacuum belt filter shall be as per the Gypsum Dewatering Building Drawing provided in the Annexure-IV Sub Section-D of Section-I. Any changes for optimization of the layout shall be suggested by Bidder accordingly.
4.3.13	The service factor of the gear unit (if any) shall be minimum 1.5.
4.3.14	Piping and wiring within the skid should be in the vendor’s scope.

	4x250 MW NABINAGAR TPP		SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SECTION : I	
			SUB-SECTION : C1	
			REV. 00	
			SHEET 11 OF 18	

4.3.15	All client end connection flanges shall be ANSI B 16.5/AWWA.
4.4	Vacuum System
4.4.1	The filtrate from each belt filter, cake washing & cloth washing shall be taken to separate receiver tank(s) as per the supplier’s proven practice. Each belt filter shall be provided with an independent vacuum pump sized to meet the requirements of the belt filter operating at its maximum capacity. An additional 10% margin over the above shall be provided in each vacuum pump.
4.4.2	Each Vacuum pump shall have its own piping system, which connects the pump with the associated vacuum belt filter. Bidder to provide Equipment layout and General Arrangement (GA) of Gypsum dewatering building along with the offer.
4.4.2	The vacuum pump shall be of low speed liquid ring type of proven design. The design of the vacuum pumps shall avoid cavitation under all operating conditions.
4.4.3	The seals shall be of proven design.
4.4.4	Silencers shall be provided, if required, to limit the noise level to values stipulated elsewhere in this specification.
4.4.5	The vacuum receiver and pump internals shall be suitably lined to protect against the corrosive environment. The material selected for vacuum pumps & vacuum receivers shall be proven for similar application and shall be subject to approval of BHEL/BRBCL.
4.4.6	Each vacuum receiver tank(s) shall be provided with slide plate type pneumatic vacuum breaker. The plate shall be stainless steel with a min. thickness of 3 mm.
4.4.7	The filtrate extraction pump shall be capable of pumping filtrate water with solid concentration of not less than 10% and particle lumps of 6-7 mm. A 10% margin shall be provided in each of the pump.
4.5	COMMON REQUIREMENTS FOR PUMPS (VACUUM PUMP, FILTRATE BELT FILTER, CAKE WASH)
4.5.1	All the pump wear parts in contact with the slurry shall be provided with replaceable rubber/elastomer liners suitable for the fluid handled. The Bidder can also offer a hi-chrome alloy line pump if the Bidder has previous experience of the same for similar applications. The material used by the contractor shall be proven in previous installations.
4.5.2	The pump shall be provided with seals of proven type and shall be designed for minimization of seal water consumption. The shaft shall be supported on heavy-duty ball/roller bearings.
4.5.3	All pumps shall be designed to withstand a test pressure of 1.5 times the maximum possible pump shut off pressure under maximum suction pressure conditions.
4.5.4	Product water flushing lines and drains are to be supplied for each pump handling the prevailing water to avoid corrosion if the pump is out of operation for extended periods.
4.5.5	Pumps must be carefully set to ensure that the net positive suction head available under all operating conditions will be adequate. The NPSH Values are to be referred to the least favorable operating conditions- lowest atmospheric pressure, lowest level of water on the suction side of the pump and highest temperature of the pumped fluid. An adequate safety margin of normally greater than 1 m to the max NPSH required shall be provided.
4.5.6	All pumps shall be fitted with suction and discharge pressure gauges. Pressure gauges shall be with diaphragm seal for slurry application. Pressure gauges for other medium shall be with gate valves. All the wetted parts shall be SS 316 or equivalent.
4.5.7	Venting valve shall be fitted to all pumps at suitable points on the pump casing unless the pump is self-venting due to the arrangement of the suction and discharge nozzles. Drainage facilities shall be provided on the pump casing or adjacent pipe work to facilitate the dismantling of pumps.

	4x250 MW NABINAGAR TPP		SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SECTION : I	
			SUB-SECTION : C1	
			REV. 00	
		SHEET 12 OF 18		
4.5.8	Design pumps not to be damaged during reverse rotation at up to 150% of design RPM, at full discharge head in the event that a pump trips while the other operating pump remain on line.			
4.5.9	Pumps shall have stable head-capacity characteristics curve from run-off to shut-off. Shut-off head should be 115% of Best Efficiency Point (BEP).			
4.5.10	Selection of Duty point should preferably be at BEP (Best Efficiency Point) or slightly at the left of BEP. Selection of Duty point beyond 115% of BEP will not be acceptable. It should be noted that head variation is due to level variation in tank. Pump has to run in the system without compromising its NPSH requirement at lowest water level in tank. Hence, when tanks are filled-up and are at normal water level, pump will operate at the right of BEP, pump's operating zone should be considered accordingly.			
4.5.11	External flushing is required to remove the accumulated particles and all related information should be mentioned in datasheet.			
4.5.12	Pump should have adjustment provision of axial clearance between casing and impeller for maintenance of performance at best efficiency when there is wear in between impeller and casing.			
4.5.13	In case rubber or nonmetallic linings are used, these will be two piece molded under pressure and adjusted to the screwed metallic clamping which have been welded to the casting.			
4.5.14	Each pump will have a coupling of adequate size, designed for full load and capable of supporting start –up on overload moments. Each half of the coupling will be factory mounted and locked to its shaft. The coupling must be able to accept the adjustment of the impeller.			
4.5.15	The pumps shall have mechanical seals of cartridge type with self-lubrication sliding ring cartridges. The static part will be mounted on the seal plate with circumferential ring (O-ring) or another flexible sealing ring. Built in seal design will not be accepted.			
4.5.16	The sealing areas shall be designed in such a way so that solids do not precipitate in them or affect the cooling or affect the adjustment and mechanical functioning of the seals. Seals which do not need jet cleaning are preferred.			
4.5.17	Pump induced vibration due to flow pulsations shall be avoided through suitable design.			
4.5.18	Each rotating equipment shall be first statically balanced and then dynamically balanced according to ISO 1940 (in the case of impellers this shall be done before and after mounting of the service rotor shaft).			
4.5.19	The material and thickness of the liners of slurry pumps shall ensure a minimum service life of 2 years before replacement. All the wear parts of the pump shall be guaranteed for a minimum wear life of not less than 14000 hours.			
4.5.20	Coupling halves shall be machine matched to ensure accurate alignment. Couplings must have a rated capacity of at least 120% of the maximum potential power transmission requirement.			
4.5.21	All rotating parts such as coupling shall be covered with suitable protective guards. Guards shall be easily removable type. Coupling shall be of flexible type made of cast steel. The bidder shall furnish both halves of the coupling. Both the Coupling halves shall be bored and keyed to fit shafts of the pump and the motor by bidder. The coupling between shafts shall be so designed that they become tight during pump operation.			
4.5.22	A common base plate shall be provided for pump assembly & Motor and the same shall be rigidly constructed, adequately braced and provided with finish pads for mounting pump.			
4.5.23	Pump manufacturer is to supply base plate along with Foundation bolt & Nut, “Taper wedge” and the necessary fastener for Pump and Motor with Base plate.			

	4x250 MW NABINAGAR TPP		SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SECTION : I	
			SUB-SECTION : C1	
			REV. 00	
			SHEET 13 OF 18	
4.5.24	Nameplate: All equipment shall be provided with name plates indicating the item number and service name. Nameplates shall be of 304 Stainless steel plate and placed at a readily visible location. Nameplate of main equipment shall have enough information, which will be confirmed during engineering phase. Stainless steel nameplates for all instruments and valves shall be provided.			
4.5.25	Rotation arrows shall be cast in or attached with stainless steel plate on each item of rotation equipment at a readily visible location.			
4.5.26	Unless otherwise specified, all equipment items where the weight exceeds 15 kg shall be provided with suitable lifting lugs, ears or ring bolts or tapped holes for lifting rings. Minimum shock factor for lifting lugs shall be 2.0. The position of lifting lugs and reference dimension shall be shown on GA and/or outline drawings. NDT shall be conducted for lifting lugs. When any spreader bars are required for lifting and laydown, the bidder shall provide spreader bar with equipment.			
4.5.27	Skid Mount/Transportation: Equipment shall be fabricated as skid mount design as much as practical to minimize erection at the site.			
4.5.28	Two pieces of stainless-steel earth lugs shall be provided with equipment diagonally. The position of earth lugs shall be shown on each GA and/or outline drawing.			
4.5.29	Provide double nuts for anchor bolts.			
4.5.30	Bidder shall provide allowable vibration level on foundation in foundation drawings and/or general arrangement drawings.			
4.5.31	If the driver/driven equipment train is in the resonance condition or any vibration problems occur, the bidder shall solve the problems in a timely manner.			
4.5.32	Bidder shall provide the mating flanges with the necessary gaskets.			
4.5.33	All the surfaces of the carbon steel should be rust prevented before shipment for the period of at least 12 months for storage and construction.			
4.5.34	Bidder to provide capacity of crane or hoist required for safe material handling and the details of heaviest component to be handled.			
4.5.35	Bidder to provide Pipe & Valve Material as per the Annexure VIII, Sub-Section-D, Section-I of the Specification.			
4.5.36	A 1000 mm wide platform with suitable approach shall be provided by the bidder for each hydro cyclone.			
4.5.37	A 1500 mm space around all the pumps shall be provided by the bidder.			
4.5.38	Equipments requiring monitoring during regular operation shall be approachable from the ground floor through staircase. Staircase with minimum width of 1200 mm shall be provided for approach to elevated structures at 5 m height from the nearest platform. Below this height, a vertical ladder with minimum clear width of 600 mm may also be acceptable.			
4.5.39	The list of all Bought out items with makes and country of origin and contact details of the manufacturers to be mentioned along with offer to be submitted. Acceptance of makes shall be subject to BHEL's Customer's acceptance during the detailed engineering without cost and delivery implication to BHEL.			

	4x250 MW NABINAGAR TPP		SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT		SECTION : I	
			SUB-SECTION : C1	
			REV. 00	
			SHEET 14 OF 18	

5.0	PIPING & INSTRUMENTATION DIAGRAMS (P&IDs)
-----	---

The Piping and Instrumentation Diagram are enclosed in in Annexure-IV, Sub-Section-D of Section-I.

5.1 PROCESS PARAMETERS FOR PRIMARY HYDROCYCLONE - OPERATION POINT							
Sl. No.	Parameters	Primary Cyclone Slurry	Hydro Feed	Primary Cyclone Flow	Hydro Over	Primary Cyclone Flow	Hydro Under
a.	Total Flow (m ³ /hr.)	106.384		61.468 (*1)		44.916 (*1)	
b.	Total Flow (t/hr.)	128.904		68.084 (*1)		60.82 (*1)	
c.	Operating Temp (C)	61.6		61.6		61.6	
d.	Design Temp (C)	70		70		70	
e.	Solid (wt. %)	30		16.6 (*1)		> 45 (*2)	
f.	Density (Kg/m ³)	1212		1108 (*1)		1354 (*1)	
g.	pH	4-7		4-7		4-7	
h.	Cl ⁻ (mg/l)	<25000		<25000		<25000	
5.2 PROCESS PARAMETERS FOR SECONDARY HYDROCYCLONE - OPERATION POINT							
Sl. No.	Parameters	Secondary Hydro cyclone – Feed Slurry	Secondary Hydro cyclone– Overflow	Secondary Hydro cyclone – Under flow			
a.	Total flow (m ³ /hr)	61.468 (*1)	38.42 (*1)	23.044 (*1)			
b.	Total flow (t/hr)	68.084 (*1)	39.16 (*1)	28.936 (*1)			
c.	Operating Temp (°C)	61.6	61.6	61.6			
d.	Design Temp (°C)	70	70	70			
e.	Solid (% wt.)	16.6 (*1)	3 (*2)	35 (*1)			
f.	Density (kg/m ³)	1108 (*1)	1019	1256			
g.	pH	4-7	4-7	4-7			
h.	Cl ⁻ (mg/l)	<25000	<25000	<25000			
5.3 DATA SHEET OF BELT FILTER - OPERATION POINT							
Sl. No.	Parameters	Belt Filter Feed Slurry	Product Gypsum	Filtrate	Washing **	Water	
a.	Total Flow (m ³ /hr)	44.916 (*1)					
b.	Total Flow (t/hr)-Wet	60.82 (*1)	30.712				
c.	Design Temp (°C)	70.0					
d.	Solid (% wt.)	>45 (*2)	>90 (*2)	<0.2			
e.	Density kg/m ³	1354 (*1)					
f.	pH	4~7	5~8				
g.	Cl	<25000	<100 ppm (*2)				
h.	Belt filter and the peripherals shall be designed at 33.8 TPH (wet cake) discharge of product gypsum a. **Quantity of water shall be finalized by the vendor. Property of process water (Clarified water) is given below.						
i.	(*1) shall be finalized by vendor. (*2) Shall be guaranteed by vendor.						



4x250 MW NABINAGAR TPP

GYPSUM DEWATERING SYSTEM

TECHNICAL SPECIFICATION

SPECIFIC TECHNICAL REQUIREMENT

SPECIFICATION No: PE-TS-463-571-A101


SECTION : I

SUB-SECTION : C1

REV. 00

SHEET 15 OF 18

5.4 GYPSUM PARTICLE SIZE AT HYDRO CYCLONE FEED SLURRY IS SHOWN BELOW:

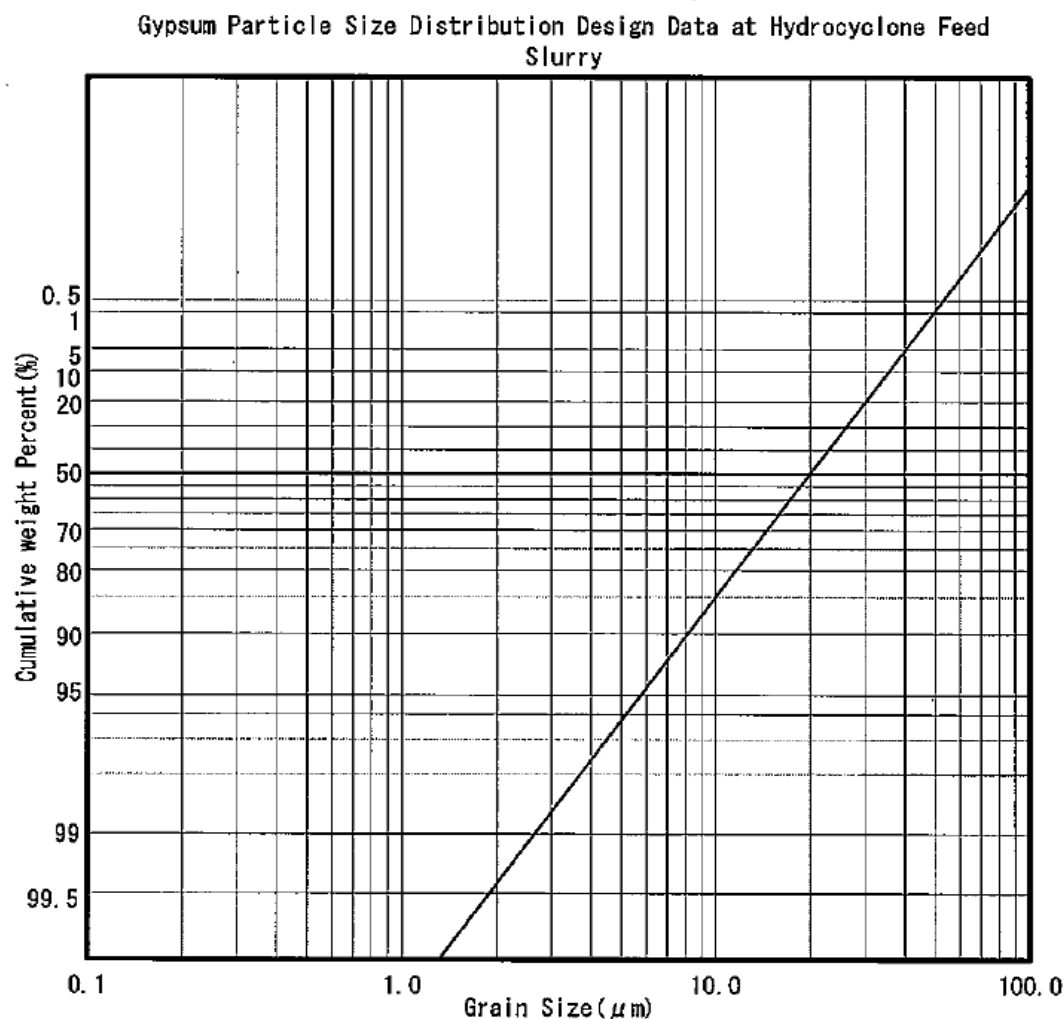

Note:

1. Vendor to submit the PSD based on their design for PHC & SHC underflow and overflow
2. Hydro cyclone backpressure shall not exceed 20m H

5.5 GYPSUM PARTICLE SIZE AT BELT FILTER FEED SLURRY IS SHOWN BELOW:

Vendor to submit PSD graph design data at VBF inlet / PHC outlet.

5.6 DESIGN CONDITIONS OF PRIMARY & SECONDARY HYDRO CYCLONES:

1	Primary Hydrocyclone quantity	:	2 sets (1W+1SB)
2	Secondary Hydrocyclone quantity	:	2 sets (1W+1SB)
3	Primary Hydrocyclone capacity	:	117 m ³ /hr each
4	Secondary Hydrocyclone capacity	:	68 m ³ /hr each
5	Type of Hydrocyclone	:	Vertical
6	Material (MOC) of Cyclone Clusters	:	Polyurethane/Urethane
7	MOC of Feed Chamber	:	CS+12 mm rubber lining
8	MOC of Overflow Chamber	:	CS+12mm rubber lining
9	MOC of Underflow Chamber	:	CS+12mm rubber lining



4x250 MW NABINAGAR TPP

GYPSUM DEWATERING SYSTEM

TECHNICAL SPECIFICATION

SPECIFIC TECHNICAL REQUIREMENT

SPECIFICATION No: PE-TS-463-571-A101

SECTION : I

SUB-SECTION : C1

REV. 00

SHEET 16 OF 18

5.7	CLARIFIED WATER (USED FOR CAKE WASHING) CHARACTERISTICS		
S.No.	Constituents	Unit	Water quality
1.	Calcium as CaCO ₃	ppm	131
2.	Magnesium as CaCO ₃	ppm	52
3.	Sodium + Potassium as CaCO ₃	ppm	65
4.	Iron as Fe	ppm	0.3
5.	Total alkalinity as CaCO ₃	ppm	125
6.	Chlorides as CaCO ₃	ppm	20
7.	Sulphate as CaCO ₃	ppm	93
8.	pH		7.0 – 8.2
9.	Turbidity	NTU	10
10.	Nitrate as CaCO ₃	ppm	10
11.	Total Anions CaCO ₃	ppm	248
12.	Total Cations CaCO ₃	ppm	248
13.	Total Silica SiO ₂	ppm	22

5.8	PROCESS WATER (USED FOR BELT WASHING) CHARACTERISTICS		
S.No.	Constituents	Unit	Water quality
1.	Calcium as CaCO ₃	ppm	131 X 5.5
2.	Magnesium as CaCO ₃	ppm	52 X 5.5
3.	Sodium + Potassium as CaCO ₃	ppm	65 X 5.5
4.	Iron as Fe	ppm	0.3 X 5.5
5.	Total alkalinity as CaCO ₃	ppm	125 X 5.5
6.	Chlorides as CaCO ₃	ppm	20 X 5.5
7.	Sulphate as CaCO ₃	ppm	93 X 5.5
8.	pH		8.5
9.	Turbidity	NTU	50
10.	Nitrate as CaCO ₃	ppm	10 X 5.5
11.	Total Anions CaCO ₃	ppm	248 X 5.5
12.	Total Cations CaCO ₃	ppm	248 X 5.5
13.	Total Silica SiO ₂	ppm	22 X 5.5

6.0	SPARES, TOOLS & TACKLES
6.1	START UP & COMMISSIONING SPARES

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 17 OF 18	

	Start-up & Commissioning Spares shall be part of the main supply of the GDS. Start-up & commissioning spares are those spares which may be required during the start-up and commissioning of the equipment/system. All spares required for successful operation till commissioning of GDS shall come under this category. Bidder shall provide an adequate stock of such start-up and commissioning spares to be brought by him to the site for the equipment erection and commissioning. The spares must be available at Site before the equipment’s are energized. List shall be furnished by bidder along with bid as indicated at Section-III.
6.2	MANDATORY SPARES
	a) The list of mandatory spares considered essential by the BHEL’s Customer/Employer is indicated in Annexure-II of Sub Section-D of Section-I in the specification. The bidder shall indicate the prices for each and every item (except for items not applicable to the bidder’s design) in the ‘Schedule of Mandatory Spares’ whether or not he considers it necessary for the Employer to have such spares. If the bidder fails to comply with the above or fails to quote the price of any spare item, the cost of such spares shall be deemed to be included in the contract price. The bidder shall furnish the population per unit of each item in their Bid. Whenever the quantity is mentioned in “sets”, the bidder has to give the item details and prices of each item. b) Whenever the quantity is indicated as a percentage, it shall mean percentage of total population of that item in the station (project), unless specified otherwise, and the fraction will be rounded off to the next higher whole number. One set for the particular equipment. e.g. ‘set’ of bearings for a pump would include the total number of bearings in a pump. Also the ‘set’ would include all components required to replace the item; for example, a set of bearings shall include all hardware normally required while replacing the bearings. c) The assembly / sub assembly which have different orientation (like left hand, right hand, top or bottom), different direction of rotation or mirror image positioning or any other regions which result in maintaining two different sets of spares to be used for subject assembly / sub-assembly shall be considered as different type of assembly/sub-assembly. d) The prices of mandatory spares indicated by the Bidder in the Bid Proposal sheets shall be used for bid evaluation purposes. Bidder to provide the split up price for mandatory spares during placement of order as per price format.
6.3	RECOMMENDED SPARES:
	In addition to the spare parts mentioned above, the bidder shall also provide a list of recommended spares for 3 years of normal operation of the plant and indicate the list. This list shall take into consideration the mandatory spares specified in this Sub-Section and should be independent of the list of the mandatory spares.
6.4	SPECIAL TOOLS & TACKLES:
	Any special tools & tackles required for the entire equipment to disassemble, assemble or maintain the units, they shall be included in the quotation and furnished as part of the initial supply of the machine. List of special tools & tackles shall be decided by bidder as per his proven practice. When special tools are provided, they shall be packaged in separate, boxes with lugs and marked as “Special Tools for (tag / item number).” Each tool shall be stamped

	4x250 MW NABINAGAR TPP	SPECIFICATION No: PE-TS-463-571-A101	
	GYPSUM DEWATERING SYSTEM	SECTION : I	
		SUB-SECTION : C1	
		REV. 00	
		SHEET 18 OF 18	
	TECHNICAL SPECIFICATION		
	SPECIFIC TECHNICAL REQUIREMENT		

	or tagged to indicate its intended usage. Levers and eye bolts for the removal of parts to be serviced shall be submitted with special tools. List shall be furnished by bidder along with bid as indicated at Section-III.
--	---

7.0	FIRST FILL OF CONSUMABLES
------------	----------------------------------

7.1	Bidder's scope shall include supply and filling of all chemicals, lubricants, grease, filters and consumable items for operation up to commissioning including top up requirements. All lubricants proposed for the plant operation shall be suitable for all operating and environmental conditions that will be met on site consistent with good maintenance procedures as instructed in the maintenance manuals.
7.2	Bidder shall also supply a quantity not less than 10% of the full charge or One (1) year of top-up requirement (whichever is higher) of each variety of lubricants, servo fluids, gases, chemicals etc. (as applicable) used which is expected to be utilized during the first year of operation. This additional quantity shall be supplied in separate containers.
7.3	Detailed specifications for the lubricating oil, grease, gases, servo fluids, control fluids, chemicals including items qualities and quantities required per month of the plant operation for the Customer/BHEL's approval herein shall be furnished within 2 months of placement of Order. On completion of erection, complete list of bearings/equipment giving their location and identification marks shall be furnished to BHEL along with lubrication requirements. All types of chemicals, consumables, lubricants and grease shall be readily obtainable locally and the number of different types shall be kept to a minimum. For each type and grade of lubricant recommended, bidder shall list at least three equivalent lubricants manufactured by alternative companies.

8.0	LIST OF REFERENCE DRAWINGS BY BHEL
------------	---

The drawings specified in in Annexure-IV, Sub-Section-D of Section-I are being provided along with the tender specification for estimation and calculation purpose of the bidder.

9.0	PAINTS /PAINTING
------------	-------------------------

Bidder shall follow BHEL/ Customer painting philosophy specified Sub-Section- C2-B Section-I in the specification. An approved painting Schedule (Drawing No. 0270-109-PVM-H-001, R1) is provided. However, for components where no specific requirement is stipulated, the bidder shall follow its standard practice suitable for operating condition and subject to customer approval.

10.0	EXCLUSIONS
-------------	-------------------

Below are excluded from scope of the GDS Supplier:

- All utilities such as instrument air, process water and clarified water up to terminal point
- Control System (excluding Junction box)
- Cranes & Hoists for Material handling
- 3D Modeling
- Gypsum Conveyor from the discharge of chute

11.0	BID EVALUATION CRITERIA FOR POWER CONSUMPTION
-------------	--

Bidder is required to quote GPC in the price schedule issued along with tender.

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION SPECIFIC TECHNICAL REQUIREMENT	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C 2	
		REV. 00	

SECTION: I
SUB-SECTION: C 2
CUSTOMER SPECIFICATION

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION PROJECT SPECIFIC GENERAL REQUIREMENTS	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C 2A	
		REV. 00	

SECTION: I

SUB-SECTION: C 2A

CUSTOMER SPECIFICATIONS

PROJECT SPECIFIC GENERAL REQUIREMENTS



SUB-SECTION-VI

FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES

LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(1A)-2

एनटीपीसी
NTPC

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
2.02.00	Test Instrumentation, Flow Measurement and their Calibration			
2.02.01	All instruments required for performance testing shall be of the type and accuracy required by the code and prior to the test, the Contractor shall get these instruments calibrated in an independent test Institute approved by the Employer and submit the same to Employer prior to commencement of test. All test instrumentation required for performance tests shall be supplied by the Contractor and shall be retained by him upon satisfactory completion of all such tests at site. All calibration procedures and standards shall be subject to the approval of the Employer prior to commencement of test. The protecting tubes, pressure connections and other test connections required for conducting guarantee test shall conform to the relevant codes. Tools and tackles, thermowells (both screwed and welded) instruments/devices including flow devices, matching flanges, impulse piping & valves etc. and any special equipment, required for the successful completion of the tests, shall be provided by the Contractor free of cost. The Performance test shall be carried out as per the agreed procedure. The detailed PG test procedure shall be submitted within 90 days of the date of Notification of Award and finalization of the PG test procedure shall be done within 180 days from the date of Notification of Award.			
2.02.02	The P&G test procedures shall be submitted for equipments/system & subsystem under Contractor's scope for all Guarantees as mentioned below, as per latest International codes / standard including correction curves, meeting the specification requirements along with sample calculations & detailed activity plan of preparation (including test instrumentation), conductance and evaluation of Guarantees.			
2.02.03	The Contractor shall submit for Employer's approval the detailed Performance Test procedure containing the following: (a) Object of the test. (b) Various guaranteed parameters & tests as per contract. (c) Method of conductance of test and test code. (d) Duration of test, frequency of readings & number of test runs. (e) Method of calculation. (f) Correction calculations & curves. (g) Instrument list consisting of range, accuracy, least count, and location of instruments.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 2 OF 24

एनटीपीसी
NTPC

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
3.00.00	Accept the equipment /system/ plant after levying Liquidated Damages. The liquidated damages for shortfall in performance indicated in clause 3.00.00 of this sub-section shall be levied separately for each unit. The rates indicated in clause 3.00.00 of this sub-section are on per unit basis. The liquidated damages shall be pro-rated for the fractional parts of the deficiencies. (ii) For Category-II Guarantees In case during performance guarantee test(s) it is found that the equipment/system has failed to meet the guarantees, the Contractor shall carry out all necessary modifications and/or replacements to make the equipment/system comply with the guaranteed requirements at no extra cost to the Employer and re-conduct the performance guarantee test(s) with Employer's consent. In case the specified performance guarantee(s) are still not met even after the above modifications/replacements within ninety (90) days or a reasonable period allowed by the Employer, after the tests have been completed, the Employer will have the right to either of the following: Reject the equipment /system / plant and recover from the Contractor the payments already made. OR Accept the equipment/system after assessing the deficiency in respect of the various ratings, performance parameters and capabilities and recover from the contract price an amount equivalent to the damages as determined by the Employer. Such damages shall, however be limited to the cost of replacement of the equipment(s)/system(s), replacement of which shall remove the deficiency so as to achieve the guaranteed performance. These parameters/capacities shall be termed as "Category-II" Guarantees.			
	AMOUNT OF LIQUIDATED DAMAGES (LD) APPLICABLE FOR GUARANTEES FOR EACH PROJECT The rate of liquidated damages and acceptable shortfall limits for different guarantees shall be as under and such liquidated damages shall be deducted from the Contract Price of the project.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2		SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES PAGE 4 OF 24

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
	<u>NABINAGAR JV BIHAR-I (3X660 MW)</u>			
	Sl.No	Guarantee	Rate of Liquidated Damage (LD)	Acceptable Shortfall Limit with LD
	i)	For shortfall in guaranteed SO ₂ removal efficiency in percentage points under conditions stipulated in clause 4.01.00 (i) of Sub-Section-VI, Part A, Section-VI.	US \$ 52,393/- (US Dollar Fifty Two Thousand Three Hundred Ninety Three only) for every 0.1% point shortfall in SO ₂ removal efficiency from the guaranteed value	(-)0.25% point from the guaranteed SO ₂ removal efficiency.
	ii)	For increase in the limestone consumption of FGD system in T/hr under conditions stipulated in clause 4.01.00 (ii) of Sub-Section-VI, Part A, Section-VI.	US \$ 249,736/- (US Dollar Two Hundred Forty Nine Thousand Seven Hundred Thirty Six only) for every 100 kg/hr increase in Limestone consumption from guaranteed value.	(+)10% of the guaranteed limestone consumption.
iii)	Auxiliary Power Consumption For increase in the auxiliary power consumption in KW guaranteed as per the requirements of clause 4.01.00 (iii), of Sub-Section-VI, Part A, Section-VI.	US \$ 2484/- (US Dollar Two Thousand Four Hundred Eighty Four only) for every KW increase in Auxiliary power consumption from the guaranteed value.	(+)1% of the guaranteed auxiliary power consumption	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 12 OF 24

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			एनटीपीसी NTPC															
	<u>NABINAGAR JV RLY-I (4X250 MW)</u>																		
	<table><tr><th>Sl.No</th><th>Guarantee</th><th>Rate of Liquidated Damage (LD)</th><th>Acceptable Shortfall Limit with LD</th></tr><tr><td>i)</td><td>For shortfall in guaranteed SO₂ removal efficiency in percentage points under conditions stipulated in clause 4.01.00 (i) of Sub-Section-VI, Part A, Section-VI.</td><td>US \$ 21,045/- (US Dollar Twenty One Thousand Forty Five only) for every 0.1% point shortfall in SO2 removal efficiency from the guaranteed value</td><td>(-)0.25% point from the guaranteed SO2 removal efficiency.</td></tr><tr><td>ii)</td><td>For increase in the limestone consumption of FGD system in T/hr under conditions stipulated in clause 4.01.00 (ii) of Sub-Section-VI, Part A, Section-VI.</td><td>US \$ 255,904/- (US Dollar Two Hundred Fifty Five Thousand Nine Hundred Four only) for every 100 kg/hr increase in Limestone consumption from guaranteed value.</td><td>(+)10% of the guaranteed limestone consumption.</td></tr><tr><td>iii)</td><td>Auxiliary Power Consumption For increase in the auxiliary power consumption in KW guaranteed as per the requirements of clause 4.01.00 (iii), of Sub-Section-VI, Part A, Section-VI.</td><td>US \$ 2129/- (US Dollar Two Thousand One Hundred Twenty Nine only) for every KW increase in Auxiliary power consumption from the guaranteed value.</td><td>(+)1% of the guaranteed auxiliary power consumption</td></tr></table>	Sl.No	Guarantee	Rate of Liquidated Damage (LD)	Acceptable Shortfall Limit with LD	i)	For shortfall in guaranteed SO ₂ removal efficiency in percentage points under conditions stipulated in clause 4.01.00 (i) of Sub-Section-VI, Part A, Section-VI.	US \$ 21,045/- (US Dollar Twenty One Thousand Forty Five only) for every 0.1% point shortfall in SO2 removal efficiency from the guaranteed value	(-)0.25% point from the guaranteed SO2 removal efficiency.	ii)	For increase in the limestone consumption of FGD system in T/hr under conditions stipulated in clause 4.01.00 (ii) of Sub-Section-VI, Part A, Section-VI.	US \$ 255,904/- (US Dollar Two Hundred Fifty Five Thousand Nine Hundred Four only) for every 100 kg/hr increase in Limestone consumption from guaranteed value.	(+)10% of the guaranteed limestone consumption.	iii)	Auxiliary Power Consumption For increase in the auxiliary power consumption in KW guaranteed as per the requirements of clause 4.01.00 (iii), of Sub-Section-VI, Part A, Section-VI.	US \$ 2129/- (US Dollar Two Thousand One Hundred Twenty Nine only) for every KW increase in Auxiliary power consumption from the guaranteed value.	(+)1% of the guaranteed auxiliary power consumption		
Sl.No	Guarantee	Rate of Liquidated Damage (LD)	Acceptable Shortfall Limit with LD																
i)	For shortfall in guaranteed SO ₂ removal efficiency in percentage points under conditions stipulated in clause 4.01.00 (i) of Sub-Section-VI, Part A, Section-VI.	US \$ 21,045/- (US Dollar Twenty One Thousand Forty Five only) for every 0.1% point shortfall in SO2 removal efficiency from the guaranteed value	(-)0.25% point from the guaranteed SO2 removal efficiency.																
ii)	For increase in the limestone consumption of FGD system in T/hr under conditions stipulated in clause 4.01.00 (ii) of Sub-Section-VI, Part A, Section-VI.	US \$ 255,904/- (US Dollar Two Hundred Fifty Five Thousand Nine Hundred Four only) for every 100 kg/hr increase in Limestone consumption from guaranteed value.	(+)10% of the guaranteed limestone consumption.																
iii)	Auxiliary Power Consumption For increase in the auxiliary power consumption in KW guaranteed as per the requirements of clause 4.01.00 (iii), of Sub-Section-VI, Part A, Section-VI.	US \$ 2129/- (US Dollar Two Thousand One Hundred Twenty Nine only) for every KW increase in Auxiliary power consumption from the guaranteed value.	(+)1% of the guaranteed auxiliary power consumption																
	NOTES APPLICABLE FOR EACH PROJECT: i) Each of the liquidated damages specified above shall be independent and these liquidated damages shall be levied concurrently as applicable. ii) If the contract currency is other than US dollars, then the liquidated damages shall be in equivalent amount in contract currency based on Bill selling exchange rate of State Bank of India prevailing on the date of award of contract.																		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 15 OF 24															

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
	iii) All these liquidated damages for short fall in performance shall be deducted from the contract price as detailed in accompanying General Conditions of Contract (GCC)/ Special Conditions of Contract (SCC) iv) Contractor's aggregate liability to pay Liquidated Damages (LD) for failure to attain the functional guarantee shall not exceed twenty five percent (25%) of the Contract Price. v) The LD values are applicable on per unit basis.			
4.00.00	GUARANTEES PARAMETERS			
4.01.00	Guarantees Under Category-I The Performance Guarantees which attract Liquidated Damages (LD) are as follows: The following shall be guaranteed by the Bidder under guarantee point condition of Sub- Section-V, Part-A of section- VI: (i) SO₂ removal Efficiency The Contractor shall Guarantee that SO₂ removal efficiency at guarantee point (as specified in Clause 1.00.00/2.00.00/3.00.00/4.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project) shall not be less than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00/4.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project). (To be conducted as per the stipulation of Cl. no. 6.00.00 of this sub-section.) (ii) Limestone consumption of FGD system Limestone consumption of FGD system in kg/hr under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00/4.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project) and SO₂ removal efficiency of not less than the value specified under guarantee point conditions (as specified in Clause 1.00.00/2.00.00/3.00.00/4.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project) (iii) Auxiliary Power Consumption The Contractor shall guarantee the total auxiliary power consumption for the FGD plant in normal operation at the guarantee point conditions, as specified in Clause 1.00.00/2.00.00/3.00.00/4.00.00 Sub-section-V, Part-A of Section-VI applicable for respective project, inline with the requirements stipulated in clause 5.00.00 of this Sub-Section.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 16 OF 24

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
4.02.00	Guarantees Under Category-II The parameters/capabilities shall be demonstrated for various systems/equipments shall include but not limited to the following:- (i) Wet ball Mill capacity at rated fineness The contractor shall demonstrate the guaranteed capacity of each limestone pulverizer under the following conditions: i) Limestone fineness : 90% or higher (as per the requirement of the absorber) through 325 mesh. ii) Limestone Quality : All available quality from the specified range. (ii) Wet ball Mill wear parts guarantee Contractor shall demonstrate the life of wet ball Mill wear parts in line with requirements stipulated in Part B of the Technical Specification. The establishment of the above guarantee shall be based on the operating records available at the Power station and will be computed for each pulverizer based on actual total hours of operation. (iii) Wet ball Mill ball consumption Contractor shall guarantee ball consumption per ton of limestone throughput in line with requirements stipulated in Part B of the Technical Specification. Contractor shall furnish the minimum ball diameter below which the balls shall be replaced. (iv) Vacuum Belt Filter Capacity Contractor shall demonstrate the Designed Capacity of the Vacuum Belt Filters to dewater the quantity of gypsum with the specified purity and moisture content as specified in Part B of the Technical Specification. (v) Gypsum Purity The contractor shall demonstrate that the purity of the gypsum produced shall not be less than 90%, chloride content shall not be more than 100ppm and the moisture content shall not be more than 10% for guarantee point condition.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 17 OF 24	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
	(vi) Waste Water The Contractor guarantees that the maximum purge flow rate to waste water treatment system for the complete plant shall be 10m³/hr averaged over a 24 hour period from each unit. (vii) Performance characteristics of fans (capacity, head developed, etc.). (viii) Margins on fans in case Booster Fan is provided by the Contractor. Booster Fans - As specified in Part B of Technical Specifications (ix) Passenger cum Goods Elevator for FGD absorber & Limestone Grinding Building: Over load tests, travel and hoist speed checks. (x) Noise All the plant, equipment and systems covered under this specification shall perform continuously without exceeding the noise level over the entire range of output and operating frequency specified in Part-C of Section-VI of the technical specifications. Noise level measurement shall be carried out using applicable and internationally acceptable standards. The measurement shall be carried out with a calibrated integrating sound level meter meeting the requirement of IEC 651 or BS 5969 or is 9779. Sound pressure shall be measured all around the equipment at a distance of 1.0 m horizontally from the nearest surface of any equipment/ machine and at a height of 1.5 m above the floor level in elevation. A minimum of 6 points around each equipment shall be covered for measurement. additional measurement points shall be considered based on the applicable standards and the size of the equipment. the measurement shall be done with slow response on the a - weighting scale. the average of a-weighted sound pressure level measurements expressed in decibels to a reference of 0.0002 micro bar shall not exceed the guaranteed value. corrections for background noise shall be considered in line with the applicable standards. all the necessary data for determining these corrections, in line with the applicable standards, shall be collected during the tests.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 18 OF 24	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
	iv) Pressure drop across air drying plant . v) Vibration and noise level of air compressors, blowers of air drying plant (if applicable) xvi) Equipment Cooling Water System i) Vibration, noise and parallel operation without hunting & abnormal noise and with flow sharing within 10% of each other at the rated duty point shall be demonstrated at site. ii) Design heat load of plate type heat exchangers and Inlet & Outlet temperatures of the Plate type heat exchangers on the primary and secondary side to be demonstrated at site. Pressure drop across the Plate type heat exchanger on the primary & secondary water circuit to be demonstrated at site. xvii) Waste Water Treatment System (Applicable for Barh-I (3X660 MW) & Nabinagar (4x250 MW)) The Contractor shall guarantee the followings. A). Wastewater treatment capacity(m³/hr) : ≥ 30 for Barh-I (3X660 MW) B). Wastewater treatment capacity(m³/hr) : ≥ 20 for Nabinagar (4x250 MW) C). Operating time : 16hr for Pre-treatment process, 24hr for Evaporation process D). The distillate quality (Evaporator and crystallizer combined) shall be a maximum of 50 ppm TDS at 120 °F, while the solids produced for disposal which will pass the paint filter test.			
5.00.00	AUXILIARY POWER CONSUMPTION (PA) FOR EACH PROJECT The unit auxiliary power consumption shall be calculated using the following relationship. $P_a = P_u + T_L$ P_a = Guaranteed Auxiliary Power Consumption. P_u = Power consumed by the auxiliaries of the unit under test. T_L = Losses of the transformers supplied by bidder based on works test reports. While guaranteeing the auxiliary power consumption of each project the bidder shall necessarily include all continuously operating auxiliaries under this package. The auxiliaries to be considered shall include but not be limited to the following:			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 20 OF 24	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC
	Drives (indicative list) are marked to be considered by the Bidder for guaranteeing the power consumption. iii. Absorber Oxidation Tank Agitator(s) iv. Gypsum Bleed Pump v. Limestone Gravimetric feeder, Wet ball mill and their integral Auxiliaries divided by the number of units in the project vi. Limestone Slurry Pump → vii. Vacuum Belt Filter, Vacuum Pump and its integral auxiliaries divided by the number of units in the project Including Filtrate Extraction Pump After Vacuum Receiver, Vent Fan & Sump Pump viii. Power consumption of Booster water pump (if provided) divided by the number of units in the project. ix. Process water pump(s) divided by the number of units in the project x. Mist Eliminator Wash Water pump(s) → xi. Power consumption of Belt Filter Wash Water Pump divided by the number of units in the project xii. DM Cooling (normally working) Water pump one(1) to supply cooling water on the primary (DM) side of the plate type heat exchangers in the closed loop Equipment cooling water system. xiii. Auxiliary Cooling (normally working) water pump one(1) to supply cooling water on the secondary side of the plate type heat exchangers in the closed loop Equipment cooling (unit auxiliary) water system. xiv. Booster Fans xv. Power consumption of Limestone Slurry Tank Agitator(s) divided by the number of units in the project xvi. Power consumption of Filtrate Pump divided by the number of units in the project Same as xi. xvii. Power consumption of Belt Filter Wash Water Pump divided by the number of units in the project → xviii. Power consumption of Cloth Wash Water Pump divided by the number of units in the project	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES PAGE 21 OF 24

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES	एनटीपीसी NTPC		
	xix. Power consumption of Hydro-cyclone and Waste Water Pump divided by the number of units in the project xx. Power consumption of all other continuous running Agitators divided by the number of units in the project xxi. Air Conditioning System (*) Total Power consumption at motor input terminals of working units (i.e. excluding stand-by) at its rated duty point of compressor and condenser fans of air cooled condensing unit, Air handling unit (AHU) fans for the Air conditioning system of FGD Control Room Building and ZLD Control Room Building (if provided) divided by total nos. of units in respective project.. xxii Total power consumption at motor input terminal at rated duty of fan of UAF divided by total nos. of units in respective project. (*) ((*) Above guaranteed power consumption values shall be at 20 deg C for centrifugal fans of AHUs and at 30 deg C for centrifugal fans of air washer units and at an elevation of RL (+) - m for both AHUs and Air washer unit centrifugal fans.) xxiii Total power consumption at motor input terminal at rated duty of Air compressor, Air drying plant (Heater and blower, as applicable) divided by total nos. of units in respective project xxiv. Power consumption of Evaporator feed pump divided by the number of units in the project, in case ZLD system is provided xxv. Power consumption of Evaporator/Brine concentrator recirculation pump divided by the number of units in the project, in case ZLD system is provided xxvi. Power consumption of Distillate pump divided by the number of units in the project, in case ZLD system is provided xxvii. Power consumption of Crystalliser feed pump divided by the number of units in the project, in case ZLD system is provided xxviii. Power consumption of Crystalliser recirculation pump divided by the number of units in the project, in case ZLD system is provided xxix. Power consumption of Mechanical vapour Compressor divided by the number of units in the project, in case ZLD system is provided The equipment's listed above for calculating auxiliary power consumption are indicative. Any other equipment required for continuous operation of the system shall also be considered for calculation of auxiliary power consumption. Power consumption of all equipments provided on unitized basis shall be included in the unit auxiliary power consumption. For common station auxiliaries, the power			
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 22 OF 24	

CLAUSE NO.	FUNCTIONAL GUARANTEES AND LIQUIDATED DAMAGES			
6.00.00 7.00.00	consumption shall be assigned to each unit based on unit load for the purpose of calculating the unit auxiliary power consumption. Note : - The bidder shall furnish a list of equipments to be covered under auxiliary power consumption, which shall be subject to Employer's approval. - The equipments listed above for calculating auxiliary power consumption are indicative. Any other equipment required for continuous operation of the system shall also be considered for calculation of auxiliary power consumption. METHOD OF COMPUTING TEST EFFICIENCY OF FGD The performance tests shall be carried out in accordance with ASME PTC 40 (1991) code. No tolerance or allowance on the test result will be permitted for instrument errors or inaccuracy, the method of testing or any other causes. The details of the test shall, however be mutually agreed upon between the employer and the contractor. METHOD OF COMPUTING AVAILABILITY The Contractor shall guarantee 98 % availability of FGD plant including waste water treatment system for Zero Liquid Discharge (ZLD), wherever provided, for a continuous period of 120 days. An availability guarantee test shall be conducted to assure this level of availability for a period of 240 days as per the procedure indicated below. Availability 'A' in %: $A = \frac{T_c \times 100\%}{T_k}$ T_c – recorded time of FGD operation, expressed in hours, T_k – recorded time of boiler operation, expressed in hours, However, it is required that: - In order to calculate the FGD availability, operation hours will be counted except boiler start-ups when the operation hours counting will start on the moment of shut down of all oil burners, - FGD will be regarded as a FGD in operation, when by-pass damper is closed and total flow of flue gas from boiler goes via FGD, and SO₂			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-A BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-VI FUNCTIONAL GUARANTEES & LIQUIDATED DAMAGES	PAGE 23 OF 24	

NTPC Limited

(A Government of India Enterprise)



LOT-IA PROJECTS

PART - C

GENERAL TECHNICAL REQUIREMENTS

SECTION – VI

FOR

**FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE**

BIDDING DOCUMENT NO.: CS-0011-109(1A)-2



PART - C

GENERAL TECHNICAL REQUIREMENTS

LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI, PART-C
BID DOC NO: CS-0011-109(1A)-2

GENERAL TECHNICAL REQUIREMENTS

PART - C

CONTENTS

Clause No.	Description	Page No.
1.00.00	Introduction	1
2.00.00	Brand Name	1
3.00.00	Base Offer & Alternate Proposals	1
4.00.00	Completeness of Facilities	1
5.00.00	Codes & Standards	2
6.00.00	Equipment Functional Guarantee	4
7.00.00	Design of Facilities/ Maintenance & Availability Considerations	5
8.00.00	Documents, Data and Drawings to be furnished by Contractor	5
9.00.00	Technical Co-ordination Meeting	21
10.00.00	Design Improvements	22
11.00.00	Equipment Bases	22
12.00.00	Protective Guards	22
13.00.00	Lubricants, Servo fluids and Chemicals	22
14.00.00	Lubrication	23
15.00.00	Material of Construction	23
16.00.00	Rating Plates, Name Plates & Labels	23
17.00.00	Tools and Tackles	24
18.00.00	Welding	25

LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI, PART-C
BID DOC NO: CS-0011-109(1A)-2

Clause No.	Description	Page No.
19.00.00	Colour Code for All equipments/Pipings/PlpeServices	25
20.00.00	Protection and Preserveative shop Coating	25
21.00.00	Quality Assurance Programme	26
22.00.00	General Requirements - Quality Assurance	27
23.00.00	Quality Assurance Documents	32
24.00.00	Project Manager's Supervision	34
25.00.00	Inspection, Testing and Inspection Certificates	35
26.00.00	Pre-commissioning and Commissioning Facilities	38
27.00.00	Taking over	41
28.00.00	Training of Employer's Personnel	41
29.00.00	Safety Aspects during Construction and Erection	42
30.00.00	Noise Level	42
31.00.00	Packaging and Transportation	42
32.00.00	Electrical Equipments/Enclosures	43
33.00.00	Instrumentation and Control	43
34.00.00	Electrical Noise Control	44
35.00.00	Surge protection for solid state equipment	44
36.00.00	Instrument Air System	44
37.00.00	Tapping Points for Measurements	45
38.00.00	System Documentation	45
39.00.00	Maintenance Manuals of Electronic Modules	45

LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(1A)-2
---	---



Clause No.	Description	Page No.
	Annexure - I	76
	Annexure - II	77
	Annexure - III	78
	Annexure - IV	79
	Annexure - V	80
	Annexure - VI	81
	Annexure - VII	83
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-C BID DOC NO: CS-0011-109(1A)-2

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
1.00.00	INTRODUCTION This part covers technical requirements which will form an integral part of the Contract. The following provisions shall supplement all the detailed technical specifications and requirements brought out in Section-VI, the Technical Specification and the Technical Data Sheets.			
2.00.00	BRAND NAME Whenever a material or article is specified or described by the name of a particular brand, manufacturer or vendor, the specific item mentioned shall be understood to be indicative of the function and quality desired, and not restrictive; other manufacturer's products may be considered provided sufficient information is furnished to enable the Employer to determine that the products proposed are equivalent to those named.			
3.00.00	BASE OFFER & ALTERNATE PROPOSALS The Bidder's proposal shall be based upon the use of equipment and material complying fully with the requirements specified herein. It is recognised that the Contractor may have standardized on the use of certain components, materials, processes or procedures different than those specified herein. Alternate proposals offering similar equipment based on the manufacturer's standard practice will also be considered, provided the base offer is in line with technical specifications and such proposals meet the specified design standards and performance requirement and are acceptable to the Employer. Sufficient amount of information for justifying such proposals shall be furnished to Employer alongwith the bid to enable the Employer to determine the acceptability of these proposals.			
4.00.00	COMPLETENESS OF FACILITIES			
4.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant shall be engineered and designed in accordance with the specification requirement. All engineering and associated services are required to ensure a completely engineered plant shall be provided.			
4.02.00	All equipments furnished by the Contractor shall be complete in every respect, with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or those needed for erection, completion and safe operation of the equipment and for the safety of the operating personnel, as required by applicable codes, though they may not have been specifically detailed in the respective specifications, unless included in the list of exclusions. All same standard components/ parts of same equipment provided, shall be interchangeable with one another.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 1 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
4.03.00	For the C&I systems, the Contractor shall be required to provide regular information about future upgrades and migration paths to the Employer.			
5.00.00	RULES, REGULATIONS, CODES & STANDARDS			
5.01.00	In addition to the codes and standards specifically mentioned in the relevant technical specifications for the equipment / plant / system, all equipment parts, systems and works covered under this specification shall comply with all currently applicable statutory regulations and safety codes of the Republic of India, NTPC rules/codes of practices as well as of the locality where they will be installed, including the following: a) Indian Electricity Act b) Indian Electricity Rules c) Indian Explosives Act d) Indian Factories Act and State Factories Act e) Indian Boiler Regulations (IBR) f) Regulations of the Central Pollution Control Board, India g) Regulations of the Ministry of Environment & Forest (MoEF), Government of India h) Pollution Control Regulations of Department of Environment, Government of India i) State Pollution Control Board. (j.) Rules for Electrical installation by Tariff Advisory Committee (TAC). (k.) Building and other construction workers (Regulation of Employment and Conditions of services) Act, 1996 (l.) Building and other construction workers (Regulation of Employment and Conditions of services) Central Rules, 1998 (m.) Explosive Rules, 1983 (n.) Petroleum Act, 1984 (o.) Petroleum Rules, 1976,			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 2 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
5.02.00	(p.) Gas Cylinder Rules, 1981 (q.) Static and Mobile Pressure Vessels (Unified) Rules, 1981 (r.) Workmen's Compensation Act, 1923 (s.) Workmen's Compensation Rules, 1924 (t.) NTPC Safety Rules for Construction and Erection (u.) NTPC Safety Policy (v.) Any other statutory codes / standards / regulations, as may be applicable. Unless covered otherwise in the specifications, the latest editions (as applicable as on date of bid opening), of the codes and standards given below shall also apply: a) Bureau of Indian standards (BIS) b) Japanese Industrial Standards (JIS) c) American National Standards Institute (ANSI) d) American Society of Testing and Materials (ASTM) e) American Society of Mechanical Engineers (ASME) f) American Petroleum Institute (API) g) Standards of the Hydraulic Institute, U.S.A. h) International Organisation for Standardisation (ISO) i) Tubular Exchanger Manufacturer's Association (TEMA) j) American Welding Society (AWS) k) National Electrical Manufacturers Association (NEMA) l) National Fire Protection Association (NFPA) m) International Electro-Technical Commission (IEC)/European Norm (EN) n) Expansion Joint Manufacturers Association (EJMA) o) Heat Exchange Institute (HEI)			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 3 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
5.03.00	p) IEEE standard q) JEC standard Other International/ National standards such as DIN, JIS, VDI, EN, BS, GOST etc. shall also be accepted for only material codes and manufacturing standards, subject to the Employer's approval, for which the Bidder shall furnish, adequate information to justify that these standards are equivalent or superior to the standards mentioned above. In all such cases the Bidder shall furnish specifically the variations and deviations from the standards mentioned elsewhere in the specification together with the complete word to word translation of the standard that is normally not published in English.			
5.04.00	Not used.			
5.05.00	In the event of any conflict between the codes and standards referred to in the above clauses and the requirement of this specification, the requirement of Technical Specification shall govern.			
5.06.00	Two (2) English language copies of all national and international codes and/or standards used in the design of the plant, equipment, civil, structural and architectural works shall be provided by the Contractor to the Employer within two calendar months from the date of the Notification of Award.			
5.07.00	In case of any change in codes, standards & regulations between the date of bid opening and the date when vendors proceed with fabrication, the Employer shall have the option to incorporate the changed requirements or to retain the original standard. It shall be the responsibility of the Contractor to bring to the notice of the Employer such changes and advise Employer of the resulting effect.			
5.08.00	A detailed list of standards apart from those mentioned in the respective detailed specifications in other parts of Section-VI to which all equipment/systems/civil works should conform as indicated in this Part C and elsewhere in the specification.			
6.00.00	EQUIPMENT FUNCTIONAL GUARANTEE			
6.01.00	The functional guarantees of the equipment under the scope of the Contract is given in Section-VI Part - A of Technical Specifications. These guarantees shall supplement the general functional guarantee provisions covered under Defect liabilities Section-IV, General Conditions of Contract.			
6.02.00	Liquidated damages for shortfall in meeting functional guarantee(s) during the performance and guarantee tests shall be assessed and recovered from the Contractor as specified elsewhere in this specification.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 4 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
7.00.00	DESIGN OF FACILITIES/ MAINTENANCE & AVAILABILITY CONSIDERATIONS			
7.01.00	DESIGN OF FACILITIES All the design procedures, systems and components proposed shall have already been adequately developed and shall have demonstrated good reliability under similar conditions elsewhere. The Contractor shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic requirements are detailed out in various clauses of the Technical Specifications. The design of various components, assemblies and subassemblies shall be done so that it facilitates easy field assembly and dismantling. All the rotating components shall be so selected that the natural frequency of the complete unit is not critical or close to the operating range of the unit.			
7.02.00	MAINTENANCE AND AVILABILITY CONSIDERATIONS Equipment/works offered shall be designed for high availability, low maintenance and ease of maintenance. The Bidder shall specifically state the design features incorporated to achieve high degree of reliability/ availability and ease of maintenance. The Bidder shall also furnish details of availability records in the reference plants stated in his experience list. Bidder shall state in his offer the various maintenance intervals, spare parts and man-hour requirement during such operation. The intervals for each type of maintenance namely inspection of the furnace, inspection of the entire hot gas path and the minor and major overhauls shall be specified in terms of fired hours , clearly defining the spare parts and man-hour requirement for each stage. Lifting devices i.e. hoists and chain pulley jacks ,etc. shall be provided by the contractor for handling of any equipment or any of its part having weight in excess of 500 Kgs during erection and maintenance activities. Lifting devices like lifting tackles, slings, etc. to be connected to hook of the hoist / crane shall be provided by the contractor for lifting the equipment and accessories covered under the specification.			
8.00.00	DOCUMENTS, DATA AND DRAWINGS TO BE FURNISHED BY CONTRACTOR			
8.01.00	Bidders may note that this is a contract inclusive of the scope as indicated elsewhere in the specification. Each of the plant and equipment shall be fully integrated, engineered and designed to perform in accordance with the technical specification. All engineering and technical services required to ensure a completely			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 5 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	engineered plant shall be provided in respect of mechanical, electrical, control & instrumentation, civil & structural works as per the scope. Each main and auxiliary equipment/item of the plant including instruments shall be assigned a unique tag number. The assignment of tag numbers shall be in accordance with KKS system. In all drawings/documents/data sheet etc. KKS tag number of the equipment/item/instrument etc. shall be indicated. The Contractor shall furnish engineering data /drawings in accordance with the schedule of information as specified in Technical Data Sheets and Technical Specification. A comprehensive engg and quality coordination procedure shall be finalized with the successful bidder covering salient features as described in this section of specifications. 8.02.00 The number of copies/prints/CD-ROMs/manuals to be furnished for various types of document is given in Annexure-VI to this Part-C, Section-VI of the Technical Specification. 8.03.00 The documentation that shall be provided by the Contractor is indicated in the various sections of specification. This documentation shall include but not be limited to the following: 8.03.01 A) BASIC ENGINEERING DOCUMENTATION Prior to commencement of the detailed engineering work, the Contractor shall furnish a Plant Definition Manual within 12 weeks from the date of the Notification of Award. This manual shall contain the following as a minimum: i) System description of all the mechanical, electrical, control & instrumentation & civil systems. ii) Technology scan for each system / sub-system & equipment. iii) Selection of appropriate technology / schemes for various systems/ subsystems including techno-economic studies between various options. iv) Optimisation studies including thermal cycle optimisation. v) Sizing criteria of all the systems, sub-systems/ equipments/ structures/ equipment foundations alongwith all calculations justifying and identifying the sizing and the design margins. vi) Schemes and Process & Instrumentation diagrams for the various systems/ sub-system with functional write-ups.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 6 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	vii) Operation Philosophy and the control philosophy of the equipments/system covered under the scope. ix) General Layout plan of the FGD System incorporating all facilities in Bidder's as well as those in the Employer's scope. This drawing shall also be furnished in the form of CD-ROMs to the Employer for engineering of areas not included in bidder's scope. x) Basic layouts and cross sections of the main plant building (various floor elevations), boiler, fuel oil area and other areas included in the scope of the bidder. xi) Documentation in respect of Quality Assurance System as listed out elsewhere in this specification. The successful bidder shall furnish within three (3) weeks from the date of Notification of Award, a list of contents of the Plant Definition Manual (PDMs) including techno-economic studies, which shall then be mutually discussed & finalised with the Employer. B) DETAILED ENGINEERING DOCUMENTS i) General layout plan of the FGD System. ii) Layouts, general arrangements, elevations and cross-sections drawings for all the equipment and facilities of the plant. iii) Flow diagram, process and instrumentation diagrams along with write up and system description. iv) Performance curves for Absorber v) Piping isometric, composite layout and fabrication drawings. vi) Piping engineering diagrams, pipe and fittings schedules, valve schedules, hanger and support schedules, insulation schedules. vii) Technical data sheets for all bought out and manufactured items. Contractor shall use the Employer's specifications as a base for placement of orders on their sub vendors. viii) Detailed design calculations for components, system, piping etc., wherever applicable including sizing calculations for all auxiliaries like mills, fans etc- as per criteria specified elsewhere in specification. ix) Absorber sizing calculations. Absorber performance data.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 7 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	x) Mass Balance Diagram xi) Characteristic Curves/ Performance Correction Curves. xii) Comprehensive list of all terminal points which interface with Employer's facilities, giving details of location, terminal pressure, temperature, fluid handled & end connection details, forces, moments etc. xiii) Power supply single line diagram, block logics, control schematics, electrical schematics, etc. xiv) Protection system diagrams and relay settings. xv) Cables schedules and interconnection diagrams. xvii) Cable routing plan. xviii) Instrument schedule, measuring point list, I/O list, Interconnection & wiring diagram, functional write-ups, and installation drawings for field mounted instruments, logic diagrams, control schematics, wiring and tubing diagrams of panels and enclosures etc. Drawings for open loop and close loop controls (both hardware and software). Motor list and valve schedule including type of actuator etc. xix) Alarm and annunciation/ Sequence of Event (SOE) list and alarms & trip set points. xx) Sequence and protection interlock schemes. xxi) Type test reports, insulation co-ordination study report xxii) Control system configuration diagrams and card circuit diagrams and maintenance details. xxiii) Detailed Control system manuals. xxiv) Detailed flow chart for digital control system. xv) Mimic diagram layout, Assignment for other application engg. drawings and documents. xxvi) Civil and Structural works drawings and documents for all structures, facilities, architectural works, foundations underground and overground works and super-structural works as included in the			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 8 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
8.03.02	scope of the bidder civil calculation sheets including structural analysis and design alongwith output results. xxvii) Underground facilities, levelling, sanitary, land scaping drawings. xxviii) Geotechnical investigation and site survey reports (if and as applicable). xxix) Model study reports wherever applicable. xxx) Functional & guarantee test procedures and test reports. xxxi) Documentation in respect of Quality Assurance System, and Documentation in respect of Commissioning, as listed out elsewhere in this specification. xxxii) Maintenance schedule for Absorber & auxiliaries clearly indicating interval, duration if shutdown required, manhours required and tools & tackles required for maintenance. The Contractor's while submitting the above documents/ drawings for approval/ reference as the case may be, shall mark on each copy of submission the reference letter alongwith the date vide which the submissions are made.			
	INSTRUCTION MANUALS The Contractor shall make first submission of instruction manual for all the equipments covered under the Contract as per agreed engineering information schedule. The Instruction manuals shall contain full details required for erection, commissioning, operation and maintenance of each equipment. The manual shall be specifically compiled for this project. After finalisation and approval of the Employer the Instruction Manuals shall be submitted as indicated in Annexure-IV. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals have been supplied to the Employer. The Instruction Manuals shall comprise of the following. A) ERECTION MANUALS The erection manuals shall be submitted atleast three (3) months prior to the commencement of erection activities of particular equipment/system. The erection manual should contain the following as a minimum. a) Erection strategy. b) Sequence of erection.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 9 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	c) Erection instructions. d) Critical checks and permissible deviation/tolerances. e) List of tool, tackles, heavy equipments like cranes, dozers, etc. f) Bill of Materials g) Procedure for erection and General Safety procedures to followed during erection/installation. h) Procedure for initial checking after erection. i) Procedure for testing and acceptance norms. j) Procedure / Check list for pre-commissioning activities. k) Procedure / Check list for commissioning of the system. l) Safety precautions to be followed in electrical supply distribution during erection. B) OPERATION & MAINTENANCE MANUALS a) The manual shall be a two rim PVC bound stiff sided binder able to withstand constant usage or where a thicker type is required it shall have locking steel pins, the size of the manual shall not be larger than international size A3. The cover shall be printed with the Project Name, Services covered and Volume / Book number Each section of the manual shall be divided by a stiff divider of the same size as the holder. The dividers shall clearly state the section number and title. All written instructions within the manual not provided by the manufacturers shall be typewritten with a margin on the left hand side. b) The arrangement and contents of O & M manuals shall be as follows: 1) <u>Chapter 1 - Plant Description:</u> To contain the following sections specific to the equipment/system supplied (a) Description of operating principle of equipment / system with schematic drawing / layouts.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 10 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	(b) Functional description of associated accessories / controls. Control interlock protection write up. (c) Integrated operation of the equipment alongwith the intended system. (This is to be given by the supplier of the Main equipment by taking into account the operating instruction given by the associated suppliers). (d) Exploded view of the main equipment, associated accessories and auxiliaries with description. Schematic drawing of the equipment alongwith its accessories and auxiliaries. (e) Design data against which the plant performance will be compared. (f) Master list of equipments, Technical specification of the equipment/ system and approved data sheets. (g) Identification system adopted for the various components, (it will be of a simple process linked tagging system). (h) Master list of drawings (as built drawing - Drawings to be enclosed in a separate volume). 2) <u>Chapter 2.0 - Plant Operation</u>: To contain the following sections specific to the equipment supplied (a) Protection logics provided for the equipment alongwith brief philosophy behind the logic, Drawings etc. (b) Limiting values of all protection settings. (c) Various settings of annunciation/interlocks provided. (d) Startup and shut down procedure for equipment alongwith the associated systems in step mode. (e) Do's and Don'ts related to operation of the equipment. (f) Safety precautions to be take during normal operation. Emergency instruction on total power failure condition/lubrication failure/any other conditions. (g) Parameters to be monitored with normal value and limiting values. (h) Equipment isolating procedures.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 11 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(i) Trouble shooting with causes and remedial measures. (j) Routine testing procedure to ascertain healthiness of the safety devices alongwith schedule of testing. (k) Routine Operational Checks, Recommended Logs and Records (l) Change over schedule if more than one auxiliary for the same purpose is given. (m) Preservation procedure on long shut down. (n) System/plant commissioning procedure. 3) <u>Chapter 3.0 - Plant Maintenance</u>- To contain the following sections specific to the equipment supplied. (a) Exploded view of each of the equipments. Drawings alongwith bill of materials including name, code no. & population. (b) Exploded view of the spare parts and critical components with dimensional drawings (In case of Electronic cards, the circuit diagram to be given) and spare parts catalogue for each equipment. (c) List of Special T/ P required for Overhauling /Trouble shooting including special testing equipment required for calibration etc. (d) Stepwise dismantling and assembly procedure clearly specifying the tools to be used, checks to be made, records to be maintained etc. Clearance to be maintained etc. (e) Preventive Maintenance schedules linked with running hours/calendar period alongwith checks to be carried out. (f) Overhauling schedules linked with running hours/calendar period alongwith checks to be done. (g) Long term maintenance schedules (h) Consumables list alongwith the estimated quantity required during normal running and during maintenance like Preventive Maintenance and Overhauling. (i) List of lubricants with their Indian equivalent, Lubrication Schedule including charts showing lubrication checking, testing and replacement procedure to be carried daily, weekly, monthly & at			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 12 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	longer intervals to ensure trouble free operation and quantity required for complete replacement. (j) Tolerance for fitment of various components. (k) Details of sub vendors with their part no. in case of bought out items. (l) List of spare parts with their Part No, total population, life expediency & their interchangeability with already supplied spares to NTPC. (m) List of mandatory and recommended spare list along with manufacturing drawings, material specification & quality plan for fast moving consumable spares. (n) Lead time required for ordering of spares from the equipment supplier, instructions for storage and preservation of spares. (o) General information on the equipment such as modification carried out in the equipment from its inception, equipment population in the country / foreign country and list of utilities where similar equipments have been supplied.	
8.03.03	After finalization and approval of the Employer, the O & M Manuals shall be submitted as indicated in Annexure-VI. The Contract shall not be considered to be completed for purposes of taking over until the final Instructions manuals (both erection and O & M manuals have been supplied to the Employer. If after the commissioning and initial operation of the plant, the instruction manuals (Erection and /or O &M manuals) require modifications/additions/changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the Contractor to the Employer for records and number of copies shall be as mentioned in Annexure-VI.	
8.03.03	PLANT HANDBOOK AND PROJECT COMPLETION REPORT	
8.03.03.01	PLANT HANDBOOK The Contractor shall submit to the Employer a preliminary plant hand book preferably in A-4 size sheets which shall contain the design and performance data of various plants, equipments and systems covering the complete project including i) Design and performance data. ii) Process & Instrumentation diagrams. iii) Single line diagrams.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 13 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	iv) Sequence & Protection Interlock Schemes. v) Alarm and trip values. vi) Performance Curves. vii) General layout plan and layout of main plant building and auxiliary buildings viii) Important Do's & Don't's The plant handbook shall be submitted within twelve (12) months from the date of award of contract. After the incorporation of Employer's comments, the final plant handbook complete in all respects shall be submitted three (3) months before start-up and commissioning activities.			
8.03.03.02	PROJECT COMPLETION REPORT The Contractor shall submit a Project Completion Report at the time of handing over the plant.			
8.03.04	DRAWINGS a) i) All the FGD plant layouts shall be made in computerised 3D modelling system. The Employer reserves the right to review the 3D model at different stages during the progress of engineering. The layout drawings submitted for Employer's review shall be fully dimensioned and extracted from 3D model after interference check. ii) All documents submitted by the Contractor for Employer's review shall be in electronic form (soft copies) along with the desired number of hard copies as per Annexure-VI of Part-C. The soft copies shall be uploaded by the vendors in C-folders, a Web-based system of NTPC ERP, for which a username and password will be allotted to the new vendor by NTPC. Similarly, the vendor can download the drawings/documents, approved/ commented by NTPC, through above site. The soft copies of identified drawings/documents shall be in pdf format, whereas the attachments/reply to the submitted document(s) can be in .doc, .xls, .pdf, .dwg or .std formats. iii) Final copies of the approved drawings along with requisite number of hard copies shall be submitted as per Annexure-VI of Part-C. iv) Contractor shall prepare the model of all the facilities located in FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE (including all			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 14 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	facilities), and any other facility in an integrated & intelligent 3D software solution using rule-based, data centric 3D Design software with equipment drawings, data sheets, intelligent P&ID correlated with intelligent 3D Model, BOQ, schematics and logic diagrams etc. attached to the respective equipment / systems in the aforesaid 3D model. Contractor shall make a presentation on 3D model every 3 months from LOA to enable NTPC to review the progress of engineering. After the completion of engineering the corresponding complete 3D review model shall be handed over to the employer for its reference. Contractor shall provide 3D model (which shall include visual interference check, walk-through animation, video simulation for major equipment placement and removal, visual effect, photo realism etc), which is extracted from intelligent 3D model, for employer's review as & when desired by employer. However, all piping layouts, equipment layouts, floor plans, ducting layout (Air/flue gas, A/C, Ventilation etc.), General Arrangement drawings of major buildings, structural arrangement drawings and RCC layout drawings shall necessarily be extracted from the aforesaid 3D model and submitted for employer's review along with the 3D review model to enable NTPC to review and approve these drawings. b) All documents/text information shall be in latest version of MS Office / MS Excel / PDF FORMAT as applicable. c) All drawings submitted by the Contractor including those submitted at the time of bid shall be in sufficient detail indicating the type, size, arrangement, weight of each component for packing and shipment, the external connection, fixing arrangement required, the dimensions required for installation and interconnections with other equipments and materials, clearance and spaces required between various portions of equipment and any other information specifically requested in the drawing schedules. d) Each drawing submitted by the Contractor (including those of subvendors) shall bear a title block at the right hand bottom corner with clear mention of the name of the Employer, the system designation, the specifications title, the specification number, the name of the Project, drawing number and revisions. If standard catalogue pages are submitted the applicable items shall be indicated therein. All titles, notings, markings and writings on the drawing shall be in English. All the dimensions should be in metric units. e) The drawings submitted by the Contractor (or their subvendors) shall bear Employer's drawing number in addition to contractor's (their sub-vendor's) own drawing number. Employer's drawing numbering system shall be made available to the successful bidder so as to enable him to assign Employer's drawing numbers to the drawings to be submitted by him during the course of execution of the Contract.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 15 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	The Contractor shall also furnish a "Master Drawing List" which shall be a comprehensive list of all drawings/ documents/ calculations envisaged to be furnished by him during the detailed engineering to the Employer. Such list should clearly indicate the purpose of submission of these drawings i.e. "FOR APPROVAL" or "FOR INFORMATION ONLY". Similarly, all the drawings/ documents submitted by the Contractor during detailed engineering stage shall be marked "FOR APPROVAL" or "FOR INFORMATION" prior to submission. Further, space shall be identified on each drawing for Approval stamp and electronic signature. f) The furnishing of detailed engineering data and drawings by the Contractor shall be in accordance with the time schedule for the project. The review of these documents/ data/ drawings by the Employer will cover only general conformance of the data/ drawings/ documents to the specifications and contract, interfaces with the equipments provided by others and external connections & dimensions which might affect plant layout. The review by the Employer should not be construed to be a thorough review of all dimensions, quantities and details of the equipments, materials, any devices or items indicated or the accuracy of the information submitted. The review and/ or approval by the Employer/ Project Manager shall not relieve the Contractor of any of his responsibilities and liabilities under this contract. g) After the approval of the drawings, further work by the Contractor shall be in strict accordance with these approved drawings and no deviation shall be permitted without the written approval of the Employer. h) All manufacturing, fabrication and execution of work in connection with the equipment / system, prior to the approval of the drawings, shall be at the Contractor's risk. The Contractor is expected not to make any changes in the design of the equipment /system, once they are approved by the Employer. However, if some changes are necessitated in the design of the equipment/system at a later date, the Contractor may do so, but such changes shall promptly be brought to the notice of the Employer indicating the reasons for the change and get the revised drawing approved again in strict conformance to the provisions of the Technical Specification. i) Drawings shall include all installations and detailed piping layout drawings. Layout drawings for all piping of 65 mm and larger diameter shall be submitted for review/ approval of Employer prior to erection. Small diameter pipes shall however be routed as per site conditions in consultation with site authority/ representative of Employer based on requirements of such piping indicated in approved/ finalised Flow Scheme/ Process & Instrumentation Diagrams and/or the requirements cropping up for draining & venting of larger diameter piping or otherwise after their erection as per actual physical condition for the entire scope of work of this package.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 16 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
8.04.00	Assessing & anticipating the requirement and supply of all piping and equipment shall be done by the contractor well in advance so as not to hinder the progress of piping & equipment erection, subsequent system charging and its effective draining & venting arrangement as per site suitability.			
	j) As Built Drawings After final acceptance of individual equipment / system by the Employer, the Contractor will update all original drawings and documents for the equipment / system to "as built" conditions and submit no. of copies as per Annexure VI.			
	k) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to Engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data/ drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same.			
	l) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The Employer shall review the drawings and return soft copy to the Contractor authorizing either to proceed with manufacture or fabrication, or marked to show changes desired. When changes are required, drawings shall be re-submitted promptly, with revisions clearly marked, for final review. Any delays arising out of the failure of the Contractor to submit/rectify and resubmit in time shall not be accepted as a reason for delay in the contract schedule.			
	m) All engineering data submitted by the Contractor after final process including review and approval by the Project Manager/ Employer shall form part of the contract documents and the entire works covered under these specification shall be performed in strict conformity with technical specifications unless otherwise expressly requested by the Project Manager in writing.			
	n) The Contractor shall submit drawings in line with the suggestive MDL covered in Part-B, Section-VI of Technical Specification and which shall be duly integrated with approved PERT network.			
	ENGINEERING INFORMATION SUBMISSION SCHEDULE			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2		GENERAL TECHNICAL REQUIREMENTS PAGE 17 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Prior to the award of Contract, a Detailed Engineering Information Submission Scheduler/Master Drawing List duly integrated with approved PERT network shall be tied up with the Employer. For this, the bidder shall furnish a detailed list of engineering information alongwith the proposed submission schedule. This list would be a comprehensive one including all engineering data / drawings / information for all bought out items and manufactured items. The information shall be categorized into the following parts. i) Information that shall be submitted for the approval to the Employer before proceeding further, and ii) Information that would be submitted for Employer's information only. The Master Drawing List (MDL) shall be updated periodically and submitted to the employer, highlighting the changes made in MDL. The schedule should allow adequate time for proper review and incorporation of changes/ modifications, if any, to meet the contract without affecting the equipment delivery schedule and overall project schedule. The early submission of drawings and data is as important as the manufacture and delivery of equipment and hardware and this shall be duly considered while determining the overall performance and progress.			
8.05.00	ENGINEERING PROGRESS AND EXCEPTION REPORT			
8.05.01	The Contractor shall submit every month an Engineering progress and Exception Report giving the status of each engineering information including a) A list of drawings/engineering information which remains unapproved for more than four (4) weeks after the date of first submission b) Drawings which were not submitted as per agreed schedule.			
8.05.02	The draft format for this report shall be furnished to the Employer within four (4) weeks of the award of the contract, which shall then be discussed and finalised with the Employer.			
8.06.00	Engineering Co-ordination Procedure			
8.06.01	The following principal coordinators will be identified by respective organizations at time of award of contract: NTPC Engineering Coordinator (NTPC EC): Name :			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 18 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE : Contractor's/ Vendor's Engineering Coordinator (VENDOR EC): Name : Designation : Address : a) Postal : b) Telegraphic / e-Mail : c) FAX : TELEPHONE :			
8.06.02	All engineering correspondence shall be in the name of above coordinators on behalf of the respective organizations.			
8.06.03	Contractor's/Vendor's Drawing Submission and Approval Procedure: a) All data/information furnished by Vendor in the form of drawings/ documents/catalogues or in any other form for NTPC's information/ interface and or review and approval are referred by the general term "drawings". b) The 'Master drawings list' indicating titles, Drawing Number, Date of submission and approval etc. shall be finalised mutually between Contractor and Employer before the award of contract. This list shall be updated if required at suitable interval during detailed engineering. c) All drawings (including those of subvendor's) shall bear at the right hand bottom corner the 'title plate' with all relevant information duly filled in. The Contractor shall furnish this format to his subvendor along with his purchase order for subvendor's compliance. d) Employer and contractor shall follow their own numbering systems for the drawings. However, Employer shall intimate the contractor, NTPC drawing number on receipt of the first submission of each drawing. Vendor,			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 19 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	thereafter, shall indicate NTPC's drawing number in subsequent Submission, in the space provided for this purpose in title plate, in addition to his own drawing number. e) The contractor shall make a visit to site to see the existing facilities and understand the layout completely and collect all necessary data / drawings at site which are needed as an input to the engineering. The contractor shall do the complete engineering including interfacing and integration of all his equipment, systems & facilities within his scope of work as well as interface engineering & integration of systems, facilities, equipment & works under Employer's scope and submit all necessary drawings/ documents for the same. f) Drawings must be checked by the Contractor in terms of its completeness, data adequacy and relevance with respect to engineering schedule prior to submission to the Employer. In case drawings are found to be submitted without proper endorsement for checking by the Contractor, the same shall not be reviewed and returned to the Contractor for re-submission. g) The Contractor shall submit adequate prints of drawing / data / document for Employer's review and approval. The drawings submitted by the Contractor/vendor shall be reviewed by NTPC and their comments shall be forwarded within four (4) weeks of receipt of drawings. Upon review of each drawing, depending on the correctness and completeness of the drawing, the same will be categorized and approval accorded in one of the following categories : CATEGORY- I: Approved CATEGORY- II Approved, subject to incorporation of comments/ modification as noted. Resubmit revised drawing incorporating the comments. CATEGORY –III Not approved. Resubmit revised drawings for approval after incorporating comments/ modification as noted. CATEGORY -IV For information and records. h) Contractor shall resubmit the drawings approved under Category II, III & IV within three (3) weeks of receipt of comments on the drawings, incorporating all comments. Every revision of the drawing shall bear a revision index wherein such revisions shall be highlighted in the form of description or marked up in the drawing identifying the same with relevant revision Number enclosed in a triangle (eg. 1, 2, 3 etc). Contractor shall not make any changes in the portions of the drawing other than those commented. If changes are required to be made in the portions already approved, the			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 20 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Contractor shall resubmit the drawing identifying the changes for Employer's review and approval. Drawings resubmitted shall show clearly the portions where the same are revised marking the relevant revision numbers and Employer shall review only such revised portion of documents. i) In case, the Contractor/ Vendor does not agree with any specific comment, he shall furnish the explanation for the same to NTPC for consideration. In all such cases the Contractor shall necessarily enclose explanations along with the revised drawing (taking care of balance comments) to avoid any delay and/or duplication in review work. j) It is responsibility of the Contractor/ Vendor to get all the drawings approved in the Category I & IV (as the case may be) and complete engineering activities within the agreed schedule. Any delay arising out of submission and modification of drawings shall not alter the contract completion schedule. k) If Contractor/ Vendor fails to resubmit the drawings as per the schedule, construction work at site will not be held up and work will be carried out on the basis of comments furnished on previous issues of the drawing. l) These comments will be taken care by the contractor while submitting the revised drawing. The contractor shall use a single transmittal for drawings. Submission. This shall include transmittal numbers and date, number of copies being sent, names of the agencies to whom copies being sent, drawing number and titles, remarks or special notes if any etc.			
9.00.00	TECHNICAL CO-ORDINATION MEETING			
9.01.00	The Contractor shall be called upon to organise and attend monthly Design/ Technical Co-ordination Meetings (TCMs) with the Employer/Employer's representatives and other Contractors of the Employer during the period of contract. The Contractor shall attend such meetings at his own cost at NEW DELHI / NOIDA or at mutually agreed venue as and when required and fully co-operate with such persons and agencies involved during the discussions.			
9.02.00	The Contractor should note that Time is the essence of the contract. In order to expedite the early completion of engineering activities, the Contractor shall submit all drawings as per the agreed Engineering Information Submission Schedule. The drawings submitted by the Contractor will be reviewed by the Employer as far as practicable within three (3) weeks from the date of receipt of the drawing .The comments of the Employer shall then be discussed across the table during the above Technical Co-ordination Meeting (s) wherein best efforts shall be made by both sides to ensure the approval of the drawing.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 21 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
9.02.01	The Contractor shall ensure availability of the concerned experts / consultants/ personnel who are empowered to take necessary decisions during these meetings. The Contractor shall be equipped with necessary tools and facilities so that the drawings/documents can be resubmitted after incorporating necessary changes and approved during the meeting itself.	
9.02.02	Should any drawing remain unapproved for more than six (6) weeks after it's first submission ,this shall be brought out in the monthly Engineering Progress and Exception Report with reasons thereof.	
9.03.0	Any delays arising out of failure by the Contractor to incorporate Employer's comments and resubmit the same during the TCM shall be considered as a default and in no case shall entitle the Contractor to alter the Contract completion date.	
10.00.00	DESIGN IMPROVEMENTS The Employer or the Contractor may propose changes in the specification of the equipment or quality thereof and if the parties agree upon any such changes the specification shall be modified accordingly. If any such agreed upon change is such that it affects the price and schedule of completion, the parties shall agree in writing as to the extent of any changing the price and/or schedule of completion before the Contractor proceeds with the change. Following such agreement, the provision thereof, shall be deemed to have been amended accordingly.	
11.00.00	EQUIPMENT BASES A cast iron or welded steel base plate shall be provided for all rotating equipment which is to be installed on a concrete base, unless otherwise specifically agreed to by the Employer. Each base plate shall support the unit and its drive assembly, shall be of a neat design with pads for anchoring the units, shall have a raised lip all around, and shall have threaded drain connections.	
12.00.00	PROTECTIVE GUARDS Suitable guards shall be provided for protection of personnel on all exposed rotating and/or moving machine parts. All such guards shall be designed for easy installation and removal for maintenance purpose.	
13.00.00	LUBRICANTS, SERVO FLUIDS AND CHEMICALS	
13.01.00	I. All the first fills of consumables and one years topping requirement of consumables such as greases, oil, lubricants, servo fluids / control fluids, gases and essential chemicals etc. which will be required to put the equipment covered under the scope of specifications, into successful commissioning / initial operation and to establish completion of facilities shall	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2
GENERAL TECHNICAL REQUIREMENTS		PAGE 22 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	be supplied by the Contractor. Suitable standard lubricants as available in India are desired. Efforts should be made to limit the variety of lubricants to minimum. Bidder shall supply a quantity not less than 10 % of the full charge or one (1) year topping requirement mentioned above (whichever is higher) of each variety of lubricants, servo fluids, gases, chemicals etc (as detailed above) which is expected to be utilized during the first year of operation. The additional quantity shall be supplied in separate container.			
13.02.00	As far as possible lubricants marketed by the Indian Oil Corporation shall be used. The variety of lubricants shall be kept to a minimum possible.			
	Detailed specifications for the lubricating oil, grease, gases, servo fluids, control fluids, chemicals etc. required for the complete plant covered herein shall be furnished. On completion of erection, a complete list of bearings/ equipment giving their location and identification marks shall be furnished to the Employer alongwith lubrication requirements.			
14.00.00	LUBRICATION			
14.01.00	Equipment shall be lubricated by systems designed for continuous operation. Lubricant level indicators shall be furnished and marked to indicate proper levels under both standstill and operating conditions.			
15.00.00	MATERIAL OF CONSTRUCTION			
15.01.00	All materials used for the construction of the equipment shall be new and shall be in accordance with the requirements of this specification. Materials utilised for various components shall be those which have established themselves for use in such applications.			
16.00.00	RATING PLATES, NAME PLATES & LABELS			
16.01.00	Each main and auxiliary item of plant including instruments shall have permanently attached to it in a conspicuous position, a rating plate of non-corrosive material upon which shall be engraved manufacturer's name, equipment, type or serial number together with details of the ratings, service conditions under which the item of plant in question has been designed to operate, and such diagram plates as may be required by the Employer.			
16.02.00	Each item of plant shall be provided with nameplate or label designating the service of the particular equipment. The inscriptions shall be approved by the Employer or as detailed in appropriate section of the technical specifications.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 23 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
16.03.00	Such nameplates or labels shall be of white nonhygroscopic material with engraved black lettering or alternately, in the case of indoor circuit breakers, starters, etc. of transparent plastic material with suitably coloured lettering engraved on the back. The name plates shall be suitably fixed on both front and rear side.	
16.04.00	Items of plant such as valves, which are subject to handling, shall be provided with an engraved chromium plated nameplate or label with engraving filled with enamel. The name plates for valves shall be marked in accordance with MSS standard SP-25 and ANSI B 16.34 as a minimum.	
16.05.00	Hanger/ support numbers shall be marked on all pipe supports, anchors, hangers, snubbers and restraint assemblies. Each constant and variable spring support shall also have stamped upon it the designed hot and cold load which it is intended to support. Suitable scale shall also be provided to indicate load on support or hanger.	
16.06.00	Valves, steam traps and strainers shall be identified by Employer's tag number of a metal tap permanently attached to non pressure parts such as the yoke by a stainless steel wire. The direction of flow shall also be marked on the body.	
16.07.00	Safety and relief valves shall be provided with the following: a) Manufacturer's identification. b) Nominal inlet and outlet sizes in mm. c) Set pressure in Kg/cm² (abs). d) Blowdown and accumulation as percentage of set pressure. e) Certified capacity in Kg of saturated steam per hour or in case of liquid certified capacity in litres of water per minute.	
16.08.00	All such plates, instruction plates, etc. shall be bilingual with Hindi inscription first, followed by English. Alternatively, two separate plates one with Hindi and the other with English inscriptions may be provided.	
16.09.00	All segregated phases of conductors or bus ducts, indoor or outdoor, shall be provided with coloured phase plates to clearly identify the phase of the system.	
17.00.00	TOOLS AND TACKLES The Contractor shall supply with the equipment one complete set of all special tools and tackles and other instruments required and other instruments for the erection, assembly, disassembly and proper maintenance of the plant and equipment and systems (including software). These special tools will also include special material handling equipment, jigs and fixtures for maintenance and calibration / readjustment,	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2
GENERAL TECHNICAL REQUIREMENTS		PAGE 24 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	checking and measurement aids etc. A list of such tools and tackles shall be submitted by the Bidder alongwith the offer. The price of each tool / tackle shall be deemed to have been included in the total bid price. These tools and tackles shall be separately packed and sent to site. The Contractor shall also ensure that these tools and tackles are not used by him during erection, commissioning and initial operation. For this period the Contractor should bring his own tools and tackles. In case these tools and tackles are used by the Contractor during erection, commissioning or initial operation the same shall be refurbished repaired/replaced as required to the satisfaction of the Employer before handing over to the Employer. All the tools and tackles shall be of reputed make acceptable to the Employer.	
18.00.00	WELDING	
18.01.00	If the manufacturer has special requirements relating to the welding procedures for welds at the terminals of the equipments to be per formed by others the requirements shall be submitted to the Employer in advance of commencement of erection work.	
19.00.00	COLOUR CODE FOR ALL EQUIPMENTS/ PIPINGS/ PIPE SERVICES	
19.01.00	All equipment/ piping/ pipe services are to be painted by the Contractor in accordance with Employer's standard colour coding scheme, which will be furnished to the Contractor during detailed engineering stage.	
20.00.00	PROTECTION AND PRESERVATIVE SHOP COATING	
20.01.00	PROTECTION All coated surfaces shall be protected against abrasion, impact, discoloration and any other damages. All exposed threaded portions shall be suitably protected with either metallic or a nonmetallic protection device. All ends of all valves and piping and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage. The parts which are likely to get rusted, due to exposure to weather, should also be properly treated and protected in a suitable manner. All primers/paints/coatings shall take into account the hot humid, corrosive & alkaline, subsoil or over ground environment as the case may be. The requirements for painting specification shall be complied with as detailed out in Part-A & B of the Technical Specification.	
20.02.00	PRESERVATIVE SHOP COATING All exposed metallic surfaces subject to corrosion shall be protected by shop application of suitable coatings. All surfaces which will not be easily accessible after the shop assembly, shall be treated beforehand and protected for the life of the	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 25 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	equipment. All surfaces shall be thoroughly cleaned of all mill scales, oxides and other coatings and prepared in the shop. The surfaces that are to be finish-painted after installation or require corrosion protection until installation, shall be shop painted as per the requirements covered in the relevant part of the Technical Specification. Transformers and other electrical equipments, if included shall be shop finished with one or more coats of primer and two coats of high grade resistance enamel. The finished colors shall be as per manufacturer's standards, to be selected and specified by the Employer at a later date.			
20.03.00	Shop primer for all steel surfaces which will be exposed to operating temperature below 95 degrees Celsius shall be selected by the Contractor after obtaining specific approval of the Employer regarding the quality of primer proposed to be applied. Special high temperature primer shall be used on surfaces exposed to temperature higher than 95 degrees Celsius and such primer shall also be subject to the approval of the Employer.			
20.04.00	All other steel surfaces which are not to be painted shall be coated with suitable dust preventive compound subject to the approval of the Employer.			
20.05.00	All piping shall be cleaned after shop assembly by shot blasting or other means approved by the Employer. Lube oil piping or carbon steel shall be pickled.			
20.06.00	Painting for Civil structures and equipment/system covered under this package shall be done as specified under technical requirements on civil works in relevant part of this specifications.			
21.00.00	QUALITY ASSURANCE PROGRAMME			
21.01.00	To ensure that the equipment and services under the scope of contract whether manufactured or performed within the Contractor's works or at his sub-contractor's premises or at the Employer's site or at any other place of work are in accordance with the specifications, the Contractor shall adopt suitable quality assurance programme to control such activities at all points, as necessary. Such programmes shall be outlined by the Contractor and shall be finally accepted by the Employer/authorised representative after discussions before the award of the contract. The QA programme shall be generally in line with ISO-9001/IS-14001. A quality assurance programme of the contractor shall generally cover the following: a) His organisation structure for the management and implementation of the proposed quality assurance programme b) Quality System Manual c) Design Control System			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 26 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	d) Documentation Control System e) Qualification data for Bidder's key Personnel. f) The procedure for purchase of materials, parts, components and selection of sub-contractor's services including vendor analysis, source inspection, incoming raw-material inspection, verification of materials purchased etc. g) System for shop manufacturing and site erection control including process controls and fabrication and assembly controls. h) Control of non-conforming items and system for corrective actions. i) Inspection and test procedure both for manufacture and field activities. j) Control of calibration and testing of measuring testing equipments. k) System for Quality Audits. l) System for indication and appraisal of inspection status. m) System for authorising release of manufactured product to the Employer. n) System for handling storage and delivery. o) System for maintenance of records, and p) Furnishing of quality plans for manufacturing and field activities detailing out the specific quality control procedure adopted for controlling the quality characteristics relevant to each item of equipment/component as per formats enclosed as Annexure-I and Annexure-II respectively.			
22.00.00	GENERAL REQUIREMENTS - QUALITY ASSURANCE			
22.01.00	All materials, components and equipment covered under this specification shall be procured, manufactured, erected, commissioned and tested at all the stages, as per a comprehensive Quality Assurance Programme. An indicative programme of inspection/tests to be carried out by the contractor for some of the major items is given in the respective technical specification. This is, however, not intended to form a comprehensive programme as it is the contractor's responsibility to draw up and implement such programme duly approved by the Employer. The detailed Quality Plans for manufacturing and field activities shall be drawn up by the Bidder and will be submitted to Employer for approval. Schedule of finalisation of such quality plans will be finalised before award on enclosed format No. QS-01-QAI-P-1/F3-R0. Monthly progress reports shall be furnished.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 27 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
22.02.00	Manufacturing Quality Plan will detail out for all the components and equipment, various tests/inspection, to be carried out as per the requirements of this specification and standards mentioned therein and quality practices and procedures followed by Contractor's/ Sub-contractor's/ sub-supplier's Quality Control Organisation, the relevant reference documents and standards, acceptance norms, inspection documents raised etc., during all stages of materials procurement, manufacture, assembly and final testing/performance testing. The Quality Plan shall be submitted on electronic media through C-folders, a web based system of NTPC ERP in addition to hard copy, for review and approval. After approval the same shall be submitted in compiled form on CD-ROM (As per format at Annexure-I)			
22.03.00	Field Quality Plans will detail out for all the equipment, the quality practices and procedures etc. to be followed by the Contractor's "Site Quality Control Organisation", during various stages of site activities starting from receipt of materials/equipment at site (As per format at Annexure – II).			
22.04.00	The Bidder shall also furnish copies of the reference documents/plant standards/acceptance norms/tests and inspection procedure etc., as referred in Quality Plans along with Quality Plans. These Quality Plans and reference documents/standards etc. will be subject to Employer's approval without which manufacturer shall not proceed. These approved documents shall form a part of the contract. In these approved Quality Plans, Employer shall identify customer hold points (CHP), i.e. test/checks which shall be carried out in presence of the Employer's Project Manager or his authorised representative and beyond which the work will not proceed without consent of Employer in writing. All deviations to this specification, approved quality plans and applicable standards must be documented and referred to Employer along with technical justification for approval and dispositioning.			
22.05.00	The contractor shall submit to the Employer Field Welding Schedule for field welding activities in the format enclosed at Annexure-V . The field welding schedule shall be submitted to the Employer along with all supporting documents, like welding procedures, heat treatment procedures, NDT procedures etc. at least ninety days before schedule start of erection work at site.			
22.06.00	The contractor shall have suitable Field Quality Organization with adequate manpower at Employer's site, to effectively implement the Field Quality Plan (FQP) and Field Quality Management System for site activities. The contractor shall submit the details of proposed FQA setup (organizational structure and manpower) for employer's approval. The FQA setup shall be in place at least one month before the start of site activities.			
22.07.00	No material shall be despatched from the manufacturer's works before the same is accepted, subsequent to predespatch final inspection including verification of records of all previous tests/inspections by Employer's Project Manager/Authorised representative and duly authorised for despatch by issuance of Material Despatch			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 28 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Clearance Certificate (MDCC).			
22.08.00	All material used for equipment manufacture including casting and forging etc. shall be of tested quality as per relevant codes/standards. Details of results of the tests conducted to determine the mechanical properties; chemical analysis and details of heat treatment procedure recommended and actually followed shall be recorded on certificates and time temperature chart. Tests shall be carried out as per applicable material standards and/or agreed details			
22.09.00	All welding and brazing shall be carried out as per procedure drawn and qualified in accordance with requirements of ASME Section IX/BS-4870 or other International equivalent standard acceptable to the Employer. All welding/brazing procedures shall be submitted to the Employer or its authorised representative for approval prior to carrying out the welding/brazing.			
22.10.00	All brazers, welders and welding operators employed on any part of the contract either in Contractor's/his sub-contractor's works or at site or elsewhere shall be qualified as per ASME Section-IX or BS-4871 or other equivalent International Standards acceptable to the Employer.			
22.11.00	Welding procedure qualification & Welder qualification test results shall be furnished to the Employer for approval. However, where required by the Employer, tests shall be conducted in presence of Employer/authorized representative.			
22.12.00	For all IBR pressure parts and high pressure piping welding, the latest applicable requirements of the IBR (Indian Boiler Regulations) shall also be essentially complied with. However, other piping system ASME B31.1 or other relevant code as applicable shall be followed. Similarly, any other statutory requirements for the equipment/systems shall also be complied with. On all back-gauged welds MPI/LPI shall be carried before seal welding			
22.13.00	All the heat treatment results shall be recorded on time temperature charts and verified with recommended regimes.			
22.14.00	No welding shall be carried out on cast iron components for repair.			
22.15.00	Unless otherwise proven and specifically agreed with the Employer, welding of dissimilar materials and high alloy materials shall be carried out at shop only.			
22.16.00	All non-destructive examination shall be performed in accordance with written procedures as per International Standards. The NDT operator shall be qualified as per SNT-TC-IA (of the American Society of non-destructive examination) or equivalent. NDT shall be recorded in a report, which includes details of methods and equipment used, result/evaluation, job data and identification of personnel employed and details of co-relation of the test report with the job.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 29 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
22.17.00	In general all plates of thickness greater than 40mm & for pressure parts plates of thickness equal to or greater than 25mm shall be ultrasonically tested otherwise as specified in respective equipment specification. All bar stock/Forging of diameter equal to or greater than 40 mm shall be ultrasonically tested. The Contractor shall list out all major items/ equipment/ components to be manufactured in house as well as procured from sub-contractors (BOI). All the sub-contractor proposed by the Contractor for procurement of major bought out items including castings, forging, semi-finished and finished components/equipment etc., list of which shall be drawn up by the Contractor and finalised with the Employer, shall be subject to Employer's approval on enclosed format No. QS-01-QAI-P-01/F3. The contractor's proposal shall include vendor's facilities established at the respective works, the process capability, process stabilization, QC systems followed, experience list, etc. along with his own technical evaluation for identified sub-contractors enclosed and shall be submitted to the Employer for approval within the period agreed at the time of pre-awards discussion and identified in "DR" category prior to any procurement. Monthly progress reports on sub-contractor detail submission / approval shall be furnished preferably on enclosed format at Annexure-IV. Such vendor approval shall not relieve the contractor from any obligation, duty or responsibility under the contract.			
22.18.00	For components/equipment procured by the contractors for the purpose of the contract, after obtaining the written approval of the Employer, the contractor's purchase specifications and inquiries shall call for quality plans to be submitted by the suppliers. The quality plans called for from the sub-contractor shall set out, during the various stages of manufacture and installation, the quality practices and procedures followed by the vendor's quality control organisation, the relevant reference documents/standards used, acceptance level, inspection of documentation raised, etc. Such quality plans of the successful vendors shall be finalised with the Employer and such approved Quality Plans shall form a part of the purchase order/contract between the Contractor and sub-contractor. Within three weeks of the release of the purchase orders /contracts for such bought out items /components, a copy of the same without price details but together with the detailed purchase specifications, quality plans and delivery conditions shall be furnished to the Employer on the monthly basis by the Contractor along with a report of the Purchase Order placed so far for the contract.			
22.19.00	Employer reserves the right to carry out quality audit and quality surveillance of the systems and procedures of the Contractor's or their sub-contractor's quality management and control activities. The contractor shall provide all necessary assistance to enable the Employer carry out such audit and surveillance.			
22.20.00	The contractor shall carry out an inspection and testing programme during manufacture in his work and that of his sub-contractor's and at site to ensure the			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 30 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	mechanical accuracy of components, compliance with drawings, conformance to functional and performance requirements, identity and acceptability of all materials parts and equipment. Contractor shall carry out all tests/inspection required to establish that the items/equipment conform to requirements of the specification and the relevant codes/standards specified in the specification, in addition to carrying out tests as per the approved quality plan.			
22.21.00	Quality audit/surveillance/approval of the results of the tests and inspection will not, however, prejudice the right of the Employer to reject the equipment if it does not comply with the specification when erected or does not give complete satisfaction in service and the above shall in no way limit the liabilities and responsibilities of the Contractor in ensuring complete conformance of the materials/equipment supplied to relevant specification, standard, data sheets, drawings, etc.			
22.22.00	For all spares and replacement items, the quality requirements as agreed for the main equipment supply shall be applicable.			
22.23.00	Repair/rectification procedures to be adopted to make the job acceptable shall be subject to the approval of the Employer/ authorised representative.			
22.24.00	Environmental Stress Screening All solid state electronic system / equipment / sub assembly shall be free from infant mortile components. For establishing the compliance to this requirement, the contractor / sub – contractor should meet the following. 1) The Contractor / Sub – contractor shall furnish the established procedure being followed for eliminating infant mortile components. The procedure followed by the Contractor / Sub – contractor should be substantiated along with the statistical figures to validate the procedure being followed. The necessary details as required under this clause shall be furnished at the stage of QP finalization. Or In case the Contractor / Sub – contractor do not have any established procedure to eliminate infant mortile components then two or 10% whichever is less, most densely populated Panels shall be tested for Elevated Temperature Cycle Test as per the following procedure. <u>Elevated Temperature Test Cycle</u> During the elevated temperature test which shall be for 48 hours, the ambient temperature shall be maintained at 50° C. The equipment shall be interconnected with devices and kept under energized conditions so as to repeatedly perform all operations it is expected to perform in actual service			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 31 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	with load on various components being equal to those which will be experienced in actual service. During the elevated temperature test the cubicle doors shall be closed (or shall be in the position same as they are supposed to be in the field) and inside temperature in the zone of highest heat dissipating components / modules shall be monitored. The temperature rise inside the cubicle should not exceed 10° C above the ambient temperature at 50° C. In case of any failure during the test cycle, the further course of action should be mutually discussed for demonstrating the intent of the above requirement. 2) <u>Burn in Test Cycle</u> The test shall be conducted on all the panels fully assembled and wired including the panels having undergone the above mentioned elevated temperature test. The period of Burn in Test Cycle shall be 120 hrs and process shall be similar to the elevated temperature test as above except that the temperature shall be reduced to the ambient temperature prevalent at that time. During the above tests, the process I/O and other load on the system shall be simulated by simulated inputs and in the case of control systems; the process which is to be controlled shall also be simulated. Testing of individual components or modules shall not be acceptable. During the Burn in Test the cubicle doors shall be closed (or shall be in the position same as they are supposed to be in the field) and inside temperature in the zone of highest heat dissipating components / modules shall be monitored. The temperature rise inside the cubicle should not exceed 10° C above the ambient temperature.			
22.25.00	The Contractor / Sub-contractor shall carry out routine test on 100% item at contractor / sub-contractor's works. The quantum of check / test for routine & acceptance test by employer shall be generally as per criteria / sampling plan defined in referred standards. Wherever standards have not been mentioned quantum of check / test for routine / acceptance test shall be as agreed during detailed engineering stage.			
23.00.00	QUALITY ASSURANCE DOCUMENTS			
23.01.00	The Contractor shall be required to submit the QA Documentation in two hard copies and two CD ROMs, as identified in respective quality plan with tick (✓)mark.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 32 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
23.01.01	Each QA Documentation shall have a project specific Cover Sheet bearing name & identification number of equipment and including an index of its contents with page control on each document. The QA Documentation file shall be progressively completed by the Supplier's sub-supplier to allow regular reviews by all parties during the manufacturing. The final quality document will be compiled and issued at the final assembly place of equipment before despatch. However CD-Rom may be issued not later than three weeks.			
23.02.00	Typical contents of QA Documentation is as below:- (a.) Quality Plan (b.) Material mill test reports on components as specified by the specification and approved Quality Plans. (c.) Manufacturer / works test reports/results for testing required as per applicable codes and standard referred in the specification and approved Quality Plans. (d.) Non-destructive examination results /reports including radiography interpretation reports. Sketches/drawings used for indicating the method of traceability of the radiographs to the location on the equipment. (e.) Heat Treatment Certificate/Record (Time- temperature Chart) (f.) All the accepted Non-conformance Reports (Major/Minor)/deviation, including complete technical details / repair procedure). (g.) CHP / Inspection reports duly signed by the Inspector of the Employer and Contractor for the agreed Customer Hold Points. (h.) Certificate of Conformance (COC) wherever applicable. (i.) MDCC			
23.03.00	Similarly, the contractor shall be required to submit two sets (two hard copies and two CD ROMs), containing QA Documentation pertaining to field activities as per Approved Field Quality Plans and other agreed manuals/ procedures, prior to commissioning of individual system.			
23.04.00	Before despatch / commissioning of any equipment, the Supplier shall make sure that the corresponding quality document or in the case of protracted phased deliveries, the applicable section of the quality document file is completed. The			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 33 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	supplier will then notify the Inspector regarding the readiness of the quality document (or applicable section) for review. (a.) If the result of the review carried out by the Inspector is satisfactory, the Inspector shall stamp the quality document (or applicable section) for release. (b.) If the quality document is unsatisfactory, the Supplier shall endeavor to correct the incompleteness, thus allowing to finalize the quality document (or applicable section) by time compatible with the requirements as per contract documents. When it is done, the quality document (or applicable section) is stamped by the Inspector. (c.) If a decision is made for despatch, whereas all outstanding actions cannot be readily cleared for the release of the quality document by that time, the supplier shall immediately, upon shipment of the equipment, send a copy of the quality document Review Status signed by the Supplier Representative to the Inspector and notify of the committed date for the completion of all outstanding actions & submission. The Inspector shall stamp the quality document for applicable section when it is effectively completed. The submission of QA documentation package shall not be later than 3 weeks after the despatch of equipment.	
23.05.00	TRANSMISSION OF QA DOCUMENTATION On release of QA Documentation by Inspector, one set of quality document shall be forwarded to Corporate Quality Assurance Department and other set to respective Project Site of Employer. For the particular case of phased deliveries, the complete quality document to the Employer shall be issued not later than 3 weeks after the date of the last delivery of equipment.	
24.00.00	PROJECT MANAGER'S SUPERVISION	
24.01.00	To eliminate delays and avoid disputes and litigation, it is agreed between the parties to the Contract that all matters and questions shall be referred to the Project Manager and without prejudice to the provisions of 'Arbitration' clause in Section GCC, the Contractor shall proceed to comply with the Project Manager's decision.	
24.02.00	The work shall be performed under the supervision of the Project Manager. The scope of the duties of the Project Manager pursuant to the Contract, will include but not be limited to the following:	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 34 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(a.) Interpretation of all the terms and conditions of these documents and specifications (b.) Review and interpretation of all the Contractor's drawing, engineering data, etc (c.) Witness or his authorised representative to witness tests and trials either at the manufacturer's works or at site, or at any place where work is performed under the contract (d.) Inspect, accept or reject any equipment, material and work under the contract (e.) Issue certificate of acceptance and/or progressive payment and final payment certificates (f.) Review and suggest modifications and improvement in completion schedules from time to time, and (g.) Supervise Quality Assurance Programme implementation at all stages of the works.			
25.00.00	INSPECTION, TESTING AND INSPECTION CERTIFICATES			
25.01.00	The word 'Inspector' shall mean the Project Manager and/or his authorised representative and/or an outside inspection agency acting on behalf of the Employer to inspect and examine the materials and workmanship of the works during its manufacture or erection.			
25.02.00	The Project Manager or his duly authorised representative and/or an outside inspection agency acting on behalf of the Employer shall have access at all reasonable times to inspect and examine the materials and workmanship of the works during its manufacture or erection and if part of the works is being manufactured or assembled on other premises or works, the Contractor shall obtain for the Project Manager and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Contractor's own premises or works.			
25.03.00	The Contractor shall give the Project Manager/Inspector fifteen (15) days written notice of any material being ready for testing. Such tests shall be to the Contractor's account except for the expenses of the Inspector's. The Project Manager/Inspector, unless the witnessing of the tests is virtually waived and confirmed in writing, will attend such tests within fifteen (15) days of the date on which the equipment is noticed as being ready for test/inspection failing which the contractor may proceed with test which shall be deemed to have been made in the inspector's presence and he shall forthwith forward to the inspector duly certified copies of test reports in two			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 35 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(2) copies.			
25.04.00	The Project Manager or Inspector shall within fifteen (15) days from the date of inspection as defined herein give notice in writing to the Contractor, or any objection to any drawings and all or any equipment and workmanship which is in his opinion not in accordance with the contract. The Contractor shall give due consideration to such objections and shall either make modifications that may be necessary to meet the said objections or shall inform in writing to the Project Manager/Inspector giving reasons therein, that no modifications are necessary to comply with the contract.			
25.05.00	When the factory tests have been completed at the Contractor's or sub-contractor's works, the Project Manager /Inspector shall issue a certificate to this effect fifteen (15) days after completion of tests but if the tests are not witnessed by the Project Manager /Inspectors, the certificate shall be issued within fifteen (15) days of the receipt of the Contractor's test certificate by the Project Manager /Inspector. Project Manager /Inspector to issue such a certificate shall not prevent the Contractor from proceeding with the works. The completion of these tests or the issue of the certificates shall not bind the Employer to accept the equipment should it, on further tests after erection be found not to comply with the contract.			
25.06.00	In all cases where the contract provides for tests whether at the premises or works of the Contractor or any sub-contractor, the Contractor, except where otherwise specified shall provide free of charge such items as labour, material, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Project Manager /Inspector or his authorised representatives to carry out effectively such tests on the equipment in accordance with the Contractor and shall give facilities to the Project Manager/Inspector or to his authorised representative to accomplish testing.			
25.07.00	The inspection by Project Manager / Inspector and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Contractor in respect of the agreed Quality Assurance Programme forming a part of the contract.			
25.08.00	To facilitate advance planning of inspection in addition to giving inspection notice as specified at clause no 25.03.00 of this chapter, the Contractor shall furnish quarterly inspection programme indicating schedule dates of inspection at Customer Hold Point and final inspection stages. Updated quarterly inspection plans will be made for each three consecutive months and shall be furnished before beginning of each calendar month.			
25.09.00	All inspection, measuring and test equipment used by contractor shall be calibrated periodically depending on its use and criticality of the test/measurement to be done. The Contractor shall maintain all the relevant records of periodic calibration and instrument identification, and shall produce the same for inspection by NTPC. Wherever asked specifically, the contractor shall re-calibrate the measuring/test equipment in the presence of Project Manager / Inspector.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 36 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
25.10.00	Associated document for Quality Assurance programme			
25.10.01	Manufacturing Quality Plan Format No. : QS-01-QAI-P-09/F1-R1 enclosed at Annexure-I.			
25.10.02	Field Quality Plan Format No.: QS-01-QAI-P-09/F2-R1 enclosed at Annexure-II.			
25.10.03	List of items requiring quality plan and sub supplier approval. Format No.: QS-01-QAI-P-01/F3-R0 (Annexure-III).			
25.10.04	Status of items requiring Quality Plan and sub supplier approval. Format enclosed at Annexure-IV.			
25.10.05	Field Welding Schedule Format enclosed at Annexure-V.			
25.11.00	Not Used			
25.12.00	DEMONSTRATION OF APPLICATION ENGINEERING			
25.12.01	Based on NTPC inputs, the Contractor shall prepare and submit typical implemented scheme in their system (Control system & HMI) on sample basis. The typical cases to be covered shall include but not be limited to the following. (i) Logics/Loops: a) Drive logics implementation for each type of binary drive along with its display in HMI. b) Sequence implementation along with its display in HMI. c) Single non-cascade controller implementation. d) Cascade loop implementation. e) Master slave implementation with different slave combination. f) Temperature & pressure compensation for flow signals & pressure compensation for level signals as applicable. (ii) HMI Functions: a) LVS Annunciation. b) Graphics. c) HSR d) Logs/Reports.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 37 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
25.12.02	e) Calculations (Basic & Performance Calculations). The above typical cases shall be finalized with the Employer through Technical Co-ordination meetings. After review and finalization of the typical cases, the implementation of each logic & control loop shall be carried out by the Contractor based on NTPC inputs. After implementation of these logics & loops, the Contractor shall test each logic /loop and record the observations in a format to be provided by the Employer and demonstrate to Employer at Employer premises during engineering finalization. Any modifications as a result of the demonstration shall be done and documented as part of the test report along with the final scheme. Similarly, HMI functions shall also be demonstrated by the Contractor at Employer premises & the results shall be documented as part of test report.	
25.12.03	During the integrated testing at the Contractor's works, only sample checks shall be done by the Employer for the items covered in above application engineering demonstration.	
26.00.00	PRE-COMMISSIONING AND COMMISSIONING FACILITIES	
26.01.00	(a) As soon as the facilities or part thereof has been completed operationally and structurally and before start-up, each item of the equipment and systems forming part of facilities shall be thoroughly cleaned and then inspected jointly by the Employer and the Contractor for correctness of and completeness of facility or part thereof and acceptability for initial pre-commissioning tests, commissioning and start-up at Site. The list of pre-commissioning tests to be performed shall be as mutually agreed and included in the Contractor's quality assurance programme as well as those included in Part-D, Section-VI and elsewhere in the Technical Specifications. (b) The Contractor's pre-commissioning/ commissioning/start-up engineers, specially identified as far as possible, shall be responsible for carrying out all the pre-commissioning tests at Site. On completion of inspection, checking and after the pre-commissioning tests are satisfactorily over, the commissioning of the complete facilities shall be commenced during which period the complete facilities, equipments shall be operated integral with sub-systems and supporting equipment as a complete plant. (c) All piping system shall be flushed, steam blown, air blown as required and cleanliness demonstrated using acceptable industry standards. Procedures to accomplish this work shall be submitted for approval to the Employer six months prior to the respective implementations. The Employer will approve final verification of cleanliness.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 38 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	(d) The time consumed in the inspection and checking of the units shall be considered as a part of the erection and installation period. (e) The check outs during the pre - commissioning period should be programmed to follow the construction completion schedule. Each equipment/system, as it is completed in construction and turned over to Employer's commissioning (start-up) Engineer(s), should be checked out and cleaned. The checking and inspection of individual systems should then follow a prescribed commissioning documentation [SLs(standard check list)/TS(testing schedule)/CS(commissioning schedule)] approved by the employer. (f) The Contractor during initial operation and performance testing shall conduct vibration testing to determine the 'base line' of performance of all plant rotating equipment. These tests shall be conducted when the equipment is running at the base load, peak load as well as lowest sustained operating condition as far as practicable.			
26.01.00	Contractor shall furnish the commissioning organization chart for review & acceptance of employer at least eighteen months prior to the schedule date of synchronization of 1st unit. The chart should contain: (1.) Biodata including experience of the Commissioning Engineers. (2.) Role and responsibilities of the Commissioning Organisation members. (3.) Expected duration of posting of the above Commissioning Engineers at site.			
26.02.00	Initial Operation (a) On completion of all pre-commissioning activities/ tests and as a part of commissioning the complete facilities shall be put on 'Initial Operation' during which period all necessary adjustments shall be made while operating over the full load range enabling the facilities to be made ready for the Guarantee Tests. (b) The 'Initial Operation' of the complete facility as an integral unit shall be conducted for 720 continuous hours. During the period of initial operation of 720 hours, the FGD System shall operate continuously at full load for a period not less than 72 hours. The Initial Operation shall be considered successful, provided that each item/ part of the facility can operate continuously at the specified operating characteristics, for the period of Initial Operation with all operating parameters within the specified limits and at or near the predicted performance of the equipment/ facility.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 39 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
26.03.00	The Contractor shall intimate the Employer about the commencement of initial operation and shall furnish adequate notice to the Employer in this respect. (c) Any loss of generation due to constraints attributable to the Employer shall be construed as Deemed Generation. (d) An Initial Operation report comprising of observations and recordings of various parameters to be measured in respect of the above Initial Operation shall be prepared by the Contractor. This report, besides recording the details of the various observations during initial operation shall also include the dates of start and finish of the Initial Operation and shall be signed by the representatives of both the parties. The report shall have sheets, recording all the details of interruptions occurred, adjustments made and any minor repairs done during the Initial Operation. Based on the observations, necessary modifications/repairs to the plant shall be carried out by the Contractor to the full satisfaction of the Employer to enable the latter to accord permission to carry out the Guarantee tests on the facilities. However, minor defects which do not endanger the safe operation of the equipment, shall not be considered as reasons for with- holding the aforesaid permission.			
	Guarantee Tests a) The final test as to prove the Functional Guarantees shall be conducted at Site by the Contractor in presence of the Employer. The contractor's Commissioning, start-up and initial operation shall make the unit ready to conduct such test. Such test will be commenced, within a period of <u>three (3) months</u> after the successful completion of Initial Operations. Any extension of time beyond the above <u>three (3) months</u> shall be mutually agreed upon. b) These tests shall be binding on both the parties of the Contract to determine compliance of the equipment with the functional guarantee. c) For performance/ demonstration tests instrumentations, of accuracy class shall be as per specified test codes. The numbers and location of the instruments shall be as per the specified test codes. In addition the values of parameters shall be logged from the information system provided under Employer's Distributed Digital Control Monitoring and Information system. Test will be conducted at specified load points. d) Any special equipment, tools and tackles required for the successful completion of the Guarantee Tests shall be provided by the Contractor, free of cost.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 40 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
27.00.00	e) The Guarantee tests and specific tests to be conducted on equipments have been brought out in detail elsewhere in the specifications. TAKING OVER Upon successful completion of Initial Operations and all the tests conducted to the Employer's satisfaction, the Employer shall issue to the Contractor a Taking over Certificate as a proof of the final acceptance of the equipment. Such certificate shall not unreasonably be withheld nor will the Employer delay the issuance thereof, on account of minor omissions or defects which do not affect the commercial operation and/or cause any serious risk to the equipment. Such certificate shall not relieve the Contractor of any of his obligations which otherwise survive, by the terms and conditions of the Contract after issuance of such certificate.	
28.00.00	TRAINING OF EMPLOYER'S PERSONNEL	
28.01.00	Training for Employers O&M Personnel The scope of service under training of Employer's engineers shall include a training module covering upto six (6) man months in the areas of Operation & Maintenance. Such training should enable the personnel to individually take the responsibility of operating and maintaining the FGD system in a manner acceptable to the Employer.	
28.02.00	Training for Employers Engineering Personnel The scope of services under training for Employer's engineering personnel shall also necessarily include two (2) manmonth. This shall cover all disciplines viz, Mechanical, Electrical, C&I, & QA etc. and shall include all the related areas like Design familiarization, training on product design features and product design softwares of major equipment and systems, engineering, manufacturing, erection, commissioning, training on operating features of equipment, quality assurance and testing, plant visits and visits to manufacturer's works, exposure to various kinds of problems which may be encountered in fabrication, manufacturing, erection, welding etc. An indicative module of the training requirement of Employer's Engineering personnel is attached as Annexure-VII.	
28.03.00	Bidder shall furnish in his offer, details of training module(s) covering above requirements which shall be subject to Employer's approval. Consolidated training period included above {i.e. 6 man months (7 man months in case of projects where ZLD system is included in scope) and 3 man months (4 man months in case of projects where ZLD system is included in scope) respectively for O&M and	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 41 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	Engineering) is indicative only. Employer reserves the right to re appropriate the training period between O&M and engineering depending upon the details of training module proposed by the Bidder.	
28.04.00	Exact details, extent of training and the training schedule shall be finalised based on the Bidder's proposal within two (2) months from placement of award.	
28.05.00	In all the above cases, wherever the training of Employer's personnel is arranged at the works of the manufacturer's it shall be noted that the lodging and boarding of the Employer's personnel shall be at the cost of Contractor. The Contractor shall make all necessary arrangements towards the same.	
28.06.00	Take off prices (product wise) should be indicated by the Bidder in the Bid Proposal Sheets. Employer reserves the right to include or exclude these item(s) during placement of Award. Note: For training purposes, one (1) man month implies 30 working days (excluding all intervening holidays) per person.	
29.00.00	SAFETY ASPECTS DURING CONSTRUCTION AND ERECTION In addition to the requirements given in Erection Conditions of Contract (ECC) the following shall also cover: i) Working platforms should be fenced and shall have means of access. ii) Ladders in accordance with Employer's safety rules for construction and erection shall be used. Rungs shall not be welded on columns. All the stairs shall be provided with handrails immediately after its erection.	
30.00.00	NOISE LEVEL The equivalent 'A' weighted sound pressure level measured at a height of 1.5 m above floor level in elevation and at a distance of one (1) metre horizontally from the nearest surface of any equipment/machine, furnished and installed under these specifications, expressed in decibels to a reference of 0.0002 microbar, shall not exceed 85 dBA . However for Ball Mills the noise levels as per following shall also be acceptable: a) Ball Mill < 90 dBA	
31.00.00	PACKAGING AND TRANSPORTATION All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 42 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	time of erection. While packing all the materials, the limitation from the point of view of the sizes of railway wagons available in India should be taken account of. The Contractor shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. The Contractor shall ascertain the availability of Railway wagon sizes from the Indian Railways or any other agency concerned in India well before effecting despatch of equipment. Before despatch it shall be ensured that complete processing and manufacturing of the components is carried out at shop, only restricted by transport limitation, in order to ensure that site works like grinding, welding, cutting & preassembly to bare minimum. The Employer's Inspector shall have right to insist for completion of works in shops before despatch of materials for transportation.			
32.00.00	ELECTRICAL EQUIPMENTS/ENCLOSURES			
32.01.00	All electrical equipments and devices, including insulation, heating and ventilation devices shall be designed for ambient temperature and a maximum relative humidity as specified elsewhere in the specifications.			
33.00.00	INSTRUMENTATION AND CONTROL			
	All instrumentation and control systems/ equipment/ devices/ components, furnished under this contract shall be in accordance with the requirements stated herein, unless otherwise specified in the detailed specifications.			
33.01.00	All instrument scales and charts shall be calibrated and printed in metric units and shall have linear graduation. The ranges shall be selected to have the normal reading at 75% of full scale.			
	All scales and charts shall be calibrated and printed in Metric Units as follows:			
	1. Temperature	-	Degree centigrade (deg C)	
	2. Pressure	-	Kilograms per square centimetre (Kg/cm ²). Pressure instrument shall have the unit suffixed with 'a' to indicate absolute pressure. If nothing is there, that will mean that the indicated pressure is gauge pressure.	
	3. Draught	-	Millimetres of water column (mm wc).	
	4. Vacuum	-	Millimeters of mercury gauge (mm Hg) or water column (mm Wcl).	
	5. Flow (Gas)	-	Tonnes/ hour	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2		GENERAL TECHNICAL REQUIREMENTS
				PAGE 43 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	6. Flow (Steam) - Tonnes/ hour 7. Flow (Liquid) - Tonnes / hour 8. Flow base - 760 mm Hg. 0 deg.C 9. Density - Grams per cubic centimeter.			
33.02.00	All instruments and control devices provided on panels shall be of miniaturized design, suitable for modular flush mounting on panels with front draw out facility and flexible plan-in connection at rear.			
33.03.00	All electronic modules shall have gold plated connector fingers and further all input and output modules shall be short circuit proof. These shall also be tropicalised & components shall be of industrial grade or better.			
34.00.00	ELECTRICAL NOISE CONTROL The equipment furnished by the Contractor shall incorporate necessary techniques to eliminate measurement and control problems caused by electrical noise. Areas in Contractor's equipment which are vulnerable to electrical noise shall be hardened to eliminate possible problems. Any additional equipment, services required for effectively eliminating the noise problems shall be included in the proposal. The equipment shall be protected against ESD as per IEC-61000-2. Radio Frequency interference (RFI) and Electro Magnetic Interference (EMI) protection against hardware damage and control system mal-operations/errors shall be provided for all systems as per EN-50082-2 (1995).			
35.00.00	SURGE PROTECTION FOR SOLID STATE EQUIPMENT All solid state systems /equipment shall be able to withstand the electrical noise and surge as encountered in actual service conditions and inherent in a power plant and shall meet the requirements of surge protection as defined in ANSI C37.90.1-1989 on its suitable equivalent class of IEC 254-4. Details of the features incorporated and relevant tests carried out. The test certificates. etc. shall be submitted by the Bidder.			
36.00.00	INSTRUMENT AIR SYSTEM The instrument air supply system as supplied by the Bidder for various pneumatic control & instrumentation devices like pneumatic actuators, power cylinders, E/P converters, piping / tubing etc. Each pneumatic instrument shall have an individual air shut - off valve. The pressure regulating valve shall be equipped with an internal filter, a 50 mm pressure gauge and a built-in filter housing blow down valve.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 44 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
37.00.00	TAPPING POINTS FOR MEASUREMENTS Tapping points shall include probes, wherever applicable, for analytical measurements and sampling. For direct temperature measurement of all working media, one stub with internal threading of approved pattern shall be provided along with suitable plug and washer. The Contractor will be intimated about thread standard to be adopted. The following shall be provided on equipment by the Bidder. The standard which is to be adopted, will be intimated to the Contractor. i) Temperature test pockets with stub and thermowell ii) Pressure test pockets			
38.00.00	SYSTEM DOCUMENTATION The Bidder shall provide drawings, system overview & description, hardware/software details, technical literature, functional & hardware schemes, bill of material, parts list, interconnection diagrams, data sheets, erection/ installation/ commissioning procedures, instruction/ operating manuals, etc. for each of the C& I system / sub-systems/ equipment supplied under this package. The documentation shall include complete details of the C&I systems/ sub-systems/ equipment to enable review by Employer during detailed engineering stage and to provide information to plant personnel for operation & Maintenance (including quick diagnostics & trouble shooting) of these C&I systems/ sub-systems/ equipment at site. The minimum documentation requirements for C&I systems shall be as stipulated under C&I "Technical Data Sheets" Part of specifications. In addition to this, system documentation for control system shall include as a minimum to that specified elsewhere in the Technical Specification. The exact format, submission schedule and contents of various documents shall be as finalised during detailed engineering stage.			
38.01.00	Bill of material (instrument list) for all C&I equipment/ devices shall be furnished by the bidder in standard formats as approved by the Employer.			
39.00.00	MAINTENANCE MANUALS OF ELECTRONIC MODULES The Contractor shall have to furnish two (2) sets of all maintenance manual of each and every electronic card/module as employed on the various systems and equipment including peripherals etc., offered by him. The Contractor will also have to furnish the data regarding the expected failure rate of various modules and other system components. Further , the contractor shall furnish a set of operating manuals which should include block diagrams ,make, model/type ,details wiring and external			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 45 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	connection drawings etc as required to do the testing and maintenance of the electronic modules.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 46 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	LIST OF CODES AND STANDARDS			
	Indian Standards	Title	International and Internationally recognised standards	
	IS:277	Galvanised steel sheets (plain or corrugated)		
	IS:655	Specification for metal air duct		
	IS:800	Code of practice for use of structural steel in general building construction	BS 449:1969 BS 5950 ASA A57, 1-1952	
	IS:807	Code of practice for design, manufacture, erection and testing (Structural portion) of cranes and hoists 6588 (Issued by Standards Association of Australia). DIN 120:1936 (Sheet 1) DIN 120:1936 (Sheet 2) 327 part-I, 1951 BS 466 part-II, 1960 BS 644:1960 BS 1757:1951 BS 2573:part-I:1960	Draft Revision of A.S. NO. CS.2 SAA Crane and Hoist code Doc:No. BU/4 Rev	
	IS:875	Code of practice for design loads (other than earthquake) for buildings and structures Leading standards (issued by Canadian Standard) DIN-1055-1955 (Issued by ASA)	National Building code of Canada (1953)-Part-IV Design section 4.1	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 47 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:1239 Part-I	Mild steel tubes	(ISO/R 65-1957) (ISO/R-64-1958) (ISO/R-65-1958) (BS 1387 : 1957)	
	IS:1239 Part-II	Mild steel tubulars and other wrought steel pipe fittings	BS 1387 : 1967 BS 1387 :1967 BS 1740 :1965	
	IS:2825	Code for unfired vessels		
	IS:1520	Horizontal centrifugal pumps for clear cold and fresh water		
	IS:1600	Code for practice for performance of constant speed IC Engines for general purpose		
	IS:1601	Specification for performance of constant speed IC Engines for general Purpose		
	IS:1893	Criteria for earthquake resistant design of structures		
	IS1978-1971	Line Pipe April 1969.	API Standards 5L	
	IS:2254-1970	Dimensions of vertical shaft motor for pumps	IEC Pub 72-1 part I NEMA Pub MG 1 1954	
	IS:2266	Steel wire ropes for general engineering purposes	BS :302 : 1968	
	IS:2312	Propellant type Ventilation fans		
	IS:2365	Steel wire suspension ropes for lifts and hoists	BS : 1957	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 48 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
	IS:3346	Method for the determination of thermal conductivity of thermal insulation materials (two slab guarded hot plate method)	DIN 52612 (Deutscher Normenausschuss) ASTM C 163-1964 (American Society of Testing and materials) ASTM C 167-1974 ASTM C 177-1963	
	IS:3354	Outline dimensions for electric lifts.		
	IS:3401	Silica gel		
	IS:3588	Specification for electrical axial flow fans		
	IS:3589	Electrically welded steel pipes for water, gas and sewage (200mm to 2000 mm Nominal Diametre)		
	IS:3677	Unbonded rock and slag wool for thermal insulation		
	IS:3815	Point hook with shank for general engineering purposes	BS 482 - 1968 Doc.:67/3 1284 (Revision of BS 2903) (Issued BS)	
	IS:3895	Specification for monocry-stallines semiconductor rectifier cells and stacks		
	IS:3963	Roof extractor unit		
	IS:3975	Mild steel wires, strips and tapes for armouring cables		
	IS:4503	Shell and tube type heat Exchanger		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 49 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		एनटीपीसी NTPC
IS:4540	Specification for monory-stallines rectifire assembly equipment		
IS:4671	Expanded polystyrene for thermal insulation purpose		
IS:4736	Hot dip zinc coating on steel tubes		
IS:4894	Centrifugal fans		
IS:5456	Code of practice for testing of positive displacement type air compressors and exhauster (For Test Tolerance Only)		
IS:5749	Forged ramshorn hooks	Entwurf DIN 15402 Blett 1 Entwurf DIN 15402 BS 3017-1958	
IS:6392	Steel pipe flanges	BS 4504 : 1969	
IS:6524 Part-I	Code of practice for design of tower cranes Static and rail mounted	BS 2799 : 1956	
IS:7098	Cross linked Polyethylene insulated PVC sheathed cables	Standard No. 1 to IPCEA (USA) Pub. No. 5-66-524	
IS:7373	Specification for wrought aluminium and aluminium sheet and strips		
IS:7938	Air receivers for compressed air installation		
ISO:1217	Displacement compressor-Acceptance test		
ASHRAE-33 and air heating coils.	Methods of testing for rating of forced circulation air cooling		
ASHRAE-52-76	Air cleaning device used in general ventilation for removing particle matter.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS
			PAGE 50 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	ASHRAE-22-72 Method of testing for rating of water cooled refrigerant condensers. ASHRAE 23-67 Methods of testing for rating of positive displacement refrigerant compressors. ARI-450-6 Standard for water cooled refrigerant condensers. ARI-550 Standard for centrifugal water chilling packages. ARI-410 Standard for forced circulation air cooling and air heating coils ARI-430/435 Central station AHU/Application of Central Station AHU BS:848 Fans (Part-1,2) BS:400 Low carbon steel cylinders for the storage & transport of permanent gases. BS:401 Low carbon steel cylinders for the storage & transport of liquified gases. CTI Code Acceptance test code for Water Cooling Tower. ACT-105 ANSI-31.5 Refrigerant piping ASME-PTC- Atmospheric Water Cooling Equipment 23-1958 AMCA A-21C Test Code for air moving devices API:618 Reciprocating Compressor for general refinery services. HYDRAULIC INSTITUTE STANDARDS. HYDRANT SYSTEM MANUALS OF TAC. TAC MANUALS OF SPRAY SYSTEM NFPA USA/ NSC UK/ UL USA/ FM USA STANDARDS. INDIAN EXPLOSIVES ACT. INDIAN FACTORIES ACT. STANDARD OF TUBULAR EXCHANGER MANUFACTURER'S ASSOCIATION.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 51 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	CODE AND STANDARD FOR CIVIL WORKS Some of the applicable Standards, Codes and references are as follows: Excavation & Filling IS: 2720 (Part-II, IV TO VIII, XIV, XXI, XXIII, XXIV, XXVII TO XXIX, XL) Methods of test for soils-determination for water content etc. IS: 4701 Code of practice for earth work on canals. IS: 9758 Guide lines for Dewatering during construction. IS: 10379 Code of practice for field control of moisture and compaction of soils for embankment and sub-grade. Properties, Storage and Handling of Common Building Materials IS: 269 Specification for ordinary Portland cement, 33 grade. IS: 383 Specification for coarse and fine aggregates from natural sources for concrete. IS: 432 Specification for mild steel and (Parts 1&2) medium tensile steel bars and hard-drawn steel wires for concrete reinforcement. IS: 455 Specification for Portland slag cement. IS: 702 Specification for Industrial bitumen. IS: 712 Specification for building limes. IS: 808 Rolled steel Beam channel and angle sections. IS: 1077 Specification for common burnt clay building bricks. IS: 1161 Specification of steel tubes for structural purposes. IS: 1363 Hexagon head Bolts, Screws and nuts of production grade C. IS: 1364 Hexagon head Bolts, Screws and Nuts of Production grade A & B. IS: 1367 Technical supply conditions for Threaded fasteners. IS: 1489 Specification for Portland-pozzolana cement: (Part-I) Fly ash based.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 52 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	(Part-II)	Calcined clay based.	
	IS: 1542	Specification for sand for plaster.	
	IS: 1566	Specification for hard-drawn steel wire fabric for concrete reinforcement.	
	IS: 1786	Specification for high strength deformed bars for concrete reinforcement.	
	IS: 2062	Specification for steel for general structural purposes.	
	IS: 2116	Specification for sand for masonry mortars.	
	IS: 2386 (Parts-I to VIII)	Testing of aggregates for concrete.	
	IS: 3150	Hexagonal wire netting for general purpose.	
	IS: 3495 (Parts-I to IV)	Methods of tests of burnt clay building bricks.	
	IS: 3812	Specification for fly ash, for use as pozzolana and admixture.	
	IS: 4031	Methods of physical tests for hydraulic cement.	
	IS: 4032	Methods of chemical analysis of hydraulic cement.	
	IS: 4082	Recommendations on stacking and storage of construction materials at site.	
	IS: 8112	Specification for 43 grade ordinary portland cement.	
	IS: 8500	Medium and high strength structural steel.	
	IS: 12269	53 grade ordinary portland cement.	
	IS: 12894	Specification for Fly ash lime bricks.	
	Cast-In-Situ Concrete and Allied Works		
	IS: 280	Specification for mild steel wire for general engineering purposes.	
	IS: 456	Code of practice for plain and reinforced concrete.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 53 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
	IS: 457 IS: 516 IS: 650 IS: 1199 IS: 1791 IS: 1838 (Part-I) IS: 2204 IS: 2210 IS: 2438 IS: 2502 IS: 2505 IS: 2506 IS: 2514 IS: 2645 IS: 2722 IS: 2750 IS: 2751 IS: 3025 IS: 3366 IS: 3370	Code of practice for general construction of plain & reinforced concrete for dams & other massive structures. Method of test for strength of concrete. Specification for standard sand for testing of cement. Methods of sampling and analysis of concrete. General requirements for batch type concrete mixers. Specification for preformed fillers for expansion joints in concrete pavements and structures (non-extruding and resilient type). Code of practice for construction of reinforced concrete shell roof. Criteria for the design of reinforced concrete shell structures and folded plates. Specification for roller pan mixer. Code of practice for bending and fixing of bars for concrete reinforcement. General requirements for concrete vibrators, immersion type. General requirements for concrete vibrators, screed board type. Specification for concrete vibrating tables. Specification for Integral cement water proofing compounds. Specification for portable swing weigh batches for concrete. (single and double bucket type) Specification for Steel scaffolding. Code of practice for welding of mild steel plain and deformed bars for reinforced concrete construction. Methods of sampling and test waste water. Specification for Pan vibrators. Code of practice for concrete structures for the storage of		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 54 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	(Part I to IV) liquids. IS: 3414 Code of practice for design and installation of joints in buildings. IS: 3550 Methods of test for routine control for water used in industry. IS: 3558 Code of practice for use of immersion vibrators for consolidating concrete. IS: 4014 Code of practice for steel tubular scaffolding. (Parts I & II) IS: 4326 Code of practice for earthquake resistant design and construction of buildings. IS: 4461 Code of practice for joints in surface hydro-electric power stations. IS: 4656 Specification for form vibrators for concrete. IS: 4925 Specification for batching and mixing plant. IS: 4990 Specification for plywood for concrete shuttering work. IS: 4995 Criteria for design of reinforced concrete bins for the storage of granular and powdery materials. (Parts I & II) IS: 5256 Code or practice for sealing joints in concrete lining on canals. IS: 5525 Recommendations for detailing of reinforcement in reinforced concrete work. IS: 5624 Specification for foundation bolts. IS: 6461 Glossary of terms relating to cement concrete. IS: 6494 Code of practice for water proofing of underground water reservoirs and swimming pools. IS: 6509 Code of practice for installation of joints in concrete pavements. IS: 7861 Code of practice for extreme weather concreting. (Parts I & II) IS: 9012 Recommended practice for shot concreting. IS: 9103 Specification for admixtures for concrete.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 55 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS: 9417 Recommendations for welding cold worked steel bars for reinforced concrete construction. IS: 10262 Recommended guidelines for concrete mix design. IS: 11384 Code of practice for composite construction in structural steel and concrete. IS: 11504 Criteria for structural design of reinforced concrete natural draught cooling towers. IS: 12118 Specification for two-parts poly sulphide. IS: 12200 Code of practice for provision of water stops at transverse contraction joints in masonry and concrete dams. IS: 13311 Method of non-destructive testing of concrete. Part-1 Ultrasonic pulse velocity. Part-2 Rebound hammer. SP:23 Handbook of concrete mixes SP: 24 Explanatory Handbook on IS: 456-1978 SP: 34 Handbook on concrete reinforcement and detailing. Precast Concrete Works SP: 7(PartVII/ National Building Code- Structural design of prefabrication and Sec.7) systems building. IS: 10297 Code of practice for design and construction of floors and roofs using precast reinforced/prestressed concrete ribbed or cored slab units. IS: 10505 Code of practice for construction of floors and roofs using pre-cast reinforced concrete units. Masonry and Allied Works IS: 1905 Code of Practice for Structural Safety of Buildings-Masonry walls. IS: 2212 Code of Practice for Brickwork.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 56 OF 83