

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	IS: 2250 Code of Practice for Preparation and use of Masonry Mortar. SP: 20 Explanatory hand book on masonry code. Sheeting Works IS:277 Galvanised steel sheets (plain or corrugated). IS: 459 Unreinforced corrugated and semi-corrugated asbestos cement sheets. IS: 513 Cold-rolled carbon steel sheets. IS: 730 Specification for fixing accessories for corrugated sheet roofing. IS: 1626 Specification for Asbestos cement building pipes and pipe fittings, gutters and gutter fittings and roofing fittings. IS: 2527 Code of practice for fixing rain water gutters and down pipe for roof drainage. IS: 3007 Code of practice for laying of asbestos cement sheets. IS: 5913 Methods of test for asbestos cement products. IS: 7178 Technical supply conditions for tapping screw. IS: 8183 Bonded mineral wool. IS: 8869 Washers for corrugated sheet roofing. IS: 12093 Code of practice for laying and fixing of sloped roof covering using plain and corrugated galvanised steel sheets. IS: 12866 Plastic translucent sheets made from thermosetting polyester resin (glass fibre reinforced). IS: 14246 Specification for continuously pre-painted galvanised steel sheets and coils. Fabrication and Erection of Structural Steel Work IS: 2016 Specification for plain washers.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 57 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	IS: 814 Specification for covered Electrodes for Metal Arc Welding for weld steel. IS: 1852 Specification for Rolling and Cutting Tolerances for Hot rolled steel products. IS: 3502 Specifications for chequered plate. IS: 6911 Specification for stainless steel plate, sheet and strip. IS: 3757 Specification for high strength structural bolts IS: 6623 Specification for high strength structural nuts. IS: 6649 High Tensile friction grip washers. IS: 800 Code of practice for use of structural steel in general building construction. IS: 816 Code of practice for use of Metal Arc Welding for General Construction. IS: 4000 Code of practice for assembly of structural joints using high tensile friction grip fasteners. IS: 9595 Code of procedure of Manual Metal Arc Welding of Mild Steel. IS: 817 Code of practice for Training and Testing of Metal Arc Welders. IS: 1811 Qualifying tests for Metal Arc Welders (engaged in welding structures other than pipes). IS: 9178 Criteria for Design of steel bins for storage of Bulk Materials. IS: 9006 Recommended Practice for Welding of Clad Steel. IS: 7215 Tolerances for fabrication steel structures. IS: 12843 Tolerance for erection of structural steel. IS: 4353 Recommendations for submerged arc welding of mild steel and low alloy steels. SP: 6 (Part 1 to 7) ISI Hand book for structural Engineers.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 58 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS: 1608 Method of Tensile Testing of Steel products other than sheets, strip, wire and tube. IS: 1599 Method of Bend Tests for Steel products other than sheet, strip, wire and tube IS : 228 Methods of chemical Analysis of pig iron, cast iron and plain carbon and low alloy steel. IS : 2595 Code of Practice for Radio graphic testing. IS : 1182 Recommended practice for Radiographic Examination of fusion welded butt joints in steel plates. IS : 3664 Code of practice for Ultra sonic Testing by pulse echo method. IS : 3613 Acceptance tests for wire flux combination for submerged Arc Welding. IS : 3658 Code of practice for Liquid penetrant Flaw Detection. IS : 5334 Code of practice for Magnetic Particle Flaw Detection of Welds. Plastering and Allied Works IS : 1635 Code of practice for field slaking of Building lime and preparation of putty. IS : 1661 Application of cement and cement lime plaster finishes. IS : 2333 Plaster-of-paris. IS : 2402 Code of practice for external rendered finishes. IS : 2547 Gypsum building plaster. IS : 3150 Hexagonal wire netting for general purpose. Acid and Alkali Resistant Lining IS : 158 Ready mixed paint, brushing, bituminous, black, lead free, acid, alkali & heat resisting. IS : 412 Specification for expanded metal steel sheets for general purpose.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 59 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS : 4441 Code of practice for use of silicate type chemical resistant mortars. IS : 4443 Code of practice for use of resin type chemical resistant mortars. IS : 4456 Method of test for chemical resistant tiles. (Part I & II) IS : 4457 Specification for ceramic unglazed vitreous acid resistant tiles. IS : 4832 Specification for chemical resistant mortars. Part I Silicate type Part II Resin type Part III Sulphur type IS : 4860 Specification for acid resistant bricks. IS : 9510 Specification for bitumasitc, Acid resisting grade. Water Supply, Drainage and Sanitation IS : 458 Specification for concrete pipes. IS : 554 Dimensions for pipe threads, where pressure tight joints are made on thread. IS : 651 Specification for salt glazed stoneware pipes. IS : 774 Flushing cisterns for water closets and urinals. IS : 775 Cast iron brackets and supports for wash basins and sinks. IS : 778 Copper alloy gate, globe and check valves for water works purposes. IS : 781 Cast copper alloy screw down bib taps and stop valves for water services. IS : 782 Caulking lead. IS : 783 Code of practice for laying of concrete pipes.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 60 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC
	IS : 1172 Basic requirements for water supply, drainage and sanitation. IS : 1230 Cast iron rain water pipes and fittings. IS : 1239 Mild steel tubes, tubulars and other wrought steel fittings. IS : 1536 Centrifugally cast (Spun) iron pressure pipes for water, gas and sewage. IS : 1537 Vertically cast iron pressure pipes for water, gas and sewage. IS : 1538 Cast iron fittings for pressure pipe for water, gas and sewage. IS : 1703 Ball valves (horizontal plunger type) including float for water supply purposes. IS : 1726 Cast iron manhole covers and frames. IS : 1729 Sand cast iron spigot and socket, soil, water and ventilating pipes, fittings and accessories. IS : 1742 Code of practice for building drainage. IS : 1795 Pillar taps for water supply purposes. IS : 1879 Malleable cast iron pipe fittings. IS : 2064 Code of practice for selection, installation and maintenance of sanitary appliances. IS : 2065 Code of practice for water supply in building. IS : 2326 Automatic flushing cisterns for urinals. IS : 2470 (Part-I & II) Code of practice for installation of septic tanks. IS : 2501 Copper tubes for general engineering purposes. IS : 2548 Plastic seat and cover for water-closets. IS : 2556 (Part 1 to 15) Vitreous sanitary appliances (vitreous china). IS : 2963 Non-ferrous waste fittings for wash basins and sinks.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS
PAGE 61 OF 83		

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS : 3114 Code of practice for laying of cast iron pipes. IS : 3311 Waste plug and its accessories for sinks and wash basins. IS : 3438 Silvered glass mirrors for general purposes. IS : 3486 Cast iron spigot and socket drain pipes. IS : 3589 Electrically welded steel pipes for water, gas and sewage (200mm to 2000mm nominal diameter). IS : 3989 Centrifugally cast (Spun) iron spigot and socket soil, waste and ventilating pipes, fittings and accessories. IS : 4111 (Part I to IV) Code of practice for ancillary structure in sewerage system. IS : 4127 Code of practice for laying of glazed stone-ware pipes. IS : 4764 Tolerance limits for sewage effluents discharged into inland-surface waters. IS : 4827 Electro plated coating of nickel and chromium on copper and copper alloys. IS : 5329 Code of practice for sanitary pipe work above ground for buildings. IS : 5382 Rubber sealing rings for gas mains, water mains and sewers. IS : 5822 Code of practice for laying of welded steel pipes for water supply. IS : 5961 Cast iron grating for drainage purpose. IS : 7740 Code of practice for road gullies. IS : 8931 Cast copper alloy fancy bib taps and stop valves for water services. IS : 8934 Cast copper alloy fancy pillar taps for water services. IS : 9762 Polyethylene floats for ball valves. IS : 10446 Glossary of terms for water supply and sanitation.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 62 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS : 10592 Industrial emergency showers, eye and face fountains and combination units. IS : 12592 Specification for precast concrete manhole covers and frames. IS : 12701 Rotational moulded polyethylene water storage tanks. SP: 35 Hand book on water supply and drainage. - Manual on Sewerage and sewage treatment (Published by CPH & EEO) As updated. Doors, Windows and Allied Works IS : 204 Tower Bolts Part-I Ferrous metals. Part-II Nonferrous metals. IS : 208 Door Handles. IS : 281 Mild steel sliding door bolts for use with padlocks. IS : 362 Parliament Hinges. IS : 420 Specification for putty, for use on metal frames. IS : 1003 Specification for timber panelled and glazed shutters- Part-I door (Part-I) shutters. IS : 1038 Steel doors, windows and ventilators. IS : 1081 Code of practice for fixing and glazing of metal (steel and aluminium) doors, windows and ventilators. IS : 1341 Steel butt hinges. IS : 1361 Steel windows for industrial buildings. IS : 1823 Floor door stoppers. IS : 1868 Anodic coatings on Aluminium and its alloys. IS : 2202 Specification for wooden flush door shutters (solid core type); (Part-II) particle board face panels and hard board face panels	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 63 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	IS:2209 Mortice locks (vertical type). IS:2553 Safety glass IS:2835 Flat transparent sheet glass. IS:3548 Code of practice for glazing in buildings. IS:3564 Door closers (Hydraulically regulated). IS : 3614 Fire check doors; plate, metal covered and rolling type. IS:4351 Steel door frames. IS:5187 Flush bolts. IS:5437 Wired and figured glass IS:6248 Metal rolling shutters and rolling grills. IS:6315 Floor springs (hydraulically regulated) for heavy doors. IS:7196 Hold fasts. IS:7452 Hot rolled steel sections for doors, windows and ventilators. IS:10019 Mild steel stays and fasteners. IS:10451 Steel sliding shutters (top hung type). IS:10521 Collapsible gates. R oof Water Proofing and Allied Works IS:1203 Methods of testing tar and bitumen. IS:1322 Specification for bitumen felts for water proofing and damp proofing. IS:1346 Code of practice for water proofing of roofs with bitumen felts. IS:1580 Specification for bituminous compound for water proofing and caulking purposes.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 64 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS:3067 Code of practice for general design details and preparatory work for damp proofing and water proofing of buildings. IS:3384 Specification for bitumen primer for use in water proofing and damp proofing. Floor Finishes and Allied Works IS:1237 Specification for cement concrete flooring tiles. IS:1443 Code of practice for laying and finishing of cement concrete flooring tiles. IS:2114 Code of practice for laying in-situ terrazzo floor finish. IS:2571 Code of practice for laying in-situ cement concrete flooring. IS:3462 Specification for unbacked flexible PVC flooring. IS:4971 Recommendations for selection of industrial floor finishes. IS:5318 Code of practice for laying of flexible PVC sheet and tile flooring. IS:8042 Specification for white portland cement. IS:13801 Specification for chequered cement concrete flooring tiles. Painting and Allied Works IS:162 Specification for fire resisting silicate type, brushing, for use on wood, colour as required. IS:1477 Code of practice for painting of ferrous metals in buildings. Part-I Pretreatment. Part-II Painting. IS:1650 Specification for colours for building and decorative finishes. IS:2074 Specification for red oxide-zinc chrome, priming, ready mixed paint air drying. IS:2338 Code of practice for finishing of wood and wood based materials. Part-I Operations and workmanship	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 65 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS		
	Part-II	Schedules	
	IS:2395	Code of practice for painting concrete, masonry and plaster surfaces.	
	Part-I	Operations and workmanship.	
	Part-II	Schedule.	
	IS:2524	Code of practice for painting of nonferrous metals in buildings.	
	Part-I	Pretreatment.	
	Part-II	Painting.	
	IS:2932	Specification of synthetic enamel paint, exterior, under-coating and finishing.	
	IS:2933	Specification enamel paint, under coating and finishing.	
	IS:4759	Code of practice for hot dip zinc coating on structural steel and other allied products.	
	IS:5410	Specification for cement paint	
	IS:5411 (Part-I)	Specification for plastic emulsion paint-for exterior use	
	IS:6278	Code of practices for white washing and colour washing.	
	IS:10403	Glossary of terms relating to building finishes.	
	Piling and Foundation		
	IS:1080	Code of practice for design and construction of simple spread foundations.	
	IS:1904	Code of practice for design and construction of foundations in Soils; General Requirements.	
	IS:2911	Code of practice for designs and construction of Pile foundations (Relevant Parts).	
	IS:2950	Code of practice for designs and construction of Raft (Part-I) foundation.	
	IS:2974 (Part-I TO V)	Code of practice for design and construction of machine foundations.	
	IS:6403	Code of practice for determination of Allowable Bearing pressure on Shallow foundation.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS
			PAGE 66 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IS:8009 Code of practice for calculation of settlement of foundation subjected to symmetrical vertical loads. Part-I Shallow foundations. Part-II Deep foundations. IS:12070 Code of practice for design and construction of shallow foundations on rocks. DIN:4024 Flexible supporting structures for machines with rotating machines. VDI:2056 Criteria for assessing mechanical vibrations of machines. VDI:2060 Criteria for assessing rotating imbalances in machines. Stop Log and Trash Rack IS:4622 Recommendations for fixed - wheel gates structural design. IS:5620 Recommendations for structural design criteria for low head slide gates. IS:11388 Recommendations for design of trash rack for intakes. IS:11855 General requirements for rubber seals for hydraulic gates. Roads IRC:5 Standard specifications and Code of practice for road bridges, section-I general Features of Design. IRC:14 Recommended practice of 2cm thick bitumen and tar carpets. IRC:16 Specification for priming of base course with bituminous primers. IRC:19 Standard specifications and code of practice for water bound macadam. IRC:21 Standard specifications and Code of practice for road bridges, section-III - Cement concrete (plain and reinforced). IRC:34 Recommendations for road construction in waterlogged areas. IRC:36 Recommended practice for the construction of earth embankments for road works. IRC:37 Guidelines for the Design of flexible pavements. IRC:56 Recommended practice for treatment of embankment slopes for erosion control. IRC:73 Geometric design standards for rural (non-urban) highways. IRC:86 Geometric Design standards for urban roads in plains.	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 67 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	
	IRC:SP:13 Guidelines for the design of small bridges & culverts. IRC - Public- Ministry of Surface Transport (Roads Wing), Specifications ation for road and bridge works. IS:73 Specification for paving bitumen Loadings IS:875 Code of practice for design loads other than earthquake) for (Pt. I to V) buildings and structures. IS:1893 Criteria for earthquake resistant design of structures. IS:4091 Code of Practice for design and construction of foundation for transmission line towers & poles. IRC:6 Standard specifications & code of practice for road bridges, Section-II Loads and stresses. M.O.T. Deptt. of railways Bridge Rules. Safety IS:3696 Safety code for scaffolds and ladders. (Part I & II) IS:3764 Safety code for excavation work. IS:4081 Safety code for blasting and related drilling operations. IS:4130 Safety code for demolition of buildings. IS:5121 Safety code for piling and other deep foundations. IS:5916 Safety code for construction involving use of hot bituminous materials. IS:7205 Safety code for erection on structural steelwork. IS:7293 Safety code for working with construction machinery. IS:7969 Safety code for handling and storage of building materials IS:11769 Guidelines for safe use of products containing asbestos. - Indian Explosives Act. 1940 as updated. Architectural design of buildings SP:7 National Building Code of India SP:41 Hand book on functional requirements of buildings (other than industrial buildings)	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS PAGE 68 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	Miscellaneous IS:802 Code of practice for use of structural steel in (Relevant parts) overhead transmission line towers. IS:803 Code of practice for design, fabrication and erection of vertical mild steel cylindrically welded in storage tanks. IS:10430 Criteria for design of lined canals and liner for selection of type of lining. IS:11592 Code of practice for selection and design of belt conveyors. IS:12867 PVC handrails covers. CIRIA Design and construction of buried thin-wall pipes. Publication REFERENCE CODES AND STANDARDS FOR CONTROL AND INSTRUMENTATION The design, manufacture, inspection, testing & installation of all equipment and system covered under this specification shall conform to the latest editions of codes and standards mentioned below and all other applicable VDE, IEEE, ANSI, ASME, NEC, NEMA, ISA AND Indian Standards and their equivalents. Temperature Measurements - Instrument and apparatus for temperature measurement - ASME PTC 19.3 (1974). - Temperature measurement - Thermocouples ANSI MC 96.1 - 1982. - Temperature measurement by electrical Resistance thermometers - IS:2806. - Thermometer - element - Platinum resistance - IS:2848. Pressure Measurements - Instruments and apparatus for pressure measurement - ASME PTC 19.2 (1964). - Electronic transmitters BS:6447. - Bourdon tube pressure and vacuum gauges - IS:3624 - 1966. - Process operated switch devices (Pr. Switch) BS-6134.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 69 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	Flow Measurements Instruments and apparatus for flow measurements - ASME PTC 19.5 (1972) Interim supplement, Part-II. Measurement of fluid flow in closed conduits - BS-1042. Electronic Measuring Instrument & Control Hardware/ Software - Automatic null balancing electrical measuring instruments - ANSI C 39.4 (Rev. 1973); IS:9319. - Safety requirements for electrical and electronic measuring and controlling instrument - ANSI C 39.5 - 1974. - Compatibility of analog signals for electronic industrial process instruments - ISA - S 50.1 (1982) ANSI MC 12.1 - 1975. - Dynamic response testing of process control instrumentation ISA - S 26 (1968). - Surge Withstand Capability (SWC) tests - ANSI C 37.90 a/IEEE-472 or suitable class of IEC-255-4 equivalent to ANSI C37.90a/IEEE-472. - Printed circuit boards - IPC TM - 650, IEC 326 C. - General requirement and tests for printed wiring boards - IS 7405 (Part-I) 1973. - Edge socket connectors - IEC 130-11. - Requirements and methods of testing of wire wrap terminations DIN 41611 Part-2. - Dimensions of attachment plugs & receptacles - ANSI C 73 - 1973 (Supplement ANSI C 73 a - 1980). - Direct acting electrical indicating instrument - IS:1248 - 1968 (R). - Standard Digital Interface for Programmable Instrumentation - IEEE-488.2 - 1990. - Information Processing Systems - Local Area Networks - Part 2 : Logical Link Control - IEEE-802.2 - 1989. - Standard for Local Area Networks : Carrier Sense Multiple Access with Collision Detection - IEEE-802.3 - 1985. - Supplements A, B, C and E to Carrier Sense Multiple Access with Collision Detection - IEEE-802.3 - 1988.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 70 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	16. Standard for Local Area Networks : Token - Passing Bus Access Method - IEEE-802.4 - 1985. 17. Standard for Local Area Networks : Token - Ring Access Method and Physical Layer Specification - IEEE-802.5 - 1985. 18. IEEE Guide to Software Requirements Specifications - IEEE-830 - 1984. 19. Hardware Testing of Digital Process Computers - ISA RP55.1 - 1983. 20. Electromagnetic Susceptibility of Process Control Instrumentation - SAMA PMC 33.1 - 1978. 21. Interface Between the Data Terminal Equipment and Data Circuit - Terminating Equipment Employing Serial Binary Data Interchange - EIA-232-D-1987. 22. Electromagnetic Compatibility for Industrial Process Measurement and Control Equipment, Part 3 : Radiated Electromagnetic Field Requirements - IEC 801-3-1984. Instrument Switches and Contact 1. Contact rating - AC services NEMA ICS 2 - 1978 (with revision through May 1983), Part - 2-125, A6000. 2. Contact rating - DC services NEMA ICS 2-1978 Part-2 125, N600. Enclosures 1. Type of Enclosures - NEMA ICS Part - 6 - 1978 (with Rev. 1 4/80) through 110.22 (Type 4 to 13). 2. Racks, panels and associated equipment - EIA : RS - 310 C- 1983 (ANSI C 83.9 - 1972). 3. Protection class for Enclosures, cabinets, control panels & desks - IS:2147 - 1962. Apparatus, enclosures and installation practices in hazardous area 1. Classification of hazardous area - NFPA 70 - 1984, Article 500. 2. Electrical Instruments in hazardous dust location - ISA - 512.11, 1973. 3. Intrinsically safe apparatus - NFPA 493 1978. 4. Purged and pressurised enclosure for electrical equipment in hazardous location - NFPA 496-1982. 5. Enclosures for Industrial Controls and Systems - NEMA IS 1.1 - 1977.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 71 OF 83

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	Sampling System 1. Stainless steel material of tubing and valves for sampling system - ASTM A 296-82, Grade 7 P 316. 2. Submerged helical coil heat exchangers for sample coolers ASTM D11 92-1977. 3. Water and steam in power cycle - ASME PTC 19.11. 4. Standard methods of sampling system - ASTM D 1066-99. Annunciators 1. Specifications and guides for the use of general purpose annunciators - ISA S 19.1, 1979. 2. Surge withstand capability tests - ANSI C 37.90a - 1989/IEEE-472 or suitable class of IEC 255-4 equivalent to ANSI C37.90a 1989/IEEE-472 3. Damp heat cycling test - IS:2106 4. Specification for Electromagnetic Susceptibility - SAMA DMC 33, 1/78 Protections 1. Relays and relay system associated with electric power apparatus. ANSI C 37.90, 1 - 1989. 2. General requirements & tests for switching devices for control and auxiliary circuits including contactor relays - IS:6875 (Part-I) - 1973. 3. Turbine water damage prevention - ASME TDP-1-1980. 4. Boiler safety interlocks - NFPA 85 - 2011 or latest version. UPS System 1. Practices and requirements for semi-conductor power rectifiers - ANSI C 34.2, 1973. 2. Relays and relays system associated with electrical power apparatus - ANSI C 3.90 - 1983. 3. Surge withstand capability test - ANSI C 37.90 1 -1989. 4. Performance testing of UPS - IEC 146. 5. Stationary cells & Batteries Lead Acid type (with tubular positive plates) specification IS-1651-1991.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 72 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	6. Recommended practice for sizing large lead storage batteries for generating stations & sub-stations - IEEE-485-1985. 7. Printed Circuit Board - IPC TM 650, IEC 326C. 8. General Requirements & tests for printed wiring boards, IS:7405 (Part-I) 1973. Control Valves 1. Control valve sizing - Compressible & Incompressible fluids - ISA S 75.01-1985. 2. Face to face dimensions of control valves - ANSI B 16.00 - 1973. 3. ISA Hand Book of Control Valves - (ISBN : B: 1047-087664-234-2). 4. Codes for pressure piping - ANSI B 31.1 5. Control Valve leak class - ISA RP 39.6 Process Connection & Piping 1. Codes for pressure piping "power piping" - ANSI B 31.1. 2. Seamless carbon steel pipe ASTM - A - 106. 3. Forged & Rolled Alloy steel pipe flanges, forged fittings and valves and parts - ASTM - A - 182. 4. Material for socket welded fittings - ASTM - A - 105. 5. Seamless ferritic alloy steep pipe - ASTM - A - 335. 6. Pipe fittings of wrought carbon steel and alloy steel - ASTM - A - 234. 7. Composition bronze of ounce metal castings - ASTM - B - 62. 8. Seamless Copper tube, bright annealed - ASTM - B - 168. 9. Seamless copper tube - ASTM - B - 75. 10. Dimension of fittings - ANSI - B - 16.11. 11. Valves flanged and butt welding ends - ANSI - B - 16.34. Instrument Tubing 1. Seamless carbon steel pipe - ASTM - A 106. 2. Material of socketweld fittings - ASTM - A105. 3. Dimensions of fittings - ANSI - B - 16.11.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 73 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS			
	4. Code for pressure piping, welding, hydrostatic testing - ANSI B 31.1. Cables 1. Thermocouples extension wires/cables - ANSI MC 96.1 - 1992. 2. Requirements for copper conductor-Wiring cables for telecommunications & information processing system - VDE:0815. 3. Colour coding of single or multi-pair cables - ICEA - S - 61-402 (third edition) NEMA WCS - 1979 with revisions thorough 2/83. 4. Insulation & Sheathing compounds for cables : VDE 0207 (Part-4, 5 & 6). 5. Guide design and installation of cable systems in power generating stations (insulation, jacket materials) - IEEE Std. 422-1977. 6. Rules for Testing insulated cables and flexible cables : VVDE - 0472 7. Requirements of vertical flame propagation test - IEEE 383 - 1974 (R 1980) 8. Standard specification for tinned soft or annealed copper wire for electrical purpose - ASTM B-33-81. 9. Oxygen index and temperature index test - ASTM D - 2863. 10. Smoke density measurement test - ASTMD - 2843. 11. Acid gas generation test - IEC - 754 - 1. 12. Swedish Chimney test - SEN - 4241475 (F3). 13. Teflon (FEP) insulation & sheath test - ASTMD - 2116. 14. Thermocouple compensating cables - Testing requirements & sampling plan IS:8784. 15. PVC insulated electric cables for working voltage upto and including 1100 V - IS:1554 (Part-I). Cable Trays, Conduits 1. Guide for design and installation of cable systems in power generating station (Cable trays, support systems, conduits) - IEEE Std. 422, 1977, NEMA VE-1 1979, NFPA 70-1984. 2. -do- Test Standards. NEMA VE-1-1979. 3. Zinc coating "hot dip" on assembled products for galvanising of carbon steel cable trays - ASTM A - 386-78.			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 74 OF 83	

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	Public Address System - Specifications for loud speakers - IS:7741 (Part-I, II and III) - Code of safety requirement for electric mains operated audio amplifiers - IS:1301 - Specification for Public Address Amplifiers - IS:10426. - Code of practice for outdoor installation of PA system - IS:1982. - Code of practice for installation for indoor amplifying and sound distribution system - IS:1881. - Basic environmental testing procedures for electronic and electrical items - IS:9000. - Characteristics and methods of measurements for sound system equipment - IS:9302 - Code of practice of electrical wiring installations (System voltage not exceeding 650 volts) - IS:732 - Rigid steel conduits for electric wiring - IS:9537 (Part-I and II) - Fittings for rigid steel conduits for electrical wiring - IS:2667 - Degree of protection provided by enclosure for low voltage switchgear and control gear - IS:2147. Vibration Monitoring System - API 670 - 1994 - BS : 4675 Part-2			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC. NO. CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS	PAGE 75 OF 83

MANUFACTURER'S NAME AND ADDRESS

MFGR.'s LOGO

MANUFACTURING QUALITY PLAN

ITEM :
SUB-SYSTEM:

PROJECT :
PACKAGE :
CONTRACT NO. :
MAIN-SUPPLIER:

SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
					M	C / N			9.	D*	M	C	N	
1.	2.	3.	4.	5.	6.		7.	8.	9.	D*	**	10.		11.

MANUFACTURER/ SUB-SUPPLIER

SIGNATURE

MANUFACTURER'S NAME AND ADDRESS

MFGR.'s LOGO

LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
** M: MANUFACTURER/SUB-SUPPLIER C: MAIN SUPPLIER, N: NTPC
P: PERFORM W: WITNESS AND V: VERIFICATION, AS APPROPRIATE,
CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS ' W'

FOR NTPC USE

DOC. NO.:

REV..... CAT.....

REVIEWED BY

APPROVED BY

APPROVAL SEAL

FORMAT NO.: QS-01-QAI-P-09/F1-R1

1/1

ENG. DIV./QA&I

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE

LOT-1A PROJECTS

TECHNICAL SPECIFICATION
SECTION – VI, PART-C
BID DOC. NO.:CS-0011-109(1A)-2

GENERAL TECHNICAL REQUIREMENT

PAGE 76 OF 83

SUPPLIER'S LOGO	SUPPLIER'S NAME AND ADDRESS		FIELD QUALITY PLAN				PROJECT :						
			ITEM :		QP NO.:		PACKAGE :						
			SUB-SYSTEM:		REV. NO.:		CONTRACT NO.:						
					DATE:		MAIN-SUPPLIER:						
					PAGE: ... OF								

SL. NO	ACTIVITY AND OPERATION	CHARACTERISTICS / INSTRUMENTS	CLASS OF CHECK #	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	REMARKS
1.	2.	3.	4.	5.	6.	7.	8.	9. D*	10.

MANUFACTURER/ SUB-SUPPLIER	SIGNATURE	LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. LEGEND TO BE USED: CLASS # : A = CRITICAL, B=MAJOR, C=MINOR; 'A' SHALL BE WITNESSED BY NTPC FQA, 'B' SHALL BE WITNESSED BY NTPC ERECTION / CONSTRUCTION DEPTT. AND 'C' SHALL BE WITNESSED BY MAIN SUPPLIER (A & B CHECK SHALL BE NTPC CHP STAGE)		DOC. NO.:		REV.	
				FOR NTPC USE			
FORMAT NO.: QS-01-QAI-P-09/F2-R1				1/1			
				REVIEWED BY	APPROVED BY	APPROVAL SEAL	
				ENGG. DIV./QA&I			

ANNEXURE-III



Project :
Package :
Supplier :
Contractor No. :

Stage :

LIST OF ITEMS REQUIRING QUALITY PLAN
AND SUB-SUPPLIER APPROVAL
SUB-SYSTEM :

DOC. NO.:
REV. NO.:
DATE :
PAGE : OF

S. N.	Item	QP/ Insp. Cat.	QP No.	QP Sub. Schedule	QP approval schedule	Proposed sub-supplier	Place	Sub-suppliers approval status / category	Sub-supplier Details on schedule	Remarks

LEGENDS
SYSTEM SUPPLIER/SUB-SUPPLIER APPROVAL STATUS CATEGORY (SHALL BE FILLED BY NTPC)
A – For these items proposed vendor is acceptable to NTPC. To be indicated with letter "A" in the list alongwith the condition of approval, if any.
DR – For these items "Detailed required" for NTPC review. To be identified with letter "DR" in the list.
NOTED – For these items vendors are approved by Main Supplier and accepted by NTPC without specific vendor approval from NTPC. To be identified with "NOTED."
QP/INSPN CATEGORY:
CAT-I : For these items the Quality Plans are approved by NTPC and the final acceptance will be on physical inspection witness by NTPC.
CAT-II : For these items the Quality Plans approved by NTPC. However no physical inspection shall be done by NTPC. The final acceptance by NTPC shall be on the basis review of documents as per approved QP.
CAT-III : For these items Main Supplier approves the Quality Plans. The final acceptance by NTPC shall be on the basis certificate of conformance by the main supplier.
UNITS/WORKS : Place of manufacturing Place of Main Supplier of multi units/works.

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	LOT-1A PROJECTS	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC.NO.:CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENT	PAGE 78 OF 83
--	-----------------	--	-------------------------------	---------------

[illegible]

ANNEXURE-V

		Project Contractor System		Stage :		FIELD WELDING SCHEDULE (To be raised by the contractor) Welding Code:				DOC. NO.: REV. NO.: DATE : PAGE : OF					
Sl. No.	DRG No. for Weld Location and Identification mark	Description of parts to welded	Matl. Spec.	Dimensions	Process of welding	Type of Weld	Electrode filler spec.	WPS. No.	Min. pre-heat	Heat treatment		NDT method/Quantum	REF	Remarks	
										Temp.	Holding time			Spec. No.	ACC Norm Ref.
NOTES:															
SIGNATURE															
FORMAT															
Engg. Div. / QA&I															

FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	LOT-1A PROJECTS	TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC.NO.:CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENT	PAGE 80 OF 83
--	-----------------	--	----------------------------------	---------------

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)																																																											
	<table><tr><th>S.No</th><th>Description of Drgs/Docs</th><th>No of Prints</th><th>No of CD ROMs/DVDs/Portable Hard Disk</th></tr><tr><td rowspan="8">1</td><td>Drawings, Data sheets, Design calculations, Purchase specifications and other documents</td><td></td><td></td></tr><tr><td>First submission and submission with major changes</td><td></td><td></td></tr><tr><td>▪ Layout (A0&A1 sizes)</td><td>4</td><td>-</td></tr><tr><td>▪ Other Drawings/Documents (A0&A1 sizes)</td><td>2</td><td>-</td></tr><tr><td>▪ P&ID (All sizes)</td><td>4</td><td>-</td></tr><tr><td>a) Final drawings/documents (Directly to site)</td><td>6</td><td>2</td></tr><tr><td>b) "As Built" Drawing/Documents (Directly to site)</td><td>6</td><td>2</td></tr><tr><td>c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.</td><td>2</td><td>2</td></tr><tr><td>2</td><td>Erection Manual (Directly to site)</td><td>4 sets</td><td>2</td></tr><tr><td rowspan="2">3</td><td>Operation & Maintenance manual</td><td rowspan="2">1 set</td><td rowspan="2">-</td></tr><tr><td>i) First Submission</td></tr><tr><td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td></tr><tr><td rowspan="2">4</td><td>Plant Hand Book</td><td rowspan="2">1</td><td rowspan="2">1</td></tr><tr><td>i) First Submission</td></tr><tr><td rowspan="2">5</td><td>Commissioning and Performance Test Procedure manual</td><td rowspan="2">1 set</td><td rowspan="2">-</td></tr><tr><td>i) First Submission</td></tr><tr><td></td><td>ii) Final Submission (Directly to site)</td><td>4 sets</td><td>2</td></tr></table>				S.No	Description of Drgs/Docs	No of Prints	No of CD ROMs/DVDs/Portable Hard Disk	1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents			First submission and submission with major changes			▪ Layout (A0&A1 sizes)	4	-	▪ Other Drawings/Documents (A0&A1 sizes)	2	-	▪ P&ID (All sizes)	4	-	a) Final drawings/documents (Directly to site)	6	2	b) "As Built" Drawing/Documents (Directly to site)	6	2	c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2	2	Erection Manual (Directly to site)	4 sets	2	3	Operation & Maintenance manual	1 set	-	i) First Submission		ii) Final Submission (Directly to site)	4 sets	2	4	Plant Hand Book	1	1	i) First Submission	5	Commissioning and Performance Test Procedure manual	1 set	-	i) First Submission		ii) Final Submission (Directly to site)	4 sets	2
S.No	Description of Drgs/Docs	No of Prints	No of CD ROMs/DVDs/Portable Hard Disk																																																									
1	Drawings, Data sheets, Design calculations, Purchase specifications and other documents																																																											
	First submission and submission with major changes																																																											
	▪ Layout (A0&A1 sizes)	4	-																																																									
	▪ Other Drawings/Documents (A0&A1 sizes)	2	-																																																									
	▪ P&ID (All sizes)	4	-																																																									
	a) Final drawings/documents (Directly to site)	6	2																																																									
	b) "As Built" Drawing/Documents (Directly to site)	6	2																																																									
	c) Analysis reports of Equipments / piping /structures components/system employing software packages as detailed in the specifications.	2	2																																																									
2	Erection Manual (Directly to site)	4 sets	2																																																									
3	Operation & Maintenance manual	1 set	-																																																									
	i) First Submission																																																											
	ii) Final Submission (Directly to site)	4 sets	2																																																									
4	Plant Hand Book	1	1																																																									
	i) First Submission																																																											
5	Commissioning and Performance Test Procedure manual	1 set	-																																																									
	i) First Submission																																																											
	ii) Final Submission (Directly to site)	4 sets	2																																																									
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC.NO.:CS-0011-109(1A)-2	GENERAL TECHNICAL REQUIREMENTS Annexure-VI	PAGE 81 OF 83																																																								

CLAUSE NO.	GENERAL TECHNICAL REQUIREMENTS (Annexure-VI)				
	S.No	Description of Drgs/Docs	No of Prints	No of CD ROMs/DVDs/Portable Hard Disk	
	6	Performance and Functional Guarantee Test Report i) First Submission	2 sets	—	
		ii) Approved Copies (Direct to Site)	4 sets	2	
	7	Project Completion Report (Directly to site)	6 sets	2	
	8	QA programme including Organisation for implementation and QA system manual(with revisions)	1	—	
	9	Vendor details in respect of proposed vendors including contractor's evaluation report.	2	—	
	10	Manufacturing QPs, Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc i) For review/comment	1	—	
		ii) Approved final copies of Field QPs, Field welding schedules and their reference document like test procedures, WPS, POR etc (Direct to Site)	4	2	
	11	Welding Manual, Heat Treatment Manuals, Storage & preservation manuals i) For review/comment	1 set	—	
		ii) Approved copies (Direct to Site)	4 sets	2	
	12	QA Documentation Package for items / equipment manufactured and despatched to site	2 sets	2	
	13	QA Documentation Package for field activities on equipment/systems at site	2 sets	2	
	LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-C BID DOC.NO.:CS-0011-109(1A)-2		GENERAL TECHNICAL REQUIREMENTS Annexure-VI

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION PROJECT SPECIFIC GENERAL REQUIREMENTS	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C 2A	
		REV. 00	

SECTION: I

SUB-SECTION: C 2A

PAINTING SPECIFICATION

6693/2020/PS-PEM-MAX

 RANIPET	Bharat Heavy Electricals Limited Boiler Auxiliaries Plant Ranipet – 632 406	BHEL DOC NO.	PS: NN FGD: : G201
		REVISION NO.	01
		DATE	18.11.2019

NABINAGAR FGD PACKAGE

PAINTING SCHEME for FGD SYSTEM, BOOSTER FAN& GATES& DAMPERS

NTPC CONTRACT NO: CS-0270-109(1A) -2/FC/19-20/18-19 dtd 10.07.2019

NTPC DRG NO: 0270-109-PVM-H-001

BHEL RANIPET Customer No(s).: G201-G204

Prepared By	Reviewed & Approved By
	
Rajamanickam M Dy.Manager/QA	K.C. Gandhi Parimalam DGM/QA

6693/2020/PS-PEM-MAX

Sl No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

				Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	100	With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)		
28	Slurry pumps & accessories, Water pumps (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 701 FW 702	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Light blue RAL 5012	100	210
29	Monorail for hoist & cranes (Clause 31.03.00 of Sec VI, Part-B, Subsection- IV-D)	FW 710	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
30	Handling Equipment- Hoists& Man hole door (Clause 20.03.00 of Part- C Section VI)	FW 713 FW 714 FW 717	Power Tool Cleaning to st3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Idle roller shall be applied with two coats of 70 microns at shop	70	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	60	130
31	Agitator support Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 721	Blast cleaning to Sa 2½ (Near white metal) with surface	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume	70	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane	70	240

6693/2020/PS-PEM-MAX

Sl No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	
41	Gypsum belt filter and accessories Structural items (Clause 1.04.00 of Part- A Section VI)	FW 738	Blast cleaning to Sa 2½	Primer: Two coats of Epoxy resin based Epoxy Zinc phosphate primer to IS 13238 DFT- 50µ/coat Intermediate: One coat of Two component epoxy based intermediate paint pigmented with MIO/Tio2 DFT- 100µ	100 100	Finish: One coat of Epoxy based finish paint to IS 14209; DFT- 75µ Finish: One coat of acrylic aliphatic polyurethane paint to IS 13213 DFT-25µ Shade: Grey White, RAL9002	75 25	300
42	Lime stone slurry storage tank, Auxiliary absorber tank, Filtrate tank, Wastage water tank, Hydro cyclone waste water tank, Neutralization tank, Process Water tank, Belt filter washing tank, Primary hydro cyclone feed tank, Clarified water tank Outside surfaces (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 742 FW 743 FW 744 FW 745 FW 747 FW 748 FW 785 FW 786 FW 800 FW 802	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60µm conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% ±2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70µ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80%±2) DFT- 100µ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55%±2) DFT- 35µ/ coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0Δ E)	70	240
43	Lime stone slurry storage tank, Auxiliary absorber tank, Filtrate tank, Wastage water tank, Hydrocyclone waste water tank, Neutralization tank,	FW 742 FW 743 FW 744 FW 745 FW 747 FW 748 FW 749	Blast cleaning to Sa 2½ (Near white metal) with surface profile 35-50µm	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) (Liner is inside the tank, hence primer is only envisaged; Protection till erection only)	60	NIL		60

6693/2020/PS-PEM-MAX

Sl No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

	Process Water tank, Belt filter washing tank, Primary Hydrocyclone feed tank, Clarified water tank, Tank internal structure Inside surfaces	FW 800 FW 802						
--	--	------------------------------	--	--	--	--	--	--

44	Process water pipe accessories, Cooling pipe accessories (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 751 FW 752	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5	100	210
45	Slurry pipe accessories (Referred from cl. 7.05.00 of Section-VI, Part-B, Sub section-I-M5)	FW 753	Power Tool Cleaning to St3 (SSPC-SP3)	Primer: Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats) Intermediate: One coat of Synthetic Enamel intermediate coat to IS 2932; DFT- 50µ	60 50	Two coats of Synthetic Enamel to IS 2932, DFT- 50µ/ coat Shade: Grey white RAL 9002 Identification Tag: Sea Green Shade no: 217 as per IS 5	100	210
46	Service Air pipe accessories (Referred from cl. 10.00.00 of Section-VI, Part-B, Sub section-I-M3)	FW 754	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat Identification Tag: Sky Blue Shade no: 101 as per IS 5	60	120
47	Instrument air pipe accessories (Referred from cl. 10.00.00 of Section-VI, Part-B, Sub section-I-M3)	FW 755	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coat)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30µ/ coat	60	120

6693/2020/PS-PEM-MAX

Sl No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (μ m min.)
				PAINT	DFT (μ m min.)	PAINT	DFT (μ m min.)	

						Identification Tag: Sky Blue Shade no: 101 as per IS 5		
48	All valves (Temp <95 deg C) (Clause 20.03.00 of Part- C Section VI)	FW 815 to FW 851	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)- 30 μ / coat	60	120
49	Structure for Pipe racks, Sub pipe racks Trestle for pipe racks, Structures inside Gypsum dewatering building & Ball mill building (Clause 31.03.00 of Sec.VI, Part-B, Subsection- IV-D)	FW 761 FW 765 FW 768 FW 769 FW 787	Blast cleaning to Sa 2½ (Near white metal) with surface profile 40-60 μ m conforming to ISO 8501-1	Primer: One coat of Two component moisture curing zinc (ethyl) silicate primer coat (Min 80% metallic zinc content in dry film, solid by volume minimum 60% $\pm$ 2). Zinc dust composition and properties shall be as per Type II as per ASTM D520-00 DFT- 70 μ Intermediate: One coat of Two component polyamide cured epoxy with MIO content (containing lamellar MIO Min 30% on pigment, solid by volume min. 80% $\pm$ 2) DFT- 100 μ	70 100	Finish: Two coats of two pack aliphatic isocyanate cured acrylic polyurethane paint to IS 13213 solid by volume min.55% $\pm$ 2) DFT- 35 μ / coat Shade: Grey white, RAL 9002 With gloss retention (SSPC paint spec no.36, ASTM D4587, D2244, D523 of level 2 after min. 1000 hrs exposure, gloss less than 30 and colour change less than 2.0 Δ E)	70	240
50	Supports for cable trays, Air receivers, commissioning& Mandatory spares, Tools & tackles (Clause 20.03.00 of Part- C Section VI)	FW 779 FW 798 FW 988 FW 996	Power Tool Cleaning to St3 (SSPC-SP3)	Red Oxide Zinc Phosphate Primer to IS: 12744 (Two coats)	60	Synthetic Enamel to IS 2932 Shade: Grey white RAL 9002 (Two coats)	40	100

6693/2020/PS-PEM-MAX

Sl No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

GENERAL NOTES

1. No painting is required for Galvanized, non-ferrous & stainless steel items, except as indicated above.
2. Machined items are to be applied with coat of temporary rust preventive oil
3. PGMA's covered in sub-supplier (ie., Purchased) items viz., Agitator/ slide bearing and other sub-delivery components etc., are not indicated in the above list. However, the Painting Schedule for all items supplied by all sub-suppliers and BOI under the scope of BHEL shall be same as for main equipment covered in this document.
4. In sub-assy, wherever plates / sheets of thickness less than or equal to 5mm and rods are used, very minor items like clamps, small items etc - Power Tool or Hand Tool Cleaning to SSPC - SP 3 / SP 2 shall be followed and painting under SI no:01 of Fans shall be followed.
5. Ground shade/colour of finish paints and identification tag/band for equipment, fans, piping, pipe services, supporting structures and other components is followed as per NTPC doc no: QS-01-DIV-W-4 at site.
6. All components covered under different PGMA's are to be painted. Incase any component is left out, the same shall deemed to be included under the relevant section.
7. All threaded and other surfaces of foundation bolts and its materials, insulation pins, Anchor channels, Sleeves shall be coated with temporary rust preventive fluid and during execution of civil works; the dried film of coating shall be removed using organic solvents.
8. Painting requirement for all electrical equipment shall be as per the details identified in specification for the respective equipment.
9. All steel structures shall be provided with painting as given in the specification. Further, painting system shall also meet the requirements of corrosivity category C3 (durability high) as per ISO 12944.
10. Finish coat to be applied after an interval of min 10 hrs and within 6 months (after completion of intermediate coat).
11. Primer coat on steel shall be applied in shop immediately after blast cleaning by airless spray technique.
12. For the portion of steel surfaces embedded in concrete, the surface shall be prepared by Manual cleaning and provided with Primer coat of Chlorinated Rubber based Zinc Phosphate Primer of Minimum 50 Micron DFT.

6693/2020/PS-PEM-MAX

Sl No	SURFACE LOCATION	PGMA	SURFACE PREPARATION	PRIMER		FINISH		TOTAL DFT IN (µm min.)
				PAINT	DFT (µm min.)	PAINT	DFT (µm min.)	

PAINTING SCHEME- DETAILS OF PROCUREMENT & APPLICATION PROCESSES

SL NO	TYPE OF PAINT	SPECIFICATION OF PAINT	NO OF PACK	VOLUME OF SOLIDS (% Min)	MODE OF APPLICATION	MIN. OVER COATING INTERVAL (hours)	SHADE
01	Epoxy Zinc phosphate primer	IS 13238	2	40	Spray	24	Grey
02	Zinc Ethyl silicate primer (% Zn on dry film= 80 (min))	IS 14946	2	60	Airless Spray only At Shop	24	Grey
03	Epoxy High solid- Polyamide cured Epoxy based MIO pigmented intermediate coat	--	2	80	Airless Spray only At Shop	16	Brown
04	Aliphatic isocyanate acrylic polyurethane paint	IS 13213	2	55	Spray At Shop	16	Corresponding shade no
05	Heat resistant aluminium paint	IS 13183 Grade II	1	--	Brush/ Spray	24	--
06	Long oil alkyd Synthetic enamel finish paint	IS 2932	1	35	Brush/ Spray	12	Corresponding shade no
07	Synthetic Enamel Intermediate coat	IS 2932	1	40	Brush/ Spray	12	--
08	Red oxide Zinc phosphate primer	IS 12744	1	--	Brush/ spray	12	--

	4x250 MW NABINAGAR TPP GYP SUM DEWATERING SYSTEM TECHNICAL SPECIFICATION (ELECTRICAL PORTION)	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C-3	
		REV. 00	

SECTION: I

SUB-SECTION: C-3

TECHNICAL SPECIFICATION (ELECTRICAL PORTION)

4X250 MW NABINAGAR FGD

TECHNICAL SPECIFICATION GYPSUM DEWATERING SYSTEM (ELECTRICAL PORTION)



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA, UP [INDIA]**

6693/2020/PS-PEM-MAX



TITLE:

**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
GYPSUM DEWATERING SYSTEM
4 X 250 MW NABINAGAR FGD**

SPECIFICATION NO.

VOLUME NO. : **II-B**SECTION: **I**REV NO. : **00** DATE: 12.03.2020

SHEET: 1 OF 1

CONTENTS

SECTION	TITLE	NO OF SHEETS
I	SPECIFIC TECHNICAL REQUIREMENTS	3
I	ELECTRICAL SCOPE BETWEEN BHEL & VENDOR (ANNEURE-I)	2
I	ELECTRICAL LOAD DATA FORMAT (ANNEXURE-II)	1
I	CABLE SCHEDULE FORMAT (ANNEXURE-III)	1
I	TECHNICAL SPECIFICATION FOR MOTORS	10
I	MOTOR DATASHEET-A	1
I	MOTOR DATASHEET-C	2
II	STANDARD SPECIFICATION FOR LV MOTORS	5
II	REFERENCE QUALITY PLAN	3
II	TECHNICAL SPECIFICATION FOR CABLE TRAYS & ACCESSORIES	7
II	TYPICAL DETAILS OF CABLE TRAYS AND ACCESSORIES	2

The requirements mentioned in Section-I shall prevail and govern in case of conflict between the same and the corresponding requirements mentioned in the descriptive portion in Section-II.

6693/2020/PS/PEM-MAX



TITLE :
**ELECTRICAL EQUIPMENT SPECIFICATION
 FOR
 GYPSUM DEWATERING SYSTEM**
4X250 MW NABINAGAR FGD

SPECIFICATION NO.
 VOLUME NO. : **II-B**
 SECTION : **I**
 REV NO. : **00** DATE : **12.03.2020**
 SHEET : 1 OF 3

**TECHNICAL SPECIFICATION
 FOR
 GYPSUM DEWATERING SYSTEM
 (ELECTRICAL PORTION)**



TITLE :	SPECIFICATION NO.
	VOLUME NO. : II-B
	SECTION : I
	REV NO. : 00 DATE : 12.03.2020
	SHEET : 2 OF 3

**ELECTRICAL EQUIPMENT SPECIFICATION
FOR
GYPSUM DEWATERING SYSTEM
4X250 MW NABINAGAR FGD**

1.0 EQUIPMENT & SERVICES TO BE PROVIDED BY BIDDER:

- a) Services and equipment as per “Electrical Scope between BHEL and Vendor”.
- b) Any item/work either supply of equipment or erection material which have not been specifically mentioned but are necessary to complete the work for trouble free and efficient operation of the plant shall be deemed to be included within the scope of this specification. The same shall be provided by the bidder without any extra charge.
- c) Supply of mandatory spares as specified in the specifications of mechanical equipments.
- d) Electrical load requirement for (GYPSUM DEWATERING SYSTEM) all AC & DC loads at different voltage levels like 415V AC, 240 V AC, 220 V DC etc).
- e) All equipment shall be suitable for the power supply fault levels and other climatic conditions mentioned in the enclosed project information.
- f) Bidder to furnish list of makes for each equipment at contract stage, which shall be subject to customer/BHEL approval without any commercial and delivery implications to BHEL
- g) Various drawings, data sheets as per required format, Quality plans, calculations, test reports, test certificates, operation and maintenance manuals etc shall be furnished as specified at contract stage. All documents shall be subject to customer/BHEL approval without any commercial implication to BHEL.
- h) Motor shall meet minimum requirement of motor specification.
- i) Vendor to clearly indicate equipment locations and local routing lengths in their cable listing furnished to BHEL.
- j) Cable BOQ worked out based on routing of cable listing provided by the vendor for “ both end equipment in vendor’s scope”shall be binding to the vendor with +10 % margin to take care of slight variation in routing length & wastages.

2.0 EQUIPMENT & SERVICES TO BE PROVIDED BY PURCHASER FOR ELECTRICAL & TERMINAL POINTS:

Refer “Electrical Scope between BHEL and Vendor”.

3.0 DOCUMENTS TO BE SUBMITTED ALONG WITH BID

- 3.1 The electrical specification without any deviation from the technical/quality assurance requirements stipulated shall be deemed to be complied by the bidder in case bidder furnishes the overall compliance of package technical specification in the form of compliance certificate/No deviation certificate.
- 3.2 No technical submittal such as copies of data sheets, drawings, write-up, quality plans, type test certificates, technical literature, etc, is required during tender stage. Any such submission even if made, shall not be considered as part of offer.

6693/2020/PS/PEM-MAX



TITLE :
**ELECTRICAL EQUIPMENT SPECIFICATION
 FOR
 GYPSUM DEWATERING SYSTEM**
4X250 MW NABINAGAR FGD

SPECIFICATION NO.
 VOLUME NO. : **II-B**
 SECTION : **I**
 REV NO. : **00** DATE : **12.03.2020**
 SHEET : 3 OF 3

4.0 List of enclosures :

- a) Electrical scope between BHEL & vendor (Annexure –I)
- b) Technical specification for motors.
- c) Datasheets & quality plan for motors.
- d) Electrical Load data format (Annexure –II)
- e) BHEL cable listing format (Annexure –III)

REV-0, DATE: 08.01.2020

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR**PACKAGES: GYPSUM DEWATERING SYSTEM****SCOPE OF VENDOR: SUPPLY & SUPERVISION OF VENDOR'S EQUIPMENT****PROJECT: 4X250 MW NABINAGAR FGD**

S.NO	DETAILS	SCOPE SUPPLY	SCOPE E&C	REMARKS
1	11 kV / 3.3 KV / 415 V Switchgear	BHEL	BHEL	HT motor (If applicable), (Motor feeder) power supply shall be provided by BHEL For all LT motor & Auxiliary supply, 415 V AC (3 ph. 4 wire)/240 V AC (supply feeder) shall be provided by BHEL based on load data provided by vendor at contract stage for all equipment supplied by vendor as part of contract. Any other voltage level (AC/DC) required will be derived by the vendor.
2	Local Push Button Station (for motors)	BHEL	BHEL	Located near the motor.
3	Power cables, control cables and screened control cables for a) both end equipment in BHEL's scope b) both end equipment in vendor's scope c) one end equipment in vendor's scope	BHEL BHEL BHEL	BHEL BHEL BHEL	1. For 3.b) & c): Sizes of cables required shall be informed by vendor at contract stage (based on inputs provided by BHEL) in the form of cable listing. Finalisation of cable sizes shall be done by BHEL. Vendor shall provide lugs & glands accordingly. 2. Termination at BHEL equipment terminals by BHEL. 3. Termination at Vendor equipment terminals by Vendor.
4	Junction box for control & instrumentation cable	Vendor	BHEL	Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 10-12 mtrs) and trunk cable.
5	Any special type of cable like compensating, co-axial, prefab, MICC etc.	Vendor	BHEL	
6	Cable trays, accessories & cable trays supporting system 100/ 50 mm cable trays/ Conduits/ Galvanised steel cable troughs for local cabling	BHEL Vendor	BHEL BHEL	Local cabling from nearby main route cable tray (BHEL scope) to equipment terminal (vendor's scope) shall be through 100/ 50 mm. cable trays/ conduits/ Galvanised steel cable troughs, as per approved layout drawing during contract stage.
7	a. Cable glands b. Lugs and bimetallic strip for equipment supplied by Vendor	Vendor Vendor	BHEL BHEL	a. Double compression Ni-Cr plated brass cable glands b. Solder less crimping type heavy duty tinned copper lugs for power and control cables.
8	Conduit and conduit accessories for cabling between	Vendor	BHEL	Conduits shall be medium duty, hot dip galvanised cold rolled mild steel

REV-0, DATE: 08.01.2020

ELECTRICAL SCOPE BETWEEN BHEL AND VENDOR**PACKAGES: GYPSUM DEWATERING SYSTEM****SCOPE OF VENDOR: SUPPLY & SUPERVISION OF VENDOR'S EQUIPMENT****PROJECT: 3X660 MW NABINAGAR –I FGD**

	equipment supplied by vendor			rigid conduit as per IS: 9537.
9	Lighting	BHEL	BHEL	
10	Equipment grounding (including electronic earthing) & lightning protection	BHEL	BHEL	
11	Below grade grounding	BHEL	BHEL	
12	LT Motors with base plate and foundation hardware.	Vendor	BHEL	Makes shall be subject to customer/ BHEL approval at contract stage.
13	HT Motor with base plate and foundation hardware.	Vendor	BHEL	Makes shall be subject to customer/ BHEL approval at contract stage.
14	HT cable & Cable termination kit for HT Motor	BHEL	BHEL	
15	Mandatory spares	Vendor	-	Vendor to quote as per specification.
16	Recommended O & M spares	Vendor	-	As specified elsewhere in specification
17	Any other equipment/ material/ service required for completeness of system based on system offered by the vendor (to ensure trouble free and efficient operation of the system).	Vendor	BHEL	
18	a) Input cable schedules (Control & Screened Control Cables) b) Cable interconnection details for above c) Cable block diagram	Vendor Vendor Vendor	- - -	Cable listing for Control and Instrumentation Cable and electronic earthing cable in enclosed excel format shall be submitted by vendor during detailed engineering stage.
19	Electrical Equipment & cable tray layout drawings	-	-	Vendor to furnish drawing (both in print form as well as in AUTOCAD) of Gypsum Dewatering Building layout clearly indicating all motors, panels, JB's etc. which require cabling along with their terminal box/location/ Foundation etc.
20	Electrical Equipment GA drawing	Vendor	-	For necessary interface review.

NOTES:

1. Make of all electrical equipment/ items supplied shall be reputed make & shall be subject to approval of BHEL/customer after award of contract.
2. All QPs shall be subject to approval of BHEL/customer after award of contract without any commercial implication.
3. In case the requirement of Junction Box arises on account of Power Cable size mis-match due to vendor engineering at later stage, vendor shall supply the Junction Box for suitable termination.

CABLE SCHEDULE FORMAT

ANNEXURE III

[illegible]



SUB-SECTION-II-E2

MOTORS

**LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(1A)-2**

PS-REM-MAX		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
CLAUSE NO.					
		MOTORS			
1.00.00	GENERAL REQUIREMENTS				
1.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% (at 40 deg C) shall be considered. The equipment shall operate in a highly polluted environment.				
1.02.00	All equipment's shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.				
1.03.00	Contactor shall provide fully compatible electrical system, equipment's, accessories and services.				
1.04.00	All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes & Standards, especially the Indian Statutory Regulations.				
1.05.00	Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.				
1.06.00	The responsibility of coordination with electrical agencies and obtaining all necessary clearances for Contactors equipment and systems shall be under the Contactor scope.				
1.07.00	Degree of Protection				
	Degree of protection for various enclosures as per IEC60034-05 shall be as follows :-				
	i)	Indoor motors	-	IP 54	
	ii)	Outdoor motors	-	IP 55	
	iii)	Cable box-indoor area	-	IP 54	
	iv)	Cable box-Outdoor area	-	IP 55	
2.00.00	CODES AND STANDARDS				
	1)	Three phase induction motors	:	IS/IEC:60034	
	2)	Single phase AC motors	:	IS/ IEC:60034	
	3)	Crane duty motors	:	IS:3177, IS/IEC:60034	
	4)	DC motors/generators	:	IS:4722, IS/IEC:60034	
	5)	Energy Efficient motors	:	IS 12615, IEC:60034-30	
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 171 of 528		SUB SECTION-II-E2 MOTORS	
				PAGE 1 OF 9	

CLAUSE NO.	TECHNICAL REQUIREMENTS	
3.00.00	TYPE	
3.01.00	AC Motors: a) Squirrel cage induction motor suitable for direct-on-line starting. b) Continuous duty LT motors upto 200 KW Output rating (at 50 deg.C ambient temperature), shall be Premium Efficiency class-IE3, conforming to IS 12615, or IEC:60034-30. c) Crane duty motors shall be slip ring/ squirrel cage Induction motor as per the requirement. d) Motor operating through variable frequency drives shall be suitable for inverter duty. Also these motors shall comply the requirements stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable.	
3.02.00	DC Motors Shunt wound.	
4.00.00	RATING (a) Continuously rated (S1). However, crane motors shall be rated for S4 duty, 40% cyclic duration factor. (b) Whenever the basis for motor or driven equipment ratings are not specified in the corresponding mechanical specification sub-sections, maximum continuous motor ratings shall be at least 10% above the maximum load demand of the driven equipment under entire operating range including voltage and frequency variations.	
5.00.00	TEMPERATURE RISE Air cooled motors 70 deg. C by resistance method for both thermal class 130(B) & 155(F) insulation. Water cooled 80 deg. C over inlet cooling water temperature mentioned elsewhere, by resistance method for both thermal class 130(B) & 155(F) insulation.	
6.00.00	OPERATIONAL REQUIREMENTS	
6.01.00	Starting Time	
6.01.01	For motors with starting time upto 20 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 secs. more than starting time.	
6.01.02	For motors with starting time more than 20 secs. and upto 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 secs. more than starting time.	
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 172 of 528
		SUB SECTION-II-E2 MOTORS
		PAGE 2 OF 9

CLAUSE NO.	TECHNICAL REQUIREMENTS
6.01.03 6.01.04 6.02.00 6.02.01 6.02.02 6.03.00	For motors with starting time more than 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time. Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met. Torque Requirements Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% motor full load torque. Pull out torque at rated voltage shall not be less than 205% of full load torque. It shall be 275% for crane duty motors. Starting voltage requirement (a) Up to 85% of rated voltage for ratings below 110 KW (b) Up to 80% of rated voltage for ratings from 110 KW to 200 KW (c) Up to 85% of rated voltage for ratings from 201 KW to 1000 KW (d) Up to 80% of rated voltage for ratings from 1001 KW to 4000 KW (e) Up to 75 % of rated voltage for ratings above 4000KW
7.00.00 7.01.00 7.02.00	DESIGN AND CONSTRUCTIONAL FEATURES Suitable single phase space heaters shall be provided on motors rated 30KW and above to maintain windings in dry condition when motor is standstill. Separate terminal box for space heaters & RTDs shall be provided. However for flame proof motors, space heater terminals inside the main terminal box may be acceptable. All motors shall be either Totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or Closed air circuit air cooled (CACA) type. However, motors rated 3000KW or above can be Closed air circuit water cooled (CACW). The method of movement of primary and secondary coolant shall be self-circulated by fan or pump directly mounted on the rotor of the main motor as per IEC 60034-6. However VFD driven motors can be offered with forced cooling type with machine mounted fan or pump driven by separate electric motor. Motors and EPB located in hazardous areas shall have flame proof enclosures conforming to IS:2148 as detailed below (a) Fuel oil area : Group – IIB (b) Hydrogen generation : Group - IIC or (Group-I, Div-II as per plant area NEC) or (Class-1, Group-B, Div-II as per NEMA /IEC60034)
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 173 of 528 SUB SECTION-II-E2 MOTORS PAGE 3 OF 9



CLAUSE NO.	TECHNICAL REQUIREMENTS			
7.03.00	Winding and Insulation (a) Type : Non-hygroscopic, oil resistant, flame resistant (b) Starting duty : Two hot starts in succession, with motor initially at normal running temperature. (c) 11kV & 3.3 kV AC motors : Thermal class 155 (F) insulation. The winding insulation process shall be total Vacuum Pressure Impregnated i.e resin poor method. The lightning Impulse & interturn insulation surge withstand level shall be as per IEC-60034 part-15. (d) 240VAC, 415V AC & 220V DC motors : Thermal Class (B) or better			
7.04.00	Motors rated above 1000KW shall have insulated bearings to prevent flow of shaft currents.			
7.05.00	Motors with heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate inlet and outlet primary air temperature.			
7.06.00	Noise level for all the motors shall be limited to 85 dB(A) except for BFP motor for which the maximum limit shall be 90dB(A). Vibration shall be limited within the limits prescribed in IS:12075 / IEC 60034-14 . Motors shall withstand vibrations produced by driven equipment. HT motor bearing housings shall have flat surfaces, in both X and Y directions, suitable for mounting 80mmX80mm vibration pads.			
7.07.00	In HT motors, at least four numbers simplex / two numbers duplex platinum resistance type temperature detectors shall be provided in each phase stator winding. Each bearing of HT motor shall be provided with dial type thermometer with adjustable alarm contact and preferably 2 numbers duplex platinum resistance type temperature detectors.			
7.08.00	Motor body shall have two earthing points on opposite sides.			
7.09.00	11 KV motors shall be offered with Separable Insulated Connector (SIC) as per IEEE 386. The offered SIC terminations shall be provided with protective cover and trifurcating sleeves. SIC termination kit shall be suitable for fault level of 25 KA for 0.17 seconds.			
7.10.00	3.3 KV motors shall be offered with dust tight phase separated double walled (metallic as well as insulated barrier) Terminal box. Employer shall provide termination kit for the offered Terminal box. The offered Terminal Box shall be suitable for fault level of 250 MVA for 0.12 sec. Removable gland plates of thickness 3 mm (hot/cold rolled sheet steel) or 4 mm (non magnetic material for single core cables) shall be provided.			
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 174 of 528	SUB SECTION-II-E2 MOTORS	PAGE 4 OF 9

CLAUSE NO.	TECHNICAL REQUIREMENTS	
7.11.00	The spacing between gland plate & centre of terminal stud shall be as per Table-I.	
7.12.00	All motors shall be so designed that maximum inrush currents and locked rotor and pullout torque developed by them at extreme voltage and frequency variations do not endanger the motor and driven equipment.	
7.13.00	The motors shall be suitable for bus transfer schemes provided on the 11kV, 3.3 kV /415V systems without any injurious effect on its life.	
7.14.00	For motors rated 2000 KW & above, neutral current transformers of PS class shall be provided on each phase in a separate neutral terminal box.	
7.15.00	The size and number of cables (for HT motors) to be intimated to the successful Contactor during detailed engineering and the Contactor shall provide terminal box suitable for the same.	
8.00.00	The ratio of locked rotor KVA at rated voltage to rated KW shall not exceed the following (without any further tolerance): (a) From 50KW & upto 110KW : 11.0 (b) From 110 KW & upto 200 KW : 9.0 (c) Above 200 KW & upto 1000KW : 10.0 (d) From 1001KW & upto 4000KW : 9.0 (e) Above 4000KW : 6 to 6.5	
10.00.00	TYPE TEST	
10.01.00	HT MOTORS	
10.01.01	The Contactor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The Contactor shall indicate the charges for each of these type tests separately in the relevant schedule of Section - VII- (BPS) and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the Employer's engineer.	
10.01.02	The type tests shall be carried out in presence of the Employer's representative, for which minimum 15 days notice shall be given by the Contactor. The Contactor shall obtain the Employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out.	
10.01.03	In case the Contactor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering	
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 175 of 528	SUB SECTION-II-E2 MOTORS PAGE 5 OF 9

PS-REM-MAX		TECHNICAL REQUIREMENTS			
10.01.04		the type test reports to the Employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The Employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the Contactor.			
10.01.05		Further the Contactor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED" and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval. LIST OF TYPE TESTS TO BE CONDUCTED The following type tests shall be conducted on each type and rating of HT motor (a) No load saturation and loss curves upto approximately 115% of rated voltage (b) Measurement of noise at no load. (c) Momentary excess torque test (subject to test bed constraint). (d) Full load test(subject to test bed constraint) (e) Temperature rise test at rated conditions. During heat run test, bearing temp., winding temp.,coolant flow and its temp. shall also be measured. In case the temperature rise test is carried at load other than rated load, specific approval for the test method and procedure is required to be obtained. Wherever ETD's are provided, the temperature shall be measured by ETD's also for the record purpose.			
10.01.06		LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of HT motor (a) Degree of protection test for the enclosure followed by IR, HV and no load run test.			
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 176 of 528		SUB SECTION-II-E2 MOTORS	
				PAGE 6 OF 9	

CLAUSE NO.	TECHNICAL REQUIREMENTS	
	(b) Terminal box-fault level withstand test for each type of terminal box of HT motors only. (c) Lightning Impulse withstand test on the sample coil shall be as per clause no. 4.3 IEC-60034, part-15 (d) Surge-withstand test on inter-turn insulation shall be as per clause no. 4.2 of IEC 60034, part-15	
10.02.00	LT Motors	
10.02.01	LT Motors supplied shall be of type tested design. During detailed engineering, the Contactor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last <i>ten</i> years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.	
10.02.02	However if the Contactor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contactor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.	
10.02.03	LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED The following type test reports shall be submitted for each type and rating of LT motor of above 50 KW only - Measurement of resistance of windings of stator and wound rotor. - No load test at rated voltage to determine input current power and speed - Open circuit voltage ratio of wound rotor motors (in case of Slip ring motors) - Full load test to determine efficiency power factor and slip - Temperature rise test - Momentary excess torque test. - High voltage test - Test for vibration severity of motor. - Test for noise levels of motor(Shall be limited as per clause no 7.06.00 of this section)	
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 177 of 528	SUB SECTION-II-E2 MOTORS PAGE 7 OF 9

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
10.03.00 10.04.00	10. Test for degree of protection and 11. Overspeed test. 12. Type test reports for motors located in fuel oil area having flame proof enclosures as per IS 2148 / IEC 60079-1 All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price. The type test reports once approved for any projects shall be treated as reference. For subsequent projects of NTPC, an endorsement sheet will be furnished by the manufacturer confirming similarity and "No design Change". Minor changes if any shall be highlighted on the endorsement sheet.			
LOT-IA PROJECTS FLUE GAS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1)-2 Page 178 of 528	SUB SECTION-II-E2 MOTORS	PAGE 8 OF 9	

TABLE - I

DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS

Motor MCR in KW	Minimum distance between centre of
	stud and gland plate in mm
UP to 3 KW	As per manufacturer's practice.

Above 3 KW - upto 7 KW	85
Above 7 KW - upto 13 KW	115
Above 13 KW - upto 24 KW	167
Above 24 KW - upto 37 KW	196
Above 37 KW - upto 55 KW	249
Above 55 KW - upto 90 KW	277
Above 90 KW - upto 125 KW	331
Above 125 KW-upto 200 KW	203

For HT motors the distance between gland plate and the terminal studs shall not be less than 500 mm.

PHASE TO PHASE/ PHASE TO EARTH AIR CLEARANCE:

NOTE: Minimum inter-phase and phase-earth air clearances for LT motors with lugs installed shall be as follows:

Motor MCR in KW	Clearance
UP to 110 KW	10mm
Above 110 KW and upto 150 KW	12.5mm
Above 150 KW	19mm

6693/2020/PS-PEM-MAX



TITLE

LV MOTORS**DATA SHEET-A**

4X250 MW NABINAGAR FGD

SPECIFICATION NO.

VOLUME II B

SECTION D

REV. NO. DATE: 22.01.2020

SHEET 1 OF 2

ANNEXURE-III

- 1.0 Design ambient temperature : 50 °C
- 2.0 Maximum acceptable kW rating of LV motor : 200KW *
- 3.0 Installation (Indoors/ Outdoors) : As required
- 4.0 Details of supply system
- a) Rated voltage (with variation) : 415V $\pm$ 10%
 - b) Rated frequency (with variation) : 50 Hz + 3 % to - 5%
 - c) Combined voltage & freq. variation : 10% (sum of absolute values)
 - d) System fault level at rated voltage : 50 kA for 1 sec
 - e) Short time rating for terminal boxes
 - o 110 kW and above (Breaker : 50 KA for 0.25 sec. Controlled)
 - o Below 110 kW (Contactor : 50 KA protected by HRC fuse Controlled)
 - f) LV System grounding : Solidly
- 5.0 Winding & Insulation : Class F with temp rise limited to class B
- 6.0 Minimum voltage for starting : 85% for motor ratings below 110kW
(As percentage of rated voltage) 80% for motor ratings from 110kW to 200kW.
- 7.0 Power cables data : Shall be given during detailed engg.
- 8.0 Earth Conductor Size & Material : Shall be given during detailed engg.
- 9.0 Space heater supply (for motors $\geq$ 30kW) : 240 V, 1 ϕ , 50 Hz
- 10.0 Rating up to which Single phase motor : Acceptable below 0.2 kW
- 11.0 Locked rotor current
- a) Limit as percentage of FLC : As per IS 12615
- 12.0 Makes : BHEL/ Customer approval (Package owner to take care)
- 13.0 Paint shade : Blue (RAL 5012) – Corrosion proof
- 14.0 Degree Of protection for motor/ terminal box : Degree of protection for various enclosures as per IEC60034-05 shall be as follows:-
- i) Indoor motors - IP 54
 - ii) Outdoor motors - IP 55
 - iii) Cable box-indoor area - IP 54
 - iv) Cable Box-Outdoor area - IP 55

*** LT motors of continuous duty shall be energy efficient IE3 class conforming to IS-12615**

15.0 TESTING REQUIREMENTS: IN LINE WITH SPECIFICATION

6693/2020/PS-PEM-MAX

	TITLE MOTORS DATA SHEET – C 4X250 MW NABINAGAR FGD	SPECIFICATION NO.
		VOLUME II B
		SECTION D
		REV NO. 00 DATE 12.03.2020
		SHEET 1 OF 2

S. No.	Description		Data to be filled by successful bidder
A.	General		
1	Manufacturer & country of origin		
2	Motor type		
3	Type of starting		
4	Name of the equipment driven by motor & Quantity		
5	Maximum Power requirement of driven equipment		
6	Rated speed of Driven Equipment		
7	Design ambient temperature		
B.	Design and Performance Data		
1	Frame size & type designation		
2	Type of duty		
3	Rated Voltage		
4	Permissible variation for		
5	a	Voltage	
6	b	Frequency	
7	c	Combined voltage & frequency	
8	Rated output at design ambient temp (by resistance method)		
9	Synchronous speed & Rated slip		
10	Minimum permissible starting voltage		
11	Starting time in sec with mechanism coupled		
12	a) At rated voltage		
13	b) At min starting voltage		
14	Locked rotor current as percentage of FLC (including IS tolerance)		
15	Torque		
	a) Starting		
	b) Maximum		
16	Permissible temp rise at rated output over ambient temp & method		
17	Noise level at 1.0 m (dB)		
18	Amplitude of vibration		
19	Efficiency & P.F. at rated voltage & frequency		
	a) At 100% load		
	c) At 75% load		

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

6693/2020/PS-PEM-MAX

	TITLE MOTORS DATA SHEET – C 4X250 MW NABINAGAR FGD	SPECIFICATION NO.
		VOLUME II B
		SECTION D
		REV NO. 00 DATE 12.03.2020
		SHEET 2 OF 2

S. No.	Description	Data to be filled by successful bidder
	c) At starting	
C.	Constructional Features	
1	Method of connection of motor driven equipment	
2	Applicable Standard	
3	DOP of Enclosure	
4	Method of cooling	
5	Class of insulation	
6	Main terminal box	
	a) Type	
	b) Power Cable details (Conductor, size, armour/unarmour)	
	c) Cable Gland & lugs details (Size, type & material)	
	d) Permissible Fault level (kArms & duration in sec)	
7	Space heater details (Voltage & watts)	
8	Flame proof motor details (if applicable)	
	a) Enclosure	
	b) suitability for hazardous area	
	i Zone	O / I / II
	ii Group	IIA / IIB / IIC
9	No. of Stator winding	
10	Winding connection	
11	Kind of rotor winding	
12	Kind of bearings	
13	Direction of rotation when viewed from NDE	
14	Paint Shade & type	
15	Net weight of motor	
16	Outline mounting drawing No (To be enclosed as annexure)	
D.	Characteristic curves/ drawings (To be enclosed for motors of rating $\geq 55KW$)	
	a) Torque speed characteristic	
	b) Thermal withstand characteristic	
	c) Current vs time	
	d) Speed vs time	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

6693/2020/PS-PEM-MAX

TITLE :

GENERAL TECHNICAL REQUIREMENTS

FOR

LV MOTORS

SPECIFICATION NO.

PE-SS-999-506-E101

VOLUME NO. : II-B

REV NO. : 00 DATE : 29/08/2005

SHEET : 1 OF 1

GENERAL TECHNICAL REQUIREMENTS**FOR****LV MOTORS****SPECIFICATION NO.: PE-SS-999-506-E101 Rev 00**

20/PS-PEM-MAX 20/PS-PEM-MAX 	FILE : GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101
		VOLUME NO. : II-B
		SECTION : D
		REV NO. : 00 DATE : 29/08/2005
		SHEET : 1 OF 4

1.0

INTENT OF SPECIFIATION

The specification covers the design, materials, constructional features, manufacture, inspection and testing at manufacturer’s work, and packing of Low voltage (LV) squirrel cage induction motors along with all accessories for driving auxiliaries in thermal power station.

Motors having a voltage rating of below 1000V are referred to as low voltage (LV) motors.

2.0

CODES AND STANDARDS

Motors shall fully comply with latest edition, including all amendments and revision, of following codes and standards:

IS:325	Three phase Induction motors
IS : 900	Code of practice for installation and maintenance of induction motors
IS: 996	Single phase small AC and universal motors
IS: 4722	Rotating Electrical machines
IS: 4691	Degree of Protection provided by enclosures for rotating electrical machines
IS: 4728	Terminal marking and direction of rotation rotating electrical machines
IS: 1231	Dimensions of three phase foot mounted induction motors
IS: 8789	Values of performance characteristics for three phase induction motors
IS: 13555	Guide for selection and application of 3-phase A.C. induction motors for different types of driven equipment
IS: 2148	Flame proof enclosures for electrical appliance
IS: 5571	Guide for selection of electrical equipment for hazardous areas
IS: 12824	Type of duty and classes of rating assigned
IS: 12802	Temperature rise measurement for rotating electrical machnines
IS: 12065	Permissible limits of noise level for rotating electrical machines
IS: 12075	Mechanical vibration of rotating electrical machines

In case of imported motors, motors as per IEC-34 shall also be acceptable.

3.0

DESIGN REQUIREMENTS

3.1

Motors and accessories shall be designed to operate satisfactorily under conditions specified in data sheet-A and Project Information, including voltage & frequency variation of supply system as defined in Data sheet-A

3.2

Motors shall be continuously rated at the design ambient temperature specified in Data Sheet-A and other site conditions specified under Project Information
Motor ratings shall have at least a 15% margin over the continuous maximum demand of the driven equipment, under entire operating range including voltage & frequency variation specified above.

3.3

Starting Requirements

3.3.1

Motor characteristics such as speed, starting torque, break away torque and starting time shall be properly co-ordinated with the requirements of driven equipment. The accelerating torque at any speed with the minimum starting voltage shall be at least 10% higher than that of the driven equipment.

3.3.2

Motors shall be capable of starting and accelerating the load with direct on line starting without exceeding acceptable winding temperature.

	TITLE : GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101 VOLUME NO. : II-B SECTION : D REV NO. : 00 DATE : 29/08/2005 SHEET : 2 OF 4
	The limiting value of voltage at rated frequency under which a motor will successfully start and accelerate to rated speed with load shall be taken to be a constant value as per Data Sheet - A during the starting period of motors. 3.3.3 The following frequency of starts shall apply i) Two starts in succession with the motor being initially at a temperature not exceeding the rated load temperature. ii) Three equally spread starts in an hour the motor being initially at a temperature not exceeding the rated load operating temperature. (not to be repeated in the second successive hour) iii) Motors for coal conveyor and coal crusher application shall be suitable for three consecutive hot starts followed by one hour interval with maximum twenty starts per day and shall be suitable for minimum 20,000 starts during the life time of the motor 3.4 Running Requirements 3.4.1 Motors shall run satisfactorily at a supply voltage of 75% of rated voltage for 5 minutes with full load without injurious heating to the motor. 3.4.2 Motor shall not stall due to voltage dip in the system causing momentary drop in voltage upto 70% of the rated voltage for duration of 2 secs. 3.5 Stress During bus Transfer 3.5.1 Motors shall withstand the voltage, heavy inrush transient current, mechanical and torque stress developed due to the application of 150% of the rated voltage for at least 1 sec. caused due to vector difference between the motor residual voltage and the incoming supply voltage during occasional auto bus transfer. 3.5.2 Motor and driven equipment shafts shall be adequately sized to satisfactorily withstand transient torque under above condition. 3.6 Maximum noise level measured at distance of 1.0 metres from the outline of motor shall not exceed the values specified in IS 12065. 3.7 The max. vibration velocity or double amplitude of motors vibration as measured at motor bearings shall be within the limits specified in IS: 12075. 4.0 CONSTRUCTIONAL FEATURES 4.1 Indoor motors shall conform to degree of protection IP: 54 as per IS: 4691. Outdoor or semi-indoor motors shall conform to degree of protection IP: 55 as per IS: 4691 and shall be of weather-proof construction. Outdoor motors shall be installed under a suitable canopy 4.2 Motors upto 160KW shall have Totally Enclosed Fan Cooled (TEFC) enclosures, the method of cooling conforming to IC-0141 or IC-0151 of IS: 6362. Motors rated above 160 KW shall be Closed Air Circuit Air (CACA) cooled 4.3 Motors shall be designed with cooling fans suitable for both directions of rotation.	

20/PS-PEM-MAX 07/05/17 	FILE : GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101
		VOLUME NO. : II-B
		SECTION : D
		REV NO. : 00 DATE : 29/08/2005
		SHEET : 3 OF 4
4.4.	Motors shall not be provided with any electric or pneumatic operated external fan for cooling the motors.	
4.5	Frames shall be designed to avoid collection of moisture and all enclosures shall be provided with facility for drainage at the lowest point.	
4.6	In case Class ‘F’ insulation is provided for LV motors, temperature rise shall be limited to the limits applicable to Class ‘B’ insulation. In case of continuous operation at extreme voltage limits the temperature limits specified in table-1 of IS:325 shall not exceed by more than 10°C.	
4.7	Terminals and Terminal Boxes	
4.7.1	Terminals, terminal leads, terminal boxes, windings tails and associated equipment shall be suitable for connection to a supply system having a short circuit level, specified in the Data Sheet-A. Unless otherwise stated in Data Sheet-A, motors of rating 110 kW and above will be controlled by circuit breaker and below 110 kW by switch fuse-contactor. The terminal box of motors shall be designed for the fault current mentioned in data sheet “A”.	
4.7.2	unless otherwise specified or approved, phase terminal boxes of horizontal motors shall be positioned on the left hand side of the motor when viewed from the non-driving end.	
4.7.3	Connections shall be such that when the supply leads R, Y & B are connected to motor terminals A B & C or U, V & W respectively, motor shall rotate in an anticlockwise direction when viewed from the non-driving end. Where such motors require clockwise rotation, the supply leads R, Y, B will be connected to motor terminals A, C, B or U W & V respectively.	
4.7.4	Permanently attached diagram and instruction plate made preferably of stainless steel shall be mounted inside terminal box cover giving the connection diagram for the desired direction of rotation and reverse rotation.	
4.7.5	Motor terminals and terminal leads shall be fully insulated with no bar live parts. Adequate space shall be available inside the terminal box so that no difficulty is encountered for terminating the cable specified in Data Sheet-A.	
4.7.6	Degree of protection for terminal boxes shall be IP 55 as per IS 4691.	
4.7.7	Separate terminal boxes shall be provided for space heaters.. If this is not possible in case of LV motors, the space heater terminals shall be adequately segregated from the main terminals in the main terminal box. Detachable gland plates with double compression brass glands shall be provided in terminal boxes.	
4.7.8.	Phase terminal boxes shall be suitable for 360 degree of rotation in steps of 90 degree for LV motors.	
4.7.9	Cable glands and cable lugs as per cable sizes specified in Data Sheet-A shall be included. Cable lugs shall be of tinned Copper, crimping type.	
4.8	Two separate earthing terminals suitable for connecting G.I. or MS strip grounding conductor of size given in Data Sheet-A shall be provided on opposite sides of motor frame. Each terminal box shall have a grounding terminal.	
4.9	General	

Page 186 of 528

	FILE : GENERAL TECHNICAL REQUIREMENTS FOR LV MOTORS	SPECIFICATION NO. PE-SS-999-506-E101 VOLUME NO. : II-B SECTION : D REV NO. : 00 DATE : 29/08/2005 SHEET : 4 OF 4
	4.9.1 Motors provided for similar drives shall be interchangeable. 4.9.2 Suitable foundation bolts are to be supplied alongwith the motors. 4.9.3 Motors shall be provided with eye bolts, or other means to facilitate safe lifting if the weight is 20Kgs. and above. 4.9.4 Necessary fitments and accessories shall be provided on motors in accordance with the latest Indian Electricity rules 1956. 4.9.5 All motors rated above 30 kW shall be provided with space heaters to maintain the motor internal air temperature above the dew point. Unless otherwise specified, space heaters shall be suitable for a supply of 240V AC, single phase, 50 Hz. 4.9.6 Name plate with all particulars as per IS: 325 shall be provided 4.9.7 Unless otherwise specified, the colour of finish shall be grey to Shade No. 631 and 632 as per IS:5 for motors installed indoor and outdoor respectively. The paint shall be epoxy based and shall be suitable for withstanding specified site conditions. 5.0 INSPECTION AND TESTING 5.1 All materials, components and equipments covered under this specification shall be procured, manufactured, as per the BHEL standard quality plan No. PED-506-00-Q-006/0 and PED-506-00-Q-007/2 enclosed with this specification and which shall be complied. 5.2 LV motors of type-tested design shall be provided. Valid type test reports not more than 5 year shall be furnished. In the absence of these, type tests shall have to be conducted by manufacturer without any commercial implication to purchaser. 5.3 All motors shall be subjected to routine tests as per IS: 325 and as per BHEL standard quality plan. 5.4 Motors shall also be subjected to additional tests, if any, as mentioned in Data Sheet A. 6.0 DRAWINGS TO BE SUBMITTED AFTER AWARD OF CONTRACT a) OGA drawing showing the position of terminal boxes, earthing connections etc. b) Arrangement drawing of terminal boxes. c) Characteristic curves: (To be given for motor above 55 kW unless otherwise specified in Data Sheet). i) Current vs. time at rated voltage and minimum starting voltage. ii) Speed vs. time at rated voltage and minimum starting voltage. iii) Torque vs. speed at rated voltage and minimum voltage. For the motors with solid coupling the above curves i), ii), iii) to be furnished for the motors coupled with driven equipment. In case motor is coupled with mechanical equipment by fluid coupling, the above curves shall be furnished with and without coupling. iv) Thermal withstand curve under hot and cold conditions at rated voltage and max. permissible voltage.	



SUB-SECTION-V-QE1

MOTORS

**LOT-IA PROJECTS
FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.: CS-0011-109(1A)-2**

 MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	STANDARD QUALITY PLAN		SPEC. NO. :
	CUSTOMER :		QP NO. : PED-506-00-Q-006, REV-02
	PROJECT :		DATE: 27.02.2020
	ITEM: AC ELECT. MOTORS UPTO 55KW (LV (415V))		PO NO. :
	SYSTEM: SECTION: II		SHEET 1 OF 2

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
1	2	3	4	5	6		7	8	9	* D		** M C N		
					M	C/N								
1.0	ASSEMBLY	1.WORKMANSHIP	MA	VISUAL	100%	-	MFG. SPEC.	MFG. SPEC.	-DO-			P	-	-
		2.DIMENSIONS	MA	-DO-	-DO-	-	MFG. DRG./ MFG. SPEC.	MFG. DRG./ MFG. SPEC.	-DO-			P	-	-
		3.CORRECTNESS COMPLETENESS TERMINATIONS/ MARKING/COLOUR CODE	MA	VISUAL	100%	-	MFG. SPEC./	MFG. SPEC.	-DO-			P	-	-
2.0	PAINTING	1.SHADE	MA	VISUAL	SAMPLE	-	MFG. SPEC/ APPROVED DATASHEET	SAME AS COL.7	LOG BOOK			P	-	-
3.0	TESTS	1.ROUTINE TEST INCLUDING SPECIAL TEST	MA	-DO-	100%	100%	IS-325 / IS-12615/ APPROVED DATA SHEET	SAME AS COL.7	TEST/ INSPN. REPORT			P	W	W
		2.OVERALL DIMENSIONS & ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET	TEST/ INSPN. REPORT			P	W	W

NOTE -1
&
NOTE-2

NOTE -1
&
NOTE-2

ENGINEERING		BHEL		QUALITY	
Sign & Date	Name		Sign & Date	Name	
Prepared by: <i>[Signature]</i>	Hema K.		Checked by: <i>[Signature]</i>	Kunt	
Reviewed by: <i>[Signature]</i>	P.Dutta		Reviewed by: <i>[Signature]</i>	Ganesh	

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

 MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO.:	
		CUSTOMER :		QIP NO.: PED-506-00-Q-006, REV.02	
PROJECT:		ITEM: AC ELECT. MOTORS UPTO 56KW (LV (415V))		PO NO.:	
SYSTEM:		SECTION: II		SHEET 2 OF 2	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY			
1	2	3	4	5	6		7	8	9	D	..			
					M	C/N					M	C	N	
		3 NAMEPLATE DETAILS	MA	VISUAL	100%	100%	IS-325 / IS-12815 / APPROVED DATA SHEET	SAME AS COL.7	TEST/ INSPN. REPORT		P	W	W	
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MFG. STANDARD / APPROVED PACKING DRAWING. (#)	AS PER MFG. STANDARD / APPROVED PACKING DRAWING. (#)	INSPC. REPORT		P	W	-	(#) APPLICABLE FOR EXPORT JOBS

NOTES:

- 1 ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR, HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON
- 2 FOR EXHAUST/VENTILATION FAN MOTORS OF RATING UPTO 1.5KW, ONLY ROUTINE TEST CERTIFICATES SHALL BE FURNISHED FOR SCRUTINY.
- 3 IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
- 4 BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
- 5 AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL FOR REVIEW.
- 6 IN CASE, ANY CHANGES IN QIP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/CUSTOMER.

LEGENDS:

* RECORDS, IDENTIFIED WITH "TICK" (✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 ** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,
 P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
 MA: MAJOR, MI: MINOR, CR: CRITICAL
 D: DOCUMENT

ENGINEERING				BHEL		QUALITY	
Sign & Date	Name		Sign & Date	Name			
Prepared by:	Hema K.		Checked by:	Kumar			
Reviewed by:	P. D. H. S.		Reviewed by:	G. D. H. S.			



BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

 MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO. :	
		CUSTOMER :		QP NO. : PED-506-00-Q-007, REV/04	
		PROJECT :		PO NO. :	
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	
		SECTION: II		SHEET 1 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY				
					M	C/N			9		D	M	C	N	
1	2	3	4	5		6	7	8							
1.0	RAW MATERIAL & BOUGHT OUT CONTROL.														
1.1	SHEET STEEL, PLATES, SECTION, EYEBOLTS.	1 SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM BLINKS, CRACKS, WAVERNESS ETC	LOG BOOK		P	-	-		
1.2	HARDWARES	2 DIMENSIONS	MA	MEASUREMENT	SAMPLE	-	MANUFACTURERS DRG./SPEC	MANUFACTURERS DRG./SPEC	-DO-	-DO-	P	-	-		
		3 PROOF LOAD TEST (EYE BOLT)	MA	MECH. TEST	-DO-	-	-DO-	MANUFACTURERS DRG./SPEC	-DO-	TEST REPORT	PV	-	-		
		1 SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM CRACKS, UN-EVENNESS ETC.	-DO-	P	-	-	-		PROPERTY CLASS MARKING SHALL BE CHECKED BY THE VENDOR
1.3	CASTING	2 PROPERTY CLASS	MA	VISUAL	SAMPLES	-	MANUFACTURERS DRG./SPEC	MANUFACTURERS DRG./SPEC	SUPPLIERS TC & LOG		PV	-	-		
		1 SURFACE CONDITION	MA	VISUAL	100%	-	-	FREE FROM CRACKS, BLOW HOLES ETC.	LOG BOOK		PV	-	-		
1.4	PAINT & VARNISH	2 CHEM. & PHY. PROP.	MA	CHEM & MECH TEST	1/HEAT NO.	-	MANUFACTURERS DRG./SPEC	MANUFACTURERS DRG./SPEC	SUPPLIERS TC		PV	-	-		HEAT NO SHALL BE VERIFIED
		3 DIMENSIONS	MA	MEASUREMENT	100%	-	-	MANUFACTURERS DRG.	LOG BOOK		PV	-	-		
		1 MAKE, SHADE, SHELF LIFE & TYPE	MA	VISUAL	100% CONTINUOUS	-	-	MANUFACTURERS DRG./SPEC	LOG BOOK		PV	-	-		

Page 191 of 528

ENGINEERING		BHEL		QUALITY	
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name
Reviewed by:		Hema K.	Reviewed by:		Hema K.

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

		MANUFACTURER/ BIDDER SUPPLIER NAME & ADDRESS	
STANDARD QUALITY PLAN		SPEC. NO. :	
CUSTOMER :		QP NO. : PED-506-00-Q-007, REV-04	
PROJECT :		DATE: 27.02.2020	
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	
SECTION: II		SHEET 2 OF 9	

SI No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				
					M	C/N				D	M	C	N	
1														
15	SHAFT (FORGED OR ROLLED)	1. SURFACE COND. 2. CHEM. & PHYSICAL PROPERTIES	MA	VISUAL	100%	-	MANUFACTURER'S DRG./ SPEC.	FREE FROM VISUAL DEFECTS MANUFACTURER'S DRG./ STD.	-DO- SUPPLIERS TC	P	-	-	-	VENDOR'S APPROVAL IDENTIFICATION SHALL BE MAINTAINED
16	SPACE HEATERS, CONN- TIONS, TERMINAL BLOCKS, CABLES, CABLE TIES, CARBON BRUSH TEMP DETECTORS, RTD, RTDS	1. MAKE & RATING 2. PHYSICAL COND. 3. DIMENSIONS (WHEREVER APPLICABLE) 4. PERFORMANCE/ CALIBRATION	MA	VISUAL	100%	-	MANUFACTURER'S DRG./ STD.	MANUFACTURER'S DRG./ STD.	-DO- TEST REPORT	PV	-	-	-	FOR DIA OF 55 MM & ABOVE

ENGINEERING		BHEL		QUALITY	
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name
Reviewed by:					

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

 MANUFACTURER/BIDDER SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO.:		DATE: 27.02.2020 SHEET 3 OF 9
		CUSTOMER :		QP NO. : PED-5005-00-Q-007, REV.04		
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		
				SECTION: II		

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY				
1	2	3	4	5	6		7	8	9	10		11			
					M	CN				D	M	C	N		
1.7	OTHER INSULATING MATERIALS LIKE SLEEVES, BINDINGS CORDS, PAPERS, PRESS BOARDS ETC.	1. SURFACE COND. ETC. 2. OTHER CHARACTERISTICS	MA	VISUAL	100%	-	MANUFACTURERS STD.	NO VISUAL DEFECTS	TEST REPORT	PV	-	-	-	-	
1.8	SHEET STAMPING (PUNCHED)	1. SURFACE COND.	MA	VISUAL	100%	-	-	NO VISUAL DEFECTS (FREE FROM BURS)	LOG BOOK	P	-	-	-	-	
1.9	CONDUCTORS	2.DIMENSIONS INCLUDING BURS HEIGHT	MA	MEASUREMENT	SAMPLE	-	MANUFACTURERS DRG.	MANUFACTURERS DRG.	-DO-	PV	-	-	-	-	
		3. ACCEPTANCE TESTS	MA	ELECT. & MECH TESTS	-DO-	-	MANUFACTURERS DRG/ STD.	MANUFACTURERS DRG/ STD.	SUPPLIERS TC	PV	-	-	-	-	
		1. SURFACE FINISH	MA	VISUAL	100%	-	-	FREE FROM VISUAL DEFECTS	LOG BOOK	TPV	-	-	-	-	
		2.ELECT. PROP. & MECH PROP	MA	ELECT. & MECH TEST	SAMPLES	-	MANUFACTURERS DRG/ SPEC.	MANUFACTURERS / SPEC.	SUPPLIERS TC & VENDORS TEST REPORTS	PV	-	-	-	-	
* MOTOR MANUFACTURER TO CONDUCT INSULATION TEST FOR SURFACE FINISH ON RANDOM BASIS (10% SAMPLE) AT HIS WORKS AND MAINTAIN RECORD FOR VERIFICATION BY BHEL/CUSTOMER															

Page 193 of 528

* MOTOR MANUFACTURER TO CONDUCT VISUAL CHECK FOR SURFACE FINISH ON BASIS 10% SAMPLE AT HIS WORKS AND MAINTAIN RECORD FOR VERIFICATION BY BHEL/CUSTOMER.

ENGINEERING		BHEL		QUALITY	
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name
Reviewed by:					

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

			
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS			
STANDARD QUALITY PLAN		SPEC. NO.:	
CUSTOMER :		QP NO.: PED-506-00.Q.007, REV-04	
PROJECT:		PO NO.:	
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:	SECTION: II	DATE: 27.02.2020
SHEET 4 OF 9			

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD		AGENCY		
1	2	3	4	5	6		7	8	9	*	**		
					M	CN					M	C	N
1.10	BEARINGS	3.DIMENSIONS 1.MAKE & TYPE 2.DIMENSIONS	MA MA MA	MEASUREMENT VISUAL MEASUREMENT	-DO- 100% SAMPLE	- - -	-DO- MANUFACTURERS DRG / APPROVED DATASHEET APPROVED DATASHEET	-DO- MANUFACTURERS DRG / APPROVED DATASHEET APPROVED DATASHEET/ BEARING MANUFS CATALOGUES	Log Book -DO- -DO-	 <			

ENGINEERING				QUALITY			
BHEL							
Prepared by:	Sign & Date	Name		Sign & Date	Name		
Reviewed by:	44/12/2019	Hemant K.	Checked by:	44/12/2019	K. R. S.	Reviewed by:	
		P. Dutta					

BIDDER/ SUPPLIER	
Sign & Date	
Seal	

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:			
	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

	
MANUFACTURER/BIDDER/ SUPPLIER NAME & ADDRESS	
STANDARD QUALITY PLAN	SPEC. NO.:
CUSTOMER :	QP NO. : PED-506-00-Q-007, REV-04
PROJECT:	PO NO.:
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))	SYSTEM:
SECTION: II	DATE: 27.02.2020
SHEET 5 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY												
					M	CN				D	M	C	N									
1	2	3	4	5	-	-	7	8	9	.	M	C	N									
20	IN PROCESS STATOR FRAME WELDING (IN CASE OF FABRICATED STATOR)	1 WORKMANSHIP & CLEANNESS	MA	VISUAL	100%	-	-DO-	GOOD FINISH	LOG BOOK	PW	-	-	-									
21	2 DIMENSIONS	MA	MEASUREMENT	-DO-	-	MANUFACTURERS DRG	MANUFACTURERS DRG	-DO-	LOG BOOK	P	-	-	-									
22	MACHINING	MA	1 FINISH 2 DIMENSIONS	VISUAL	100%	-	-DO- MANUFACTURERS DRG	GOOD FINISH MANUFACTURERS DRG	LOG BOOK	P	-	-	-									
23	PAINING	MA	3 SHAFT SURFACE FLOWS	PT	100%	100%	MANUFACTURERS STD / ASTM E 185	MANUFACTURERS STD / APPROVED DATASHEET, SAME AS COL.7	LOG BOOK	✓	P	V	-									
		MA	1 SURFACE PREPARATION	VISUAL	100%	-	MANUFACTURERS STD/APPROVED DATASHEET		LOG BOOK	P	-	-	-									
		MA	2 PAINT THICKNESS (BOTH PRIMER & FINISH COAT)	MEASUREMENT BY ELCOMETER	SAMPLE	-	-DO-	-DO-	-DO-	P	-	-	-									
		MA	3 SHADE	VISUAL	-DO-	-	-DO-	-DO-	LOG BOOK	P	-	-	-									
		MA	4 ADHESION	GROSS CUTTING & TAPE TEST	-DO-	-	-DO-	-DO-	LOG BOOK	P	-	-	-									
ENGINEERING				BHSL				QUALITY														
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name																	
Reviewed by:																						
				BIDDER/SUPPLIER																		
				SIGN & DATE																		
				Seal																		
										FOR CUSTOMER REVIEW & APPROVAL												
										Doc No:	Sign & Date	Name	Seal									
										Reviewed by:												
										Approved by:												

 MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO.:		
		CUSTOMER:		CP NO.: PED-506-00-Q-007, REV.04		DATE: 27.02.2020
		PROJECT:		PO NO.:		
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:		
				SECTION: II		SHEET 6 OF 9

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				THREE DIPS TO BE GIVEN
					M	CN				D	M	C	N	
1														
2.4	SHEET STACKING	1.COMPLETENESS 2.COMPRESSION & TIGHTENING 1.COMPLETENESS	MA	MEASUREMENT MEASUREMENT			MANUFACTURERS STD. -DO-	MANUFACTURERS STD. -DO-	LOG BOOK		P	-	-	
2.5	WINDING	2.CLEANLINESS 3.IR/HV-IR 4.RESISTANCE 5.INTERTURN INSULATION	CR	VISUAL ELECT. TEST -DO- -DO- -DO-	100% 100% 100% 100%		MANUFACTURERS STD/APPROVED DATASHEET -DO- IS-325/IS-12815/IEC-60034 PART-1 IS-325/IS-12815/IEC-60034 PART-1 -DO-	MANUFACTURERS STD/APPROVED DATASHEET -DO- IS-325/IS-12815/IEC-60034 PART-1 IS-325/IS-12815/IEC-60034 PART-1 -DO-	LOG BOOK LOG BOOK LOG BOOK LOG BOOK		P P P P	- V - -	- - - -	
2.6	IMPERMEATION	1.VISCOSITY 2.TEMP. PRESSURE VACUUM 3.NO. OF DIPS	MA	PRY. TEST PROCESS CHECK -DO-	AT STARTING CONTINUOUS CONTINUOUS		MANUFACTURERS STANDARD MANUFACTURERS STANDARD MANUFACTURERS STANDARD	MANUFERS STANDARD MANUFACTURERS STANDARD MANUFACTURERS STANDARD	LOG BOOK LOG BOOK LOG BOOK		P P P	- - V	- - -	

02/03/2020

ENGINEERING		QUALITY	
Prepared by:	Sign & Date	Checked by:	Sign & Date
Reviewed by:	Name	Reviewed by:	Name

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No.:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

 MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO.:	DATE: 27.02.2020 SHEET 7 OF 9
		CUSTOMER :		QP NO.: PED-506-00-Q-007, REV-04	
		PROJECT:		PO NO.:	
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))		SYSTEM:	
				SECTION: II	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
					M	CN				D	M	C	N
1													
2.7	COMPLETE STATOR ASSEMBLY	4 DURATION 1 COMPLETENESS & CLEANLINESS 1 COMPLETENESS	MA MA CR	-DO- VISUAL -DO-	CONTINUOUS 100% -DO-	CONTINUOUS -DO-	-DO- -DO- -DO-	-DO- -DO- -DO-	LOG BOOK LOG BOOK LOG BOOK	✓ P P	P P P	V - -	- - -
2.8	BRAZING COMPRESSION JOINT	2 SOUNDNESS	CR	Mallet Test & UT	100% -DO-	100% -DO-	-DO- -DO-	-DO- -DO-	LOG BOOK	✓ P	P P	V -	- -
2.9	COMPLETE ROTOR ASSEMBLY	3 HV 1 RESIDUAL UNBALANCE 2 SOUNDNESS CASTING	MA CR CR	ELECT. TEST DYN. BALANCE ELECT. (GROWLER TEST)	100% -DO- 100%	100% -DO- 100%	-DO- MANUFACTURER'S SPEC/ ISO 1940 MANUFACTURER'S SPEC.	-DO- MANUFACTURER'S DWG. MANUFACTURER'S SPEC.	LOG BOOK LOG BOOK LOG BOOK	✓ P P	P P P	V - -	- - -
2.10	ASSEMBLY	1 ALIGNMENT 2 WORKMANSHIP 3 AXIAL PLAY 4 DIMENSIONS 5 CORRECTNESS, COMPLETENESS, TERMINATIONS/ MARKING/ COLOUR CODE 6 RTD, RTD & SPACE HEATER MOUNTING	MA MA MA MA MA MA	MEAS. VISUAL MEAS. -DO- VISUAL	-DO- -DO- 100% -DO- 100%	-DO- -DO- -DO- -DO- -DO-	-DO- -DO- -DO- -DO- MANUFACTURER'S SPEC.	-DO- -DO- -DO- -DO- MANUFACTURER'S SPEC.	LOG BOOK LOG BOOK LOG BOOK LOG BOOK LOG BOOK	✓ P P P P	P P P P P	V - - - -	- - - -

ENGINEERING		BHEL		QUALITY	
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name
Reviewed by:			Reviewed by:		

BIDDER/ SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

STANDARD QUALITY PLAN										SPEC. NO.			
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS										DATE: 27.02.2020			
CUSTOMER :										QIP NO.: PED-506-00-Q-007, REV.04			
PROJECT:										PO NO.:			
ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))										SYSTEM:			
SECTION: II										SHEET 8 OF 9			
Sl. No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY			
1	2	3	4	5	6	7	8	9		D	M	C	N
3.0	TESTS	1. TYPE TESTS INCLUDING SPECIAL TESTS 2. ROUTINE TESTS INCLUDING SPECIAL TEST	MA	ELECT. TEST	1/TYPE/SIZE	1/TYPE/SIZE	IS-325/IS-12615/APPROVED DATASHEET	IS-325/IS-12615/APPROVED DATASHEET	TEST REPORT	P	W*	W*	NOTE - 1
		3. VIBRATION & NOISE LEVEL	MA	-DO-	100%	100%	IS-12075 / IEC 60034-14 & IS-12065	IS-12075 / IEC 60034-14 & IS-12065	-DO-	P	VW*	VW*	NOTE - 2
		4. OVERALL DIMENSIONS AND ORIENTATION	MA	MEASUREMENT & VISUAL	100%	100%	APPROVED DRG/DATA SHEET	APPROVED DRG/DATA SHEET &	TEST/INSPC REPORT	P	W	-	TC FROM AN INDEPENDENT LABORATORY, REFER NOTE-3
		5. DEGREE OF PROTECTION	MA	ELECT. & MECH. TEST	1/TYPE/ SIZE	1/TYPE/ SIZE	IEC 60034-5/IS-12615	APPROVED DATASHEET	TC	✓	P	V	V
		6. MEASUREMENT OF RESISTANCE OF RTD & RTD	MA	-DO-	100%	100%	IS-325/IS-12615/IEC-60034 PART-1 /IS-12062	IS-325/IS-12615/IEC-60034 PART-1 /IS-12062	-DO-	P	VW*	VW*	NOTE - 2
		7. MEASUREMENT OF RESISTANCE IN OF SPACE HEATER	MA	-DO-	100%	100%	IS-325/IS-12615/IEC-60034 PART-1	IS-325/IS-12615/IEC-60034 PART-1	-DO-	P	VW*	VW*	NOTE - 2
		8. NAME PLATE DETAILS	MA	VISUAL	100%	100%	IS-325/IS-12615 & DATA SHEET	IS-325/IS-12615 & DATA SHEET	TEST/INSPC REPORT	P	VW*	VW*	NOTE - 2
		9. EXPLOSION FLAME PROOF (PRESSURE SPECIFIED)	MA	EXPLOSION FLAME PROOF TEST	1/TYPE	1/TYPE	IS 2148 / IEC 60079-1	IS 2148 / IEC 60079-1	TC	✓	P	V	V
		10. PAINT SHADE, THICKNESS & FINISH	MA	VISUAL & MEASUREMENT BY ELKONETER	SAMPLE	SAMPLE	APPROVED DATASHEET	APPROVED DATASHEET	TC		P	WS	WS
SAMPLING PLAN TO BE DECIDED BY INSPECTION AGENCY													
NOTE - 2													

ENGINEERING			QUALITY			BIDDER/SUPPLIER			FOR CUSTOMER REVIEW & APPROVAL		
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Sign & Date	Seal	Doc No:	Sign & Date	Name	Seal
03/01/2020	03/01/2020	P. Dab	03/01/2020	03/01/2020	K. K. K.						

		STANDARD QUALITY PLAN				SPEC. NO.		DATE: 27.02.2020	
		CUSTOMER :				QP NO.: PED-506-00-Q-007, REV-04			
		PROJECT:				PO NO.:			
		ITEM: AC ELECT. MOTORS 55 KW & ABOVE (LV (415V))				SYSTEM:			
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS				SECTION: II				SHEET 9 OF 9	

Sl No.	Component & Operations	Characteristics	Class	Type of Check	Quantum Of check		Reference Document	Acceptance NORMS	FORMAT OF RECORD	AGENCY				IF APPLICABLE REFER SEAWORTHY PACKING ALSO.
1	2	3	4	5	6		7	8	9					
					M	CN				D	M	P	C	N
4.0	PACKING	SURFACE FINISH & COMPLETENESS	MA	VISUAL	100%	100%	AS PER MANUFACT STANDARD / APPROVED CROSS SECTION DRAWING.	AS PER MANUFACT STANDARD / APPROVED CROSS SECTION DRAWING.	INSPEC. REPORT					

NOTES:

1. DEPENDING UPON THE SIZE AND CRITICALLY, WITNESSING BY BHEL SHALL BE DECIDED.
2. ROUTINE TESTS ON 100% MOTORS SHALL BE DONE BY THE VENDOR. HOWEVER, BHEL/CUSTOMER SHALL WITNESS ROUTINE TESTS ON RANDOM SAMPLES. THE SAMPLING PLAN SHALL BE MUTUALLY AGREED UPON.
3. IN CASE TEST CERTIFICATES FOR THESE TESTS ON SIMILAR TYPE, SIZE AND DESIGN OF MOTOR FROM INDEPENDENT LABORATORY ARE AVAILABLE, THESE TEST MAY NOT BE REPEATED.
4. BHEL RESERVES THE RIGHT TO PERFORM REPEAT TEST, IF REQUIRED.
5. AFTER PACKING AND PRIOR TO ISSUE MDCC, PHOTOGRAPHS OF ITEMS TO BE DESPATCHED SHALL BE SENT TO BHEL PURCHASE GROUP FOR REVIEW.
6. IN CASE, ANY CHANGES IN QP COMMENTED BY CUSTOMER AT CONTRACT STAGE SHALL BE CARRIED OUT BY BIDDER WITHOUT ANY IMPLICATION TO BHEL/CUSTOMER.

LEGENDS:

* RECORDS, IDENTIFIED WITH TICK(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

** M: SUPPLIER/ MANUFACTURER/ SUB-SUPPLIER, B: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, C: CUSTOMER,

P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE

MA: MAJOR, MI: MINOR, CR: CRITICAL

D: DOCUMENT

ENGINEERING		BHEL		QUALITY	
Sign & Date	Name	Sign & Date	Name	Sign & Date	Name
Prepared by:	<i>[Signature]</i>	Checked by:	<i>[Signature]</i>	Reviewed by:	<i>[Signature]</i>
Reviewed by:	<i>[Signature]</i>	Reviewed by:	<i>[Signature]</i>	Reviewed by:	<i>[Signature]</i>

BIDDER/SUPPLIER	
Sign & Date	Seal

FOR CUSTOMER REVIEW & APPROVAL			
Doc No:	Sign & Date	Name	Seal
Reviewed by:			
Approved by:			

CLAUSE NO.		QUALITY ASSURANCE																		
MOTOR																				
TESTS/CHECKS TEMS/COMPONENTS		Visual	Dimensional	Make/Type/Rating Physical Inspection	Mech/Chem. Properties	NDT /DP/MPI/UT	Metallography	Electrical Characteristics	Welding/Brazing(WPS/PQR)	Heat Treatment	Magnetic Characteristics	Hydraulic/Leak/Pressure Test	Thermal Characteristics	Run out	Dynamic Balancing	Routine & Acceptance tests as per IS-325/IS-4722 /IS- 9283/IS 2148/IEC60034/IEC 60079-I/ IS-12615	Vibration	Over speed	Tan delta, shaft voltage & polarization index test	Paint shade, thickness & adhesion
Plates for stator frame, end shield, spider etc.		Y	Y	Y	Y	Y				Y										
Shaft		Y	Y	Y	Y	Y	Y			Y										
Magnetic Material		Y	Y	Y	Y			Y			Y		Y							
Rotor Copper/Aluminium		Y	Y	Y	Y			Y		Y										
Stator copper		Y	Y	Y	Y			Y		Y			Y							
SC Ring		Y	Y	Y	Y	Y		Y	Y	Y			Y							
Insulating Material		Y		Y	Y			Y					Y							
Tubes, for Cooler		Y	Y	Y	Y	Y				Y		Y								
Sleeve Bearing		Y	Y	Y	Y	Y				Y		Y								
Stator/Rotor, Exciter Coils		Y	Y	Y				Y	Y											
Castings, stator frame, terminal box and bearing housing etc.		Y	Y	Y	Y	Y			Y											
Fabrication & machining of stator, rotor, terminal box		Y	Y			Y			Y	Y										
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE						TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2						SUB-SECTION-V-QE1 MOTORS				PAGE 1 OF 2				

CLAUSE NO.	QUALITY ASSURANCE																		
Wound stator	Y	Y					Y	Y											
Wound Exciter	Y	Y					Y	Y											
Rotor complete	Y	Y					Y						Y	Y					
Exciter, Stator, Rotor, Terminal Box assembly	Y	Y					Y												
Accessories, RTD, BTD,CT, Space heater, antifriction bearing, gaskets etc.	Y	Y	Y																
Complete Motor	Y	Y	Y												Y	Y	Y	Y1 Y	
Note: 1. This is an indicative list of tests/checks. The manufacture is to furnish a detailed Quality Plan indicating the practices & Procedure followed along with relevant supporting documents during QP finalization. However, No QP for LT motor upto 50KW. 2. Additional routine tests for Flame proof motors shall be applicable as per relevant standard 3. Makes of major bought out items for HT motors will be subject to NTPC approval. 4. Y1 = for HT Motor / Machines only.																			
LOT-IA PROJECTS FLUE GAS DESULPHURISATION SYSTEM PACKAGE						TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC. NO CS-0011-109(1A)-2						SUB-SECTION-V-QE1 MOTORS				PAGE 2 OF 2			

Page 202 of 528

CLAUSE NO.	TECHNICAL REQUIREMENTS		
3.02.00 3.02.01 3.02.02 3.02.03	Support System for Cable Trays Cable tray support system shall be pre-fabricated out of single sheet as per enclosed tender drawings. Support system for cable trays shall essentially comprise of the two components i.e. main support channel and cantilever arms. The main support channel shall be of two types : (i) C1:- having provision of supporting cable trays on one side and (ii) C2:-having provision of supporting cable trays on both sides. The support system shall be the type described hereunder - Cable supporting steel work for cable racks/cables shall comprise of various channel sections, cantilever arms, various brackets, clamps, floor plates, all hardwares such as lock washers, hexagon nuts, hexagon head bolt, support hooks, stud nuts, hexagon head screw, channel nut, channel nut with springs, fixing studs, etc. - The system shall be designed such that it allows easy assembly at site by using bolting. All cable supporting steel work, hardwares fittings and accessories shall be prefabricated factory galvanised. - The main support and cantilever arms shall be fixed at site using necessary brackets, clamps, fittings, bolts, nuts and other hardware etc. to form various arrangements required to support the cable trays. Welding of the components shall not be allowed. However, welding of the bracket (to which the main support channel is bolted) to the overhead beams, structural steel, insert plates or reinforcement bars will be permitted. Any cutting or welding of the galvanised surface shall be brushed and red lead primer, oil primer & aluminium paint shall be applied - All steel components, accessories, fittings and hardware shall be hot dip galvanised after completing welding, cutting, drilling and other machining operation. - The typical arrangement of flexible support system is shown in the enclosed drawings and described briefly below: The main support channel and cantilever arms shall be fabricated out of 2.5 thick rolled steel sheet conforming to IS 1079. - Cantilever arms of 320 mm, 620mm and 750 mm in length are required, and shall be as shown in the enclosed drawing. The arm portion shall be suitable for assembling the complete arm assembly on to component constructed of standard channel section. The back plate shall allow sufficient clearance for fixing bolt to be tightened with tray in position. - Support system shall be able to withstand - weight of the cable trays - weight of the cables (75 Kg/Metre run of each cable tray) - Concentrated load of 75 Kg between every support span. - Factor of safety of minimum 1.5 shall be considered. The size of structural steel members or thickness of sheet steel of main support channel and cantilever arms and other accessories as indicated above or in the enclosed drawings are indicative only. Nevertheless, the support system shall be designed by the bidder to fully meet the requirements of type tests as specified. In case the system fails in the tests, the components design modification shall be done by the Bidder without any additional cost to	LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2 SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION Page 4 of 69	

CLAUSE NO.	TECHNICAL REQUIREMENTS	
	the Employer. The bidder shall submit the detailed drawings of the system offered by him alongwith the bid.	
3.02.04	Four legged structure shall be provided wherever there is change in elevation and change in direction	
3.02.05	FOR COAL HANDLING PLANT/FGD PLANT AREA THE FOLLOWING SHALL ALSO BE APPLICABLE: a) All overhead cable routes shall be along the route of the conveyor gallery on separate supporting structures and cables shall be laid in vertical trays. The bottom of the steel shall be such that the existing facilities, movement of trucks/human beings etc. does not get affected. The cable trestle shall have a minimum 600mm clear walk way and shall have maintenance platforms as required. The bottom of the steel supporting structure shall be generally at 3.0M above the grade level except for rail/road crossings where it shall be at 8.0M above grade level. Tap offs from the overhead cable trestle can be through shallow trenches with prior approval of the Employer. Directly buried cable, if essential, shall not have concentration of more than 4 cables on one route. b) Cable trenches shall be provided only in Switchgear/MCC rooms. c) Cables shall not be routed through the conveyor galleries except for the equipment located in the conveyor galleries for a particular conveyor i.e. protection switches, receptacles etc. d) Cables for PCS and BSS shall be routed along the conveyors through GI conduits.	
3.03.00	Pipes, Fittings & Accessories	
3.03.01	Pipes offered shall be complete with fittings and accessories (like tees, elbows, bends, check nuts, bushings, reducers, enlargers, coupling caps, nipples etc.) The size of the pipe shall be selected on the basis of maximum 40% fill criteria	
3.03.02	GI Pipes shall be of medium duty as per IS: 1239	
3.03.03	Duct banks shall be High Density PE pipes encased in PCC (10% spare of each size, subject to minimum one) with suitable water-proof manholes.	
3.03.04	Hume pipes shall be NP3 type as per IS 458.	
3.03.05	TERNE Coated Flexible Steel Conduits shall be water proof and rust proof made of heat resistant lead coated steel. Conduit diameter shall be uniform throughout its length. Internal surface of the conduit shall be free from burrs and sharp edges. Conduits shall be complete with necessary accessories for proper termination of the conduit with junction boxes and lighting fixtures	
3.03.06	HDPE pipes and conduits shall be PE-80, PN-10 type as per IS 4984/IS 8008 part-I.	
3.04.00	Junction Boxes	
3.04.01	Junction box shall be made of Fire retardant material. Material of JB shall be Thermoplastic or thermosetting or FRP type. The box shall be provided with the terminal blocks, mounting bracket and screws etc. The cable entry shall be through galvanized steel conduits of	
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION Page 5 of 69

IPS-PEM-MAX

CLAUSE NO.

TECHNICAL REQUIREMENTS



suitable diameter. The JB shall have suitable for installing glands of suitable size on the bottom of the box. The JB shall be suitable for surface mounting on ceiling/structures. The JB shall be of grey color RAL 7035. All the metal parts shall be corrosion protected. Junction box surface should be such that it is free from crazings, blisterings, wrinkling, colour blots/striations. There should not be any mending or repair of surface. JB's will be provided with captive screws so that screws don't fall off when cover is opened. JB's mounting brackets should be of powder coated MS. Type test reports for the following tests shall be furnished:-

(a) Impact resistance for impact energy of 2 Joules (IK07) as per BS EN50102

(b) Thermal ageing at 70deg C for 96 hours as per IEC60068-2-2Bb.

(c) Class of protection shall be IP 55.

(d) HV test.

3.04.02

Terminal blocks shall be 1100V grade, of suitable current rating, made up of unbreakable polyamide 6.6 grade. The terminals shall be screw type or screw-less (spring loaded) / cage clamp type with lugs. Marking on terminal strips shall correspond to the terminal numbering in wiring diagrams. All metal parts shall be of non-ferrous material. In case of screw type terminals the screw shall be captive, preferably with screw locking design. All terminal blocks shall be suitable for terminating on each side the required cables/wire size. All internal wiring shall be of cu. Conductor PVC wire.

3.05.00

Terminations & Straight Through Joints

3.05.01

Termination and jointing kits for 33kV, 11 kV, 6.6 KV and 3.3 kV grade XLPE insulated cables shall be of proven design and make which have already been extensively used and type tested. Termination kits and jointing kits shall be Pre-moulded type or heat shrinkable type. Further Cold shrinkable type termination and jointing kits are also acceptable. The Cold shrinkable type kits shall be type tested as per relevant standards. Calculation to withstand the required fault level shall also be furnished in case of cold shrinkable type kits. 33 kV, 11 kV, 6.6 KV and 3.3kV grade joints and terminations shall be type tested and Type test reports as per IS:13573 Part-II and IEC60502 shall be furnished. Also, heat shrink material shall comply with requirements of ESI 09-13 (external tests). Critical components used in cable accessories shall be of tested and proven quality as per relevant product specification/ESI specification. Cable joints and terminations should be with FRLS properties as per IEC 60754-1&2. Kit contents shall be supplied from the same source as were used for type testing. The kit shall be complete with the tinned copper solderless crimping type cable lugs & ferrule or mechanical connectors (wherein bolts are tightened that shear off at an appropriate torque) as per DIN standard suitable for aluminium compacted conductor cables. (Tender drg. no 0000-211-POE -A-51-RA of cable lug attached at the end of this chapter).

3.05.02

Straight through joint and termination shall be capable of withstanding the fault level of 21 KA for 0.12 Sec with dynamic peak of 52 KA for 33 KV system & of 40 kA for 0.12 sec with a dynamic peak of 100 kA for 11 kV, 6.6 KV & 3.3 KV system. Straight through joints shall have provisions for shield connection and earthing wherever required and complete with all accessories and consumables suitable for storage without deterioration at a temperature of 50 deg. C with shelf life of more than five years. 1.1 kV grade straight through joints shall also be of proven design

3.05.03

1.1 KV grade Straight Through Joint shall be of proven design.

LOT-1A PROJECTS
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION – VI, PART-B
BID DOC NO : CS-0011-109(1A)-2


SUB SECTION-II-E6
CABLING, EARTHING &
LIGHTNING PROTECTION

Page
6 of 69

CLAUSE NO.	TECHNICAL REQUIREMENTS	
3.06.00	Cable glands	
3.06.01	Cable shall be terminated using double compression type cable glands. Testing requirements of Cable glands shall conform to BS:6121 and gland shall be of robust construction capable of clamping cable and cable armour (for armoured cables) firmly without injury to insulation. Cable glands shall be made of heavy duty brass machine finished and nickel chrome plated. Thickness of plating shall not be less than 10 micron. All washers and hardware shall also be made of brass with nickel chrome plating. Rubber components shall be of neoprene or better synthetic material and of tested quality. Cable glands shall be suitable for the sizes of cable supplied/erected.	
3.07.00	Cable lugs/ferrules	
3.07.01	Cable lugs/ferrules for power cables shall be tinned copper solderless crimping type suitable for aluminium compacted conductor cables. Cable lugs and ferrules for control cables shall be tinned copper type. The cable lugs for control cables shall be provided with insulating sleeve and shall suit the type of terminals provided on the equipments. Cable lugs and ferrule shall conform to IS/DIN standards.	
3.08.00	Trefoil clamps	
3.08.01	Trefoil clamps for single core cables shall be pressure die cast aluminum or fibre glass or nylon and shall include necessary fixing accessories like G.I. nuts, bolts, washers, etc. Trefoil clamps shall have adequate mechanical strength, when installed at 1 mtr intervals, to withstand the forces generated by the peak value of maximum system short circuit current.	
3.09.00	Cable Clamps & Ties	
3.09.01	The cable clamps/ties required to clamp multicore cables shall be of SS-316 material, 12mm wide, polyester coated ladder lock type. The clamps/ties shall have self locking arrangement & shall have sufficient strength. The cable clamps/ties shall be supplied in finished individual pieces of suitable length to meet the site requirements.	
3.10.00	Receptacles	
3.10.01	Receptacles boxes shall be fabricated out of MS sheet of 2mm thickness and hot dipped gavanised or of die-cast aluminium alloy of thickness not less than 2.5 mm. The boxes shall be provided with two nos. earthing terminals, gasket to achieve IP55 degree of protection, terminal blocks for loop-in loop-out for cable of specified sizes, mounting brackets suitable for surface mounting on wall/column/structure, gland plate etc. The ON-OFF switch shall be rotary type heavy duty, double break, AC23 category, suitable for AC supply. Plug and Socket shall be shrouded Die-cast aluminium. Socket shall be provided with lid safety cover. Robust mechanical interlock shall be provided such that the switch can be put ON only when the plug is fully engaged and plug can be withdrawn only when the switch is in OFF position. Also cover can be opened only when the switch is in OFF position. Wiring shall be carried out with 1100 V grade PVC insulated stranded aluminium/copper wire of adequate size. The Terminal blocks shall be of 1100 V grade. The Terminal blocks shall be of 1100 V grade made up of unbreakable polyimide 6.6 grade with adequate current rating and size. The welding receptacles shall be provided with inbuilt ELCB rated for suitable mA sensitivity ranging from 30-300 mA	
3.11.00	Cable Drum Lifting Jack The jack for cable drum lifting shall be of screw type with 10 ton capacity. The cable drum jacks shall be manufactured from fabricated steel. The spindles supplied with the cable drum jack shall be manufactured using BSEN-24 grade steel bar with locking collars. Jack nests shall be of SG cast steel. Cable drum jack supplied shall have undergone load testing and reports for the same shall be submitted. At least Two Nos. of jacks shall be supplied for	
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION Page 7 of 69


CLAUSE NO.	TECHNICAL REQUIREMENTS		
	NTPC use. Contractor has to make arrangements for his own jacks for cable reeling/unreeling under his scope of installation.		
3.12.00	Galvanising		
3.12.01	Galvanising of steel components and accessories shall conform to IS:2629 , IS4759 & IS:2633. Additionally galvanising shall be uniform, clean smooth, continuous and free from acid spots.		
3.12.02	The amount of zinc deposit over threaded portion of bolts, nuts, screws and washers shall be as per IS:1367 . The removal of extra zinc on threaded portion of components shall be carefully done to ensure that the threads shall have the required zinc coating on them as specified		
3.13.00	Welding		
3.13.01	The welding shall be carried out in accordance with IS:9595. All welding procedures and welders qualification shall also be followed strictly in line with IS:9595		
4.00.00	INSTALLATION		
4.01.00	Cable tray and Support System Installation		
4.01.01	Cables shall run in cable trays mounted horizontally or vertically on cable tray support system which in turn shall be supported from floor, ceiling, overhead structures, trestles, pipe racks, trenches or other building structures.		
4.01.02	Horizontally running cable trays shall be clamped by bolting to cantilever arms and vertically running cable trays shall be bolted to main support channel by suitable bracket/clamps on both top and bottom side rails at an interval of 2000 mm in general. For vertical cable risers/shafts cable trays shall be supported at an interval of 1000mm in general. Fixing of cable trays to cantilever arms or main support channel by welding shall not be accepted. Cable tray installation shall generally be carried out as per the approved guidelines/ drawings. Vendor shall design the support system along with tray, spacing etc in line with tray loadings/drawings.		
4.01.03	The cantilever arms shall be positioned on the main support channel with a minimum vertical spacing of 300 mm unless otherwise indicated.		
4.01.04	The contractor shall fix the brackets/ clamps/ insert plates using anchor fasteners. Minimum size of anchor fasteners shall be M 8 X 50 and material shall be stainless steel grade 316 or better. Anchor fastener shall be fixed as recommended by manufacturer and as approved by site engineer. For brick wall suitable anchor fasteners shall be used as per the recommendations of manufacturer. Make of anchor fasteners subject to QA approval and the same shall be finalized at pre-award stage.		
4.01.05	All cable way sections shall have identification, designations as per cable way layout drawings and painted/stenciled at each end of cable way and where there is a branch connection to another cable way. Minimum height of letter shall be not less than 75 mm. For long lengths of trays, the identification shall be painted at every 10 meter. Risers shall additionally be painted/stenciled with identification numbers at every floor.		
4.01.06	In certain cases it may be necessary to site fabricate portions of trays, supports and other non standard bends where the normal prefabricated trays, supports and accessories may not be suitable. Fabricated sections of trays, supports and accessories to make the installation complete at site shall be neat in appearance and shall match with the		
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION Page 8 of 69

CLAUSE NO.	TECHNICAL REQUIREMENTS											
	prefabricated sections in the dimensions. They shall be applied with one coat of red lead primer, one coat of oil primer followed by two finishing coats of aluminium paint. 4.02.00 Conduits/Pipes/Ducts Installation 4.02.01 The Contractor shall ensure for properly embedding conduit pipe sleeves wherever necessary for cabling work. All openings in the floor/roof/wall / cable tunnel/cable trenches made for conduit installation shall be sealed and made water proof by the Contractor. 4.02.02 GI pull wire of adequate size shall be laid in all conduits before installation. Metallic conduit runs at termination shall have two lock nuts wherever required for junction boxes etc. 4.02.03 Conduit runs/sleeves shall be provided with PVC bushings having round edge at each end. All conduits/pipes shall have their ends closed by caps until cables are pulled. After cables are pulled, the ends of conduits/pipes shall be sealed with Glass wool/Cement Mortar/Putty to prevent entrance of moisture and foreign material 4.02.04 Exposed conduit/pipe shall be adequately supported by racks, clamps, straps or by other approved means. Conduits /pipe support shall be installed square and true to line and grade with an average spacing between the supports as given below, unless specified otherwise <table data-bbox="402 793 950 1050"> <thead> <tr> <th>Conduit /pipe size (dia).</th><th>Spacing</th></tr> </thead> <tbody> <tr> <td>Upto 40 mm</td><td>1 M</td></tr> <tr> <td>50 mm</td><td>2.0 M</td></tr> <tr> <td>65-85 mm</td><td>2.5 M</td></tr> <tr> <td>100 mm and above</td><td>3.0 M</td></tr> </tbody> </table> 4.02.05 For bending of conduits, bending machine shall be arranged at site by the contractor to facilitate cold bending. The bends formed shall be smooth. 4.03.00 Junction Boxes Installation 4.03.01 Junction boxes shall be mounted at a height of 1200mm above floor level or as specified in the drawings and shall be adequately supported/mounted on masonry wall by means of anchor fasteners/ expandable bolts or shall be mounted on an angle, plate or other structural supports fixed to floor, wall, ceiling or equipment foundations. 4.04.00 Cable Installation 4.04.01 Cable installation shall be carried out as per IS:1255 and other applicable standards. 4.04.02 For Cable unloading, pulling etc following guidelines shall be followed in general: a) Cable drums shall be unloaded, handled and stored in an approved manner on hard and well drained surface so that they may not sink. In no case shall be drum be stored flat i.e. with flange horizontal. Rolling of drums shall be avoided as far as possible. For short distances, the drums may be rolled provided they are rolled slowly and in proper direction as marked on the drum. In absence of any indication, the drums may be rolled in the same direction as it was rolled during taking up the cables. For unreeling the cable, the drum shall be mounted on suitable jacks or on cable wheels and shall be rolled slowly so that cable comes out over the drum and not from below. All possible care shall be taken during unreeling and laying to avoid damage due to twist, kink or sharp bends. Cable ends shall be provided with sealed plastic caps to prevent damage and ingress of moisture.	Conduit /pipe size (dia).	Spacing	Upto 40 mm	1 M	50 mm	2.0 M	65-85 mm	2.5 M	100 mm and above	3.0 M	
Conduit /pipe size (dia).	Spacing											
Upto 40 mm	1 M											
50 mm	2.0 M											
65-85 mm	2.5 M											
100 mm and above	3.0 M											
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION – VI, PART-B BID DOC NO : CS-0011-109(1A)-2	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION Page 9 of 69										

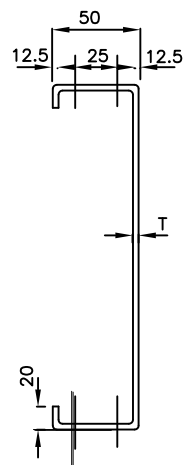


SECTION-CC
(100/50 TRAYS)

-4 HOLES 10mm DIA.

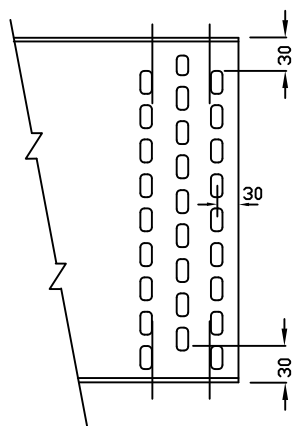

ARRANGEMENT OF PERFORATIONS

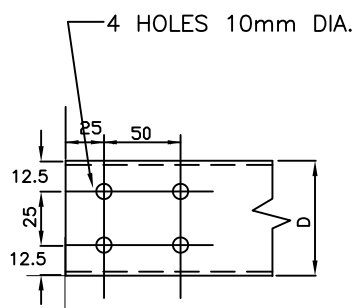

VIEW-DD
(100,50W TRAYS)


TRAY WIDTH W (mm)	100	50
TRAY DEPTH D (mm)	50	50
T (mm)	2	2

PERFORATED TYPE TRAY



TYPICAL DETAILS OF CABLE TRAYS AND ACCESSORIES

DWG. NO.	
----------	--

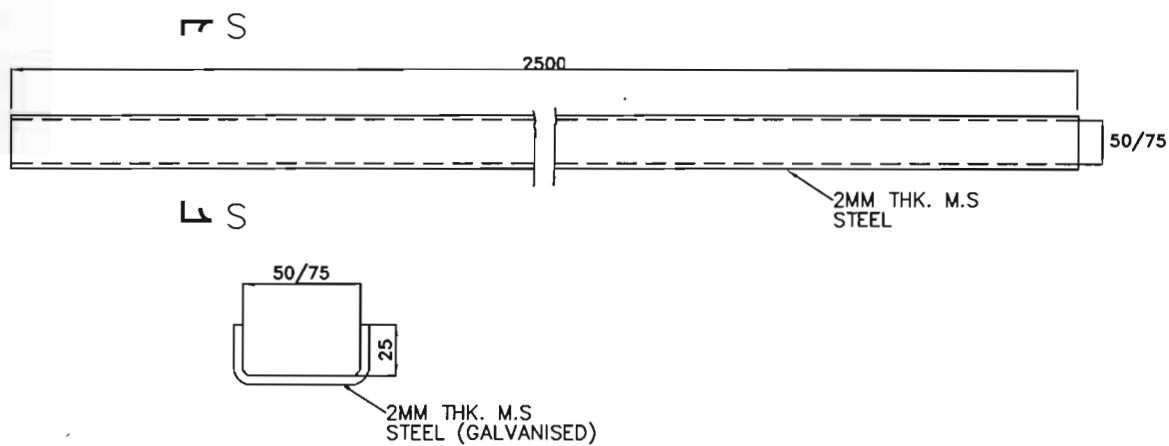

SECTION S-S

CABLE TROUGHS

SEE GENERAL NOTES IN SHEET 11.



TYPICAL DETAILS OF
CABLE TRAY AND ACCESSORIES

BHEL DRAWING NO.
PE-DG-427-507-E005

SH 10 OF 11

REV 00

	4x250 MW NABINAGAR TPP GYPSUM DEWATERING SYSTEM TECHNICAL SPECIFICATION (C&I PORTION)	SPECIFICATION No: PE-TS-463-571-A101	
		SECTION : I	
		SUB-SECTION : C-4	
		REV. 00	

SECTION: I

SUB-SECTION: C-4

TECHNICAL SPECIFICATION (C&I PORTION)

	4X250 MW BRBCL NABINAGAR - FGD		SECTION: C	
	TECHNICAL REQUIREMENTS (C&I) GYPSUM DEWATERING SYSTEM			
CONTROL AND INSTRUMENTATION FOR GYPSUM DEWATERING SYSTEM				
	4X250 MW BRBCL NABINAGAR - FGD		DESG	KKM
	JOB NO: 463		CHKD	KKM
	REV. NO. 00	DATE: 13.03.2020	APPD	RKR



C&I SPECIFICATION FOR GYPSUM DEWATERING SYSTEM

SECTION: C
SUB SECTION: C&I

INDEX

S. No.	DESCRIPTION
1	TITLE SHEET
2	INDEX SHEET
3	C&I SPECIFIC TECHNICAL REQUIREMENT
4	GENERAL TECHNICAL REQUIREMENTS
5	LIST OF DOCUMENTS/DELIVERABLES
6	SPECIFICATION FOR MEASURING INSTRUMENTS (PRIMARY & SECONDARY), VFD, ELECTRICAL ACTUATOR AND LCP
7	INSTRUMENTATION CABLE, CABLE INTERCONNECTION AND TERMINATION PHILOSOPHY
8	INSTRUMENT STUB DETAILS
9	INSTRUMENT INSTALLATION DRAWING
10	SIGNAL EXCHANGE BETWEEN DRIVES AND DCS
11	DRIVE AND INSTRUMENT INTERFACE DIAGRAM
12	QUALITY ASSURANCE FOR INSTRUMENTS & STARTER PANEL/LCP AND TYPE TEST REQUIREMENTS
13	MANDATORY SPARES
14	SUB VENDOR LIST



**C&I SPECIFICATION FOR
GYPSUM DEWATERING SYSTEM**

SECTION: C
SUB SECTION: C&I

**C&I SPECIFIC TECHNICAL REQUIREMENT
FOR DCS BASED
GYPSUM DEWATERING SYSTEM**

|



C&I SPECIFICATION FOR GYPSUM DEWATERING SYSTEM

SECTION: C
SUB SECTION: C&I

Specific Technical Requirements (C&I):

1. GYPSUM DEWATERING SYSTEM (GDS) shall be operated from DCS (BHEL's scope).
2. The Contractor shall provide complete Instrumentation along with necessary fittings, accessories and valve manifold etc for control, monitoring and operation of entire GDS except marked as BHEL's scope in P&ID attached in specification. All instruments shall be provided with durable epoxy coating for housing and all exposed surfaces of the instruments.
3. All the Electronic Transmitter for Pressure, Temperature and DP based Flow /Level measurements shall be genuine, verifiable PROFIBUS PA protocol compatible instruments. The transmitters shall be connected to DDCMIS through PROFIBUS PA protocol complying to IEC 61158 directly from transmitter. This is subject to customer approval and BHEL decision shall be final.
4. Electrical Actuators (as applicable) shall be Non-Intrusive type electric actuators envisaged with integral starter. The interface of these actuators with DCS shall be of two types viz. with Hardwired interface and with PROFIBUS DP interface. All actuator settings including torque, limit shall be possible without opening the actuator cover and LCD indication shall be available integral to actuator body. Open/Close command termination logic suitably built inside the actuator Details shall be referring in the specification.
5. All ON, OFF, and INCHING Type electric actuators shall be PROFIBUS DP compatible. However, the exact protocol shall be based on finalized protocol of DCS. If PROFIBUS DP protocol is envisaged, then actuator shall have two (redundant) PROFIBUS DP ports for connecting the redundant PROFIBUS DP cables. That is if one PROFIBUS DP cable is cut or not working/not available, then complete actuator functionality shall be available through the second redundant cable without any manual intervention.
6. The PROFIBUS protocol design shall be further validated by BHEL and approved by NTPC during detailed engineering and any variation/ changes required based on DDCMIS system requirements and actual field installation, operational philosophy etc. shall be considered by bidder without any implications.
7. The requirements given are to be read in conjunction with detailed Technical specification enclosed in the specification. Further in case of any discrepancy in the requirement within the same section noted by the bidder in the specification, the same will be brought to the notice of BHEL in the form of pre- bid clarification. In absence of any pre-bid clarification, the more stringent requirement as per interpretation of customer shall prevail without any commercial implication.
8. The make of the items shall be from sub-vendor list. However, the make/model of various instruments/items/systems shall be subject to approval of owner/purchaser during detailed engineering stage. No commercial and delivery implication in this regard shall be acceptable. In case of any conflict or repetition of clauses in the specification, the more stringent requirements among them are to be complied with.
9. All transmitters shall be suitably grouped together and mounted inside (i) Local Instruments Enclosures (LIEs) in case of open areas of the plant and (ii) In Local Instrument Racks (LIRs) in case of covered areas.



C&I SPECIFICATION FOR GYPSUM DEWATERING SYSTEM

SECTION: C
SUB SECTION: C&I

10. All instruments (except PROFIBUS PA compatible transmitters) and control elements shall be terminated on JB/LCP in field and JB/LCP are in bidder's scope for bidder's supplied instrument and in BHEL's scope for BHEL's supplied instrument. Number of Junction Boxes shall be sufficient and positioned in the field to minimize local cabling (max 12-15 mtrs) and trunk cable.
11. The contacts of equipment mounted instruments; sensors, switches etc. For external connection including spare contacts shall be wired out to suitably located junction boxes by bidder.
12. For cable scope refer to electrical scope between BHEL and vendor defined in electrical specification.
13. The design, manufacture, inspection, testing, site calibration and installation of all C&I equipment and systems covered under this specification shall conform to the latest editions of applicable codes and standards.
14. Bidder to provide mandatory spares as per mandatory spares list.
15. The specifications for instruments mentioned in the specification are minimum requirements. The detail specifications shall be finalized during detail engineering. The bidders shall specifically mention any deviation they would like to take on the C&I specification. In absence of only deviation, a No deviation certificate is to be furnished.
16. The quantity of instruments for the system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication.
17. Bidder to provide input/output list, drives list, junction box schedule and termination details, recommended control logics / write-up etc. the list of documents to be submitted after award of contract is to be referred by bidder.
18. All the transmitters supplied by Bidder shall be rack mounted. The transmitter racks shall be in Bidder's scope of supply. All transmitters shall be HART compatible.
19. Bidder to perform tests of C&I items/instruments/systems as per Quality plans/type test attached in the specification. However, if any test not specified in the quality plan but specified in specification Tests for I&C equipment included elsewhere in specification will have to perform by Bidder without any cost implication.
20. Instrument installation and accessories required for the same shall be in Bidder's scope and shall be submitted after award of contract. However, any instrument/ analyser installation not covered in the same shall be subject to customer and BHEL approval during detailed engineering. Bidder to provide erection hardware including junction boxes, canopies, structural steel as required.



C&I SPECIFICATION FOR GYPSUM DEWATERING SYSTEM

SECTION: C
SUB SECTION: C&I

21. Provision for separate Terminal block/wiring diagram for power and control blocks of control panel to be ensured.
22. All Temperature sensors shall be Duplex type and temperature transmitter shall be provided for all temperature measurement applications. Bidder to provide temperature transmitter, JB/Rack & other erection hardware.
23. Bidder to provide temperature sensor along with temperature transmitter for HT drives i.e. Pump and Motor for BRG and winding temp measurement.
24. Vibration Monitoring System, is envisaged for HT Motor, which is in BHEL scope. However, for mounting of vibration sensors/probe, vendor to provide vibration pad (of dimension of 80mm x 80mm x 10mm each) for mounting of sensors and a notch/slot for mounting of key phasor.
25. Bidder to provide Flow measuring device suitable for the service condition, which shall be decided by BHEL/customer during detail engineering. Bidder to comply the requirement without any commercial implication.
26. Bidder to furnish electrical load/UPS load data during detailed engineering.
27. 415VAC /230 V UPS Power supply shall be provided by BHEL at a single point, further distribution to various instruments/equipment of the system shall be in bidder scope. Bidder to include necessary power distribution board in his scope. Any power supply other than the above, if required by any instrument/equipment has to be derived by the bidder from the above supply & all necessary hardware for the same shall be in bidder scope. Bidder to submit the power requirement along with the bid.
28. Power supply derived for contact interrogation, interposing relay and solenoid shall generally be ungrounded 24 V D.C. only.
29. Interface of MCC, HT SWGR, Solenoid valves, field instruments, Actuators etc. with DDCMIS based control system shall be as per Drive Control Philosophy enclosed in specification.
30. Local control panel and VFD panel, if any required for operation shall be in bidder scope.
31. The solenoid operated valves/Dampers/Gate shall have a limit switch for open/close feedback. Solenoid Valve shall be rated for 24V Dc only.
32. All field instruments enclosure shall be IP65, local panel/cabinet enclosure shall be IP 55, unless otherwise specified.
33. Diaphragm seal shall be provided with Instruments having contact with corrosive media.
34. To ensure availability, adequate redundancy in system design shall be provided at hardware, software and sensor level. For the protection system, independent sensing device shall be provided to ensure adequate safety of plant equipment.



C&I SPECIFICATION FOR GYPSUM DEWATERING SYSTEM

SECTION: C
SUB SECTION: C&I

35. Redundancy of sensors shall be provided by bidder
 - (i) Triple redundancy for all Analog and binary inputs required for protection of system/drives.
 - (ii) For all other control functions dual redundancy of the sensors shall be provided by the bidder.
36. Double root valve shall be provided for all pressure tapings where the pressure exceeds 40kg/cm².
37. Use of process actuated shall be avoided unless unavoidable.
38. Number of pairs to be selected for Screen /Control cable
 - a) F-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - b) G-Type: 2P/4P/8P/12P (Size: 0.5sqmm²)
 - c) Core Cable: 3CX2.5sqmm²/ 5CX2.5sqmm²/ 12CX1.5sqmm²
39. Instrument installation shall be as per the attached "Standard Hook-up diagram of instrument."
40. In addition to requirements specified here, all C&I systems/ sub-systems/ equipment/ devices shall also meet other requirements stipulated under other Sub-sections/ parts/ sections of specification. In case of any conflict and repetition of clauses in the specification, BHEL discretion will prevail. The requirements given are to be read in conjunction with detailed Technical specification enclosed.
41. All field instruments shall be weatherproof, drip tight, dust tight and splash proof suitable for use under outdoor ambient conditions prevalent in the subject plant. All field-mounted instruments shall be mounted in suitable locations where maximum accessibility for maintenance is achieved. All the field instruments shall also be provided with SS tag nameplate and double compression type Nickel-plated brass cable gland. Gaskets, Fasteners, Counter and mating flange (SS316 material), nuts & bolts etc. shall also be included, wherever required with the field instruments.
42. All the outdoor field instruments such as analysers/transmitters/meters etc. shall be provided with suitable Free standing cabinet(s)/panel/rack/canopy so that the equipments are protected against rain/ sunlight etc.
43. All instruments should be supplied with valid calibration and test certificates provided by OEM.
44. At least 20% spare unused terminals shall be provided everywhere including local junction boxes, instrument racks/enclosures, termination/marshalling cabinets, etc.
45. Drive control philosophy/signal exchange list attached elsewhere in the specification are Tentative. Shall be finalized during detailed engineering.



C&I SPECIFICATION FOR GYPSUM DEWATERING SYSTEM

SECTION: C
SUB SECTION: C&I

46. Contractor shall furnish Instrument Schedule, I/O list, Drive list, Cable Schedule, Cable interconnection (DCS end terminal details shall be provided to vendor during detail engineering to incorporate in cable interconnection), JB grouping, Annunciation list, SOE list, List of Instruments/devices for HART in BHEL approved format. Also reusable database format like MS Excel, MS Access etc. of these documents shall also be provided by Contractor in BHEL approved format. Soft copy of the formats shall be provided to the successful bidder.

Note:-

1. All equipment items shall be of latest design with proven on track record.
2. The above given scope is indicative & minimum. Any item/ equipment not indicated above however required for the completeness of the system is to be supplied by bidder without any technical, commercial and delivery implication to BHEL.
3. Documents of C&I System shall be submitted to end user/owner for approval during detail engineering. Changes, if any, shall be accommodated by the bidder without any price/time implication.



**C&I SPECIFICATION FOR
GYPSUM DEWATERING SYSTEM**

SECTION: C
SUB SECTION: C&I

**GENERAL TECHNICAL REQUIREMENTS
(GYPSUM DEWATERING SYSTEM)**

	SPECIFICATION FOR CONTROL & INSTRUMENTATION FOR AUX PACKAGES	SPECIFICATION NO.:	
		VOLUME	
		SUB SECTION	
		REV. NO.	DATE :
		SHEET	OF

GENERAL REQUIREMENT

1.0 Bidder shall provide complete and independent control & instrumentation system with all accessories, auxiliaries and associated equipments for the safe, efficient and reliable operation of auxiliary systems.

2.0 The quantity of instruments for auxiliary system shall be as per tender P & ID wherever provided of the respective system as a minimum, for bidding purpose. However, Bidder shall also include in his proposal all the instruments and devices that are needed for the completeness of the plant auxiliary system/ equipment supplied by the bidder, even if the same is not specifically appearing in the P & ID. During detail engineering if any additional instruments are required for safe & reliable operation of plant, bidder shall supply the same without any price implication.

3.0 Measuring instruments/equipment and subsystems offered by the bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Further all the instruments shall be of proven reliability, accuracy, and acceptable international standards and shall be subject to employer's approval. All instrumentation equipment and accessories under this specification shall be furnished as per technical specification, ranges, makes/ numbers as approved by the employer' during detail engineering.

4.0 The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifold and all the other accessories required for mounting/ erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments; sensors, switches etc for external connection including spare contacts shall be wired out to suitably located junction boxes.

5.0 The customer specification attached as Specific Technical Requirement will supercede the Data sheets, if there is any mismatch.



**C&I SPECIFICATION FOR
GYPSUM DEWATERING SYSTEM**

SECTION: C
SUB SECTION: C&I

LIST OF DOCUMENTS/DELIVERABLES



C&I SPECIFICATION FOR GYPSUM DEWATERING SYSTEM

SECTION: C
SUB SECTION: C&I

LIST OF DELIVERABLES OF PEM - C&I DEPARTMENT

Sl. No.	DRAWING NO.	DRAWING/DOCUMENT TITLE	CATEGORY
1	PE-V4-463-145-I901	CONTROL & OPERATIONAL WRITE-UP FOR THE SYSTEM WITH SET POINTS	A
2	PE-V4-463-145-I902	CONTROL SCHEME/LOGIC DIAGRAM (TO BE IMPLEMENTED IN DDCMIS)	A
3	PE-V4-463-145-I903	HMI PICTURES/PLANT SCHEMATICS	A
4	PE-V4-463-145-I904	INSTRUMENT SCHEDULE WITH SET POINTS	A
5	PE-V4-463-145-I905	I/O LIST (ANALOG & BINARY)	A
6	PE-V4-463-145-I906	DRIVE LIST/SOLENOID/ACTUATOR VALVE LIST WITH LOCATION DATA	A
7	PE-V4-463-145-I907	FIELD JB/LIE/LIR, DRIVES TERMINATIONS	A
8	PE-V4-463-145-I908	DATASHEETS FOR INSTRUMENTS, JB's, etc.	A
9	PE-V4-463-145-I909	QUALITY PLANS (INSTRUMENTS, VMS, etc.)	A
10	PE-V4-463-145-I910	INSTRUMENT HOOK-UP DRAWING	A
11	PE-V4-463-145-I911	THERMOWELL SIZING CALCULATION	A
12	PE-V4-463-145-I913	CABLE SCHEDULE & INTERCONNECTION	A
13	PE-V4-463-145-I914	ANNUNCIATION & SOE LIST	A

NOTES:

ANY OTHER DOCUMENT DECIDED DURING DETAILED ENGINEERING SHALL BE PROVIDED BY BIDDER WITHOUT ANY COMMERCIAL/TECHNICAL IMPLICATION.

CONTRACTOR TO SUBMIT REUSABLE DATABASE FORMATS IN BHEL/CUSTOMER APPROVED FORMATS LIKE MS EXCEL, MS ACCESS OF DOCUMENTS LIKE INSTRUMENT SCHEDULE, I/O LIST, DRIVE LIST, FIELD JB TERMINATIONS, CABLE SCHEDULE & INTERCONNECTION, etc. SOFT COPY OF FORMATS SHALL BE PROVIDED TO SUCCESSFUL BIDDERS.



**C&I SPECIFICATION FOR
GYPSUM DEWATERING SYSTEM**

SECTION: C
SUB SECTION: C&I

**SPECIFICATION FOR MEASURING INSTRUMENTS
(PRIMARY & SECONDARY), VFD, ELECTRICAL
ACTUATOR AND LCP.**

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
1.00.00 1.01.00 1.02.00 1.03.00 1.04.00 1.05.00 1.06.00 1.07.00	MEASURING INSTRUMENTS (PRIMARY AND SECONDARY) Measuring instruments/equipment and subsystems offered by the Bidder shall be from reputed experienced manufacturers of specified type and range of equipment, whose guaranteed and trouble free operation has been proven. Refer Sub-section Basic Design Criteria. Further, all instruments shall be of proven reliability, accuracy, and repeatability requiring a minimum of maintenance and shall comply with the acceptable international standards and shall be subject to Employer's approval. Every panel-mounted instrument requiring power supply shall be provided with easily replaceable glass cartridge fuses of suitable rating. Every instrument shall be provided with a grounding terminal and shall be suitably connected to the panel grounding bus. All transmitters, sensors, switches and gauges for parameters like pressure, temperature, level, flow etc. as required for the safe and efficient operation and maintenance as well as for operator and management information (including all computation) of equipment in the system under the scope of specification shall be provided on as required basis with in quoted lump sum price. The Contractor shall furnish all Instrumentation / Control equipment & accessories under this specification as per technical specification, ranges, makes & model as approved by the Employer during detailed engineering. The necessary root valves, impulse piping, drain cocks, gauge-zeroing cocks, valve manifolds and all the other accessories required for mounting/erection of these local instruments shall be furnished, even if not specifically asked for, on as required basis. The contacts of equipment mounted instruments, sensors, switches etc. for external connection including spare contacts shall be wired out in flexible/rigid conduits, independently to suitably located common junction boxes. The proposal shall include the necessary cables, flexible conduits, junction boxes and accessories for the above purpose. Double root valves shall be provided for all pressure tapping where the pressure exceeds 40 Kg./sq.cm. All instruments envisaged for sea water applications, shall be provided with wetted parts made of Monel/ Hastelloy C or any other material (if provenness experience of the proposed material for such applications is established by contractor). For Chlorine application: Instruments shall be provided with wetted parts (e.g. diaphragm seal, etc.) made of Hastelloy C. Also, filled liquid shall be Fluorolube oil/ Inert Hydrocarbon / CTFE etc., for these applications. For applications of FECL3 solution: Instruments shall be provided with wetted parts (e.g. diaphragm seal, etc.) made of Tantalum. For coastal areas, all instruments shall be provided with durable epoxy coating for housings and all exposed surfaces of the instruments. The instruments, for which technical specification is not attached, shall be supplied as per the standard and proven practice of the contractor. The same shall be established by the contractor during detailed engineering by providing detailed explanation/concepts, if required by the employer, of such implementation along with standard documentation.			
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 1 OF 34	

020/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC						
16.00.00	FIELD INSTRUMENTS BASED ON FIELDBUS The following instruments shall be connected to DDCMIS through fieldbus i.e. FOUNDATION Fieldbus/PROFIBUS PA protocol complying to IEC 61158 directly from transmitter.									
16.01.00	Electronic Transmitter for Pressure, Differential Pressure and DP based Flow / Level measurements. <table><tr><th>S No.</th><th>Features</th><th>Essential/Minimum Requirements</th></tr><tr><td>1.</td><td>Type of Transmitter</td><td>FOUNDATION Fieldbus/PROFIBUS PA based output</td></tr></table>				S No.	Features	Essential/Minimum Requirements	1.	Type of Transmitter	FOUNDATION Fieldbus/PROFIBUS PA based output
S No.	Features	Essential/Minimum Requirements								
1.	Type of Transmitter	FOUNDATION Fieldbus/PROFIBUS PA based output								
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 5 OF 8						

020/PS-PEM-MAX					
CLAUSE NO.		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
		2	Accuracy	± 0.060 % of calibrated range (minimum) for calibrated range greater than 400 mmwc. +0.065% of calibrated range (minimum) for calibrated range greater than 250 kg/cm2. ± 0.10 % of calibrated range (minimum) for calibrated range less than 400 mmwc.	
		3.	Stability	0.25 % of calibrated range for 10 years for calibrated range greater than equal to 400 mmwc on standard conditions of manufacturer. 0.2 % of calibrated range for 1 years for calibrated range less than 400 mmwc on standard conditions of manufacturer. 0.15% of calibrated range for 5 years for DPT with static pressure greater than 250 kg/cm2.	
		4	Turn down	50:1 for greater than or equal to span of 400mmwcl. 20:1 for span below 400mmwcl. 10:1 for span greater than 250 kg/cm2 (Above mentioned (2,3,4) parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only).	
		5	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating	
		6.	Electrical connection	½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible	
		7.	Process connection	½” NPT (F)	
		8.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.	
			Overpressure	150% of max operating pressure	
		9	Accessories	-Diaphragm seal, pulsation dampeners, syphon etc. as required by service and operating condition. -2 valve manifold for absolute & gauge pressure transmitters, -3-valve for DP and 5 valve manifold for level/flow applications. -The valve manifold shall be non-integral type. -For hazardous area, enclosure as described in NEC article 5.	
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 6 OF 8

020/PS-PEM-MAX				एनटीपीसी NTPC																						
CLAUSE NO.		TECHNICAL REQUIREMENTS																								
		10. Mounting 2 inch pipe mounting with Enclosure/Rack/Canopy. 11. Diagnostics & display Self-Indicating feature and digital display on transmitter Notes - For primary air/ secondary air/flue gas/ furnace pressure applications, DP type transmitters shall be provided for pressure measurement below 2000 mmwc. - LVDT type is not acceptable. - Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application.																								
16.02.00		Temperature Transmitter																								
16.02.01		Single Input /Dual Input Temperature transmitter																								
		Temperature transmitter shall be provided which shall be fully compatible with thermocouples and RTDs being provided by the contractor. Temperature compensation for thermocouples shall be performed in the temperature transmitter itself. Transmitters shall be capable of withstanding ambient temperature up to 85 deg C. Following specifications are applicable for dual input/single input temperature transmitter. <table><tr><th>S No.</th><th>Features</th><th>Essential/Minimum Requirements</th></tr><tr><td>1.</td><td>Output</td><td>FOUNDATION fieldbus /PROFIBUS PA</td></tr><tr><td>2.</td><td>Input</td><td>Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types</td></tr><tr><td>3.</td><td>Housing</td><td>Weather proof as per IP-67, metallic housing with durable corrosion resistant coating</td></tr><tr><td>4.</td><td>Electrical connection</td><td>½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible</td></tr><tr><td>5.</td><td>Diagnostics & display</td><td>Self-Indicating feature and digital display on transmitter</td></tr><tr><td>6.</td><td>Operating Ambient temperature</td><td>85 deg C without display. 70 deg C with display.</td></tr></table>				S No.	Features	Essential/Minimum Requirements	1.	Output	FOUNDATION fieldbus /PROFIBUS PA	2.	Input	Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types	3.	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating	4.	Electrical connection	½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible	5.	Diagnostics & display	Self-Indicating feature and digital display on transmitter	6.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.
S No.	Features	Essential/Minimum Requirements																								
1.	Output	FOUNDATION fieldbus /PROFIBUS PA																								
2.	Input	Same transmitter shall be capable to handle Pt-100 RTD, Thermocouples –K, R & ,S types																								
3.	Housing	Weather proof as per IP-67, metallic housing with durable corrosion resistant coating																								
4.	Electrical connection	½” NPT(F) FOUNDATION Fieldbus/PROFIBUS PA compatible																								
5.	Diagnostics & display	Self-Indicating feature and digital display on transmitter																								
6.	Operating Ambient temperature	85 deg C without display. 70 deg C with display.																								
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS																						
				PAGE 7 OF 8																						

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
	7. Mounting 2 inch pipe mounting with Canopy. 8. Accessories As required by service and operating condition. 9. Composite Accuracy (Refer note 2) RTD $\leq 0.25\%$ of 0-250 deg C span T/C-K type $\leq 0.2\%$ of 0-600 deg C span CJC accuracy (for thermocouples) shall be ≤ 1 deg C Notes: 1. In case of failure (open or burn-out) of RTD/thermocouple, transmitter shall provide low temperature output. 2. Dual input temperature transmitter shall have bump less changeover facility to second sensor in case first sensor fails. This changeover is to be alarmed. 3. Composite accuracy is to be calculated as summation of all applicable accuracies of temperature transmitter for converting sensor input to output (e.g., basic accuracy, digital accuracy, etc.) and temperature effect on these accuracies at ambient temperature of 50 deg C, based on the figure/ formula given in the standard product catalogue for span as specified above for various types of temperature elements specified. All such accuracy/ temperature effect figures in catalogue shall be first converted to deg C, and then percentage of this converted accuracy in specified span shall be calculated to compare with the specified composite accuracy figures. All temperature transmitters shall be interchangeable (i.e. can be used for either RTD or thermocouple) and composite accuracy shall be met for each type of input as specified above. 3. Above mentioned parameters/features of offered models shall be strictly as defined in standard published catalogue of the manufacturer only. 4. Dual input temperature transmitters can also be accepted in place of single input TT.			
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	PART-B SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 8 OF 8

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC														
2.02.00	GUIDED WAVE RADAR TYPE LEVEL TRANSMITTER <table><tr><td>Type</td><td>Microprocessor based 2 wire type (loop powered), HART protocol compatible Guided wave radar transmitter.</td></tr><tr><td>Principle</td><td>TDR (Time domain reflectometry)</td></tr><tr><td>Probe Type & Material</td><td>(i) Coaxial probe of SS316/316L. If required, probe shall be suitable for overfill prevention. (ii) Rod probe, cable probe of SS316/SS316L can be used for applications wherever coaxial probe is not suitable.</td></tr><tr><td>Output signal</td><td>4-20 mA DC along with superimposed digital signal (based on HART protocol), suitable for over fill prevention.</td></tr><tr><td>Accuracy</td><td>+/- 0.5% of calibrated span or minimum 5mm.</td></tr><tr><td>Power supply</td><td>24 VDC +/- 10%.</td></tr><tr><td>Housing</td><td>Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.</td></tr></table>	Type	Microprocessor based 2 wire type (loop powered), HART protocol compatible Guided wave radar transmitter.	Principle	TDR (Time domain reflectometry)	Probe Type & Material	(i) Coaxial probe of SS316/316L. If required, probe shall be suitable for overfill prevention. (ii) Rod probe, cable probe of SS316/SS316L can be used for applications wherever coaxial probe is not suitable.	Output signal	4-20 mA DC along with superimposed digital signal (based on HART protocol), suitable for over fill prevention.	Accuracy	+/- 0.5% of calibrated span or minimum 5mm.	Power supply	24 VDC +/- 10%.	Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.	
Type	Microprocessor based 2 wire type (loop powered), HART protocol compatible Guided wave radar transmitter.															
Principle	TDR (Time domain reflectometry)															
Probe Type & Material	(i) Coaxial probe of SS316/316L. If required, probe shall be suitable for overfill prevention. (ii) Rod probe, cable probe of SS316/SS316L can be used for applications wherever coaxial probe is not suitable.															
Output signal	4-20 mA DC along with superimposed digital signal (based on HART protocol), suitable for over fill prevention.															
Accuracy	+/- 0.5% of calibrated span or minimum 5mm.															
Power supply	24 VDC +/- 10%.															
Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.															
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS														
PAGE 3 OF 34																

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		एनटीपीसी NTPC
2.03.00	Adjustment/ calibration	Using hand held HART calibrator/ centralized PC based system (as applicable).	
	Zero & span adjustment	Continuous, temper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.	
	Display	Integral digital display.	
	Load Impedance	500 ohms (minimum).	
	Electromagnetic compatibility	Shall meet EN 61326-1 (1997) and AmdtA1, class A equipment/EN 50081-2 & EN 5008 1-2 & EN 50082-2	
	Mounting	(i) External cage shall be provided where ever side mounting is required. External cage and other mounting accessories to be provided by the contractor.	
		(ii) Where ever top mounting is required, all mounting accessories, stilling well (as required) etc., shall be provided by the contractor.	
(iii) All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations.			
Note: Four wire type transmitters can also be provided for applications where 2- wire transmitter has some technical limitations, subject to employer's approval during detailed engineering stage. However, in such cases isolated 4-20 mA DC (analog) output shall be provided. Power supply required for such transmitters shall be 240V AC / 24V DC.			
Ultrasonic Type level Transmitter			
	S.No.	Features	Essential/Minimum requirement
	1.	Type of Transmitter	Non-contact Microprocessor based 2 wire type (loop powered), HART protocol compatible Ultrasonic transmitter.
	2.	Output signal	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol).
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 4 OF 34

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		एनटीपीसी NTPC		
	3.	Accuracy	+/- 0.5% of calibrated span or minimum 5mm.		
	4.	Power supply	24 V DC +/- 10%.		
	5.	Temperature compensation	To be provided within transducer.		
	6.	Housing	Weather proof as per IP-65, metallic housing with durable corrosion resistance coating.		
	7.	Adjustment/calibration/ maintenance	Using hand held HART calibrator/ centralized PC based system (as applicable).		
	8.	Zero and Span adjustment	Continuous, tamper proof, remote as well as manual adjustability from instrument. It should be possible to calibrate the instrument without any level in the tank/sump etc.		
	9.	Sensor Material	Corrosion resistant material to suit individual application requirement.		
	10.	False signal tolerance	Transmitter shall be capable of ignoring false echoes from internal tank/sumps obstructions such as pipes, heating coils or agitator blades. Also transmitter shall have adjustable damping circuitry.		
	11.	Range	Range of transmitter shall be capable of covering the complete level span of tank taking care of blocking distance, frequency attenuation due to surface, obstructions, vapors etc.		
	12.	Display	Integral digital display		
	13.	Diagnostics	Loss of echo alarm etc.		
	14.	Load Impedance	500 ohms (minimum).		
	15.	Electrical Connection	Plug and socket		
	LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 5 OF 34

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		एनटीपीसी NTPC											
2.04.00	16.	Accessories	- All weather canopy shall be provided for protection from direct sunlight and direct rain for open locations. - All mounting accessories required for erection and commissioning shall be provided. - For hazardous area, explosion proof enclosure as described in NEC article 500											
	Note: 1) Contractor can also provide Radar type transmitter as per above specification in place of ultrasonic transmitter subject to approval by Employer during detailed Engineering. Sonic frequency based transmitters can also be provided under “ultrasonic transmitters” category for fly ash silo level. 2) Four wire type transmitters can also be provided for applications where 2- wire transmitter has some technical limitations, subject to employer’s approval during detailed engineering stage. However, in such cases isolated 4-20 mA DC (analog) output shall be provided. Power supply required for such transmitters shall be 240V AC / 24V DC. 3) For applications where transmitter location is not accessible, the transmitter shall have separate sensor unit and electronic unit for such applications. It shall be possible to mount the electronic unit at accessible location. Specification for ULTRASONIC TYPE FLOW TRANSMITTER <table><tr><th>S.No</th><th>Features</th><th>Essential/Minimum requirement</th></tr><tr><td>1.</td><td>Type of Transmitter</td><td>Non contact Microprocessor based 2 wire type, HART protocol compatible Ultrasonic transmitter. Insertion type.</td></tr><tr><td>2.</td><td>Output signal</td><td>4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol).</td></tr><tr><td>3.</td><td>Sensor Accuracy</td><td>+/- 2% of calibrated span.</td></tr></table>			S.No	Features	Essential/Minimum requirement	1.	Type of Transmitter	Non contact Microprocessor based 2 wire type, HART protocol compatible Ultrasonic transmitter. Insertion type.	2.	Output signal	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol).	3.	Sensor Accuracy
S.No	Features	Essential/Minimum requirement												
1.	Type of Transmitter	Non contact Microprocessor based 2 wire type, HART protocol compatible Ultrasonic transmitter. Insertion type.												
2.	Output signal	4-20 mA DC (Analog) along with superimposed digital signal (based on HART protocol).												
3.	Sensor Accuracy	+/- 2% of calibrated span.												
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 6 OF 34											

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		एनटीपीसी NTPC
	4.	Power supply	24 V DC +/-10%.
	5.	Temperature compensation	To be provided within transducer.
	6.	Housing	Weather proof as per IP-55 with durable corrosion resistance coating.
	7.	Adjustment/calibration/ maintenance	From hand held calibrators/centralized PC based system (as applicable).
	8.	Zero and Span adjustment	Continuous, tamper proof, remote as well as manual to calibrate the instrument without any process flow.
	9.	Sensor Material	Corrosion resistant material to suit individual application requirement.
	10.	False signal tolerance	Transmitter shall be capable of ignoring false echoes from internal tank/sumps obstructions such as pipes, heating coils or agitator blades. Also transmitter shall have adjustable damping circuitry.
	11.	Range	Should be suitable for the required process range.
	12.	Display	LCD display with integral keypad to be provided.
	13.	Diagnostics	Loss of echo alarm etc.
	14.	Load Impedance	500 ohms minimum
	15.	Electrical Connection	Plug and socket
	16.	Accessories	• All weather canopy for protection from direct sunlight and direct rain. • All mounting hardware and accessories required for erection and commissioning mounting fittings materials shall be SS 316. • For hazardous area, explosion proof enclosure as described in NEC article 500
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS
PAGE 7 OF 34			

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		एनटीपीसी NTPC																								
3.02.00	Resistance Temperature Detector (RTD) <table><tr><th>Sr. No.</th><th>Features</th><th>Essential/Minimum Requirements</th></tr><tr><td>1</td><td>Type of RTD.</td><td>: Four wire, Pt-100 (100 Ohms resistance at zero degree Centigrade).</td></tr><tr><td>2</td><td>No. of element</td><td>: Duplex</td></tr><tr><td>3</td><td>Housing/Head</td><td>: IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well</td></tr><tr><td>4</td><td>Insulation and sheathing of RTD</td><td>: Mineral (magnesium oxide) insulation and SS316 sheath,</td></tr><tr><td>5</td><td>Calibration and accuracy</td><td>: As per IEC-751/ DIN-43760 Class-A for RTD</td></tr><tr><td>6</td><td>Accessories</td><td>: Thermo well and associated fittings</td></tr><tr><td>7</td><td>Standard</td><td>: IEC-751/ DIN-43760 for RTD and ASME PTC-19.3 for Thermo-well.</td></tr></table> NOTES : 1) The specifications for RTDs of winding/ bearings of motor/pump, can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However the type of RTD shall be Pt100. 2) The specifications of temp elements for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice.			Sr. No.	Features	Essential/Minimum Requirements	1	Type of RTD.	: Four wire, Pt-100 (100 Ohms resistance at zero degree Centigrade).	2	No. of element	: Duplex	3	Housing/Head	: IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well	4	Insulation and sheathing of RTD	: Mineral (magnesium oxide) insulation and SS316 sheath,	5	Calibration and accuracy	: As per IEC-751/ DIN-43760 Class-A for RTD	6	Accessories	: Thermo well and associated fittings	7	Standard	: IEC-751/ DIN-43760 for RTD and ASME PTC-19.3 for Thermo-well.
Sr. No.	Features	Essential/Minimum Requirements																									
1	Type of RTD.	: Four wire, Pt-100 (100 Ohms resistance at zero degree Centigrade).																									
2	No. of element	: Duplex																									
3	Housing/Head	: IP-65/Diecast Aluminium. Head of TE to be provided with sufficient space and arrangement to mount head mounted temperature transmitter (as applicable). Plug in connectors are to be provided for external signal cable connection. TE terminal head shall be spring loaded for positive contacts with the thermo well																									
4	Insulation and sheathing of RTD	: Mineral (magnesium oxide) insulation and SS316 sheath,																									
5	Calibration and accuracy	: As per IEC-751/ DIN-43760 Class-A for RTD																									
6	Accessories	: Thermo well and associated fittings																									
7	Standard	: IEC-751/ DIN-43760 for RTD and ASME PTC-19.3 for Thermo-well.																									
3.03.00	Metal Temperature Thermocouples <table><tr><td>Measuring Medium</td><td>Metal Temperature</td></tr><tr><td>Material of Thermocouple.</td><td>Chromel Alumel Type K</td></tr><tr><td>Type of Thermocouple</td><td>Duplex with ungrounded separate hot junctions</td></tr><tr><td>Insulation</td><td>Mineral Insulation (Magnesium Oxide).</td></tr></table>			Measuring Medium	Metal Temperature	Material of Thermocouple.	Chromel Alumel Type K	Type of Thermocouple	Duplex with ungrounded separate hot junctions	Insulation	Mineral Insulation (Magnesium Oxide).																
Measuring Medium	Metal Temperature																										
Material of Thermocouple.	Chromel Alumel Type K																										
Type of Thermocouple	Duplex with ungrounded separate hot junctions																										
Insulation	Mineral Insulation (Magnesium Oxide).																										
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 9 OF 34																								

PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
	Thermocouple wire gauge 16 AWG Protective sheath SS 321 Protective sheath dia 8 mm OD Calibration & accuracy As per IEC-584/ ANSI-MC-96.1 (special limits of error) for T/C Mounting accessories 1/2" BSP SS sliding end connector, weld pad, clamps of heat resistant steel SS310. Adjustable gland fitting for connection at the junction box end as per manufacturer's standard. Cold end sealing SS pot seal with colour coded PTFE Insulated flexible tails. Sealing compound- Epoxy resin. Length of PTFE insulated flying leads shall be minimum 750 mm. Minimum bending radius 30 mm Length of T/C On as required basis considering location of measurement point and the JB/TTJB location. Notes : 1) The specification for thermocouples of bearings metal temp measurements can be as per their manufacturer standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice. However type of thermocouples shall be K-type.		
3.04.00	Thermo well (for all process temp. elements) (a) Shall be one piece solid bored type of 316 SS of step-less tapered design. (As per ASME PTC 19.3, 1974) (b) For Mill classifier outlet long life solid sintered tungsten carbide material of high abrasion resistance shall be provided. (c) For Air & Flue gas 316 SS protecting tube with welded cap. (However contractor shall provide better material for Flue gas service if required based on the specified boiler design parameters). (d) For furnace zone, impervious ceramic protecting tube of suitable material along with Incoloy supporting tubes and adjustable flanges.		
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 10 OF 34

CLAUSE NO.

TECHNICAL REQUIREMENTS

4.00.00

SPECIFICATIONS FOR PR. GAUGE, D.P. GAUGE, TEMP. GAUGE AND LEVEL GAUGE.

SI. No	FEATURES	ESSENTIAL/MINIMUM REQUIREMENTS		
		Pr. Gauge/ DP Gauge/ Draught gauges	Temperature Gauge	Level Gauge
1	Sensing Element	Bourdon for high pressure, Diaphragm/ Bellow for low pr.	Inert gas actuated/ Liquid filled other than mercury	Tempered * toughened Borosilicate gauge glass steel armoured reflex or transparent type.
2	Material of sensing element	SS 316	SS 316	
3	Material of movement	SS 304	SS 304	
4	Body material	Die-cast aluminium	Die-cast aluminium	Forged carbon steel/304 SS
5	Dial size	150mm	150 mm	Tubular covering entire range
6	End connection	1/2 inch NPT (M)	1/2 inch or 3/4 inch NPT (M).	Process connection as per ASME PTC and drain/vent 15 NB

LOT-1A PROJECTS
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI, PART-B
BID DOCUMENT NO.: CS-0011-109(1)-2

SUB-SECTION-III-C2
MEASURING
INSTRUMENTS

PAGE 12 OF 34

CLAUSE NO.	TECHNICAL REQUIREMENTS एनटीपीसी NTPC				
	7	Accuracy	±1% of span	± 1% of span	± 2%
	8	Scale	Linear, 270° arc graduated in metric units	Linear, 270° arc graduated in °C	Linear vertical
	9	Range selection	Shall cover 125% of max. operating press	Shall cover 125% of max. operating temp	Shall cover max. Operating level.
	10	Over range	125% of FSD	125% of FSD	-
	11	Housing	Weather and dust proof as per IP-55	Weather and dust proof as per IP-55	CS/304 SS leak proof
	12	Zero/span adjustment	Provided	Provided	--
	13	Identification	Engraved with service legend or laminated phenolic name plate		
	14	Accessories	Blow out disc, siphon, snubber, pulsation dampener, chemical seal (if required by process) gauge isolation valve	SS Thermowell	Gasket for all KEL-F shield for transparent type vent and drain valves of Steel/SS as per CS/Alloy process Requirement.
	Notes:-				
	*Bicolour type level gauges will be provided for applications involving steam and water except for condensate and feed water services.				
	Length of gauge glass shall not be more than 1400 mm. If the vessel is higher, multiple gauge glasses with 50 mm overlapping shall be provided.				
	Where the process fluids are corrosive, viscous, solid bearing or slurry type, diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application.				
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2		SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 13 OF 34

020/PS PEM MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS				
5.00.00	PROCESS ACTUATED SWITCHES				
	FEATURES	ESSENTIAL / MINIMUM REQUIREMENTS			
		Pressure/ Draft Switches/ DP Switches	Temperature switches	Level switches	
	Sensing Element	Piston actuated for high pressure and diaphragm or bellows for low pr./ vacuum	Vapor pressure sensing, liquid filled bellow type with SS bulb and capillary (5 m minimum, to suit application)	Capacitance types, float type, conductivity type, RF type, Ultrasonic type as per suitability to the application. .	
	Material	316 SS	Bulb 316 SS/ capillary 304 SS	316 SS	
	End connection	½ inch NPT (F)	½ inch NPT (F)	Manufacturer standard	
	Over range/ proof pressure	150% of maximum operating pr.	-	150% of maximum operating pr.	
	Repeatability	+/- 0.5% of full range			
	No. of contacts	2 No.+2NC. SPDT snap action dry contact			
	Rating of contacts	60 V DC, 6 VA (or more if required by DDCMIS)			
	Elect. Connection	Plug in socket.			
	Set point adjustment	Provided over full range.			
	Dead band adjustment	Adjustable/ fixed as per requirement of application.			
	Enclosure	Weather and dust proof as per IP-55, metallic housing.			
	Accessories	Siphon, snubber, chemical seal, pulsation dampeners as required by process	Thermo well of 316 SS and packing glands	All mounting accessories	
	Mounting	Suitable for enclosure/ rack mounting or direct mounting	Suitable for rack mounting or direct mounting	-	
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2		SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 14 OF 34

020/PS PEM MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		एनटीपीसी NTPC
	Power Supply (wherever required)	As per Contractor's Standard practice.	
	Notes :- 1) Where the process fluids are corrosive, viscous, solid bearing or slurry type diaphragm seals shall be provided. Parts below the diaphragm shall be removable for cleaning. The entire volume above the diaphragm shall be completely filled with an inert liquid suitable for the application. 2) Pressure/ Diff pressure switches for very low press/ DP measurements can have sensor material other than SS316 in case of any technical limitation and the offered product is standard product of the manufacture for very low pressure applications. 3) Repeatability can be upto +/-1% of full range in case of switches with diaphragm seals or very low pressure/DP range. 4) The specifications of switches for air conditioning & ventilation system / process can be as per system manufacturer's standards. The manufacturer shall submit the adequate supporting documents for establishing their standard practice.		
6.00.00	SOLENOID VALVES Solenoid valves shall fulfill the following requirements: - a) Type 2/3/4 way SS 316/ forged brass (depending on the application subject to Employer's approval during detailed engg.) b) Power supply 24V DC. c) Plug in connector connection. d) Insulation : Class "H"		
7.00.00	Limit switches e) Limit switches shall be silver plated with high conductivity and non-corrosive type. Contact rating shall be sufficient to meet the requirement of Fire alarm Control System subject to a minimum of 60V, 6VA rating. Protection class shall be IP-55.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 15 OF 34

CLAUSE NO.

TECHNICAL REQUIREMENTS

9.00.00	SPECIFICATION FOR FLOW ELEMENTS		
9.01.00	Orifice Plate		
	Features	Essential/Minimum Requirements	
	Type	Concentric as per ASME PTC-19.5 (Part-II), ISA RP-3.2, 1960 or BS-1042, ISO 5167	
	Material	316 SS	
	Thickness	3 mm for main pipe diameter up to 300 mm and 6 mm for main pipe dia above 300 mm.	
	Material of branch pipe	Same as main pipe	
	Root valve type	Globe	
	Root valve material	Same as pipe material	
	Root valve size	1 / 2 inch or 1 inch (as applicable)	
	Impulse pipe of same material up to root valve	Required	
	Tappings	Flanged weld neck or D & D/2 with 3 pairs of tapping (as applicable). Root valves to be provided in all the tappings. However for flow elements in CPU, DM & PT plant- 2 Pairs of Tappings shall be provided as minimum.	
	Beta Ratio	0.34 to 0.7	
	Beta Ratio calculation to be submitted	Yes	
	Assembly drg. and flow Vs DP Curves	Yes	
	Accessories	Root valves, flanges, Vent/drain hole (As required)	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 16 OF 34

6693/2020/PS-PEM-MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS 
	Contractor shall submit certified flow calculation and differential pressure vs. flow curves for each element for Employer's approval. Sizing calculation, precise flow calculation for all the flow elements, fabrication and assembly drawings and installation drawings shall be submitted for Employer's approval.

LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 17 OF 34

CLAUSE NO.

TECHNICAL REQUIREMENTS



9.04.00

ROTAMETERS

Sr. No.	Features	Essential / minimum requirements	
1.	Type	Variable Area Metal Tube	
2.	Fluid media	Water/oil	
3.	Tube body	SS316	
4.	Material of float	316 SS	
5.	Indicator	Linear scale	

LOT-1A PROJECTS
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI, PART-B
BID DOCUMENT NO.: CS-0011-109(1)-2

SUB-SECTION-III-C2
MEASURING
INSTRUMENTS

PAGE 18 OF 34

CLAUSE NO.	एनडीपीसी NTPC TECHNICAL REQUIREMENTS			
10.00.00	6.	Accessories	Flange, orifice in case of bypass Rota meter (for line size above 100 mm)	
	7.	Housing protection class	IP-55	
	8.	Accuracy	± 2% of measured value.	
	ANALYSER INSTRUMENTS (OTHER THAN CEMS):			
	Common Requirements			
	1	Output signals		
		Analog	4-20 mA DC galvanically isolated. If analyser provides superimposed HART signal on 4-20 mA DC output, It shall also be connected to PC based station.	
		Binary	2 NO + 2 NC for high alarm	
	2	Zero & span Adjustment	To be provided with range selection facility.	
	3	Ambient temp.	50°C	
	4	Indication	Digital Alphanumeric Display. Display of reading in engineering units shall be provided.	
	5	Enclosure Type/Material	Weather & Dust proof (IP 55) Die cast Aluminium/SS.	
	6	Type of Electronics	Microprocessor based with self diagnostic.	
	7	Digital transmission Signal	HART / RS 485 Port Modbus Protocol / Ethernet TCP/IP protocol for communication with plant control system.	
	8	Calibration	Auto & Manual (from Remote)	
	9	Power Supply	To be arranged by Contractor subject to Employer's approval.	
	10.	Others	All interconnection tubing and cabling between probe and analyser / analyser panel and cabling from analyser/ analyser panel to local junction box are to be provided.	
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2		SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 19 OF 34

CLAUSE NO.	TECHNICAL REQUIREMENTS			एनटीपीसी NTPC
			All the calibration gases required for one year continuous operation shall be provided. The calibration gas container material shall not contaminate the calibration gas.	
	11.	Compliance to standards	USEPA, TUV, MCERTS or equivalent standards	
	12.	Type of Technology	SO ₂ :- Hot-extractive sampling type/ Dilution Extractive/ In-situ (Path) type For Hot-extractive sampling type and Dilution extractive type systems, the entire system including analysers, sample handling/conditioning system etc offered shall be sourced from/assembled at Original Analyser manufacturer(OAM) works	
	13	Measurement Range, Tapping point	As per FGD system design and process parameter	
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2		SUB-SECTION-III-C2 MEASURING INSTRUMENTS PAGE 20 OF 34

12.00.00

SPECIFICATION OF ANALYSERS

12.01.00

Common Requirements

1.	Type of electronics	Microprocessor based
2.	Zero & span Adjustment	To be provided
3.	Ambient temp.	50°C
4.	Display	LCD
5.	Enclosure Type / Material	Weather and Dust proof (IP 55), Die cast aluminum with corrosion resistant epoxy coating for external field mounting analysers
6.	Output signals Analog	4-20 mA DC
7.	Error / fault Diagnostic	To be provided.
8.	Power supply	The power supply to all the analyzers / monitors shall be supplied by contractor

LOT-1A PROJECTS
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE

TECHNICAL SPECIFICATION
SECTION-VI, PART-B
BID DOCUMENT NO.: CS-0011-109(1)-2

SUB-SECTION-III-C2
MEASURING
INSTRUMENTS

PAGE 30 OF 34

020/PS PEM MAX

CLAUSE NO.	TECHNICAL REQUIREMENTS		
		with all necessary switches, fuses, wiring / cabling and other required accessories etc. for distribution to individual requirements.	
	9. Load	500 Ohms minimum	
	10. Mounting	All mounting arrangements for the sensors and the monitors are to be provided by the Contractor. SWAS instruments to be mounted in the panel except Hotwell analysers. For the same and other field application free standing cabinet(s) / panel / rack is to be provided by the Contractor for mounting the analysers / transmitters / meters as applicable due to environment.	
	11. Other Requirements	All chemical reagents required for silica, phosphate, sodium, chloride, residual chlorine and hydrazine analyzers for 12 months operation is to be supplied in phased manner depending on shelf life.	

12.03.00	pH analyser <table><tr><td>1. Type</td><td>Continuous flow through type</td></tr><tr><td>2. Range</td><td>0 - 14 pH freely programmable</td></tr><tr><td>3. Accuracy</td><td>< ± 1% of reading</td></tr><tr><td>4. Temperature Compensation</td><td>Automatic</td></tr><tr><td>5. No. of Streams</td><td>Single</td></tr></table>	1. Type	Continuous flow through type	2. Range	0 - 14 pH freely programmable	3. Accuracy	< ± 1% of reading	4. Temperature Compensation	Automatic	5. No. of Streams	Single
1. Type	Continuous flow through type										
2. Range	0 - 14 pH freely programmable										
3. Accuracy	< ± 1% of reading										
4. Temperature Compensation	Automatic										
5. No. of Streams	Single										
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 31 OF 34								

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
14.00.00	Electronic Flow-Meter Electronic Flow-meters shall be provided where ever indicated in the P&IDs. The electronic flow meter shall include flow sensor and flow indicator cum integrator/totaliser and shall include all required accessories for satisfactory operation. The flow meter shall be based on full bore ultrasonic/electromagnetic principle and shall be electronic type of proven design, make and model acceptable to the owner. The Bidder shall submit all necessary technical literature and details of selection criteria of the instrument offered to substantiate the model selected. The Bidder shall also furnish list of similar installation along with feedback on satisfactory performance of the instruments. The flow meter shall meet or exceed the following requirement: (a) Output : 4-20 mA DC Isolated output (b) Accuracy : $\pm 0.5\%$ of calibrated span or better * (c) Repeatability : $\pm 0.2\%$ of calibrated span or better (d) Ambient Temp. & : 4 deg.C to 55 deg.C. Humidity 5% to 100% RH (e) Power Supply : 240V AC $\pm 10\%$, 50 HZ $\pm 5\%$/ 24 V DC, to be arranged by the contractor. (f) Protection class : IP-55 (g) Flow tube SS304 (h) liner Hard Rubber The flow meter shall provide local indication for instantaneous flow. It should also be possible to get local display for daily and monthly discharge. The flow meter shall indicate totaliser / integrator to get the daily and monthly discharge as stated above.		
LOT-1A PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1)-2	SUB-SECTION-III-C2 MEASURING INSTRUMENTS	PAGE 34 OF 34

CLAUSE NO.	TECHNICAL REQUIREMENTS			
1.00.00	GENERAL:			
1.01.00	Actuators shall be designed for valve operation to ensure proper function in accordance with specifications given below and complying to EN15714-2 or equivalent. All standards, specifications and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions.			
1.02.00	This sub-section of specification is applicable for following types of electric actuators:			
1.02.01	Modulating duty electric actuators:			
	These shall be provided as per standard practice of OEM of equipment, meeting other requirements of specifications. For specifications of Blade pitch actuators, refer clause no. 5.00.00 of this chapter.			
1.02.02	Electric actuators for valves/ dampers/ gates (other than covered in 1.02.01):			
	These actuators shall be Non-Intrusive type electric actuators. The interface of these actuators with DDCMIS shall be of two types viz. with Hardwired interface and with Fieldbus interface. The common requirements of both these type of actuators are specified at clause 2.00.00, specific requirements of Non-Intrusive hardwired actuators are specified at clause 3.00.00 and specific requirements of Non-Intrusive fieldbus actuators are specified at clause 4.00.00. The applications where these two types of actuators are to be provided is specified in Part-A of Technical Specifications.			
2.00.00	COMMON REQUIREMENTS FOR NON INTRUSIVE ELECTRIC ACTUATORS			
2.01.00	TYPE:			
2.01.01	The actuators shall have integral starters with built in SPP (Single Phasing Preventer). 415 V, 3 phase 3 wire power supply shall be given to the actuator from switch board as applicable through a switch fuse unit. Control voltage of the motor starter shall be 110 V AC / 24 V DC, derived suitably from 415V power supply.			
2.01.02	The actuators shall be Non- Intrusive electric actuator. All actuator settings including torque, limit shall be possible without opening the actuator cover and LCD indication shall be available integral to actuator body.			
2.02.00	RATING:			
	(a) Supply Voltage & frequency: 415V +/- 10%, 3 Phase, 3 Wire & 50HZ +/-5%.			
	(b) Sizing:			
	Open/Close at rated speed against designed differential pressure at 90% of rated voltage.			
	For ON/OFF type: Three successive open-close operations or 15 minutes, whichever is higher.			
	For inching type: 150 starts per hour or required cycles, whichever is higher.			
2.03.00	CONSTRUCTION:			
	(a) Enclosure:			
	Totally enclosed weatherproof, minimum IP-68 degree of protection.			
	(b) Manual Wheel:			
	Shall disengage automatically during motor operation.			
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	SUB-SECTION-IIIIC-8 ELECTRIC ACTUATORS	PAGE 1 OF 4

SUB-SECTION-IIIIC-8 ELECTRIC ACTUATORS		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
2.04.00		MOTOR: (a) Type : Squirrel cage induction motor suitable for Direct On Line (DOL)starting. (b) Enclosure: Totally enclosed, self-ventilated. (c) Insulation Class F. Temperature rise 70 Deg C. over 50 Deg C ambient. (d) Bearings: Double shielded, grease lubricated antifriction. (e) Earth Terminals: Two (f) Protection: Single Phasing Protection, Over heating protection through Thermostat (as applicable) and wrong phase sequence protection shall be provided over and above other protection features standard to bidder's design. Suitable means shall be provided to diagnose the type of fault locally.			
2.05.00		POSITION/TORQUE TRANSMITTER: The Position/ Limit measurement shall be done using absolute encoders which will give information of position/ limit in both the directions. Electronic measurement of torque shall be provided.			
2.06.00		LOCAL OPERATION: It shall be possible to operate the actuator locally also. Lockable local/remote selection shall be provided on the actuator.			
2.07.00		LCD DISPLAY: A local LCD display shall be provided to give information regarding actuator alarms, status and valve position indications as a minimum in local.			
2.08.00		WIRING: Suitable voltage grade copper wire.			
2.09.00		TERMINAL BLOCK: For power cables, the grade of TBs shall be minimum 650V.			
2.10.00		ACCESSORIES: All required accessories (if applicable) for calibration / settings/ configuration of various parameters of actuator shall be provided. For quantities, please refer Part A of technical specifications.			
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		SUB-SECTION-IIIIC-8 ELECTRIC ACTUATORS	
				PAGE 2 OF 4	

0/PS-PEM-MAX CLAUSE NO.		TECHNICAL REQUIREMENTS		एनटीपीसी NTPC	
2.11.00	SIL CERTIFICATION: All actuators shall be certified for SIL 2 or better.				
3.00.00	SPECIFIC REQUIREMENTS FOR NON INTRUSIVE HARDWIRED ACTUATORS				
3.01.00	INTERFACES: For ON-OFF and INCHING type actuators interface with the control system shall be through hardwired signal only. (a) Open/Close command, open/ close status and disturbance monitoring signal (common contact for Overload, Thermostat, control supply failure, L/R selector switch at local & other protections operated) shall be provided hardwired. (b) The actuator shall be able to accept open/close command at 24V DC with max. 2.5VA load from control system. Accordingly suitable isolated interface in the actuator shall be provided. (c) Open/close command termination logic shall be suitably built inside actuator. (d) For typical wiring diagram Refer Tender Drawing No. 0000-999-POI-A-063 (Except plug & socket connector, if not applicable)				
3.02.00	TERMINAL BOX: Suitable terminals/ connectors, integral to actuator, for terminating instrumentation & power cables shall be provided. Necessary glands for power cables and instrumentation cables shall be provided.				
4.00.00	SPECIFIC REQUIREMENTS FOR NON INTRUSIVE FIELDBUS ACTUATORS				
4.01.00	INTERFACES: For ON-OFF and INCHING type actuators interface with the control system shall be through fieldbus network. (a) Open/ close commands, open/ close feedback status, disturbance signal etc. shall be available to the Control System through the fieldbus network along with diagnostics. The detailed diagnostics including the actuator operating data shall be available to the DDCMIS through the fieldbus network. (b) All actuators shall be Foundation Fieldbus/ Profibus compatible. However the exact protocol shall be based on finalized protocol of DDCMIS. If Profibus DP protocol is envisaged then actuator shall have two (redundant) Profibus DP ports for connecting the redundant Profibus DP cables. That is if one profibus cable is cut or not working/ not available, then complete actuator functionality shall be available through the second redundant cable without any manual intervention. (c) Open/close command termination logic shall be suitably built inside actuator.				
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		SUB-SECTION-IIIIC-8 ELECTRIC ACTUATORS	
				PAGE 3 OF 4	

CLAUSE NO.	TECHNICAL REQUIREMENTS 
4.02.00	TERMINAL BOX: Suitable terminals/ connectors, integral to actuator, for terminating fieldbus cables and power cables shall be provided. Necessary glands for power cables and armored fieldbus cables shall be provided.

LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	SUB-SECTION-IIIC-8 ELECTRIC ACTUATORS	PAGE 4 OF 4

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC		
		CONTROL VALVES, ACTUATORS & ACCESSORIES 1.00.00 CONTROL VALVES & ACCESSORIES 1.01.00 General Requirements 1.01.01 The control valves and accessories equipment furnished by the Bidder shall be designed, constructed and tested in accordance with the latest applicable requirements of code for pressure piping ANSI B 31.1, the ASME Boiler & pressure vessel code, Indian Boiler Regulation (IBR), ISA, and other standards specified elsewhere as well as in accordance with all applicable requirements of the "Federal Occupational Safety and Health Standards, USA" or acceptable equal standards. All the Control Valves, their actuators and accessories to be furnished under this Sub-section will be fully suitable and compatible with the modulating loops covered under the Specification. 1.01.02 All the control valves and accessories offered by the Bidder, shall be from reputed, experienced manufacturers of specified type and range of valves. 1.02.00 CONTROL VALVE SIZING & CONSTRUCTION 1.02.01 The design of all valve bodies shall meet the specification requirements and shall conform to the requirements of ANSI (USA) for dimensions, material thickness and material specification for their respective pressure classes. 1.02.02 The valve sizing shall be suitable for obtaining maximum flow conditions with valve opening at approximately 80% of total valve stem travel and minimum flow conditions with valve stem travel not less than 10% of total valve stem travel. All the valves shall be capable of handling at least 120% of the required maximum flow. Further, the valve stem travel range from minimum flow condition to maximum flow condition shall not be less than 50% of the total valve stem travel. The sizing shall be in accordance with the latest edition of ISA handbook on control valves. While deciding the size of valves, Bidder shall ensure that valves trim exit outlet velocity as defined in ISA handbook does not exceed 8 m/sec for liquid services, 150 m/sec. for steam services and 50% of sonic velocity for flashing services. Bidder shall furnish the sizing calculations clearly indicating the outlet velocity achieved with the valve size selected by him as well as noise calculations, which will be subject to Employer's approval during detailed engineering. 1.02.03 Control valves for steam and water applications shall be designed to prevent cavitation, wire drawing, flashing on the downstream side of valve and down stream piping. Thus for cavitation/flashing service, only valve with anti cavitation trim shall be provided. Detailed calculations to establish whether cavitation will occur or not for any given application shall be furnished. 1.02.04 Control valves shall have leakage rate as per leakage Class-IV.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C7 CONTROL VALVES, ACTUATORS & ACCESSORIES	PAGE 1 OF 5

CLAUSE NO.	TECHNICAL REQUIREMENTS	एनटीपीसी NTPC	
1.02.05	The control valve induced noise shall be limited to 85 dBA at 1 meter from the valve surface under actual operating conditions. The noise abatement shall be achieved by valve body and trim design and not by use of silencers.		
2.00.00	VALVE CONSTRUCTION		
2.01.00	All valves shall be of globe /Butterfly body design & straightaway pattern with single or double port, unless other wise specified or recommended by the manufacturer to be of angle body type. Rotary valve may alternatively be offered when pressure and pressure drops permit.		
2.02.00	Valves with high lift cage guided plugs & quick-change trims shall be supplied.		
2.03.00	Cast Iron valves are not acceptable.		
2.04.00	Bonnet joints for all control valves shall be of the flanged and bolted type or other construction acceptable to the Employer. Bonnet joints of the internal threaded or union type will not be acceptable.		
2.05.00	Plug shall be of one-piece construction cast, forged or machined from solid bar stock. Plug shall be screwed and pinned to valve stems or shall be integral with the valve stems.		
2.06.00	All valves connected to vacuum on down stream side shall be provided with packing suitable for vacuum applications (e.g. double vee type chevron packing)		
2.07.00	Valve characteristic shall match with the process characteristics.		
2.08.00	Extension bonnets shall be provided when the maximum temperature of flowing fluid is greater than 280 deg. C.		
2.09.00	Flanged valves shall be rated at no less than ANSI press class of 300 lbs.		
3.00.00	VALVE MATERIALS Refer mechanical sections for body and trim materials. The exact body and trim materials shall be finalised during detailed engineering depending on the service applications. However, Bidder may offer valves with body and trim materials better than specified materials and in such cases Bidder shall furnish the comparison of properties including cavitation resistance, hardness, tensile strength, strain energy, corrosion resistance and erosion resistance etc. of the offered material vis-a-vis the specified material for Employer's consideration and approval.		
LOT-IA PROJECTS FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOCUMENT NO.: CS-0011-109(1A)-2	SUB-SECTION-III-C7 CONTROL VALVES, ACTUATORS & ACCESSORIES PAGE 2 OF 5



VFD

VARIABLE FREQUENCY DRIVES

Variable Frequency Drive (VFD)

1.00.00

GENERAL

The Design, manufacture, erection, testing and performance of items and services provided under this specification shall comply with the latest edition including all applicable official amendments and revisions as on date of award of the following standards. In case of conflict between this specification and code (IS Code, standards, etc.) referred herein, the former shall prevail. All work shall be carried out as per the following codes and standards.

2.00.00

CODES AND STANDARDS

HT breaker	IEC:60056
DC reactor	IEC 60289
Transformers	IS:2026, IEC: 60076 IEC 61378
Bushing	IS: 2099, IEC 60137
Adjustable Speed Electrical Power Drive Systems	IEC 61800
Semiconductor converters-General requirements	IEC 60146
IEEE Recommended practices and requirements for harmonic control in electrical power systems	IEEE 519
Degrees of protection provided by enclosures (IP Code)	IEC 60529
Electrostatic immunity test	IEC1000-4-2
Fast transient immunity test	IEC1000-4-4
Surge immunity test	IEC1000-4-5
High-voltage switchgear and controlgear; Pt.102: Alternating current disconnectors and earthing switches	IEC 62271-102
High-voltage switchgear and controlgear; Pt.200: AC metal-enclosed switchgear and controlgear for rated voltages above 1 kV and up to and including 52 KV	IS/IEC: 62271-200
AC electricity meters	IS: 722
Metal oxide surge arrestor without gap for AC system	IEC: 60099-4
Terminal blocks for copper conductors	IEC: 60947-7-1
Dry transformer	IS: 11171
Motor	IEC 60034-18-41 &42, IEC60034 / NEMA 30 & 31,
Contactor/Switches/Fuses etc.	IEC:60947, IS: 13947
Harmonics & EM compatibility	IEEE:519/IEC: 61000
VFD	IEC:60034/ IEC: 61800

Equipment complying with other internationally accepted standards will also be considered if they ensure performance and constructional features equivalent or superior to standards listed above. In such a case, the Bidder shall clearly indicate

VARIABLE FREQUENCY DRIVES

the standard(s) adopted, furnish a copy in English of the latest revision amendments and revision in force as on date of opening of bid and shall clearly bring out the salient features for comparison.

3.00.00 **OPERATING CONDITIONS**

3.01.00 For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and also relative humidity of 95% at 40 deg. Celsius shall be considered.

3.02.00 All equipment shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.

3.03.00 The auxiliary AC voltage supply arrangement shall have 11/6.6/3.3kV and 415V systems (as applicable). It shall be designed to limit voltage variations as given below under worst operating condition:

1. 11kV/ 3.3 kV/ 6.6 KV : +/- 6%
2. 415V : +/- 10%

Note: The Voltage level mentioned above is the Nominal Voltage available at the input of the VFD System from the MCC/ Switchgear/transformer, based on the system requirement/Availability.

The voltage level for the VFD output to be fed to motor shall be as follows:-

1. Upto 400 kW : 415V/690V, Low Voltage, Three Phase AC
2. Above 400kW and upto 700 KW : 690V, Low Voltage, Three Phase AC
3. Above 700KW : Medium Voltage

From here onwards in the specifications all the VFD Systems consisting of either 415 V or 690 V may be termed as LV VFD while the higher rated VFD System shall be termed as MV VFD. If nothing is mentioned than the Clause is applicable for both the LV and the MV VFD until deliberated otherwise.

4.00.00 **SYSTEM DESCRIPTION**

Type of drive 3-Phase Diode / Thyristor / Multi Stage IGBT / IGCT / SGCT/ IEGT

5.00.00 Type of Cooling of VFD Naturally air cooled/forced air cooled/Liquid cooled

Converter Type Full wave diode rectifier/active front end type

Inverter Type Thyristor/IGBT/IGCT/SGCT/IEGT

GENERAL REQUIREMENTS

5.01.00 **Medium Voltage VFD:** The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system

6693/2020/PS-REM-MAX

VARIABLE FREQUENCY DRIVES

	shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum eighteen (18) pulse design.
5.02.00	415 V/690 V LV VFD: The Variable frequency drive (VFD) system shall be of a modern proven design for similar applications in power plants/industry. The system shall be either Current Source Inverter (CSI) or Voltage Source Inverter (VSI) type with minimum Twelve (12) pulse design. For drives less than 100 KW Six (6) pulse can be offered meeting all other requirements.
5.03.00	The system shall be fully digital, PLC/Microprocessor based, energy efficient, and shall provide very high reliability, high power factor, low harmonic distortion and low vibration and wear and noise. It shall be easy to install in minimum time and expense and no special tools shall be required for routine maintenance.
5.04.00	The offered equipment shall be with state of art technology and proven field track record. No prototype equipment shall be offered.
5.05.00	The VFD manufacturer shall ensure the proper coordination of their VFD with the Driven Motor and the supply system. All the Motors which are to be driven by VFDs will be of Inverter duty type. Also these motors shall comply the requirements stipulated in IEC: 60034-18-41 and IEC: 60034-18-42 as applicable. The VFD operation shall have no inherent detrimental impact on the Motors/ cables & supply system.
6.00.00	TECHNICAL AND OPERATIONAL REQUIREMENTS
6.01.00	The system shall be designed to deliver the motor input current and torque for the complete speed torque characteristics of the driven equipment, with worst input supply voltage and frequency variation. The system shall be suitable for the load characteristics and the operational duty of the driven equipment.
6.02.00	The overload capacity of the controller shall be 150% of the rated current of the motor for one minute for constant torque applications and 110% of rated current for one minute for variable torque applications at rated voltage. If the motor load exceeds the limit, the drive shall automatically reduce the frequency and voltage to the motor to guard against overload.
6.03.00	The drive system shall be designed to operate in one or more of the following operating modes as to suit characteristics of the driven equipment or specified by the load: a. Variable torque changing as a function of speed. b. Constant torque over a specific speed range. c. Constant power over a specific speed range. d. Any other as specified in data-sheet
6.04.00	VFDs shall comply with the latest edition of IEEE 519 & IEC 61000 for both individual as well as total harmonic voltage and current distortion limits. The Voltage and Current limits shall be applicable at the Point of Common Coupling (PCC), which shall be the MCC/ Switchgear/ from which the VFD system is fed.

6693/2020/PS-REM-MAX

VARIABLE FREQUENCY DRIVES

6.05.00	The above compliance shall be verified by the field measurements of harmonics at the PCC with and without VFDs operation.
6.06.00	VFD shall be capable of withstanding the thermal and dynamic stresses and the transient mechanical torque, resulting from short circuit. Any damage resulting from such a short circuit or internal fault shall be limited to the component concerned.
6.07.00	The system shall be suitable to maintain speed variation within range 10-110% or as per the requirement of driven equipment with speed set accuracy of +1% of rated maximum speed and steady state regulation of +0.5% of rated speed as per system requirement.
6.08.00	The VFD System shall maintain a power factor of 0.95 (minimum) (for LV VFD system) and 0.9 (minimum) (for MV VFD system) in the entire operating range.
6.09.00	Maximum allowable audible noise from the VFD system will be 85 dB (A) at a distance of one meter under rated loaded with all cooling fan operating conditions.
6.10.00	All the circuit components shall be suitably protected against over voltages, surges, lightning etc.
6.11.00	The panels shall be designed to provide easy access to hardware, to facilitate replacement of cards in case of any failure.
6.12.00	All the VFDs for particular application shall be of same design so as to ensure 100 % interchangeability of components.
6.13.00	For each programmed warning and fault protection function, the VFD shall display a message in complete English words or Standard English abbreviations. At least 30 time tagged fault messages shall be stored in the drive's fault history.
6.14.00	The VFD cubicles shall be placed in air conditioned environment. However if VFDs of less than 100 kW are designed to operate in non-air condition environment the same shall also be acceptable.
6.15.00	The 3-Phase Thyristor/IGCT/SGCT/ multistage IGBT/IEGT based VFD system shall have minimum number of components to ensure very high reliability. The input side converter shall have 3-Phase Diode/Thyristor bridge configuration modular type and inverter shall be of 3-Phase Thyristor/IGCT/SGCT/multi stage IGBT/IEGT type, using Pulse Width Modulation or better technique for generating near sine wave output to motor.
6.16.00	Fiber optic cable connection shall be provided preferably to ensure high network reliability.
7.00.00	VFD COMPATIBILITY WITH THE MOTOR
7.01.00	MV VFD output current waveform, as measured at the motor, shall be inherently sinusoidal at nominal loads, with a total harmonic current and voltage distortion within acceptable/standard limits. VFD with transformers on output side are not acceptable.

VARIABLE FREQUENCY DRIVES

7.02.00	The system design shall not have any inherent output harmonic resonance in the operating speed range.
7.03.00	VFD shall provide stable operation of motor from high-voltage dv/dt stress, regardless of cable length to motor. The vendor shall clearly state the limitations in the motor cable distance in his proposal. However, due to system requirements & constraints if the cable length becomes critical, filters/ chokes etc. shall be provided by the VFD manufacturers as an integral part of the VFD to mitigate the reflected wave effect of harmonics.
8.00.00	BYPASS ARRANGEMENT (OPTIONAL, IF SPECIFIED)
8.01.00	The VFD System shall have an optional feature to run the motor under bypass arrangement for operation of Motor with VFD bypassed. During starting (under rated conditions) the motor will be switched on in VFD Mode to limit the starting current and after gaining speed, the load would be switched over to bypass mode.
8.02.00	Comprehensive motor protection scheme for protection and control for operation VFD during bypass mode shall be finalized during detailed engineering.
9.00.00	STANDBY VFD ARRANGEMENT (OPTIONAL, IF SPECIFIED)
9.01.00	A Common standby arrangement with auto/manual switchover shall be provided in case of failure of any VFD in a group of drives. Complete protection, interlocks & control required shall be provided in the changeover module.
10.00.00	EFFICIENCY
10.01.00	Efficiency (Drive only) shall be minimum 98% for both MV VFD and LV VFD. Overall efficiency shall be minimum 96.5% for LV VFD and minimum 94 % for MV VFD at rated load and speed. Overall Efficiency evaluation shall include input transformer, harmonic filters and power factor correction (if applicable), VFD converters, cooling fans and output filter, as applicable in the system. Auxiliary controls, such as internal VFD control boards, cooling fans/pumps.
10.02.00	In absence of valid test report, a factory test shall be performed at the VFD manufacturer's facility verifying the efficiencies. Manufactures who are supplying Drive and transformer from different locations, efficiency test will be conducted separately for Drive and transformer.
11.00.00	COOLING SYSTEM
11.01.00	The VFD shall be designed to operate indoor under temperature range of 0 deg C to 50 deg C and relative humidity of 95 %(at 40 deg C).
11.02.00	VFD manufacturer to primarily offer Air cooled Design. However in case of large ratings, liquid cooled drives may be accepted subject to employer's approval. In case of liquid cooled system, there shall be no necessity of continuous water supply system (Closed Loop System).
11.03.00	In case of Air cooled design, the VFD Cooling system shall be such that it puts minimum heat load inside the room and preferably throw the hot air outside the room with ventilation ducts. The Cooling system shall be designed in such a way that the Air Conditioning & Ventilation Air requirements are kept to minimum. The VFD

VARIABLE FREQUENCY DRIVES

	Manufacturer shall furnish the data regarding heat load, air flow requirements during the detailed engineering.
11.04.00	Air cooled VFDs shall be provided with cooling fans mounted integral to the VFD/ enclosure. The VFD shall include air-flow pressure switches and temperature detectors to monitor proper operation of the air cooling system. If the fan fails, the system must generate the alarm/trip for the fan failure.
12.00.00	TRANSFORMER:
12.01.00	Type: Outdoor Mineral oil filled ONAN type or Indoor natural air-cooled Dry type, Three phase unit, rectifier/converter duty type transformer.
12.02.00	All other components, technical parameters shall be as per applicable IEC/IS.
12.03.00	Enclosure for Dry Type Transformer (as applicable)
	Enclosure shall be of a tested quality sheet steel of minimum thickness 2 mm & shall also accommodate cable terminations. The housing door shall be interlocked such that it should be possible to open the door only when transformer is off. The enclosure shall be provided with lifting lugs and other hardware for floor mounting.
12.04.00	Core Shall be High grade non-ageing cold rolled grain oriented silicon steel Laminations.
12.05.00	Winding conductor Shall be electrolytic grade copper. Windings shall be of class F insulation.
12.06.00	Winding temperature Indicator (WTI) Shall be Platinum resistance type temperature detector in each limb.
12.07.00	Thermistors Shall be embedded in each limb with alarm and trip contacts for remote annunciation.
12.08.00	Temperature rise: Winding temperature rise shall be as per applicable IEC.
13.00.00	POWER CONVERTER:
13.01.00	The static power converter shall consist of a line side converter for operation as a rectifier and a load side power converter for operation as a fully controller inverter. Power converter shall be fast switching, most efficient and low loss type.
13.02.00	The converter shall be coordinated with the transformers. The converter shall be able to withstand a three phase short circuit current until interrupted by normal breaker operation.
13.03.00	Adequate short circuit and over voltage protection shall be provided for the converter and inverter system.
13.04.00	All power converter devices shall include protective devices, snubber networks and dv/dt networks as required.
13.05.00	The current rating of the converter's semi-conductor components shall not be less than 120% of the nominal current flowing through the elements at full load of the VFD

6693/2020/PS-REM-MAX

VARIABLE FREQUENCY DRIVES

	through the whole speed range. If the parallel connection of semiconductor is applied, the above current rating shall not be less than 140% of the above values.
13.06.00	All power diodes shall be of silicon type with minimum VBO rating at 2.5 times the rated operating voltage.
13.07.00	The power converter circuit shall be designed so that motor can be powered at its full nameplate rating continuously without exceeding its rated temperature rise nor reducing its service factor due to harmonic currents generated by the inverter operation. The conversion devices and associated heat sinks shall be assembled such that individual devices can be replaced without requiring the use of any special precautions / tools.
13.08.00	The cooling system of the electronic components, if provided, shall be monitored and necessary alarms shall be provided to prevent any consequential damage to the power control devices.
14.00.00	OUTPUT FILTER (AS APPLICABLE):
14.01.00	Output/ dv/dt filter shall be provided, if required. It shall be an integral part of the VFD system and included within the VFD enclosure. It shall inherently protect motor from high voltage dv/dt stress.
15.00.00	DC LINK CAPACITOR (AS APPLICABLE):
15.01.00	Capacitor shall be of self-healing film or electrolytic type having high life time. The capacitor shall be an integral part of VFD system. DC link Capacitors shall have discharge resistors which shall be capable of reducing the residual charges to zero just after the capacitor is disconnected from the supply source. The capacitor shall be suitable for high ripple currents.
16.00.00	AC/DC Reactor (As applicable)
	1) Type: Dry type, air cored, self cooled, indoor type. Suitable for withstanding earth fault continuously. 2) Insulation: Thermal Class 155(F), temperature rise is limited to thermal class 130 (B). 3) Noise level shall not exceed value specified in NEMA TR-1.
17.00.00	VFD PANEL REQUIREMENTS
17.01.00	Enclosure frames and load bearing members shall be fabricated using suitable mild steel structural sections or pressed and shaped cold-rolled sheet steel of thickness 2.0 mm. Frames shall be enclosed in cold-rolled sheet steel of thickness 1.6 mm. Doors and covers shall also be of cold rolled sheet steel of thickness 1.6 mm. Stiffeners shall be provided wherever necessary. The gland plate thickness shall be 3.0 mm for hot / cold-rolled sheet steel and 4.0 mm for non-magnetic material. In case dry type transformer is provided inside VFD panels, the enclosure and in its frame thickness shall be same as indicated in this para.
17.02.00	The cable entry shall be from the bottom of the panel and a removable bolted un-drilled gland plate.
17.03.00	All Panels shall be of dust-proof and vermin-proof construction and shall be provided with a degree of protection of IP: 3X or better for MV VFD and IP: 4X or better for LV VFD as per IS/IEC 60947

	VARIABLE FREQUENCY DRIVES
17.04.00	Enclosures must be designed to avoid harmonic and inductive heating effects and to shield any outside equipment from interference, enclosing and shielding the complete to eliminate any radio frequency interference. The construction of the panel shall provide effective protection against electromagnetic emissions.
17.05.00	Each panel shall be provided with illuminating lamp, space heater with switch fuse and variable setting thermostat.
17.06.00	Proper ventilation using air filters and fans/pumps shall be provided in the panels to ensure that maximum temperature inside the cubicle is within permissible limits for reliable and continuous operation of the system.
18.00.00	PAINTING Paint shade shall be as follows a) VFD transformer : RAL 5012 (Blue), legend in black letter reactor enclosure b) Motors : RAL 5012 (Blue) c) VFD Panels : Front and rear panels in Grey (RAL9002). End panel sides in blue (RAL 5012)
19.00.00	HT SWITCHGEAR
19.01.00	The technical requirements of HT switchgear shall be as per chapter of HT switchgear in Part-B of Technical specifications.
20.00.00	MOTORS
20.01.00	VFD shall be used to drive three (3) phase squirrel cage inverter duty Induction motor with VPI insulation (Resin poor) suitable for VFD application. These motors shall be provided with insulated bearing on at least one side.
20.02.00	Motors shall also meet the requirements mentioned in subsection for motors and relevant IS/IEC.
20.03.00	Motor shall be suitable for operation with a solid state power supply consisting of an adjustable frequency inverter for speed control & shall be suitable for the current waveforms produced by the power supply including the harmonics generated by the drive.
20.04.00	Motor insulation shall be designed to accept the applied voltage waveform, within the Vpeak and dv/dt limits as per IEC-61800.
20.05.00	Drive manufacturer shall coordinate with the motor manufacturer for proper selection of the motor for the given load application and the output characteristics of the drive.
20.06.00	Other requirements of motor shall be as stipulated in technical chapter of Motors in Part-B of technical specifications.
21.00.00	LT & HT CABLES
21.01.00	Contractor's scope shall also include LT and HT cables suitable for VFD system and Motors.
22.00.00	CONTROL AND PERFORMANCE REQUIREMENTS

VARIABLE FREQUENCY DRIVES

22.01.00	The VFD to provide an automatic current limiting feature to control motor currents during startup and provide a "soft start" torque profile for the motor load combination. Current and torque limit adjustments shall be provided to limit the maximum VFD output current and the maximum torque produced by the motor.
22.02.00	It shall be possible to vary the speed of the drive and control it in either Local or Remote mode. Local / Remote selection shall be done from VFD panel unless otherwise specified.
22.03.00	Provision shall be kept for exchange of information between different VFD control system parameters thru PLC/DDCMIS. Man machine interface for (MV) VFD shall have one flat TFT monitor with keyboard (password protected) in the VFD room and a color laser printer for system alarm and monitoring located in control room. Parameter Monitoring: -Input and output voltage of Drive - Input and output current of Drive - Motor speed - Input and output power frequency of Drive - Torque -Input and Output power of Drive system (covering transformer if applicable) - Output kWhr of Drive - Transformer (if applicable) temperature for alarm & trip. - Ambient temperature - Run/stop and local/remote status displayed
22.04.00	Drive shall be equipped with a front mounted operator console panel consisting of a backlit alphanumeric display and a keypad with keys for parameterization and adjusting parameter. Control panel shall be operable with password for changing the protection setting, safety interlock etc.
22.05.00	Operator console/Main Control Card shall have facility / port to connect external hardware such as Lap-Top etc. Console shall have facility for upload and download of all parameter settings from one drive to another drive for start up and operation.
22.06.00	User-friendly licensed software for operation and fault diagnostic shall be loaded in the drive system panel before commissioning.
23.00.00	PROTECTION FEATURES
23.01.00	The system offered shall incorporate adequate protection features as per IEC 61800-4: 2002 Table-8, properly coordinated for the drive control and for motor including following: i) Converter transformer: short circuit, over current, earth fault & winding temperature high protection. ii) Incoming and outgoing line surge protection. iii) Under / over voltage protection iv) Phase loss, phase reversal, overload, negative phase sequence, locked rotor protection.

VARIABLE FREQUENCY DRIVES

	v) Instantaneous Over current & Earth fault protection vi) Converter/Inverter module failure indication. vii) Over frequency/speed protection. viii) Ventilation failure indication & alarm. ix) Over temperature of VFD x) Bearing temperature protection. xi) System earth fault protection. xii) Speed reference loss protection.
23.02.00	Under VFD Bypass Mode (if applicable) all the electrical protections related to the Motor shall remain applicable.
24.00.00	CONTROL FEATURES
24.01.00	Following controls shall be provided as a part of the Operator Control Panel or through separate switches on the front panel door. i) Start / stop (in local/remote mode) ii) Speed control (Raise / lower) iii) Acknowledge/Accept/ Test Push Button for annunciation iv) Auto / Manual / Test Mode select v) Emergency stop vi) Trip-Remote Breaker
25.00.00	DIAGNOSTIC FEATURES
25.01.00	The VFD shall include a microprocessor/PLC based digital diagnostic system which monitors its own control functions and displays faults and operating conditions.
25.02.00	Fault diagnostic shall be built into the system to supervise the operation and failure of the system. The information regarding failure of any of the system including shut down of the system shall be available. It shall be possible to retrieve the record of events prior to tripping of the system or de-energization. Auxiliary supply to the system components or to the electronics (firmware) for the diagnostics / display shall be taken care of by the manufacturer for this purpose.
26.00.00	SERVICEABILITY / MAINTAINABILITY
26.01.00	Power Component Accessibility: All power components in the converter sections shall be designed for rack-out accessibility for ease of maintenance and to minimize repair downtime.

6693/2020/PS-REM-MAX

VARIABLE FREQUENCY DRIVES

26.02.00	Marking / Labeling: Sleeve type wire marker tags or other acceptable means of permanent identification shall be applied to power and control wiring. Individual labels shall be provided for all major components of the VFD system.
27.00.00	STORAGE AND PRESERVATION
27.01.00	The Contractor shall be responsible for the storage and preservation of all the equipments to be supplied under the VFD System, till the time of successful installation and commissioning. The equipment should be suitable for storage for long periods before installation. Contractor should take adequate measures to ensure that no damage happens to the VFD System due to storage and preservation.
28.00.00	TESTS
28.01.00	ROUTINE TESTS
	All acceptance and routine tests as envisaged in QA section shall be carried out. Charges for these shall be deemed to be included in the equipment price.
28.02.00	TYPE TESTS
28.02.01	The Contractor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The bidder shall indicate the charges for each of these type tests separately in the relevant schedule and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the employer's engineer.
28.02.02	The type tests shall be carried out in presence of the employer's representative, for which minimum 15 days' notice shall be given by the Contractor. The Contractor shall obtain the employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out.
28.02.03	In case the Contractor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering the type test reports to the Employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The Employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the Contractor.
28.02.04	Further the Contractor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED" and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the Contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the Contractor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.

28.03.00

LIST OF TYPE TESTS TO BE CONDUCTED

The following type tests shall be conducted under this contract for MV VFD

- i) Overall efficiency determination of VFD system including transformer/ Harmonic filters etc at motor full load
- ii) Temperature rise test
- iii) Noise level
- iv) Harmonics of No load current.(Input/Output)

28.04.00

LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED

The following type test reports shall be submitted for VFD Panels'

1) VFD panels (For LV VFD)

- i. Rated Current/ Output
- ii. Temperature rise test
- iii. Noise level test
- iv. Power Loss Determination Test
- v. Power factor measurement.
- vi. Degree of Protection Test
- vii. EMC Test
- viii. The Fast transient SWC tests as per ANSI / IEEE C37.901-2002 / IEC 60255-22-04-2008 / IEC 61800

2) VFD panels (For MV VFD)

- i. Rated Current/ Output
- ii. Current Sharing
- iii. Voltage Division
- iv. Power Loss Determination Test
- v. Power factor measurement.
- vi. Degree of Protection Test
- vii. The Fast transient SWC tests as per ANSI / IEEE C37.901-2002 / IEC 60255-22-04-2008 / IEC 61800

3) AC/DC Reactor

- i. Lightning impulse test(If applicable)
- ii. Heat run test
- iii. Short time current test(If applicable)
- iv. Noise level test

4) Transformers (In case of non integrated type)

6693/2020/PS-REM-MAX

VARIABLE FREQUENCY DRIVES

- i. As per requirements mentioned in subsection for Transformer chapter in technical specifications.

CLAUSE NO.	TECHNICAL REQUIREMENTS			
1.00.00	CONTROL DESK & PANELS			
1.01.00	GENERAL			
1.01.01	All control desk, panels, LVS panel etc. shall be furnished fully wired with necessary provision for convenience outlets, internal lighting, grounding, ventilation, space heating, anti vibration pads, internal piping & accessories as required for completeness of the system.			
1.01.02	All panels, desks, cabinets shall be free standing type & have bottom / top entry for cables to be finalised application wise during detailed engineering stage. The bottom of desk & cabinets shall be sealed with bottom plate, compression cable glands (double for field and single for inside rooms) and fire proof sealing material to prevent ingress of dust and propagation of fire. Sufficient number of power receptacles with disconnect switches shall be installed within all panels/desk.			
1.01.03	Exterior steel surface shall be sand blasted, ground smooth, filled, primed, sanded and smooth enamel painted to give a good finish subject to minimum paint thickness of 65-75 microns for sheet thickness of 3 mm and 50 microns for sheet thickness of 2mm. The exact color shall be finalised during detailed engineering.			
1.01.04	The design shall conform to the EN ISO 11064 (Ergonomical design of control room), Part-1,2 and 3.			
2.00.00	CONTROL DESK & PANEL			
2.01.00	GENERAL			
2.01.01	The exact dimensions, material, construction details, grounding, general arrangement etc. of Control Desk etc. shall be as per the actual requirement and shall be finalised during detailed engineering and subjected to Employer's Approval.			
2.01.02	For control desk mounted instruments/ devices etc., which are to be powered from UPS, all required conversion of interface equipments / accessories to make such devices compatible with UPS supply shall be provided. All necessary hardware like Input switches/ fuse unit for each feeder as well as switch fuse unit for each instrument/ device on the power supply line shall be provided. From UPS, redundant feeders shall be provided with suitably rated MCB and provision of fast auto changeover of UPS feeders.			
2.02.00	Control Desk (CD)			
2.02.01	Control desk shall be Modular, non-welded construction free standing table top type with front & back cover constructed of 1.6 mm thick CRCA steel plates. The tabletop of the control desk shall be arc-shaped for mounting TFT monitors & mice. The work surface of control desk shall be 30mm thick with the top 12mm of Acrylic Solid Surface (ASS) and the remaining 18mm of laminated medium density fiber board. Work surface shall be made of two different colors at same level and seamlessly joined in each section. The structure frame shall consist of extruded aluminum top and bottom horizontal beams and vertical support tensioned together to form an integrated, finished curvilinear shaped frame. Vertical & Horizontal supports, minimum 2.5mm and 2mm thick respectively, have to be provided for the structure frame. Extreme side legs shall be illuminated type and should complete the			
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2	SUB-SECTION-IIIC-9 CONTROL DESK & PANELS	PAGE 1 OF 3

CLAUSE NO.	TECHNICAL REQUIREMENTS			
	overall form and aesthetics of the desk. It shall have concealed cable & wire way management system. Telephone sets shall be mounted on the control desk. Sliding keyboard trays shall be provided on the CD. The exact profile of the desk, dimension and the radius of curvature shall be finalised during detailed engineering stage.			
2.02.02	All operator monitors & mice shall be mounted on this CD.			
2.02.03	The cabling / wiring between OWS & CPU's, power supply cables etc. shall be aesthetically routed and concealed from view.			
2.03.00	Internal Panel/Desk Items Equipment and devices mounted within the panels/desk shall be mounted on suitable racks/brackets and shall be arranged for convenient access for adjustment and maintenance work.			
LOT-1A PROJECTS, FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE		TECHNICAL SPECIFICATIONS SECTION – VI, PART-B BID DOC. NO.: CS-0011-109(1A)-2		SUB-SECTION-IIIC-9 CONTROL DESK & PANELS
				PAGE 2 OF 3



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A	
VOLUME	II B
SECTION	D
REV. NO. 03	DATE : 16-09-2013
SHEET	1 OF 6

1.0 SCOPE

This specification covers the Design, Manufacture, Inspection and Testing at the manufacturer's works, proper packing for transportation and delivery to site, **supervision, erection, and commissioning at site** of Local Panels required for control and monitoring of the Auxiliary Plant & Equipment.

2.0 CODES AND STANDARDS

2.1 All the equipments specified herein shall comply with the requirements of the latest issue of the relevant National and International standards.

2.2 As a minimum requirement, the following standards shall be complied with:

- a) IS-6005 : 1998 : Code of practice for phosphating of iron and steel.
- b) IS-5 : 2007 : Colors for ready mixed paints and enamels.
- c) IS-1248:2003 : Direct Acting Indicating Analog Elec Measuring Instruments.
- d) IS/IEC 60947:Part 1:2004 : Low Voltage switchgear & control gear: Part-I (General Rules)
- e) IS-8828:1996 : Circuit breaker for household and similar installations.
- f) IS-13947 (Part-I):1993 : Low Voltage switchgear & control gear : Part-I (General Rules)
- g) ISA-18.1:1979 : Annunciator Sequences and Specification
- h) NFPA-496:2003 : Purged & Pressurised Enclosure for Electrical Equipment in Hazardous Locations.

3.0 TECHNICAL REQUIREMENTS

3.1 Panel Construction

3.1.1 The local panels shall house the secondary instruments, annunciation system, Single loop controller, Control switches / push buttons, indicating lamps/**LED cluster**, relays, timers and other devices required for operation and monitoring of the equipment locally.

3.1.2 The panels shall be of free standing type either welded construction on angle iron (minimum section of 50 x 50 x 4 mm) structure or folded construction by sheet metal formation depending upon the equipments to be mounted on it. The panels shall be robustly built and **stiffeners** as necessary shall be provided.

3.1.3 The panel shall be suitably reinforced to ensure adequate support for all instruments mounted thereon. All welds on exposed panel surfaces shall be ground smooth.

3.1.4 The salient features of construction shall be:

Sheet material: Cold rolled sheet steel

Frame thickness: Not less than 3.0mm

Enclosure thickness: Not less than 2.5 mm for load bearing sections (Mounted with instruments)
1.6 mm for doors and Not less than 2.0 mm for others

Panel Height: Not less than 2365 mm (Refer data sheet-A (No. PES-145A-DS1-0)

Gland plate thickness: 3.0mm

Base channel: ISMC 100 with anti-vibration mounting & foundation bolts.

3.1.5 The panel shall be provided with rear doors with integral lockable handle. The door when locked shall be held at minimum three places. The door width shall not be more than 550mm. The doors shall be provided with suitable **stiffeners** to prevent buckling. The handle shall be on the right side of the door. The door shall be removable type with concealed hinges to facilitate maintenance work. Suitable pocket inside the door shall be provided for keeping the drawings / documents. **Double door shall be provided with suitable glass windows, as per the requirement.**

3.1.6 Suitable neoprene gasket shall be provided on all doors and removable covers. Suitable ventilation **system along with louvers** shall be provided at bottom and top of the doors covered with removable wire mesh.



SPECIFICATION FOR LOCAL PANELS

SPECIFICATION NO.: PE-SS -999- 145 -054A	
VOLUME	II B
SECTION	D
REV. NO. 03	DATE : 16-09-2013
SHEET	2 OF 6

- 3.1.7 The class of protection shall be in accordance with IP-42 unless otherwise specified in the data sheet – A (No. PES-145-54A-DS1-0).
- 3.1.8 All steel surfaces shall be cleaned by sand / pellet blasting, treated for pickling, degreasing and phosphating etc. by seven tank method. The panel shall have a high quality finish and appearance. The panel shall be painted with two coats of primer followed by two coats of epoxy / synthetic enamel based final paint of color shade and finish as given in data sheet-A (No. PES-145A-DS1-0). Minimum thickness of the paint shall be 85 microns for external paint and 70 microns for internal paint.
- 3.1.9 The cable glands of the required size and type as given in data sheet-A (No. PES-145A-DS1-0) shall be supplied alongwith the Panel.
- 3.1.10 All operable and indicating devices shall be mounted on the front of the panel while aux. Relays / timers MCBs etc. required for realization of control logics shall be mounted on a mounting plate inside the panel. Auxiliary relays and timers etc. shall be grouped according to the control function. No operable or indicating devices shall be mounted below 750 mm and above 1800 mm (w.r.t. finished ground level). The devices shall be located in such a way so as to ensure easy access for operation / maintenance.
- 3.1.11 Single / dual control power supply feeders of voltage class as specified in data sheet-A (No. PES-145A-DS1-0) shall be provided by the purchaser. In case redundant power supply feeders are provided then auto changeover unit shall be mounted on the panel are in the panel supplier's scope. Where DC control power supply is specified an additional 240V, 50 Hz AC supply feeder for powering of space heater and lighting shall be provided by the purchaser. Suitable arrangement shall be provided inside the panel to receive and terminate the power supply feeder(s). For this purpose MCBs of suitable current rating shall be provided by the vendor. A supervisory relay along with a pilot lamp to indicate control supply 'ON' shall be provided on the panel. Any other power supply required for the operation of the devices mounted in the panel shall be arranged by the vendor.
- 3.1.12 The internal wiring shall be carried out with 1100 volt grade PVC insulated copper multi strand wire / flexible of 1.5mm² size. AC & DC wires shall be kept separate from each other. Separate coloured wires to be used for AC and DC circuits. All wires shall be properly numbered and identified with ferrules as per the Control scheme / wiring diagram. Wires shall be routed and run through PVC troughs.
- 3.1.13 Terminal blocks shall be clip on type, 1100 volts grade. Separate terminal blocks shall be used for AC & DC circuits. The terminals shall be suitable for terminating 0.5 mm² to 2.5mm² external cables. **The TB points in terminal block shall be cage clamp type / screw type.** The terminal for ammeters shall be provided with removable links for shorting CTs. Each terminal strip shall be provided with identification strip. The terminal shall not be mounted below 250 mm **height from finished floor. The panel shall have ten (20) percent spare terminal.**
- 3.1.14 The interior of each panel shall be suitably illuminated through fluorescent **lamps / tube lights with shrouded cover of minimum 15W** operable on 240V 50 Hz AC power supply through panel door switch. A 15 Amp. 3-pin Power receptacle shall be provided.
- 3.1.15 Suitable space heaters operable on 240 Volts 50 Hz AC power system shall be provided at the panel bottom. These shall be designed to maintain the panel temperature five (5) deg. C above the ambient temperature during maintenance shutdown. Suitable isolating and control devices comprising of MCB, thermostat etc. shall be provided for the space heater.
- 3.1.16 The panel shall be provided with a copper earth bus of 25 x 6 mm size running throughout the width of the panel. It shall be terminated internally with 10 mm bolts at extreme ends for connection to; main station earth. The panel mounted equipments / devices shall be connected to earth bus through green coloured PVC insulated stranded copper conductor of 2.5 mm² size.
- 3.1.17 Local Panel shall be provided with main name plate of 150 mm x 40 mm size having inscription of 20 mm height. The individual devices on the panels shall be as provided with separate name plate with inscription of 3 mm height. The instrument / devices shall be provided with stick on label plates inside the panel. The material of the main and individual labels shall be three (3) ply 3 mm thick Traffolyte