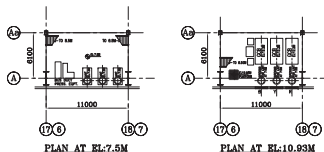
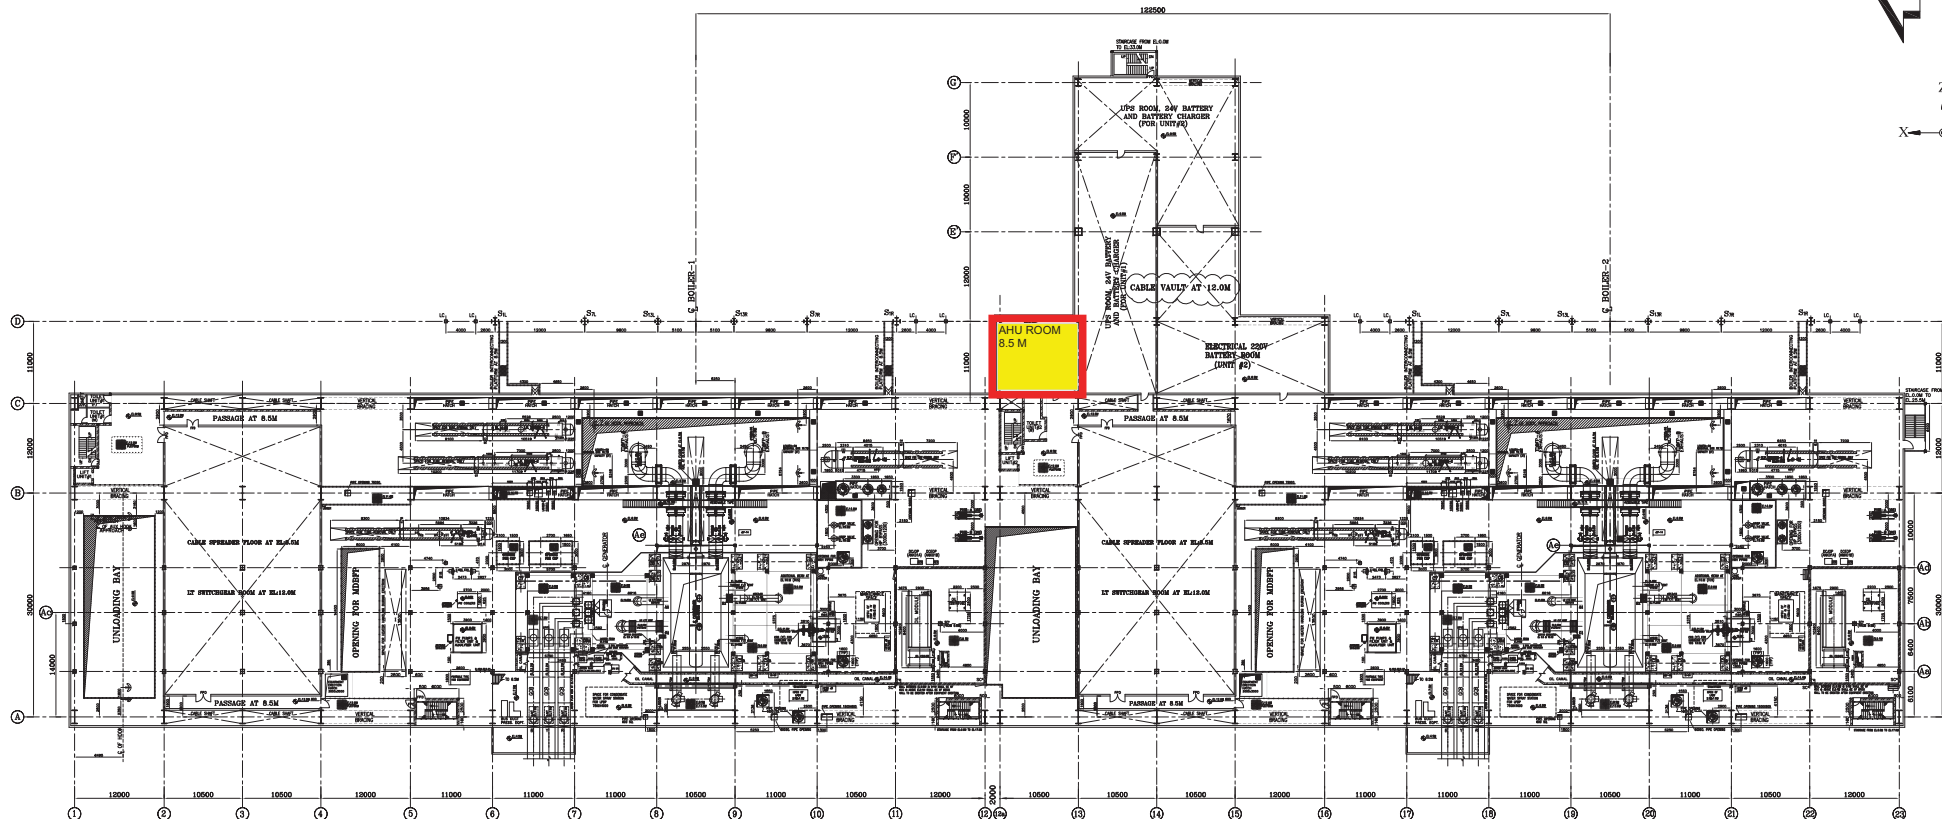


NORTH



- LEGEND:**
- CHECKERED PLATE FLOORING
 - REMOVABLE CHECKERED PLATE
 - GRATED FLOORING
 - REMOVABLE GRATING
 - CONCRETE BLOCK
 - HAND RAILING
 - PARAPET WALL
 - GLASS PARTITION
 - CUT OUT
 - BRICK WALL

NOTES:

1. ALL DIMENSIONS ARE IN METERS AND LEVELS ARE IN METERS.
2. ALL ELEVATIONS PROVIDED IN THE DRG ARE B.S.P. FROM RAISE GROUND FLOOR ELEVATION AS 8.50M, WHICH CORRESPONDS TO R.L. 11.050M.
3. EQUIPMENT ROOMS SHOWN IN THE DRAWING ARE WORKING ROOMS, THE SAME SHALL BE PROVIDED DURING DETAILED ENGINEERING.

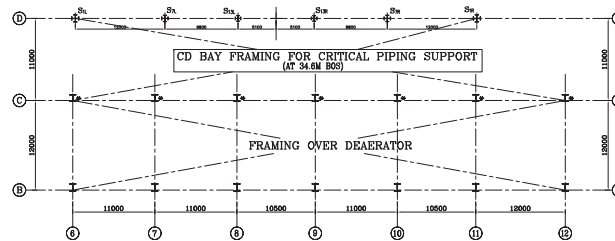

REFERENCE DRAWINGS:

- | | |
|---|------------------------|
| 1. EQUIPMENT PLAN AT 8.50M | PE-00-412-100-0001 |
| 2. EQUIPMENT PLAN AT 11.00M | PE-00-412-100-0002 |
| 3. EQUIPMENT PLAN AT 24.00M/25.00M | PE-00-412-100-0003 |
| 4. CROSS SECTION OF MAIN PLANT | PE-00-412-100-0007 |
| 5. CONDENSER ASSEMBLY (S.A.) | CHS-00-000-0000 (S.A.) |
| 6. GENERATOR OUTLINE | --- (S.A.) |
| 7. OIL ROOM APPROPRIATE | --- (S.A.) |
| 8. FOUNDATION DETAILS OF GEN. ALTERNATOR EQUIPMENTS | --- (S.A.) |
| 9. LP BYPASS VALVE ARRANGEMENT | --- (S.A.) |
| 10. GENERAL ARRANGEMENT OF LP HEATER No-1 | --- (S.A.) |
| 11. GENERAL ARRANGEMENT OF LP HEATER No-2 | --- (S.A.) |
| 12. GENERAL ARRANGEMENT OF LP HEATER No-3 | --- (S.A.) |
| 13. GENERAL ARRANGEMENT OF LP HEATER No-4 | --- (S.A.) |
| 14. GENERAL ARRANGEMENT OF HP HEATER No-5 | --- (S.A.) |
| 15. FOUNDATION DETAILS OF HP HEATER (S.A.) | --- (S.A.) |
| 16. TURNING JOINT LAYOUT | --- (S.A.) |
| 17. OIL CANAL | --- (S.A.) |

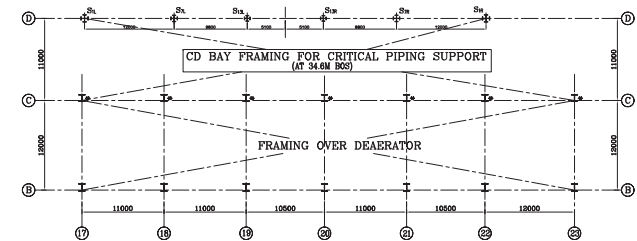
REV	DATE	ALTO	CHD	APPRO	REV	DATE	ALTO	CHD	APPRO

PROJECT 2x660 MW ENNORE SEZ COAL BASED STPP AT ASH DYKE OF NCTPS, CHENNAI	
CUSTOMER: TAMILNADU GENERATION AND DISTRIBUTION CORPORATION LIMITED (TANGEDCO)	
CONSULTANT: DESIGN PRIVATE LIMITED DESIGN HOUSE, GREATER KAILASH-II, NEW DELHI	
JOB NO. 412	CONTRACT
DEVELOPER: SHARAT HEAVY ELECTRICALS LTD POWER SECTOR ENGINEERING MANAGEMENT NEW DELHI	
TITLE T.G. EQUIPMENT LAYOUT PLAN AT EL. 8.50M	
DEPT. PE-00	SCALE: 1:200
DRN 112-100-0004	DRAWING NO.
DATE 14/08/2014	DATE

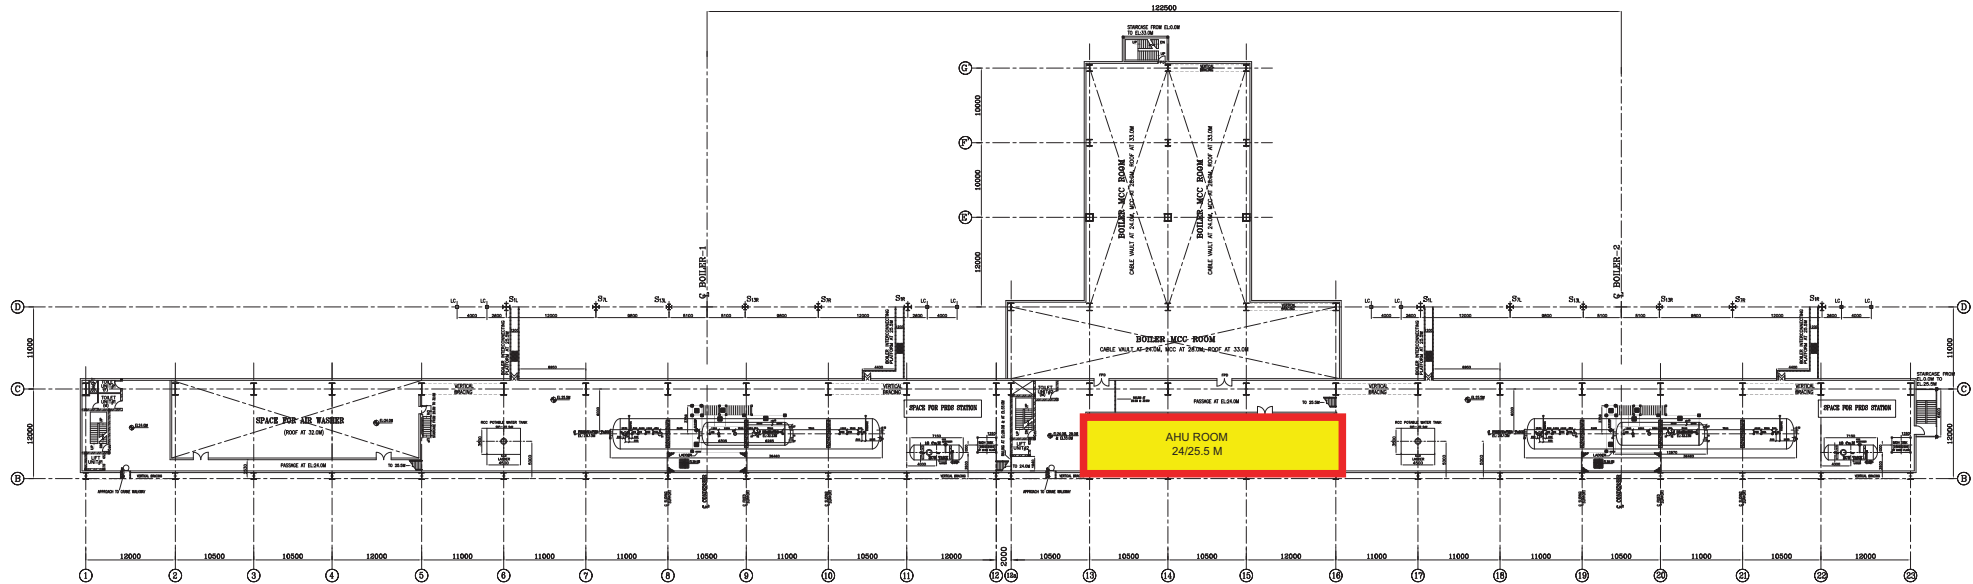
Anshul
S A Khan
Praveen Kishore



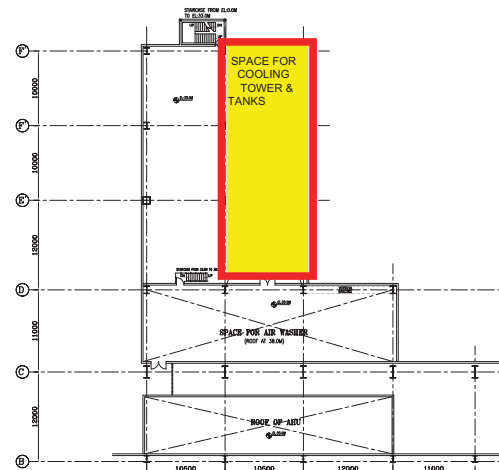
PLAN AT EL:37.5M (TOS)



PLAN AT EL:37.5M (TOS)



PLAN AT EL:24.0M/25.5M



- NOTES:
1. ALL DIMENSIONS ARE IN METERS AND LEVELS ARE IN METERS.
 2. ALL DIMENSIONS INDICATED IN THE PLAN ARE MEASUREMENTS FROM THE EXISTING FLOOR LEVEL TO THE TOP OF THE ROOF.
 3. EQUIPMENT SIZES SHOWN IN THE DRAWING ARE INDICATIVE ONLY. THE SAME SHALL BE FINALIZED DURING DETAILED ENGINEERING.

- LEGEND:
- CHECKERED PLATE FLOORING
 - REMOVABLE CHECKERED PLATE
 - GRADED FLOORING
 - REMOVABLE GRATING
 - CONCRETE BLOCK
 - HAND RAILING
 - PARAMET WALL
 - GLASS PARTITION
 - CUT OUT
 - BRICK WALL

REFERENCE DRAWINGS:

1. EQUIPMENT PLAN AT 0.0M
2. EQUIPMENT PLAN AT 8.5M
3. EQUIPMENT PLAN AT 17.0M
4. CROSS SECTION OF MAIN PLANT
5. GA OF DEAERATOR
6. DEAERATOR PLATFORM ASSEMBLY
7. GA OF SINK TANK
8. GA OF SINK DOING TANK
9. GA OF PORTABLE WATER TANK

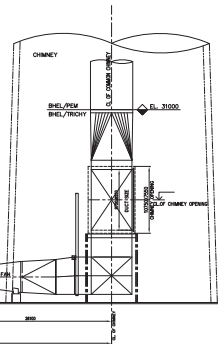
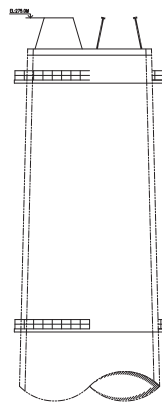
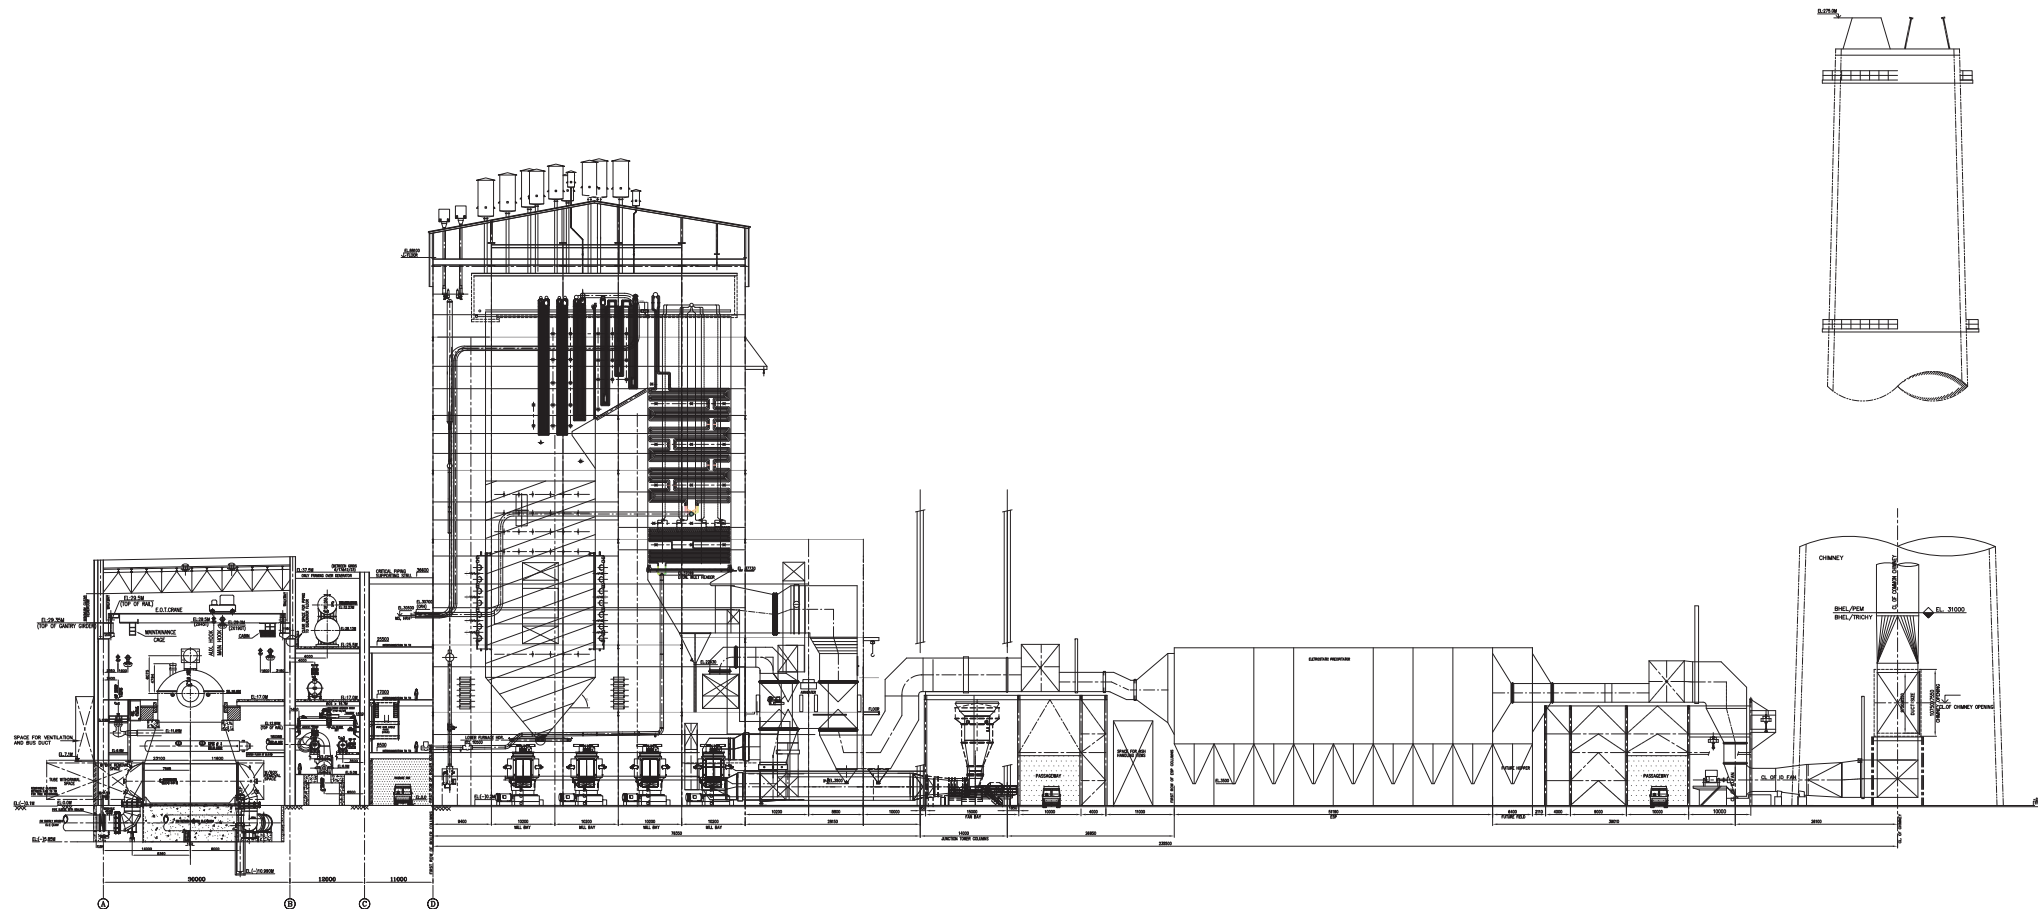
- PE-00-412-100-M003
PE-00-412-100-M004
PE-00-412-100-M005
PE-00-412-100-M007
--- (HND)
--- (HND)
--- (HND)
--- (HND)
--- (HND)

Anshul

S A Khan

Praveen Kishore

PROJECT 2x660 MW ENNORE SEZ COAL BASED STTP AT ASH DYKE OF NCTPS, CHENNAI	
CUSTOMER TAMILNADU GENERATION AND DISTRIBUTION CORPORATION LIMITED (TANGEDCO)	
CONSULTANT DESIGN PRIVATE LIMITED DESIGN HOUSE, GREATER KAILASH-II, NEW DELHI	
DESIGN DESIGNER CHECKER APPROVER	
JOB NO. 412	
STATUS CONTRACT	
DISTRIBUTION TO FROM	
REVISION REV. DATE ALTO CHD APPD	
DATE	
SCALE: 1:500	
DRAWING NO. PE-00-412-100-M006	
DATE	
FORMAT SIZE A0	



REFERENCE DRAWINGS:

1. MAIN EQUIPMENT PLAN LAYOUT
2. EQUIPMENT PLAN AT 0.0M
3. EQUIPMENT PLAN AT 8.5M
4. EQUIPMENT PLAN AT 17.0M
5. EQUIPMENT PLAN AT 24.0M/ 25.5M
6. GA OF BOILER SECTIONAL SIDE ELEVATION
7. GA OF D SYSTEM SIDE ELEVATION
8. GA OF CONDENSER
9. GA OF DEARATOR
10. GA OF CEP
11. CW PIPING LAYOUT INSIDE TO BUILDING

- PE-00-412-100-M002
PE-00-412-100-M003
PE-00-412-100-M004
PE-00-412-100-M005
PE-00-412-100-M006
--- (REV)
01601070702030 (HMR)
--- (HFD)
--- (HYD)
--- (PEM)

NOTES:-

1. ALL DIMENSIONS ARE IN MM'S AND LEVELS ARE IN METRES.
2. ALL ELEVATIONS INDICATED IN THE Dwg. ARE W.R.T. POWER HOUSE GROUND FLOOR ELEVATION AS 0.00M, WHICH CORRESPONDS TO RL (+)10.0M.
3. EQUIPMENT SIZES SHOWN IN THIS DRAWING ARE INDICATIVE ONLY, THE SAME SHALL BE FINALIZED DURING DETAILED ENGINEERING.

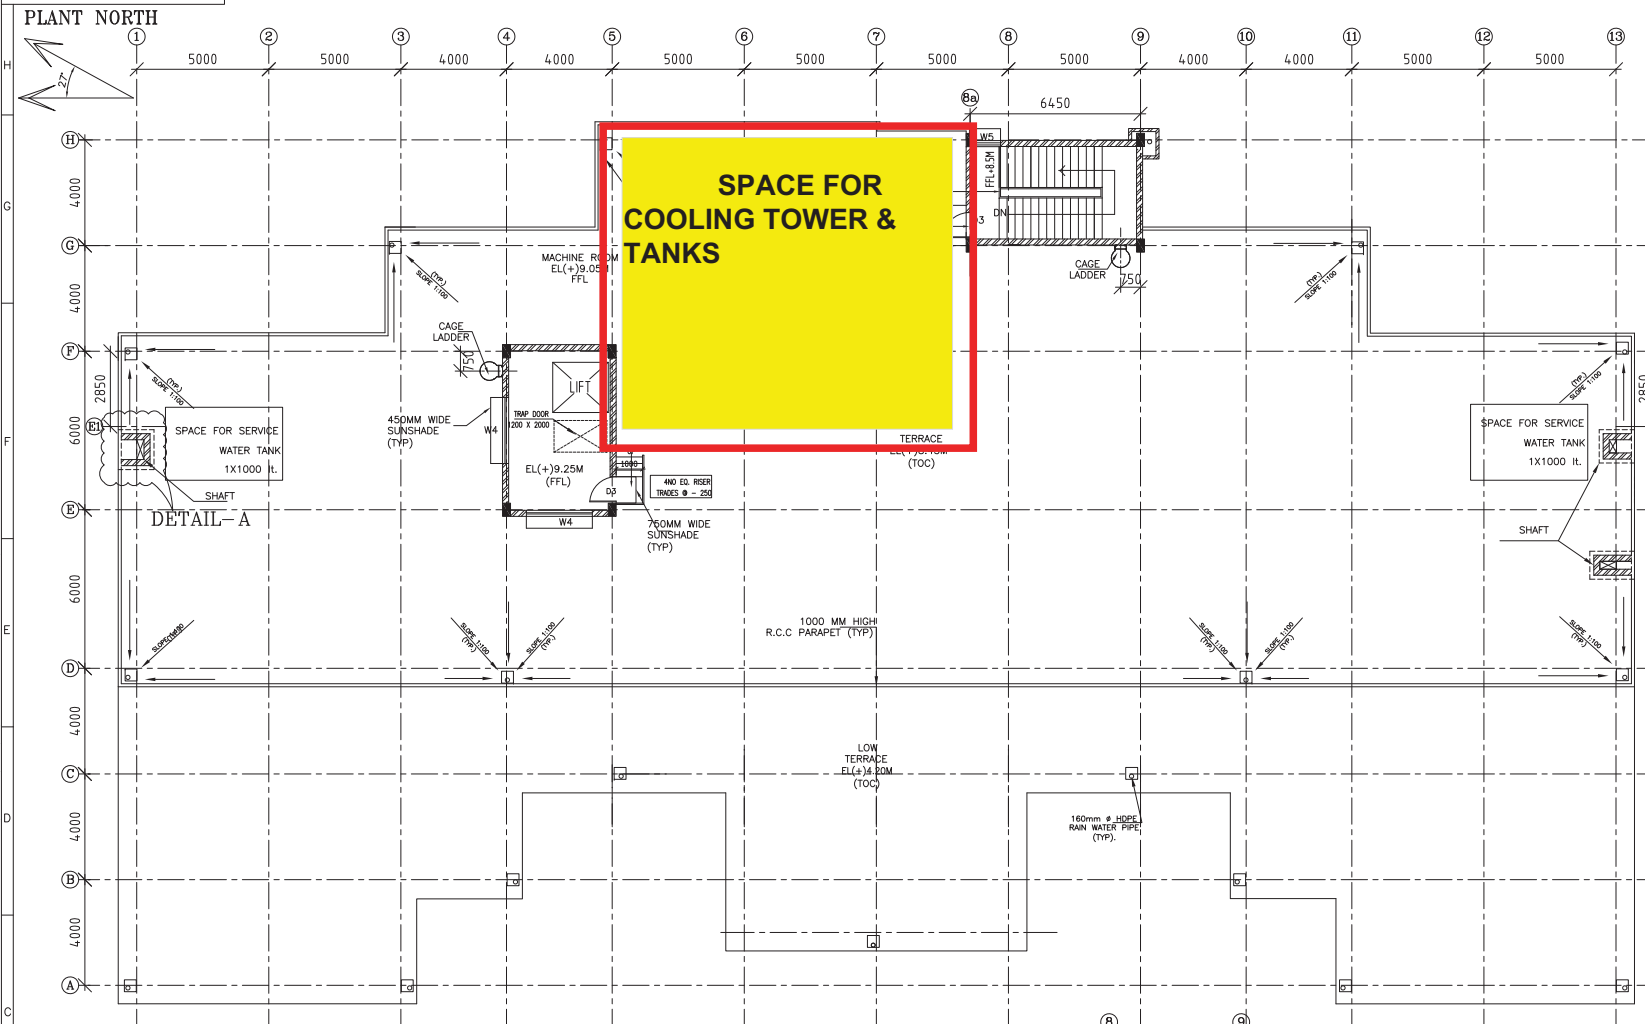
JOB NO.	412
STATUS	CONTRACT
DISTRIBUTION	DESIGN
TO	
BY	
DATE	

PROJECT 2x660 MW ENNORE SEZ COAL BASED STPP AT ASH DYKE OF NCTPS, CHENNAI	
CUSTOMER	TAMILNADU GENERATION AND DISTRIBUTION CORPORATION LIMITED (TANGEDCO)
CONSULTANT	DESIGN PRIVATE LIMITED DESIGN HOUSE, GREATER KAILASH-II, NEW DELHI
DESIGNER	SHARAT HEAVY ELECTRICALS LTD POWER SECTOR PROJECT ENGINEERING MANAGEMENT NEW DELHI
DATE	18/12/2014
SCALE	1:1000
DRAWING NO.	PE-00-412-100-M007
DATE	18/12/2014
FORMAT	A3


Anshul

S A Khan

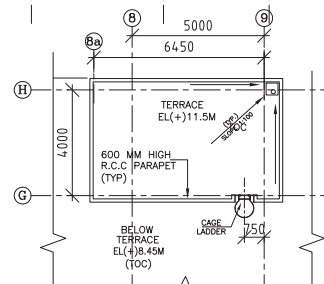
Praveen Kishore



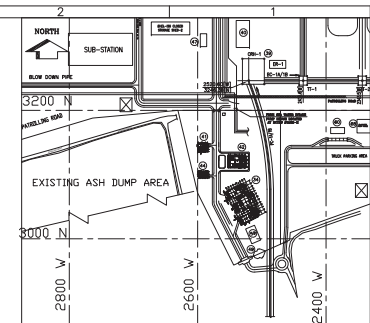
ROOF PLAN AT EL(+)8.45M



PLAN AT EL.(+)13.25M
(FOR MACHINE ROOM ROOF)



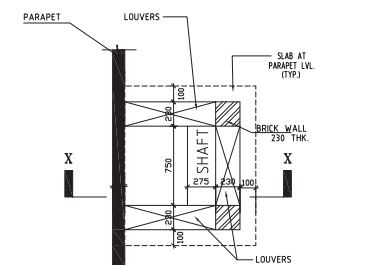
PLAN AT EL(+)^{11.5}M
(FOR STAIRCASE ROOF)




KEY PLAN

REFERENCE DRAWINGS:-

1. FOR GENERAL NOTES REFER DRAWING NO. ---PE-DG-412-611-C031
2. PLOT PLAN ----- PE-DG-412-100-M001
3. ARCH. PLAN AT EL+0.00M ----- PE-DG-412-641-C001
4. ARCH. PLAN AT EL+4.25M ----- PE-DG-412-641-C002
5. FINISHING DETAILS ----- PE-DG-412-641-C011



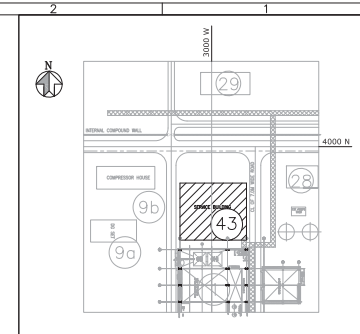
DETAIL-A



SECTION X-X

BHEL-PROJECT ENGINEERING MANAGEMENT(CIVIL)	
THIS DRAWING MARKED(✓) IS RELEASED FOR	
☐ COMMENTS/APPROVAL ☐ PLANNING/INFORMATION ☐ CONSTRUCTION	
STAMP ALL PREVIOUS REVISION AS SUPERSEDED	
ISSUED BY	
NAME	S.PANDIT
SIGNATURE	
DATE	

PROJECT		2x860 MW ENNORE SEZ SUPERCRITICAL THERMAL POWER PROJECT AT ASH DYKE OF NCTPS, CHENNAI			
OWNER:		TAMILNADU GENERATION & DISTRIBUTION CORPORATION LIMITED			
CONSULTANT		DESEIN PRIVATE LIMITED DESEIN HOUSE, NEW DELHI			
					
BHARAT HEAVY ELECTRICALS LTD POWER SECTOR PROJECT ENGINEERING MANAGEMENT NEW DELHI		DEPT CODE	NAME	SIGN	DATE
		C	DRN. USHA		11.03.2011
			DESEIN S.B		11.03.2011
			CHD S.PANJIT		11.03.2011
			APPAL A.NARAYAN		11.03.2011
ADMINISTRATIVE BUILDING ROOF PLAN AT EL (+) 8.45M					
		DEPT. SCALE:	DRAWING NO.		
		SIGN	PE-DG-412-641-C003		
		DATE	SHEET 1 OF 1 REV. 0		

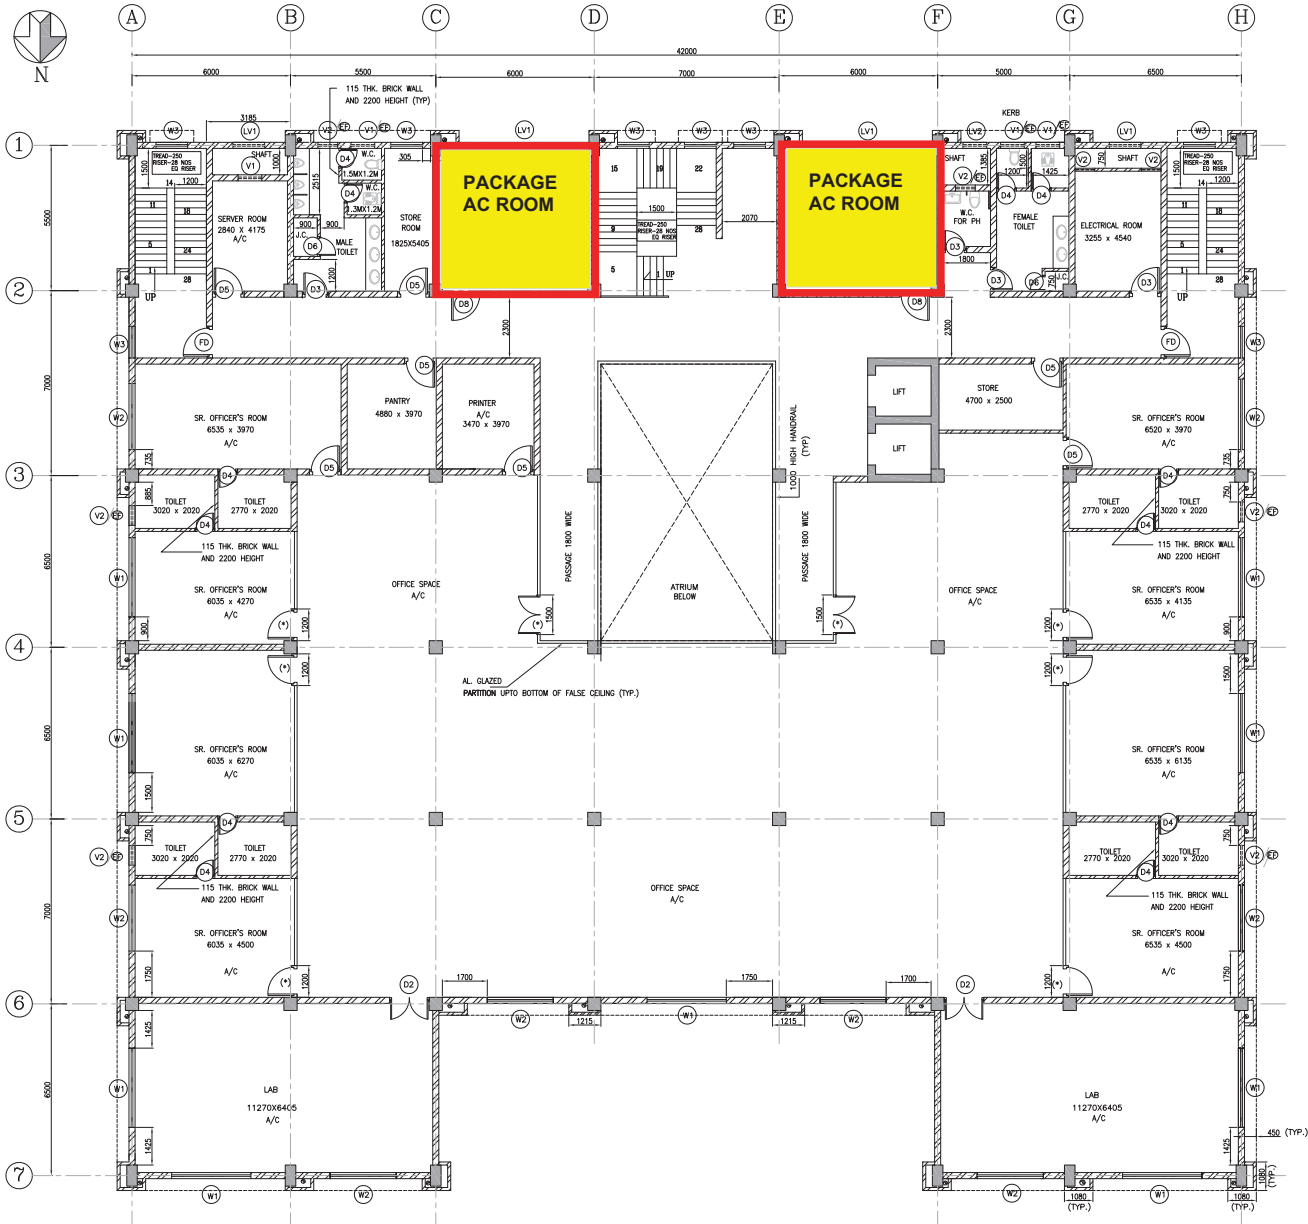


BHEL-PROJECT ENGINEERING MANAGEMENT(CIVIL)	
THIS DRAWING MARKED (✓) IS RELEASED FOR	
☐ COMMENTS/APPROVAL ☐ PLANNING/INFORMATION ☐ CONSTRUCTION	
STAMP ALL PREVIOUS REVISION AS SUPERSEDED	
ISSUED BY	
NAME	S.PANDIT
SIGNATURE	
DATE	02.02.2015

(*)= DOORS MARKED WITH (*) ARE PART OF ALUMINIUM PARTITION

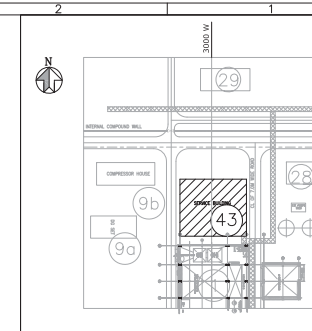
FORMAT SIZE A1

COPY RIGHT AND CONFIDENTIAL
The information on this document is the property of BHARAT HEAVY ELECTRICALS LIMITED
It must not be used directly or indirectly in any way detrimental to the interest of the company.



PLAN AT EL (+) 8.500M LEVEL

(*)= DOORS MARKED WITH (*) ARE PART OF ALUMINIUM PARTITION



KEY PLAN

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETERS AND ELEVATIONS IN METERS UNLESS NOTED.
2. ALL ELEVATIONS ARE REFERRED TO THE FINISHED GROUND FLOOR LEVEL OF POWER HOUSE BUILDING AS EL. 0.00 M WHICH CORRESPONDS TO RL +10.00 M.
3. UNLESS NOTED OTHERWISE WINDOW / DOOR/ ROLLING SHUTTER LOCATION SHALL BE AT CENTER BETWEEN GRIDS.
4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH CONTRACT TERMS AND CONDITIONS, SPECIFICATION AND SCHEDULE OF ITEMS.

ARCH. REF. DWG.

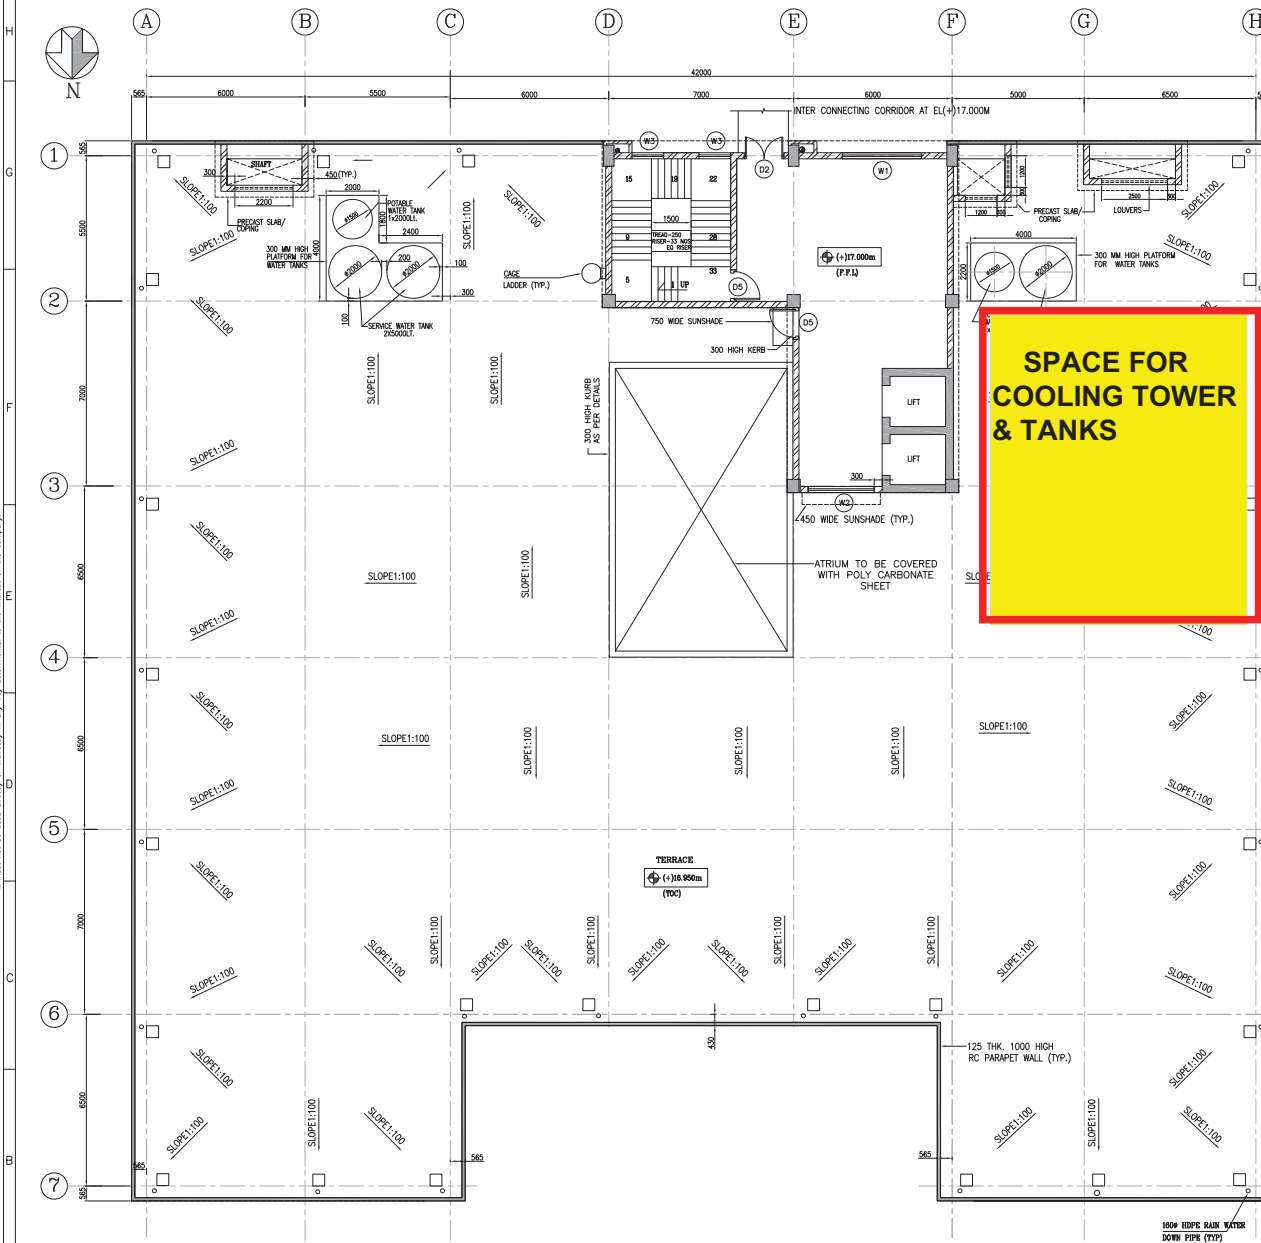
- | | |
|---|--------------------|
| 1. PLOT PLAN | PE-DG-412-100-M001 |
| 2. ARCH. PLAN AT EL+0.000M | PE-DG-412-640-C001 |
| 3. ARCH. PLAN AT EL+4.250M | PE-DG-412-640-C002 |
| 4. ARCH. PLAN AT EL+12.750M | PE-DG-412-640-C004 |
| 5. ARCH. PLAN AT EL+17.000M | PE-DG-412-640-C005 |
| 6. DOOR WINDOWS AND FINISHING SCHEDULE | PE-DG-412-640-C006 |
| 7. WINDOWS DETAILS | PE-DG-412-640-C013 |
| 8. DOOR AND PARTITION DETAILS | PE-DG-412-640-C014 |
| 9. TOILET DETAILS | PE-DG-412-640-C015 |
| 10. FOR GENERAL NOTES REFER DRAWING NO. | PE-DG-412-611-C031 |

LEGENDS

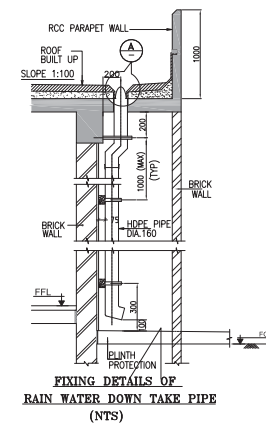
1. J.C ----- JANITOR CLOSET
2. T.O.C ----- TOP OF CONCRETE
3. F.G.L ----- FINISHED GROUND LEVEL
4. B.O.L ----- BOTTOM OF LINTEL
5. F.F.L ----- FINISHED FLOOR LEVEL
6. TYP ----- TYPICAL
7. THK ----- THICK
8. LVL ----- LEVEL
9. EX ----- EXHAUST FAN
10. P.H ----- PHYSICALLY HANDICAPPED

BHEL-PROJECT ENGINEERING MANAGEMENT(CIVIL)	
THIS DRAWING MARKED (✓) IS RELEASED FOR	
☐ COMMENTS/APPROVAL ☐ PLANNING/INFORMATION ☐ CONSTRUCTION	
STAMP ALL PREVIOUS REVISION AS SUPERSEDED	
ISSUED BY	
NAME	S.PANDIT
SIGNATURE	
DATE	02.02.2015


PROJECT  2x660 MW ENNORE SEZ SUPERCRITICAL THERMAL POWER PROJECT AT ASH DYKE OF NCTPS, CHENNAI	OWNER: TAMILNADU GENERATION & DISTRIBUTION CORPORATION LIMITED OWNER'S CONSULTANT: DESEIN PRIVATE LIMITED DESEIN HOUSE, NEW DELHI																				
 भारत भारी बिजली सी. लि. DESEIN	DEPT CODE <table border="1"> <thead> <tr> <th>DRN</th> <th>NAME</th> <th>SIGN</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td>DRN</td> <td>OM</td> <td></td> <td>02.02.2011</td> </tr> <tr> <td>DESN</td> <td>SR</td> <td></td> <td>02.02.2011</td> </tr> <tr> <td>CHD</td> <td>S. PANDEY</td> <td></td> <td>02.02.2011</td> </tr> <tr> <td>APPD</td> <td>A. NARAYAN</td> <td></td> <td>02.02.2011</td> </tr> </tbody> </table>	DRN	NAME	SIGN	DATE	DRN	OM		02.02.2011	DESN	SR		02.02.2011	CHD	S. PANDEY		02.02.2011	APPD	A. NARAYAN		02.02.2011
DRN	NAME	SIGN	DATE																		
DRN	OM		02.02.2011																		
DESN	SR		02.02.2011																		
CHD	S. PANDEY		02.02.2011																		
APPD	A. NARAYAN		02.02.2011																		
TITLE ARCHITECTURAL PLAN AT EL (+) 8.500M LEVEL	BHARAT HEAVY ELECTRICALS LTD POWER SECTOR PROJECT ENGINEERING MANAGEMENT NEW DELHI																				
DEPT. SCALE: SIGN DATE	DRAWING NO. PE-DG-412-640-C003 SHEET 1 OF 1 REV. 0																				




ROOF PLAN AT EL (+)17.000m



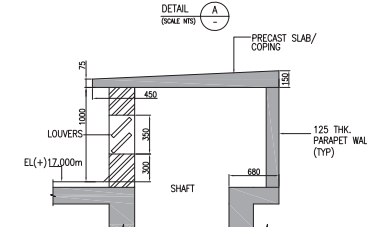
FIXING DETAILS OF
RAIN WATER DOWN TAKE PIPE
(NTS)



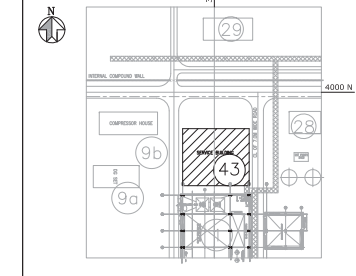
FIXTURE DETAIL



HDPE INLET & CATCH BASIN DETAILS



TYPICAL SHAFT DETAILS
(NTS)



KEY PLAN

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETERS AND ELEVATIONS IN METERS UNLESS NOTED.
 2. ALL ELEVATIONS ARE REFERRED TO THE FINISHED GROUND FLOOR LEVEL OF POWER HOUSE BUILDING AS EL. 0.00 M WHICH CORRESPONDS TO RL. -10.00 M.
 3. UNLESS NOTED OTHERWISE WINDOW / DOOR / ROLLING SHUTTER LOCATION SHALL BE AT CENTER BETWEEN GRIDS.
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH CONTRACT TERMS AND CONDITIONS, SPECIFICATION AND SCHEDULE OF ITEMS.

ARCH. REF. DWG.

- | | |
|--|--------------------|
| 1. PLOT PLAN ----- | PE-DG-412-100-M001 |
| 2. ARCH. PLAN AT EL+0.000M ----- | PE-DG-412-640-C002 |
| 3. ARCH. PLAN AT EL+1.250M ----- | PE-DG-412-640-C003 |
| 4. ARCH. PLAN AT EL+8.500M ----- | PE-DG-412-640-C003 |
| 5. ARCH. PLAN AT EL+12.750M ----- | PE-DG-412-640-C004 |
| 6. DOOR WINDOWS AND FINISHING SCHEDULE ----- | PE-DG-412-640-C006 |
| 7. WINDOWS DETAILS ----- | PE-DG-412-640-C013 |
| 8. DOOR AND PARTITION DETAILS ----- | PE-DG-412-640-C014 |
| 9. TOILET DETAILS ----- | PE-DG-412-640-C015 |
| 10. FOR GENERAL NOTES REFER DRAWING NO. - | PE-DG-412-611-C031 |

LEGENDS

1. T.O.C -----TOP OF CONCRETE
2. F.G.L -----FINISHED GROUND LEVEL
3. B.O.L -----BOTTOM OF LINTEL
4. F.F.L -----FINISHED FLOOR LEVEL
5. TYP -----TYPICAL
6. THK.-----THICK
7. LVL -----LEVEL

BHEL-PROJECT ENGINEERING MANAGEMENT(CIVIL)	
THIS DRAWING MARKED (✓) IS RELEASED FOR	
☐ COMMENTS/ APPROVAL ☐ PLANNING/ INFORMATION ☐ CONSTRUCTION	
STAMP ALL PREVIOUS REVISION AS SUPERSEDED	
ISSUED BY	
NAME	S.PANDIT
SIGNATURE	
DATE	02.02.2015

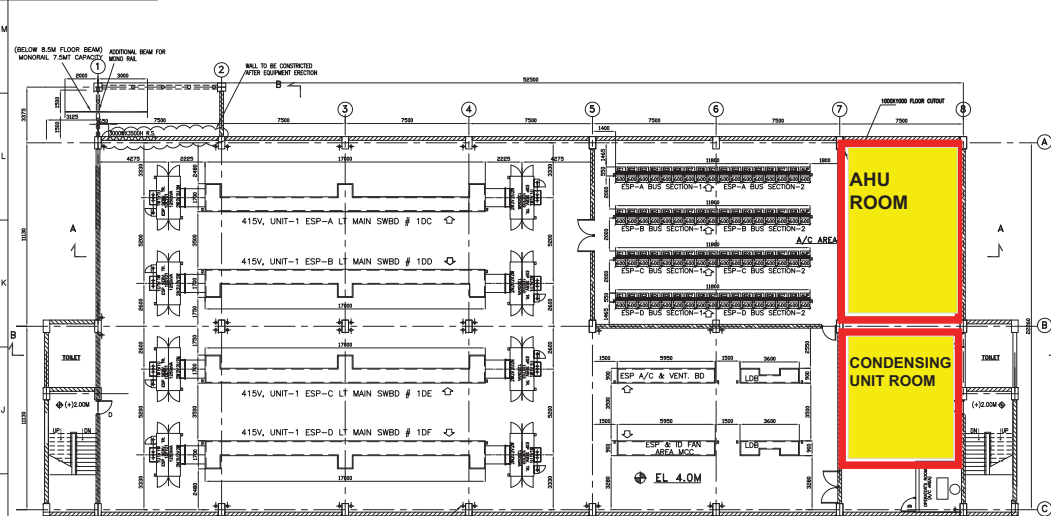
PROJECT		2x660 MW ENNORE SEZ SUPERCRITICAL THERMAL POWER PROJECT AT ASH DYKE OF NCTPS, CHENNAI																							
		OWNER: TAMILNADU GENERATION & DISTRIBUTION CORPORATION LIMITED																							
		OWNER'S CONSULTANT: DESEIN PRIVATE LIMITED DESEIN HOUSE, NEW DELHI																							
		BHARAT HEAVY ELECTRICALS LTD POWER SECTION PROJECT ENGINEERING MANAGEMENT NEW DELHI		<table border="1"> <thead> <tr> <th>DEPT</th> <th>NAME</th> <th>SIGN.</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td>DRN</td> <td>OM</td> <td></td> <td>02.02.2015</td> </tr> <tr> <td>DR</td> <td>SR</td> <td></td> <td>02.02.2015</td> </tr> <tr> <td>CHD</td> <td>S. PANDEY</td> <td></td> <td>02.02.2015</td> </tr> <tr> <td>APPO</td> <td>A. NARAYAN</td> <td></td> <td>02.02.2015</td> </tr> </tbody> </table>		DEPT	NAME	SIGN.	DATE	DRN	OM		02.02.2015	DR	SR		02.02.2015	CHD	S. PANDEY		02.02.2015	APPO	A. NARAYAN		02.02.2015
DEPT	NAME	SIGN.	DATE																						
DRN	OM		02.02.2015																						
DR	SR		02.02.2015																						
CHD	S. PANDEY		02.02.2015																						
APPO	A. NARAYAN		02.02.2015																						
TITLE		SERVICE BUILDING ARCHITECTURAL PLAN AT EL. (+) 17.00M LEVEL																							
DEPT.		SCALE:		DRAWING NO.																					
SIGN.				PE-DG-412-640-C005																					
DATE				SHEET 1 OF 1 REV. 0																					



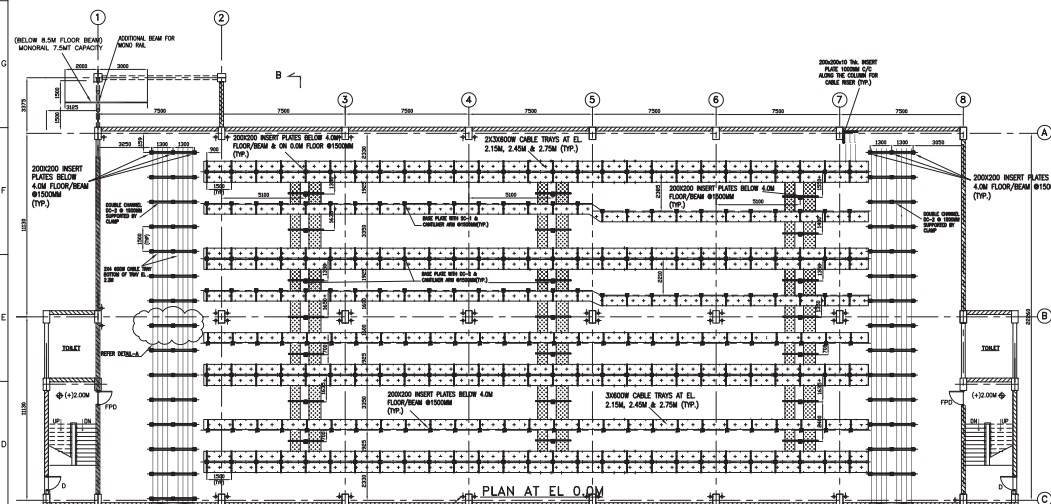
NOTE: (*) - ALUMINIUM GRILL SHALL BE PROVIDED FOR ALL GROUND FLOOR WINDOWS.
(**) - SILL FOR W3 WINDOW SHALL BE 900 FROM LANDING LVL AT STAIRCASE.

BHEL-PROJECT ENGINEERING MANAGEMENT(CIVIL)	
THIS DRAWING MARKED (✓) IS RELEASED FOR	
☐ COMMENTS/APPROVAL ☐ PLANNING/INFORMATION ☐ CONSTRUCTION	
STAMP ALL PREVIOUS REVISION AS SUPERSEDED	
ISSUED BY	
NAME	S.PANDIT
SIGNATURE	
DATE	02.02.2015

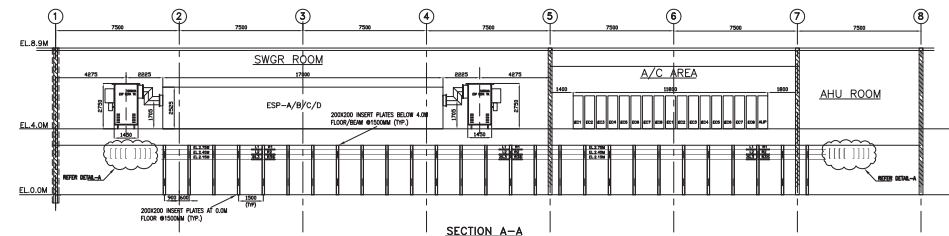
PROJECT	2x660 MW ENNORE SEZ SUPERCRITICAL THERMAL POWER PROJECT AT ASH DYKE OF NCTPS, CHENNAI									
										
OWNER:	TAMILNADU GENERATION & DISTRIBUTION CORPORATION LIMITED									
OWNER'S CONSULTANT:										
	DESEIN PRIVATE LIMITED DESEIN HOUSE, NEW DELHI									
DEPT	CODE	DRN	ORIN	NAME	SIGN	DATE	BHARAT HEAVY ELECTRICALS LTD			
							POWER SECTOR			
DEPT	CODE	DRN	ORIN	NAME	SIGN	DATE	PROJECT ENGINEERING MANAGEMENT			
							NEW DELHI			
				CHD	PANIGT	02.02.2017	APPD A. NARAYAN			
				CHD	PANIGT	02.02.2017				
							Bharat Heavy Electricals Limited Company			
TITLE							SERVICE BUILDING			
ROOF PLAN, DOOR, WINDOW & FINISHING SCHEDULE										
							DEPT.	SCALE:	DRAWING NO.	
							SIGN.		PE-DG-412-640-C006	
							DATE		SHEET 1 OF 1 REV. 0	
Page 569 of 697										



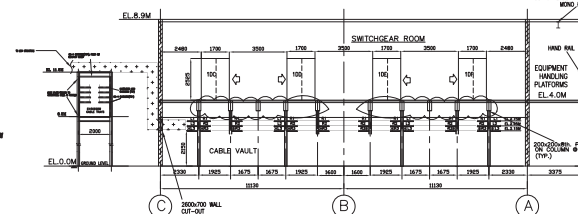
PLAN AT EL. 4.0M




PLAN AT EL. 0.0M



SECTION A-A



SECTION B-B



DETAIL-A

REFERENCE DRAWINGS :

S. NO.	TITLE	DRAWING NO.	SOURCE AGENCY
1.	PLOT PLAN	PE-DC-412-100-M001	PEM/ MPL
2.	MAIN PLANT EQUIPMENT LAYOUT PLAN	PE-DC-412-100-M002	PEM/ MPL
3.	CROSS SECTION OF MAIN PLANT	PE-DC-412-100-M007	PEM/ MPL
4.	RECOMMENDED CONTROL ROOM LAYOUT FOR ESP	2-00-114-29869	BHEL/ RANIPET
5.	ELECTRICAL SINGLE LINE DIAGRAM	PE-DC-412-565-E001	PEM/ ELECT
6.	CABLE ERECTION PHILOSOPHY	PE-DC-412-507-E004	BHEL/ ELECT
7.	TYPICAL DETAILS OF CABLE TRAYS & ACCESSORIES	PE-DC-412-507-E005	BHEL/ ELECT
8.	INSTALLATION DETAILS FOR CABLE TRAY SUPPORT SYSTEM	PE-DC-412-507-E006	BHEL/ ELECT
9.	DESIGN PHILOSOPHY FOR ELECTRICAL EQUIPMENTS LAYOUT	PE-DC-412-507-E101	BHEL/ ELECT

NOTES :

- ALL ELEVATIONS MARKED ARE W.R.T. T.G. HALL FINISHED FLOOR ELEVATION OF 0.0 M. WHICH CORRESPONDS TO RL +10.0M.
- ALL DIMENSIONS ARE IN MM AND ELEVATIONS IN METRES UNLESS STATED OTHERWISE.
- THE PANEL DIMENSIONS INDICATED IN DRAWING ARE TENTATIVE AND ARE SHOWN FOR DEVELOPING CONCEPTUAL LAYOUT.
- SEPARATE DRAWING IS SUBMITTED FOR UNIT-2 ESP CONTROL ROOM.
- THIS DRAWING IS TO BE REFERRED FOR DETAILS OF ELECTRICAL EQUIPMENT AND CABLING LAYOUT ONLY. LAYOUT SHOWN FOR FACILITIES SUCH AS AC & VENTILATION SYSTEM IS INDICATIVE & FOR INTERFACE PURPOSE. FOR EXACT LAYOUT OF OTHER SYSTEMS, RELEVANT DISCIPLINE DRAWINGS SHALL BE REFERRED.
- ALL AREAS SHOWN IN THIS DRAWING ARE NON A/C UNLESS STATED OTHERWISE.
- CABLE TRAYS & SUPPORTS INSTALLATION SHALL BE DONE AS PER REF. DRG. NO. 6, 7 & 8.
- BOTTOM MOST/OUTERMOST TRY OF ALL RUNS SHALL BE PERFORMED TYPE.

TABLE-I

S.NO.	EQUIPMENT	SOURCE
1.	ESP SG	BHEL/RANIPET
2.	EC	BHEL/RANIPET
3.	DT TRANSFORMERS	BHEL/JAWAH.
4.	NSP BUSDUCT	BHEL/CBU
5.	ESP & ID FAN AREA MCCs	BHEL/CBU
6.	AC & VENT MCC	BHEL/CBU
7.	LOB	PEM/ELECT.

LEGEND

- ☆ OPERATING FRONT OF THE PANEL
- BRICK WALL
- CABLE TRAYS
- CABLE TRAYS
- DOUBLE LEAF DOOR WITH TRANSOM ARRANGEMENT
- SINGLE LEAF DOOR (1000Wx2100H)
- FIRE PROOF DOOR
- PERFORATED TYPE CABLE TRAY

CUSTOMER

TAMILNADU GENERATION AND DISTRIBUTION CORPORATION LIMITED (TANGROO)

CONSULTANT

DESIGN PRIVATE LIMITED
DESIGN HOUSE, GREATER KAILASH-II, NEW DELHI

JOB NO.

412

STATUS

CONTRACT

DRAWN BY

NSG

CHECKED BY

NSG

PROJECT ENGINEERING MANAGEMENT

NOIDA

ELECTRICAL EQUIPMENT & CABLING LAYOUT IN ESP CONTROL BUILDING (UNIT-1)

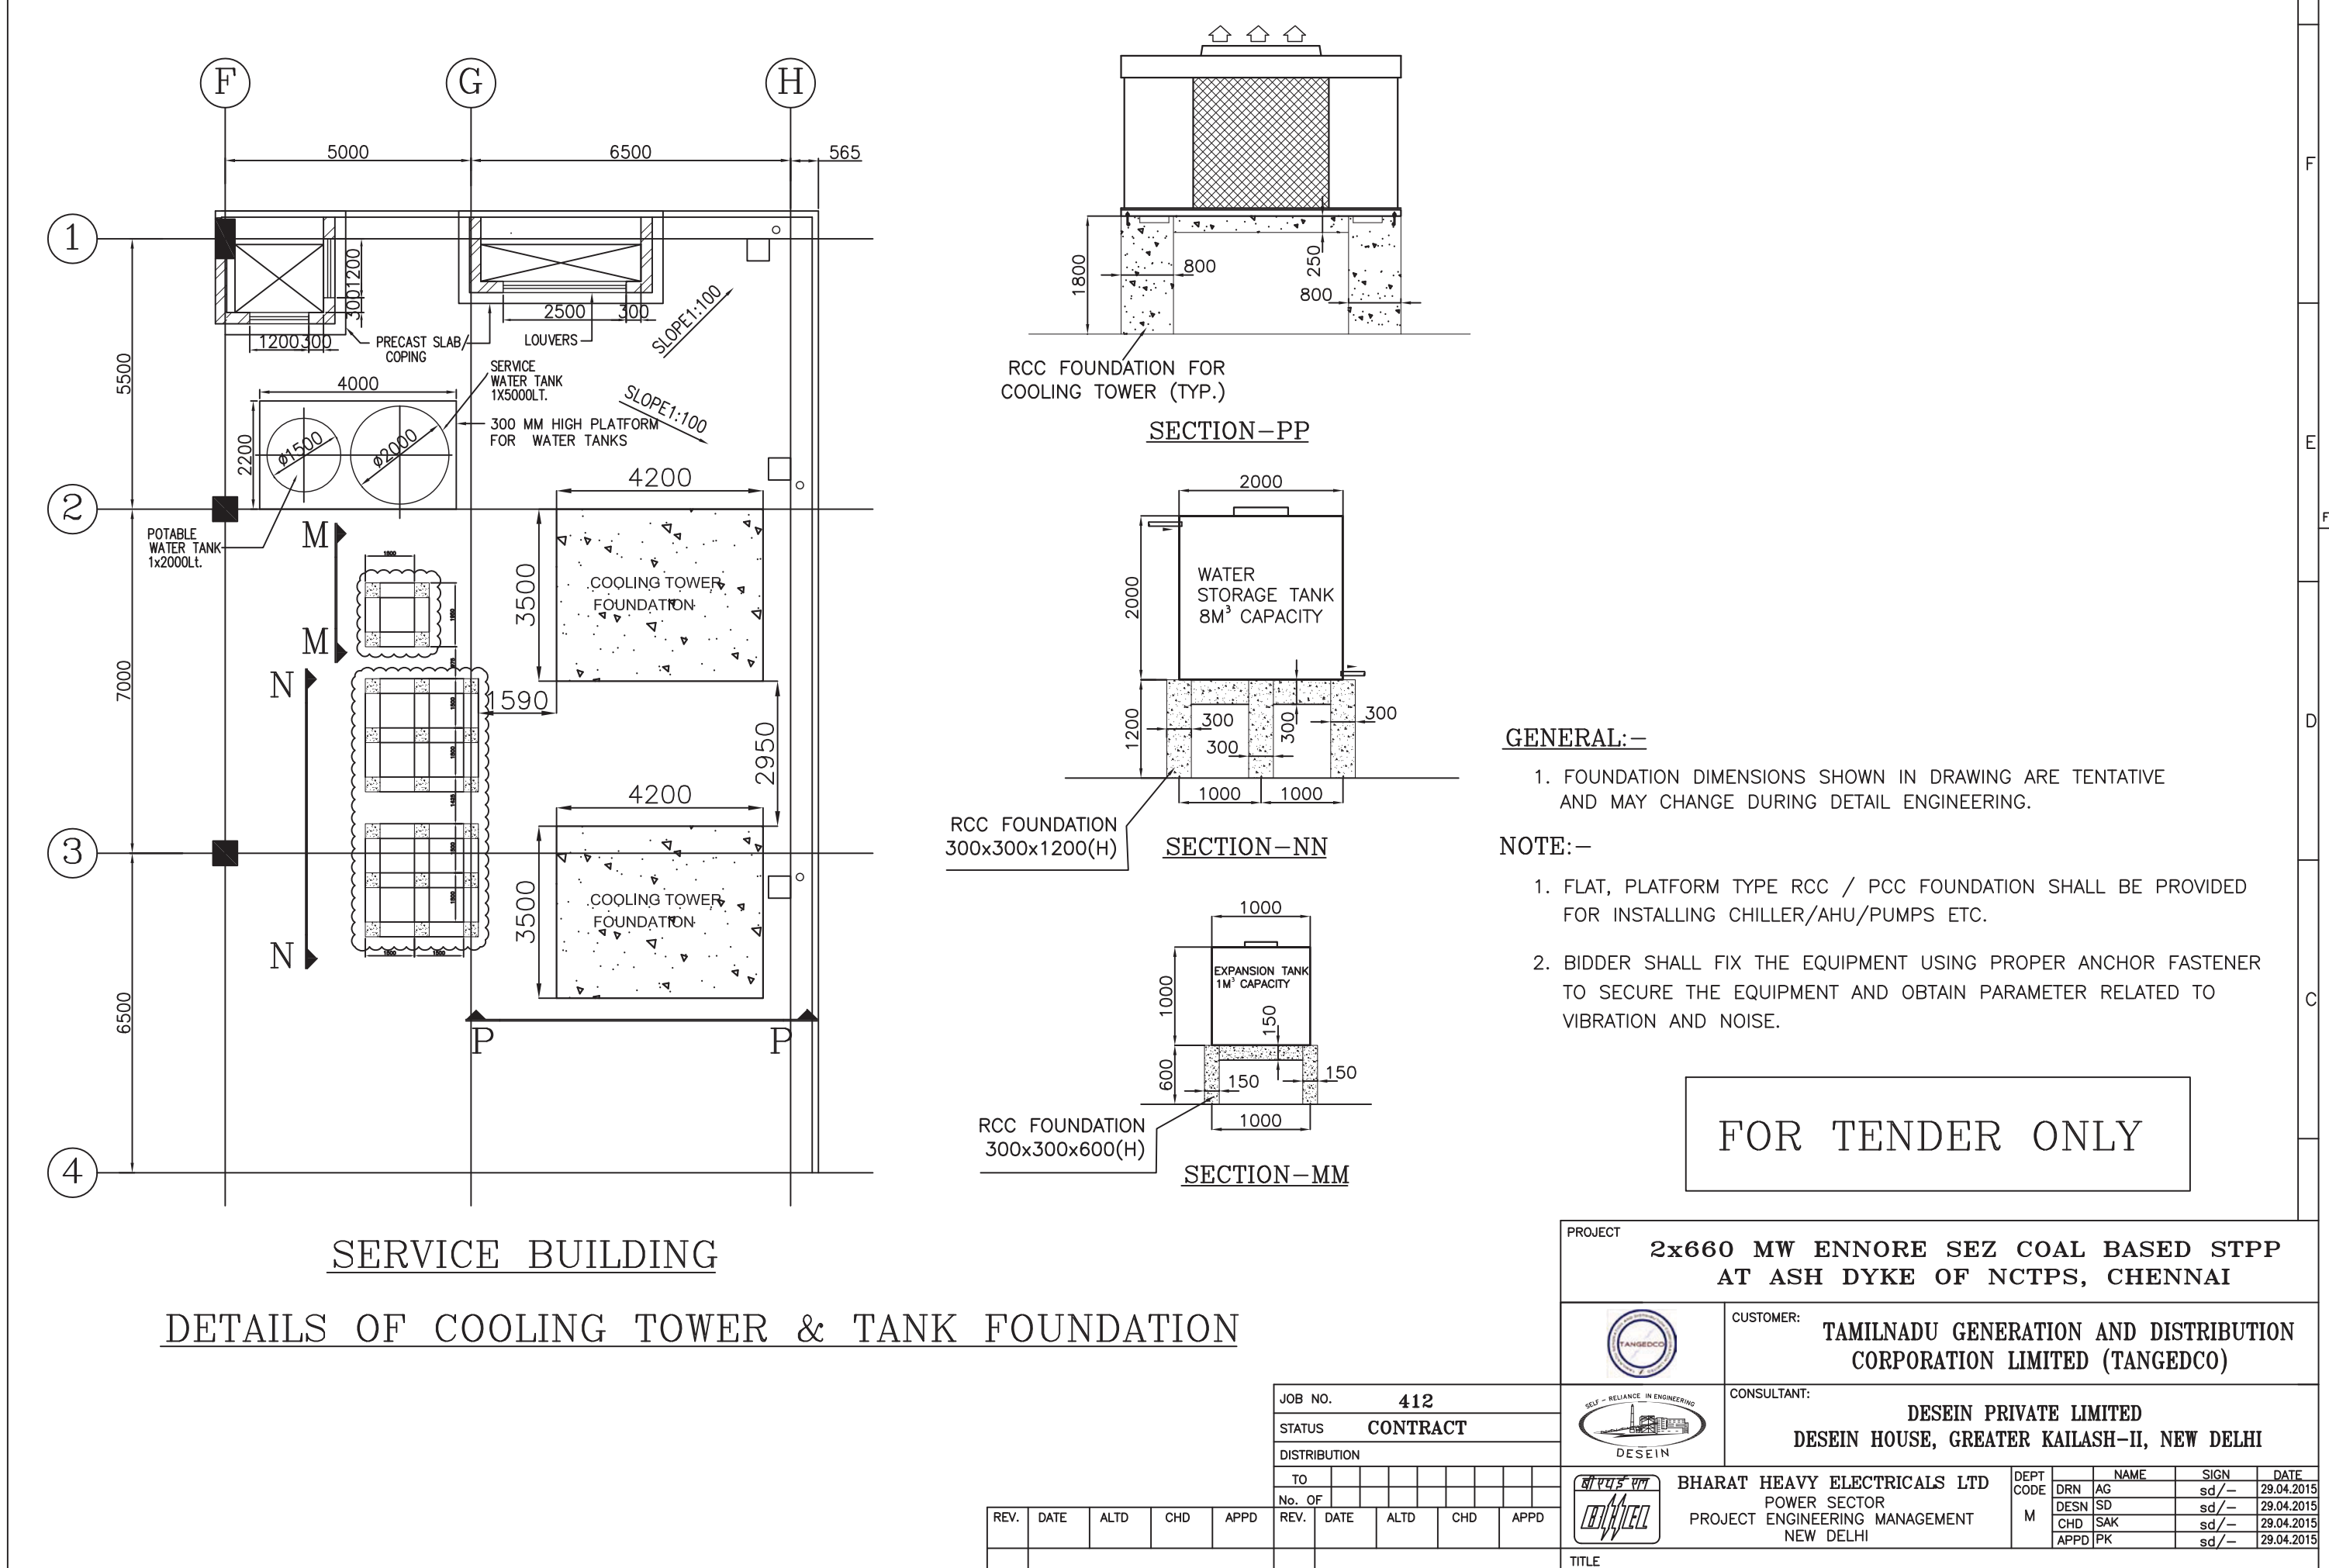
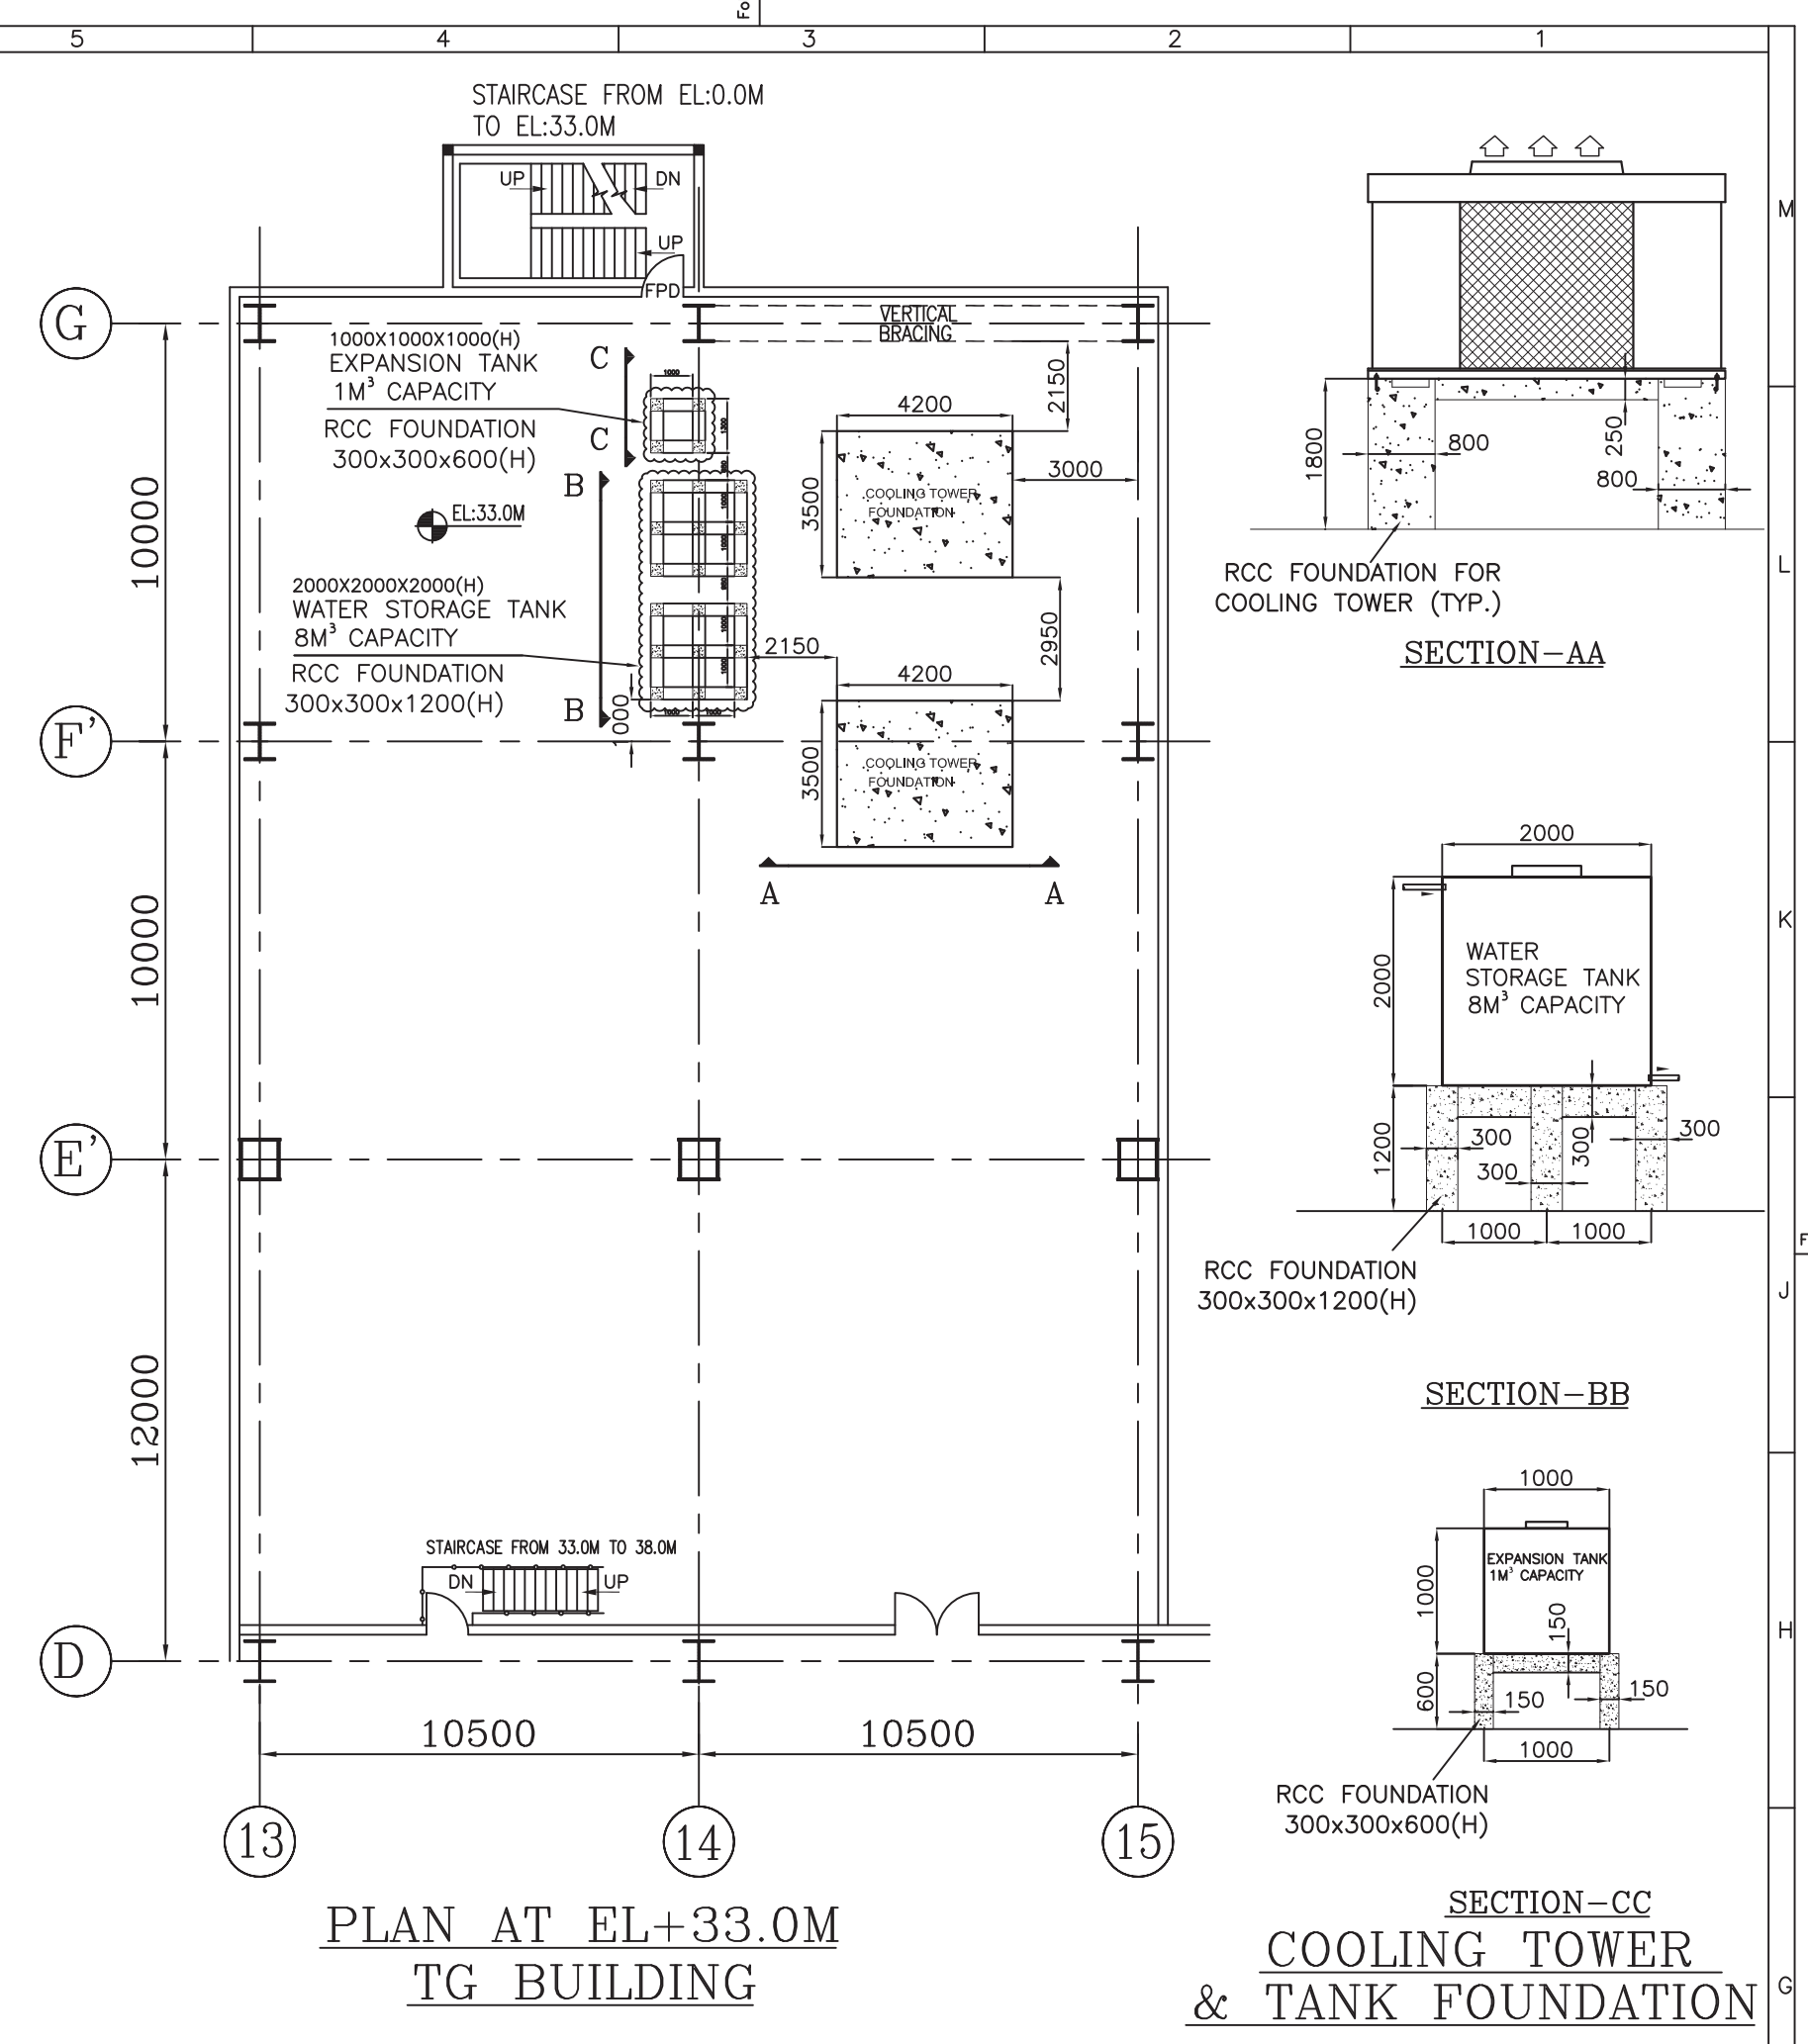
NOIDA

DATE

11/09/2019

PAGE

5702 of 597





**2x660MW ENNORE STPP
AIRCONDITIONING SYSTEM
STANDARD TECHNICAL SPECIFICATIONS**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV. 00

DATE: Feb 2017

SECTION: II
STANDARD TECHNICAL SPECIFICATIONS



**2x660MW ENNORE STPP
AIRCONDITIONING SYSTEM
STANDARD TECHNICAL SPECIFICATIONS**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

Sub Section D

REV. 00

DATE: Feb 2017

SECTION: II

SUB SECTION D

STANDARD TECHNICAL SPECIFICATIONS



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D

REV. 02


DATE: 17.09.2012

SHEET 1 OF 6

**STANDARD TECHNICAL SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING PLANT**


Anshul


S.A. Khan


Pawan Kishore

	STANDARD TECHNICAL SPECIFICATION FOR CENTRAL AIR-CONDITIONING	SPECIFICATION NO.PES-553-01	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 2 OF 6	

1.	<u>GENERAL</u>
1.1	This specification covers the design, manufacture, testing at Manufacturer’s works, delivery to site, handling at site, installation, commissioning and carrying out acceptance tests and final painting at site of various equipment of the central air conditioning plant, as specified hereinafter.
2.	<u>CODES & STANDARDS</u>
2.1	The design, manufacture and performance of air conditioning equipment shall comply with all currently applicable statutes, regulations and safety codes in the locality where the equipment are to be installed. The equipment shall also conform to the latest applicable Indian/British/American standards. Nothing in this specification shall be construed to relieve the tenderer of this responsibility. In particular the equipment shall conform to the latest editions of the following standards.
2.1.1	IS-660 : Safety code for Mechanical Refrigeration.
2.1.2	ARI 520-90 : Standard for Positive Displacement Refrigerant compressors and condensing units.
2.1.3	IS-5111 : Code of Practice of Measurement for Testing Refrigeration compressors.
2.1.4	ASHRAE/23-93 : Method of Testing for Rating Positive Displacement Refrigerant compressors and condensing units.
2.1.5	ARI-450: Standard for water-cooled Refrigerant condensers, Remote Type.
2.1.6	ASME : Unfired pressure Vessels Code. (Section VIII)
2.1.7	IS-2825 : -do-
2.1.8	IS-4503 : Shell and tube type heat exchangers.
2.1.9	ASHRAE/22-92 : Method of Testing for rating of Water Cooled refrigerant condensers.
2.1.10	IS-659 : Safety code for Air conditioning.
2.1.11	IS-2379 : Color Code for Identification of pipe lines.
2.1.12	TEMA : Standards of Tubular Exchanger manufacturers Association.
2.1.13	IS-1239 (Part-I) : Seamless steel tubes (Up to & including 168.2 mm OD.).
2.1.14	IS-3589 : For piping above 168.2mm to 2032mm Outside Diameter.
2.1.15	IS-778 : Valves up to 50 MM.
2.1.16	IS-780 : Valves 50 MM to 300 MM.
2.1.17	ASHRAE 24 : Method of Testing for Rating liquid coolers.

	STANDARD TECHNICAL SPECIFICATION FOR CENTRAL AIR-CONDITIONING		SPECIFICATION NO.PES-553-01	
			VOLUME II B	
			SECTION D	
			REV. 02	DATE: 17.09.2012
			SHEET 3 OF 6	
2.1.18	ARI-480:	Standard for refrigerant cooled liquid coolers-Remote type.		
3.	<u>DESIGN & CONSTRUCTION REQUIREMENTS</u>			
3.1	The components of Central air conditioning plant comprising compressor, chiller refrigerant piping, valves and fittings etc. Shall be as given in Data sheet A. The type of all accessories, controls and instrumentation shall also be as indicated in data sheet A.			
3.2	The various equipments supplied under this specification shall be fully compatible with each other & capable of operating as fully balanced integrated system to deliver the specified output under design conditions.			
4.	<u>TESTING AND INSPECTION</u>			
	(Refer standard quality plan)			
4.1	Hydrostatic, Volumetric and refrigerant leak tests etc. shall be carried out at manufacturers works before dispatch of equipment in accordance with the applicable codes and standards.			
	Following minimum tests amongst others shall be conducted.			
4.1.1	Material analysis, testing and identification (Data sheet/ Drg. Shall clearly indicate the specification, grade, class and Heat treatment condition of material for which TC will be furnished)			
4.1.2	Hydrostatic pressure test of all pressure parts.(Testing pressure shall be clearly indicated for each component/ subassembly/ assembly)			
4.1.3	Static and Dynamic balancing test of rotating parts at rated and over speed and to determine vibration & noise level.(Grade of balancing, type- whether dynamic or single plane balancing for components/ subassembly/ assembly shall be clearly indicated in data sheet/ approved drg.. Permissible vibration (velocity and displacement –peak to peak and noise level in dB(A) to be indicated in Data Sheet/Approved Drg.)			
4.1.4	Radiography & magna-flux examination of materials & welds.(Components to be subjected to NDT with applicable, procedures and acceptance norms to be clearly indicated in Data sheet/ approved drg. If in a component only certain areas are to be subjected to NDT same shall be clearly brought out else it will be understood that the entire component is subject to NDT)			
4.1.5	Ultrasonic test of castings & forgings.(Procedure and acceptance norms with areas subject to NDT to be clearly indicated in Quality Plan).			
4.1.6	Performance test including determination of capacity, efficiency & characteristics etc.(Applicable standard, Acceptance norms, Procedure for test (if not covered in applicable standard),performance characteristics with applicable tolerances and drive to be used during shop test to be clearly indicated in Quality Plan). Performance data to be indicated in Approved Drg./ Data Sheet)			

	STANDARD TECHNICAL SPECIFICATION FOR CENTRAL AIR-CONDITIONING	SPECIFICATION NO.PES-553-01	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 4 OF 6	
4.1.7	Functional checks and adjustments of controls & instrumentation. (Functional checks required to be clearly indicated with extent of check and applicable standard in approved check list / Quality plan. Class of instruments / tolerances and performance data to be incorporated in Approved Data Sheet / Drg.)		
4.1.8	Checking of working clearances.(desired working clearances to be indicated in approved Drg.)		
4.1.9	Examination after selective opening up after testing.(basis/ reasons for selective opening up, areas to be examined and parameters to be checked to be brought out in Quality Plan)		
4.2	TESTS AT SITE Tests to prove guaranteed performance of the air conditioning plant, shall also be carried out at site after proper installation. The site test shall include performance testing (as per FQP) of equipment for 72 continuous hours each in all three seasons i.e. Summer, Winter and Monsoon. Unless specified elsewhere. All instruments, tools etc. as may be required to carry out site tests shall be arranged by the tenderer.		
5.	<u>PERFORMANCE GUARANTEE</u>		
5.1	Each equipment of air conditioning system shall be guaranteed for its rated capacity under the specified site conditions.		
5.2	If the shop/site performance tests indicate failure of equipment to meet specified requirement, it would be tenderer’s responsibility to carry out required alterations at no extra cost to purchaser. Tests shall be repeated after carrying out the modifications to demonstrate the performance.		
5.3	The air conditioning plant before being taken over by purchaser shall be subjected to running test for a minimum period of one week during which all readings shall be recorded. Any deficiencies noted during this period, shall be rectified by the tenderer /at no extra cost to purchaser. These running tests shall be in addition to the seasonal performance test specified under clause 4.2. The inside design conditions shall be guaranteed throughout the year.		



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012


SHEET 5 OF 6

6. DRAWINGS/DOCUMENT/DATA REQUIRED AFTER AWARD OF CONTRACT

- 6.1 Final version of all drawings & data submitted with the along with technical schedules enclosed in Volume III.
- 6.2 Drawings including equipment layout, foundation & loading details etc. for civil works for the entire plant. These drawings must cover sufficient details so that design of civil works can be completed.
- 6.3 Inspection, operation & Maintenance Manuals.
- 6.4 Manuals for method of testing & calibration of all instruments.
- 6.5 Equipment description giving complete design calculations, basis of design, selection criteria etc.
- 6.6 Schematic piping diagrams.
- 6.7 Layout of piping.
- 6.8 Electrical drawings.
- 6.9 Test Certificates.
- 6.10 Final as built documentation i.e. final-version of all drawings, data & information as per the requirement specified elsewhere.


Anshul


S.A. Khan


Pawan Kishore



**STANDARD TECHNICAL
SPECIFICATION
FOR
CENTRAL AIR-CONDITIONING**

SPECIFICATION NO.PES-553-01

VOLUME II B

SECTION D


REV. 02

DATE: 17.09.2012

SHEET 6 OF 6


Anshul


S A Khan


Pawan Kishore



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 1 OF 4

DESCRIPTION

DATA

1. GENERAL

- | | | |
|-----|---|---|
| 1.1 | Type of AC plant | : Chilled Water Type. |
| 1.2 | Plant configuration/capacity. | : Refer to Section-C of Specific Technical Requirements. |
| 1.3 | Location of AC plant rooms | : As per Tender drawings. |
| 1.4 | Type of lifting facility provided. | : Chain Pulley block with monorail (by BHEL) |
| 1.5 | Electrical work scope: - | |
| | i) MCC for AC plant | : By Others |
| | ii) Power cables / Control cables. | : By Others |
| | iii) Drives | : By Bidder. |
| | iv) Whether separate alarm/annunciation Panel/control panels required | : Yes (By bidder), Refer to Section-C of Specific Technical Requirements. |
| | v) Termination of cabling & earthing at Equipment end. | : By Bidder for bidder supplied equipment. |

2. REFRIGERATION COMPRESSOR

- | | | |
|-------|--------------------------|--|
| 2.1. | Type | : SCREW CHILLE |
| 2.2. | Nos. (working + standby) | : Refer to Section-C of Specific Technical Requirements. |
| 2.3. | Type of capacity control | : Automatic. |
| 2.4. | Type of drive | : Direct driven. |
| 2.5. | Restart after tripping | : Manual. |
| 2.6. | Type of start | : As per manufacturing standard. |
| 2.7. | Shaft Seal | : Mechanical shaft seal. |
| 2.8. | Purge Recovery unit | : As per manufacturing standard. |
| 2.9. | Type of lubrication | : As per manufacturing standard. |
| 2.10. | Refrigerant used | : Environment friendly HCFC, (CFC is not acceptable) |



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 2 OF 4

3. DESIGN REQUIREMENTS

- 3.1. Minimum capacity at Design conditions : Refer to Section-C of Specific Technical Requirements.
- 3.2. Capacity control : Microprocessor based Control Panel sheet metal panel, located on each Compressor/chiller unit including protection devices
- 3.3. Vibration isolator : Neoprene rubber pads/Equivalent approved to suit chiller package.
- 3.4. Type of foundation : Floating / As per manufacturing standard

4.0 CONDENSER

- 4.1 Type : Horizontal shell & tube type water-cooled
- 4.2 Number required : One no. for each machine.
- 4.3 Design requirements
- 4.3.1 Fluid : Refrigerant (Shell side) Water (tube side)
- 4.3.2 Cooling Water Quantity : To suit requirement.
- 4.3.3 Capacity of condensers : To match compressor & to provide at least 2°C sub cooling.
- 4.3.4 Cooling water inlet temp. : Refer to Section-C of Specific Technical Requirements.
- 4.3.5 Leaving Water Differential. : Refer to Section-C of Specific Technical Requirements.
- 4.3.6 Max. flow velocity through tubes. : 2.5 m/sec.
- 4.3.7 Design fouling factor : 0.0002 (MKS Unit)
- 4.3.8 Maximum pressure drop. : 0.6 Kg/cm² (g)
- 4.3.9 Tube wall Thickness : Not less than 18 SWG
- 4.4 Materials of construction
- i/ Shell : M.S. Plate fusion welded.
- ii/ Tube : Integrally bonded Seamless copper



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 3 OF 4

- iii/ Head ends : Cast Iron.
- iv/ Tube sheet material : Steel
- v/ Baffle plate : Steel.
- 4.5 Accessories required
- i/ Purge & drain connections with valves. : Yes
- ii/ Relief valves : Yes
- iii/ Liquid line shut off valve. : Yes
- iv/ Isolating valves on water side. : Yes
- v/ Flow switch : Yes (interlocked with control of individual refrigeration system)
- vi/ Pressure/temperature gauges at inlet/outlet : Yes
- vii/ Descaling tee : Yes
- viii/Charging valve : Yes
- ix/ MS supporting frame work : Yes
- viii/Cooling thermostat : Yes
- ix/ MS supporting frame work. : Yes
- 5.0 **CHILLER** (Applicable for chilled water type plant only.)
- 5.1 Type : Horizontal shell & tube flooded type
- 5.2 Number required/standby : One no. for each chiller package.
- 5.3 Design requirements
- 5.3.1 Fluid to be cooled : Water
- 5.3.2 Water flow rate (Inside tube) : To suit requirement.
- 5.3.3 Water inlet temperature : 12 °C approx.
- 5.3.4 Water outlet temperature : 7 °C approx.
- 5.3.5 Super heating of refrigerant material : By at least 3 deg. C.
- 5.3.6 Insulation /thickness/finish : As per the manufacture standard.
- 5.3.7 Design fouling factor : 0.00010(MKS Unit)



CENTRAL AIR-CONDITIONING PLANT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 4 OF 4

- 5.3.8 Maximum pressure drop. : 0.6 Kg/cm² (g)
- 5.3.9 Tube wall Thickness : Not less than 22 SWG.
- 5.4 Materials of construction
- i/ Shell : M.S. Plate fusion welded.
 - ii/ Tube : Integrally Seamless copper (internally Corrugated)
 - iii/ Head ends : Cast Iron.
 - iv/ Tube sheet material : Steel.
 - v/ Baffle plate : Steel.
- 5.5 Accessories required
- i/ Purge & drain : Yes
 - ii/ Gate valves at water inlet/outlet. : Yes
 - iii/ Flow switch : Yes
 - iv/ Pressure/temperature gauges at inlet/outlet : Yes
 - v/ Anti-freeze thermostat : Yes
 - vi/ Thermostatic expansion valves : Yes
 - vii/ Pilot solenoid valve : Yes
 - viii/ Cooling thermostat : Yes
 - ix/ MS supporting frame work. : Yes

Note :-

The system shall also incorporate:

- 1) Auto operation of chilling plant for operation of the whole AC system.
- 2) A Central Control Panel with fault annunciators with provision for remote extension besides local control kiosks.
- 3) Water Chiller package shall be skid-mounted unit with microprocessor based control panel complete with all accessories and controls are assembled at manufacturing works on single unit.
- 4) Screw chiller shall be suitable for 415V $\pm$ 10 %/50 Hz $\pm$ 3%/3 phase operation with voltage & frequency variation as specified with built in starter etc.
- 5) Only supply feeders shall be provided for chillers.

Anshul
Anshul

S A Khan
S A Khan

Praveen Kishore
Praveen Kishore



TECHNICAL SPECIFICATION
AIR HANDLING UNITS

SPECIFICATION NO.PES-553-02

VOLUME II B

SECTION D

REV. 02


DATE: 17.09.2012

SHEET 1 OF 6

**STANDARD TECHNICAL SPECIFICATION
FOR
AIR HANDLING UNITS**


Anshul


S A Khan


Pawan Kishore

	TECHNICAL SPECIFICATION AIR HANDLING UNITS	SPECIFICATION NO.PES-553-02	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 2 OF 6	

1.	<u>GENERAL</u>
1.1	This specification covers the design, manufacture, Construction features, installation, commissioning, inspection and performance testing at site of AHUs.
2.	<u>CODES AND STANDARDS</u>
2.1	The design manufacture and performance of AHU shall comply with all currently applicable statutes, regulations and safety codes in the locality where the AHU is to be installed. The equipments shall also conform to the requirements of the latest editions of applicable Indian/British/US standards. Nothing in this spec. shall be construed to relieve vendor of this responsibility. In particular the equipment shall conform to the latest editions of the following standards:
2.1.1	IS-659 : Safety code for air conditioning
2.1.2	IS-660 : Safety code for mechanical refrigeration
2.1.3	ASHRAE: Method of testing forced circulation air-cooling and air heating coils. standard 33
2.1.4	ARI 41 : Standard for forced circulation air cooling and air heating coils.
2.1.5	ARI 430/435 : Air-cooling and air heating coils Central Station AHU / Application of Central Station AHU.
2.1.6	AMCA : 211 and 311
	In case of any conflict in the standards and this specification the decision of PEM,BHEL shall be final and binding.
3.	<u>CONSTRUCTION FEATURES</u>
3.1	The casing of AHU shall be made of insulated double wall construction of min. 24 gauge galvanized sheet steel - IS 277 Gr. 120 (parent sheet: D/DD-IS-513) ribbed and reinforced for structural strength and rigidity with 25 mm thick polyurethane insulation of minimum 40 kg/m³ density in between. The external wall will be pre-plasticised over GI coating on the outside. Angle irons or channel sections made of 16 gauge galvanized sheet steel shall be used for reinforcing. The casing shall be of sectionalized construction with proper sealing at the joints to make them air tight. Fan section and panels with bearing support shall be reinforced with heavy gauge channels (min. 5 mm thick). Suitable number of forged hot dip galvanized (610 gm/sq.m) U brackets shall be provided for AHU suspended from ceiling/roof. Necessary arrangement shall be provided on the casing for measuring temperature and pressure in cooling/heating coil. Class of instruments shall be min. 2.
3.2	Fan impeller shall be forwardly/backwardly inclined curved blade centrifugal type. Impeller shall be double width double inlet type. Fans shall be preferably low rpm (<=1500) to minimize vibration and noise. Noise shall be within 85 dB(A) at 1 metre distance from AHU casing. Max. Vibration level shall be acceptance and norms to be specified. Two to three wheels (impellers) shall be provided for each AHU. Impeller blades shall be fabricated from (min. 1.0 mm) galvanized/ epoxy powder coated sheet steel. Fan shall be of epoxy powder coated / galvanized sheet steel (min. 1.6



TECHNICAL SPECIFICATION

AIR HANDLING UNITS

SPECIFICATION NO.PES-553-02

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 3 OF 6

mm) scroll with die formed inlets for uniform air flow. Fan shafts shall be solid cold rolled carbon steel (EN8 normalised), ground and polished. Fan shaft bearings shall be of heavy duty type selected for average operating life of 100,00 hours. Bearings shall be self-aligning, permanently lubricated type. Make of Brgs(SKF/FAG/NORMA/TATA) to be specified. Bearing Housing shall be of casting of min. IS Gr. 210, split type and suitably supported. The V-belt drive with belt guard shall be provided. Motors shall have minimum 15% margin over maximum BHP in working range.

3.3 DX or chilled water cooling coils and steam/hot water coils shall be internally corrugated copper/ cupronickel tubes (as per manufacturer's standard) with smooth non corrugated external fins of aluminium (thickness 0.14 mm and grade 1100 as per spec) unless specified otherwise in specification. At least 5 fins /per cm. shall be provided. The chilled water/hot water coils shall have suitable (standardize class, size, threading) drain and vent connections.

3.4 The filters in the filter section shall be provided as detailed in data sheet A.

3.5 Humidifier shall be Pan type/as specified in the specification.

Pan type Humidifier consisting of SS304/316 tank, heater, geyserstat with piping connection to supply air duct shall be provided unless specified otherwise in data sheet A.

Heaters and branch line shall be of galvanized steel and nozzles shall be of brass (matl. grade) /SS 304.

3.6 Condenser water from coil or surplus water from spray humidifier shall be collected in 16 gauge SS-304 pan. Minimum 50mm dia GI pipe nipple shall be provided on each end for drain connection. The drains for these points shall be extended to the main drain in AHU room. Condensate drain pipe (GI) of required length with sealing loop shall be provided and insulated as specified in the specification for insulation. Minimum requirement For GI Pipes and fittings shall be ERW/Seamless of medium thickness as per IS-1239/3589 and Hot dip galvanized

3.7 Suitable number of Spring type vibration isolators shall be provided for fan and motor assembly. Neoprene rubber pads shall be provided below the AHU.

The AHU shall be provided with 18 G SS drain pan.

Anshul

S A Khan

Praveen Kishore



TECHNICAL SPECIFICATION
AIR HANDLING UNITS

SPECIFICATION NO.PES-553-02

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 4 OF 6


4.

TESTING AND INSPECTION AT MANUFACTURERS WORKS:

List of TCs arranged as per Approved Quality Plan shall be furnished along with copy of TCs at the time of inspection.


Anshul


S A Khan


Pawan Kishore

	TECHNICAL SPECIFICATION AIR HANDLING UNITS	SPECIFICATION NO.PES-553-02	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 5 OF 6	
4.1	Visual inspection of GI sheets and angles, channels etc. – dents, black spots, chipping of zinc coating, white dust on galvanised sheets shall be avoided. Pitting , lamination in angles and channels shall be avoided.		
4.2	Galvanised sheets - Test certificate shall be furnished for visual check, coating thickness, adhesion test, sheet thickness, uniformity of coating. For pipes and fittings compliance report shall be furnished by Manufacturer for visual check, coating thickness, adhesion test, sheet thickness, uniformity of coating.		
4.3	Shaft: Mechanical and chemical.		
4.4	Motors (of approved make): Routine TC.		
4.5	Workmanship and dimensional check as per manufacturing drg. and approved Drgs.		
4.6	Balancing of impellers- Dynamic balancing certificates shall be furnished –grade 6.3 or better to ISO-1940. Balancing weights shall be positively locked to avoid loosening. Balancing weights and fasteners used shall be galvanized.		
4.7	Performance test of one Centrifugal fan/per type/per size as per AMCA standard (for indigenous make).		
4.8	Centrifugal fans for AHUs will be 100% run tested by main contractor of BHEL. One centrifugal fan/per type/per size will be run tested. Vibration shall be within good zone of VDI 2056 / ISO 10816-1(group- K) machines when measured on bearing housing and noise level <85 dbA at 1 metre distance. Max. Temp. on bearing housing- 40 degrees Centigrade + ambient.		
4.9	Complete assembly of one AHU/per type/ per size (excluding cooling coil and filter) shall be witnessed.		
4.10	Run test of one complete assembly/per type/per size (excluding cooling coil and filter). Vibration shall be within satisfactory zone of VDI 2056 / ISO 10816-1(group- K) machines when measured on bearing housing and noise level <85 dbA at 1 metre distance. Max. Temp. on bearing housing- 40 degrees Centigrade + ambient.		



TECHNICAL SPECIFICATION
AIR HANDLING UNITS

SPECIFICATION NO.PES-553-02

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 6 OF 6

5. DRAWINGS/DOCUMENT/DATA REQUIRED AFTER AWARD OF CONTRACT

- 5.1 GA drawing of AHU & data- sheet to be submitted along with technical schedules enclosed in Volume III.
- 5.2 Drawing including equipment layout, foundation & loading details etc. for civil works. These drawings must cover sufficient details so that design of civil works can be completed.
- 5.3 Inspection, operation & Maintenance Manuals.
- 5.4 Equipment description giving complete design calculations, basis of design, selection criteria etc.
- 5.5 Test Certificates.
- 5.6 Final as built documentation i.e. final-version of all drawings, data & information as per the requirement specified elsewhere.
- 5.7 Performance Test Certificates.



AIR HANDLING UNIT
DATA SHEET - A

VOLUME - II-B

SECTION - D

REV 00

DATE 17.09.2012

SHEET 1 OF 2

DESCRIPTION

DATA

- | | |
|--|--|
| 1. Nos. required/working | : Refer to Section-C of Specific technical requirement. |
| 2. Location | : Refer to Section-C of Specific technical requirement. |
| 3. Service/type | : Air Conditioning /Double skin. |
| 4. Fan type | : Centrifugal (forward/backward curve Blade) limit load. |
| a) Capacity | : To Suit as per calculation. |
| b) Static pressure | : To suit but not less than 60 mm wc for AHU's Micro-V filters. |
| c) Discharge direction | : To suit layout. |
| d) Motor | : By Bidder, |
| e) Local push button station (Start/Stop) | : By Others |
| f) Motor location | : Inside AHU Casing. |
| g) Drive | : Belt, pulley, belt guard. |
| 5. Face and Bypass Damper | : Required (Opposed blade type) DX AHU's having |
| 6. Cooling coil | |
| a) Duty sensible heat | : To suit as per calculations |
| b) Duty latent heat | : -do- |
| c) Type of coil | : Chilled Water/DX/Hot Water. |
| d) No. of rows | : To suit but not less than four (4) |
| e) Material of tube /Thickness | : Seamless Copper to ASTM-A-75/Equivalent. |
| f) Material of fins | : Aluminium to SAE-1100-/1145-0 |
| g) Number of fins | : Not greater than 5 per cm (13 per inch). |
| h) Max. face velocity | : 2.5 m/sec. |
| i) Air flow quantity | : To suit as per tender drawings/documents. |
| 7. 3 - way motorised mixing valve with thermostat. | : Required with thermostat & actuator for chilled water system for each AHU. |



AIR HANDLING UNIT
DATA SHEET - A

VOLUME - II-B

SECTION - D

REV 00

DATE 17.09.2012

SHEET 2 OF 2

8. Damper at discharge : Manually operated at discharge of each AHU outlet.
a) Material of construction : Mild Steel, galvanised.
9. Filters (Pre-filters)
a) Type & thickness : Dry panel type/ 50 mm
b) Filter area. : To suit as per velocity requirements. "V" - Bank.
c) Filter efficiency : Average arrestance efficiency of 65-80 %
d) Press drop (Clean) : Not to exceed 2.5 mmwc when clean & 6.5 mmwc while dirty.
10. Humidification section : As per the System requirement.
a) Type : Pan type, unless otherwise specified.
b) Operation : Automatic with Humidification.
11. Fresh air arrangement : Required.
a) Fresh air fan : Tube axial flow fans with motor.
b) Accessories : i) Inlet cone with Bird screen.
: ii) Dry panel pre-filters,
: iii) High efficiency filters for control room areas.
: iv) Volume Control Dampers,
: v) Supports etc.
12. Vibration isolator required. : Yes
13. Type of vibration isolator. : Neoprene ribbed Rubber for AHU's.
14. Any other requirement : i) In addition to dry panel filters on AHU, High efficiency filters(average arrestance efficiency of 80-90 %) shall be provided in supply air duct side of AHU for all control room and allied areas.
: ii) Bidder to also provide suitable electrical strip heaters for winter heating & monsoon reheating with Contactor box etc. Heaters to be interlocked with airstat.
15. Instrument & controls : Lot.(including Control box for strip heaters, pan humidifiers etc. in each AHU room.)
16. Insulation of drain piping : Lot.



**STANDARD TECHNICAL
SPECIFICATION
FOR
COOLING TOWER**

SPECIFICATION NO. PES-553-03

VOLUME II B

SECTION D

REV. 02


DATE: 17.09.2012

SHEET 1 OF 5

**STANDARD TECHNICAL SPECIFICATION
FOR
COOLING TOWER**


Anshul


S A Khan


Pawan Kishore

	TECHNICAL SPECIFICATION COOLING TOWER	SPECIFICATION NO.PES-553-03	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 2 OF 5	

1.

GENERAL

1.1

this standard specification covers the design, manufacture assembly, inspection & testing at manufacturer’s works, suitable painting & packing, delivery, erection & commissioning at site of all materials and equipments for mechanical induced draught cooling tower complete with all accessories as specified hereinafter.

2.

CODES & STANDARDS

2.1

the design, manufacture, inspection & testing and performance of the cooling tower as specified hereinafter shall comply with the requirements of all applicable latest Indian/British/American standards and codes of practice. the latest editions of the following standards & publications shall be followed in particular:

2.1.1

Cooling tower institute USA bulletin ATP-10S: Acceptance test procedure for industrial water-cooling tower.

2.1.2

PTC-23 ASME performance test code for Atmospheric water-cooling equipment.

2.1.3

In case of any conflict between the above codes & standards and-this specification, the later shall prevail.

3.

DESIGN REQUIREMENTS

3.1

the cooling tower shall be designed for continuous operation to cool not less than design flow of water from specified inlet temperature to the outlet temperature at a design ambient wet bulb temperature as indicated under data sheet a.

3.2

all the components shall be capable of safe, proper and continuous operation at all cooling water flows upto & including those specified under data sheet a & shall be designed with regard to case of maintenance, repair, cleaning & inspection.

3.3

the cooling tower shall be of induced draught cross flow or counter flow type and with multiple cells (if specified in data sheet a.) the cooling tower shall be suitable for handling the fluid and also for achieving the specified parameter as per data sheet a. the cooling tower shall be designed such that the drift losses & evaporation losses are minimum.

4.

CONSTRUCTIONAL FEATURES

4.1

CASING & LOUVERS

4.1.1

The cooling tower casing shall be made of FRP/as specified in data sheet A. The louvers shall be made of FRP/as specified. Louvers, if provided, shall be designed for air entry to the tower with low velocity for minimum pressure drop & less chance of recirculation of moist air. To eliminate splash out, louvers shall slope to shed water inwards. Air intake shall be all along the base circumference of the casing & hotdip galvanised expanded metal mesh shall be provided to protect the air intake.

	TECHNICAL SPECIFICATION COOLING TOWER	SPECIFICATION NO.PES-553-03	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 3 OF 5	

4.2	FILL
4.2.1	Cooling tower fills shall be made of noncombustible PVC/as specified in data sheet A. The design & arrangement of the fills shall be so as to expose maximum air/water surface with minimum pressure drop.
4.3	Drift Eliminators
4.3.1	Multi-pass drift eliminators with minimum two pass zig-zag path shall be provided so to minimise the drift losses.
4.3.2	In case of FRP cooling tower the drift eliminators shall be of multi-blade rotary type.
4.4	Fans & Accessories
4.4.1	The fans shall be multiple blade, low speed, high efficiency axial flow type located above the top deck level of the cooling tower. Fan rotating assembly shall be statically & dynamically balanced. The fan blades shall be preferably adjustable in stand still condition for propeller action. The fan shall be either directly mounted on the shaft of a totally enclosed weather proof motor or shall be suitable for V-belt drive.
4.4.2	The rating of drive motor shall have at least 15% margin over maximum fan power consumption. The design & construction of the drive motor shall be in accordance with enclosed specification for LVAC motors.
4.5	Water basin
4.5.1	The material of construction of water basin shall be FRP or RCC as specified in data sheet A. The basin shall be provided as a part of cooling tower in case of FRP construction. The sump shall have sufficient storage capacity for safe operation of AC plant.
4.6	Hot water distribution system
4.6.1	Manually operated flow control valves shall be provided in hot water distribution piping such that each cooling tower can be isolated without affecting the operation of other cells.
4.6.2	The nozzles shall be spaced to give even distribution of water over entire space occupied by top row of fills. The nozzles shall be made of brass /SS 304/316/316L (brass shall be as per manufacturer’s standard) unless specified in data sheet A:
4.6.3	In case of FRP tower water shall be distributed over the fill by means of a multiple area fail safe rotary sprinkler made of PVC pipes fitted on a aluminium alloy (as per manufacturers standard) rotary head and mounted on sealed ball bearings (make) .
4.7	Access
4.7.1	A stair case paddle ladder (as per manufacturer’s standard) shall be provided external to the cooling tower at one end of each tower along with stairways hand rails etc give safe & convenient access to the top deck from ground level.

	TECHNICAL SPECIFICATION COOLING TOWER	SPECIFICATION NO.PES-553-03	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 4 OF 5	
4.8	Painting		
4.8.1	The cooling towers shall be painted with suitable anti-corrosive paint as per approval of purchaser. All galvanized external surfaces shall be painted to match colouring scheme. Before painting galvanized surfaces -etch primer to be applied.		
5.	<u>SHOP INSPECTION & TESTING</u>		
5.1	Compliance certificates for nozzles (Or rotary sprinkler), piping, fill material, drift eliminator, louvers components etc.		
5.2	Certificate of conformance for all other material components.		
5.3	Balancing report for Static & dynamic balancing of fan assembly.		
6.	<u>TESTS AT SITE</u>		
6.1	Hydrostatic testing of complete hot water distribution piping at site.		
7.	<u>PERFORMANCE GUARANTEE</u>		
7.1	The cooling tower shall be guaranteed to meet the performance requirements as specified & when tested in accordance with ATP-105.		
7.2	The vendor shall furnish performance curves for the cooling tower showing variations in performance from design duty point with change in approach to wet bulb temperature, cooling range, water loading of cooling tower.		

	TECHNICAL SPECIFICATION COOLING TOWER	SPECIFICATION NO.PES-553-03	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 5 OF 5	

8.	<u>DATA TO BE FURNISHED BY VENDOR AFTER THE AWARD OF CONTRACT</u>
8.1	General arrangement drawing of complete cooling tower (showing plan, front elevation and side elevation) incorporating principal dimensions, limits of scope of supply of piping, limits of civil works included showing extent of platforms, walkways, handrails, access doors, staircase etc. and the limits of scope of supply of electrical works.
8.2	General arrangement and sectional assembly drawings pertaining to the following components of the cooling tower: i) Tower fill with supporting arrangement. ii) Drift eliminator installation and details. iii) Complete hot water distribution system including flow regulating valves, distribution basin/pipes and nozzles etc.
8.3	Cooling tower performance curves showing WBT Vs cold-water temperature for design cooling range, 90% cooling range and 110% cooling range at 100%, 90%, and 110% design flow.
8.4	Performance curves of cooling tower fans.
8.5	Test procedure along with details of tests to be conducted for the offered cooling tower.
8.6	Quality Plan along with complete details of the testing and inspection requirements of mechanical and electrical items of the cooling tower in BHEL format.
8.7	Operation and maintenance instructions.



**COOLING TOWER
DATA SHEET - A**

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 1 OF 2

A. GENERAL DATA

- 1) Service : Cooling of condenser water of AC plant.
- 2) Type : Fibreglass reinforced plastic construction induced draught.
- 3) Quantity : Refer to Section-C of Specific Technical Requirements.
- 4) Place of installation : Refer to Section-C of Specific Technical Requirements.

B. DESIGN DATA

- 1) Capacity at specified conditions. : To suit the system requirement.
- 2) Water flow rate : To suit the system requirement.
- 3) Design wet bulb temperature : 25 Deg. C.
- 4) Hot water inlet temperature : To suit requirement.
- 5) Cooled water temperature : To suit requirement.
- 6) Depth of sump Tank : As per manufacturer's standard.

C. MATERIAL

- 1) Sump tank & Casing : FRP
- 2) Louvers : FRP/PVC/Aluminium.
- 3) Type of fill : Non-combustible PVC/Eq.
- 4) Nozzles : Brass with chrome plating/polypropylene.
- 5) Ladder : Hot dip galvanized steel ladder for each tower.
- 6) Bird screen : 25 mm square made of GI/SS wire mesh of 16 gauge.
- 7) Fan impeller : Cast Aluminium Alloy/FRP propeller type and multi-blade aerofoil construction with adjustable pitch..
- 8) Supporting structure : MS with spray galvanization of epoxy painting.
- 9) Strainer : Plant strainer made of GI/SS wire mesh of 16 gauge.

D. ACCESSORIES

- 1) Make up connection : Yes.



COOLING TOWER
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 2 OF 2

- 2) Quick fill connection : Yes.
- 3) Overflow & drain & blow down connection : Yes.
- 4) Access door in louvers/fan deck : Yes (if applicable).
- 5) Supports & supporting structure for mounting : Yes.
- 6) Level switch : Yes.
- 7) Rain protection for motor : Yes (suitable Canopy by Bidder)
- E. ELECTRICAL DATA
- i) Power supply : 415 V $\pm$ 10%/50 Hz $\pm$ 3%/3 phase.
- ii) Motor : As per specification attached.
- F. INSPECTION & TESTING : As per approved quality plan.



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

REV. 02


DATE: 17.09.2012

SHEET 1 OF 9

STANDARD TECHNICAL SPECIFICATION
FOR
LOW PRESSURE AIR DISTRIBUTION SYSTEM


Anshul


S.A. Khan


Pawan Kishore



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 2 OF 9

1. GENERAL

1.1 This specification covers the design, manufacture, construction features, installation, inspection testing and air balancing of air distribution system upto a total pressure of 95mm w.g. The specification is intended to cover the air distribution for air conditioning system and ventilation system not involving localised exhaust.

2. CODES AND STANDARDS

2.1 The design, construction and performance of complete system shall conform to all currently applicable statutes, regulations, safety codes in the locality where the equipment are to be installed

2.2 Unless specified otherwise the equipments shall generally conform to latest applicable Indian Standards. Nothing in this specification shall be construed to relieve the vendor of this responsibility. In particular the equipment shall generally conform to latest editions by the following standards:-

- a) IS: 655 - Specifications for metal air ducts.
- b) IS:277 - Specifications for galvanised steel sheets.
- c) IS:737 - Specification for wrought aluminium and aluminium alloy sheet and strip.

3. MATERIAL

3.1 Metal air ducts shall be either of galvanised steel sheets or aluminium sheets, as indicated in data sheet-A.

3.2 The rolled steel sheets before galvanising shall be properly annealed or normalised so as to allow fabrication of ducts without developing cracks. Zinc coating on the steel shall be as per technical requirement refer to Section-C of Specific Technical Requirements.

3.3 The aluminium sheets shall be of grade S1C or NS3 and shall be suitable for duct fabrication work as per IS-737 latest

4. CONSTRUCTION/FABRICATION

4.1 The thickness of sheets, the type of bracing and other fabrication details shall generally conform to requirements given hereunder unless specified otherwise in data sheet A and/or indicated on drawings.

4.2 RECTANGULAR DUCTS

4.2.1

S.No.	Max Side	Sheet Thickness	Type of transverse	Bracings
-------	----------	-----------------	--------------------	----------

Anshul

S.A. Khan

Praveen Kishore



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 3 OF 9

		(mm) GI	(mm) AI	Joint connections	
a)	Up to 600	0.63 (24G)	0.80	S-drive, pocket or bar slips or flanged joints on 2.5m centres	None
b)	601 to 750	0.63 (24G)	0.80	S-drive, 25mm pocket or 25mm bar slips or flanged joints on 2.5m centres	25x25x3 mm MS angles, 1.2m from joints
c)	751 to 1000	0.80 (22G)	1.00	S-drive, 25mm pocket or 25mm bar slips or flanged joints on 2.5m centres	25x25x3 mm MS angles, 1.2m from joints
d)	1001 to 1500	0.80 (22G)	1.00	40x40x3mm MS angle, flanged connections or 40mm pocket or 40mm bar slips with 35x3mm bar reinforcing on 2.5m centres	40x40x3 mm MS angles, 1.2m from joints
e)	1501 to 2250	1.00 (20G)	1.50	40x40x3mm MS angle, flanged connections or 40mm pocket or 40mm bar slips, 1M maximum centres, with 35x3mm bar reinforcing	40x40x3 mm diagonal angles or 40x40x3mm angles, 600mm from joints
f)	2251 & above	1.25 (18G)	1.80	50x50x3mm MS angles, connections or 40mm pocket or 40 mm bar slips, 1M maximum centres with 35x3mm bar reinforcing.	50x50x3mm diagonal angles or 50x50x3mm angles 600 mm from joints.
g)	No bracing is required if transverse joints are less than 600mm apart				
h)	For ducts larger than 2250mm, special handling and supporting methods shall be provided as per the approval of Purchaser				

- 4.2.2 All rectangular ducts having either dimension larger than 450mm shall be cross broken except these ducts which are insulated with sand cement plaster. Air outlet connections on ducts need not be cross broken.
- 4.2.3 The seams on duct cones shall be of Pittsburgh type. Longitudinal seams shall be smooth inside the ducts.
- 4.2.4 The flanges used for transverse joints shall be joined together with GI bolts (grade 4.6) and nuts spaced at 125mm centres as per following:
- a) Upto 1000mm - 6 mm dia GI bolts
 - b) 1001 to 1500 - 8 mm dia GI bolts
 - c) 1501 and above - 10mm dia GI bolts

Anshul
Anshul

S A Khan
S A Khan

Praveen Kishore
Praveen Kishore



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 4 OF 9

4.2.5 The MS angle flanges shall be connected to ducts with rivets at approx. 100mm centres. The flanged joints shall have 6mm thick felt packing stuck to flanges with shellac varnish. The holes in the felt packing shall be burnt through. The ducts are to be tapped 6mm across the MS flanges.

4.2.6 MS angles used for bracings shall be tack welded to the ducts or rivetted at 125mm centres, as applicable.

4.3 ROUND DUCTS

4.3.1

S.No.	Duct dia-mm	Sheet Thickness		Reinforcing
		(mm) GI	(mm) Al	
a)	Up to 150	0.63 (24G)	0.80	None
b)	151 to 600	0.80 (22G)	1.00	None
c)	601 to 1000	1.00 (20G)	1.50	40x40x3mm girth MS
d)	1001 to 1250	1.00 (20G)	1.50	40x40x3mm girth MS angles at 2.0 meter centres
e)	1251 & above	1.25 (18G)	1.80	40x40x3mm girth MS angles at 1.2m centres

4.3.2 The seams on round ducts may be continuously welded or grooved longitudinal seam. In case of welding of GI sheet, zinc rich paint shall be applied on the welded zone.

4.3.3 Round ducts shall either be joined by welding or the ducts shall be swedged 40mm from the ends such that larger end will butt against the swedge and is held in place with sheet metal screws.

4.4 DUCT SUPPORTS

Unless specified otherwise on drawings, rectangular ducts with larger side of 2250mm or above shall be supported by 15mm MS rods and 50x50x3mm and MS angles while those below 2250 mm shall be supported by 10mm MS rods and all angles shall be given a coat of primer paint. The duct supports shall be at a distance not exceeding 1800mm. The MS rods shall be fixed to MS angle cleats, which in turn are fixed to ceiling slab by suitable anchor fasteners. All anchor fasteners, MS angle cleats, coach screws, hooks and other supporting material required shall be provided by vendor.

However, If ducts are thermally insulated, the MS angles and supports shall not be in

	TECHNICAL SPECIFICATION LOW PRESSURE AIR DISTRIBUTION SYSTEM	SPECIFICATION NO.PES-553-07	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 5 OF 9	

direct contact with ducts, for which purpose wooden pieces/ Resin bonded fibre glass sheets (50 mm thick) shall be used in between.

4.5 FLEXIBLE CONNECTIONS

Wherever the sheet metal ducts connects to intake or discharge of fan units a flexible connection of at least 150mm width made by closely woven double layer Fire resistant or canvas shall be provided. The same shall be attached to angle iron frames on equipment and to similar frame on duct or casing by means of a steel band 9r (or) collar fitting over the end of the flexible connection and bolted through angle iron frame so as to clamp securely between the band and the angle frame.

4.6 TRANSFORMATIONS AND BREACHES

All curves, bends, offsets and other transformations shall be made for easy and noiseless flow of air. The throat of every branch duct shall be sized to have a velocity not exceeding that in the main duct to which the branch is connected.

4.7 CAULKING

Wherever duct passes through wall, the opening between masonry and duct work shall be neatly caulked or sealed to prevent movement of air from one space to adjoin by space with a rated fire resistant material.

4.8 EASEMENT

Normally pipe hangers, light fitting rods etc. shall not be allowed to pass through the ducts. Wherever, It becomes absolutely essential to pass these hangers/rods etc. Through the ducts, prior approval of purchaser shall be taken and light streamlines easement around the same shall be provided to maintain smooth air flow.

4.9 ACCESS DOORS

Access doors shall be provided in ducts, plenums etc. on both sides to allow access and servicing of equipment viz. pipes, dampers, coils, valves, heaters etc.

All access doors shall be adequately sized and lined suitably with felt to prevent air leakage. The doors shall be of built-up construction, structurally strong and shall have at least two hinges each, and shall be with two rust proof window sash locks of approved type. All doors shall be so set as to flush with outer finish of duct insulation etc.

4.10 DAMPERS AND SPLITTERS

4.10.1 Dampers and splitters shall be provided at suitable points for proportional volume control of the system. Splitters and dampers shall be made of minimum 18 gauge GSS of quadrant type with locking device mounted outside the duct at accessible location.

4.10.2 FIRE DAMPERS

Fire dampers shall be provided as specified in Data Sheet -A and shall be installed at locations indicated on drawings and/or as required/approved by purchaser, including all openings in passage of duct work through fire walls and floors etc. The fire damper shall be of electrical type with damper motor actuated by thermal

	TECHNICAL SPECIFICATION LOW PRESSURE AIR DISTRIBUTION SYSTEM	SPECIFICATION NO.PES-553-07	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 6 OF 9	

sensor or fusible link type.

4.10.3

VANES

Unless otherwise shown in the drawings all elbows shall be such that the throat radius is 75% of the duct width. In case throat radius is smaller, suitable single thickness vanes of approved details shall be provided.

4.10.4

FLASHING

For the ducts penetrating roofs or outside walls, provision of flashing shall be made by the ducting vendor.

4.11

DIFFUSERS AND GRILLS

The type and quantity of diffusers and grills is indicated on enclosed drawings/data sheet A. The size/quantity of diffusers/ grills indicated in the drawing/data sheet is indicative and is for vendor’s reference purpose only. Vendor shall ensure that the diffusers/grills offered are of requisite capacity, throw and terminal velocity. The pressure drop and noise levels shall be as per data sheet. A enclosed. The diffusers/grills shall be approved by purchaser.

Unless specified otherwise the diffusers/grills shall be of mild steel land painted with two coats of primer paint. Supply air grills shall be complete with volume control dampers. Supply air grills shall be double deflection type while Return Air grills can be single deflection type. Ceiling outlets/diffusers shall have volume control dampers, fixed grids and blanking baffles. All volume control dampers shall be operated by a key from the front of grills/diffusers.

Suitable vanes shall be provided in duct collars to have uniform air distribution. Blank-off baffles wherever required, shall also be provided.

4.12

PLENUMS AND RA BOXING

All plenum chambers and/or connections to fans, dampers etc. shall be constructed in 18 gauge GI sheet. supported on 40x40x6mm MS angle frames. All vertical angles shall be riveted at appox. 125mm. centres to the casing. Suitable caulking compound (Pecora or equivalent) shall be inserted between the base of the angle and all masonry construction to which angles are fastened.

Return air boxing requirements if any are indicated in data sheet-A and the same shall be provided by vendor. The return air box shall be fabricated out of GI sheets shall be insulated with 25mm thick fibre-glass.

4.13

ACCOUSTIC LINING

The ducts shall be lined acoustically from inside as given in data- sheet A and/or section C of the specification.

4.14

PAINTING

Wherever specified the ducts shall be painted or lined with suitable anti-corrosive paint/ lining as per approval of purchaser. In particular the ducts coming in contact with acid fumes shall be epoxy coated, inside and outside.

	TECHNICAL SPECIFICATION LOW PRESSURE AIR DISTRIBUTION SYSTEM	SPECIFICATION NO.PES-553-07	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 7 OF 9	

4.15	THERMAL INSULATION Thermal insulation shall be as per data sheet - A and the insulation shall conform to enclosed spec. no. PES-553-08.
5.	<u>INSPECTION AND TESTING</u>
5.1	INSPECTION & TESTING DURING FABRICATION
5.1.1	Visual inspection of GI sheets and angles, channels etc. – dents, black spots, chipping of zinc coating, white dust on galvanised sheets shall be avoided. Pitting , lamination in angles and channels shall be avoided.
5.1.2	Galvanised sheets - Test certificate shall be furnished for visual check, coating thickness, adhesion test, sheet thickness, uniformity of coating.
5.1.3	Check for dimensions & mass as per latest IS-277.
5.1.4	Check for defect, twists, ungalvanised spots as per IS-2629.
5.1.5	Bend test & wrapping test as per IS-277.
5.1.6	Zinc coating test on samples as per IS-6745.
5.2	<u>INSPECTION & TESTING AT SITE.</u>
5.2.1	The duct branches, elbows etc. shall be inspected and the joints and connections etc, are to be checked before they are assembled in position.
5.2.2	After completion, all duct systems shall be checked and tested for air leakage, tightness, velocity, pressure drop, vibration and noise etc.
6.	<u>BALANCING</u>
6.1.1	The entire air distribution system shall be balanced by vendor to supply the air quantities as required in various rooms so as to maintain the requisite temperature and air flow in the conditioned spaces. The final balance of air quantities through each grill/diffuser etc. shall be recorded and submitted to purchaser for approval. Proper steps shall be taken to have a uniform temperature in all enclosures, with utmost care for noise level to be within tolerance limit
6.1.2	All instruments required for testing/balancing etc. of the air distribution system shall be provided by vendor.



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012


SHEET 8 OF 9

7. DATA TO BE FURNISHED BY VENDOR AFTER THE AWARD OF CONTRACT

- 7.1 Fabrication drawings of ducts and grilles, louvers, dampers, etc, including typical details of grilles dampers etc.
- 7.2 Test certificates in line with scope of inspection.
- 7.3 Other dimensional drawings & documents as may be required by purchaser for better understanding of the system & for preparation of operation, maintenance & instruction manual.


Anshul


S.A. Khan


Praveen Kishore



TECHNICAL SPECIFICATION
LOW PRESSURE AIR DISTRIBUTION
SYSTEM

SPECIFICATION NO.PES-553-07

VOLUME II B

SECTION D


REV. 02

DATE: 17.09.2012

SHEET 9 OF 9


Anshul


S A Khan


Praveen Kishore



LOW PRESSURE AIR DISTRIBUTION SYSTEM

DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 1 OF 2

Description

Data

- | | |
|--------------------------------|---|
| 1. General (List of areas) | : As per Specification/Tender drawing. |
| 2. GSS Duct Work | |
| a) Type | : GSS as per IS: 277
(Zinc coating as per Section-C of Specific Technical Requirements.) |
| b) Size | : As per Section-C of Specific Technical Requirements and bill of quantity. |
| 3. Acoustic lining | : Up to 5m length from AHU Outlet. |
| 4. Special painting | : Galvanised. |
| 5. Thermal Insulation | : Required in supply air duct in AC entire length. |
| 6. Diffusers (Circular/Square) | |
| 300 mm size | |
| 350 mm size | |
| 450 mm size | |
| 550 mm size | |
| 600 mm size | |
| Any other size | |
| 7. SA grilles (for each size) | : Bidder to estimate as per drawings./specification.
All grille frame and louvers shall be manufactured of at least 16 SWG Aluminium |
| 8. RA grilles (for each size) | : To suit air flow as per System requirements / Tender Drawings. |
| | : -do- |

NOTE:

- Duct sheet thickness shall be as per IS-655
- Opposed blade type volume control damper shall be provided at each supply air diffusers/grilles.
- Bidder to provide suitable gasketing at each duct flange.
- Fire damper shall be motor operated type, when otherwise specified under Section-C.
- Access door in ducting system shall be provided as required.
- MS Angle (painted) shall be used for duct supports etc.
- Velocity thru duct shall normally not exceed 9.0 M/sec for Air conditioning system. Maximum velocity (outlet) for supply air diffuser shall not exceed 2.5 m/sec.



LOW PRESSURE AIR DISTRIBUTION SYSTEM

DATA SHEET - A

VOLUME II-B

SECTION D

REV 00


DATE 17.09.2012

SHEET 2 OF 2

8. All Grilles & diffusers shall be supported with frame. Frame etc. shall be supplied by bidder.


Anshul


S A Khan


Pawan Kishore



TECHNICAL SPECIFICATION
CENTRIFUGAL PUMPS

SPECIFICATION NO.PES-553-04

VOLUME II B

SECTION D

REV. 02


DATE: 17.09.2012

SHEET 1 OF 10

**STANDARD TECHNICAL SPECIFICATION
FOR
CENTRIFUGAL PUMPS**


Anshul


S A Khan


Praveen Kishore



TECHNICAL SPECIFICATION **CENTRIFUGAL PUMPS**

SPECIFICATION NO.PES-553-04

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 2 OF 10

1. GENERAL

1.1 This specification covers the design, material, constructional features, manufacture, assembly, inspection and testing at manufacturer's or his subcontractor's works, suitable painting requirements of centrifugal pumps and drives complete with all accessories as specified hereinafter.

2. CODES AND STANDARDS

2.1 The design, manufacture, inspection, testing & performance of the pumps as specified hereinafter, shall comply with the requirements of the latest revision of the following standards as indicated below (as applicable):

- 2.1.1 IS-1520 : Horizontal centrifugal pumps for clear, cold and fresh water.
- 2.1.2 IS-5120 : Technical requirements - Rotodynamic special purpose pump.
- 2.1.3 IS-1710 : Vertical turbine pumps for clear, cold and fresh water.
- 2.1.4 BS - 599 : Method of testing Pumps.
- 2.1.5 PTC - '6' : Centrifugal Pumps Power test code
- 2.1.6 API - 610
- 2.1.7 Hydraulic Institute Standards of USA

Wherever standards for certain aspects materials etc., not mentioned, the same shall be as per the applicable Indian or International standards.

2.2 In case of any conflict between the above codes/standards and this specification, the later shall prevail and in case of any further conflict in this matter, the decision of Purchaser's engineering shall be final and binding.

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 3 OF 10	

3.

DESIGN REQUIREMENTS

3.1

The pumps shall be of heavy duty suitable for long periods of uninterrupted service and shall be standard product of the manufacturer thoroughly proven for satisfactory performance and reliability.

3.2

The materials of construction of various components shall be as indicated under Data Sheet-A and where not specified to the applicable Indian/British/American standards..

3.3

All pressure containing components including the pump casing, nozzles and stuffing box housing shall be designed, fabricated and tested in accordance with applicable Indian standards if not specified otherwise.

3.4

The pump shall be suitable for handling the fluid as specified in Data Sheet-A.

4.

CONSTRUCTION FEATURES:

4.1

PUMP CASING

4.1.1

Pump casing may be axially or radially split or barrel type construction as specified in the pump data specification sheet. The casing shall be designed to withstand 1.5 times the maximum pressure developed by the pump at the pumping temperature.

4.1.2

Pump casing shall be provided with adequate number of vent and priming connections with valves, unless the pump is made self venting & priming. Casing drain, as required, shall be provided complete with drain valves or plugged with threaded plugs as required.

4.1.3

Pump shall preferably be of such construction that it is possible to service the internals of the pump without disturbing suction and discharge piping connections.

4.1.4

Under certain conditions, the pump casing nozzles will be subjected to reactions from external piping. Pump design must ensure that the nozzles are capable of withstanding external reactions not less than those specified in API-610

4.2

IMPELLER

4.2.1

Unless specifically indicated under Data Sheet-A enclosed, the pump impellers shall be of closed vane type. The impellers shall be secured to the shaft and shall be retained against circumferential movement by keying, pinning or lock rings. Impellers shall be checked for eccentricity and statically and dynamically balanced individually. The assembled rotor shall be dynamically balanced and checked for eccentricity. Supplier shall ensure during balancing that wall thickness of impeller vane, shroud etc is maintained above the minimum thickness requirement as per design.

4.3

WEARING RING

4.3.1

Renewable wearing rings for the casing and/or the impellers and renewable shaft sleeves, shall be provided for all pumps. Length of the shaft sleeves must extend



TECHNICAL SPECIFICATION

CENTRIFUGAL PUMPS

SPECIFICATION NO. PES-553-04

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 4 OF 10

beyond the outer faces of gland packing or seal and plate so as to distinguish between the leakage between shaft & shaft sleeve and that past the seals/gland.

4.4 **SHAFT**

4.4.1 Shaft size selected shall take into consideration the critical speed which shall be away from the operating speed as recommended in applicable Code/Standard. The critical speed shall also be at least 10% away from runaway speed.

4.5 **BEARING**

4.5.1 Bearings and hydraulic devices, of approved make, (if provided for balancing axial thrust) of adequate design shall be furnished for taking the entire pump load arising from all probable conditions of continuous operation throughout its Range of Operation and also at the shut off condition. The bearing shall be designed on the basis of 20,000 working hrs minimum for the load corresponding to the duty point. Proper lubricating arrangement for the bearings shall be provided. The design shall be such that the bearing lubricating element does not contaminate the liquid being pumped. Where there is a possibility of liquid entering the bearing, suitable arrangement in the form of deflectors or otherwise shall be provided ahead of bearing assembly. Bearings shall be easily accessible without disturbing the pump assembly.

4.6 **STUFFING BOX**

4.6.1 Packed type stuffing boxes of adequate depth with lantern rings shall be provided to minimize the leakage. In all cases where the pump suction is below atmospheric pressure, the shaft packing shall be sealed by the liquid pumped by tapping off from the pump discharge itself and all pipes, valves, fittings etc., required for this shall be furnished by the manufacturer. Tubings used for connections shall be flexible metallic type preferably SS-304/316. PVC/ rubber tubings are not acceptable.

4.7 **SHAFT COUPLING**

4.7.1 The pumps shall be directly coupled to their drives through heavy-duty flexible coupling. Suitable sturdy coupling guards of min. 1.5 mm MS sheet/ Aluminium sheet shall be provided along with the coupling. The pump and its drive motor shall be mounted on a common base plate.

4.8 **BASE PLATE AND SOLE PLATE**

4.8.1 Unless otherwise stated the data specification sheet, a common base plate mounting both for the pump and drive shall be furnished. The base plate shall be of rigid construction, suitably ribbed and reinforced. Base plate and pump supports shall be so constructed and the pumping unit so mounted as to minimize misalignment caused by mechanical forces such as normal piping strain, hydraulic piping thrust, etc. Suitable drain taps and drip lip shall be provided. The external corners of the base plate shall be rounded to avoid sharp corners. Drilled holes shall have sufficient space around for proper seating of washer with nut. If required in the data specification sheet, steel sole plates shall be provided, below the base plate.

Anshul
Anshul

S A Khan
S A Khan

Praveen Kishore
Praveen Kishore

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 5 OF 10	
4.9 4.9.1 4.10 4.10.1 5. 5.1 5.2 5.3 5.4 6. 6.1 6.2 6.3 7. 7.1 7.1.1		PRIME MOVER The drive motor selected shall conform to the requirements of the enclosed motor specifications. LIFTING ARRANGEMENT Each pump and motor shall incorporate suitable lifting attachments e.g. lifting lugs or eye bolts etc., to facilitate erection and maintenance.. <u>PERFORMANCE REQUIREMENTS</u> The pump shall be designed to have best efficiency at the specified duty point. The pump set shall be suitable for continuous operation at any point within the Range of Operation as stipulated in the data specification sheets. Pump shall have a continuously rising head capacity characteristics from the specified duty point towards shut off point, the maximum being at shut off. Power capacity characteristic will be non-overloading type i.e. 110% of the design flow the power required to drive the pump will be practically the same as that at the design flow. Wherever specified in data sheet, pumps of each category shall be suitable for parallel operation. The head vs capacity, input power vs. capacity characteristics, etc., shall match to ensure equal load sharing and trouble free operation throughout the range. The pump motor set shall be designed in such a way that there is no damage due to the reverse flow through the pump which may occur due to any malfunction of the system. <u>DRIVE RATING</u> The power rating of the drive shall be selected such that a minimum margin of 15% is available over the pump input power required at the rated duty point. However, the drive rating shall not be less than the maximum power requirement at any point within the 'Range of Operation' specified. In cases where parallel operation of the pumps are specified the actual drive rating is to be selected by the bidder considering overloading of the pumps in the event of tripping of one of the operating pumps. The bidder under this specification shall assume full responsibility in the operation of the pump and the drive as one unit. <u>SCOPE OF INSPECTION AND TESTING</u> CASTING The Witnessing pouring and thereafter physical testing of castings of 'Critical' nature such as casings, impellers, diffusers. Castings shall have 'as cast' heat numbers	

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 6 OF 10	
		unless they require overall machining. For partially machined components manufacturer shall ensure availability of as cast heat nos. on unmachined area.	
7.1.2	Identification and correlation with test reports for all tests as per the relevant material specifications for castings of ‘Major’ nature such as suction bell, discharge elbow, stuffing box, gland, wearing rings, shaft sleeves etc.		
7.1.3	Foundry’s conformity certificate for castings of ‘Minor’ nature such as base plates, covers etc.		
7.1.4	Verification of Heat treatment charts (as applicable)		
7.1.5	Castings may be required to meet NDT requirements such as Radiography, Magnetic Particle Testing or Dye-penetrant testing prior to Hydro-test as per requirements specified in Quality Plan.		
7.1.6	Surface finish of Steel castings shall meet MSS SP-55.		
7.2	FORGING		
7.2.1	Identification and correlation with mill test certificates for all tests as per the relevant specifications for important forgings like casings, stage bodies, diffusers, shaft material.		
7.2.2	Verification of heat treatment charts (time temperature) (as applicable).		
7.2.3	Forgings may be required to meet NDT requirements such as Radiography, Magnetic Particle Testing or Dye-penetrant testing prior to Hydro-test as per requirements specified in Quality Plan.		
7.3	FABRICATED ITEMS		
7.3.1	Identification and correlation with mill test certificates for material of items such as discharge bellows, column pipes etc.		
7.3.2	Approval of welding procedure specifications and qualifications of weld procedures and personnel as per ASME Sec IX.		
7.3.3	Dye penetrant tests of weldment as per ASTM E-165 and acceptance norm as per ASME Sec.VIII, Div.1, Appendix 8		
7.3.4	Verification of heat treatment charts (time temperature), (as applicable)		
7.3.5	Note: For para 7.1.2, 7.2.1 and 7.3.1 above; in case correlating original test certificates are not available, material shall be identified by Main Vendor and test conducted at NABL approved Laboratory.		
7.4	IN PROCESS INSPECTION AND TESTING		
7.4.1	Identification Dye penetrant testing after machining for impellers including vanes, pump shaft, diffusers as per applicable code; in absence of which, as per ASTM E - 165. Permissible defects and acceptance norms need to be specified. On static parts acceptance norms are as per ASME Sec.III NB 2546.		
7.4.2	Ultrasonic testing of dynamic duty component, i.e. pump shafts (50mm dia and above) and static duty forgings i.e. Barrel, casting (15mm and above wall thickness)		

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 7 OF 10	
		as per applicable code, in absence of which as per ASTM E388 and acceptance norms as stipulated hereunder. Probe shall be of min. 2 MHz frequency.	
7.4.3	Acceptance norms for UT for dynamic duty components. the following defects are unacceptable		
	a) Cracks, flakes, seams and laps		
	b) Defects giving indications longer than that from a 4mm equivalent flaw.		
	c) Group of defects with maximum indications less than that from a 4mm equivalent flaw, which cannot be separated at testing sensitivity, if the back echo is reduced to less than 50%.		
	d) Defects giving indications of 2 to 4mm dia. equivalent flaw separated by distance less than four times the size of the larger of the adjacent flaw.		
7.4.4	For static duty components - as per NB 2542.2 of ASME Sec. III		
7.4.5	Hydro tests of all pressure parts such as casings, column pipes, discharge elbows etc., at two times duty point pressure or 1.5 time shut off pressure, whichever is higher for 30 min., without any leakage.		
	Note : In case the pump is required to boost certain pressure, the inlet pressure head shall also be taken into consideration to compute test pressures		
7.4.6	Static and dynamic balancing of individual impellers and also assembled rotors as per V.D.I. 2060 Q 6.3 or ISO 1940 G 6.3.		
7.5	PERFORMANCE TEST		
7.5.1	Pump testing with unit supply motor as per specifications and acceptance norms cited elsewhere, in absence of which as per IS 5120 latest edition. Performance shall be checked for minimum of 7 points (including shut off head and over load) following characteristics shall be checked.		
	a) Capacity V/s Head		
	b) Capacity V/s Power absorbed by pump		
	c) Capacity V/s pump efficiency		
	Note : For pump of fire protection system, performance test shall be conducted up to 150% of rated capacity.		
7.5.2	NPSH test in case specifically mentioned elsewhere.		
7.5.3	Vibration, noise level and temperature rise measurement. Noise level shall be within 85dB(A) at 1 metre distance. Vibration within satisfactory zone of VDI 2056 Group G machines. Temperature shall not exceed ambient + 40 deg. C.		
7.5.4	Overall dimensions as per GA drawings. One pump/type/size assembly with job motor shall be mounted on base plate, provided the components are ordered on the same manufacturer.		
7.5.5	Examination after selective opening up after running for pumps operating at speed over 1800 rpm and capacity exceeding 68M3/hr.		
7.5.6	Painting and packing as per technical specification.		

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 8 OF 10	

7.6	TEST AT SITE
7.6.1	The pumps will be tested at site by the purchaser to verify their performance. If the pumps fail to operate smoothly or within the required performance all such deficiencies shall be rectified by the manufacturer by making suitable alternatives in the pump set and additional tests required to show the effect of such alterations shall be performed by him.
7.7	PERFORMANCE GUARANTEE
7.7.1	The vendor shall guarantee the material and workmanship of all components as well as the operation of the pump as per requirement of this specification. The vendor shall also guarantee for each pump the total dynamic head at the specified rated capacity and also corresponding efficiency, brake horse power and shut off head
8.	<u>CLEANING, PROTECTION , PAINTING & PACKING</u>
8.1	Before shipment of the equipment to be supplied under this specification the necessary cleaning, flushing etc., as per manufacturers standard/ as specified for the contract in Data Sheet A/ elsewhere shall be done to remove all dirts, scales etc. Shop coats of rust inhibiting paints, lacquers etc., shall be applied to various parts as per manufacturers standard/ as specified for the contract in Data Sheet A/ elsewhere. Flanges, inlet and outlet pipe, etc shall be protected. Packing shall be done as per manufacturers standard/ as specified for the contract in Data Sheet A/ elsewhere.

	TECHNICAL SPECIFICATION CENTRIFUGAL PUMPS	SPECIFICATION NO.PES-553-04	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 9 OF 10	

9.	<u>DRAWINGS, TECHNICAL DOCUMENTS AND OTHER INFORMATION REQUIRED WITH THE PROPOSAL</u>
9.1	Fully dimensioned outline GA drawings of the pump motor assembly unit for each type and size offered. This drawing should include: a) Foundation base plate and sole plate details as applicable b) Civil foundation and anchor bolts details and loading data c) Minimum submergence required for the pump (if applicable)
9.2	Cross sectional drawing of the equipment showing the details of assembly of components and their material of construction and/ make with standard applicable codes.
9.3	Performance characteristics (Discharge capacity vs head, BHP and efficiency of the pumps.
9.4	Motor speed torque curve superimposed on pump speed torque curve. Required NPSH of pump.
9.5	Experience list about the supply and successful operation of similar pumps for similar application.
9.6	A comprehensive write up or brochure on the details of manufacturing and testing facilities in the shop of the manufacturer.
9.7	Quality plan for the equipment being offered, in BHEL format as practiced in the manufacturer’s works and Field Quality Plan for receipt, storage erection, commissioning & testing at site.
9.8	Data sheet-B with all the particulars filled in.
10.	<u>MANUFACTURERS NAME AND TAG. PLATES</u>
10.1	Each pump shall have a permanently attached brass/ Stainless steel tag on the body indicating the following information both in Hindi and English: a) Manufacturer’s name and trade mark. b) Design Capacity and Head. c) Design. d) Purchaser’s tag no. as furnished during the contract. The purchaser’s tag no. will be indicated by the Purchaser on the drawing submitted for approval by the vendor.



TECHNICAL SPECIFICATION
CENTRIFUGAL PUMPS

SPECIFICATION NO.PES-553-04

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 10 OF 10

11. DRAWINGS/DOCUMENT/DATA REQUIRED AFTER AWARD OF CONTRACT

- 11.1 Certified GA drawings of pump motor assembly weights, crane.
- 11.2 Detailed cross sectional drawings of the pump and motor assembly and all equipment & accessories supplied under the this specification along with details of material of construction with applicable standard codes.
- 11.3 Foundation drawings with details of foundation pocket indicating static as well as dynamic load and other data with dimensions.
- 11.4 Certified characteristics curves (discharge capacity vs. head, BHP and efficiency) of each type of pump and motor.
- 11.5 Material and other test certificates as required by the application clauses of this specification.
- 11.6 Motor speed torque curves super imposed on pump speed torque curves.
- 11.7 Quality plan along with complete details of testing and inspection requirements of centrifugal pumps in BHEL format. Vendor shall also furnish Field Quality Plan.
- 11.8 Installation , operation and maintenance manual.
- 11.9 Other drawings and data, if necessary.



CENTRIFUGAL PUMPS
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 1 OF 2

DESCRIPTION

DATA

- | | |
|------------------------------------|---|
| 1. Designation | : Condenser water and Chilled Water pumps for AC plant. |
| 2. Type | : Horizontal, Centrifugal pump or vertical split type casing pump . |
| 3. Quantity | : Refer to section-C of Specific Technical Requirements |
| 4. Installation | : On floating type foundation. |
| 5. Fluid to be handled | : Water |
| 6. Temperature of fluid | : To suit. |
| 7. Capacity M3/hr and TDH at rated | : To suit system requirements but head shall not be less than 25 MWC. |
| 8. Duty | : Continuous (24 hours / day) |
| 9. Suction condition | : Flooded |
| 10. Type of drive | : Direct |
| 11. Prime Mover | : LV AC motor |
| 12. Maximum speed | : 1500 RPM |
| 13. Type of lubrication | : Grease Lubrication |
| 14. Material | |
| a) Impeller | : Bronze to Grade IS: 318 Grade 2 |
| b) Pump shaft | : EN - 8 / Equivalent (Approved). |
| c) Casing | : CAST IRON TO IS: 210 Grade - 260. |
| d) Wearing ring | : Bronze to Grade IS:318 GR-2, Renewable type. |
| e) Shaft Sleeve | : -do- |
| f) Base plate | : Cast Iron to Grade FG-200 IS-210/M.S. fabricated. |
| g) Bolt and nuts. | : MS |
| h) Stuffing Box gland/bush case. | : Deep Bronze packing to be renewable with case. |



CENTRIFUGAL PUMPS
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 2 OF 2

i) Stuffing box Packing. : Flexible Graphite or PTFE (Asbestos shall not be used)

j) Pump motor coupling. : Flexible.

15. ACCESSORIES REQUIRED:-

The following accessories shall be provided by the bidder for each pump:

a) Suction & Discharge pressure gauges. : Yes.

b) Vent connection : Yes.

c) Drain piping up to common drain point : Yes
in plant room.

d) Companion flanges. : Yes

e) Common base plate. : Yes.

f) Suction strainer. : Yes

g) Isolating valve : Yes

h) NRV at pump outlet at inlet/outlet : Yes

i) Any special requirements : The Chilled Water pumps shall be suitably
insulated as per spec.

j) Inspection & Testing : As per specification enclosed elsewhere.



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

REV. 02


DATE:17.09.2012

SHEET 1 OF 6

**STANDARD TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**


Anshul


S.A. Khan


Pawan Kishore



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

REV. 02

DATE:17.09.2012

SHEET 2 OF 6

1 GENERAL

- 1.1 This specification covers the design, manufacture, inspection and testing at the manufacturer's works and suitable packing delivery and testing of the packaged air conditioning unit.

2 CODES AND STANDARDS

- 2.1 The design, manufacture, inspection, testing and performance of the packaged type air conditioning unit shall comply with all statutes, regulations and safety codes currently applicable in the locality where the equipment will be installed. The equipment shall also conform to the latest editions of the codes and standards specified herein under. Nothing in this specification shall be construed to relieve the vendor of this responsibility.

In particular, the packaged air conditioning Unit (max 7.5 TR capacity, ductable or non ductable type) or cassette type (up to 5 TR) shall conform to the latest editions of the following standards:

- 2.1.1 I.S.660 : Safety code for Mechanical Refrigeration.
- 2.1.2 I.S.5111 : Code of practice for measurement, and testing of refrigerant compressor.
- 2.1.3 I.S.659 : Safety code for air conditioning.
- 2.1.4 I.S.2494 : V Belt for industrial purpose.
- 2.1.5 I.S.3142 : V grooved pullies for V Belts.
- 2.1.6 I.S.4503 : Shell and tube type heat exchanger.
- 2.1.7 ARI 210 : Standard for/unitary air conditioning equipment
- 2.1.8 ARI 270 : Standard for application installation and servicing of unitary equipment.
- 2.1.9 ASHRAE-37 : Standard methods of testing for rating unitary air conditioning and heat pump / equipment.
- 2.1.10 ANSI-B9-1 : Safety code for mechanical refrigeration.

3 DESIGN AND CONSTRUCTIONAL REQUIREMENTS

3.1 Compressor


The compressor shall be hermetic or semi-hermetic or screw rotary type or scroll type. The same shall be suitable for R410A/R407C/R134A refrigerant. The compressor shall be mounted on anti-vibration spring/rubber pads and shall be positioned in such a way that it is freely accessible with sufficient space all around for easy maintenance. Safety controls like High and Low pressure cut-out overload and single phasing protection for the motors shall be provided. A crankcase heater shall also be provided, if considered necessary by the vendor.

3.2 CONDENSING UNIT

Shell and tube type water cooled condenser or air cooled condenser with adequate area shall be provided as specified in Data Sheet-A. The condensing unit shall be complete with


Anshul


S A Khan


Pawan Kishore



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

REV. 02

DATE:17.09.2012

SHEET 3 OF 6

multipass heads and shall be fitted with the following:

- 3.2.1 Hot gas inlet and liquid outlet connection with shut off valve for liquid.
- 3.2.2 Drain plug, air vent and test valve.
- 3.2.3 Water inlet and outlet connection with thermowell and suitable cocks respectively.
- 3.2.4 Relief valve and air purge valve (Fusible plug in place of relief valve not acceptable)
- 3.2.5 Any other accessory as recommended by the manufacturer for proper functioning of the equipment.

3.3 AIR HANDLING FAN

The air handling fan shall be of the centrifugal type and with forward curved blades. This shall be driven by means of a three phase induction motor through V belt drive. The fan static pressure shall be selected for passing air through high efficiency absolute filters, if specified in Data Sheet-A.

3.4 FILTERS

Filters shall be of dry panel type and shall be cleanable. The velocity of air across the filters shall not exceed 1.75m/sec (350FPM).

3.5 COOLING COIL

The cooling coil shall be of direct expansion type and shall be made of heavy gauge copper with aluminium fins. The fins shall be bonded to the copper tubes under hydraulic pressure. A distributor shall be provided for feeding the refrigerant to different sections of the coil. Rows shall be staggered in the directions of airflow. The velocity of air across coil shall not exceed 2.5M/Sec. (500 FPM).

3.6 CONTROLS

All necessary controls and accessories like thermostatic expansion valve, refrigerant solenoid valve, distributor, filter drier in the liquid lines, shut off valves, HP/LP cut out for compressor, thermostat with adjustable settings, overload and single phasing preventer for motor etc. are to be provided. The microprocessor based control panel shall be provided outside the packaged unit on one side. The control panel shall generally be in line with the specification for control panels given elsewhere.

The control shall be so interlocked that the fan shall be started independently first, and then only the compressor. Tripping of the compressor by the thermostat or compressor cut outs shall not trip the fan. The thermostat setting shall be adjustable

3.7 REFRIGERANT PIPING


The refrigerant piping shall be either heavy gauge copper as furnished in Data Sheet-A. The piping shall be completely factory assembled, pressure tested, dehydrated and initially charged with FREON gas and compressor oil. The line accessories shall include liquid line shutoff valve dehydrator, strainer, flow indicator and distributor etc.

3.8 CABINET

All the equipments, except control panel, mentioned above shall be provided within a heavy gauge sheet metal cabinet, of floor/ wall mounted type. This shall be given two coats of anti-corrosive and rust proof paint, finished with two coats of final paint . Painting shall be as per manufacturers std unless specified otherwise in data sheet 'A'. The interior of the cabinet shall be provided with thermal and acoustic insulation of minimum 25mm thick. The insulating material shall be fire proof.


Anshul


S A Khan


Praveen Kishore



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

REV. 02

DATE:17.09.2012

SHEET 4 OF 6

The front and back side of the cabinets shall be easily removable providing maintenance to all the interior parts.

All the electric wires within the cabinet shall run in flexible conduits and carry identification tags. The bottom side of the panel shall be specially ribbed to take care of the transportation.

3.9 OTHER ACCESSORIES

Each packaged air conditioner shall be provided with required number of neoprene rubber isolating pads.

4 CONTROL AND INTERLOCK REQUIREMENTS

The compressor shall have all protective devices like HP/LP cutouts, overload protection for the motor, single phasing preventor for motor etc.

The interlocking requirement shall be as indicated below:

4.1 The compressor shall not start, unless condenser water flow is achieved for water cooled condenser. The condenser flow shall be sensed by means of a flow switch.

4.2 The compressor shall not start unless the evaporator fan is started.

4.3 The tripping of compressor on HP/LP, overload or on thermostat shall not trip the fan.

4.4 Strip heater (if provided in the ducting system) shall not be switched on, unless the evaporator fan is started and airflow is established. For this purpose, an air stat on flow switch shall be used. The heater shall be separately controlled by humidistat/thermostat

4.5 A humidifying package, if specified in data sheet A, shall be controlled by humidistat.

5 TEST AND INSPECTION

5.1 Inspection and Testing at Manufacturer's Works

5.1.1 static and dynamic test for fans

5.1.2 Hydrostatic static test on condenser and cooling coil.

5.1.3 vacuum/pressure test for the complete refrigeration circuit.

5.1.4 Visual and Free running test of the packaged unit on test bed.

5.1.5 Free running test on compressor.

5.1.6 AIR CAPACITY WITH ANEMOMETER.

5.1.7 NOISE LEVEL- ≤ 85 dB(A).

5.1.8 Other tests as per approved qualities plan/scope of inspection.

5.2 Inspection and Testing at Site

5.2.1 Performance testing of the packaged unit for 72 hours in summer / monsoon & 24-hours in winter- Up-to 3 TR (individual M/c capacity) inside room temperature (Dry & wet bulb) will be checked with all machines in the room operating.


The actual days of testing shall be mutually agreed. During the above testing, the following readings shall be taken to compare the same with guaranteed performance data.

5.2.1.1 Condenser inlet and outlet pressure and temperature

5.2.1.2 Entering and leaving air temperature of the cooling coil air filters.


Anshul


S A Khan


Praveen Kishore



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

REV. 02

DATE:17.09.2012

SHEET 5 OF 6

- 5.2.1.3 Motor current for the compressor and blower.
- 5.2.1.4 Air quantity delivered by the fan. This shall be computed by adding air quantity leaving all the grilles entering the air filters.
Room temperature (Dry & wet bulb)
- 5.2.1.5 Test to ensure all controls and safety instruments are working properly.
During the above testing, noise level also will be checked to ensure that the same are within acceptable limits. Any undue vibration detected physically will be corrected.
All tools and instruments required for the above testing will be provided by the vendor.
- 6 PAINTING:**
The packaged unit shall be given two coats of primer paint finished with two coats of finish paint as per Manufacturers std. unless specified otherwise elsewhere/ Data sheet 'A'. The colour of finish paint will be as specified in Data Sheet-A.
- 7 GUARANTEES**
The package unit shall be guaranteed for performance measured in terms of the inside temperature maintained.
The packaged unit shall also be free from any manufacturing defects and shall be guaranteed as per contract after the first test as per 5.0 is successfully carried out, and the plant taken over by the purchaser.
- 8 NAME PLATES**
Suitable Name plate as per Data Sheet 'A', depicting the equipment number as designated in Data Sheet A shall be provided for each packaged unit and screwed to a prominent position on the packaged unit.



**TECHNICAL SPECIFICATION
FOR
PACKAGE CONDITIONING UNIT**

SPECIFICATION NO.PES-553-05

VOLUME II B

SECTION D

REV. 02

DATE:17.09.2012


SHEET 6 OF 6

9. DATA TO BE FURNISHED AFTER AWARD OF CONTRACT

- 9.1 Final technical data as per Data Sheet-B
- 9.2 G.A. and interior view of packaged unit
- 9.3 Electrical wiring diagram
- 9.4 Catalogues for all controls
- 9.5 O & M Manual
- 9.6 Erection Manual


Anshul


S A Khan


Pawan Kishore



PACKAGE-CONDITIONING UNIT
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 1 OF 1

DESCRIPTION

DATA

- | | |
|---|---|
| 1) Capacity of the unit at operating conditions. | : As specified |
| 2) Numbers required | : Refer to Section-C of Specific Technical Requirements |
| 3) Designation of the unit | : Package AC Unit |
| 4) Whether air cooled/water cooled | : Refer to Section-C of Specific Technical Requirements |
| 5) The plant shall be suitable for maximum-
- ambient temp. | : Refer outdoor design condition as specified. |
| 6) Whether a plenum Chamber required | : Units shall be connected to fresh air ducts. |
| OR | |
| Whether to be connected duct system. | : Yes. |
| 7) Whether Humidifier required for humidity-
-control. | : Refer to Section-C of Specific Technical Requirements |
| 8) Whether strip heaters required for winter
heating. | : Refer to Section-C of Specific Technical Requirements |
| 9) Whether strip heater required for Humidity
control. | : Refer to Section-C of Specific Technical Requirements |
| 10) Final painting colour shade | : Subject to approval / during detail engineering stage. |
| 11) Whether fan static pressure is to be
designed for filters arrangement shown. | : Yes. |
| 12) Installation supporting structure/
drain piping, insulation. | : Required. Drain piping with insulation up to the nearest drain point. |
| 13) Controls & Instruments | : Yes (Lot) |
| 14) Isolation Switch | : Yes |



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO.PES-553-06

VOLUME II B

SECTION D

REV. 02


DATE: 17.09.2012

SHEET 1 OF 4

**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**


Anshul


S.A. Khan


Pawan Kishore



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO.PES-553-06

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 2 OF 4

1. GENERAL

This specification covers the design, manufacture, inspection and testing at manufacturer's work or his sub-contractor's works of Air filters to be used for air-conditioning and ventilation system.

2. CODES AND STANDARDS

This design, manufacture and performance of AIR FILTERS shall comply with all currently applicable statutes, regulation and safety codes in the locality where the equipment will be installed. The equipment shall also conform to latest applicable Indian/British/USA standards. Nothing in this specification shall be construed to relieve the vendor of this responsibility. The following standards, in particular, shall be applicable for certified ratings of filters and for conducting performance test, if required.

a) BS EN - 779 -Methods of test for air filters used in air conditioning and general ventilation.

3. GENERAL

The enclosed Data sheet A gives the type and other particulars of filters required.

3.1 POLY FIBRE AIR FILTERS

Filtering media shall consist of a suitable fibrous material (e.g. polyethylene extruded sections coir etc.) packed into a 20 gauges GSS framework, complete with handles etc. The filter element shall be supported by galvanised steel wire mesh of 10mm. sq. on either side, Velocity across the filters shall not exceed 2.5 M/sec. Average efficiency E_m (%) shall be ≥ 80 as per BS EN - 779.

3.2 DRY FABRIC AIR FILTERS

Filter element shall be pressed felt filter fabric or suitable material recommended by the manufacturer, stitched on to galvanised wire gauge support and crimped to form deep folds. Suitable aluminium spacers shall be provided to ensure uniform distribution of air flow through filters. Filter casing shall be provided with neoprene sponge rubber sealing, The filter shall have Average efficiency E_m (%) of ≥ 95 as per BS EN - 779.


3.3 PANEL TYPE METALLIC FILTERS (DRY/VISCOUS)

Filter shall consist of V-fold galvanised wire mesh interspaced with flat layers of galvanised wire mesh. The density of media shall increase in the direction of air flow. Edges of wire mesh shall be suitably hemmed to prevent abrasion during handling. The media shall be supported on either side by galvanised expanded metal casing. The framework shall be at least 18 gauge GSS. Filter shall be either dry or wetted type as per data sheet=A. The oil shall be mineral oil of approved quality and make. As a the filter frame made of Aluminium alloy conforming to IS:737 can be considered unless use of aluminium is prohibited otherwise due to site conditions being saline/corrosive.

All filters shall be capable of being cleaned of their accumulated dust by tap water flushing. The dry metallic filter shall have Average arrestance A_m (%) shall be ≥ 90 .


Anshul


S A Khan


Pawan Kishore



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO. PES-553-06

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 3 OF 4

However oil wetted air filters shall have Average Efficiency E_m (%) ≥ 90 as per BS EN - 779..

3.4 AUTOMATIC CLEANING FILTERS

This shall consist of a filter mat and drop eliminator, driven by a suitably rated geared motor unit being supported on a steel framework. The filter mat shall consist of an endless steel wire mat insets of steel mesh held between an upper & a lower shall drop eliminator shall consist of an endless steel wire without insets of steel mesh. The unit shall include a suitable oil pump, gludge raking mechanism and sludge container and tensioning device. Pressure drop shall be limited to 0.5 / mm WG when clean & 10 mm when dirty. Air velocity across filter shall not exceed 3 M/sec.

3.5 ABSOLUTE FILTERS

Filters shall be constructed by pleating a continuous sheet of filter medium into closely spaced pleats separated by heavy corrugated aluminium spacers. They shall be individually tested and certified to have an efficiency of not less than 99.97% when tested with 0.3 micron dioctylphthalate smoke as per IS:2831. The clean filter initial static pressure drop shall not be greater than 25mm WC at rated capacity. A neoprene sponge rubber sealing shall be provided on either face of filter frame.

3.6 WATER REPELLANT NYLON FILTERS

This shall be constructed of water repellent nylon fabric with continuous water spraying on it from a header for keeping it clean. Efficiency of this filter shall be 85% down to 10 microns. This filter shall be used for unitary air filtration system only.

4. INSPECTION & TESTING

The scope of inspection for air filters shall be as below:

4.1 Dimensional inspection of frame & filter media.


4.2 Witnessing of type tests on one per type per size air filters for the following properties.

- a) Gravimetric efficiency.
- b) Pressure drop in clean & dirty (choked - %age to be specified) condition.
- c) Efficiency as per BS EN - 779.

4.3 Verification of type test certificates for similar type & size of filters for sodium flame test as per BS-3928 (if applicable- refer data sheet).


Anshul


S A Khan


Praveen Kishore



**STANDARD TECHNICAL SPECIFICATION
FOR
AIR FILTER**

SPECIFICATION NO.PES-553-06

VOLUME II B

SECTION D

REV. 02 DATE: 17.09.2012


SHEET 4 OF 4

5. DATA TO BE FURNISHED BY VENDOR AFTER AWARD OF CONTRACT

- 5.1 GA Drawing.
- 5.2 Drawing showing material/construction detail
- 5.3 Installation and\service manual
- 5.4 Rating curves/charts
- 5.5 Test certificates
- 5.6 Elect. diagrams (when automatic cleaning type)


Anshul


S A Khan


Praveen Kishore



**AIR FILTER
DATA SHEET - A**

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 1 OF 1

DESCRIPTION

DATA

1) General

- | | |
|------------------------------|--|
| 1.1 Service | : Air Conditioning. |
| 1.2 Location | : Central Air conditioning plant, & package AC plant, fresh air fan system. Also for split AC. |
| 1.3 Nos. | : Refer Section 'C' of Specification. |
| 1.4 Total air flow/type | : Refer Section 'C' of Specification. |
| 1.5 Temperature | : As per project information. |
| 1.6 Relative Humidity | : 100% |
| 1.7 Gas Composition | : Atmospheric Air (Dusty) as prevalent in power Station. |
| 1.8 Filter Media | : Synthetic non-woven |
| 1.9 Efficiency | : Average arrestance efficiency of 65-80 % for Dry Panel filter (pre-filters) and average arrestance Efficiency of 80-90 % for fine filters. |
| 1.10 Allowable pressure drop | : 2.5 mm & 6.5 mm in clean and dirty condition respectively for dry panel filters(prefilters).
12 mm in clean condition for fine filters. |
| 1.11 Frame Work | : 18 G, GSS. |
| 1.12 Mounting | : Ladder Type M.S Angles (galvanised) |
| 1.13 Size | : 600 x 600 mm |

Note:-

- 1) Face velocity of air across the filters shall not exceed 2.5 m/sec.



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD
SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

REV. 02


DATE: 17.09.2012

SHEET 1 OF 6

STANDARD TECHNICAL SPECIFICATION
FOR
THERMAL INSULATION FOR COLD SURFACES


Anshul


S.A. Khan


Pawan Kishore

	TECHNICAL SPECIFICATION THERMAL INSULATION FOR COLD SURFACES	SPECIFICATION NO.PES-553-08	
		VOLUME II B	
		SECTION D	
		REV. 02	DATE: 17.09.2012
		SHEET 2 OF 6	

1.

SCOPE

This specification covers design, manufacture, testing at manufacturers works, supply, application & finishing of insulation for cold piping, air conditioning ducting & equipment for low temperature service.

2.

CODES & STANDARDS

The design, manufacture and performance of materials covered under this specification shall comply with all currently applicable statues, regulations & safety codes in the locality where the equipment/material are to be installed. The material shall also conform to the latest applicable Indian/British/American codes & standards. Nothing in this specification shall be construed to relieve the vendor of his responsibility. In particular, the material shall conform to the latest editions of the following standards :-

IS:3069: GLOSSARY OF TERMS & SYMBOLS & UNITS RELATING TO THERMAL INSULATION

materials.

2.1 IS:4671: Expanded polystyrene for thermal insulation purposes.

2.2 IS:3677: Mineral wool for thermal insulation.

2.3 IS:8183: Resin bonded mineral wool.

3.

DESIGN REQUIREMENTS

3.1 The insulating material as well as protective covering shall be new & unused, non-corrosive, vermin/rodent proof and shall be guaranteed to withstand continuously & without deterioration the maximum/minimum temperatures to which they may be subjected to, under specified site conditions.

3.2 The insulation material must be light weight, strong, free from shots & coarse fibre & shall provide high insulation efficiency at low weight & coat. It should be non-hygroscopic & should not rot. It shall not settle or shake down even when subjected to prolonged vibrations.

3.3 The insulation material, density and thickness etc. Shall be as specified in DATA SHEET A.

4.

APPLICATION DETAILS

4.1 The surface to be insulated shall be thoroughly cleaned and allowed to dry. Pressure/hydrostatic tests, if any, shall be carried out before application of insulation.

4.2 A layer of solvent free, anticorrosive paint shall be applied & allowed to dry.

4.3 Hot industrial bitumen of grade 85/40 or 85/25 conforming to latest IS:702 shall be uniformly applied @ 1.5 kg/sq.m on the surface to be insulated. A similar layer shall also be applied on the inside surface & edges of the insulation. A suitable cold adhesive compound may also be used in place of bitumen.

4.4 Insulation in the form of pipe sections/rolls slabs of specified density & thickness shall be stuck to the coated surface with joints staggered & well butted & secured. The adjoining sections shall be tightly pressed together. All the joints shall be sealed with



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 3 OF 6

bitumen/equivalent adhesive. Voids if any shall be packed with suitably cut pieces of insulation material.

- 4.5 In case of double layer application both circumferential & longitudinal joints shall be suitably staggered.

5. VAPOR SEALING & INSULATION FINISH

The insulation shall be treated for vapor sealing & weather proofing & finished as specified in DATA SHEET A The acceptable types of finishes are outlined below:-

5.1 FINISHING SYSTEM I: EXTERNAL INSULATION WITH PLASTER FINISH

- 5.1.1 A thick vapor seal of hot bitumen @ 2.5 kg/Sqm shall be applied on the outer surface of insulation & allowed to dry.

- 5.1.2 The surface shall then be wrapped with 20mm (3/4" hexagonal mesh of 24 SWG GI wire, butting all the joints & laced down with 22 SWG GI lacing wire.

- 5.1.3 12.5mm (1/2 inch) thick sand cement plaster in the ratio of (1:1) shall be applied in two layers, the second layer being brought to a smooth finish. A water proofing compound shall be added to the cement before its application.

5.2 FINISH SYSTEM II: EXTERNAL INSULATION WITH PLASTER FINISH OVER POLYTHENE.

- 5.2.1 The insulation shall be covered with 500 g polythene/polythene bonded Hessians (PBH) with 50mm overlap on longitudinal & circumferential joints. Overlaps shall be sealed with synthetic adhesive in case of polythene & liberal coat of bitumen in case of PBH:

- 5.2.2 The surface shall then be wrapped with 20mm (3/4") mesh of 24 SWG GI wire butting all the joints & laced down with 22 SWG GI lacing wire.

- 5.2.3 12.5mm thick (1/2 inch) sand cement plaster in ratio of(4:1) shall be applied in two layers, the second layer being brought to a smooth & even finish similarly as described above.

5.3 FINISH III:EXTERNAL INSULATION WITH SHEET METAL FINISH

- 5.3.1 The insulation shall be covered with 500g polythene with 50mm overlaps at joints which shall be sealed with synthetic adhesive or equivalent compound.

- 5.3.2 The polythene shall be covered with 24 gauge GI/aluminum sheet

- 5.3.3 25mm wide x 22 SWG GI/aluminum peripheral straps shall be fixed over the GI/aluminum sheet at 300mm centres to secure.

5.4 FINISH IV: EXTERNAL INSULATION WITH PLASTER & WATER PROOFING COMPOUND

For ducts & piping exposed to atmosphere, the finish shall be as follows:

- 5.4.1 A thick vapor seal of hot bitumen at 2.05 kg/sq.m shall be applied on the outer surface of insulation & allowed to dry.

- 5.4.2 The surface shall then be wrapped with 20mm (3/4") hexagonal mesh of 24 SWG GI Wire butting all the joints & laced down with 22 SWG GI lacing wire.

- 5.4.3 12.5mm thick (1/2 inch) sand cement plaster in ratio of (4:1) shall be applied in two layers, the second layer being brought to a smooth finish with water proofing compound added to the cement.

Anshul
Anshul

S A Khan
S A Khan

Priyanka Kishore
Priyanka Kishore



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012


SHEET 4 OF 6

5.4.4

3 mm (1/8") thick coat of water proofing compound shall be applied & wrapped with fibre glass RP tissue. A final coat of 3mm thick water proofing compound shall then be applied over the fiberglass RP tissue & allowed to dry. Alternatively, in place of water proofing as desired above, tar felt type 3 grade 1 of IS 1322 with joints overlapped by 75mm shall be fixed & sealed with bitumen & over this 24 SWG. 25mm hexagonal GI mesh shall be fixed with 22 swig. GI lacing wire & finally bitumen paint shall be applied over wire netting.


Anshul


S.A. Khan


Pawan Kishore



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 5 OF 6

6. INSULATION OF PUMPS & VALVES

6.1 For all inspection covers & hatches on equipment, pump casing & valve bodies, flanges etc. the insulation shall be applied such as to facilitate removal with minimum damage to the insulation. This shall be achieved by encasing the insulation in 22 gauge aluminum sheet metal boxes, which shall be bolted together around the equipment to permit easy removal & replacement. Proper care shall be taken to maintain continuity of vapor seal between the static & removable partitions of the insulation.

6.2 The tenderer may offer thickness of insulation & finishes other than that specified in DATA SHEET A. However, calculations/reasons in support of alternative proposal shall be furnished for purchaser's approval.

7. INSPECTION & TESTING (REFER SPEC. NO - PES-553.00)

7.1 All necessary tests, as required to ensure that the material supplied conform to the requirements of applicable codes & standards, shall be carried out at manufacturer's works & test certificates including these for material/accessories shall be furnished for purchasers approval.

8. PAINTING

8.1 Pipe work having insulation & cladding shall be provided with color identification for the fluids handled and for indicating direction of flow.

8.2 Equipment surfaces having insulation and cladding shall also have identification numbers and any other relevant data provided on the insulated surface.

8.3 All painting for insulated surfaces shall conform to the requirement specified elsewhere.

Anshul
Anshul

S.A. Khan
S.A. Khan

Praveen Kishore
Praveen Kishore



TECHNICAL SPECIFICATION
THERMAL INSULATION FOR COLD SURFACES

SPECIFICATION NO.PES-553-08

VOLUME II B

SECTION D

REV. 02

DATE: 17.09.2012

SHEET 6 OF 6

9. DATA TO BE FURNISHED AFTER AWARD OF CONTRACT

- 9.1 Final version of data sheet 'B' incorporating changes if any along with design data.
- 9.2 Test certificates/reports giving result of insulation to ensure conformance to applicable codes & standards & in particular the following:-
- a) Thermal conductivity test.
 - b) Sound absorption coefficient test.
 - c) Corrosion test.
 - d) Sulphur content, moisture content, shot content, moisture absorption etc.
 - e) Compressive strength & cross breaking strength test.
- 9.3 Sketches/technical literature/sectional drgs. indicating insulation materials finish and method of application etc.
- 9.4 Manual dealing with safety aspects & instructions for combating fire arising out of insulation work.
- 9.5 Instructions on maintenance of insulation work.



THERMAL INSULATION
FOR COLD SURFACE
DATA SHEET - A

VOLUME II-B

SECTION D

REV 00

DATE 17.09.2012

SHEET 1 OF 1

Insulation Material

Insulation	Code	Thermal Conductivity MW/cm ⁰ C	Density Kg/m ³
Resin bonded mineral wool / glass wool	IS:8183	0.49 at 50 °C	At least 24 for duct insulation and 48 for acoustic lining.
Mineral Wool Pipe Section (min. Gr.2)	IS:9842	0.43 at 50 °C	At least 81
Expanded Polystyrene	IS:4671	0.37 at 10 °C	At least 15

Type of Insulation

S.No.	Surface	Insulation Material	Insulation Form	Thickness (mm)
i)	Supply & Return air duct for air-conditioning system	Resin bonded roll Mineral Wool (IS:8183)		25
ii)	Refrigerant Piping	a) Expanded Polystyrene or b) Mineral Wool	Pipe Section Pipe Section	75 75
iii)	AHU drain pipe	a) Expanded Polystyrene or b) Mineral Wool	Pipe Section Pipe Section	25 25
iv)	AHU drain pan coil section and fan section	a) Expanded Polystyrene or b) Mineral Wool	Slabs Slabs	25 25
v)	Chilled water piping, valves & specialties	a) Expanded Polystyrene or b) Mineral Wool	Pipe Section Pipe Section	75 75
vi)	Chiller	a) Expanded Polystyrene or b) Mineral Wool	Slabs Slabs	100 100
vii)	Chilled Water Pumps	a) Expanded Polystyrene or b) Mineral Wool	Slabs Slabs	50 50
viii)	Expansion tank with pipe	a) Expanded Polystyrene or b) Mineral Wool	Slabs/Pipe Section Slabs/Pipe Section	50 50

Anshul

S.A. Khan

Praveen Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
FORMAT FOR OPERATION AND
MAINTENANCE MANUAL**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV 00

DATE: Feb 2017

SHEET 1 OF 4

SECTION-II

ANNEXURE-I

FORMAT FOR OPERATION AND MAINTENANCE MANUAL



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
FORMAT FOR OPERATION AND
MAINTENANCE MANUAL**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV 00

DATE: Feb 2017

SHEET 2 OF 4

Project name :
Project number :
Package Name :
PO reference :
Document number :
Revision number :

Sl.no. & Sections	Description	Tick (√)if included in Manual			Remarks
		Yes	No	Not Applicable	
1.	COVER PAGE				
1.1	Project Name				
1.2	Customer/consultant Name				
1.3	Name of Package				
1.4	Supplier details with phone, FAX ,email address , Emergency Contact number				
1.5	Name and sign of prepared by , checked by & approved by				
1.6	Revision history with approval Details				
2.0	INDEX				
2.1	showing the sections & related page nos All the pages should be numbered section wise				
3.0	DESCRIPTION OF PLANT/SYSTEM				
3.1	Description /write up of operating principle of system equipment/ associated sub-systems & accessories/controls system , operating conditions, performance parameters under normal , start up and special cases				
3.2	Equipment list and basic parameter with Tag numbers				
3.3	Data sheets approved by Customer/for information and catalogues provided by original manufacturer				
3.4	Associated other packages and Interface /terminal points				
3.5	P&ID & Process Diagrams				
3.6	GA Layout drawings, As-built drawings , Actual photograph of items/system (Drawings of A2 & bigger sizes are to be attached in the last)				
3.7	Single line/wiring diagrams				
3.8	Control philosophy /control write-ups				



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
FORMAT FOR OPERATION AND
MAINTENANCE MANUAL**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV 00

DATE: Feb 2017

SHEET 3 OF 4

Sl.no. & Sections	Description	Tick (V)if included in Manual			Remarks
		Yes	No	Not Applicable	
4.0	COMMISSIONING ACTIVITIES (IF NOT COVERED IN SEPARATE DOCUMENT I.E. ERECTION MANUAL, COMMISSIONING MANUAL)				
4.1	Pre-Commissioning Checks				
4.2	handling of items at site				
4.3	Storage at site				
4.4	Unpacking & Installation procedure				
5.0	OPERATION GUIDELINES FOR PLANT PERSONAL/USER/OPERATOR				
5.1	Interlock & Protection logic along with the limiting values of protection settings for the equipment along with brief philosophy behind the logic, drawings etc. to be provided.				
5.2	Start up, normal operation and shut down procedure for equipments along with the associated systems in step by step mode. Valve sequence chart, step list, interlocks etc. with Equipment isolating procedures to be mentioned.				
5.3	Do's & Don't of the equipments.				
5.4	Safety precautions to be taken during normal operation. Safety symbols, Emergency instructions on total power failure condition/lubrication failure/any other condition				
5.5	Parameters to be monitored with normal values and limiting values				
5.6	Trouble shooting with causes and remedial measures				
5.7	Routine operational checks, recommended logs & records				
5.8	Changeover schedule if more than one auxiliary for the same purpose is given				
5.9	Painting requirement and schedule				
5.10	Inspection, repair , Testing and calibration procedures				
6.0	MAINTENANCE GUIDELINES FOR PLANT PERSONAL				

Anshul
Anshul

S.A. Khan
S.A. Khan

Praveen Kishore
Praveen Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
FORMAT FOR OPERATION AND
MAINTENANCE MANUAL**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV 00

DATE: Feb 2017

SHEET 4 OF 4

Sl.no. & Sections	Description	Tick (V)if included in Manual			Remarks
		Yes	No	Not Applicable	
6.1	List of Special Tools and Tackles required for Overhaul/Trouble shooting including special testing equipment required for calibration etc.				
6.2	Stepwise dismantling and re-assembly procedure clearly specifying the tools to be used, checks to be made, records to be maintained, clearances etc. to be mentioned. Tolerances for fitment of various components to be given.				
6.3	Preventive Maintenance & Overhauling schedules linked with running hours/calendar period along with checks to be given				
6.4	Long term maintenance schedules especially for structural, foundations etc.				
6.5	Consumable list along with the estimated quantity required during commissioning, normal running and during maintenance like Preventive Maintenances and Overhaul. Storage/handling requirement of consumables/self-life.				
6.6	List of lubricants with their Indian equivalent, Lubrication Schedule, Quantity required for each equipment for complete replacement is to be given				
6.7	List of vendors & Sub-vendors with their latest addresses, service centres ,Telephone Nos., Fax Nos., Mobile Nos., e-mail IDs etc.				
6.8	List of mandatory and recommended spare parts list				
6.9	Tentative Lead time required for ordering of spares from the equipment supplier				
6.10	Guarantee and warranty clauses				
7.0	Statutory and other specific requirements considerations.				
8.0	List of reference documents				
9.0	Binding as per requirement				



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
SITE STORAGE AND PRESERVATION**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV 00

DATE: Feb 2017

SHEET 1 OF 16


SECTION-II

ANNEXURE-II

SITE STORAGE AND PRESERVATION


Anshul


S A Khan


Praveen Kishore

SITE STORAGE AND PRESERVATION GUIDELINES FOR MECHANICAL BOPs

(Doc No: PE-DC-SSG-A001 REV.00)



PROJECT ENGINEERING MANAGEMENT, POWER SECTOR
BHARAT HEAVY ELECTRICALS LIMITED-NOIDA

CONTENT

- 1 SCOPE OF THE DOCUMENT
- 2 PURPOSE OF STORAGE & PRESERVATION
- 3 MEASURES TO BE TAKEN FOR STORAGE AND PRESERVATION
 - a) GENERAL STORAGE REQUIREMENTS
 - b) GENERAL PRESERVATION REQUIREMENTS
 - c) GENERAL INSPECTION REQUIREMENTS
- 4 TYPE OF STORAGE FOR VARIOUS EQUIPMENT
5. CONCLUSION
6. STACKING ARRANGEMENT FOR PLATES AND STRUCTURAL STEEL

1. SCOPE OF THE DOCUMENT

This guideline is prepared in intent to provide proper site storage and preservation of the Mechanical, Electrical and C & I items / equipment supplied under various bought out packages/items. This storage procedure shall be followed at different power plant sites by concerned agency for storage and preservation from the date of equipment received at site until the same are erected and handed over to the customer.

2. PURPOSE OF STORAGE & PRESERVATION

Many of the items may be required to be kept in stores for long period. It shall therefore be essential that proper methods of storage and preservation be applied so that items do not deteriorate, loose some of their properties and become unusable due to atmospheric conditions and biological elements.

3. MEASURES TO BE TAKEN FOR STORAGE, HANDLING & PRESERVATION

a) GENERAL STORAGE REQUIREMENTS

1. To the extent feasible, materials should be stored near the point of erection. The storage areas should have adequate unloading and handling facilities with adequate passage space for movement of material handling equipment such as cranes, fork lift trucks, etc. The storage of materials shall be properly planned to minimise time loss during retrieval of items required for erection.
2. The outdoor storage areas as well as semi-closed stores shall be provided with adequate drainage facilities to prevent water logging. Adequacy of these facilities shall be checked prior to monsoon.
3. The storage sheds shall be built in conformity with fire safety requirements. The stores shall be provided with adequate lights and fire extinguishers. 'No smoking' signs shall be placed at strategic locations. Safety precautions shall be strictly enforced.
4. Adequate lighting facility shall be provided in storage areas and storage sheds and security personnel positioned to ensure enforcement of security measures to prevent theft and loss of materials.
5. Adequate number of competent stores personnel and security staff shall be deployed to efficiently store and maintain the equipment / material.
7. The equipment shall be stored in an orderly manner, preserving their identification slips, tags and instruction booklets, etc., required during erection. The storage of materials shall be equipment-wise. Loose parts shall be stored in sheds on racks,

preserving the identification marks and tags in good condition. The group codes shall be displayed on the racks

6. At no time shall any materials be stored directly on ground. All materials shall be stored minimum 200 mm above the ground preferably on wooden sleepers

b) GENERAL PRESERVATION REQUIREMENTS

1. All special measures to prevent corrosion shall be taken like keeping material in dry condition, avoiding the equipment coming in contact with corrosive fluid like water, acid etc.
2. Materials which carry protective coating shall not be wrapped in paper, cloth, etc., as these are liable to absorb and retain moisture. The material shall be inspected and in case of signs of wear or damages to protective coating, that portion shall be cleaned with approved solution and coated with an approved protective paint. Complete record of all such observations and protective measures taken shall be maintained.
3. Generally equipment supplied at site are properly greased or rust protective oil is applied on machined/ fabricated components. However periodic inspection shall be carried out to ensure that protection offered is intact.
4. While handling the equipment, no dragging on the ground is permitted. Avoid using wire rope for lifting coated components. Use polyester slings (if possible) otherwise protective material (e.g. clothes, wood block etc.) should be used while handling the components with rope / slings
5. For Equipment supplied with finished paint, touch paint shall be done in case any surface paint gets peeled off during handling. Otherwise such surfaces shall necessarily be wrapped with polythene to avoid any corrosion. Further for equipment wherein finish coat is to be applied at site, site to ensure that equipment is received with primer coat applied.
6. It shall be ensured by periodic inspection that plastic inserts are intact in tapped holes, wherever applicable.
7. Pipes shall be blown with air periodically and it shall be ensured that there is no obstruction.
8. Silica gel or approved equivalent moisture absorbing material in small cotton bags shall be placed and tied at various points on the equipment, wherever necessary.
9. Heavy rotating parts in assembled conditions shall be periodically rotated to prevent corrosion/jamming due to prolonged storage.

10. All the electrical equipment such as motors, generators, etc. shall be tested for insulation resistance at least once in three months and a record of such measured insulation values shall be maintained.
11. Following preservatives/preservation methods can be used depending upon type of equipment
 - a. Rust preventive fluid (RPF)
 - b. Rust protective paints
 - c. Tarpaulin covers, in case of outdoor storage
 - d. De-oxy aluminate for weld-ments

c) GENERAL INSPECTION REQUIREMENTS

1. Period inspection of materials with specific reference to –
 - Ingress of moisture and corrosion damages.
 - Damage to protective coating.
 - Open ends in pipes, vessels and equipment -
 - In case any open ends are noticed, same shall be capped.
2. Any damages to equipment / materials.
 - In case of any damages, these shall be promptly notified and in all cases, the repairs / rectification shall be carried out.
 - Any items found damaged or not suitable as per project requirements shall be removed from site. If required to store temporarily, they shall be clearly marked and stored separately to prevent any inadvertent use.

4. TYPE OF STORAGE FOR VARIOUS EQUIPMENT

The types of storage are broadly classified under the following heads:

i **Closed storage with dry and dust free atmosphere. (C)**

The closed shed can be constructed by using cold-rolled / tubular components for structure and corrugated asbestos sheets / galvanised iron sheets for roofing. Brick walls / asbestos sheets can be used to cover all the sides. The floor of the shed can be finished with plain cement concrete suitably glazed. The shed shall be provided with proper ventilation and illumination.



ii **Semi-closed storage. (S)**

The semi closed shed can be constructed by using cold-rolled / tubular components for structure and corrugated / asbestos sheets for roofing. The floor shall be brick paved. If required a small portion of sides can be covered to protect components from rainwater splashing onto the components.





iii Open storage (O)

The open yard shall be levelled, well consolidated to achieve raised ground with the provision of feeder roads for crane approach along with access roads running all sides. One part of the open yard shall be stone pitched, levelled and consolidated with raised ground suitable for storing / stacking heavier and critical components with due space to handle them by cranes etc . Adequate number of sleepers, concrete block etc. to be provided to make raised platforms to stack critical materials.

A separate yard to be identified as “scrap yard” slightly away from main open yard to store wooden/steel scraps, which are to be disposed off. This is required to avoid mix up with regular components as well as to avoid fire hazard.

Some of the components, which are having both machined & un-machined surfaces and are bulky, shall be stored in open storage area on a raised ground and suitably covered with water proof / fire retardant tarpaulin.



The equipment listed below shall be stored and inspected as per requirement mentioned in the table below.

Sl. No.	Description of the equipment	Type of Storage	Check for	Remarks
Raw material /mechanical items like pipes, plates, structure sections etc.)				
1.	Steel pipes (lined/unlined)	S	Damage , paint, corrosion, rubber lining peeling	Provide end cap
2.	MS Plates	S	Damage, paint, corrosion	
3.	SS Plates	S	Damage	
4.	Non-metallic pipes	S	Damage, cracks	Provide end cap
5.	Stainless steel pipes	S	Damage ,	Provide end cap
6.	MS sections, beams	S	Damage, paint, corrosion	
7.	Cable trays	S	Damage, condition of preservations	
8.	Insulation sheets	S	Damage	
9.	Insulation	C	Damage, packing	
10.	Hangers Rods	S	Damage, paint, packing	
11.	Tubes	S	Damage, paint , packing	Provide end cap
12.	Hume pipes	O	Damage	
13.	Castings	O	Damage, paint, corrosion	
Fabricated mechanical items (pressure vessels, tanks etc.)				
14.	Pressure vessels (unlined)	O	Damage, paint, corrosion,	Covered nozzles
15.	Atmospheric storage tanks (unlined)	O	Damage, paint, corrosion	Covered nozzles

Sl. No.	Description of the equipment	Type of Storage	Check for	Remarks
16.	Pressure vessels (lined)	S	Damage, paint, corrosion, rubber lining	
17.	Atmospheric storage tanks(lined)	S	Damage, paint, corrosion, rubber lining	
18.	Support structures	O	Damage , paint, corrosion	
19.	Flanges	C	Damage , paint, corrosion	
20.	Fabricated pipes	S	Damage , paint, corrosion	Provide end cap
21.	Vessels internals	C	Damage , paint, corrosion ,packing	
22.	Grills	S	Damage , paint, corrosion	
23.	Angles	S	Damage , paint, corrosion	
24.	Bridge mechanism/clarifier mechanism	O	Damage , paint, corrosion	
25.	Cranes, rails	S	Damage , paint, corrosion	
26.	Stair cases	O	Damage , paint, corrosion	
27.	Ladders/handrails	O	Damage , paint, corrosion	
28.	Fabricated ducts	S	Damage , paint, corrosion	
29.	Isolation Gates	O	Damage , paint, corrosion	
30.	Fabricated boxes/panels	S	Damage , paint, corrosion	
Mechanical components like valves, fittings, cables glands, spares etc.)				
31.	Valves	S	Damage , packing	

Sl. No.	Description of the equipment	Type of Storage	Check for	Remarks
32.	Fittings	S	Damage , packing	Provide end cap
33.	Cable glands	C	Damage , packing	
34.	Tools & tackles	C	Damage , packing	
35.	Nut , bolts, washers,	C	Damage , packing	
36.	Gasket & Packings	C	Damage , packing	
37.	Copper tubes	C	Damage , packing, corrosion	Provide end cap
38.	SS tubing	C	Damage , packing	Provide end cap
Rotating assemblies (pumps, blowers, stirrers, fans, compressors etc.)				
39.	Pumps	S	Damage , packing, corrosion	Shaft rotation
40.	Blowers/Compressors	S	Damage , packing, corrosion	Shaft rotation
41.	Agitators/stirrers/radial launders	C	Damage , packing, corrosion	Shaft rotation
42.	Rollers for chlorine tonner mounting	C	Damage , packing, corrosion	
43.	Centrifuge	S	Damage , packing,	
44.	Gear box	C	Damage , packing, corrosion	
45.	Bearings	C	Damage , packing, corrosion	
46.	Fans	S	Damage , packing, corrosion	
47.	Dosing skids	S	Damage , packing, corrosion	
48.	Pump assemblies	S	Damage , packing, corrosion	
49.	Air washers(INTERNALS)	S	Damage , packing	
50.	Air conditioners (split)	C	Damage , packing	

Sl. No.	Description of the equipment	Type of Storage	Check for	Remarks
51.	Elevators(CONTAINERIZED)	O	Damage , packing, corrosion	
52.	Chillers/VA machines	S	Damage , packing	
53.	Air handling Unit/Package unit	S	Damage , packing	
54.	Chlorinators & Evaporators	C	Damage , packing	
55.	Ejectors	C	Damage , packing	
56.	Electrolyser	C	Damage , packing	
Miscellaneous items like chain pulley blocks, hoists etc.				
57.	Chain pulley blocks	S	Damage, Packing	
58.	Electric hoists	S	Damage, Packing	
59.	Fire extinguishers	C	Damage, expiry date	
60.	Fork Lift Truck	S	Damage, Packing	
61.	Hydraulic Mobile Crane	O	Damage, Packing	
62.	Mobile Pick Up & Carry Crane	O	Damage, Packing	
63.	Motor boats	O	Damage, Packing	
64.	Safety showers	S	Damage, Packing	
65.	Diffusers/dampers	S	Damage, Packing	
Chemicals and consumables (acid, alkali, paints, oils, reagents and special chemicals)				
66.	Hydro Chloric Acid (HCl)	Store in canes/ storage tank in dyke area	Date of production/ leakage/fumes	hazardous chemical
67.	Sulphuric acid (H ₂ SO ₄)	Store in canes/ storage tank in dyke area	Date of production/ leakage/fumes	hazardous chemical

Sl. No.	Description of the equipment	Type of Storage	Check for	Remarks
68.	Sodium hydroxide (NaOH)	Store in canes/ storage tank in dyke area	Date of production/ leakage/ fumes/ breather	hazardous chemical ,breather to be checked for air ingress
69.	Sodium hypo chlorite	To be stored under shed	Date of production/ leakage/ fumes	hazardous chemical ,self-life normally 15-30 days after which strength of chemical decays
70.	Ammonia	S	Date of production/ leakage/ fumes	Store in closed storage tanks, hazardous chemical
71.	CW treatment chemicals	S	Date of production , Self-life	Store in closed canes
72.	RO/UF cleaning chemicals	S	Date of production , Self-life	Store in closed canes
73.	Lime	C	Damage to packing , seepage	Prevent moisture, rain
74.	Alum bricks	C	Damage to packing	Prevent moisture, rain
75.	Poly electrolyte	S		Store in closed storage tanks
76.	Laboratory chemicals(powder)	C	Damage, Packing self-life	
77.	Laboratory chemicals(liquid)	C	Damage, Packing self-life	
78.	Lubrication oils	C	Leakage	
79.	Paints	S	Leakage ,air tightness	
80.	Sand	O	Damage of packing	No hooks
81.	Salt (NaCl)	C	Damage of packing, water ingress	Prevent moisture, rain
82.	Anthracite	S	Damage of packing	
83.	Activated carbon	S	Damage of packing	

Sl. No.	Description of the equipment	Type of Storage	Check for	Remarks
84.	Thermal insulation	S	Damage of packing	
85.	Cement	C	Damage of packing	Prevent moisture, rain
86.	Gravels	O	Damage of packing	
87.	ION exchange resins	C	Damage , packing	Refer manufacturer guidelines
88.	RO membranes	C	Damage , packing	Refer manufacturer guidelines
89.	UF membranes	C	Damage , packing	Refer manufacturer guidelines
90.	Cleaning chemicals	C	Damage , packing	Refer manufacturer guidelines
91.	Chemicals for analysers/calibration	C	Damage , packing	Refer manufacturer guidelines
Electrical and C & I items (motors, cables etc.)				
92.	Motors	C	Damage , packing	
93.	Cable drums	O	Damage	
94.	Control Panel /control desk, UPS ,JB	S	Damage, Packing	
95.	Instruments(gauges/analysers)	C	Damage	
Special items		As per Manufacturer's item, like Hydrogen cylinders, Ozonator, Analyser, Chlorine dioxide generators etc.		

5. CONCLUSION

Concerned storage agency at site should make sure that loss in equipment performance and wear & tear are minimised through proper storage and preservation. The above are broad guidelines and cover major equipment / materials. However specific storage practices shall be followed as per manufacturer recommendation. All the necessary measures even in addition to the ones mentioned above, if found necessary, should be taken to achieve the objective.

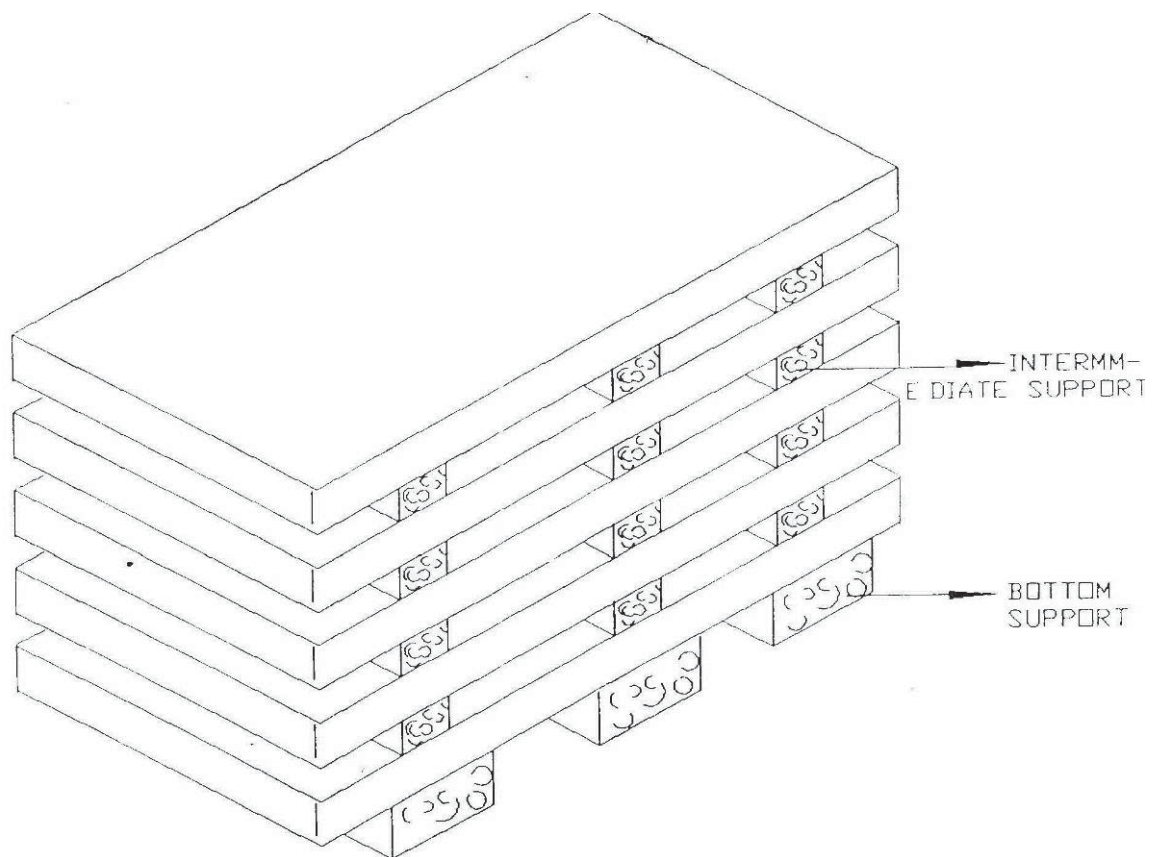


Figure – 1 – PLATE STACKING ARRANGEMENT

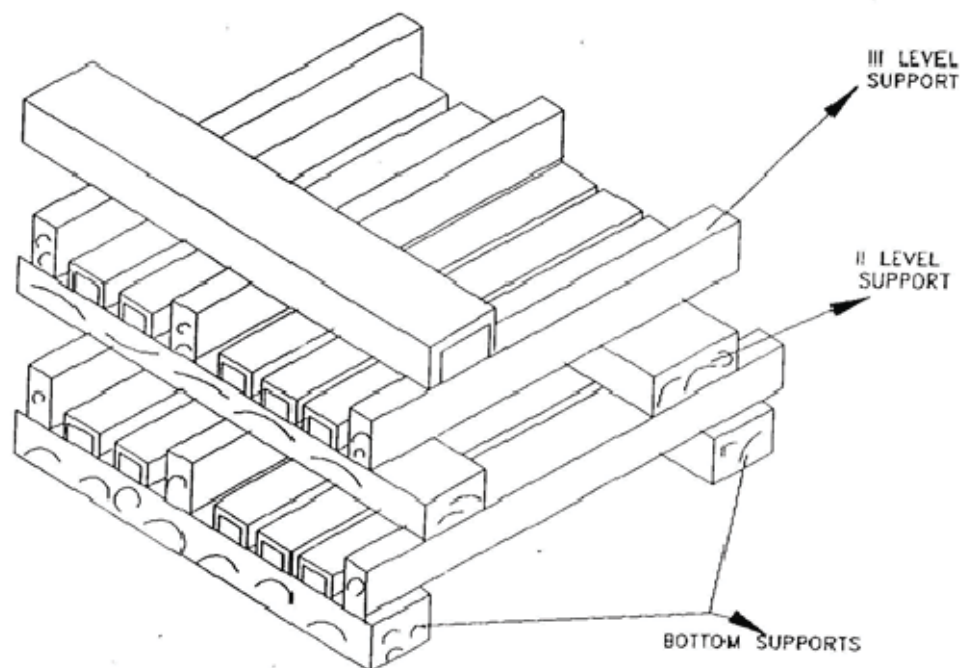


Figure – 2 – STRUCTURAL STEEL STACKING ARRANGEMENT



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
INSPECTION AND TESTING**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV 00

DATE: Feb 2017

SHEET 1 OF 4


SECTION-II

ANNEXURE-III

INSPECTION AND TESTING


Anshul


S A Khan


Praveen Kishore

	2x660MW ENNORE STPP AIR CONDITIONING SYSTEM INSPECTION AND TESTING	SPECIFICATION No: PE-TS-412-553-A001	
		SECTION : II	
		REV 00	DATE: Feb 2017
		SHEET 2 OF 4	
1.01.00	Inspection and Tests during Manufacture.		
1.01.01	The method and techniques to be used by the Bidder for the control of quality during manufacture of all plant and equipment shall be agreed with the Owner.		
1.01.02	The Owner’s general requirements with respect to quality control and the required shop tests are set out elsewhere in this specification.		
1.01.03	Before any item of plant or equipment leaves its place of manufacture the Owner shall be given the option of witnessing inspections and tests for compliance with the specification and related standards.		
1.01.04	Advance notice shall be given to the Owner as agreed in the Contract, prior to the stage of manufacture being reached, and the piece of plant must be held at this stage until the Owner has inspected the piece, or has advised in writing that inspection is waived. If having consulted the Owner and given reasonable notice in writing of the date on which the piece of plant will be available for inspection, the Owner does not attend the Bidder may proceed with manufacture having forwarded to the Owner duly certified copies of his own inspection and test results. The owner’s representative shall have at all reasonable times access to bidder’s or his sub-vendor’s premises and shall have power to inspect/ examine materials and workmanship or equipment under manufacture. The Bidder shall forthwith forward to the engineer duly certified copies of the Test Certificates in six copies (one to the Purchaser and five to the Consulting Engineer) for approval. Further nine (9) copies of Shop Test Certificates shall be bound with Instruction Manuals referred to elsewhere. For electrical equipment, routine tests as per relevant IS spec are to be carried out on all equipment. Type tests are also to be carried out on selected equipment as detailed in the specs of concerned electrical equipment.		
1.01.05	Under no circumstances any repair or welding of castings be carried out without the consent of the Engineer. Proof of the effectiveness of each repair by radiographic and/or other non-destructive testing technique, shall be provided to the Engineer.		
1.01.06	All the individual and assembled rotating parts shall be statically and dynamically balanced in the works. Where accurate alignment is necessary for component parts of machinery normally assembled on site, the Bidder shall allow for trial assembly prior to despatch from place of manufacture.		
1.01.07	All materials used for the manufacture of equipment covered under this specification shall be of tested quality. Relevant test certificates shall be made available to the		



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
INSPECTION AND TESTING**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : II

REV 00

DATE: Feb 2017

SHEET 3 OF 4

Purchaser. The certificates shall include tests for mechanical properties and chemical analysis of representative material. Equipment or parts coming under any statutory Regulations shall be certified by a Competent Authority under the regulations in the specified format.

1.01.08 All pressure parts connected to pumping main shall be subjected to hydraulic testing at a pressure of 150% of shut-off head for a period not less than one hour. Other parts shall be tested for one and half times the maximum operating pressure, for a period not less than one hour.

1.01.09 All necessary non-destructive examinations shall be performed to meet the applicable code requirements.

1.01.10 All welding procedures adopted for performing welding work shall be qualified in accordance with the requirements of Section-IX of ASME code or IBR as applicable. All welded joints for pressure parts shall be tested by liquid penetrant examination according to the method outlined in ASME Boiler and Pressure Vessel code. Radiography, magnetic particle examination magnuflux and ultrasonic testing shall be employed wherever necessary/ recommended by the applicable code. At least 10% of all major but welding joints shall be radiographed unless otherwise stipulated.

Statutory payments in respect of IBR approvals including inspection shall be made by the bidder. Bidder's scope shall include to preparation of all necessary documents, co-ordination and follow-up for above approval. Owner shall only forward assistance/endorsement of documents /design /drawings /reports/records to be submitted for approval as stipulated/ required by Statutory Authorities till registration of the unit and clearance for commercial operation.

1.02.00 Performance Tests at Site

1.02.01 The full requirements for testing the system shall be agreed between the Owner and the Bidder prior to Award of Contract. The completely erected System shall be tested by the Bidder on site under normal operating conditions. The Bidder shall also ensure the correct performance of the System under abnormal conditions, i.e. the correct working of the various emergency and safety devices, interlocks, etc.

1.02.02 The Bidder shall provide complete details of his normal procedures for testing, for the quality of erection and for the performance of the erected plant. These tests shall include site pressure test on all erected pipe work to demonstrate the quality of the piping and the adequacy of joints made at site.

1.02.03 The Bidder shall furnish the quality procedures to be adopted for assuring quality from the receipt of material at site, during storage, erection, pre-commissioning to tests on completion and commissioning of the complete system/equipment.

1.03.00 For details of specific tests required on individual equipment refer to respective section of this specification.

Anshul
Anshul

S A Khan
S A Khan

Praveen Kishore
Praveen Kishore





**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM**

SPECIFICATION No: PE-TS-412-553-A001

SECTION: III

REV. 00


DATE: Feb 2017

SECTION III

DOCUMENTS TO BE SUBMITTED BY BIDDER


Anshul


S A Khan


Pawan Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
LIST OF DOCUMENTS TO BE SUBMITTED WITH
BID**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : III

SUB-SECTION : 1

REV: 00

DATE: Feb 2017


SHEET 1 OF 1

BIDDER SHOULD SUBMIT THE SIGNED AND STAMPED COPY OF THE FOLLOWING DOCUMENTS:

1. Compliance cum confirmation certificate
2. Guaranteed power consumption (In the format attached in the spec mentioning KW rating).
3. Un priced format for main package (mentioning quoted against each item)
4. Un priced format for mandatory spare (mentioning quoted against each item, if applicable)
5. Un priced format for Tools and Tackles (mentioning quoted against each item)
6. Un priced format for Commissioning spare (mentioning quoted against each item)
7. Complete set of technical specification duly signed and stamped.
8. No deviation certificate


Anshul


S A Khan


Pawan Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
COMPLIANCE CUM CONFIRMATION
CERTIFICATE**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : III

SUB-SECTION : 2

REV. NO. 00

DATE: Feb 2017

SHEET: 1 OF 2

COMPLIANCE CUM CONFIRMATION CERTIFICATE

The bidder shall confirm compliance with following by signing / stamping this compliance certificate (every sheet) and furnish same with the offer.


- a) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions, other than those mentioned under "exclusion and those resolved as per 'Schedule of Deviations', with regard to same.
- b) There are no other deviations w.r.t. specifications other than those furnished in the 'Schedule of Deviations'. Any other deviation, stated or implied, taken elsewhere in the offer stands withdrawn unless specifically brought out in the 'Schedule of Deviations'
- c) Bidder shall submit QP in the event of order based on the guidelines given in the specification & QP enclosed therein. QP will be subject to BHEL / CUSTOMER approval & customer hold points for inspection / testing shall be marked in the QP at the contract stage. Inspection / testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc. This is within the contracted price without any extra implications to BHEL after award of the contract.
- d) All drawings/ data-sheets / calculations etc. submitted along with the offer shall not be taken cognizance off.
- e) The offered materials shall be either equivalent or superior to those specified in the specification & shall meet the specified / intended duty requirements. In case the material specified in the specifications is not compatible for intended duty requirements then same shall be resolved by the bidder with BHEL during the pre-bid discussions, otherwise BHEL / Customer's decision shall be binding on the bidder whenever the deficiency is pointed out.

For components where materials are not specified, same shall be suitable for intended duty, all materials shall be subject to approval in the event of order.

- f) The commissioning spares shall be supplied on 'As Required Basis' & prices for same included in the base price itself.
- g) All sub vendors shall be subject to BHEL / CUSTOMER approval in the event of order.
- h) Guarantee for plant/equipment shall be as per relevant clause of GCC / SCC / Other Commercial Terms & Conditions
- i) In the event of order, all the material required for completing the job at site shall be supplied by the bidder within the ordered price even if the same are additional to approved billing break up, approved drawing or approved Bill of quantities within the scope of work as tender specification. This clause will apply in case during site


Anshul


S.A. Khan


Pritam Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
COMPLIANCE CUM CONFIRMATION
CERTIFICATE**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : III

SUB-SECTION : 2

REV. NO. 00

DATE: Feb 2017

SHEET: 2 OF 2

commissioning, additional requirements emerges due to customer and / or consultant's comments. No extra claims shall be put on this account

- j) Schedule of drawings submissions, comment incorporations & approval shall be as stipulated in the specifications. The successful bidder shall depute his design personnel to BHEL's / Customer's / Consultant's office for across the table resolution of issues and to get documents approved in the stipulated time.
- k) As built drawings shall be submitted as and when required during the project execution.
- l) The bidder has not tempered with this compliance cum confirmation certificate and if at any stage any tempering in the signed copy of this document is noticed then same shall be treated as breach of contract and suitable actions shall be taken against the bidder.
- m) Successful bidder shall furnish detailed erection manual for each of the equipment supplied under this contract at least 3 months before the scheduled erection of the concerned equipment / component or along with supply of concerned equipment / component whichever is earlier.
- n) Document approval by customer under Approval category or information category shall not absolve the vendor of their contractual obligations of completing the work as per specification requirement. Any deviation from specified requirement shall be reported by the vendor in writing and require written approval. Unless any change in specified requirement has been brought out by the vendor during detail engineering in writing while submitting the document to customer for approval, approved document (with implicit deviation) will not be cited as a reason for not following the specification requirement.
- o) In case vendor submits revised drawing after approval of the corresponding drawing, any delay in approval of revised drawing shall be to vendor's account and shall not be used as a reason for extension in contract completion.



2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
PRE-BID CLARIFICATION SCHEDULE

SPECIFICATION No: PE-TS-412-553-A001

SECTION : III

SUB-SECTION : 3

REV. NO. 00

DATE: Feb 2017

SHEET: 1 OF 1

PRE-BID CLARIFICATION SCHEDULE

S. NO.	SECTION/CLAUSE/PAGE NO.	STATEMENT OF THE REFERRED CLAUSE	CLARIFICATION REQUIRED

The bidder hereby clarifies that above mentioned are the only clarifications required on the technical specification for the subject package.

Signature: _____

Name: _____

Designation: _____

Company: _____

Date: _____

Company Seal

Anshul

S A Khan

Praveen Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
NO DEVIATION CERTIFICATE**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : III

SUB-SECTION : 4

REV: 00


DATE: Feb 2017

SHEET 1 OF 2

NO DEVIATION CERTIFICATE


Anshul


S A Khan


Praveen Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
NO DEVIATION CERTIFICATE**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : III

SUB-SECTION : 4

REV: 00

DATE: Feb 2017

SHEET 2 OF 2

SL NO	VOULME / SECTION	PAGE NO.	CLAUSE NO.	TECHNICAL SPECIFICATION / TENDER DOCUMENT	COMPLETE DESCRIPTION OF DEVIATION	COST OF DEVIATION	PORTION OF PRICE SCHEDULE ON WHICH COST OF DEVIATION IS APPLICABLE	NATURE OF COST OF DEVIATION (POSITIVE/ NEGATIVE)	WHETHER COST OF DEVIATION INCLUDED/ EXCLUDED IN PRICE BID	REMARKS
-------	------------------	----------	------------	---	-----------------------------------	-------------------	--	--	---	---------

TECHNICAL DEVIATIONS

PARTICULARS OF BIDDERS/ AUTHORISED REPRESENTATIVE


NAME	DESIGNATIONS	SIGN & DATE	COMPANY SEAL

NOTES:

1. Cost of deviation will be applicable on the basic price (i.e. excluding taxes, duties & freight) only.
2. All the bidders have to list out all of their Technical Deviations in detail in the above format on cost basis (if any).
3. Any deviation not mentioned above and shown separately will not be taken cognizance of and the offer shall be liable for rejection.
4. Bidder shall indicate "quoted" in cost of deviation column of the schedule above along with their Technical offer.
5. Bidder shall furnish priced schedule of technical deviation along with price bid in sealed envelop.
6. The final decision of acceptance/ rejection of the deviations quoted by the bidder along with its cost shall be at discretion of the Purchaser.
7. Bidders to note that any deviation not listed above and asked after Part I Bid opening shall not be considered.
8. Bidders to note that no Price Impact will be acceptable after Part I Bid opening subject to if there is any change in Technical Specification/NIT terms from BHEL side.
9. Deviation listed above without any cost of deviation, if found acceptable to BHEL, will be considered without any price implication.


Anshul


S A Khan


Praveen Kishore



**2x660MW ENNORE STPP
AIR CONDITIONING SYSTEM
SUGGESTED PRICE FORMAT**

SPECIFICATION No: PE-TS-412-553-A001

SECTION : III

SUB-SECTION : 5


REV 01

DATE: Feb 2017

**SECTION-III
SUB-SECTION-5
SUGGESTED PRICE FORMAT**


Anshul



S A Khan


Praveen Kishore

SUGGESTED PRICE FORMAT (FOR MAIN PLANT, ESP ,ADMIN , SERVICE AND OTHER AUX BUILDINGS)				
		Doc No: PE-PF-412-553-A001	Rev : 01	Date: 18 Feb 2017
NAME OF PROJECT:		2x660 MW ENNORE STPP		
NAME OF PACKAGE:		AIR CONDITIONING SYSTEM		
TECHNICAL SPECIFICATION No:		PE-PF-412-553-A001		
S. No.	Description	UNIT	Amount	
1	Total lump sum firm price for design, engineering, manufacture, supply, fabrication, assembly, inspection/ testing at vendor's & sub-vendor's works, painting, maintenance / special tools & tackles (as applicable), mandatory spares alongwith spares for erection & commissioning and startup spares as required, forwarding, proper packing, shipment and delivery at site, trial run at site, unloading, handling, transportation & storage at site, in site transportation, assembly, erection & commissioning, final painting, minor civil work, trial run at site, preparation and submission of drawing /documents including "As Built" drawings and O&M manuals, layout drawings in 2D & 3D (As applicable), carrying out performance guarantee / Functional / Demonstration tests at site (As applicable) & equipment / system guarantee etc. inclusive of all prevailing taxes, duties and other levies and handover in flawless condition of the package specified above for above mentioned project to the end customer complete with all accessories for the total scope defined as per BHEL NIT & tender technical specification as specified above, amendment & agreements till placement of order.	Lot		
2	MAJOR BREAK-UP OF PRICES GIVEN IN 1.0 ABOVE.			
2.1	Total lump sum firm price for design, engineering, manufacture, supply, fabrication, assembly, inspection / testing at vendor's / sub-vendor's works, painting, maintenance / special tools & tackles alongwith spares for erection & commissioning and startup spares as required, forwarding, proper packing, shipment and delivery at site, trial run at site, unloading, handling, transportation & storage at site, in site transportation, assembly, erection & commissioning, final painting, minor civil work, trial run at site, preparation and submission of drawing /documents including "As Built" drawings and O&M manuals, layout drawings in 2D & 3D (As applicable),carrying out performance guarantee / Functional / Demonstration tests at site (As applicable) & equipment / system guarantee etc. inclusive of all prevailing taxes, duties and other levies and handover in flawless condition of the package specified above for above mentioned project to the end customer complete with all accessories for the total scope defined as per BHEL NIT & tender technical specificationas specified above, amendment & agreements till placement of order. Further, break up prices for items covered for the system shall be provided as per Annexure A	Lot		
2.2	Total lumpsum on FOR basis inclusive of all prevailing taxes, duties and other levies for SUPPLY OF MANDATORY SPARES (as per ANNEXURE- B) and as per BHEL NIT & tender technical specification as specified above, amendment & agreements till placement of order.	Lot		
Note: 1.) Bidder to quote Guaranteed Power Consumption for Air Condinting System as per Annexure-C . 2.) PG to consider and suitably incorporate taxes, duties and other commercial aspects.				
Particulars of bidder / authorised representative				
Name	Designation	Signature	Date	Company Seal


Anshul


S A Khan



Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
A	AC-Plant-1: CENTRAL CHILLED WATER SYSTEM FOR MAIN CR AREAS.								
1	Microprocessor controlled, water cooled chiller package each of minimum capacity 300TR consisting of Hermetically sealed Screw type refrigerant compressor operating on R134a / R407C refrigerant complete with motor, unit mounted starter, complete with suction and discharge shut off valves, HP / LP cutouts, oil pressure failure switch, gauge panel, automatic capacity control; Condenser, relief valve, chiller, controls such as thermostatic/electronic expansion valve, cooling thermostat, antifreeze thermostat, water flow switch, integral refrigerant pipes & fittings, strainer, sight glass, isolating valves, chiller drain valve, chiller insulation, refrigerant piping insulation, first charge of gas and oil, base frames, vibration isolators, integral wiring, unit mounted isolator / fuse switch and other accessories as specified.	2	NO						
2	Sheet metal cabinet type air handling units (double skin as per specification) consisting of chilled water cooling coil, centrifugal blower, TEFC sq cage induction motor, VFD drive set , filters (pre filter), 3 way motorised mixing valve with thermostatic controls and other accessories as per specifications to meet the AC load of the main Control Room areas of power house building at 17.0m and kept at 19 M floor level as per specification. Fine filter and HEPA Filters shall be provided with individual AHU discharge.	4	NO						
3	Sheet metal cabinet type air handling units (double skin as per specification) consisting of chilled water cooling coil, centrifugal blower, TEFC sq cage induction motor, VFD drive set , filters (pre filter), 3 way motorised mixing valve with thermostatic controls and other accessories as per specifications to meet the AC load of the UPS & Battery charger areas of Unit 1 & 2 at 8.5m. Fine filter shall be provided with individual AHU discharge.	2	NO						
4	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level Switch, drains, piping, valves, strainers, ladder & all accessories as specified.	2	NO						


Anshul


S A Khan



Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
5	Centrifugal pump sets for condenser water recirculation complete with TEFC motor & all accessories as specified.	2	NO						
6	Centrifugal pump sets for chilled water recirculation complete with TEFC motor & all accessories, as specified.	2	NO						
7	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 8 m3 .	2	NO						
8	FRP Expansion Tank (insulated) for chilled water with all accessories as required, capacity 1 m3.	1	NO						
9	Online chemical scale preventer, with all accessories as required to meet system requirements	1	NO						
10	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	1	LOT						
11	Chilled water piping from AC plant to AHU rooms within power house building complete with valves supports, fittings, strainers, PUF section insulation with finish as per specification.	1	LOT						
12	Monsoon reheating/ winter heating kit comprising strip heaters, safety controls, air-stat, contactors, frame work, thermostat & humidistat/ sensors etc.	1	LOT						
13	Pan type humidifier for each AHU room.	1	LOT						
14	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	1	LOT						
B	AC Plant -2 & 3 : WATER COOLED DX SYSTEM (ESP building) Unit-1 & 2								


Anshul


S A Khan



Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
1	DX type water cooled condensing unit of minimum 30TR capacity. The refrigerant compressor shall be hermetically sealed Srew type operating on R-134a / R-407c refrigerant complete with motor, unit mounted starter, complete with suction and discharge shut off valves, HP / LP cutouts, oil pressure failure switch, gauge panel, automatic capacity control, condenser, relief valve, chiller, controls such as thermostatic/electronic expansion valve, cooling thermostat, antifreeze thermostat, water flow switch, integral refrigerant pipes & fittings, strainer, sight glass, isolating valves, chiller drain valve, chiller insulation, refrigerant piping insulation, first charge of gas and oil, base frames, vibration isolators, integral wiring, unit mounted isolator / fuse switch and other accessories as specified.	4	NO						
2	Sheet metal cabinet type air handling units (double skin as per specification) consisting of Dampers, Filters (pre filter and fine filters), DX- cooling coil, and Fan section with fan & TEFC sq cage induction motor, VFD drive set, face and bypass damper with modulating motor, condensate drain pan, thermostatic controls and other accessories to meet the AC load of control room area, complete with all accessories as per specification.	4	NO						
3	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level Switch, drains, piping, valves, strainers, ladder & all accessories as specified.	4	NO						
4	Centrifugal pump sets for condenser water recirculation complete with TEFC motor & all accessories as specified.	4	NO						
5	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 2m ³ .	4	NO						
6	Online non - chemical scale preventer, with all accessories as required to meet system requirements	2	NO						
7	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	2	LOT						


Anshul


S A Khan



Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
8	Monsoon reheating/ winter heating kit comprising strip heaters, safety controls, air-stat, contactors, frame work, thermostat & humidistat/ sensors etc.	2	LOT						
9	Pan type humidifier for each AHU room.	2	LOT						
10	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	2	LOT						
C	AC-Plant-4: WATER COOLED PACKAGED AC FOR SERVICE BUILDING AREAS								
1*	Water cooled packages, each of following capacity consisting of water cooled condenser & evaporating unit including complete refrigerant piping / unit with insulation, controls, complete drain piping to nearest drain and all other accessories as per specifications.								
a*	20TR (Actual)	12	NO*						
b*	15TR (Actual)	24	NO*						
2	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level switch, drains, piping, valves, strainers, ladder & all accessories as specified. The capacity of each cooling tower shall be 300 CMH.	2	NO						
3	Centrifugal pump sets for condenser water recirculation complete with TEFC with TEFC motor & all accessories as specified.	2	NO						
4	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 8 m3 .	2	NO						
5	Online non - chemical scale preventer, with all accessories as required to meet system requirements	1	NO						
6	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	1	LOT						
7	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	1	LOT						


Anshul


S A Khan



Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
D	AC-Plant-5: WATER COOLED PACKAGED AC FOR ADMINISTRATIVE BUILDING AREAS.								
1*	Water cooled packages, each of following capacity consisting of water cooled condenser & evaporating unit including complete refrigerant piping / unit with insulation, controls, complete drain piping to nearest drain and all other accessories as per specifications.								
a*	20TR (Actual)	6	NO*						
b*	15 TR (Actual)	8	NO*						
2	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level switch, drains, piping, valves, strainers, ladder & all accessories as specified. The capacity of each cooling tower shall be 125 CMH.	2	NO						
3	Centrifugal pump sets for condenser water recirculation complete with TEFC with TEFC motor & all accessories as specified.	2	NO						
4	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 8 m3 .	2	NO						
5	Online non - chemical scale preventer, with all accessories as required to meet system requirements	1	NO						
6	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	1	LOT						
7	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	1	LOT						
E	ITEMS COMMON TO ALL AC PLANTS								
1*	FAN COIL UNIT consisting of chilled water cooling coil, blower, motor, driveset, filters (prefilter), 3way motorised mixing valve with thermostatic controls and other accessories as per specifications								


Anshul


S A Khan



Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
a*	3 TR	4	NO*						
b*	2TR	1	NO*						
c*	1.5 TR	1	NO*						
2*	Fire damper.								
a*	Fire damper with auto resetting, limit switches, indication lamps etc.	30	SQM*						
b*	Motorized actuator with single phase power supply for the above fire damper.	40	NO*						
3*	GSS zinc coating 275 gms/ m ² ducting complete with hangers/ supports, dampers, grilles, diffusers (with & without VCD) etc.								
a*	18G.	1500	SQM*						
b*	20G.	3000	SQM*						
c*	22G.	3500	SQM*						
d*	24G.	5000	SQM*						
e*	Supply air diffuser with VCD (Extruded Aluminium).	75	SQM*						
f*	Return air diffuser without VCD (Extruded Aluminium).	90	SQM*						
g*	GI Volume control dampers for Duct	20	SQM*						
4	Acoustic insulation of the first 6 of ducting from AHU outlets.	1	LOT						
5*	Acoustic insulation of walls of AHU / PU room as per specifications.	2000	SQM*						
6*	Thermal insulation of supply air duct & return air duct with finish as specified.	13000	SQM*						
7*	MS medium class drain piping upto nearest drain point with and without insulation								
a*	50mm	200	Rmt*						
b*	40mm	250	Rmt*						


Anshul


S A Khan



Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
8	Field instruments like pressure gauge, temperature gauge, pressure switch, differential pressure switch, flow switch, differential pressure gauge across hepa filters, flow meters, velocity sensor, static pressure sensors and other required instruments as per specifications, including necessary control panel form hook up with main DDCMIS as per specifications	1	LOT						
9	PLC control system complete with PLC panels , RIO panels and all accessories as specified in the specification for power house,ESP, admin and service building, AC and ventilation system.	1	LOT						
10*	Fibre optic cable.	400	Rmt*						
F	AC System for Aux. building for unit#1 & 2)								
1*	Air Cooled PAC-Unit complete with all accessories as specified The package unit shall be complete with all accessories like duct hetaers, pan humidifier, filters, acoustic insulation of duct for 5m from PU, drain piping with insulation upto nearest drain, required instrumentation etc								
(a)*	15 TR net capacity	1	No*						
(b)*	10 TR net capacity	1	No*						
2*	Air-cooled split type AC units consisting of condensing unit & evaporating unit including refrigerant pipes & fittings with insulation etc. (Minimum BEE Rating 5 Star for non ductable units).								
(a)*	5.0 TR capacity (ductable type, 415 V, 3 phase with isolation switch).	2	NO*						
(b)*	2.0 TR capacity (non-ductable type, 240 V, 1 phase) with isolation switch , i.e MCB of suitable rating as specified, voltage stabilizer, cabling, all supporting structure and refrigerent piping to suite actual site condition.	50	NO*						
(c)*	1.5 TR capacity (non-ductable type, 240 V, 1 phase) with isolation switch , i.e MCB of suitable rating as specified, voltage stabilizer, cabling, all supporting structure and refrigerent piping to suite actual site condition.	90	NO*						


Anshul


S A Khan


Praveen Kishore


ANNEXURE - A of Doc No: PE-PF-412-553-A001 PRICE BREAKUP (FOR MAIN PLANT TG, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS) AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-I)									
SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
3*	Air curtain								
(a)*	For minimum door height 3M and width 900 MM	8	NO*						
(b)*	For minimum door height 3M and width 1200 MM	4	NO*						
(C)*	For minimum door height 3M and width 1800 MM	4	NO*						
(d)*	For minimum door height 3M and width 2100 MM	2	NO*						
5*	Handling arrangement for AC equipments								
(a)*	Manually operated, platform trolley of 1 Ton capacity with base area 2m x 1.5m	4	NO*						
(b)*	3T Electric hoist with monorail arrangement for AC plant	1	NO*						
(C)*	1T Chain pulley block with travelling trolley	7	NO*						
6	Total lumpsum price for special tools & tackles for maintenance inclusive of packing forwarding, transportation up to site, etc. (Bidder shall submit item-wise price break-up-As per Appendix A).	1	LOT						
7	Total lumpsum price for commissioning spares inclusive of packing forwarding, transportation up to site, etc. (Bidder shall submit item-wise price break-up-As per Appendix B).	1	LOT						
8	Total lumpsum price for Mandatory Spare for air conditioning inclusive of packing forwarding, transportation up to site, etc. (Bidder to submit item-wise price break-up As per Annexure -B).	1	LOT						
9	Any other item not indicated above, but required to make the system complete in all respects.	1	LOT						

NOTES The bidder shall furnish unit rates for variable item (marked *) for necessary adjustment (plus or minus) variation during detailed engg. stage. The unit rates quoted above shall be considered and no separate unit rates shall be quoted. Unit rates shall be valid throughout the contract.

1 Bidder must submit prices in the Pro Forma duly filled in signed and stamped on every page without any ambiguity. The price shall be written against each item. Term such as "refer covering letter" etc. are not acceptable. Extra sheet may be attached if the space provided is not sufficient


Anshul


S A Khan


Praveen Kishore

ANNEXURE - A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (FOR MAIN PLANT, ESP , ADMIN ,SERVICE BUILDING AND OTHER AUX BUILDINGS)
AIR CONDITIONING SYSTEM FOR 2x660 MW ENNORE STPP (OPTION-II)

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY		ERECTION AND COMMISSIONING		TOTAL (Supply + E&C)	
				Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)	Unit Price (Rs)	Total price (Rs)
A	AC-Plant-1: CENTRAL CHILLED WATER SYSTEM FOR MAIN CR AREAS.								
1	Microprocessor controlled, water cooled chiller package each of minimum capacity 350TR consisting of Hermetically sealed Screw type refrigerant compressor operating on R134a / R407C refrigerant complete with motor, unit mounted starter, complete with suction and discharge shut off valves, HP / LP cutouts, oil pressure failure switch, gauge panel, automatic capacity control; Condenser, relief valve, chiller, controls such as thermostatic/electronic expansion valve, cooling thermostat, antifreeze thermostat, water flow switch, integral refrigerant pipes & fittings, strainer, sight glass, isolating valves, chiller drain valve, chiller insulation, refrigerant piping insulation, first charge of gas and oil, base frames, vibration isolators, integral wiring, unit mounted isolator / fuse switch and other accessories as specified.	2	NO						
2	Sheet metal cabinet type air handling units (double skin as per specification) consisting of chilled water cooling coil, centrifugal blower, TEFC sq cage induction motor, VFD drive set , filters (pre filter), 3 way motorised mixing valve with thermostatic controls and other accessories as per specifications to meet the AC load of the main Control Room areas of power house building at 17.0m and kept at 19 M floor level as per specification. Fine filter and HEPA Filters shall be provided with individual AHU discharge.	4	NO						
3	Sheet metal cabinet type air handling units (double skin as per specification) consisting of chilled water cooling coil, centrifugal blower, TEFC sq cage induction motor, VFD drive set , filters (pre filter), 3 way motorised mixing valve with thermostatic controls and other accessories as per specifications to meet the AC load of the C&I areas such as conference room,meeting room , locker Room areas of power house building at 17.0m and kept at 17 M floor level as per specification. Fine filter and HEPA Filters shall be provided with individual AHU discharge.	2	NO						


Anshul


S A Khan


Praveen Kishore

4	Sheet metal cabinet type air handling units (double skin as per specification) consisting of chilled water cooling coil, centrifugal blower, TEFC sq cage induction motor, VFD drive set , filters (pre filter), 3 way motorised mixing valve with thermostatic controls and other accessories as per specifications to meet the AC load of the UPS & Battery charger areas of Unit 1 & 2 at 8.5m . Fine filter shall be provided with individual AHU discharge.	2	NO						
5	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level Switch, drains, piping, valves, strainers, ladder & all accessories as specified.	2	NO						
6	Centrifugal pump sets for condenser water recirculation complete with TEFC motor & all accessories as specified.	2	NO						
7	Centrifugal pump sets for chilled water recirculation complete with TEFC motor & all accessories, as specified.	2	NO						
8	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 8 m3 .	2	NO						
9	FRP Expansion Tank (insulated) for chilled water with all accessories as required, capacity 1 m3.	1	NO						
10	Online chemical scale preventer, with all accessories as required to meet system requirements	1	NO						
11	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	1	LOT						
12	Chilled water piping from AC plant to AHU rooms within power house building complete with valves supports, fittings, strainers, PUF section insulation with finish as per specification.	1	LOT						
13	Monsoon reheating/ winter heating kit comprising strip heaters, safety controls, air-stat, contactors, frame work, thermostat & humidistat/ sensors etc.	1	LOT						
14	Pan type humidifier for each AHU room.	1	LOT						
15	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	1	LOT						
B	AC Plant -2 & 3 : WATER COOLED DX SYSTEM (ESP building) Unit-1 & 2								


Anshul



S A Khan


Praveen Kishore

1	DX type water cooled condensing unit of minimum 30TR capacity. The refrigerant compressor shall be hermetically sealed Srew type operating on R-134a / R-407c refrigerant complete with motor, unit mounted starter, complete with suction and discharge shut off valves, HP / LP cutouts, oil pressure failure switch, gauge panel, automatic capacity control, condenser, relief valve, chiller, controls such as thermostatic/electronic expansion valve, cooling thermostat, antifreeze thermostat, water flow switch, integral refrigerant pipes & fittings, strainer, sight glass, isolating valves, chiller drain valve, chiller insulation, refrigerant piping insulation, first charge of gas and oil, base frames, vibration isolators, integral wiring, unit mounted isolator / fuse switch and other accessories as specified.	4	NO						
2	Sheet metal cabinet type air handling units (double skin as per specification) consisting of Dampers, Filters (pre filter and fine filters), DX- cooling coil, and Fan section with fan & TEFC sq cage induction motor, VFD drive set, face and bypass damper with modulating motor, condensate drain pan, thermostatic controls and other accessories to meet the AC load of control room area, complete with all accessories as per specification.	4	NO						
3	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level Switch, drains, piping, valves, strainers, ladder & all accessories as specified.	4	NO						
4	Centrifugal pump sets for condenser water recirculation complete with TEFC motor & all accessories as specified.	4	NO						
5	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 2m3 .	4	NO						
6	Online non - chemical scale preventer, with all accessories as required to meet system requirements	2	NO						
7	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	2	LOT						
8	Monsoon reheating/ winter heating kit comprising strip heaters, safety controls, air-stat, contactors, frame work, thermostat & humidistat/ sensors etc.	2	LOT						
9	Pan type humidifier for each AHU room.	2	LOT						
10	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	2	LOT						


Anshul



S A Khan


Praveen Kishore

C	AC-Plant-4: WATER COOLED PACKAGED AC FOR SERVICE BUILDING AREAS								
1*	Water cooled packages, each of following capacity consisting of water cooled condenser & evaporating unit including complete refrigerant piping / unit with insulation, controls, complete drain piping to nearest drain and all other accessories as per specifications.								
a*	20TR (Actual)	12	NO*						
b*	15TR (Actual)	24	NO*						
2	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level switch, drains, piping, valves, strainers, ladder & all accessories as specified. The capacity of each cooling tower shall be 300 CMH.	2	NO						
3	Centrifugal pump sets for condenser water recirculation complete with TEFC with TEFC motor & all accessories as specified.	2	NO						
4	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 8 m3 .	2	NO						
5	Online non - chemical scale preventer, with all accessories as required to meet system requirements	1	NO						
6	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	1	LOT						
7	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	1	LOT						
D	AC-Plant-5: WATER COOLED PACKAGED AC FOR ADMINISTRATIVE BUILDING AREAS.								
1*	Water cooled packages, each of following capacity consisting of water cooled condenser & evaporating unit including complete refrigerant piping / unit with insulation, controls, complete drain piping to nearest drain and all other accessories as per specifications.								
a*	20TR (Actual)	6	NO*						
b*	15 TR (Actual)	8	NO*						


Anshul


S A Khan


Praveen Kishore

2	Fibreglass reinforced plastic (FRP) construction cooling towers complete with fan, motor, FRP basin, nozzles, make-up water & quick fill water connection, Level switch, drains, piping, valves, strainers, ladder & all accessories as specified. The capacity of each cooling tower shall be 125 CMH.	2	NO						
3	Centrifugal pump sets for condenser water recirculation complete with TEFC with TEFC motor & all accessories as specified.	2	NO						
4	Make up water FRP Storage tank to cooling towers with level switch, pr switch and other accessories as required. Capacity of each tank 8 m3 .	2	NO						
5	Online non - chemical scale preventer, with all accessories as required to meet system requirements	1	NO						
6	Condenser water piping with necessary fittings, strainers, valves including piping from soft water storage tank to pan humidifiers of AHU room as specified.	1	LOT						
7	Fresh air fan (axial flow type), complete with motor, inlet cone, air filters (pre and fine), dampers etc.	1	LOT						
E	ITEMS COMMON TO ALL AC PLANTS								
1*	FAN COIL UNIT consisting of chilled water cooling coil, blower, motor, driveset, filters (prefilter), 3way motorised mixing valve with thermostatic controls and other accessories as per specifications								
a*	3 TR	4	NO*						
b*	2TR	1	NO*						
c*	1.5 TR	1	NO*						
2*	Fire damper.								
a*	Fire damper with auto resetting, limit switches, indication lamps etc.	30	SQM*						
b*	Motorized actuator with single phase power supply for the above fire damper.	40	NO*						
3*	GSS zinc coating 275 gms/ m ² ducting complete with hangers/ supports, dampers, grilles, diffusers (with & without VCD) etc.								
a*	18G.	1500	SQM*						
b*	20G.	3000	SQM*						
c*	22G.	3500	SQM*						

d*	24G.	5000	SQM*						
e*	Supply air diffuser with VCD (Extruded Aluminium).	75	SQM*						
f*	Return air diffuser without VCD (Extruded Aluminium).	90	SQM*						
g*	GI Volume control dampers for Duct	20	SQM*						
4	Acoustic insulation of the first 6 of ducting from AHU outlets.	1	LOT						
5*	Acoustic insulation of walls of AHU / PU room as per specifications.	2000	SQM*						
6*	Thermal insulation of supply air duct & return air duct with finish as specified.	13000	SQM*						
7*	MS medium class drain piping upto nearest drain point with and without insulation								
a*	50mm	200	Rmt*						
b*	40mm	250	Rmt*						
8	Field instruments like pressure gauge, temperature gauge, pressure switch, differential pressure switch, flow switch, differential pressure gauge across hepa filters, flow meters, velocity sensor, static pressure sensors and other required instruments as per specifications, including necessary control panel form hook up with main DDCMIS as per specifications	1	LOT						
9	PLC control system complete with PLC panels , RIO panels and all accessories as specified in the specification for power house,ESP, admin and service building, AC and ventilation system.	1	LOT						
10*	Fibre optic cable.	400	Rmt*						
F	AC System for Aux. building for unit#1 & 2)								
1*	Air Cooled PAC-Unit complete with all accessories as specified The package unit shall be complete with all accessories like duct hetaers, pan humidifier, filters, acoustic insulation of duct for 5m from PU, drain piping with insulation upto nearest drain, required instrumentation etc								
(a)*	15 TR net capacity	1	No*						
(b)*	10 TR net capacity	1	No*						
2*	Air-cooled split type AC units consisting of condensing unit & evaporating unit including refrigerant pipes & fittings with insulation etc. (Minimum BEE Rating 5 Star for non ductable units).								


(a)*	5.0 TR capacity (ductable type, 415 V, 3 phase with isolation switch).	2	NO*						
(b)*	2.0 TR capacity (non-ductable type, 240 V, 1 phase) with isolation switch , i.e MCB of suitable rating as specified, voltage stabilizer, cabling, all supporting structure and refrigerent piping to suite actual site condition.	30	NO*						
(c)*	1.5 TR capacity (non-ductable type, 240 V, 1 phase) with isolation switch , i.e MCB of suitable rating as specified, voltage stabilizer, cabling, all supporting structure and refrigerent piping to suite actual site condition.	70	NO*						
3*	Air curtain								
(a)*	For minimum door height 3M and width 900 MM	8	NO*						
(b)*	For minimum door height 3M and width 1200 MM	4	NO*						
(C)*	For minimum door height 3M and width 1800 MM	4	NO*						
(d)*	For minimum door height 3M and width 2100 MM	2	NO*						
4*	Handling arrangement for AC equipments								
(a)*	Manually operated, platform trolley of 1 Ton capacity with base area 2m x 1.5m	4	NO*						
(b)*	3T Electric hoist with monorail arrangement for AC plant	1	NO*						
(C)*	1T Chain pulley block with travelling trolley	7	NO*						
5	Total lumpsum price for special tools & tackles for maintenance inclusive of packing forwarding, transportation up to site, etc. (Bidder shall submit item-wise price break-up-As per Appendix A).	1	LOT						
6	Total lumpsum price for commissioning spares inclusive of packing forwarding, transportation up to site, etc. (Bidder shall submit item-wise price break-up-As per Appendix B).	1	LOT						
7	Total lumpsum price for Mandatory Spare for air conditioning inclusive of packing forwarding, transportation up to site, etc. (Bidder to submit item-wise price break-up As per Annexure -B).	1	LOT						
8	Any other item not indicated above, but required to make the system complete in all respects.	1	LOT						

NOTES The bidder shall furnish unit rates for variable item (marked *) for necessary adjustment (plus or minus) variation during detailed engg. stage. The unit rates quoted above shall be considered and no separate unit rates shall be quoted. Unit rates shall be valid throughout the contract.

1 Bidder must submit prices in the Pro Forma duly filled in signed and stamped on every page without any ambiguity. The price shall be written against each item. Term such as "refer covering letter" etc. are not acceptable. Extra sheet may be attached if the space provided is not sufficient


Anshul


S A Khan


Praveen Kishore

APPENDIX- A of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (TOOLS AND TACKLES)
AIR CONDITIONING SYSTEM FOR 2X660 MW ENNORE STPP


SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY	
				Unit Price (Rs)	Total price (Rs)
1	FLAT D WRENCH - 6 MM TO 32 MM (12 Pcs)	1	SET		
2	BOX WRENCHES - 6 MM TO 22 MM (14 Pcs)	1	SET		
3	RING SPANNER - 6 MM TO 32 MM (12 Pcs)	1	SET		
4	ALLEN KEYS - 2 MM TO 10 MM	1	SET		
5	CRESCENT SCREW SPANNER	1	NO.		
6	SCREW DRIVER	1	NO.		
7	OFFSET SCREW DRIVER	1	NO.		
8	INSULATED PLIER	1	NO.		
9	TORCH LIGHT FOR 2 CELL	1	NO.		
10	HAMMER 1 LB	1	NO.		
11	OIL CAN	1	NO.		
12	POCKET THERMOMETER - 0 TO 50 DEG. C)	1	NO.		
13	INSULATION TAPE ROLL	1	NO.		
14	STEEL FOOT RULE - 12"	1	NO.		
15	FEELER GAUGE 9 BLADES	1	NO.		
16	PIPE WRENCH	1	NO.		
17	FLARE NUT (1/4")	6	NOS.		
18	FLARING TOOL	1	NO.		
19	TUBE CUTTER	1	NO.		
20	GAS CHARGING PIPE	1	NO.		
21	NITROGEN CHARGING ADAPTER	1	NO.		
22	FREON PRESSURE GAUGE (2 1/2" DIA DIAL)) 0 - 300 MM PSI	1	NO.		
23	FREON PRESSURE GAUGE (2 1/2" DIA DIAL)) 30 - 150 MM PSI	1	NO.		
24	PSYCHRO METER	1	NO.		
25	LOCK WITH KEY FOR TOOL BOX	1	NO.		
26	RATCHET 1/4"	1	NO.		
27	MS TOOL BOX	1	NO.		
NOTES					
1	ABOVE IS THE MINIMUM LIST. ANY OTHER TOOL / TACKEL REQUIRED FOR THE SYSTEM SHALL ALSO BE PROVIDED BY THE VENDOR WITHOUT ANY COST IMPLICATION.				

APPENDIX- B of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (COMMISSIONING SPARES)
AIR CONDITIONING SYSTEM FOR 2X660 MW ENNORE STPP

SL NO	DESCRIPTION OF EQUIPMENT/ ITEM	Qty	UNIT	SUPPLY	
				Unit Price (Rs)	Total price (Rs)
1	AHU FAN BELTS	1	SET		
2	PRESSURE GAUGE	1	NO.		
3	TEMPERATURE GAUGE	1	NO.		
4	FILTER	1	SET		
5	COMPRESSOR OIL	1 Lot	Ltr.		
6	REFRIGERANT	1 Lot	Kg		
NOTES					
1	ABOVE IS THE MINIMUM LIST. ANY OTHER COMMISSIONING SPARE REQUIRED FOR THE SYSTEM SHALL ALSO BE PROVIDED BY THE VENDOR WITHOUT ANY COST IMPLICATION.				


Anshul


S A Khan


Praveen Kishore

ANNEXURE - B of Doc No: PE-PF-412-553-A001
PRICE BREAKUP (MANDATORY SPARES)
AIR CONDITIONING SYSTEM FOR 2X660 MW ENNORE STPP

SL No	DESCRIPTION OF EQUIPMENT/ ITEM	QTY	UNIT	Unit Price (Rs)	Total ex-works price (Rs)	Remarks
A	MECHANICAL					
1	Vapour Compression chiller					
1.1	Oil filter "O" ring	1	set			
1.2	Refrigerant filter	1	set			
1.3	Master solenoid valve	1	no			
1.4	Master solenoid valve coil	1	set			
2	Screw compressors					
2.1	Valve Head assembly	0.25	of each type and rating			
2.2	Bearings	0.25	of each type and rating			
2.3	Seal gasket and other wear out parts in sets	0.25	of each type and rating			
2.4	O' rings & oil seals	2	set of each rating of compressor			
2.5	Crank case heater	1	no of each rating of compressor			
2.6	Suction filter elements	4	set of each rating of compressor			
2.7	Compressor shaft seal assembly	2	set of each rating of compressor			
2.8	Oil pressure failure safety switch	1	set of each rating of compressor			
3	Reciprocation compressor					
3.1	Piston ring in sets	0.25	of each type and rating			
3.2	Piston in sets	0.3	of each type and rating			
3.3	Bearing in sets	0.25	of each type and rating			
3.4	Seal gasket and other wear out parts in sets	0.25	of each type and rating			
3.5	Valve Head assembly	0.25	of each type and rating			
3.6	Crank shaft in sets	0.1	of each type and rating			
3.7	Connecting rod in sets	0.1	of each type and rating			
4	Pumps (condenser & chilling water pumps)					
4.1	Pump Impeller	1	no of each type			
4.2	Pump Bearing	1	set			
4.3	Pump Motor Bearing	1	set			
4.4	Shaft Sleeve	1	set			
5	Cooling Towers					
5.1	Nozzles for cooling towers	2	set			
5.2	Float valve assembly	1	no			
5.3	Fan Bearing	1	set			
5.4	Motor Bearing	1	set			
6	Packaged Air - conditioners					
6.1	Filters	1	set			
6.2	Expansion valve	1	set			
6.3	Motor for compressor	1	set			
7	Air Handling Unit					
7.1	V-Belt for AHU blower	2	sets of each type			
7.2	AHU blower bearing	1	sets of each type			
7.3	Filters	2	sets of each type			
7.4	Blower motor bearing	1	set			
8	Tube axial fan					

8.1	Bearing	1	set			
8.2	Filter	1	set			
8.3	Motor Bearing	1	set			
B	ELECTRICAL SPARES					
1	Terminal plates					
a	For motors upto 30 KW	10	nos			
b	For motors above 30 KW	4	nos			
2	Heaters	2	sets			
3	Greasing arrangements	4	sets of each type of motor			
4	Motor of each type and rating	0.1	of installed quantity or minimum 1 number whichever be higher.			
5	Bearings (DE and NDE) for each type and rating of motor	4	sets			
C	C&I SPARES					
	Each type of lamps, PBs, ILPBs, fuse, MCB, MCCB used in the equipment/system.	20%	of Installed of each type.			
a)	Measuring Instruments					
1	Indicators, Recorders, Electrical Metering and Skid Mounted Instruments					
1.1	Indicators, recorders and meters offered from each model for the project. These instruments shall be supplied with three sets of blank scales.	10%	of Installed of each type/Model or a minimum of one number for each model and type, whichever is more			
1.2	For skid mounted instruments	10%	of Installed of each type/Model or a minimum of one number for each model and type, whichever is more			
2	Temperature Elements and Thermowells					
2.1	Thermocouple/RTD elements	10%	of Installed of each type/Model or a minimum of one number for each model and type, whichever is more			
2.2	Thermowells	10%	of Installed of each type/Model or a minimum of one number for each model and type, whichever is more			
3	Temperature Transmitters and Electronic Transmitters (For Pressure, DP, Temp, Flow, Level), Temperature, Pressure, Flow & Level Switch, safety switches, Gauges, meters, Transducer or any other instrument etc.	10%	of Installed of each type/Model or a minimum of one number for each model and type, whichever is more			
4	DDCMIS/PLC system, Master slave clock system, Hart Management System, Vibration Monitoring system, CAAQMS, ERP/MIS/LAN/Simulator/ WAN, CCTV, Microprocessor based control system, and other Control System/Sub-systems/electronic system listed in NIT.					
1	I/O cards	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			
1.1	Analog Input module	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			
1.2	Analog output module	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			
1.3	RTD/TC cards/modules	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			
1.4	Digital input module	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			

1.5	Digital output module	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			
5	All types of electronic modules, controllers, function modules, cards, terminal boards, relay boards, power supply cards etc for above mentioned system and other Control System/Sub- systems and any other type of PCB not covered above	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			
6	Electronic Cards/modules	10%	of number for each type or minimum of 2 number for each type whichever is high.			
7	Auto/Manual stations, set-point/bias stations etc	10%	of qty Installed of each category/model or at least 2 No. of each type/model (Whichever is more)			
8	Control logic power supply fuses, MCB,MCCB, at each current rating required for the project.	20%	spare for each type/Model.			
9	Electronic cards of each type used for each type of Servers supplied with any control system	10%	or 2 no. (Whichever is more)			
10	Electric to pneumatic converters of each type utilized with automatic control system using pneumatic drives	10%	of each type or a minimum of one of each type, whichever is more.			
11	Plug-in type keyboard	5	nos for each type/Model.			
12	OEWS with 24" LED monitor	1	of each type / model with complete accessories & monitors.			
13	OVS	1	of each type with complete accessories & monitors.			
14	DVD/CD	10	boxes			
15	Data highway cable with adequate connectors of each type	200	mts each set			
16	Hard disc drive unit	5	nos of each type/model			
17	Prefab cable connectors	10%	or 5 nos (whichever is more) of each type of Installed			
18	Cubicle power supply power supply modules	10%	or 5 nos (whichever is more) of Installed of each type and rating			
19	Interposing/coupling relays.	10%	Installed of each type and rating			
20	Ethernet Switches, Routers & other communication hardware	10%	Installed of each type or a minimum of 2 numbers from each model, whichever is more			
21	Sensors with special cables, Power supply modules, Relay, Interface Module, and electronic modules used for vibration monitoring system.	10%	of qty installed or Five no. (Whichever is more) of each type			
22	Printer toners for all printers	1	no. (A3) Tonner			
23	RJ 45 connector with box of each type	20%	or 2 no. (Whichever is more)			
24	Hooters, Buzzers, Cooling fans of each type.	10%	2 no. (Whichever is more)			
25	Interface cables	2	sets of each type/model			
26	Power supply modules (AC to DC convertors)	10%	or Five no. (Whichever is more) of each type/model			
27	DVD/CD drive unit of each type	5	nos			
28	Mouse	5	nos. of each type/model.			

B)	Relay based Control Panels					
1	LEDs for indicating lights	10%	of qty installed.			
2	Control circuit fuses/MCB/MCCB/ Semiconductor Fuses	300%	of installed of each type, current rating.			
3	Relays modules & contactors.	20%	spare of qty Installed of each type & rating			
C)	Alarm Annunciation System					
1	logic modules, group card modules, power supply modules, Hooters and any other electronic module.	20%	spares of each type installed			
2	un-engraved window boxes complete with LED etc.	5%	spares of each type installed			
3	LEDs for annunciation facia windows and LEDs box assemblies offered for the project	20%	of qty installed			
4	Annunciator hooter	1	One (1) No. of each type			
D)	Un-interrupted Power Supply System and DC Control Power Supply System					
1	As per Manufacturer's Recommendation for Three Years Continuous Operation or minimum quantities indicated as below (whichever is more)					
2	Fuses/Semiconductor Fuses	300%	of installed of each type, current rating with each panel /board			
3	Miscellaneous parts for the power supplies such as SCRS, transistors, resistors, diodes, light bulbs, static switches, blocking diodes etc	10%	Minimum of 10% or atleast two (which ever is more) of each type			
4	Battery cells complete with contactor,cover plates etc	10%	of qty installed			
5	Electronic Modules like Rectifier control card, inverter control card, Driver card, IGBT Module, DC-DC converter card or any other card as listed in approved BOM for UPS, AC supply & 24 V DC supply etc.	1	1 Set of each type & rating			
6	Miniature Circuit breakers for AC and DC supply.	20%	of installed or 10 Nos of each type (which ever is more) for ACDB and DCDB.			
7	Digital/analog panel meters/indicators	5%	or 2 no. of each type (whichever is more)			
8	CT's, CVT's VT's chokes, AC/DC isolators, contactors, timers, relays.	10%	or 2 nos. of each type and rating, (whichever is more)			
9	Cooling Fans in UPS & 24 V DC charger panels	10%	or 2 nos. of each type and rating, (whichever is more)			
10	Following accessory equipment for the battery shall be furnished :	2	sets			
10.1	Cell lifting facilities					
10.2	Assembly wrenches					
10.3	Vent plug hydrometer thermometer					
10.4	Vent plug					
10.5	Supply of corrosion-preventive grease.					
10.6	10% spare cells.					
11	Electronic modules of each type & rating for UPS and DC control power supply system.	1	One set of with each set consisting of at least one number of each type of electronic module for inverters, chargers, static switch, stabiliser etc. as per approved BOM.			
12	MCCB for UPS & 24 V DC charger panels, ACDB, DCDB.	20%	of installed or 5 Nos of each type (which ever is more)			

Anshul

S A Khan

Praveen Kishore

E)	Erection hardware					
1	Instrument valves	10%	of each type & Size installed			
2	Condensate pots of each type & Size installed	10%	of total number of Installed or four numbers whichever is higher .			
3	Manifold	10%	of each type & Size installed			
4	Fittings	10%	of each type & Size installed			
F)	Mandatory Spares for Control valves, Power Cylinder, Control Dampers, Actuators and Accessories					
1	Following spares shall be furnished for control valves, Power Cylinder, Control Dampers as applicable.					
2	One set of spare control valve stem packing for each control valve.					
3	Two moulded rubber diaphragms for each control valve.					
4	One sets of each of O-rings and rubber gaskets for each control valve.					
5	100 percent qty. of lubricants for gaskets for each control valve on one year consumption basis.					
6	2 sets of limit switches and 1 set of valve positioner for each control valve.					
7	20 percent of position transmitter (4-20mA) for total qty. of control valve.					
8	One (1) set of valve trims (such as plug, stem, seat ring /cage, guide bushing, stem lock pin, packing retaining ring, etc) for each control valve.					
9	One completes actuator of each type or min 10% for each type and size whichever is more.					
10	20 percent of Solenoid valves or min 2 no. of each type for total qty. of control valves.					
11	20% of I to P converters, Pressure regulators.					
h)	Mandatory spares not covered above					
	Bidder to supply 10% or 1 no. (whichever is more) of each type of sensor/instrument, instrumentation/mechanical fittings etc for any other electronic system, feeder control cabinets, hydrastep (EWLI), Vibration Monitoring System, CCTV, C&I Lab Instruments, On line Carbon in Ash analyser system, On line Coal mass flow/speed measurement system, On line secondary air flow measurement system Mass Flow meter, Solid flow meter, 3 D Acoustic type level transmitters, Nucleonic & non nucleonic density transmitter etc.					

SUGGESTED PRICE FORMAT ANNEXURE-C (option 1)					Doc No:	PE-PF-412-553-A001
					Rev No:	1
Guaranteed Power Consumption For Air Conditioning System					Date of issue	18-Feb-17
S.NO.	DESCRIPTION OF EQUIPMENT	NO OF EQUIPMENT		TOTAL GUARANTEED POWER CONSUMPTION FOR EACH EQUIPMENT AT MOTOR INPUT TERMINAL AND CONTROL PANEL (IN KW)	DUTY FACTOR	TOTAL KW
		WORKING	STANDBY			
		3A	3B	4	5	6=3Ax4x5
1	AC-Plant-1: (CENTRAL CHILLED WATER SYSTEM FOR MAIN CR AREAS COMMON FOR UNIT-1&2.)					
1.1	Water chilling machine -Screw chiller	1	1		1	0
1.2	AHUs for Common control room areas, CER,	2	2		1	0
1.3	AHUs for 8.5 m battery charger & UPS room	1	1		1	0
1.4	Cooling tower fans for AC plant	1	1		1	0
1.5	Condenser water pumps for AC plant	1	1		1	0
1.6	Chilled water pumps for AC plant	1	1		1	0
1.7	Fresh air fans for above AHU rooms	4	0		1	0
2	AC PLANT-2 (ESP Building- UNIT- 1)					
2.1	Water cooled DX condensing machine -Screw	1	1		1	0
2.2	AHUs for ESP control room	1	1		1	0
2.3	Cooling tower fans for AC plant	1	1		1	0
2.4	Condenser water pumps for AC plant	1	1		1	0
2.5	Fresh air fans for above AHU rooms	2	0		1	0
3	AC PLANT-3 (ESP Building- UNIT- 2)					
3.1	Water cooled DX condensing machine -Screw	1	1		1	0
3.2	AHUs for ESP control room	1	1		1	0
3.3	Cooling tower fans for AC plant	1	1		1	0
3.4	Condenser water pumps for AC plant	1	1		1	0
3.5	Fresh air fans for above AHU rooms	2	0		1	0
4	AC PLANT-4 (Service Building)					
4.1	Water cooled package AC (20TR)	15	15		1	0
4.3	Fresh air fans for above PAC room.	20	0		1	0
4.4	Cooling tower fans for AC plant	1	1		1	0
4.5	Condenser water pumps for AC plant	1	1		1	0
5	AC PLANT-5 (Admin Building)					
5.1	Water cooled package AC (20TR)	3	3		1	0
5.2	Water cooled package AC (15TR)	3	3		1	0
5.3	Fresh air fans for above PAC room.	8	0		1	0
5.4	Cooling tower fans for AC plant	1	1		1	0
5.5	Condenser water pumps for AC plant	1	1		1	0
				TOTAL (KW)		1050
Note:	Estimated power consumption (EPC) figure for the system (for working drives only) has been considered as 1050 KW. So long bidder's quoted guaranteed power consumption (GPC) above remains within this EPC, there will be no technical loading of bid on power consumption for evaluation. However, if bidder's quoted GPC exceeds EPC, there shall be technical loading of bid for evaluation @ Rs3,56,607 per KW of additional power over EPC. Bidder's guaranteed power consumption at motor input terminals (not shaft power) as furnished in relevant schedule shall be demonstrated by the successful bidder during performance testing at works/ site. In case power consumption is noted higher than EPC / bidder's quoted GPC whichever is higher, during inspection/ PG test, penalty @ Rs3,56,607 per KW shall be levied on vendor.					

SUGGESTED PRICE FORMAT ANNEXURE-C (option 2)					Doc No:	PE-PF-412-553-A001
Guaranteed Power Consumption For Air Conditioning System					Rev No:	1
					Date of issue	18-Feb-17
S.NO.	DESCRIPTION OF EQUIPMENT	NO OF EQUIPMENT		TOTAL GUARANTEED POWER CONSUMPTION FOR EACH EQUIPMENT AT MOTOR INPUT TERMINAL AND CONTROL PANEL (IN KW)	DUTY FACTOR	TOTAL KW
		WORKING	STANDBY			
		3A	3B	4	5	6=3Ax4x5
1	AC-Plant-1: (CENTRAL CHILLED WATER SYSTEM FOR MAIN CR AREAS COMMON FOR UNIT-1&2.)					
1.1	Water chilling machine -Screw chiller	1	1		1	0
1.2	AHUs for Common control room areas, CER,	2	2		1	0
1.3	AHUs for areas at 17 m level conference room,	1	1		1	0
1.4	AHUs for 8.5 m battery charger & UPS room	1	1		1	0
1.5	Cooling tower fans for AC plant	1	1		1	0
1.6	Condenser water pumps for AC plant	1	1		1	0
1.7	Chilled water pumps for AC plant	1	1		1	0
1.8	Fresh air fans for above AHU rooms	6	0		1	0
2	AC PLANT-2 (ESP Building- UNIT- 1)					
2.1	Water cooled DX condensing machine -Screw	1	1		1	0
2.2	AHUs for ESP control room	1	1		1	0
2.3	Cooling tower fans for AC plant	1	1		1	0
2.4	Condenser water pumps for AC plant	1	1		1	0
2.5	Fresh air fans for above AHU rooms	2	0		1	0
3	AC PLANT-3 (ESP Building- UNIT- 2)					
3.1	Water cooled DX condensing machine -Screw	1	1		1	0
3.2	AHUs for ESP control room	1	1		1	0
3.3	Cooling tower fans for AC plant	1	1		1	0
3.4	Condenser water pumps for AC plant	1	1		1	0
3.5	Fresh air fans for above AHU rooms	2	0		1	0
4	AC PLANT-4 (Service Building)					
4.1	Water cooled package AC (20TR)	15	15		1	0
4.3	Fresh air fans for above PAC room.	20	20		1	0
4.4	Cooling tower fans for AC plant	1	1		1	0
4.5	Condenser water pumps for AC plant	1	1		1	0
5	AC PLANT-5 (Admin Building)					
5.1	Water cooled package AC (20TR)	3	3		1	0
5.2	Water cooled package AC (15TR)	3	3		1	0
5.3	Fresh air fans for above PAC room.	8	0		1	0
5.4	Cooling tower fans for AC plant	1	1		1	0
5.5	Condenser water pumps for AC plant	1	1		1	0
				TOTAL (KW)		1090
Note:	Estimated power consumption (EPC) figure for the system (for working drives only) has been considered as 1090 KW. So long bidder's quoted guaranteed power consumption (GPC) above remains within this EPC, there will be no technical loading of bid on power consumption for evaluation. However, if bidder's quoted GPC exceeds EPC, there shall be technical loading of bid for evaluation @ Rs3,56,607 per KW of additional power over EPC. Bidder's guaranteed power consumption at motor input terminals (not shaft power) as furnished in relevant schedule shall be demonstrated by the successful bidder during performance testing at works/ site. In case power consumption is noted higher than EPC / bidder's quoted GPC whichever is higher, during inspection/ PG test, penalty @ Rs 3,56,607 per KW shall be levied on vendor.					