

VOLUME II

NTPC LIMITED

2 X 500 MW MAUDA FGD PROJECT

TECHNICAL SPECIFICATION

FOR

HT XLPE POWER CABLES

SPECIFICATION NO: *PE-TS-444-507-E001*

REVISION: 0



BHARAT HEAVY ELECTRICALS LIMITED

POWER SECTOR

PROJECT ENGINEERING MANAGEMENT

NOIDA, UP (INDIA) – 201301



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

REVISION 0

DATE: 01.05.2019

SHEET 1 of 1

CONTENTS

<u>S. NO.</u>	<u>DESCRIPTION</u>	<u>NO. OF SHEETS</u>
1.	CONTENTS	01
2.	COMPLIANCE CERTIFICATE	01
3.	SECTION – I	
	a) SPECIFIC TECHNICAL REQUIREMENTS	03
	b) DATA SHEET-A	04
	c) DATA SHEET-C (GUARANTEED TECHNICAL PARTICULARS)	04
4.	SECTION – II	
	a) GENERAL TECHNICAL SPECIFICATION	02
	b) QUALITY PLAN (ALONGWITH ANNEXURE A to QP)	16
	c) ANNEXURE-B (QUALITY ASSURANCE & INSPECTION)	04
	d) ANNEXURE-C TO SECTION-II (STEEL DRUM DRAWING, TYPICAL)	01
	TOTAL NO. OF SHEETS=	37
	(INCLUDING COVER/ SEPARATOR SHEETS)	



DOCUMENT TITLE

TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

REVISION 0

DATE: 01.05.2019

SHEET 1 of 1

COMPLIANCE CERTIFICATE

The bidder shall confirm compliance to the following by signing/ stamping this compliance certificate and furnishing same with the offer.

1. The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusion/ deviation with regard to same
2. There are no deviation with respect to specification other than those furnished in the 'schedule of deviations'
3. Only those technical submittals which are specifically asked for in NIT to be submitted at tender stage shall be considered as part of offer. Any other submission, even if made, shall not be considered as part of offer.
4. Any comments/ clarifications on technical/ inspection requirements furnished as part of bidder's covering letter shall not be considered by BHEL, and bidder's offer shall be construed to be in conformance with the specification.
5. Any changes made by the bidder in the price schedule with respect to the description/ quantities from those given in 'BOQ-Cum-Price schedule' of the specification shall not be considered (i.e., technical description & quantities as per the specification shall prevail).

BIDDER'S STAMP & SIGNATURE



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

SECTION I

REVISION - 0

DATE: 01.05.19

SECTION –I

SPECIFIC TECHNICAL REQUIREMENTS



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

SECTION I

REVISION - 0

DATE: 01.05.2019

SHEET 1 OF 2

1.0 SCOPE OF ENQUIRY

- 1.1 Design, Manufacture, Inspection and Testing at Manufacturer's works, proper packing and delivery to site of HT XLPE Power Cables conforming to this specification.
- 1.2 General technical requirements of the HT XLPE Power cables are indicated in Section-II. Project specific technical/ quality requirements / changes are listed in Section-I.
- 1.3 The stipulations of Section-I, followed by those of Data Sheet-A shall prevail in case of any conflict between the stipulations of Section-I, Data Sheet - A & Section-II.
- 1.4 The documents shall be in English Language and MKS system of units.

2.0 BILL OF QUANTITIES:

- 2.1 Quantity requirements shall be as per 'BOQ-cum-price schedule' as part of NIT.

3.0 SPECIFIC TECHNICAL REQUIREMENTS

- 3.1 The quality plan no. 0000-999-QOE-S-042 R0 shall be read in conjunction with Annexure B (Quality Assurance & Inspection).

4.0 Type test

- 4.1 Successful bidder shall submit the reports of all the type tests as listed in this specification and carried out within last ten years from the date of bid opening i.e. 26.02.18. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent lab or should have witnessed by a client.
- 4.2 In addition to Sl. No. 4.1 above, type test are required to be conducted. Bidder shall indicate the unit price of cables inclusive of type test charges. No separate Type Test charges are to be quoted by bidder.
- 4.3 Type test requirement shall be as per Annexure A to QAP.

5.0 DRAWINGS & DOCUMENTS TO BE SUBMITTED

- 5.1 Following documents/drawings shall be submitted after placement of order for BHEL & customer's approval:-

Sl. No.	Drawings/Document Description	Drawings / Document Number
1.	Technical Data sheet & Cross section drawings for HT XLPE Power Cables	9561-109-PEM-PVE-W-235
2.	Manufacturing Quality Plan for HT XLPE Power Cables	9561-109-PEM-PVE-W-235*
3.	Type test reports for HT cables (as per clause 4.1 above)	9561-109-PEM-PVE-W-243
4.	Steel drum drawing – HT XLPE Power Cables (if applicable)	PE-V0-444-507-E105



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

SECTION I

REVISION - 0

DATE: 01.05.2019

SHEET 2 OF 2

Sl. No.	Drawings/Document Description	Drawings / Document Number
5.	Type Test Reports – HT XLPE Power Cables (Conducted for this contract)	PE-V0-444-507-E106

Note:

- * Standard Quality Plan as enclosed in the technical specification is to be appended with cover sheet bearing document number and description as stated above. The signed and stamped copy of the same shall be submitted to BHEL without making any changes in the contents of the document.



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS-444-507-E001

VOLUME II

SECTION I

REVISION 00

DATE: 01.05.2019

SHEET -

DATASHEET A



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

SECTION I

REVISION 00

DATE: 01.05.19

SHEET 1 of 4

1.0	Type of Cable	Flame Retardant-Low Smoke (FRLS)
2.0	Standard applicable in general (Latest amendment to be referred if any)	IS:7098 (Part-2), IS:8130, IS:5831, IS:10810, IS:3975, ASTMD:2843, ASTMD:2863, IEC-754-1, IEC:60332 (Part-1), IEC:60332-3-23, IEEE:60383
3.0	Voltage Grade	11/11kV(UE) & 3.3/3.3kV(UE)
4.0	Number of cores, cross sectional area of conductors and quantities	11 kV – Unarmoured - 01C X 630 SQ. MM 11 kV – Unarmoured - 03C X 150 SQ. MM 11 kV – Armoured - 03C X 150 SQ. MM 3.3 kV – Unarmoured - 03C X 150 SQ. MM 3.3 kV – Armoured - 03C X 150 SQ. MM As per BOQ cum price schedule (part of NIT)
5.0	CONDUCTOR	
(a)	Material	Aluminium
	Grade and Class	Multi-Stranded, H2, Class 2
(b)	Standard Applicable	IS: 8130
(c)	Shape	Compacted Circular
(d)	Min. number and diameter of strands	As per Class-2 of IS: 8130
(e)	Conductor screen	
(i)	Material	Extruded Cross-linked Semi-conducting compound
(ii)	Minimum thickness	0.3 mm
6.0	INSULATION	
(a)	Material	Cross-Linked Polyethylene(XLPE)
(b)	Standard Applicable	IS: 7098 (Part-2)
(c)	Continuous withstand temperature	90°C
(d)	Short-circuit withstand temperature	250°C
(e)	Nominal Thickness of Insulation	As per Table – 4 of IS 7098 Part-2
7.0	INSULATION SCREEN	For both SINGLE CORE & MULTI CORE cables
(a)	Non-metallic	
(i)	Material	Extruded Cross-linked Semi-conducting compound
(ii)	Type of Semiconducting compound	Bonded
(iii)	Minimum thickness	0.3 mm
(b)	Metallic	
(i)	Material	Copper
(ii)	Type	Tape
(iii)	Size	Nominal thickness 0.1mm with tolerance ($\pm$) 10%
(iv)	Minimum Overlap	20%
(c)	Earth fault current withstand capacity	600A, 2 sec (For multi-core cables, screen of each core shall be rated individually for the above value).
8.0	EXTRUSION (Insulation and Screens)	
(a)	Process	Triple Extrusion



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

SECTION I

REVISION 00

DATE: 01.05.19

SHEET 2 of 3

		(Extruded semi-conducting compound conductor screen and insulation screen shall be applied along with XLPE insulation in a single operation by triple extrusion process).
(b)	Method of Curing	For 11 kV & 3.3 kV - Dry curing/gas curing/steam curing
9.0	CORE IDENTIFICATION	Colour coding as per IS:7098(Part-2)
10.0	INNER SHEATH	(Not applicable for Single Core Unarmoured Cable)
(a)	Material	PVC Type ST-2
(b)	Standard Applicable	IS: 7098 (Part-2) & IS: 5831
(c)	Colour	Black
(d)	Whether FR-LSH	NO
(e)	Inner sheath applicable for single core cable	NO
(f)	Fillers	Acceptable
(g)	Material of fillers (if permitted)	Same as inner sheath (Material of filler to be compatible with that of inner sheath)
(h)	Method of application	
(1)	Multi-core cables:	
(i)	With fillers	[√]Pressure extruded [√]Vacuum extruded
(ii)	Without fillers	Pressure extruded
(i)	Thickness of inner sheath	As per Table-5 of IS: 7098 (Part-2)
11.0	ARMOUR	Applicable, as per BOQ cum price schedule (part of NIT)
a)	Material	Galvanised Steel
(i)	Multicore cables	Strip Armour (Armour dimensions as per Sl. No.(ii) of table – 6 of IS 7098 Part-II.
(ii)	Single core cables	Not applicable as per BOQ cum price schedule (part of NIT)
b)	Minimum coverage	90%
c)	Gap between armour wires	Shall not exceed one armour wire space (No core-over/over-riding)
d)	Breaking load of joint	95% of normal armour
e)	Armour joint surface	To be applied with Zinc rich paint
12.0	OUTERSHEATH	
(a)	Material	PVC Type ST2 as per IS: 5831
(b)	Colour	Black
(c)	Whether FR-LSH	Yes
(d)	Method of application	Extruded
(e)	Thickness of outer sheath	As per Table-7 of IS: 7098 (Part-2)
(f)	Marking	(A) Following shall be marked @ 5m (by embossing): 'FR-LSH', Manufacturer's name and trade mark, Year of manufacture, cable code, Type of cable and Voltage grade, cross section area of conductor and number of cores, Screen fault current 600A for 2 sec, "BHEL-PEM", "NTPC"



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS- 444-507-E001

VOLUME II

SECTION I

REVISION 00

DATE: 01.05.19

SHEET 3 of 3

		(B) Progressive sequential marking of length of the cable in metres @ 1m (by embossing/ printing)
13.0	FR-LSH CHARACTERISTICS	
(a)	Oxygen index	Min 29 (As per IS 7098-2 /ASTMD 2863)
(b)	Temperature index	Min. 250°C(As per IS 7098-2 /ASTMD 2863)
(c)	Acid gas generation	Max. 20% by weight (As per IS 7098-2 /IEC-60754-1)
(d)	Smoke density rating	Max. 60% (As per IS 7098-2 /ASTM D 2843)
(e)	Flammability Test	
(i)	Flammability test for single cable	YES As per: IEC-60332 Part-1
(ii)	Flammability test for bunched cables	YES As per IEC-60332 Part-3, CAT-B
14.0	TOLERANCE ON OUTER DIAMETER	(±)2 mm. over the declared value
15.0	CABLE DRUMS	
(a)	Type of Drum	[√] Wooden as per IS 10418 [√] Steel as per relevant IS
(b)	Standard drum length	1000M (±) 5% for Single core cables 750M (±) 5% for Multi-core cables
(c)	Painting	Entire surface to be painted
(d)	Outermost Layer	To be covered with waterproof polyethylene
(e)	Others	Both the ends of the cables shall be properly sealed with heat shrinkable PVC/ rubber caps secured by 'U' nails so as to eliminate ingress of water during transportation, storage and erection. Wood preservative anti-termite treatment shall be applied to the entire drum.
(f)	Particular information on Drum	Each drum shall carry manufacturer's name, owner's name, address and contract no., item no. & type, size & length of cable and net gross weight stencilled on both sides of drum. A tag containing same information shall be attached to the leading end of the cable. An arrow & suitable accompanying wording shall be marked on one end of the reel indicating the direction in which it should be rolled.

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS-444-507-E001	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: 01.05.2019
		SHEET 1 OF 4	

DATASHEET C

**GUARANTEED TECHNICAL PARTICULARS
(TO BE SUBMITTED BY SUCCESSFUL BIDDER)**

S.No.	Particulars	Unit	Description
1.0	GENERAL		
1.1	Name of Manufacturer	-	
1.2	Place of Manufacture	-	
2.0	STANDARDS APPLICABLE		
2.1	IS: 7098 Part-2 For general specification of XLPE Cables	YES	
2.2	IS: 8130 For conductor material	YES	
2.3	IS: 5831 For material of innersheath & outersheath	YES	
2.4	IS: 3975 / IS: 8130 For armour of 3 core/ single core cables	YES	
2.5	IS: 10810 For method of tests	YES	
2.6	ASTMD-2863 For oxygen index test	YES	
2.7	SS:424-14-75 & IEC-60332-3 & IEC-60332-1 & IEEE: 60383 For flammability test	YES	
2.8	IEC-60754-1 For acid gas generation test	YES	
2.9	ASTMD-2843 For smoke generation test	YES	
2.10	Current rating of cables conforms to	-	
2.11	Short circuit rating conforms to	-	
2.12	Formula for calculating short circuit current for different durations	-	
3.0	INSTALLATION CONDITIONS AT SITE		
3.1	Ambient air temperature	deg. C	
3.2	Ground temperature	deg. C	
3.3	Depth of laying of cables buried in ground	cm	
3.4	Thermal resistivity of soil	deg. C cm/W	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS-444-507-E001	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: 01.05.2019
		SHEET 2 OF 4	

4.0	INSTALLATION CONDITIONS FOR CURRENT RATING SPECIFIED AT CLAUSE 7.3		
5.0	CHARACTERISTICS OF FR-LSH SHEATH		
5.1	Oxygen index	-	
5.2	Temperature index	-	
5.3	Acid gas generation	-	
5.4	Smoke density rating	-	
6.0	CABLE DRUMS		
6.1	Type & construction	-	
6.2	Standard drum length	-	
6.3	Tolerance on drum length	-	
7.0	INFORMATION TO BE FILLED IN FOR EACH SIZE CABLE IN THE FORM OF TABLE		
7.1	No. of cores x size	-	
7.2	Voltage grade (Uo/U)	kV	
7.3	Base current ratings (*) based on Clause No. 3.0		
a)	In air	Amp	
b)	In ground	Amp	
c)	ducts	Amp	
7.4	Short circuit rating	kA, sec	
7.5	Properties		
a)	D.C. resistance of conductor at 20 deg. C	ohm/km	
b)	A.C. resistance of conductor at 90 deg. C	ohm/km	
c)	Reactance of cable at normal frequency	ohm/km	
d)	Electrostatic capacitance of cable at normal frequency	mF/km	
7.6	CONDUCTOR		
a)	Material type & grade	-	
b)	No & dia of wires in each core before stranding	no x mm	
c)	Shape	-	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS-444-507-E001	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: 01.05.2019
		SHEET 3 OF 4	

7.7	CONDUCTOR SCREEN		
a)	Material	-	
b)	Minimum thickness	mm	
7.8	XLPE INSULATION		
a)	Nominal thickness of insulation	mm	
b)	Method of curing	-	
7.9	INSULATION SCREEN		
a)	Type of screen	-	
b)	Material and thickness (minimum and nominal)	mm	
i)	Metallic	-	
	No. of tapes and Minimum overlapping	-	
ii)	Non-metallic	-	
iii)	Earth fault current withstand capacity (calculation to be furnished)	kA, sec.	
7.10	PVC ST2 INNERSHEATH		
a)	Material	-	
b)	Thickness (min.)	mm.	
c)	Method of application	-	
1)	Multi-core cables		
i)	With fillers	-	
ii)	With out fillers	Pressure Extruded	
2)	Single core cables		
d)	Type & Shape of fillers (if used)	-	
e)	Colour	-	
7.11	ARMOUR		
a)	Material	-	
b)	Size/ dimensions	-	
c)	Minimum no. of wires/ formed wires	-	
d)	Tolerance on formed wire dimension	-	
e)	Maximum resistivity of GS formed wire	-	
f)	Maximum resistivity of Al round wire	-	
7.12	PVC/POLYETHYLENE ST2 FR-LSH OUTERSHEATH		
a)	Nominal thickness of outer sheath	mm.	

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			

	DOCUMENT TITLE TECHNICAL SPECIFICATION FOR HT XLPE POWER CABLES	SPECIFICATION NO. PE-TS-444-507-E001	
		VOLUME II	
		SECTION I	
		REVISION 00	DATE: 01.05.2019
		SHEET 4 OF 4	

7.13	DIAMETERS		
a)	Diameter of insulated conductor	mm.	
b)	Cable diameter under armour	mm.	
c)	Cable diameter over armour	mm.	
d)	Overall diameter of cable	mm.	
7.14	Tolerance on overall diameter	(±) mm	
7.15	Minimum bending radius	x O.D.	
7.16	Safe pulling force	kg.	
7.17	Weight of cable	kg./km	
a)	Weight of conductor	MT./km	
b)	Weight of XLPE insulation	MT./km	
c)	Weight of PVC (Inner Sheath & Fillers)	kg./km	
d)	Maximum resistivity of GS formed wire	kg./km	
e)	Weight of PVC/Polyethylene (Outer Sheath & Fillers)	kg./km	
7.18	Dimension of drum	mm.	
7.19	Shipping weight	kg	
7.20	Cable marking on outer sheath	-	

(*) For single core cables, the continuous current rating shall be furnished separately for armour earthed at one end and at both ends.

:

NAME OF VENDOR			SEAL	REV.	
NAME	SIGNATURE	DATE			



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS-444-507-E001

VOLUME II

SECTION II

REVISION 00

DATE: 27.03.18

SECTION – II

GENERAL TECHNICAL SPECIFICATION



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR
HT XLPE POWER CABLES**

SPECIFICATION NO. PE-TS-436-507-E001

VOLUME II

SECTION II

REVISION 00

DATE: 27.03.2018

SHEET 1 OF 1

1.0 TECHNICAL REQUIREMENTS

- 1.1 Technical requirements for HT XLPE POWER CABLES shall be as indicated in this section, in addition to those specified in Section I & Datasheet-A.

2.0 CODES & STANDARDS

- 2.1 The design, material, construction, manufacture, inspection, testing and performance of HT XLPE POWER CABLES shall conform to the latest revision of relevant standards and codes of practices mentioned in Data Sheet - A.
- 2.2 In case of conflict between the applicable reference standard and this specification, this specification shall govern.

3.0 QUALITY ASSURANCE REQUIREMENTS

- 3.1 Bidder shall confirm compliance with the Standard Quality Plan as attached with the specification without any deviations. At contract stage, the successful bidder shall submit the same QP for BHEL/ ultimate customer's approval. In case bidder has reference QP agreed with ultimate customer, same can be submitted for specific project after award of contract for BHEL/ultimate customer's approval. There shall be no commercial implication to BHEL on account of minor changes in QP during contract stage.
- 3.2 All materials shall be procured, manufactured, inspected and tested by vendor/ sub-vendor as per approved Quality Plan.
- 3.3 Type testing requirements, routine / acceptance testing and special testing requirements shall be as per Annexure – A to QP. Charges for all these tests for all the equipment & components shall be deemed to be included in the bid price (except UV Radiation & Hydraulic Stability test).
- 3.4 The charges of UV Radiation test & Hydrolytic Stability test (if applicable) shall be reimbursed extra at actual against original money receipt of Govt. Lab. (CPRI/ ERDA etc.).
- 3.5 Cost of cables consumed for testing shall be to bidder's account.

4.0 Packing

- 4.1 Cables shall be supplied in non-returnable drums. Material of cable drums shall be as specified in Datasheet-A.
- 4.2 In case of wooden drums, all wooden parts shall be manufactured from seasoned wood treated with copper naphthenates / zinc naphthenates (refer IS: 401). Dimensions of wooden drums shall be as per IS 10418. All ferrous parts shall be treated with suitable rust protective finish or coating to avoid rusting during transit and storage. BIS certification mark shall be stamped on each cable drum. Over the cables polyethylene sheet shall be wrapped and then sealed properly.
- 4.3 In case of Steel drums, New or practically new cable drums made of steel and painted with epoxy resin paint are to be used. Cable ends are carefully protected before packing. Over the cables polyethylene sheet shall be wrapped and then sealed properly. For Typical details of Steel drums, Annexure-B to Section-II, may be referred by the bidder. Bidder may modify, to choose appropriate dimensions of steel drums to suite various sizes/weight/ lengths of HT XLPE POWER CABLES. BIS certification mark shall be stamped on each cable drum.



DOCUMENT TITLE

**TECHNICAL SPECIFICATION FOR HT
XLPE POWER CABLES**

SPECIFICATION NO. PE-TS-444-507-E001

VOLUME II

SECTION II

REVISION 00

DATE: 01.05.2019

SHEET -

QUALITY PLAN

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 1 of 12 VALID UP TO: 11-04-15		REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG		APPROVED BY अनुमोदित A.K. Gargi Dt. 12-04-12 RAJEEV GARG		1		
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks	
					M	C/N					D*	M	C	N	
1	2	3	4	5	6		7	8	9		10				11

Instructions: 1) Cable manufacturer to maintain records to show co- relation of raw materials to finished cables i.e. raw material batch/ lot no. should be traceable to the final cable drum number or batch number.
2) Cable manufacturer to maintain all quality control records identified as per all QP stages enumerated below whether it is identified for NTPC verification or witness or not.
3) Sources of raw material shall be submitted at the time of submission of endorsement sheet for approval by NTPC.

A	Raw material/ Brought out Items													
1.01	Aluminum rod for conductor	1.Make	MA	Verify	100%	---	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	QCR		V	--	--	
		2. Grade	MA	--do--	--do--	--	NTPCADS	NTPC ADS	--do--		V	--	---	
		3. Resistivity	MA	Elect	As per cable mnfr std.	--	IS 5082	IS 5082	-do--		P	--	--	
1.02	Aluminum rod for Armouring (as applicable)	1. Make	MA	Verify	100%	--	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	Q.C.R		V	--	--	
		2. Grade	MA	Verify	As per mnfr std.	--	NTPC ADS	NTPC ADS	Manuf. TC		V	--	--	
		3. Resistivity	MA	Verify	-do-	-	IS 5082	IS 5082	-do--		P	--	--	
1.03	Copper rod (If applicable)	1. Make	MA	Verify	100%	--	Manufacturer approved vender	Manufacturer approved vender	QCR		V	--	--	
		2. Resistivity	MA	Verify	As per cable mnfr std.	--	IS 613	IS 613	--do--		P			
1.04	XLPE compound for insulation	1. Make	MA	Verify	--do--	100%	MANUFACTURER APPROVED SOURCES	MANUFACTURER APPROVED SOURCES	--do--		V	V	V	
		2. Type/ Grade	MA	Verify	100%	100%	NTPC ADS	NTPC ADS	--do--		V	V	V	
		3. Shelf life/ Storage condition	MA	Verify	100%	100%-	Compound manuf. Std	Compound manuf. Std	QCR		V	V	V	
		4. All acceptance test as per manufacturer norms	MA	Verify	As per manufacturer norms	As per manufacturer norms	NTPC ADS	NTPC ADS	Supplier TC		V	V	V	Refer note 1

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 2 of 12 VALID UP TO: 11-04-15		REVIEWED BY Inderjit Singh Vikram Talwar Rajeev Garg						2
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks	
					M	C/N					D*	M	C	N	
1	2	3	4	5	6		7	8	9	10				11	

1.05	PVC Compound for Inner sheath	1. Make	MA	Verify	As per manufacturer norms	--	MANUFACTURER APPROVED sources	MANUFACTURER APPROVED sources	Supplier TC		V	V	--	
		2. Type/ Grade	MA	Verify	--do--	--	NTPC ADS	NTPC ADS	--do--		V	V	--	
1.06	Semi Conducting Compound	1. Make	MA	Verify	100%	100%	NTPC Approved sources	NTPC Approved sources	--do--		P	V	V	
		2. Resistivity	MA	--do--	100%	100%	NTPC ADS	NTPC ADS	--do--		P	V	V	
		3. Shelf Life / Storage condition	MA	Verify	100%	100%	Compound manuf. recommendation	Compound manuf. recommendations	--do--		P	V	V	
1.07	Copper tape (Electrolytic High Conductivity Copper Foils)	1. Make	MA	Verify	100%	100%	NTPC Approved sources	NTPC Approved sources	--do--	√	P	V	V	
		2. Dimension	MA	Measu	As per cable mnfr std.	--	NTPC ADS	NTPC ADS	--do--		P	--	--	
		3. Resistivity	MA	Verify	100%	----	IS 613	IS 613	Supplier TC		V	V	V	
		4. Chem. & Phy. properties	MA	Elec & Mech.	As per cable mnfr std.	--	As per cable mnfr std.	As per cable mnfr std.	--do--		V	V	-	
1.08	Polyester Tape (As applicable)	1. Make	MA	Verify	100%	100%	Manufacturer approved vendor	Manufacturer approved vendor	--do--		P	V	V	
		2. Dimension	Phy.	Meas	As per cable mnfr std.	--	Manuf. Data sheet	Manuf. Data sheet	--do--		P	-	-	
		3. T.S & Elongation	Phy.	Phy.	-do--	--	--do--	--do--	--do--		V	--	--	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S-042 REV-00 DATE : 12-04-12 Page 3 of 12 VALID UP TO: 11-04-15		REVIEWED BY Inderjit Singh Vikram Talwar RAJEEV GARG		APPROVED BY  A.K. Garg		3	
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency			Remarks	
					M	C/ N				D*	M	C	N	
1	2	3	4	5	6		7	8	9	10			11	

1.09	Steel wire / Formed Wire (As applicable)	1. Make	MA	Verify	As per cable mnfr std.	100%	MANUFACTURER APPROVED sources	MANUFACTURER APPROVED sources	QCR		V	V	V	BIS licensees only
		2. Dimension	MA	Meas	1 sample from each size / lot	--	NTPC APPROVED DATA SHEET & IS 3975	NTPC APPROVED DATA SHEET & IS 3975	QCR		P	--	--	
		3. All acceptance tests as per IS 3975	MA	Verify	As per IS 3975	--	IS 3975	IS 3975	Supplier TC		V	V	--	
1.10	PVC compound for Sheath	1. Make	MA	Verify	As per manufacturer norms	100%	MANUFACTURER APPROVED sources	MANUFACTURER APPROVED sources	QCR		V	V	V	
		2. Type / Grade	MA	Verify	100%	100%	NTPC ADS	NTPC ADS	QCR		V	V	V	
		3. All acceptance test as per manufacturer norms	MA	Verify	As per manufacturer norms	As per manufacturer norms	Compound Mnfr standard	IS 5831	QCR		V	V	V	Refer note 1
		4. Thermal Stability	MA	Chem	One sample / Batch	--	IS 5831	IS 5831	QCR		P	--	--	
		5. Oxygen Index	MA	Chem	--do--	--	NTPC ADS/ IS 10810 Part 58	NTPC ADS	--do--		P	--	--	
1.11	Filler Material (As applicable)	1.Type	MA	Verify	As per manuf. Std.	----	NTPC ADS	NTPC ADS	QCR	-	P	--	--	
1.12	Wooden Drum	1. Dimension	MI	Meas	Manuf. Std.	--	IS 10418	IS10418	--do--		P	--	--	
		2. Anti termite treatment	MI	Chem	Cable manuf. std	--	CABLE MANUF. STD.	CABLE MANUF. STD.	COC		V	V	V	COC from drum manuf.
1.13	Steel Drum	1. Dimension	MI	Meas	--do--	--	--do--	--do--	QCR		P	--	--	
		2. Surface finish	MI	Meas	--do--	--	--do--	--do--	--do-		P	--	--	
B	Process & Stage Inspection													
2.01	Wire Drawing	1.Surface finish	MA	Visual	One sample/Settling of each size	--	SHOULD BE SMOOTH & FREE FROM SCRATCHES	SHOULD BE SMOOTH & FREE FROM SCRATCHES	QCR		P	--	--	
		2. Wire Diameter	MA	Meas	--do--	--	NTPC ADS	NTPC ADS	--do-		P	--	--	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

एन टी सी NTPC		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 4 of 12 VALID UP TO: 11-04-15			REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG		APPROVED by A.K. Garg Approved Date: 12-04-12				4
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks		
					M	C/ N				D*	M	C	N			
1	2	3	4	5	6		7	8	9	10				11		

2.02	Bunching / stranding	3. Tensile test	CR	Mech	One sample/Setting of each size	One sample / Setting of each size	IS 8130	IS 8130	QCR		P	V	V	Refer Sl. No.3.03(iii)
		4. Wrapping test	CR	Mech	--do--	--do--	--do--	--do--	--do--		P	V	V	--do--
		5. Annealing Test	CR	Mech	--do--	--do--	--do--	--do--	--do--		P	V	V	--do--
		1. No. of wires	MA	Meas	--do--	--	NTPC ADS	NTPC ADS	--do--		P	--	--	
		2. Dia of wire	MA	Meas	--do--	--	--do--	--do--	--do--		P	--	--	
		3. Dimension of Conductor	MA	Meas	--do--	--	--do--	--do--	--do--		P	--	--	
		4. Direction of lay	MA	Visual	--do--	--	--do--	--do--	--do--		P	--	--	
		5. Records of strand breakage / welding during conductor stranding	MA	Verify	--do--	--	IS 8130	IS8130	--do--		P	--	--	
		6. Surface finish	MA	Visual	--do--	--	--do--	--do--	--do--		P	--	--	
		7. DC Resistance	CR	Meas	--do--	--	IS8130/NTPC ADS	IS8130/ NTPC ADS	--do--		P	--	--	
2.03	Insulation extrusion (Conductor screen, XLPE Insulation & Insulation screen)	1. Surface finish	MA	Visual	One sample / Setting of each size	--	Extrusion should be by triple extrusion technique Method of curing for cables shall be "dry curing / gas curing/ steam curing" up to 11KV & " dry curing/ gas curing " for 19/33 KV Insulation extrusion area should be preferably clean & dust free. Extrusion Should be smooth. No porosity is permitted		QCR-		P	-	--	
		2. Thickness	CR	Meas	--do--	--	NTPC ADS	NTPC ADS	QCR		P	--	--	
		3. Eccentricity & Ovality	CR	Meas	--do--	--	Eccentricity of core shall not exceed 10% and Ovality not to exceed 2%	Eccentricity of core shall not exceed 10% and Ovality not to exceed 2%	--do--		P	--	--	
		3. Hot Set	CR	Mech	One sample/Setting of each size	--	IS 7098- Part II	IS 7098- Part II	--do--		P	--	--	Sample is to be taken from both top & bottom end

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 5 of 12 VALID UP TO: 11-04-15		REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG		APPROVED BY  A.K. Garg Approved		5	
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks
					M	C/N				D*	M	C	N	
1	2	3	4	5	6		7	8	9	10				11

2.04	Copper Taping	1. Thickness	CR	Mech	One sample/Settling of each size	--	NTPC ADS	NTPCADS	QCR		P	--	--	
		2. No. of tape	CR	Meas	--do--	--	--do--	--do--	--do--		P	--	--	
		3. Tape application overlap	CR	Meas	--do--	--	--do--	--do--	--do--		P	--	--	
		4. Core identification tape	CR	Visual	--do--	--	--do--	--do--	--do--		P	--	--	
2.05	Laying up	1. Core sequence	MA	Visual	--do--	--	IS 7098- Part II	IS 7098- Part II	--do--		P	--	--	
		2. Direction of lay	MA	Visual	--do--	--	--do--	--do--	--do--		P	--	--	
		3. Lay Length	MA	Meas	--do--	--	Manuf. Std.	Manuf. Std	--do--		P	--	--	
		4. Dia over laid up core	MA	Meas	--do--	--	NTPC ADS	NTPC ADS	--do--		P	--	--	
2.06	Inner Sheath	1.Colour	MA	Visual	--do--	-	--do--	--do--	--do--		P	--	--	
		2.Thickness	MA	Meas	One sample/Settling of each size	-	NTPC ADS	NTPC ADS	--do--		P	--	--	
		3.Dia over inner sheath	MI	Meas	--do--	-	--do--	--do--	--do--		P	--	--	
		4.Coverage & Quality of armouring	MA	Meas.	100%	--	IS 7098- Part II	IS 7098- Part II	QCR		P	--	--	
2.07	Armouring (As Applicable)	1.Dimension	MA	Meas	--do--	-	--do--	--do--	--do--		P	--	--	
		2.No. of wires / strip	MA	Meas.	--do--	-	--do--	--do--	--do--		P	--	--	
		3. Direction of lay	MA	Visual	--do--	--	IS 7098- Part II	IS 7098- Part II	QCR		P	--	--	
		5 Dia over armouring	MA	Meas.	One sample/Settling of each size	--	NTPC ADS	--do--	--do--		P	--	--	
2.08	Outer Sheath	1. Surface finish	MA	Visual	100%	--	Pimple, Fish Eye, Burnt particles, Blow Hole not permitted. Repairing on outer sheath not permitted. (As per NTPC specification) PVC FRLS compound shall be preferably loaded in to	--do--	--do--		P	--	--	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.
 -M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

Page 5 of 12
 FORMAT NO:QS-01-QAI-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 6 of 12 VALID UP TO: 11-04-15		REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG		 APPROVED BY अनुमोदित A. K. Garg Dt..... Agency				6
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks	
					M	C/ N				D*	M	C	N		
1	2	3	4	5	6		7	8	9	10				11	

		2.Colour of sheath	MA	Visual	One sample/Settin g of each size	--	extruder by suction method. NTPC ADS	NTPC ADS	QCR		P	--	--	
		3. Dia over outer sheath	MA	Meas	--do--	--	NTPC ADS	NTPC ADS	--do--		P	--	--	
		4.Thickness of outer sheath	CR	Meas	--do--	-	--do--	--do--	--do--		P	--	--	
		5. Embossing quality	MA	Visual	100%	-	Following shall be embossed or printed on outer sheath at every 5 meter length of cable: (1).Batch number or Drum number (2) IS 7098-II (3) Cable size (4) Voltage grade (5) word "FRLS" (marking shall be legible & indelible).	--do--	--do--		P	--	--	
		6. Sequential marking	MA	Visual	Full length	--	Sequential marking of length of cable in meters at every one meter is to be embossed or printed. Embossing or printing shall be progressive, automatic, in line & marking shall be legible & indelible	--do--	--do--		P	--	--	
C	Finished Cables													
3.01	Type Test clearance from NTPC Engineering to be verified at the time of final inspection.													
3.02	Routine Tests	1.High Voltage test at room temperature	CR	Elect	100%	100%	NTPC ADS / IS 7098- Part II	NTPC ADS	Test certificate	✓	P	W	W	Refer note 2
		2.Conductor Resistance	CR	Elect	100%	100%	NTPC ADS / IS 7098- Part II	NTPC ADS	--do--	✓	P	W	W	Refer note 2
		3. Partial Discharge Test	CR	Elect.	100%	100%	NTPC ADS / IS 7098- Part II	NTPC ADS	-do--	✓	P	W	W	For Screened cable only/ Refer note 2
3.03	Acceptance Tests													
3.03 (i)	Construction of finished Cable	1. OD of Cable	MA	Meas.	Each type & size of cables as per sampling plan of IS 7098- Part II		NTPC ADS	NTPC ADS	--do--	✓	P	W	W	
		2. Laying of core	CR	Visual	--do--		NTPC ADS / IS 7098- Part II	NTPC ADS / IS 7098- Part II	--do--	✓	P	W	W	
		3. Core Identification	CR	Visual	--do--		--do--	--do--	--do--	✓	P	W	W	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S-042 REV-00 DATE : 12-04-12 Page 7 of 12 VALID UP TO: 11-04-15		REVIEWED BY Inderjit Singh Vikram Talwar Rajeev Garg						7
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks	
					M	C/N				D*	M	C	N		
1	2	3	4	5	6		7	8	9	10				11	

		4. Colour of outer sheath	MA	Visual	Each type & size of cables as per sampling plan of IS 7098- Part II	NTPC ADS	NTPC ADS	QCR	✓	P	W	W	
		5. Inner sheath thickness	CR	Meas	--do--	--do--	--do--	--do--	✓	P	W	W	
		6. Inner sheath colour	MA	Visual	--do--	--do--	--do--	--do--	✓	P	W	W	
		7. Copper tape / Wire dimension with overlap (As applicable)	CR	Phy	--do--	NTPC ADS/ Min overlap 20%	NTPC ADS/ Min. overlap 20%	--do--	✓	P	W	W	
3.03 (ii)	Armour wires/ Formed wires.	1.Dimensions	CR	Meas	Each type & size of cables as per sampling plan of IS 7098- Part II	NTPC ADS/ IS7098-II	NTPC ADS	Test Certificate	✓	P	W	W	Test as applicable for Galvanized wires/ strips / Al wires
		2. No. of wires/ formed wire	CR	Mech	--do--	--do--	--do--	--do--	✓	P	W	W	
		3. Tensile test	CR	Mech	--do--	IS 3975	IS 3975	--do--	✓	P	W	W	
		4. Elongation test	CR	Mech	--do--	--do--	--do--	--do--	✓	P	W	W	
		5. Torsion test (for round wires only)	CR	Mech	--do--	--do--	--do--	--do--	✓	P	W	W	
		6. Wrapping test	CR	Mech	--do--	--do--	--do--	--do--	✓	P	W	W	
		7. Resistance test	CR	Mech	--do--	--do--	--do--	--do--	✓	P	W	W	
		8. Mass of Zinc coating	CR	Meas	--do--	--do--	--do--	--do--	✓	P	W	W	
		9. Uniformity of Zinc Coating	CR	Chem.	--do--	--do--	--do--	--do--	✓	P	W	W	
		10. Adhesion test	CR	Mech	--do--	--do--	--do--	--do--	✓	P	W	W	
		11. Freedom from defects	CR	Visual	--do--	--do--	--do--	--do--	✓	P	W	W	
3.03 (iii)	Conductor	1. Resistance Test	CR	Elect	--do--	--do--	--do--	--do--	✓	P	W	W	
		2. Tensile test	CR	Mech	Each type & size of cables as per sampling plan of IS 7098-Part-II	IS 8130	IS 8130	Test Certificate	✓	P	W	W	Test report of manufacturer to be reviewed as per Sl. No. 2.01 for Tensile test & wrapping test

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)	STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 8 of 12 VALID UP TO: 11-04-15		REVIEWED BY Inderjit Singh Vikram Talwar Rajeev Garg						8
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks
					M	C/ N				D*	M	C	N	
1	2	3	4	5	6		7	8	9	10				11

		3. Wrapping test	CR	Mech	--do--	--do--	--do--	--do--	✓	P	P	W	--do--
3.03 (iv)	XLPE Insulation & PVC Sheath	1. Thickness of insulation & sheath	CR	Meas.	--do--	NTPC ADS & IS 7098-Part II	NTPC ADS	--do--	✓	P	W	W	
		2. Tensile strength & elongation at break of insulation & outer sheath (before ageing)	CR	Mech	--do--	IS 7098-Part II	IS 7098-Part II		✓	P	W	W	Refer Note 3 Also
		3. Tensile strength & elongation at break of insulation & outer sheath (after Ageing)	CR	Mech	Refer Note 3	IS 7098-Part II	IS 7098-Part II	Test Certifi cate	✓	P	W	W	Refer Note 3
		4. Insulation resistance (Volume resistivity method)	CR	Elect	Each type & size of cables as per sampling plan of IS 7098-Part II	--do--	--do--	--do--	✓	P	W	W	
		5. Partial Discharge test	CR	Elect.	--do--	--do--	--do--	--do--	✓	P	W	W	For Screened cable only
		6. High voltage test at room temperature	CR	Elect	Each type & size of cables as per sampling plan of IS 7098-Part II	--do--	--do--	--do--	✓	P	W	W	
		7. Thermal stability on outer sheath	CR	Chem	One sample of each offered lot of all offered sizes	--do--	--do--	--do--	✓	P	W	W	


		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 9 of 12 VALID UP TO: 11-04-15		REVIEWED BY Inderjit Singh Vikram Talwar Rajeev Garg		APPROVED BY अनुमोदित A.K. Garg D..... 				9
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks	
					M	C/ N				D*	M	C	N		
1	2	3	4	5	6		7	8	9	10				11	

		8. Hot Set Test for inculation	CR	Mech	Each type & size of cables as per sampling plan of IS 7098-Part II		IS 7098-Part II	IS 7098-Part II	QCR	✓	P	W	W	For XLPE insulation only
		9. Smoke density test on outer sheath	CR	Chem	One sample of each offered lot of all offered sizes		NTPC ADS & ASTM D2843	NTPC ADS	--do--	✓	P	W	W	
		10. Acid gas generation test on outer sheath	CR	Chem	--do--		NTPC ADS & IEC 60754-1	NTPC ADS	--do--	✓	P	W	W	
		11. Oxygen Index	CR	Chem	--do--		NTPC ADS/ IS 10810 Part 58	--do--	--do--	✓	P	W	W	
		12. Flammability test on completed cable	CR	Chem	One sample irrespective of size per voltage grade		NTPC ADS & IEC 60332 Part-3 (Category-B)	--do--	--do--	✓	P	W	W	
		13. Surface finish & length measurement.	CR	Visual & Meas	One length of each size	One length of each size	A) Following shall be embossed or printed on outer sheath at every 5 meter length of cable: (1).Batch number or Drum number (2) IS 7098-II (3) Cable size (4) Voltage grade (5) word "FRLS" (marking shall be legible & indelible). B) Sequential marking of length of cable in meters at every one meter is to be embossed or printed. Embossing or printing shall be progressive, automatic, in line & marking shall be legible & indelible		Test Certificate	✓	P	W	W	Pimple, Fish Eye, Burnt particles, Blow Hole etc. not permitted. Repairing on outer sheath not permitted.
		14. Sequence of cores armour coverage, gap between two consecutive armour/ formed wire	CR	Visual & Meas	One length of each size	One length of each size	Min. area of coverage of armouring shall be 90%. The gap between armour wires / formed wires shall not exceed one armour wire/ formed wire space & there shall be no cross over/ over riding of armour wire / formed wire. Zn rich paint shall be applied on armour joint surface of G.S. Wire /formed wire		--do--	✓	P	W	W	
		15. Measurement of Eccentricity & Ovality	CR	Meas.	--do--	--do--	Eccentricity of core shall not exceed 10% and Ovality not to exceed 2%		--do--	✓	P	W	W	

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 10 of 12 VALID UP TO: 11-04-15		REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG		APPROVED BY अनुमोदित Apprvd Garg Dt..... 				10
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	Agency				Remarks	
					M	C/ N				D*	M	C	N		
1	2	3	4	5	6		7	8	9	10				11	

4	Packing	1. Sealing	MA	Visual	100%	100%	(1) IS 7098-Part II (2) The surface of the drum and the outer most cable layer shall be covered with water proof cover. (3) Both the ends of cables shall be properly sealed with heat shrinkable PVC/ rubber caps secured by "U" nails.	QCR	✓	P	--	--	
4.01	Identification	NTPC Sealing	MA	Visual	100%	100%	Sealing shall be visible	QCR	✓	P	V	V	

Notes:													
1)	If the compound manufacturer is carrying out Ageing test , test report of compound manufacturer is to be reviewed. If the compound manufacturer is not carrying out ageing test, then cable manufacturer will carry out ageing test & the test report will be reviewed by NTPC (quantum of ageing test sample shall be one sample /batch)												
2)	(a) In case of manufacturers / supplier who have supplied cables in the past through Corporate Centre/ Regional Offices :- Routine Test of manufacturer internal test report are to be verified by NTPC at the time of final inspection. NTPC will also witness routine tests on cables on 10% sample basis on 1.9 KV/ 3.3 KV and 3.3KV/ 3.3 KV cables , other HT cables will be witnessed on 100% basis. 2(b) In case of manufacturers / supplier WHO HAVE NOT SUPPLIED cables in the past through Corporate Centre/ Regional Offices, :- Routine Test of manufacturer internal test report are to be verified by NTPC at the time of final inspection. NTPC will also witness routine tests on cables for the first order on 100% basis.												
3)	Refer table on page 11& 12 of 12 for Sampling & Acceptance criteria.												

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 11 of 12 VALID UP TO: 11-04-15		REVIEWED BY INDERJIT SINGH VIKRAM TALWAR RAJEEV GARG		APPROVED BY A.K. Garg Approved Dt..... Agency		11	
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	D*	M	C	N	Remarks
1	2	3	4	5	M	C/N	7	8	9	10	11			

LEGEND: NTPC ADS: NTPC approved data sheet, QCR: quality control records of cable manufacturer, CABLE MANUF STD- cable manufacturer's internal plant standard, MI: minor, MA: major, CR: critical, COC- certificate of conformance

Sampling & Acceptance Criteria				
Criteria	Manufacturer experience prerequisite	Condition	Testing procedure	Remarks
Samples as per relevant IS from every size/ type of cable in the offered lot shall be tested for Tensile Strength & Elongation (before ageing). The values will be compared with corresponding values mentioned in the Type Test report accepted by NTPC. These values of Tensile Strength & Elongation (before ageing) should be within +/- 15% tolerance (final values should be more than the minimum values indicated in relevant standard) of the Type Test report	In case of Manufacturers/ Supplier who have supplied cables in the past through Corporate Centre / Regional offices	In case of sizes/ type which meet the criteria	1 Sample per size/ type out of sizes which have met the criteria, will be put on accelerated ageing test (refer IRS specification no. IRS: S-63/2007 Rev 3.0). The samples shall be aged in air oven at temperature of 130°C+/- 2°C for 5 hours. 1 Sample of XLPE insulation per type of cables offered which have met the criteria, will be put on ageing test as per IS 7098 –II . After wards the samples shall be tested for Tensile Strength & Elongation. Acceptance norms shall be as per relevant IS. This test shall be witnessed by NTPC.	In case the samples do not meet the requirement in accelerated ageing test then 1 sample of that size/ type will be put on ageing test as per IS.
		In case of size /type which do not meet the criteria	Particular size/ type will be put on ageing test as per IS. This test shall be witnessed by NTPC.	----

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

		Item:- HT POWER FRLS CABLE (3.3 KV TO 33 KV)		STANDARD QUALITY PLAN (CONFORMING TO CODE:IS 7098 Part-II AND NTPC TECHNICAL SPECIFICATION)			QP. NO. 0000-999- QOE- S- 042 REV-00 DATE : 12-04-12 Page 12 of 12 VALID UP TO: 11-04-15		REVIEWED BY INDERJIT SINGH <i>[Signature]</i> VIKRAM TALWAR <i>[Signature]</i> RAJEEV GARG <i>[Signature]</i>		APPROVED BY A.K. Garg <i>[Signature]</i> 31/01/12 Approved * Quality Assurance * * Agency * * D * * C * * N * * P * * W * * V * * CH * * NTPC * * Noida *		12
Sl. No	Component & Operations	Characteristics	Class	Type of check	Quantum of check		Reference Document	Acceptance Norms	Record Format	D*	C	N	Remarks
1	2	3	4	5	6		7	8	9	10			11

	In case of Manufacturers/ Supplier WHO HAVE NOT SUPPLIED cables in the past through Corporate Centre / Regional offices	In case of size /type which meet the criteria	1 Sample per sizes/ type out of all sizes which have met the criteria, will be put on aging test and witnessed by NTPC as per relevant IS	----
		In case of size/ type which do not meet the criteria	Particular size / type will be put on ageing test as per IS. This test shall be witnessed by NTPC	----

LEGEND:- *RECORDS, IDENTIFIED WITH "TICK" UNDER COLUMN "D" SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION.

-M:MANUFACTURER/SUPPLIER, C:MAIN SUPPLIER, N:NTPC, P:PERFORM W:WITNESS,V:VERIFICATION AS APPROPRIATE, CHP: NTPC SHALL IDENTIFY IN COLUMN "N" AS "W"

FORMAT NO:QS-01-QA1-P-10/F3-R1

	ANNEXURE-A TO QAP	CUSTOMER: NTPC LIMITED	PROJECT TITLE: 2X500MW MAUDA FGD PROJECT	SPECIFICATION NUMBER: PE-TS-444-507-E001
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : 0000-999-QOE-S-042, R0	SPECIFICATION TITLE: TECH. SPEC. FOR HT XLPE POWER CABLES
		SYSTEM	ITEM: HT XLPE POWER CABLES	DOC. NO.

TYPE/ ACCEPTANCE/ ROUTINE TEST REQUIREMENTS

A. Type Test Conduction:

- Following tests as per table below shall be conducted as Type Test.
- Sampling:
 - Type test to be conducted on one size of each voltage grade per lot.
 - FRLS test & Electrical tests to be conducted on every size & voltage grade of cables.
 - Flammability Test to be conducted only on one sample/ lot/voltage grade.

B. Acceptance Test Conduction:

- Refer QP & Annexure-B to QP.

C. Routine Test Conduction:

- Refer QP & Annexure-B to QP.

S. No.	TEST	APPLICABLE FOR	REFERENCE STANDARD	REMARKS
1.0	Tests for Conductor			
I.	Resistance test	For Al	IS 10810 Pt 5	
2.0	Tests for Armour Wires/ Strips			
i.	Measurement of dimensions	Applicable for Aluminium wire & GS wire/ strip	IS 10810 PT 36	
ii.	Tensile test	Applicable for Aluminium wire & GS wire/ strip	IS 10810 PT 37	
iii.	Elongation at break test	Applicable for GS wire/ strip only	IS 10810 PT 37	
iv.	Torsion test	For GS round wire only	IS 10810 PT 38	
v.	Winding test	For GS strip only	IS 10810 PT 39	
vi.	Resistance test	Applicable for Aluminium wire & GS wire	IS 10810 PT 42	
vii.	Uniformity of Zinc coating test	For GS wires/strip only	IS 10810 PT 40	
viii.	Mass of Zinc coating test	For GS wires/strip only	IS 10810 PT 41	
ix.	Adhesion test	For GS wires/strip only	IS 3975	
x.	Wrapping Test	For aluminium wires only	IS 10810 PT 3	
2.0	Physical Tests for XLPE Insulation & PVC sheath			
I.	Test for thickness & Eccentricity	Applicable for XLPE insulation, PVC inner sheath & PVC outer sheath	IS 10810 Pt 6	
II.	Tensile strength and elongation test at break	Applicable for XLPE insulation & PVC outer sheath		
(a)	Before ageing		IS 10810 Pt 7	

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL

	ANNEXURE-A TO QAP	CUSTOMER: NTPC LIMITED	PROJECT TITLE: 2X500MW MAUDA FGD PROJECT	SPECIFICATION NUMBER: PE-TS-444-507-E001
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : 0000-999-QOE-S-042, R0	SPECIFICATION TITLE: TECH. SPEC. FOR HT XLPE POWER CABLES
		SYSTEM	ITEM: HT XLPE POWER CABLES	DOC. NO.

S. No.	TEST	APPLICABLE FOR	REFERENCE STANDARD	REMARKS
(b)	After ageing		IS 10810 Pt 7	
III.	Ageing in air oven	Applicable for XLPE insulation & PVC outer sheath	IS 10810 Pt 11	
IV.	Loss of mass in air oven test	For PVC outer sheath only	IS 10810 Pt 10	
V.	Hot deformation test	For PVC outer sheath only	IS 10810 Pt 15	
VI.	Heat shock test	For PVC outer sheath only	IS 10810 Pt 14	
VII.	Shrinkage test	For XLPE insulation & PVC outer sheath only	IS 10810 Pt 12	
VIII.	Thermal stability test	For PVC outer sheath only	IS 10810 Pt 60	
IX.	Hot set test	For XLPE insulation only	IS 10810 Pt 30	
X.	Water absorption (gravimetric) test	For XLPE insulation only	IS 10810 Pt 33	
XI.	Degree of cross-linking	For XLPE insulation only	IS 7098-II	
3.0	<u>Improved Fire performance (FR-LSH) Tests</u>			
I.	Oxygen index test	For outer sheath only	IS 10810 Pt 58 / ASTM D 2863	
II.	Smoke density test	For outer sheath only	ASTM D 2843	
III.	Acid gas generation test	For outer sheath only	IS 10810 Pt 59 / IEC-754-1	
IV.	Temperature Index Test	For outer sheath only	IS 10810 Pt 64 / ASTM D 2863	
4.0	<u>Flammability Tests</u>			
I.	Flammability test for bunched cables	For complete cable	IS 10810 Pt 62/ IEC-60332 (Part-3) Cat-B	
II.	Flammability test for single cable	For complete cable	IS: 10810 Pt 61 / IEC:60332 Part-1	
5.0	<u>Electrical Tests</u>			
I.	High Voltage Test	For complete cable	IS 10810 Pt 45	
II.	Insulation Resistance Test (Volume resistivity method)	For complete cable	IS 10810 Pt 43	
III.	Partial discharge test (shall be carried out on full drum length)		IS 10810 Pt 46	
IV.	Bending Test followed by Partial Discharge test		IS 10810 Pt 50	
V.	Dielectric Power Factor Test (i) As a function of voltage (ii) As a function of temperature		IS 10810 Pt 48	
VI.	Heat Cycle Test		IS 10810 Pt 49	
VII.	Impulse Withstand Test		IS 10810 Pt 47	

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL

	ANNEXURE-A TO QAP	CUSTOMER: NTPC LIMITED	PROJECT TITLE: 2X500MW MAUDA FGD PROJECT	SPECIFICATION NUMBER: PE-TS-444-507-E001
		BIDDER/VENDOR:	QUALITY PLAN NUMBER : 0000-999-QOE-S-042, R0	SPECIFICATION TITLE: TECH. SPEC. FOR HT XLPE POWER CABLES
		SYSTEM	ITEM: HT XLPE POWER CABLES	DOC. NO.

S. No.	TEST	APPLICABLE FOR	REFERENCE STANDARD	REMARKS
VIII.	Thermal ageing test	For complete cable	IS 7098-II	
IX.	Flammability Test	For PVC sheathed cable	IS 10810 Pt 53	

BHEL	PARTICULARS	BIDDER/ VENDOR	
	NAME		
	SIGNATURE		
	DATE		BIDDER'S / VENDORS COMPANY SEAL

ANNEXURE-B TO QAP

CLAUSE NO.

QUALITY ASSURANCE

MV (3.3 kV / 6.6. kV / 11 kV / 33 kV) Cables

Item / Components / Sub System Assembly	Attributes / Characteristics	Make, Type & T.C as per relevant standard	Dimension/surface finish	Mechanical properties	Chemical Composition	Spark Test(as applicable)	Electrical properties	Hot Set Test/ Eccentricity & Ovality	Lay length & Sequence	Armour coverage, cross over, looseness, gap between two wires	Batch Sequential marking/ surface finish/ cable length	T.S & elongation before & after ageing on outer sheath & insulation	Thermal stability on outer sheath	Metallic (Cu) Screening (If applicable)	Anti termite coating on wooden drums	Constructional requirements feature as per NTPC specification	Routine & Acceptance Test as per relevant standard & NTPC specification	FRLS Test
Aluminum (IS-8130)		Y	Y	Y	Y		Y											
Semiconducting Compound		Y		Y			Y											
XLPE Compound (IS-7098 Part-II)		Y		Y			Y					Y						
FRLS PVC Compound (IS-5831, ASTM-D2843, IS10810(Part 58) ,IEC-60754 Part-1)		Y		Y								Y	Y					Y
Triple Extrusion & curing /Manufacturing of Core			Y			Y		Y										
Copper Tape		Y	Y	Y			Y											
Polyster tape		Y	Y															
Core Laying									Y									
Armour wire/strip		Y	Y	Y														
Copper tapping		Y	Y											Y				
Inner sheath		Y	Y															
Armouring			Y							Y								
Outer Sheathing			Y								Y							
Power Cable (Finished)									Y	Y	Y	Y	Y			Y	Y	Y
Wooden drum(IS-10418) /Steel Drum			Y												Y	Y		

Notes:
 1. This is an indicative list of tests / checks. The manufacturer is to furnish a detailed Quality Plan indicating the practice and procedure along with relevant supporting documents.
 2. Make of all major Bought out items will be subject to NTPC approval.

LOT-IB PROJECTS
 FLUE GAS DESULPHURISATION SYSTEM PACKAGE

TECHNICAL SPECIFICATION
 SECTION – VI, PART-B
 BID DOC. NO CS-0011-109(1B)-9

SUB-SECTION-V-QE6
 HT CABLE

PAGE 1 OF 4

CLAUSE NO.

QUALITY ASSURANCE



ROUTINE TESTS	Following routine tests shall be carried out on each drum of finished cables for all types & sizes.	
1)	Conductor Resistance test	
2)	High voltage test	
3)	Partial discharge test (for Screened cables only)	
ACCEPTANCE TESTS	Following Acceptance tests shall be carried out on each size of each type (voltage rating) of cables, in the offered lot.	
A) For Conductor (as per sampling plan mentioned in IS: 7098 Part II)		
	1)	Annealing test (Copper)
	2)	Tensile Test (Aluminum)
	3)	Wrapping Test (Aluminum)
	4)	Resistance test
B) For copper tape / Wires (as per sampling plan mentioned in IS: 7098 Part II)		
	1)	Measurement of Dimensions
	2)	Conductivity check
B) For Armour Wires / Formed Wires (If applicable) (as per sampling plan mentioned in IS: 7098 Part II)		
	1.	Measurement of Dimensions
	2.	Tensile Tests
	3.	Elongation Test
	4.	Torsion Test For Round wires only
	5.	Wrapping Test
	6.	Resistance Test
	7.	Mass of Zinc coating test For G S wires / Formed wires only
	8.	Uniformity of Zinc coating For G S wires / Formed wires only
	9.	Adhesion test For G S wires / Formed wires only
	10.	Freedom from surface defects

CLAUSE NO.

QUALITY ASSURANCE

**C) For XLPE insulation & PVC Sheath (as per sampling plan mentioned in IS: 7098 Part II)**

	1)	Test for thickness
	2)	Tensile strength & Elongation before ageing (for tests after ageing see "D")
	3)	Hot set test (For XLPE insulation)

D) Ageing test:

	Criteria	Condition	Test Requirements	Remarks
PVC outer sheath :	Samples as per relevant IS, from each size of each type (voltage rating) of cables in the offered lot, shall be tested for tensile strength & elongation (before ageing). Tensile & elongation testing shall preferably be done with a computerized machine. The values will be compared with corresponding values mentioned in the Type Test report accepted by NTPC. These values of Tensile Strength & Elongation (before ageing) should be within +/- 15% of the corresponding values of Type Test report. (Please note that test values should be more than the minimum values indicated in relevant standard).	All sizes which meet the criteria	For PVC: The size which has maximum negative deviation from type test report values will be put on accelerated ageing test. The samples shall be aged in air oven at temperature of 130°C +/- 2°C for 5 hours and tested for TS & elongation. Acceptance norms shall be as per IS.	In case the size does not meet the requirement in accelerated ageing test then all sizes (which had met the criteria) will be put on ageing test as per IS.
		Sizes which do not meet the criteria	Every size will be put on ageing test as per IS.	---
XLPE Insulation	Samples as per relevant IS, from each size of each type (voltage rating) of cables in the offered lot, will be put on ageing test as per IS.			

E) Following tests will be carried out on completed cables as per IS on each size of each type

	1)	Insulation resistance test (Volume resistivity method)
	2)	High voltage test
	3)	Partial discharge test (for Screened cables only)

CLAUSE NO.

QUALITY ASSURANCE



F) Following tests shall be carried out on only one size of offered lot (comprising of all sizes & types)

	1)	Thermal stability test on outer sheath
	2)	Oxygen index test on outer sheath
	3)	Smoke density rating test on outer sheath
	4)	Acid gas generation test on outer sheath
	5)	Flammability test as per IEC 60332 - Part- 3 (Category- B) on completed cable


G) Following tests shall be carried on one length of each size of each type of offered lot:

	1)	Constructional / dimensional check, surface finish, length measurement, sequence of cores, armour coverage, Gap between two consecutive armour wires / formed wires, Sequential marking, marking of drum no. / Batch number of outer sheath extrusion
	2)	Measurement of Eccentricity & Ovality

STEEL DRUM DRAWING (TYPICAL)

ANNEXURE-C TO SECTION-II

- Dwg. not to scale.
- ALL DIMENSIONS ARE IN MM.

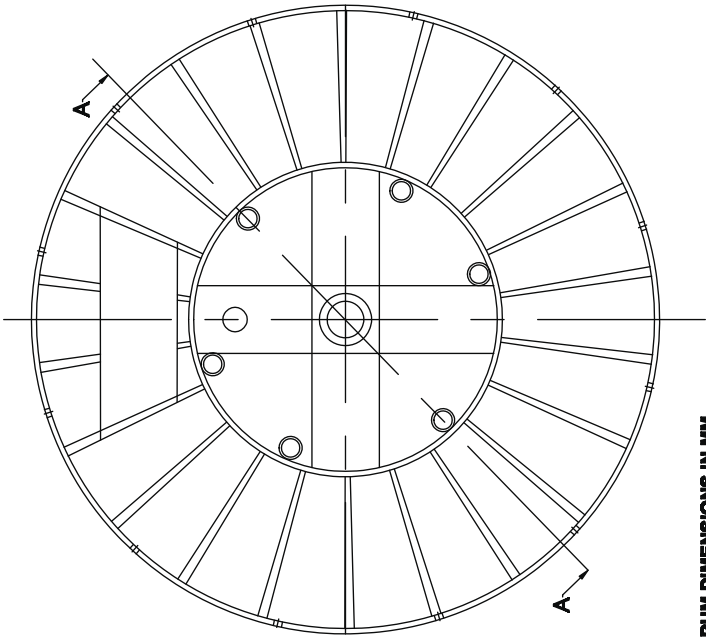

APPROXIMATE DRUM DIMENSIONS IN MM
ALL DIMENSIONS AND VALUES ARE
TYPICAL AND ARE DEPENDENT ON
CABLE WEIGHT.

A	FLANGE	2200
B	BARREL	1200
C	CENTRAL HOLE	100
D	FLANGE	50
E	TRAVERSE	1400
F	GROSS WIDTH	1600
G	STUD SIZE	16 MM.

