

**TECHNICAL SPECIFICATION
FOR
RATE CONTRACT
OF
PLATE HEAT EXCHANGERS**

Specification No. : PE-RC-999-179-N003 (REV 0)



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA-201301**



TITLE :
**TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS**

SPECIFICATION NO. PE-RC-999-179-N003

SECTION

REV. NO. 0

DATE 22/2/2020

INDEX

This Technical Specification consists of three Sections:

SECTION TITLE

SECTION I SPECIFIC TECHNICAL REQUIREMENTS

IA SPECIFIC TECHNICAL REQUIREMENTS.

IB DATA SHEET – A.

SECTION II STANDARD TECHNICAL REQUIREMENTS

IIA STANDARD TECHNICAL SPECIFICATION.

IIB STANDARD QUALITY PLAN.

SECTION III DOCUMENTS TO BE SUBMITTED BY BIDDER

IIIA COMPLIANCE CERTIFICATE (TO BE SUBMITTED BY BIDDER DURING TENDER STAGE).

IIIB GUARANTEE SCHEDULE (TO BE SUBMITTED BY BIDDER DURING TENDER STAGE).

IIIC DATASHEET –B & BALANCE DOCUMENTS AS PER CL. NO. 8 OF SECTION- IA (TO BE SUBMITTED BY SUCCESSFUL BIDDER AFTER AWARD OF CONTRACT).

Notes:

- 1) For detailed list of documents to be submitted by bidder in their technical offer, please refer cl. no. 10.00.00 of Section-IIA.
- 2) For detailed list of documents to be submitted by vendor after award of contract, please refer Datasheet-C of Section-IIA.
- 3) In case there is conflict in different clauses of specification, most stringent clause (as decided by BHEL / end customer) shall be followed, if no specific deviation is taken by bidder and accepted by BHEL during tender stage in that regard.



TITLE :
**TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS**

SPECIFICATION NO. PE-RC-999-179-N003

SECTION I

REV. NO. 0

DATE 22/2/2020

SECTION I

IA SPECIFIC TECHNICAL REQUIREMENTS

IB DATASHEET – A



TITLE :
TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N003

SECTION IA

REV. NO. 0 DATE 22/2/2020

SHEET 1 OF 2

1.0 GENERAL :

- 1.1 This specification is intended for finalization of rate contract between BHEL PEM and Bidder. Standard technical detail as indicated in the specification shall be agreed upon between BHEL PEM and Bidder. Project specific technical detail shall be made available to the bidder during the specific project ordering.
- 1.2 This enquiry covers the design, manufacture, assembly, inspection and testing at manufacturer's and/ or his sub-contractors works, painting, proper packing & delivery of the item namely PLATE HEAT EXCHANGERS complete with all spares (as applicable), accessories, commissioning spares (if any), counter flanges with nuts, bolts, gaskets and coatings (wherever necessary), including special tools & tackles (if any), including site PG test (as applicable) as mentioned in this specification.

Note:

1. This specification is being made with the intent of entering into rate contract for the supply of Plate Heat Exchangers (PHEs) of various type applicable for the various projects from time to time.
2. Type of PHEs have been detailed in Data Sheet-A, Section-1B. The bidder shall include complete supplies in his scope. Part supplies offered shall disqualify the bidder's offer. Evaluation shall be combined and further details shall be indicated in NIT.

The Plate heat Exchangers complete with all accessories including special tools and tackles (if any) shall conform to the Data Sheet-A (Section IB) and other requirements of section IIA. In addition, the requirements of this Section IA including Customer Specification attached at Appendix 1 (as applicable) shall also be complied with.

- 1.3 The bids shall be evaluated as per NIT. Ordering shall be done as per NIT.
- 1.4 Bidder to quote for items as per price schedule attached in NIT. The quantity as mentioned in the BOQ is only for evaluation purpose. However actual ordered quantity may vary from project to project throughout the year.

2.0 SPECIFIC REQUIREMENTS:

- 2.1 Project specific requirements for Flow &/ or Temp rise for PHE at primary side as well secondary side may vary slightly vis-à-vis those indicated in Datasheet A at section IB. However Flow variation shall be within +/- 20 % for primary side as well secondary side &/or Temp rise variation shall be within +/- 20 % for primary side as well as secondary side but Heat Load of PHE (Flow x Temp Rise) variation shall be within 0 to +10 % vis-à-vis Flow x Temp Rise as per Datasheet A at section IB. Exact Parameters for specific project shall be informed during project specific order Bidder to meet the above requirement during project specific ordering, without any cost implication to BHEL.
- 2.2 Design heat load of plate type heat exchangers and Inlet & Outlet temperatures of the Plate



TITLE :
TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N003

SECTION IA

REV. NO. 0 **DATE 22/2/2020**

SHEET 2 OF 2

type heat exchangers on the primary and secondary side to be demonstrated at site. Pressure drop across the Plate type heat exchanger on the primary & secondary water circuit to be demonstrated at site.

PG test at site (if applicable) as per Project specific requirement shall have to be conducted as per clause 8.02.00 of Section-IIA. Bidder to quote Unit Rate for PG test accordingly.

3.0 The drawing / document submission schedule and delivery shall be as per NIT.

4.0 The Heat transfer plate area measurement procedure and packing procedure indicated at Section-IIA are only for reference. Project specific procedures shall be submitted by the bidder during detailed engineering for approval.

5.0 Following to be complied by the bidder:

- a. Supplier to submit detailed 'Bill of Material' (BoM) at the time of drawing/document submission after placement of PO. Each item of the BoM to be uniquely identified with item code no. or item serial no.
- b. Supplier to ensure that all items which will find separate mention in the packing list are covered in this detailed BoM.
- c. Supplier to give following undertaking in the BoM"
"The BoM provided herewith completes the scope (in content and intent) of material supply under PO no.-----, dated -----.
Any additional material which may become necessary for the intended application of the supplied items(s)/package will be supplied free of cost in most reasonable time."



TITLE :
**TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS**

SPECIFICATION NO. PE-RC-999-179-N003

SECTION IA- Appendix 1

REV. NO. 0

DATE 22/02/2020

Appendix 1

CUSTOMER SPECIFICATION

CLAUSE NO.		QUALITY ASSURANCE												एनटीपीसी NTPC	
EQUIPMENT COOLING WATER SYSTEM															
TEST / CHECKS		Material Test	WPS/PQR/Welder Qualification	DPT/MPI	Assembly Fit Up	Visual & Dimensional Check	UT	RT	Hydraulic / Water Fill	Balancing	Type Test	Performance Test	Other Test		
ITEM / COMPONENTS															
A	PLATE TYPE HEAT EXCHANGER		Y	Y ³	Y	Y			Y						
A.1	Heat Transfer Plates	Y ¹		Y ²		Y							Y ⁷		
A.2	Gaskets	Y				Y									
A.3	Cover Plates (Front & Rear)	Y ¹				Y	Y ⁵								
A.4	Tie Rods	Y ¹		Y ⁴			Y ⁶								
B	HORIZONTAL CENTRIFUGAL PUMP				Y	Y						Y ¹⁰			
B.1	Casing	Y¹		Y⁴		Y			Y⁸						
B.2	Impeller	Y¹		Y⁴		Y				Y⁹					
B.3	Shaft	Y¹		Y		Y	Y⁶			Y⁹					
NOTES															
1 One per heat / HT batch															
2 DP Test shall be conducted for 10% of the lot of HT plates. However, in case of any defect, entire lot shall be tested and only defect free plates shall be accepted.															
3 100% DP Test shall be conducted on butt welds and 10% DPT on fillet weld after final run.															
4 100% DPT shall be carried out on machined surfaces.															
5 UT shall be done on plates with thickness 25 mm or above.															
6 UT shall be done on shaft / tie rod with diameter above 40 mm.															
7 After pressing each HT plate shall be subjected to either of the following tests, as per Manufacturer Practice a) Light Box Test b) Vacuum Test c) Air Chamber Test															
8 All pressure retaining parts shall be hydrostatically tested at 200% of pump rated head or 150% of shut – off head, whichever is higher, for at least 30 minutes. No leakage is allowed.															
9 Static and Dynamic Balancing shall be carried out on complete rotor assembly.															
10 All pumps shall be tested at rated speed, for head, flow capacity, efficiency and power consumption for the entire operating range i.e. from shut off head to maximum flow. A minimum of 7 readings shall be taken to plot the curve, with one reading at design flow. Testing standard shall be HIS (Hydraulic Institute Standard) of USA.															
Performance test shall be carried out with contract motor, wherever Liquidated Damages are to be ascertained based on performance test at shop.															
11 For Pipes, Valves and RE Joints refer LP Piping System requirements.															
														Page 1 of 1	

		TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER		Technical specification no	PE-RC-999-179-N003 (Rev 0)	
DATASHEET - A		Section		IB		
FOR RATE CONTRACT		Rev		0		
		Date		25-02-2020		
PHE DESCRIPTION		PHE TYPE-1		PHE TYPE-2	PHE TYPE-3	
1.0	General					
1.1	Number of Plate Heat Exchanger	Nos	Four (4) nos	Seven (7) nos	Five (5) nos	
1.2	Arrangement		As per System Requirement	As per System Requirement	As per System Requirement	
1.3	Location		Outdoor	Outdoor	Outdoor	
1.4	Primary side (Hot) Fluid		Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)	
1.5	Secondary side (Cold) fluid		CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)	
1.6	Connecting Pipe size	(Primary Side) (Secondary Side)	NB NB	125 150	100 125	80 100
1.7	Maximum permitted Length of the PHE	mm	2000 mm (excluding reducer)	2000 mm (excluding reducer)	2000 mm (excluding reducer)	
2.0	Design					
2.1	Design Code		Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards	
2.2	Design Pressure	Kg/cm ² (g)	10	10	12	
2.3	Operating Pressure	(Primary Side) (Secondary Side)	Kg/cm ² (g) Kg/cm ² (g)	6.5 to 8.5 Kg/sq. cm(g) 3.5 to 5.5 Kg/sq. cm(g)	6.5 to 8.5 Kg/sq. cm(g) 3.5 to 5.5 Kg/sq. cm(g)	7.0 to 9.0 Kg/sq. cm(g) 5.0 to 7.0 Kg/sq. cm(g)
2.4	Mechanical Design Temp.	°C	60	60	60	
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate	Kcal/Hr./m ²	6500 (Max.)	6500 (Max.)	6500 (Max.)	
2.6	Specific Heat of Fluid	(Primary Side) (Secondary Side)	Cal/gmDeg.C Cal/gmDeg.C	1 1	1 1	1 1
2.7	Density of Fluid	(Primary Side) (Secondary Side)	gm/cc gm/cc	1 1	1 1	1 1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:					
3.1	Flow rate	(DMCW Side) (ACW Side)	M ³ /hr M ³ /hr	113 159	48 88	36 63
3.2	Inlet temperature	(DMCW Side) (ACW Side)	°C °C	43.6 36	43.6 36	48 36
3.3	Outlet temp	(DMCW Side) (ACW Side)	°C °C	38 40	38 39.1	38 41.7
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side) (ACW Side)	MWC MWC	5 5	5 5	5 5
* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.						
4.0	Additional HT plates on Design Plates	%	NIL	NIL	NIL	
5.0	Heat Transfer Coefficient/Margin					
5.1	Overall fouling resistance (minimum)	Hr m2deg C/Kcal	0.00008	0.00008	0.00008	
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	1.6	1.6	
6.0	Material of Construction :					
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	SS-316	SS-316	
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness	
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding	
6.5	Support Beam/ column		Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated	
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	

	TECHNICAL SPECIFICATION FOR		Technical specification no	PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER		Section	IB	
	DATASHEET - A		Rev	0	
	FOR RATE CONTRACT		Date	25-02-2020	
	PHE DESCRIPTION		PHE TYPE-1	PHE TYPE-2	PHE TYPE-3
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)
6.13	Wetted fasteners		SS-316	SS-316	SS-316
6.14	Painting				
	External Surface				
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.
	c.) Final Paint				
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25	25
8.0	Spares	Unit of Measurement			
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	80 LOTS	140 LOTS	100 LOTS
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	120 LOTS	210 LOTS	150 LOTS
8.3	Valves	NOS.	1 NO.	1 NO.	1 NO.
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	40 LOTS	70 LOTS	50 LOTS
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	40 LOTS	70 LOTS	50 LOTS
9.0	Hydrotesting at Shop				
9.1	Hydrotesting Pressure	Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	30	30	30
10.0	Performance curves and figures to be furnished during contact stage				
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.				
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)				
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)				
10.4	Primary side water outlet temperature vs. Primary side inlet temp.				
10.5	Film heat transfer coefficient curve				
10.6	Correction Curves.				
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.				
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)				
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.				
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.				
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.				
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.				
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.				
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.				
11.8	Painting as specified at Sl. No. 6.14 above shall be subject to customer/BHEL approval during detailed engineering.				

		TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER DATASHEET - A FOR RATE CONTRACT		Technical specification no Section Rev Date		PE-RC-999-179-N003 (Rev 0) IB 0 25-02-2020			

	TECHNICAL SPECIFICATION FOR			Technical specification no	PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER			Section	IB	
	DATASHEET - A			Rev	0	
	FOR RATE CONTRACT			Date	25-02-2020	
	PHE DESCRIPTION		PHE TYPE-4	PHE TYPE-5	PHE TYPE-6	
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	
6.13	Wetted fasteners		SS-316	SS-316	SS-316	
6.14	Painting					
	External Surface					
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	
	b.) Primer		For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	
	c.) Final Paint					
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25	25	
8.0	Spares	Unit of Measurement				
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	60 LOTS	160 LOTS	80 LOTS	
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	90 LOTS	240 LOTS	120 LOTS	
8.3	Valves	NOS.	1 NO.	1 NO.	1 NO.	
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	30 LOTS	80 LOTS	40 LOTS	
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	30 LOTS	80 LOTS	40 LOTS	
9.0	Hydrotesting at Shop					
9.1	Hydrotesting Pressure	Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure	1.5 times the design pressure	
9.2	Duration of Hydrotesting	Minutes	30	30	30	
10.0	Performance curves and figures to be furnished during contact stage					
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.					
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)					
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)					
10.4	Primary side water outlet temperature vs. Primary side inlet temp.					
10.5	Film heat transfer coefficient curve					
10.6	Correction Curves.					
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.					
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)					
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.					
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.					
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.					
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter passage between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.					
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.					
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.					
11.8	Painting as specified at Sl. No. 6.14 above shall be subject to customer/BHEL approval during detailed engineering.					

	TECHNICAL SPECIFICATION FOR		Technical specification no		PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER		Section		IB	
	DATASHEET - A		Rev		0	
	FOR RATE CONTRACT		Date		25-02-2020	
PHE DESCRIPTION			PHE TYPE-7		PHE TYPE-8	
1.0	General					
1.1	Number of Plate Heat Exchanger		Nos	Seven (7) nos	Five (5) nos	Three (3) nos
1.2	Arrangement			As per System Requirement	As per System Requirement	As per System Requirement
1.3	Location			Outdoor	Outdoor	Outdoor
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid			CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	100	80	100
		(Secondary Side)	NB	125	100	100
1.7	Maximum permitted Length of the PHE		mm	2000 mm (excluding reducer)	2000 mm (excluding reducer)	2000 mm (excluding reducer)
2.0	Design					
2.1	Design Code			Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards
2.2	Design Pressure		Kg/cm ² (g)	10	12	10
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.5 to 8.5 Kg/sq. cm(g)	7.0 to 9.0 Kg/sq. cm(g)	5.5 to 7.0 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	3.5 to 5.5 Kg/sq. cm(g)	5.0 to 7.0 Kg/sq. cm(g)	2.5 to 4.0 Kg/sq. cm(g)
2.4	Mechanical Design Temp.		°C	60	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	6500 (Max.)	6500 (Max.)	6500 (Max.)
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1	1	1
		(Secondary Side)	Cal/gmDeg.C	1	1	1
2.7	Density of Fluid	(Primary Side)	gm/cc	1	1	1
		(Secondary Side)	gm/cc	1	1	1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:					
3.1	Flow rate	(DMCW Side)	M ³ /hr	48	36	40
		(ACW Side)	M ³ /hr	88	63	62
3.2	Inlet temperature	(DMCW Side)	°C	48	43.6	43.6
		(ACW Side)	°C	36	36	36
3.3	Outlet temp	(DMCW Side)	°C	38	38	38
		(ACW Side)	°C	41.5	39.2	39.6
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	5	5	5
		(ACW Side)	MWC	5	5	5
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.					
4.0	Additional HT plates on Design Plates		%	NIL	NIL	NIL
5.0	Heat Transfer Coefficient/Margin					
5.1	Overall fouling resistance (minimun)		Hr m2deg C/Kcal	0.00008	0.00008	0.00008
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)		mm	1.6	1.6	1.6
6.0	Material of Construction :					
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3			SS-316	SS-316	SS-316
6.2	Plate Gasket			Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates			Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.4	Guide Rails/ bar			Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding
6.5	Support Beam/ column			Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)			Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges			Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated

	TECHNICAL SPECIFICATION FOR			Technical specification no	PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER			Section	IB	
	DATASHEET - A			Rev	0	
	FOR RATE CONTRACT			Date	25-02-2020	
	PHE DESCRIPTION		PHE TYPE-7	PHE TYPE-8	PHE TYPE-9	
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	
6.13	Wetted fasteners		SS-316	SS-316	SS-316	
6.14	Painting					
	External Surface					
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	
	b.) Primer		For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	
	c.) Final Paint					
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25	25	
8.0	Spares	Unit of Measurement				
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	140 LOTS	100 LOTS	60 LOTS	
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	210 LOTS	150 LOTS	90 LOTS	
8.3	Valves	NOS.	1 NO.	1 NO.	1 NO.	
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	70 LOTS	50 LOTS	30 LOTS	
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	70 LOTS	50 LOTS	30 LOTS	
9.0	Hydrotesting at Shop					
9.1	Hydrotesting Pressure	Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure	1.5 times the design pressure	
9.2	Duration of Hydrotesting	Minutes	30	30	30	
10.0	Performance curves and figures to be furnished during contact stage					
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.					
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)					
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)					
10.4	Primary side water outlet temperature vs. Primary side inlet temp.					
10.5	Film heat transfer coefficient curve					
10.6	Correction Curves.					
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.					
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)					
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.					
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.					
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.					
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter passage between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.					
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.					
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.					
11.8	Painting as specified at Sl. No. 6.14 above shall be subject to customer/BHEL approval during detailed engineering.					

	TECHNICAL SPECIFICATION FOR			Technical specification no	PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER			Section	IB	
	DATASHEET - A			Rev	0	
	FOR RATE CONTRACT			Date	25-02-2020	
	PHE DESCRIPTION			PHE TYPE-10	PHE TYPE-11	PHE TYPE-12
1.0	General					
1.1	Number of Plate Heat Exchanger	Nos		Three (3) nos	Three (3) nos	Three (3) nos
1.2	Arrangement			As per System Requirement	As per System Requirement	As per System Requirement
1.3	Location			Outdoor	Outdoor	Outdoor
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid			CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side) (Secondary Side)	NB NB	100 150	100 150	150 150
1.7	Maximum permitted Length of the PHE	mm		2000 mm (excluding reducer)	2000 mm (excluding reducer)	2000 mm (excluding reducer)
2.0	Design					
2.1	Design Code			Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards
2.2	Design Pressure		Kg/cm ² (g)	10	10	10
2.3	Operating Pressure	(Primary Side) (Secondary Side)	Kg/cm ² (g) Kg/cm ² (g)	6.5 to 8.5 Kg/sq. cm(g) 3.5 to 5.5 Kg/sq. cm(g)	6.5 to 8.5 Kg/sq. cm(g) 3.5 to 5.5 Kg/sq. cm(g)	6.5 to 8.5 Kg/sq. cm(g) 3.5 to 5.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.		°C	60	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	6500 (Max.)	6500 (Max.)	6500 (Max.)
2.6	Specific Heat of Fluid	(Primary Side) (Secondary Side)	Cal/gmDeg.C Cal/gmDeg.C	1 1	1 1	1 1
2.7	Density of Fluid	(Primary Side) (Secondary Side)	gm/cc gm/cc	1 1	1 1	1 1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:					
3.1	Flow rate	(DMCW Side) (ACW Side)	M ³ /hr M ³ /hr	55 70	55 70	65 80
3.2	Inlet temperature	(DMCW Side) (ACW Side)	°C °C	43.6 36	48 36	43.6 36
3.3	Outlet temp	(DMCW Side) (ACW Side)	°C °C	38 40.4	38 43.9	38 40.6
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side) (ACW Side)	MWC MWC	5 5	5 5	5 5
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.					
4.0	Additional HT plates on Design Plates		%	NIL	NIL	NIL
5.0	Heat Transfer Coefficient/Margin					
5.1	Overall fouling resistance (minimum)	Hr m2deg C/Kcal		0.00008	0.00008	0.00008
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm		1.6	1.6	1.6
6.0	Material of Construction :					
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3			SS-316	SS-316	SS-316
6.2	Plate Gasket			Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates			Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.4	Guide Rails/ bar			Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding
6.5	Support Beam/ column			Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)			Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges			Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated

	TECHNICAL SPECIFICATION FOR			Technical specification no	PE-RC-999-179-N003 (Rev 0)
	PLATE HEAT EXCHANGER			Section	IB
	DATASHEET - A			Rev	0
	FOR RATE CONTRACT			Date	25-02-2020
	PHE DESCRIPTION		PHE TYPE-10	PHE TYPE-11	PHE TYPE-12
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)
6.13	Wetted fasteners		SS-316	SS-316	SS-316
6.14	Painting				
	External Surface				
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.
	c.) Final Paint				
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25	25
8.0	Spares	Unit of Measurement			
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	60 LOTS	60 LOTS	60 LOTS
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	90 LOTS	90 LOTS	90 LOTS
8.3	Valves	NOS.	1 NO.	1 NO.	1 NO.
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	30 LOTS	30 LOTS	30 LOTS
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	30 LOTS	30 LOTS	30 LOTS
9.0	Hydrotesting at Shop				
9.1	Hydrotesting Pressure	Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	30	30	30
10.0	Performance curves and figures to be furnished during contact stage				
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.				
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)				
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)				
10.4	Primary side water outlet temperature vs. Primary side inlet temp.				
10.5	Film heat transfer coefficient curve				
10.6	Correction Curves.				
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.				
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)				
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.				
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.				
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.				
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter passage between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.				
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.				
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.				
11.8	Painting as specified at Sl. No. 6.14 above shall be subject to customer/BHEL approval during detailed engineering.				

	TECHNICAL SPECIFICATION FOR		Technical specification no		PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER		Section		IB	
	DATASHEET - A		Rev		0	
	FOR RATE CONTRACT		Date		25-02-2020	
PHE DESCRIPTION			PHE TYPE-13		PHE TYPE-14	
1.0	General					
1.1	Number of Plate Heat Exchanger		Nos	Three (3) nos	Eight (8) nos	Three (3) nos
1.2	Arrangement			As per System Requirement	As per System Requirement	As per System Requirement
1.3	Location			Outdoor	Outdoor	Outdoor
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid			CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	150	150	150
		(Secondary Side)	NB	150	150	200
1.7	Maximum permitted Length of the PHE		mm	2000 mm (excluding reducer)	2000 mm (excluding reducer)	2000 mm (excluding reducer)
2.0	Design					
2.1	Design Code			Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards
2.2	Design Pressure		Kg/cm ² (g)	10	10	10
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.5 to 8.5 Kg/sq. cm(g)	6.5 to 8.5 Kg/sq. cm(g)	6.5 to 8.5 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	3.5 to 5.5 Kg/sq. cm(g)	4.0 to 6.0 Kg/sq. cm(g)	3.5 to 5.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.		°C	60	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	6500 (Max.)	6500 (Max.)	6500 (Max.)
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1	1	1
		(Secondary Side)	Cal/gmDeg.C	1	1	1
2.7	Density of Fluid	(Primary Side)	gm/cc	1	1	1
		(Secondary Side)	gm/cc	1	1	1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:					
3.1	Flow rate	(DMCW Side)	M ³ /hr	65	80	95
		(ACW Side)	M ³ /hr	80	95	115
3.2	Inlet temperature	(DMCW Side)	°C	48	43.6	43.6
		(ACW Side)	°C	36	36	36
3.3	Outlet temp	(DMCW Side)	°C	38	38	38
		(ACW Side)	°C	44.1	40.7	40.6
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	5	5	5
		(ACW Side)	MWC	5	5	5
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.					
4.0	Additional HT plates on Design Plates		%	NIL	NIL	NIL
5.0	Heat Transfer Coefficient/Margin					
5.1	Overall fouling resistance (minimun)		Hr m2deg C/Kcal	0.00008	0.00008	0.00008
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)		mm	1.6	1.6	1.6
6.0	Material of Construction :					
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3			SS-316	SS-316	SS-316
6.2	Plate Gasket			Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates			Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.4	Guide Rails/ bar			Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding
6.5	Support Beam/ column			Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)			Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges			Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated

	TECHNICAL SPECIFICATION FOR			Technical specification no	PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER			Section	IB	
	DATASHEET - A			Rev	0	
	FOR RATE CONTRACT			Date	25-02-2020	
	PHE DESCRIPTION		PHE TYPE-13	PHE TYPE-14	PHE TYPE-15	
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	
6.13	Wetted fasteners		SS-316	SS-316	SS-316	
6.14	Painting					
	External Surface					
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	
	b.) Primer		For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	
	c.) Final Paint					
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25	25	
8.0	Spares	Unit of Measurement				
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	60 LOTS	160 LOTS	60 LOTS	
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	90 LOTS	240 LOTS	90 LOTS	
8.3	Valves	NOS.	1 NO.	1 NO.	1 NO.	
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	30 LOTS	80 LOTS	30 LOTS	
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	30 LOTS	80 LOTS	30 LOTS	
9.0	Hydrotesting at Shop					
9.1	Hydrotesting Pressure	Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure	1.5 times the design pressure	
9.2	Duration of Hydrotesting	Minutes	30	30	30	
10.0	Performance curves and figures to be furnished during contact stage					
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.					
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)					
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)					
10.4	Primary side water outlet temperature vs. Primary side inlet temp.					
10.5	Film heat transfer coefficient curve					
10.6	Correction Curves.					
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.					
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)					
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.					
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.					
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.					
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter passage between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.					
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.					
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.					
11.8	Painting as specified at Sl. No. 6.14 above shall be subject to customer/BHEL approval during detailed engineering.					

				
TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER		Technical specification no	PE-RC-999-179-N003 (Rev 0)	
DATASHEET - A		Section	IB	
FOR RATE CONTRACT		Rev	0	
		Date	25-02-2020	
PHE DESCRIPTION		PHE TYPE-16	PHE TYPE-17	
1.0	General			
1.1	Number of Plate Heat Exchanger	Nos	Three (3) nos	Three (3) nos
1.2	Arrangement		As per System Requirement	As per System Requirement
1.3	Location		Outdoor	Outdoor
1.4	Primary side (Hot) Fluid		Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid		CW Blowdown water (Refer enclosed water analysis)	CW Blowdown water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side) (Secondary Side)	NB NB	150 200
1.7	Maximum permitted Length of the PHE	mm	2000 mm (excluding reducer)	2000 mm (excluding reducer)
2.0	Design			
2.1	Design Code		Latest IS/BS/DIN/ASTM/ASME Standards	Latest IS/BS/DIN/ASTM/ASME Standards
2.2	Design Pressure	Kg/cm ² (g)	10	10
2.3	Operating Pressure	(Primary Side) (Secondary Side)	Kg/cm ² (g) Kg/cm ² (g)	6.5 to 8.5 Kg/sq. cm(g) 3.5 to 5.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.	°C	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate	Kcal/Hr./m ²	6500 (Max.)	6500 (Max.)
2.6	Specific Heat of Fluid	(Primary Side) (Secondary Side)	Cal/gmDeg.C Cal/gmDeg.C	1 1
2.7	Density of Fluid	(Primary Side) (Secondary Side)	gm/cc gm/cc	1 1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:			
3.1	Flow rate	(DMCW Side) (ACW Side)	M ³ /hr M ³ /hr	95 115
3.2	Inlet temperature	(DMCW Side) (ACW Side)	°C °C	48 36
3.3	Outlet temp	(DMCW Side) (ACW Side)	°C °C	38 44.3
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side) (ACW Side)	MWC MWC	5 5
* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.				
4.0	Additional HT plates on Design Plates	%	NIL	NIL
5.0	Heat Transfer Coefficient/Margin			
5.1	Overall fouling resistance (minimum)	Hr m2deg C/Kcal	0.00008	0.00008
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	SS-316
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, Gr.B, with SS Cladding	Carbon Steel, IS-2062, Gr.B, with SS Cladding
6.5	Support Beam/ column		Carbon Steel, IS-2062, Gr.B, Epoxy painted	Carbon Steel, IS-2062, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated

	TECHNICAL SPECIFICATION FOR		Technical specification no	PE-RC-999-179-N003 (Rev 0)	
	PLATE HEAT EXCHANGER		Section	IB	
	DATASHEET - A		Rev	0	
	FOR RATE CONTRACT		Date	25-02-2020	
	PHE DESCRIPTION		PHE TYPE-16	PHE TYPE-17	
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent	
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H	
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber	
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)	
6.13	Wetted fasteners		SS-316	SS-316	
6.14	Painting				
	External Surface				
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	
	b.) Primer		For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	For all the steel surfaces, a coat of chlorinated rubber based zinc phosphate primer of minimum thickness DFT of 50 microns followed up with undercoat of chlorinated rubber paint of minimum DFT of 50 microns shall be applied. Then, intermediate coat consisting of one coat of chlorinated rubber based paint pigmented with Titanium di-oxide with minimum DFT of 50 microns and topcoat consisting of two coats of chlorinated rubber paint of approved shade and color with glossy finish and DFT of 100 microns shall be provided. Total DFT of paint system shall not be less than 200 microns.	
	c.) Final Paint				
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25	
8.0	Spares	Unit of Measurement			
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	60 LOTS	60 LOTS	
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	90 LOTS	90 LOTS	
8.3	Valves	NOS.	1 NO.	1 NO.	
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	30 LOTS	30 LOTS	
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	30 LOTS	30 LOTS	
9.0	Hydrotesting at Shop				
9.1	Hydrotesting Pressure	Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure	
9.2	Duration of Hydrotesting	Minutes	30	30	
10.0	Performance curves and figures to be furnished during contact stage				
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.				
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)				
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)				
10.4	Primary side water outlet temperature vs. Primary side inlet temp.				
10.5	Film heat transfer coefficient curve				
10.6	Correction Curves.				
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.				
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)				
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.				
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.				
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.				
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.				
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.				
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.				
11.8	Painting as specified at Sl. No. 6.14 above shall be subject to customer/BHEL approval during detailed engineering.				

DM WATER ANALYSIS

Applicable for ALL Projects (PHE-Primary Side)

ANNEXURE - A-9

CLAUSE NO.	PROJECT INFORMATION		
	ANALYSIS OF DM WATER TO BE USED		
	AS		
	PRIMARY FLUID FOR PHEs OF ALL THE PROJECTS		
	S.No.	Characteristics	Value
	i)	Silica (Max.)	0.02 ppm as SiO ₂
	ii)	Iron as Fe	Nil
	iii)	Total hardness	Nil
	iv)	pH value	CORRECTED TO 8.5-9.5
	v)	Conductivity excluding the effects of free CO ₂	Not more than 0.1
APPLICABLE FOR ALL PROJECTS		TECHNICAL SPECIFICATIONS SECTION-VI PART-A	PROJECT SYNOPSIS
			PAGE 1 OF 1

CLARIFIED WATER ANALYSIS

Sl. No.	Constituent	as	mg/Litre
A) COOLING WATER ANALYSIS /CW BLOW DOWN WATER ANALYSIS			
1.	Calcium	CaCO ₃	316
2.	Magnesium	CaCO ₃	292
3.	Sodium	CaCO ₃	260
4.	Potassium	CaCO ₃	24
5.	Total Cations	CaCO ₃	892
6.	M-Alkalinity	CaCO ₃	120
7.	P-Alkalinity	CaCO ₃	0
8.	Nitrate CaCO ₃	CaCO ₃	8.8
9.	Chloride	CaCO ₃	252
10.	Sulphate	CaCO ₃	160
11.	Total Anions	CaCO ₃	892
12.	Silica	SiO ₂	60
13.	Iron	Fe	0.48
14.	pH Value	-	6.5-6.9
15.	Turbidity	NTU	6
16.	Total Dissolved solids	CaCO ₃	980
17.	Organic matter (Oxygen absorbed from Acid Permanganate In 4 Hrs.)	mg/l	0.1

Note : In some cases calcium may go up to 721 mg/litre.



TITLE :
**TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS**

SPECIFICATION NO. PE-RC-999-179-N003

SECTION II

REV. NO. 0

DATE 22/02/2020

SECTION II

**IIA STANDARD TECHNICAL SPECIFICATION
STANDARD QUALITY PLAN**



TITLE :
STANDARD TECHNICAL SPECIFICATION
FOR
PLATE HEAT EXCHANGER

SPECIFICATION NO. PE-TS-999-179-N001

VOLUME :

SECTION : IIA

REV. NO. 01

DATE : 2/5/2018

SHEET 1 OF 1

SECTION - IIA
PLATE HEAT EXCHANGER
STANDARD TECHNICAL SPECIFICATION
DATA SHEET C

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 1 OF 11	

1.00.00 GENERAL

This specification covers the Design, Performance requirements, Constructional Features, Materials requirements, manufacture, assembly, Inspection and Testing at Manufacturer's and/ or his sub-contractor's works and Painting requirements for delivery of Plate Heat Exchanger complete with all accessories as specified herein-after.

1.01.00 SYSTEM DESCRIPTION:

1.01.01 The Plate Heat Exchanger are intended to be used in closed circuit DM cooling water circuit for Cooling Hot passivated DM Water by Auxiliary Cooling Water (Clarified / Sea Water).

1.01.02 Passivated DM Water is circulated through various auxiliary coolers of TG/SG/Station Aux., in closed loop by means of pumps. This DM water picks up heat from different cooling equipment's. Heat from DM water is transferred to auxiliary cooling water (Secondary side) thru' the Plate Heat Exchangers covered under this specification.

1.01.03 The analysis of DM Water, Clarified /Sea Water (Auxiliary cooling water) to be handled by the Plate Heat Exchangers are attached as Annexure to Data Sheet-A.

1.01.04 A strainer of 2 mm size at ACW inlet lines of PHE is provided and backwashing of PHE's is not envisaged.

2.00.00 CODES AND STANDARDS :

2.01.00 The design manufacture and testing of the plate heat exchanger complete with all accessories, shall generally conform to the latest editions of the following appropriate standards.

2.01.01 IS/BS/DIN/US Standards regarding pressure vessels, pressure piping, pipes, valves, flanges and other as necessary.

2.01.02 IS/ BS/ DIN/ ASTM for material specification and testing procedures.

2.02.00 In case of any conflict between the above codes/ standards and this

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 2 OF 11	
		specification, the latter shall prevail and in case of any further conflict in the matter, the interpretation of the specification by the Engineer shall be final and binding.	
3.00.00	SCOPE OF SUPPLY:		
3.01.00	The details of the Plate Heat Exchangers with the quantity, design parameters etc. to be supplied shall be as per Data Sheet-A enclosed at Section IB.		
3.02.00	Each Plate Heat Exchanger (quantity and other details specified in Data Sheet-A) shall be complete with the following accessories and auxiliaries.		
	(i)	Suitable drain and vent connections for both primary (DMCW) and Secondary Water (Raw Water/ Sea Water as applicable) streams complete with isolation valves.	
	(ii)	Supporting arrangement complete with foundation plate channels, anchor bolts, nuts, sleeves, inserts etc.	
	(iii)	Lifting arrangement i.e., lifting lugs, eye bolts etc.	
	(iv)	Matching counter flanges with necessary bolts, nuts, and gaskets for all flanged terminal points, including for DMCW and ACW inlet/outlet nozzles & reducers/ expanders.	
	(v)	Inspection ports at the End plates of the PHE.	
	(vi)	Other accessories as required to make PHE's complete in all respects.	
	(vii)	Commissioning spares, if any.	
	(viii)	One Ratchet spanner for each type of PHE is included in bidder's scope of supply.	
	(ix)	Matching piece (Reducer/Expander), with coatings (as required), to match the PHE nozzle connection with connecting pipe size at DMCW side/ ACW side as indicated in Data Sheet. In case of sea Water, Matching piece on ACW Side (Secondary) shall be flanged with coatings (as required for sea water application).	
	(x)	Spares as applicable as per data sheet A at Section IB.	
3.03.00	Finish paints for touch up painting of equipment after erection at Site in sealed containers.		
3.04.00	Items though not specifically mentioned in the specification but needed to complete the equipment to meet the intent of specification, shall also be deemed to be included unless otherwise specifically mentioned in exclusions.		

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 3 OF 11	

4.00.00 **EXCLUSIONS :**

The following are excluded from the bidder's scope:

- 4.01.00 Civil foundation works required for installation of the heat exchangers.
- 4.02.00 Piping, valves etc., on the external circuit of both primary and secondary water streams.
- 4.03.00 Erection & Commissioning of equipment at site.

5.00.00 **DESIGN AND CONSTRUCTION:**

5.01.00 **General Requirements:**

- 5.01.01 Unless otherwise necessary manufacturer's standard and proven models of the plate heat exchanger shall be supplied.

- 5.01.02 The equipment shall be capable of safe, proper and continuous operation at all heat loads and water from up to those corresponding to the operating conditions mentioned in Data Sheet-A. Vibration, noise, mechanical and thermal stresses shall be kept within allowable limits specified by relevant codes/ standards in design. Due attention shall be given to ease of maintenance, repair and cleaning.

- 5.01.03 Suitable corrosion allowance shall be provided wherever necessary. The corrosion allowance for the heat exchanger parts such as pressure plates (support plates), nozzles, sliding channels and frame shall be 1.6 mm (minimum).

- 5.01.04 Each heat exchanger shall be capable of passing a flow of at least 1.1. times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.

- 5.01.05 For the purpose of calculating dirty overall heat transfer coefficient a total fouling factor as given in Data Sheet-A shall be assumed. It is expected that the cleaning frequency shall be once in a year with the above fouling factor.

- 5.01.06 No back wash for the heat exchangers is envisaged.

5.02.00 **Performance Requirements:**

- 5.02.01 The pressure drop across plate heat exchanger from inlet to outlet in fouled conditions for primary and secondary sides, shall not be more than those

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 4 OF 11	

specified in Data Sheet-A, for the specified flow rates.

5.02.02 For the specified flow rate and inlet temperature, the primary side (hot fluid) outlet temperature shall not be more than that specified in Data Sheet-A.

5.02.03 In the event of failure to meet the above stipulated performance requirements, the equipment will be outrightly rejected.

5.03.00 **Construction of Heat Exchanger:**

5.03.01 Heat transfer plates shall be packed in a frame consisting of fixed frame plate and movable pressure plate and aligned at top and bottom on carrying bars. Design shall be such that cleaning is possible without dismantling the piping.

5.03.02 Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.

Double sealing arrangement shall be provided at outer edge and around ports. The interspace between the seals shall be vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.

The gasket arrangement shall be such that it receives continuous support to ensure a long gasket life. The gasket should be able to retain their properties and shape over a life period of 10 years.

5.03.03 Heat transfer plates shall be provided with sufficient thickness in order to impart sufficient rigidity to the plates particularly from handling considerations. Plates shall have contact points in order to provide inter-plate supports. The recesses on the plates are suitably strengthened by a reinforcement plate.

Plate thickness shall be adequate to withstand all operating conditions as specified in Datasheet-A. Flanges shall be as per ANSI B 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sec. VIII Div. 1. 25% extra capacity for additional plates shall be provided in frame.

Each plate shall be numbered in sequence. The number shall be marked by indelible ink on the plate to permit easy reassembly. The plates shall be pressed from one piece. They shall be pressed in single / progressive manner.

The corrugation shall be smooth, uniform and identical for every plate. The PHE

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 5 OF 11	

bottom frame plate and support should have fixing lugs and cleats to keep provision for enabling to fit trough with outlet nozzle fitted underneath to collect and drain out water in the event of leakages.

- 5.03.04 Frame for each heat exchanger shall have extra capacity to accommodate the additional plates if required in future because of any reason whatsoever. The extra capacity to be provided is indicated in Data Sheet-A.

The upper carrying bar and lower guide bar shall be rigid in construction without any risk or sagging or buckling, and shall facilitate easy guiding of the plates.

- 5.03.05 All inlet, outlet and other nozzles shall be flanged type and shall be as specified in Data Sheet-A. Counter flanges complete with gaskets, bolts, nuts and coatings (wherever necessary) shall be supplied for all the nozzle connections. The nozzle sizes of primary / secondary streams of PHEs shall be of adequate size within acceptable range of velocity. The size selection shall be subject to approval in the event of order.

- 5.03.06 If necessary, relief valves shall be provided on both the streams.

5.04.00 **Materials of construction :**

Material of the heat transfer plates and gaskets shall be consistent with the fluid handled. However, material specification for various parts shall be equal or superior to those specified in Data Sheet - A.

5.05.00 **Foundation And Lifting Arrangements:**

- 5.05.01 Plate heat exchanger shall be supplied with necessary foundation plates, anchor bolts, sleeves, nuts, inserts etc.

- 5.05.02 Plate heat exchanger shall be equipped with suitable lifting lugs/ eye-bolts to facilitate handling during erection and maintenance.

6.00.00 **PAINTING:**

- 6.01.00 The surface preparation of all exterior and interior surfaces of plate heat exchanger shall include the following:

a) Removal of oil, grease, dirt and swarf etc.,

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 6 OF 11	
	b) Removal of rust and scale etc., c) Sand blasting/ shot blasing.		
6.02.00	All exterior surfaces of PHEs shall be sand / shot blasted, painted with primer and finish coated with coal tar based epoxy coating of min. 250 microns thickness. Colour shade etc. shall be subject to BHEL / customer approval.		
7.00.00	SHOP INSPECTION AND TESTS:		
7.01.00	General:		
7.01.01	Manufacturer shall conduct all tests and stage inspections as per the approved quality plan to ensure that the plate heat exchanger shall conform to the requirements of this specification and of the applicable codes/ standards.		
7.01.02	All materails used for manufacture/ fabrication of the plate heat exchanger components shall be of tested quality. Relevant test certificates for chemical analysis, mechanical tests and heat treatment shall be made available before the final shop inspection. In case the relevant test certificates are not available, the manufacturer shall arrange to carry out the necessary tests required as per approved quality plan and applicable codes at his cost, for which samples shall be identified by BHEL's representative.		
7.01.03	All shop tests shall be conducted in the presence of BHEL's representative and test certificates for the same shall be furnished to BHEL for approval.		
7.01.04	Qualification of welding procedures and welders shall be as per ASME B&PV Code, Section-IX/applicable code.		
7.02.00	Heat Transfer Plates:		
7.02.01	Plate material used for pressing shall be furnished with mill test report showing chemical and physical properties and heat treatment records. Suitable correlating mark shall be available, so that BHEL's inspector can identify the material with test certificates before pressing the plates.		
7.02.02	After pressing visual and dimensional checks on the plates shall be made in the presence of BHEL's inspector, on sampling basis.		

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 7 OF 11	

7.02.03 The heat transfer plates from each lot of the plates shall be tested by liquid / dye penetrant test in order to check for cracks and other surface defects in presence of BHEL / customer's representative / third party (Llyods, TUV or equivalent). If any defect is detected in any of these plates, the whole lot shall be tested and plates without defects only shall be accepted. Plates cleaning agent, liquid penetrant and developer shall not contain any halogen. Procedure for DP test shall be subjected to purchaser's approval. Quantum of check shall be subject to customer's/purchaser's approval in the event of order.

7.02.04 The heat transfer plates shall be tested by light box test in order to check for cracks and other surface defects in presence of BHEL / customer's representative / third party (Llyods, TUV or equivalent). The plates without defects only shall be accepted. Procedure for Light box test shall be subjected to purchaser's approval. Quantum of check shall be subject to customer's/purchaser's approval in the event of order.

7.02.05 **Inspection Requirements**

- (i) Inspection for "Pressing of plates to form whole corrugation of the heat transfer plate" shall be from third party like TUV/Lloyd and certificate shall be submitted for review of BHEL.
- (ii) Minimum requirement for quality Plan shall be as per quality plan attached in the Section IIA of the specification. Manufacturing Quality Plan for PHE shall be subject to approval during detail engineering. No price implication shall be admissible to QP approval by BHEL/Customer.
- (iii) Heat transfer area for the PHE shall be measured by White light scanning / similar method during contract stage to ascertain the correctness of heat transfer area.

Bidder to note that Heat Transfer Area measured by White Light Scanning should not have negative tolerance more than 3% w.r.t to the heat transfer area indicated by bidder. However in the case of negative tolerance (limited to maximum 3 percent) , bidder has to provide additional plates proportionately, as free issue, assembled into all the applicable PHE's before the Final inspection and "As built Certificate" shall be issued by the bidder accordingly. Bidder to note that negative tolerance beyond three percent shall not be accepted, however no credit shall be given to the bidder for positive tolerance of the plate area measurement.

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 8 OF 11	

7.03.00	Gaskets :
7.03.01	Certificate on Chemical composition of the gasket material shall be furnished to prove the quality. Sample testing in presence of BHEL’s inspector shall also be conducted if desired.
7.03.02	Shore hardness test shall be conducted on the gasket and certificate shall be furnished. Sample tests shall also be done in presence of BHEL’s inspector.
7.03.03	Visual and dimensional check on a sampling basis shall be done. Plates and gaskets assembled together, will be inspected for proper assembly.
7.04.00	Frame Assembly:
7.04.01	All materials for various components of frame assembly viz frame plate, pressure plate, carrying bar, guide bar, tightening/ clamping bolts and nuts etc., shall be of tested quality and test certificates for chemical composition and physical properties shall be furnished.
7.04.02	If the thickness of the plates used for frame and pressure plates is 40 mm or more the same shall be checked ultrasonically to demonstrate the absence of lamination and lack of fusion etc.
7.05.00	All weld joints used for fabrication of heat exchangers shall be subjected to suitable non-destructive examination. This shall include 100% magnetic particle examination or other suitable NDT of all welds.
7.06.00	Nozzle and Flanged Connections:
	All materails for various nozzles, flanges, gaskets, nuts, bolts etc., shall be of tested quality and correlating test certificates for chemical and mechanical properties shall be furnished. These shall be checked for the edge preparation, fit up, orientation and satisfactory working with matching parts.
7.07.00	Dimensional Checks:
	Dimensional checks of various components of plate heat exchanger, plate pack length etc., shall be carried out as per assembly drawings approved by BHEL.

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 9 OF 11	

7.08.00 Hydrostatic Test :

Plate heat exchanger shall be hydrostatically tested at a pressure of 1.5 times the design pressure. Pressure shall be applied first to both the sides of the plate at the same time, then only to one side and finally only to other side. Pressure shall be maintained for a minimum period of 30 Minutes for each of the three cases above and for such additional time as may be necessary to conduct the examination, for leakage. The examination shall be performed on all joints, connections and regions of high stress. Fluorescent dye shall be used during the test for ease of leak detection. There shall be no structural damage deformation of the plates.

8.00.00 PERFORMANCE GUARANTEE AND TESTING AT SITE:

8.01.00 Performance Guarantee

8.01.01 After completion of erection at site, performance test will be conducted to ensure that the plate heat exchanger operation meets the specified requirements. Rectification of all defects shall have to be done by the supplier at no extra cost to the purchaser. However the purchaser reserves the right to reject the equipment/ parts not meeting the requirement if the deficiency still persists.

8.01.02 The Plate Heat Exchanger shall be guaranteed to meet the performance requirements as given in Data Sheet-A of Section-IB and also for trouble free operation after commissioning.

8.02.00 PG Testing at Site

8.02.01 The guaranteed performance figures of the plate heat exchangers shall be proved by the supplier during the performance testing at site (as applicable). If the results of these tests show the non-performance of the heat exchanger to meet the guaranteed values, the supplier shall modify the heat exchanger as required to enable it to meet the guarantees.

Even If PG test is not envisaged for any project, in the event of performance shortfall at site or if insisted by customer, performance parameters (Flow, Temperature rise & Pressure drop) are to be demonstrated at site by bidder without any cost implication to BHEL.

8.02.02 All duly calibrated instruments required for PG testing including for flow

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 10 OF 11	

measurements shall be arranged by the bidder and taken back after the Test. The computation of flow by characteristics curve of Pumps for PG Testing of PHE's shall not be permitted.

8.02.03 It is clarified that pressure gauges and temperature gauges are provided at each PHE inlet / outlet on both primary / secondary sides and bidder can install their calibrated instruments on these locations. It is further clarified that due to layout constraints flow measuring instruments installation on pipe is not feasible. Bidder shall arrange the Ultra-sonic flow meter / similar type of instrument for PG testing.

8.02.04 At the time of performance testing, cleaning of the plates (if required) and instruments like pressure gauges, temp. Gauges, flow measuring instruments etc. shall be arranged by the bidder and no instruments shall be provided by BHEL for performance testing.

9.00.00 **QUALITY ASSURANCE & QUALITY PLAN:**

9.01.00 The Plate Heat Exchanger to be supplied shall have assured quality and workmanship.

9.02.00 Typical quality plan is enclosed in section-IIB for guidance. The bidder shall comply with these minimum requirements and shall furnish his own quality plan for approval. The quality plan shall be subjected to customer's / purchaser's approval in the event of order without any cost implication.

10.00.00 **DRAWINGS, DATA & INFORMATION TO BE SUBMITTED ALONG WITH THE OFFER:**

10.01.00 Compliance certificate (duly signed and stamped).

10.02.00 Guarantee Schedule (duly signed and stamped).

10.03.00 Thermal sizing calculations (only for reference and shall be reviewed during detailed engineering).

10.04.00 GA Drg. of PHE indicating all-important details for Layout purpose, withdrawal space required for plates, weight of assembly, nozzle & matching piece details etc. (only for reference and shall be reviewed during detailed engineering).

10.05.00 Deviation Schedule (as per NIT format; in case of nil Deviation, mention "No Deviation" in the schedule and submit).



TITLE :
STANDARD TECHNICAL SPECIFICATION
FOR
PLATE HEAT EXCHANGER

SPECIFICATION NO. PE-TS-999-179-N001

VOLUME :

SECTION : IIA

REV. NO. 01

DATE : 2/5/18

SHEET 11 OF 11

11.00.00 DRAWINGS, DATA & INFORMATION TO BE SUBMITTED AFTER THE AWARD OF CONTRACT:

The drawings, data and other documents as required in Data Sheet-C shall be furnished after the award of contract.

12.00.00 In the event of Contradictions between Section I and Section-II of the Specification, the requirements of Section-I shall prevail over the Section-II.

	TITLE : DATA SHEET - C PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 1 OF 1	

1.00.00 DRAWINGS, DATA AND INFORMATION TO BE SUBMITTED AFTER THE AWARD OF CONTRACT

After the award of contract, the following drawings, data and information is to be submitted for review/ approval of BHEL as per the distribution schedule given in the enquiry.

~~1.01.00 Within 2 (two) weeks of the date of LOI, the following shall be submitted.~~

1.01.01 Data Sheet-B duly revised conforming to accepted bid.

1.01.02 Final versions of the following drawings to enable BHEL to design foundations and structures and to finalise the layout.

a) General Arrangement/ Installation drawings indicating principal dimensions, and heights of equipment being supplied, size and location of various nozzles, connections, supporting arrangement, withdrawal space, bill of quantities and materials of construction and scope of supply etc.

b) Foundation arrangement drawings showing load data on support, size and location of anchor bolts etc.

1.01.03 Sizing and calculations related to PHE/plates.

1.01.04 Performance curve and figures as indicated in Data Sheet-A (for both clean and fouled conditions).

1.01.05 Quality Plan for PHE.

1.01.06 PG Test procedure (as applicable).

1.02.00 Within the stipulated time period the following drawing/ document shall be submitted:

1.02.01 Drawings of components and details as deemed necessary.

1.02.02 Material Test Certificates.

1.02.03 Shop Tests Reports and Certificates.

1.02.04 Write-up and Instruction Manuals for Erection, Operation and Maintenance.

1.02.05 Storage Instruction.



MANUFACTURER/ BIDDER/		STANDARD QUALITY PLAN		SPEC. NO : PE-TS-999-179-N001, R01	DATE: 02/05/18
SUPPLIER NAME & ADDRESS		CUSTOMER :		QP NO.: PE-QP-999-179-N004	DATE: 15/02/2020
		PROJECT:		PO NO.:	DATE:
		ITEM: PLATE HEAT EXCHANGER		SYSTEM: DMCW/ACW	SECTION:
					SHEET 1 of 6

SL NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
	2	3	4	5	6		7	8	9	*	**			
1					M	C/ N				D	M	C	N	

1.0	RAW MATERIAL INSPECTION													
1.1	Frame Plates & Pressure Plates, Counter Flanges, Connection Lining Material, Top And Bottom Carrying Bar.	Physical Properties	MA	Physical Test	1/Heat	1/Heat	App. Drg / Data Sheet	Relevant material Std.	Mill TC Or Lab Test Report	✓	P.V	V	V	If co-related mill TCS are not available then check testing carried out by NABL lab
		Chemical Properties	MA	Chemical Analysis	1/Heat	1/Heat	App. Drg / Data Sheet	Relevant material Std.	Mill TC Or Lab Test Report	✓	P.V	V	V	If co-related mill TCS are not available then check testing carried out by NABL lab
		Dimensions	MA	Measurement	100%	100%	Approved Drawings	Approved Drawings	Inspection Reports	✓	P.V	V	V	
		Workmanship And Finish	MA	Visual	100%	100%	Approved Drawings	Approved Drawings	Inspection Reports	✓	P.V	V	V	
		Lamination (Applicable For Frame And Pressure Plate Only)	CR	Ultrasonic Test	100%	100%	SA 435	SA 435	Inspection Reports	✓	P.V	V	V	Applicable for plate thickness more than 25 mm only
1.2	Heat Transfer (HT) Plates/Coils	Physical Properties	MA	Physical Test	1/Heat	1/Heat	App. Drg. / Data Sheet	App. Drg. / Data Sheet	Mill TC Or Lab Test Report	✓	P.V	V	V	See Remark 1
		Chemical Properties	MA	Chemical Analysis	1/Heat	1/Heat	App. Drg. / Data Sheet	App. Drg. / Data Sheet	Mill TC Or Lab Test Report	✓	P.V	V	V	See Remark 1
		Dimensions	MA	Measurement	100%	Sample	Approved Drawings	Approved Drawings	Inspection Reports	✓	P.V	V	V	

ENGINEERING				QUALITY				BIDDER/SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL			
	Sign & Date	Name	Checked	Sign & Date	Name	Seal		Sign & Date				Doc No:	Sign & Date	Name	Seal
Prepared by:		NIKHIL DUBEY			MOHIT KUMAR							Reviewed by:			
Reviewed by:		VISHAL KR. YADAV			RITESH KR. JAISWAL							Approved by:			

19/2/2020



MANUFACTURER/ BIDDER/		STANDARD QUALITY PLAN			SPEC. NO : PE-TS-999-179-N001, R01		DATE: 02/05/18
SUPPLIER NAME & ADDRESS		CUSTOMER :		QP NO.: PE-QP-999-179-N004		DATE: 15/02/2020	
		PROJECT:		PO NO.:		DATE:	
		ITEM: PLATE HEAT EXCHANGER		SYSTEM: DMCW/ACW		SECTION:	
						SHEET 2 of 6	

SL NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	*	**			
					M	C/ N				D	M	C	N	
1.3	Gaskets	Dimensions	MA	Measurement	100%	Sample	Approved Drawings	Approved Drawings	Inspection Reports	✓	P.V	V	V	Co-related mill TCS to be provided.
		Workmanship And Finish	MA	Visual	100%	Sample	No damage, No Surface defects.	No damage, No Surface defects.	Inspection Reports	✓	P.V	V	V	
		Contour	MA	Visual	100%	Sample	Mfg. Drgs / specification	Mfg. Drgs / specification	Inspection Reports	✓	P.V	V	V	
		Hardness	CR	Measurement	100%	Sample	Approved Drawings	Approved Drawings	Inspection Reports	✓	P.V	V	V	
1.4	Tightening Bolts & Nuts. (Tie Rod)	Physical Properties	MA	Physical Test	1/Heat	1/ Heat	App. Drg / data sheet	Relevant Material Std.	Mill Tc Or Lab Test Report	✓	P.V	V	V	
		Chemical Properties	MA	Chemical Analysis	1/Heat	1/ Heat	App. Drg / data sheet	Relevant Material Std.	Mill Tc Or Lab Test Report	✓	P.V	V	V	
		Dimensions	MA	Measurement	100%	100%	Approved Drawings	Approved Drawings	Inspection Reports	✓	P.V	V	V	
		Workmanship and Finish	MA	Visual	100%	100%	Approved Drawings	Approved Drawings	Inspection Reports	✓	P.V	V	V	
		Internal Soundness (For diameter >= 40 mm)	CR	UT	100%	100%	ASTM A 388	See Remark - 4	Inspection Reports	✓	P.V	V	V	UT will be carried on raw material stage.
2.0	IN PROCESS INSPECTION													
2.1	HT PLATES	Area Measurement	NA	White Light Scanning	1 per Type	1 per Type	Approved drawing/ data sheet	Approved drawing/ data sheet	Inspection Reports	✓	P.V	W	V	See Remark 2

BHEL				BIDDER/SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING		QUALITY		Sign & Date		Sign & Date		Doc No:		Sign & Date	
Prepared by:	NIKHIL DUBEY	Checked by:	MOHIT KUMAR	Seal		Reviewed by:		Reviewed by:		Seal	
Reviewed by:	VISHAL KR. YADAV	Reviewed by:	JAISWAL			Approved by:		Approved by:			

19/2/2020



MANUFACTURER/ BIDDER/		STANDARD QUALITY PLAN		SPEC. NO : PE-TS-999-179-N001, R01	DATE: 02/05/18
SUPPLIER NAME & ADDRESS		CUSTOMER :		QP NO.: PE-QP-999-179-N004	DATE: 15/02/2020
		PROJECT:		PO NO.:	DATE:
		ITEM: PLATE HEAT EXCHANGER		SYSTEM: DMCW/ACW	SHEET 3 of 6
				SECTION:	

SL NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	*	**			
					M	C/ N				D	M	C	N	
		Physical Properties	MA	Physical Test	1 Sample per Heat	1 Sample per Heat	Approved drawing/ data sheet	Relevant Material Std.	Mill TC or Lab Test Report	✓	P.V	V	V	
		Chemical Properties	MA	Chemical Analysis	1 Sample per Heat	1 Sample per Heat	Approved/ drawing/ data sheet	Relevant Material Std.	Mill TC or Lab Test Report	✓	P.V	V	V	
		Dimension	MA	Measurement	1 Sample per Heat	1 Sample per Heat	Approved drawing/ data sheet	Approved drawing/ data sheet	Inspection Report	✓	P.V	V	V	
		Workmanship And Finish	MA	Visual	100%	100%	Approved drawing/ data sheet	No scratches, cracks etc.	Inspection Report	✓	P.V	V	V	
		Surface Defects And Cracks	CR	DP test	10%	2 % or min. 100 nos. whichever is higher	Manufacturer's DP test procedure (to be reviewed and approved by BHEL/Customer during contract stage)		DPT Report	✓	P.V	W	V	See Remark 3
		Light Box Test/ Vacuum chamber test		100%	10%	Manufacturer's Light Box/Vacuum test procedure (to be reviewed and approved by BHEL/Customer during contract stage)		Vacuum Test Report	✓	P.V	W	V	See Remark 3	
		PMI testing	CR	PMI test	100 %	1 Sample per Heat	Approved drawing/ data sheet	Approved drawing/ data sheet	PMI Compliance report	✓	P.V	V	V	See Remark 5

BHEL				BIDDER/SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING		QUALITY		Sign & Date		Doc No.:		Sign & Date		Name	
Prepared by:	19/12/20	NIKHIL DUBEY	Checked by:	19.02.20	MOHIT KUMAR						
Reviewed by:	19/12/20	VISHAL KR. YADAV	Reviewed by:	19/12/20	RITESH KR. JAISWAL						



MANUFACTURER/
SUPPLIER NAME & ADDRESS

STANDARD QUALITY PLAN

SPEC. NO : PE-TS-999-179-N001, R01

DATE: 02/05/18

CUSTOMER :

QP NO.: PE-QP-999-179-N004

DATE: 15/02/2020

PROJECT:

PO NO.:

DATE:

ITEM: PLATE HEAT EXCHANGER

SYSTEM: DMCW/ACW

SECTION:

SHEET 4 of 6

SL NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
1	2	3	4	5	6		7	8	9	*	**			
					M	C/ N				D	M	C	N	
2.2	Welding Procedures Specification (WPS)	Correctness	MA	Verification	100%	100%	ASME SEC-IX.	ASME SEC-IX.	QW 482 ASME SEC-IX	✓	P.V	V	V	Customer /BHEL/ BHEL TPI / NPCIL, EIL, LLYODS) approved WPS shall be used for welding.
2.3	Procedure Qualification Records (PQR)	Suitability	MA	Visual & Mechanical Test	100%	100%	ASME SEC-IX.	ASME SEC-IX.	QW 483 ASME SEC-IX	✓	P.V	V	V	
2.4	Welders Performance Qualification	Welder's Performance Soundness Of Welds	MA	Visual / RT & Mechanical	100%	100%	ASME SEC-IX.	ASME SEC-IX.	QW 484 ASME SEC-IX	✓	P.V	V	V	Customer /BHEL/ BHEL TPI / NPCIL, EIL, LLYODS) approved WPS shall be used for welding.
2.5	Weld joint of expander/reducer.	Welding Of Outer Flange To Reducer/Expander	MA	Visual	100%	100%	Approved Drawings	Approved Drawings	Inspection Report	✓	P.V	V	V	
2.6	PHE Structure	Workmanship and finish	MA	Measurement & Visual	100%	100%	Manufacturer's DP test procedure (to be reviewed and approved by BHEL/Customer during contract stage)	Approved Drawings	Inspection Report	✓	P.V	V	V	
2.7	Plate Gaskets	Presence Of Gasket	MA	Visual	100%	100%	Mfg. Spec.	Mfg. Spec.	Inspection Report	✓	P.V	W	V	
2.8	Plate arrangement to flow diagram	Correctness	CR	Visual as per flow diagram	100%	100%	Approved Drawing	Approved Drawings	Inspection Report	✓	P.V	V	-	
2.9	Assembly of tightening bolts and nuts	Squeezing of threads on T/B	MA	Visual	100%	100%	Approved Drawing / Data sheet	Approved Drawing / Data sheet	Inspection Report	✓	P.V	V	-	
2.10	Plate Pack	Length	MA	Dimension Measurement	100%	100%	Approved Drawing	Approved Drawing	Inspection Report	✓	P.V	V	V	

BHEL

BIDDER/SUPPLIER

FOR CUSTOMER REVIEW & APPROVAL

ENGINEERING		QUALITY	
Sign & Date	Name	Sign & Date	Name
Prepared by: <i>[Signature]</i>	NIKHIL DUBEY	Checked by: <i>[Signature]</i>	MOHIT KUMAR
Reviewed by: <i>[Signature]</i>	VISHAL KR. YADAV	Reviewed by: <i>[Signature]</i>	RITESH KR. JAISWAL

Sign & Date	Seal

Doc No:	Sign & Date	Name
Reviewed by:		
Approved by:		

Seal

19/12/2020

19/02/2020

	
MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS	
STANDARD QUALITY PLAN	
CUSTOMER :	
PROJECT:	
ITEM: PLATE HEAT EXCHANGER	SYSTEM: DMCW/ACW
SPEC. NO : PE-TS-999-179-N001, R01	DATE: 02/05/18
QP NO.: PE-QP-999-179-N004	DATE: 15/02/2020
PO NO.:	DATE:
SECTION:	SHEET 5 of 6

[illegible]

BHEL					
ENGINEERING			QUALITY		
	Sign & Date	Name		Sign & Date	Name
Prepared by:	<i>[Signature]</i>	NIKHIL DUBEY	Checked by:	<i>[Signature]</i> 19.02.20	MOHIT KUMAR
Reviewed by:	<i>[Signature]</i>	VISHAL KR. YADAV	Reviewed by:	<i>[Signature]</i> 19.02.20	RITESH KR. JAISWAL

BIDDER/SUPPLIER			
Sign & Date		Seal	

FOR CUSTOMER REVIEW & APPROVAL				
Doc No.		Sign & Date	Name	Seal
Reviewed by:				
Approved by:				



MANUFACTURER/ BIDDER/ SUPPLIER NAME & ADDRESS		STANDARD QUALITY PLAN		SPEC. NO : PE-TS-999-179-N001, R01	DATE: 02/05/18
CUSTOMER :		PROJECT :		QP NO.: PE-QP-999-179-N004	DATE: 15/02/2020
ITEM: PLATE HEAT EXCHANGER		SYSTEM: DMCW/ACW		PO NO.:	DATE:
		SECTION:			SHEET 6 of 6

SL NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY	REMARKS	
					6	7	8	9	*	**	
1	2	3	4	5	M	C/ N		D	M	C	N
1	Co-related Mill TC's to be furnished by vendor to BHEL representative during inspection stage for review. BHEL to verify physical correlation of Mill TC's with material.										
2	Inspection of Heat Transfer Plate Area Measurement shall be by White light Scanning Method from BHEL (Refer Annexure -A). In case, inspection of plate area measurement by white light scanning method of specific PHE model has been witnessed by BHEL in past project then Type test certificates are acceptable to BHEL for same. The type test certificate shall not be more than 5 years old from date of inspection.										
3.	Reg. Dye Penetrant Test & Light Box Test: There shall be random witness by BHEL/ Customer at Bidder's works, in case any defect is found in any of selected % of plates, the whole lot shall be tested in presence of BHEL & Customer. H.T. Plates without defect only shall be accepted.										
4.	Ultrasonic test of the rods shall be carried out using 10 mm / 20 mm size Normal Beam Probe of frequency 2 MHz. Using this probe, the back wall echo in the sound area of bar shall be adjusted to 100% of full Screen Height (FSH). The whole bar shall be scanned under this sensitivity setting. In this sensitivity setting any defect echo indication having height greater than 20% of FSH is not acceptable.										
5.	100% PMI Inspection for material grade of PHE Heat Transfer plates shall be from BHEL/ BHEL TPI. BHEL reserves the right to conduct random & independent PMI inspection on PHE's Heat Transfer plates to ascertain the plate material.										
6.	BHEL reserves the right for conducting repeat test, if required.										
7.	Photographs of packed material to be verified by BHEL before issuing MDCC.										
8.	Project specific QP to be developed based on customer requirement.										

LEGENDS:

RECORDS, IDENTIFIED WITH TICK(✓) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION,
** M: SUPPLIER/MANUFACTURER/SUB-SUPPLIER, C: MAIN SUPPLIER/ BHEL/ THIRD PARTY INSPECTION AGENCY, N: CUSTOMER, D: DOCUMENTATION
P: PERFORM, W: WITNESS, V: VERIFICATION, AS APPROPRIATE
MA: MAJOR, MI: MINOR, CR: CRITICAL

BHEL				BIDDER/SUPPLIER				FOR CUSTOMER REVIEW & APPROVAL			
ENGINEERING		QUALITY		Sign & Date		Doc No:		Sign & Date		Name	
Prepared by:	Sign & Date	Name	Checked by:	Sign & Date	Name	Reviewed by:	Sign & Date	Reviewed by:	Sign & Date	Name	Seal
by:	19/09/2020	NIKHIL DUBEY	by:	19.02.20	MOHIT KUMAR	by:		by:			
Reviewed by:	inlet	VISHAL KR. YADAV	Reviewed by:	19/02/2020	RITESH KR. JAISWAL	Approved by:		Approved by:			

19/2/2020



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N003

SECTION IIA

REV. NO. 1 DATE 18.05.2016

SHEET 1 OF 2

Annexure-A to Standard Quality Plan

PROCEDURE FOR MEASUREMENT OF HEAT TRANSFER SURFACE AREA OF
THE PHE PLATES

Definition of Heat transfer area:-

The Heat transfer area of the PHE plate is the area of the plate participating in the heat transfer process viz. the wetted surface area inside the gasketed groove of the plate as shown in the **Annexure 1**.

Steps to Measure the Heat transfer Area:

- 1) The surface area of the plate shall be cleaned thoroughly.
- 2) Apply the developer (as used in Dye Penetrant test) over the entire surface area of the plate.
- 3) Fix the reference stickers at several appropriate locations on the plate.
- 4) White light (CFL) is projected on the plate.
- 5) The entire surface area including all the geometrical features of the plate (corrugations) is captured by the 3D camera.
- 6) The 3D image of the plate is then converted into CAD format.
- 7) The surface area can be measured from the 3D CAD drawing.



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N003

SECTION IIA

REV. NO. 1

DATE 18.05.2016

SHEET 2 OF 2

ANNEXURE-1

Heat transfer area to be measured-Shown in Hatched portion below

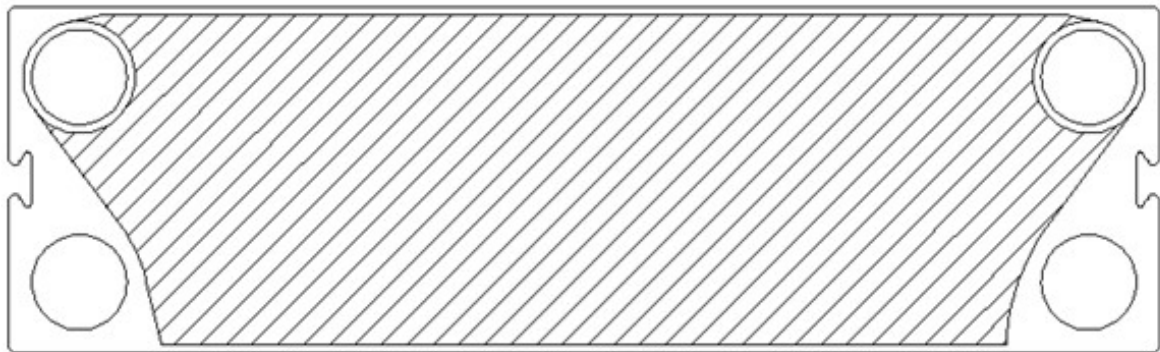


Fig. 1: Wetted Surface Area for Parallel Connection

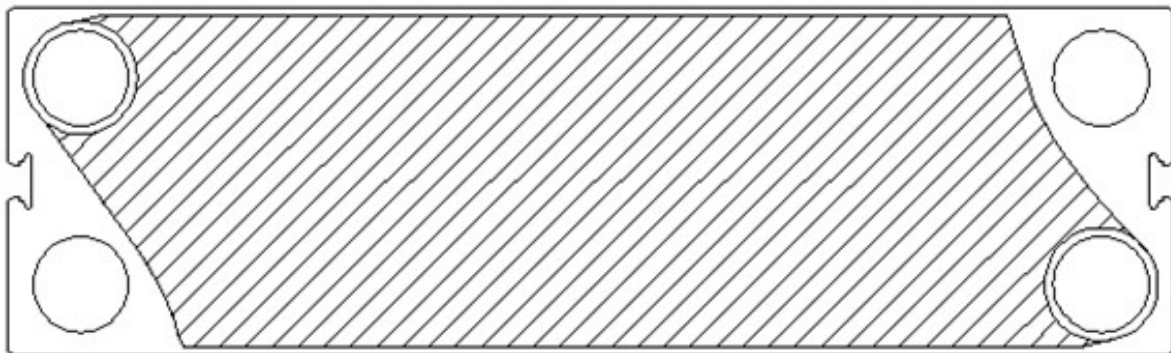


Fig. 2: Wetted Surface Area for Diagonal Connection



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N003

SECTION IIA

REV. NO. 1

DATE 18.05.2016

SHEET 1 OF 2

Annexure-B to Standard Quality Plan

PHE packing procedure before dispatch

1. Purpose:

The purpose of this procedure is to outline the requirements and procedures for protecting the equipment's during shipment and preserving during the storage.

2. Preparation for Packing:

- After hydro testing, operation, all fluids e.g. water etc., shall be completely drained from all PHE's, and the equipment blown dry.
- All material shall be cleaned internally and externally to remove, scale, rust fillings and any other foreign material.
- The PHE shall be placed on a strong wooden base & bolted to the wooden base using the foundation holes for further transportation upto site.

3. Protection of parts:

- Plate Heat Exchangers shall be packed in proper sizes of wooden cases. High grade woods like Rubber woods, jungle wood, hard wood, mango wood, pine wood, etc. is used for packing.
- All finished (or) machined (External C.S. Surfaces shall be protected against corrosion with corrosion resisting coating, which is easily removable (Compound shall be such that it will remain on the surface at temperature normally encountered during shipping & storage).
- All machined surfaces shall be protected from mechanical damage. All external unfinished carbon steel surfaces shall be sand blasted & shall be coated with rust preventive primer.
- Flanged opening if any shall be covered with blank flanges sealed with blank gasket of natural rubber or equivalent. Butt welded opening shall be closed with temporary closing covers. Internal threads shall be protected with metal plug sealed with Teflon tape (if applicable). External thread shall be protected with PVC sleeve.
- Wooden cases shall be covered with HDPE cloth from inside wooden box and the top. All the opening in plate heat exchanger shall be closed properly by suitably covering to prevent foreign material entering in plate heat exchanger.
- Loose material, primary and secondary a shall be packed in corrugated box and plastic bags with proper tagging.
- All fabricated wooden cases & crates conform to the requirement as per table given below:

Gross Weight [Kgs.]	Board Thickness	Batton / Rafter Thickness
2000 to 9000	Min. 30 mm	Min. 35 mm



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N003

SECTION IIA

REV. NO. 1

DATE 18.05.2016

SHEET 2 OF 2

9000 to 18000

Min. 50 mm

Min. 35 mm

- All the equipment shall be protected for entire period of dispatch, storage and erection against corrosion, incidental damage due to vermin, sunlight, rain, high temperature, humid atmosphere, rough handling in transit and storage. All MS parts which are not painted shall be provided with coating of grease.
- Clay Desiccant or such other moisture absorbing material in small cotton bags shall be placed and tied at various points on the equipment, wherever necessary.

4. Special tools and Spare parts:

Special tools and tackles and spares shall be packed separately with adequate identification. Such packages shall be identified as Tools/Commissioning/Operational spares.

5. Preservation

The equipment's shall be stored under closed/open space in packed condition until installation. The packages containing loose plates and gaskets are to be protected from extreme climatic conditions.





TITLE :
**TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS**

SPECIFICATION NO. PE-RC-999-179-N003

SECTION III

REV. NO. 0

DATE 22/02/2020

SECTION III

**IIIA COMPLIANCE CERTIFICATE (TO BE SUBMITTED BY
BIDDER DURING TENDER STAGE).**

**IIIB GUARANTEE SCHDULE (TO BE SUBMITTED BY BIDDER
DURING TENDER STAGE).**

**IIIC DATASHEET –B FORMAT (TO BE SUBMITTED BY
SUCESSFUL BIDDER AFTER AWARD OF CONTRACT).**

	TITLE :	SPECIFICATION NO. PE-RC-999-179-N003	
	TECHNICAL SPECIFICATION FOR	SECTION IIIA	
	RATE CONTRACT OF	REV. NO. 0	DATE 22/02/2020
	PLATE HEAT EXCHANGERS		

COMPLIANCE CERTIFICATE

The bidder shall confirm compliance with following by signing/ stamping this compliance certificate and furnishing same with the offer

- a.) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions/ deviations with regard to same.
- b.) QP/ test procedures shall be submitted in the event of order based on the guidelines given in the specification & QP enclosed therein.
QP will be subject to BHEL/Customer approval in the event of order & customer hold points for inspection/ testing shall be marked in the QP at the contract stage. Inspection/ testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc.
The charges for 3rd party inspection (Lloyds, TUV or equivalent) for imported components shall be included in the base price of the equipment by the bidder.
- c.) All drawings/data – sheets etc. to be submitted during contract shall be subject to BHEL/Customer review/ approval.
GA drawings, as submitted with offer at tender stage are for reference purpose only and shall be subject to approval during contract stage.
- d.) There are no other deviations with respect to specification other than those furnished in the 'Schedule of Deviations'
- e.) The offered materials shall be either equivalent or superior to those specified. Also for components where material is not specified it shall be suitable for intended duty, materials shall be subject to approval in the event of order.
- f.) The commissioning spares (if any) are supplied on 'As Required Basis' & prices for same included in the base price (If bidders reply to this is "No commissioning spares are required" and if some spares are actually required during commissioning same shall be supplied by bidder without any cost to BHEL).
- g.) All sub vendors shall be subject to BHEL/CUSTOMER approval.
- h.) Any special tools & tackles, if required, shall be in bidder's scope.
- i.) Performance Guarantees for PHE's shall stand valid as per commercial terms and conditions.
- j.) Regarding bidder's association with their respective Principals (Plate & Gasket supplier) bidder confirms the following:
 - i. Plate supplier shall vet the thermal design of PHE at tender and contract stage and certify the adequacy of design and number of plates.
 - ii. Guarantee schedule duly vetted by Principal shall be submitted during contract stage.
 - iii. Bidders have back to back arrangement with their principal for technical guarantees.



SCHEDULE OF PERFORMANCE GUARANTEES
FOR
PLATE HEAT EXCHANGER

SPECIFICATION NO.

PE-RC-999-179-N003

Section

IIIB

Rev No.

0

SL. NO.	DESCRIPTION	UNIT	GUARANTEE VALUE
	(To be Filled separately for each type of PHE)		
1.0	PRIMARY SIDE (HOT WATER SIDE)		
	CLEAN CONDITION		
a)	Flow rate	M ³ /Hr.	
b)	DMCW inlet temperature	°C	
c)	DMCW outlet temperature	°C	
d)	Pressure drop	MWC	
2.0	SECONDARY SIDE (COLD WATER SIDE)		
	CLEAN CONDITION		
a)	Flow rate	M ³ /Hr.	
b)	ACW inlet temperature	°C	
c)	ACW outlet temperature	°C	
d)	Pressure drop	MWC	
3.0	PRIMARY SIDE (HOT WATER SIDE)		
	FOULED CONDITION		
a)	Flow rate	M ³ /Hr.	
b)	DMCW inlet temperature	°C	
c)	DMCW outlet temperature	°C	
d)	Pressure drop	MWC	
4.0	SECONDARY SIDE (COLD WATER SIDE)		
	FOULED CONDITION		
a)	Flow rate	M ³ /Hr.	
b)	ACW inlet temperature	°C	
c)	ACW outlet temperature	°C	
d)	Pressure drop	MWC	

PARTICULARS OF BIDDER/ AUTHORISED REPRESENTATIVE

NAME

SIGNATURE

DATE

	Title DATA SHEET - B		SPECIFICATION NO. PE-RC-999-179-N003			
	PLATE HEAT EXCHANGER		VOLUME III	SECTION B		
			SHEET 1	OF 7		

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N003, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS	
1.0	General			
1.1	Number of plate heat exchangers being supplied.	Nos.		
1.2	Manufacturer			
1.3	Model Number/ Type			
1.4	Whether single or double pass			
1.5	Flow Pattern			
2.0	Design			
2.1	Design Pressure	bar (g)		
2.2	Design Temperature	°C		
2.3	Heat Load(without LMTD correction)	KW		
2.4	Heat Load(with LMTD correction)	KW		
2.5	LMTD (Corrected)	°C		
3.0	Guaranteed Performance for Each Heat Exchanger (in fouled condition)		Primary Side (Hot Fluid)	Secondary Side (Cold Fluid)
3.1	Flow rate	M ³ /hr		
3.2	Inlet temperature	°C		
3.3	Outlet temperature	°C		
3.4	Total pressure drop across heat exchanger from inlet to outlet(including inlet & outlet nozzles) a) For design flow b) For 110% design flow rate	bar		
4.0	Heat Transfer & Fluid flow data		Primary Side (Hot Fluid)	Secondary Side (Cold Fluid)
4.1	Film heat transfer co-efficient	KCal/hrM ² °C		
4.2	Fouling factor	M ² hr °C/KCal		

Name of Bidder/ Vendor					
Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N003		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	2	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N003, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
4.3	Overall fouling	M ² hr°C/KCal	
4.4	Overall heat transfer coefficient	KCal/hrM ² °C	
	a) In clean conditions		
	b) In fouled conditions		
4.5	Total effective heat transfer area per heat exchanger	M ²	
4.6	Average velocity	m/s	
	a) Through ports		
	b) Through Plate Channels		
4.7	Pressure drop in ports	bar	
4.8	Pressure drop in channels	bar	
4.9	Maximum differential pressure between hot and cold fluids in plate channels (operating)	bar (g)	
5.0	Heat Transfer Plates		
5.1	Area of each plate	M ²	
5.2	Dimension (width x height)	mm x mm	
5.3	Thickness	mm	
5.4	Material & chemical composition		
5.5	Number of plates per heat exchanger	Nos.	
5.6	Maximum number of plates that can be accommodated in the heat exchanger frame	Nos.	
5.7	Type of corrugation		
5.8	Minimum plate pack length	mm	

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N003		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	3	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N003, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
	a) As per 5.5 above b) As per 5.6 above Maximum plate pack length a) As per 5.5 above b) As per 5.6 above	mm	
5.9	Average spacing between two plates	mm	
5.10	Hold up volume of each passage	M ³	
5.11	Port size (diameter)	mm	
6.0	Plate Gaskets		
6.1	Type		
6.2	Material and composition		
6.3	Thickness of gasket	mm	
6.4	Hardness of gasket		
6.5	Expected life of gasket		
7.0	Carrying Bar		
7.1	Type of construction		
7.2	Number per heat exchanger		
7.3	Size		
7.4	Material		
8.0	Guide Bar		
8.1	Type of construction		
8.2	Number per heat exchanger		
8.3	Size		
8.4	Material		
9.0	Frame Plate		

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B		SPECIFICATION NO. PE-RC-999-179-N003	
		PLATE HEAT EXCHANGER		VOLUME III	SECTION B
				SHEET 4	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N003, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS	
9.1	Type of Construction			
9.2	Material			
10.0	Pressure Plate			
10.1	Type of construction			
10.2	Material			
11.0	Supporting Columns			
11.1	Type of Construction			
11.2	Material			
12.0	Clamping/Gasket Compression Arrangement			
12.1	Type of arrangement			
12.2	Tie Rod size & material (Length to take care 25% extra plates)			
12.3	Tie Rod Nuts size & material			
12.4	Nozzle flange stud size & material			
12.5	Nozzle flange Nut size & material			
13.0	Inlet & outlet Connection Nozzles		Primary Side (Hot Fluid)	Secondary Side (Cold Fluid)
13.1	Size	mm		
13.2	Rating			
13.3	Facing & drilling standard			
13.4	Flange material			
13.5	Are all nozzles counter-flanges, bolts, nuts, gaskets etc., are included in the		YES/NO	

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N003		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	5	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N003, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
	offer?		
14.0	Recommended Cleaning frequency of the heat exchanger for assumed fouling factor	Months	
15.0	Is backwash necessary		YES/NO
16.0	Are all auxiliaries and accessories included in the offer		YES/NO
17.0	Are all counter-flanges with nuts, bolts and gaskets for all terminal points included in the offer?		YES/ NO
18.0	Are all heat exchangers supplied with necessary foundation plates, anchor, bolts, sleeves, inserts, lifting lugs etc., as specified.		YES/ NO
19.0	Shop Tests & Inspection		
19.1	Whether all the tests and inspections as detailed in the specification/ quality plan are carried out		YES/ NO
19.2	Hydrostatic Test : a) Test Pressure b) Test duration	bar (g) min.	
19.3	Are all plates checked for cracks and other defects by the penetration method?		YES/NO

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N003		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	6	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N003, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
	If not, what percentage is checked?		
19.4	Is hardness test conducted for plate gaskets?		YES/NO
20.0	Details of Painting		
20.1	Exterior surface a) Surface preparation b) Primer c) Finish Preparation		
20.2	Interior Surface a) Surface preparation b) Primer c) Finish Preparation		
21.0	Weight of each heat exchanger a) Empty b) Flooded Flooded Weight of heat exchanger with Max. Plates	kg.	
22.0	Overall dimensions - (Length x Breadth x Height)	mm x mm x mm	
23.0	withdrawal space		
24.0	Recommended Maintenance tools and tackles furnished		Yes/No

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N003		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	7	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N003, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
25.0	Mesh Size of recommended Strainer	mm	
26.0	Foundation nuts and bolts supplied		Yes/No
27.0	Other information (if any)		

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					