

Enquiry No. B/4066/5/1105/V2

PRE-QUALIFICATION REQUIREMENTS

Bidders are required to meet the pre-qualification requirements (PQR) for supply of AOP & EOP as per criteria stipulated below:

Sl. No.	Pre-Qualification Requirements	Vendor's confirmation Indicating page no. where documents are placed																
A.	<u>Brief Introduction about the equipment: -</u> Auxiliary oil pump (AOP) with AC Motor & Emergency oil pump (EOP) with DC Motor are centrifugal pumps, vertically mounted on Main Oil Tank (i.e. Oil reservoir) & are used to supply ISO VG46 grade oil to steam turbine and Generator bearings of 210MW/250MW/270MW/300MW/500MW/600MW rating. BHEL purchases AOPs which have two duty points. One duty point corresponds to the pressure and flow required for supply of oil to bearings in running condition of Steam Turbine. Second duty point corresponds to pressure and flow required for supply of oil to bearings during turbine barring. The scope of supply shall include complete pumps i.e. Auxiliary oil pump with AC Motor & Emergency Oil Pump with DC Motor assembly along with coupling, pump base plate, flanges, gaskets, counter flanges, fasteners, suction pipe, & discharge pipe, cable glands & all the items required for safe operation of pump. Starter resistance box (Casing starter) & Field trimmer resistance (FTR) shall be supplied along with DC motor for Emergency oil Pump.																	
B.	<u>Acceptance Criterion for Vendor:-</u> 1. For each Material Code in Table-1, Vendor/ its principle should have experience of engineering, manufacturing, testing and supply of at least two Centrifugal pump-motor set with AC/DC motor after 2012 satisfying all of the following criteria: - a. Where pump is vertically mounted on top of steel Oil Tank. b. Flow rate of pump $\geq x$ LPM with Discharge Pressure of pump $\geq y$ bar (x and y are defined as in Table-1) c. Where pump is used to supply Lube oil to Steam Turbine/Gas Turbine rotors. d. Where rating of power plant is $> 200\text{MW}$ e. Where document as per Clause C below are submitted. <table><tr><th colspan="4">TABLE-1 (Value of x and y)</th></tr><tr><th>Material Code</th><th>Description</th><th>Value of x (LPM)</th><th>Value of y (bar)</th></tr><tr><td>W90311918018 W99311918016</td><td>Emergency Oil Pump with/without DC motor</td><td>1800</td><td>2</td></tr><tr><td>W90311917224 W99311917176</td><td>Auxiliary Oil Pump with/without AC motor</td><td>1919</td><td>8</td></tr></table>	TABLE-1 (Value of x and y)				Material Code	Description	Value of x (LPM)	Value of y (bar)	W90311918018 W99311918016	Emergency Oil Pump with/without DC motor	1800	2	W90311917224 W99311917176	Auxiliary Oil Pump with/without AC motor	1919	8	
TABLE-1 (Value of x and y)																		
Material Code	Description	Value of x (LPM)	Value of y (bar)															
W90311918018 W99311918016	Emergency Oil Pump with/without DC motor	1800	2															
W90311917224 W99311917176	Auxiliary Oil Pump with/without AC motor	1919	8															

	2. Vendor should have commissioned the pump set with AC motor of 415V-AC, (+/-10%), 50Hz (+/-5%) with starting current limited to 600% + (tolerances) as per IS: 12615-2011/ IEC 60034 and supplied for at least one executed P.O. 3. Vendor or their sub vendor should have commissioned the above pump set with DC motor of 220V-DC (-15%, +10%) feeder supply with starting resistance for limiting the starting current of DC motor. 4. The "Starting resistance box" of suitable design meeting the starting requirement of DC motor when coupled with Pump & "Field Trimmer Resistances" shall be supplied along with DC motor and vendor should have commissioning experience for at least one executed P.O. Vendor to furnish the copy of PO in support of the point 2 above. 5. The double compression type cable glands and suitable Lugs to be supplied along with motor terminal box (AC & DC) suiting to power cable sizes (in BHEL/Customer scope) which shall be specified during detailed engineering. 6. AC and DC motors shall be sourced from internationally reputed suppliers.	
C.	Submission of documents conforming to Clause B:- a. Vendor to furnish copy of Purchase Order of any one project. b. Vendor to furnish customer approved / end user certified copy of General Arrangement drawing/ cross-sectional drg/characteristic curves /technical datasheet of any one project. c. Vendor to furnish end user certificate (EUC) for any one project containing following information:- 1. Type of Pump: Centrifugal Pump 2. Name and Address of Plant: 3. Discharge Pressure of Pump and Flow rate: 4. Type of Power Plant: Steam Turbine/ Gas Turbine 5. Rating of Power Plant: EUC shall on the letterhead of owner of plant and shall be original ink signed by an authority not less than manager rank. EUC shall contain details of signing authority such as Name, designation, contact number, email address etc. d. Vendor should have detailed "Motor Data Sheets" with GA drawings of Motor, "Starting Resistance Box" & motor JB (junction box) details, Motor characteristic curves, Wiring diagrams etc. The same shall be furnished of any executed project. e. Vendor should have "Type Test reports" for AC & DC motors which should not be older than 10 years. The same shall be furnished of any executed project. <u>Exemption from Submission of documents:</u> Vendors, who have supplied Centrifugal Pumps to BHEL (any unit) satisfying criteria in Clause B are exempted from submission of documents provided they furnish BHEL with PO nos of supply (to BHEL).	

	TABLE-2: TO BE SUBMITTED FILLED BY VENDORS ALONGWITH OFFER.					
	Sl. no.	Description	Example field			
	1	Pump type	Centrifugal			
	3	Flow rate (LPS)	100			
	4	Discharge Pressure (bar)	7			
	5	Type of Power Plant	Steam Turbine/ Gas Turbine			
	6	Rating of Power Plant (MW)	300			
	7	Application of Pump	Lube oil supply to turbine bearings			
	8	End Customer Name	ABC			
	9	Project name	XYZ			
	10	Purchase Order No.				
	11	Contact details, Telephone no's & Email id of End user				
	11	Whether pump is mounted vertically on TOP of steel oil tank	Yes/No			
D.	BHEL reserves the right to ask for more information / documents/ clarifications. Vendor's offer shall not be considered if vendor fails to furnish the document / information / clarifications as mentioned above or vendor doesn't meet the acceptance criteria as mentioned above.					
E.	BHEL reserves the right to verify information submitted by vendor. In case of information/data furnished by the vendor found false/incorrect, BHEL reserves the right to reject their offer for the above items.					

Notes:

1. BHEL would consider the offers and open the price bids of only those bidders, who fulfill the Pre-Qualification requirements (PQRs).



Document No.
4-11917-BOI-09
Rev. No. - 00

REFERENCE TO SPECIFICATION NO. : ST39014

APPLICATION : STEAM TURBINE

ITEM : AUXILIARY OIL PUMP

ADDITIONAL SPECIFICATIONS :

1. VAR. 16 IS ADDED IN CLAUSE 5.2 ON PAGE 2 AS PER FOLOWING DETAILS.

MAXIMUM DISCHARGE (Litre/Min..) : 1919
NORMAL DISCHARGE (Litre/Min.) : 1656
PRESSURE CORRESPONDING TO MAXIMUM DISCHARGE : 8 Bar
NORMAL PRESSURE : 8.5 Bar
DESIGN TEMPERATURE : 100°C
OPERATING TEMPERATURE : 65°C

2. ADD THE FOLLOWING MATTER IN CLAUSE NO. 5.5

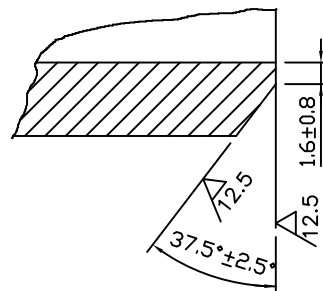
ALL THE SEATING MACHINED SURFACES OF THE BED PLATE
TO BE MAINTAINED FOR 0.5 mm FLATNESS .

3. SUPPLIER'S OFFER SHOULD BE IN SAME UNITS AS MENTIONED IN BHEL
DOCUMENTS.

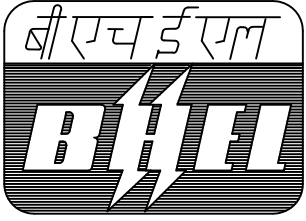
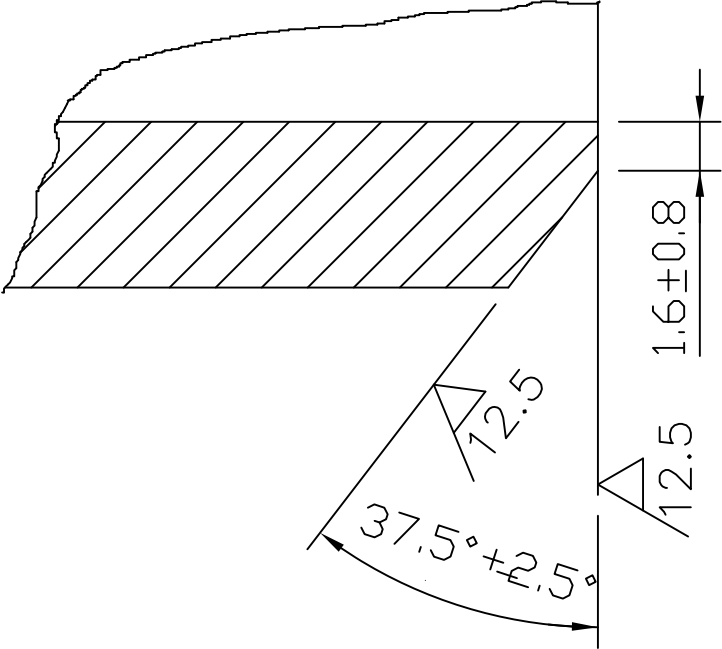
4. SUCTION AND DISCHARGE SIZES WILL BE OF BUTT WELDED TO SUIT
FOLLOWING PIPE SIZES AND EDGE PREPARATION .

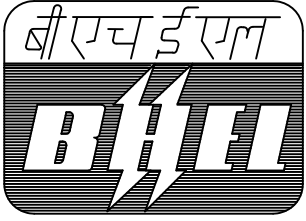
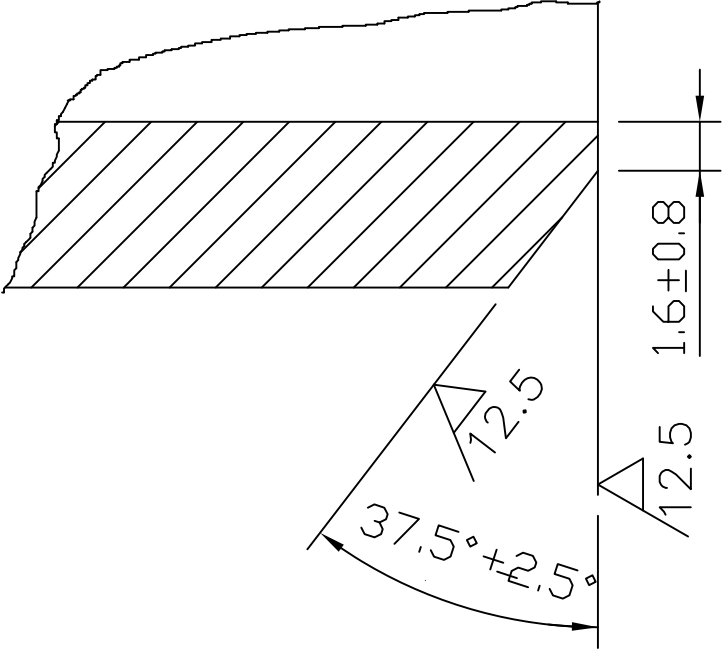
SUCTION $\phi 219.1 \times 6.3$
(Alongwith counter flange, if any)

DISCHARGE $\phi 219.1 \times 6.3$



-sd-
(V. K. GUPTA)
STE-TL

SIGN & DATE			Document No.
			4-11918-BOI-01
SUPERSEDES INVENTORY NO.			Rev. No. - 00
REFERENCE TO SPECIFICATION NO. : ST39015 APPLICATION : STEAM TURBINE ITEM : EMERGENCY OIL PUMP D.C. MOTOR			
ADDITIONAL SPECIFICATIONS : 1. PUMP NAME PLATE SHALL BE BILINGUAL IN HINDI AND ENGLISH LANGUAGES. 2. ADD THE FOLLOWING MATTER IN CLAUSE NO. 5.3. ALL THE SEATING MACHINED SURFACES OF THE BED PLATE TO BE MAINTAINED FOR 0.5 mm FLATNESS . 3. WHEREVER REQUIRED THE PUMP DATA SHEETS , G. A. DRAWING , CHARACTERISTIC CURVES AND CROSS SECTIONAL DRAWING ARE TO BE APPROVED BY CUSTOMER/CONSULTANT. 4. SUCTION AND DISCHARGE SIZES WILL BE OF BUTT WELDED TO SUIT FOLLOWING PIPE SIZES AND EDGE PREPARATION. SUCTION Alongwith counter flange) Ø141.3x6.55 DISCHARGE Ø168.3x7.11  (STE-TL)			
SIGN & DATE			
INVENTORY NO.			

SIGN & DATE			Document No.
			4-11918-BOI-01
SUPERSEDES INVENTORY NO.			Rev. No. - 00
REFERENCE TO SPECIFICATION NO. : ST39015 APPLICATION : STEAM TURBINE ITEM : EMERGENCY OIL PUMP D.C. MOTOR			
ADDITIONAL SPECIFICATIONS : 1. PUMP NAME PLATE SHALL BE BILINGUAL IN HINDI AND ENGLISH LANGUAGES. 2. ADD THE FOLLOWING MATTER IN CLAUSE NO. 5.3. ALL THE SEATING MACHINED SURFACES OF THE BED PLATE TO BE MAINTAINED FOR 0.5 mm FLATNESS . 3. WHEREVER REQUIRED THE PUMP DATA SHEETS , G. A. DRAWING , CHARACTERISTIC CURVES AND CROSS SECTIONAL DRAWING ARE TO BE APPROVED BY CUSTOMER/CONSULTANT. 4. SUCTION AND DISCHARGE SIZES WILL BE OF BUTT WELDED TO SUIT FOLLOWING PIPE SIZES AND EDGE PREPARATION. SUCTION Alongwith counter flange) Ø141.3x6.55 DISCHARGE Ø168.3x7.11  (STE-TL)			
SIGN & DATE			
INVENTORY NO.			

Drawing No. - 4 18101 17 001		REV. NO.-01 DATE- 16.07.2015
APPLICATION : AUX. OIL PUMPS (AOP) FOR STEAM TURBINE ITEM : MOTORS (AC)		
<u>ADDENDUM TO ST39014:</u> <i>Following additional specifications shall be complied to:-</i> - In addition to clause no.-7.15 at page –4 of 6 of ST39014:- - Motor Terminal box- fault level shall be 50 KA (rms) 1 second for 415V- AC system. - Cable glands shall be Nickel-Chromium plated brass, heavy duty, double compression type, confirming to BS:6121 with lugs. - The sizes of cables for glands will be intimated later on. - In addition to clause no.-7.12 at page –4 of 6 of ST39014:- Motor bearing shall be selected to take care of the Vertical/Axial thrust of the motor and the bearing loading & selection criteria shall be furnished. - Paint shade shall be “631 as per IS:5”. - Reports of type tests shall be those conducted within last five years. - Motor data sheets & other documents shall bear the “Document no.” , “Revision no.”. & “Date” and shall be subject to BHEL/customer approval.		
(Nirbhay Kumar) Prepared & Checked by		(Vinod Kumar) Approved by

Drawing No. - 4 18101 86 002		REV. NO.-00 DATE- 26.03.2004
APPLICATION : EMERGENCY OIL PUMPS (EOP) FOR STEAM TURBINE ITEM : MOTORS (DC)		
<u>ADDENDUM TO ST39015:</u> <i>Following additional specifications shall be complied to:-</i> - In addition to clause no.-7.14 at page –4 of 7 of ST39015:- - Cable glands shall be Nickel-Chromium plated brass, heavy duty, double compression type, confirming to BS:6121 with lugs. - In addition to clause no.-7.12 at page –4 of 7 of ST39015:- - The sizes of cables for Cable Glands will be intimated later on. - In addition to clause no.-7.10 at page –4 of 7 of ST39015:- Motor bearing shall be selected to take of the Vertical/Axial thrust of the motor and the bearing loading & selection criteria shall be furnished. - Paint shade shall be as per "RAL 5012 (Blue)", two coats of Red oxide Primer and Enamel paint . - Reports of type tests shall be those conducted within last five years. - Motor data sheets & other documents shall bear the "Document no." , "Revision no." . & "Date" and shall be subject to BHEL/customer approval.		
(Vinod Kumar) Prepared & Checked by		(K. B.Batra) Approved by

MANUFACTURER'S NAME AND ADDRESS

MANUFACTURING QUALITY PLAN

PROJECT:

CONTRACTOR: BHEL

VENDOR'S NAME

ITEM	AUXILIARY OIL PUMP	QP NO.
DRG. NO.		
SPEC.		ST38013/ST39014
REV		As per P.O

Page 1 of 3

BH EL

SL. NO

COMPONENT & OPERATIONS

CLASS

TYPE OF CHECK

QUANTUM OF CHECK

REFERENCE DOCUMENT

ACCEPTANCE NORMS

FORMAT OF RECORDS

AGENCY

REMARKS

1

2

3

4

5

6

7

8

9

D

10

11

h1 RAW MATERIAL INSPECTION

1.1 CASING, COVER, IMPELLER, SHAFT & WEAR RING

CHEMICAL MECHANICAL VISUAL DIMENSIONAL

MAJOR

CHEMICAL MECHANICAL VISUAL DIMENSIONAL

ONE/HEAT 100%

APPD DRG. / DATA SHEET DRG.

APPD DRG. / DATA SHEET DRG.

TC

✓ P

✓ V

1.2 PIPES & motor stool (if applicable)

CHEMICAL MECHANICAL

MAJOR

CHEMICAL MECHANICAL

ONE/HEAT BATCH

APPD DRG. / DATA SHEET

APPD DRG. / DATA SHEET

COC

✓ P

✓ V

1.3 MOTOR (TO BE PROCURED FROM BHEL APPD. SOURCE)

ROUTINE TEST TYPE TEST (FOR RATING >50KV)

MAJOR

TEST

100%

IS 325/APPD DATA SHEET IS 325/APPD DATA SHEET

IS 325/APPD DATA SHEET

TC

✓ P

✓ V

Final balancing is to be checked /recorded only after weight riveting and is to be verified

2

2.1 CASING & COVER

DIMENSIONS SURFACE EXAM

MAJOR

MEASURE VISUAL

100%

DRG.

DRG.

TC

✓ P

✓ V

STRENGTH

MAJOR

HYDRO

100%

APPD DRG. / DATA SHEET/SPEC ST38013

NO LEAKAGE / DROP IN PRESSURE

TC

✓ P

✓ V

TEST DURATION 30MINS

2.2 IMPELLER

DIMENSIONAL

MAJOR

MEASURE

100%

DRG.

DRG.

TC

✓ P

✓ V

SURFACE DEFECTS

MAJOR

DYE PENETRANT

100%

As per M& P procedure.

TC

✓ P

LEGEND:

RECORDS IDENTIFIED WITH '✓' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION.

M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER

INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION

ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER

FOR CLERK'S USE

विश्वजी शाह/Vibhuti Shah

अभियन्ता/Engineer

गुणवत्ता/Quality Assurance

बी.एस.ई.एल., बी.एस.ई.एल., बी.एस.ई.एल.

MANUFACTURER'S NAME AND ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT:				
VENDOR'S NAME				CONTRACTOR: BHEL								
ITEM				AUXILIARY OIL PUMP				Q/A/B/QP/004 REV 06				
DRG. NO.				QP NO.				Page 2 of 3				
SPEC.				ST38013/ST39014								
REV				As per P.O								
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS
1	2	3	4	5	6	7	8	9	M	B	N	11
2.3	MACHINED SHAFT	ON MACHINED SURFACE	MAJOR	TEST	100%	DRAWING	DRAWING	---				
		DIMENSIONS	MAJOR	MEASURE	100%			TC				
		INTERNAL DEFECTS for 50mm & above	MAJOR	ULTRASONIC TEST	100%	As per M&P procedure.		TC				
		SURFACE DEFECTS	MAJOR	DPT	100%	As per M&P procedure.		TC				
2.4	DISCHARGE PIPE	WELD DEFECTS	MAJOR	DP ON ROOT RUN & FINAL WELD	100%	ASME SEC V SE-165	ASME SEC VIII DIV.1 APPD. 8	TC				
			MAJOR	RADIOGRAPHY ON BUTT WELDS	10%	ASME SEC VIII	ASME SEC VIII	TC				
		DIMENSIONS	MAJOR	MEASURE	100%	DRAWING	DRAWING	TC				
		STRENGTH	MAJOR	HYDRO	100%	APPD DRG / DATA SHEET/ST38013	NO LEAKAGE / DROP IN PRESSURE	TC				TEST DURATIC N 30MIN
2.5	COMPLETE ROTOR	TRUENESS OF ROTOR	MAJOR	RUN OUT	100%	DRG.	0.1mm TIR	TC				
		DYNAMIC BALANCING	MAJOR	BALANCE	100%	APPD DRG / DATA SHEET	Spec ST 38013	TC				**
3.0	ASSEMBLY INSPECTION											
3.1	COMPLETE PUMP	VISUAL	MAJOR	VISUAL	100%	---	FREE FROM ANY DEFECTS.					
		DIMENSIONS	MAJOR	MEASURE	100%	DRG.	DRG.					

LEGEND:
RECORDS IDENTIFIED WITH '✓' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION.
M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER
INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION
ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER

FOR CUSTOMER USE

22/06/17

विभूती शाह/Vibhuti Shah
अभियन्ता/Engineer

गुणता अभिगार/BHEL Haridwar
श्री. एच. ई. एल., हरिद्वार

MANUFACTURER'S NAME AND ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT:				
BH EL	VENDOR'S NAME	ITEM	AUXILIARY OIL PUMP	QP NO.	QA/B/I/QP/004 REV 06				CONTRACTOR: BHEL			
		DRG. NO.										
		SPEC.		ST38013/ST39014								
		REV		As per P.O	Page 3 of 3							
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS
									M	B	N	
1	2	3	4	5	6	7	8	9	D	10	11	

4.0												
4.1	COMPLETE PUMP	PERFORMANCE TEST WITH ACTUAL JOB MOTOR	CRITICAL	Q VS H Q VS P Q VS EFF.	100%	APPD DATA SHEET	APPD DATA SHEET	TC	✓	P	W	
		VIBRATION AND NOISE LEVEL	MAJOR	MEASURE	100%	APPD DATA SHEET/ ST38013 rev 08 Clause.no 2.5.2	APPD DATA SHEET/ ST38013 rev 08 Clause.no 2.5.2	TC	✓	P	W	
		COUPLING TRUNESS	MAJOR	MEASURE	100%	DRG.	DRG.	TC	✓	P	W	
		STRIP TEST (WEAR, TEAR AND NECK RING CLEARANCE)	MAJOR	VISUAL	APPLICABLE ONLY IN CASE OF ABNORMAL NOISE & VIBRATION							
4.2	COMPLETE PUMP	REASSEMBLY	MAJOR	VISUAL	100%	DRAWING	DRAWING	-----		P	V	
		FINAL FINISHING, PAINTING & ACCESSORIES	MAJOR	VISUAL	100%	SPECIFICATION	SPECIFICATION	PACKING LIST		P	V	

** Dynamic balancing of the rotor to be carried out as to achieve vibration level as per ST38013 Rev 08 Clause. No 2.5.2

[Handwritten Signature]
22/09/15

विभूती शाह/Vibhuti Shah
अभियन्ता/Engineer
गुणता आश्वासन/Quality Assurance
को. एच. ई. एल., हरिद्वार/BHEL Haridwar

LEGEND: RECORDS IDENTIFIED WITH '✓' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER		FOR CUSTOMER USE	
--	--	------------------	--

MANUFACTURER'S NAME AND ADDRESS						MANUFACTURING QUALITY PLAN						
			PROJECT:									
VENDOR'S NAME BHEL L			ITEM DRG. NO.		EMERGENCY OIL PUMP		QP NO.		QA/B/QP/007 REV 01			
			SPEC.		ST38013/ST39015							
			REV		As per P.O							
									Page 1 of 3			
S.L. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	M	B	N	REMARKS
1	2	3	4	5	6	7	8	9	D	10	11	
H1 RAW MATERIAL INSPECTION												
1.1	CASING, COVER, IMPELLER SHAFT & WEAR RING	CHEMICAL MECHANICAL VISUAL DIMENSIONAL	MAJOR MAJOR	CHEMICAL MECHANICAL VISUAL DIMENSIONAL	ONE/HEAT 100%	APPD DRG / DATA SHEET DRG.	APPD DRG / DATA SHEET DRG.	TC -----	P	V		
1.2	PIPES	CHEMICAL MECHANICAL	MAJOR	CHEMICAL MECHANICAL	ONE/HEAT BATCH	APPD DRG / DATA SHEET	APPD DRG / DATA SHEET	COC	P	V		
1.3	MOTOR (TO BE PROCURED FROM BHEL APPD. SOURCE)	ROUTINE TEST TYPE TEST (FOR RATING >50KW)	MAJOR MAJOR	TEST TEST	100% 100%	IS 325/APPD DATA SHEET IS 325/APPD DATA SHEET	IS 325/APPD DATA SHEET IS 325/APPD DATA SHEET	TC TC	P P	V V		Final balancing is to be checked /recorded only after weight riveting and is to be verified
2 IN-PROCESS INSPECTION												
2.1	CASING & COVER	DIMENSIONS SURFACE EXAM STRENGTH	MAJOR MAJOR	MEASURE VISUAL HYDRO	100% 100%	DRG. APPD DRG / DATA SHEET	NO LEAKAGE / DROP IN PRESSURE	TC TC	P P	V V		TEST DURATION 30MIN
2.2	IMPELLER	DIMENSIONAL SURFACE DEFECTS ON MACHINED SURFACE	MAJOR MAJOR	MEASURE DYE PENETRANT TEST	100%	DRG. Vendor TO INFORM PROCEDURE & NORMS FOR BHEL AGREEMENT		TC	P	V		
LEGEND: I RECORDED IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M MANUFACTURER / SUBCONTRACTOR B BHEL / NOM. INSPECTION AGENCY N WBPCCL INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER												
FOR CUSTOMER USE												
APPROVED BY												

MANUFACTURER'S NAME AND ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT:			
VENDOR'S NAME		ITEM	EMERGENCY OIL PUMP		QIP NO.	QA/B/QIP007 REV 01			CONTRACTOR: BHEL		
BHEL		DRG. NO.	ST38013/ST39015		Page 2 of 3						
SPEC.		As per P.O.									
REV											
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY	REMARKS	
1	2	3	4	5	6	7	8	9	10	11	
2.3	MACHINED SHAFT	DIMENSIONS	MAJOR	MEASURE	100%	DRAWING	DRAWING	---	P	V	
	INTERNAL DEFECTS for 50mm & above	MAJOR	ULTRASONIC TEST	100%	VENDOR TO INFORM PROCEDURE & NORMS FOR BHEL AGREEMENT	TC	P	V			
	SURFACE DEFECTS	MAJOR	DPT	100%	VENDOR TO INFORM PROCEDURE & NORMS FOR BHEL AGREEMENT	TC	P	V			
2.4	DISCHARGE PIPE	WELD DEFECTS	MAJOR	DP ON ROOT RUN & FINAL WELD	100%	ASME SEC V SE-166	ASME SEC VIII DIV.1 APPD. 8	TC	P	V	
			MAJOR	RADIOGRAPHY ON BUTT WELDS	10%	ASME SEC VIII	ASME SEC VIII	TC			
		DIMENSIONS	MAJOR	MEASURE	100%	DRAWING	DRAWING	TC	P	V	
		STRENGTH	MAJOR	HYDRO	100%	APPD DRG / DATA SHEET	NO LEAKAGE / DROP IN PRESSURE	TC	P	V	
2.5	COMPLETE ROTOR	TRUENESS OF ROTOR	MAJOR	RUN OUT	100%	DRG.	0.1mm TIR	TC	P	V	
		DYNAMIC BALANCING	MAJOR	BALANCE	100%	APPD DRG / DATA SHEET	APPD DRG / DATA SHEET	TC	P	V	
3.0	ASSEMBLY INSPECTION										
3.1	COMPLETE PUMP	VISUAL	MAJOR	VISUAL	100%	---	FREE FROM ANY DEFECTS.	---	P		
		DIMENSIONS	MAJOR	MEASURE	100%	DRG.	DRG.	---	P	V	
4.0	TESTING										
4.1	COMPLETE PUMP	PERFORMANCE TEST	CRITICAL	Q VS H	100%	APPD DATA	APPD. DATA	TC	P	W	

LEGEND:

I: RECORDS IDENTIFIED WITH 'I' TICK, SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION.

M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: WBPDCI

INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION

ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER

FOR CUSTOMER USE

APPROVED BY

विभूति शाह/Vibhuti Shah

अतिरिक्त/Engineer

गुणता आश्वासन/Quality Assurance

बी. एच. ई. एल., हरिद्वार/BHEL Haridwar

MANUFACTURER'S NAME AND ADDRESS				MANUFACTURING QUALITY PLAN				PROJECT:			
VENDOR'S NAME				EMERGENCY OIL PUMP				CONTRACTOR: BHEL			
ITEM				DRG. NO.				Q/A/B/I/QP/007 REV 01			
SPEC.				ST38013/ST39015				Page 3 of 3			
REV				As per P.O							
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY		REMARKS
1	2	3	4	5	6	7	8	9	D	10	11
		WITH LAB MOTOR		Q VS P Q VS EFF.		SHEET	SHEET				
		VIBRATION AND NOISE LEVEL	MAJOR	MEASURE	100%	APPD DATA SHEET/ ST30813 rev 08 Clause: no 2.5.2	APPD DATA SHEET/ ST30813 rev 08 Clause: no 2.5.2	TC	P	W	
		COUPLING TRUNESS	MAJOR	MEASURE	100%	DRG.	DRG.	TC	P	W	
		STRIP TEST (WEAR, TEAR AND NECK RING CLEARANCE)	MAJOR	VISUAL	APPLICABLE ONLY IN CASE OF ABNORMAL NOISE & VIBRATION			TC	P	W	NO WEAR & TEAR
4.2	COMPLETE PUMP	REASSEMBLY	MAJOR	VISUAL	100%	DRAWING	DRAWING		P		
		FINAL FINISHING, PAINTING & ACCESSORIES	MAJOR	VISUAL	100%	SPECIFICATION	SPECIFICATION	PACKING LIST	P		

** Dynamic balancing of the rotor to be carried out as to achieve vibration level as per ST30813 Rev 08 Clause. No 2.5.2

Signature
22/09/15

विश्वजी शाह/Vibhuji Shah
अभियन्ता/Engineer

FOR CUSTOMER USE/Quality Assurance
अभियन्ता/Engineer

APPROVED BY



MANUFACTURER/SUBCONTRACTOR		LEGEND: : RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: WBPCL INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE/Quality Assurance अभियन्ता/Engineer	APPROVED BY
----------------------------	--	--	---	-------------


				नाम NAME	दिनांक एवं हस्ताक्षर SIGNATURE & DATE
			अनुपादक TRANSLATED BY		
TSX QAX	A.K. CHATURVEDI S.S. Chaurhan	(Ym) S. S. Chaurhan	निर्माणेकर WORKED BY	DHARAMPAL	21/08/06
			जांचकर CHECKED BY	ANUJ JAIN	21/08/06
सहमत विभाग AGREED DEPTT	नाम NAME	दिनांक एवं हस्ताक्षर DATE & SIGNATURE	पर्यवेक्षणकर SUPERVISED BY	S. C. AGRAWAL	21/08/06
			स्वीकृति APPROVED	Are Jain (A.K. JAIN) AGM	21.08.06
REV. NO. - 03			निर्माण PREPARED	नारी ISSUED	दिनांक DATE
DL 13-02-12			STE(TL/TA)	TSX	31-08-1984

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक 		ST38013	
सुपरसेड्स INVENTORY NO		STEAM TURBINE ENGINEERING PRODUCT STANDARD		पृष्ठ 10 का 2 Page 2 of 10	
समीचीन प्रती संख्या को अधिष्ठाता प्रमाण है		1.9 The discharge branch of the pump shall be taken out above the base plate by the supplier. 1.10 The pumps shall be provided with drainage and venting devices. 1.11 All pump parts conveying oil shall be of oil tight construction. Compression type fittings are not permissible. 1.12 Pump running at subcritical speeds, it shall be ensured that the critical speed lies above the maximum speed attainable during operation with a minimum margin of 15% of rated speed. For pump running at supercritical speeds, it shall be ensured that there is a difference of sufficient magnitude. The margin between the bordering critical speeds and pump rated speed shall be at least 20% of the rated speed. The type of coupling between pump & drive unit is to be taken into account while calculating the critical speeds for bending forces. 1.13 Seals are to be designed such that they can be removed and reinstalled several times without effecting the sealing quality. 1.20 COUPLING Coupling shall be preferably pin bush or jaw type. Suitable coupling with guards shall be provided for coupling pump with motor and shall be designed to facilitate easy alignment. One set of coupling pins/ bolts shall be supplied in spare. Coupling shall be preferably outside the pump base plate (towards motor side). FOUNDATION The pumps shall be mounted in the oil tank and hung from base plate at the tank top into the tank. For further details please refer the drawing No. attached herewith (STE-TL-001). All the seating machined surfaces of the base plate to be maintained for 0.5 mm flatness. 1.40 SPECIAL TOOL & TACKLES One set of tools required for erection, operation and maintenance of the pumping sets shall be supplied together with each pump. List of these tools shall be submitted along with the offer. QUALITY ASSURANCE, INSPECTION AND TESTING 2.1 The manufacturer shall conduct all tests required to ensure all the component parts of the pump offered conform to the requirements of the specification and is in compliance with the requirements of applicable codes and standards. 2.2 The bidder shall submit alongwith his offer quality plan in the enclosed format and in line with clause 2.0			
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की संपत्ति है। इसका प्रयोग एवं अप्रयोग केवल से किया जाना चाहिए। इसकी कानूनी रक्षा के लिए इसे हानिकारक हो न दिया जाए।			
दिनांक एवं हस्ताक्षर SIGN & DATE		12/5/11			
समीचीन प्रती संख्या INVENTORY NO		REV. NO. 08		निर्माणकर्ता WORKED BY	
P-5539				H. GUPTA	
				जांचकर्ता CHECKED BY	
				ANUJ JAIN	

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD		ST38013	
SUPERSEDES INVENTORY		2.3 The particulars of the proposed shop tests and procedures for the tests shall be submitted to BHEL / its customer for approval along with quality plan.		पृष्ठ 10 का 3 Page 3 of 10	
समूची सूची संख्या नों अंकित/लिखित जगह		2.4 The equipment shall be dispatched only after inspection and clearance of material by BHEL/ its customer and approval of test certificates by BHEL/ its customer.			
2.5 The minimum tests/ checks to be carried out on the pump as envisaged by BHEL are given below. This is however not intended to form a comprehensive testing programme as it is suppliers responsibility to prepare the detailed quality plan, which should also include tests, checks carried out by supplier as a part of their normal practice. This quality plan is subject to the approval of BHEL/ its customer. BHEL/ its customer reserves the right to ask for any more checks at the time of quality plan finalisation.		2.5.1 Testing of Materials The material of each component shall be tested as per relevant specification for its chemical composition and mechanical properties viz. YS, Impact, %age elongation % RA etc. Suitable NDT to ensure freedom from surface and subsurface defects shall be carried out.			
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electricals Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		2.5.2 Following tests shall be carried out during various stages of manufacturing at manufacturer's works.			
स्वत्वधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत भारी इलेक्ट्रिकल्स की संपत्ति है इसका प्रयोग एवं प्रसारण के बिना की जाये नहीं।		(a) Check for dimensions of all the component parts including surface finish, axial and radial run out of shaft etc.			
		(b) Non destructive examination DPT/ MPI on machined surfaces of casing and welds of discharge pipe, ultrasonic test on shaft ($\geq 50\text{mm}$) to be carried out.			
		(c) Dynamic balancing of the rotor to be carried out so to achieve the vibration level as per ISO 10816-7 category II . -Insitu acceptance test-4.2 mm/s(RMS) at motor DE and NDE. -Factory acceptance test- 5.1 mm/s(RMS) at motor DE and NDE.			
		(d) Pump casing and discharge pipe shall be subjected to hydraulic pressure test at 2 times the working pressure or 1.5 times the pump shut-off head whichever higher. Pump impeller shall be subjected to suitable NDT method like MPI/ DPT for surface defect examination. The pressure test shall be carried out with original bolts. Duration of hydraulic test shall be 30 minutes. The testing should be carried out at manufacturer's works in the presence of BHEL's / customer representative.			
		(e) Performance test shall be carried out with respective unit motor i.e. each pump shall be tested with its motor only. However, in case of D.C. motor the performance test may be carried out with test bed motor. Performance test shall include verification of pump characteristics e.g. discharge Vs pressure, power consumption, efficiency, vibration and noise level etc.			
दिनांक एवं हस्ताक्षर SIGN & DATE 25/2/12		REV, NO. 08		निर्माणकर्ता WORKED BY H. GUPTA	
समूची सूची संख्या INVENTORY NO P-5539		SUPERSEDES		जांचकर्ता CHECKED BY ANUJ JAIN	
				13/02/12	
				13/2/12	

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD		ST38013 पृष्ठ 10 का 4 Page 4 of 10	
SUPERSEDES INVENTORY NO. सारणी सूची संख्या को अधिगणित करता	These tests should be conducted as per DIN1944 class III or equivalent in the presence of BHEL/customer. The characteristics have to be certified by BHEL/customer representative. (f) Strip down examination to check the condition of bearing, mechanical clearances, axial play of the shaft etc. (g) Check the condition of the oil seals and any seepage of oil through the seals.				
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	2.5.3 After testing the pump, all the surfaces and internals shall be thoroughly cleaned, dried and conserved. All metallic surfaces except bright parts exposed to weather shall be given a suitable priming coat and then two coats of approved paints. Ensure assembly of all the components of pump as one unit and pack in water and dust proof package. The packages should be sufficiently strong to safeguard against any damage during transit and is safe for two years in a very damp atmosphere. 2.5.4 Test certificates indicating the test results of material testing NDT, dynamic balancing, hydraulic test, performance test, strip down examination etc. shall be furnished. 2.5.5 Blue matching between motor base and pump base plate to be carried out if required. 3.0 <u>PREAPPROVAL DOCUMENTS AT THE TIME OF OFFER</u>				
स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत भारती इंस्टीट्यूट ऑफ़ मैनेजमेंट के द्वारा प्रदान की गई है। इस दस्तावेज को बिना लिखित अनुमति के किसी भी तरह प्रयोग, प्रकाशित, प्रसारित, या किसी भी रूप में प्रतिलिपि बनाना या अन्यथा इस दस्तावेज के उपयोग के लिए न किया जाए।	3.1 Assembly drawing with parts lists. Nozzle sizes and their coordinates base plate details and cross sectional arrangement along with static and dynamical loading. 3.2 Calculation with necessary drawings (Torque / speed characteristics etc.) power requirement. 3.3 All welding shall be carried by qualified welder as per ASME sec.IX. 3.4 Examination of the pre-approval documents by BHEL shall not release the manufacturing and his subcontractors, of their responsibilities. The approval documents shall form the basis for the order. No changes shall be made without approval from BHEL. 3.5 Quality plan, detailing out various stages of manufacturer along with relevant documents standards, acceptance levels, inspection document raised.				
सारणी सूची संख्या INVENTORY NO. P-5539	REV. NO. 08	SUPERSEDES	निर्माणकर्ता WORKED BY	H.GUPTA 	13/02/12
			जांचकर्ता CHECKED BY	A. JAIN 	13/2/12

दिनांक एवं हस्ताक्षर SIGN & DATE				उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD		ST38013	
शीतली सूची संख्या INVENTORY NO. P-5539		SUPERSEDES INVENTORY NO.		पृष्ठ 10 का 5 Page 5 of 10			
शीतली सूची संख्या को अधिकतम अठ्ठा		4.0 DOCUMENTS TO BE SUPPLIED AFTER THE PLACEMENT OF ORDER These shall be supplied in 10 copies each or two copies and a set of reproducible.					
COPYRIGHT AND CONFIDENTIAL. The information on this document is the property of Bharat Heavy Electricals Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		4.1 Contractual drawings : 8 weeks					
		4.2 Overhaul and spare parts lists : 8 weeks					
		4.3 Equipment description : 8 weeks					
		4.4 O & M manual (10 hard copy + 2CD) : 12 weeks					
		4.5 Record of test on noise levels before dispatch					
		4.6 Record of test to DIN 1944-III or equivalent : Before dispatch or equivalent.					
		4.7 List of tools and tackles : 8 weeks					
		4.8 The static/ dynamic loading details on support/ foundation should be furnished : 8 weeks					
		5.0 NAME PLATE IDENTIFICATION MARKING SHOULD BE AS FOLLOWS The rating plate is to be made of X12 or Ni188 and plates should be provided in Hindi and English both.					
		स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की संपत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कर्तव्य के हित में सार्वजनिक हो न किया जाए।		5.1 Type/ Designation.			
5.2 Manufacturer.							
5.3 Manufacturer's works No.							
5.4 Year of manufacturing.							
5.5 Purchaser's order No.							
5.6 Volumetric flow (l / m)							
5.7 Discharge pressure (Bar/MWC)							
5.8 Operating temp (In degree C)							
5.9 Flow medium.							
5.10 Speed.							
दिनांक एवं हस्ताक्षर SIGN & DATE 5/2/11		REV. NO. 08		निर्माणकर्ता WORKED BY H.GUPTA			
शीतली सूची संख्या INVENTORY NO. P-5539				जांचकर्ता CHECKED BY A. JAIN			

निर्माण एवं संस्थापना SIGN & DATE				उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD		ST38013 पृष्ठ 10 का 6 Page 6 of 10	
रजिस्ट्री नं. 1000 INVENTORY NO		6.0 CLEANING & PAINTING, CONSERVATION, PACKING The surface shall be thoroughly cleaned of all mill scales, oxide and other coatings. The protective coating should be oil resistant to prevent contamination of oil specified and to prevent the deterioration of the coating itself. All surfaces, which will not be easily accessible after the shop assembly shall before hand be treated and protected for life of the equipment. Instructions should be issued regarding reconsevation, deconsevation and storage of package. Contractor shall be responsible for all loss or damage during transportation, handling and storage due to improper packing.					
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		6.1 In the packing list, dispatchable unit, BHEL P.O. number, Project name should be mentioned. 6.2 O&M manual should be mentioned in the packing list. 6.3 A check list should be prepared with a column for tick marking, so that check list convert to an erection/commissioning reports. This check list should be part of O&M manual. 6.4 Lock washers shall be supply with all fasteners 7.0 GENERAL The tenderer can make suitable offers even if there are minor deviations which do not effect the efficient functioning of the equipment. However the deviations must be clearly spelt out. Supplier shall also fill in the blank data sheet as per Annexure-I and submit the same along with the offer. The offer may not be considered if all the technical particulars and information called for in the specifications are not submitted along with the offer.					
स्वतन्त्राधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत भारती इंजीनियरिंग लिमिटेड की संपत्ति है। इसका प्रयोग या अप्रत्यक्ष रूप से किसी भी तरह का प्रयोग, जो कि कंपनी के हित में हानिकारक हो, न किया जाए।		8.0 GUARANTEE 8.1 The supplier shall guarantee trouble free and satisfactory operation of the equipment for a period of 12 months after the installation and commissioning or for a period of 18 months from the day the equipment leaves the supplier's works. 8.2 The supplier shall guarantee the capacity, head and efficiency of the pump as per the tested characteristics with oil. 8.3 If during erection at site any deficiency in a part is detected, BHEL site representative to shall prepare the assessment report and a copy of the same shall be forwarded the supplier. The supplier shall replace/ rectify the concerned items free of charge within a week time after receipt of assessment report. The supplier if he so desire, may depute his representatives to site at his own cost otherwise the findings of BHEL representative shall be final and binding on the supplier of pumping set. 8.4 The supplier shall repair/replace the defective parts at his own cost during the guarantee period. 8.5 The supplier shall guarantee vibrations at site as per clause 2.5.2 (C) of the specification.					
निर्माण एवं संस्थापना SIGN & DATE		9.0 SPARES The supplier shall quote item wise price of recommended spares for 3 years and 5 years operation respectively.					
रजिस्ट्री नं. 1000 INVENTORY NO P-5539		REV. NO. 08		SUPERSEDES		निर्माणकर्ता WORKED BY H.GUPTA  13/12/12	
रजिस्ट्री नं. 1000 INVENTORY NO P-5539		REV. NO. 08		SUPERSEDES		जांचकर्ता CHECKED BY A. JAIN  13/12/12	



उत्पाद मानक

ST38013

STEAM TURBINE ENGINEERING
PRODUCT STANDARD

पृष्ठ 10 का 7
Page 7 Of 10

ANNEXURE-I
DATA TO BE FURNISHED BY BIDDER
ALONG WITH BID FOR OIL PUMP

1.0 EQUIPMENT AND SERVICE OFFERED

Please state whether the following equipment service as specified in the data sheet are offered or not

- | | | |
|-----|--|---------|
| 1.1 | Pump as per specification | Yes/ No |
| 1.2 | Motor / Make | Yes/ No |
| 1.3 | Necessary instruments,
Test connections | Yes/ No |
| 1.4 | Base plate as per drg | Yes/ No |
| 1.5 | Companion flanges | Yes/ No |
| 1.6 | Spare parts | Yes/ No |
| 1.7 | Maintenance and special
erection tools | Yes/ No |
| 1.8 | Commissioning of the set | Yes/ No |

2.0 DESIGN AND PERFORMANCE

- | | | |
|-----|---|--------------------|
| 2.1 | Rated capacity of each pump | M ³ /hr |
| 2.2 | Discharge head at rated capacity | |
| 2.3 | Maximum discharge | |
| 2.4 | Minimum discharge pressure
corresponding to maximum flow | |

REV NO 08

निर्माकता

WORKED BY

D.PAL

जांचकर्ता

CHECKED BY

A. JAIN

16/06/06

16/6/06

2.5 Shut off head

2.6 Performance guarantee when installed as per given arrangement.

Yes/No

2.6 Pump B.H.P./KW at rated capacity

27 Maximum allowable suction lift
(for minimum NPSH REQUIRED)

29 Efficiency

3.0 MATERIAL OF CONSTRUCTION

3.1 Casing

3.2 Impeller

33 Base plate.

3.4 Wearing rings

3.5 Shaft

3 6 Stuffing box

3.7 Packing

3.8 Mechanical seal

4.() CONNECTION

41 Suction size

4.2 Discharge size

5.0 DRAWINGS

5.1 General arrangement and sectional drawings enclosed with offer

Yes/No

COPYRIGHT AND CONFIDENTIAL
The information on this document is the property of Stuart Heavy Electrical
Company. It must not be used directly or indirectly in any way detrimental to the
interest of the company.

अवतारधिकार एवं गौडनीय

[illegible]

Myth 11

निर्माणकर्ता

WORKED BY

गोपनीय

CHUNG-KUO CHYI

D PAL

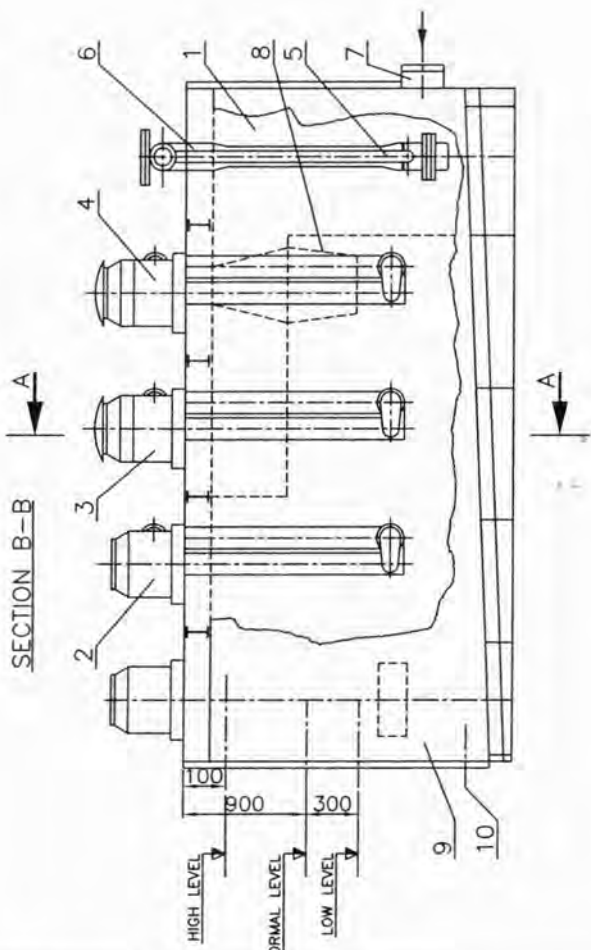
A. JAIN

REV NO. 08

16	106	102
----	-----	-----

16/6/06

SIGN & DATE				उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD		ST38013	
SUPERSEDES INVENTORY NO						पृष्ठ 10 का 9 Page 9 of 10	
संपत्ति सूची संख्या को अधिलेखित करना							
COPYRIGHT AND CONFIDENTIAL. The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.							
स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की संपत्ति है इसका प्रयोग एवं प्रकाशना के बिना की जा सकती है, जो कि कंपनी के हित में जातिविकारक हो न किया जाए।							
6.0 <u>WEIGHT SCHEDULE</u> 6.1 Weight of pump. 6.2 Weight of motor. 6.3 Weight of pump with motor and base frame. 7.0 <u>CHARACTERISTIC CURVES</u> 7.1 Power consumption / discharge flow. 7.2 Discharge quantity / Pressure. 7.3 Discharge / efficiency. 8.0 <u>CONSTRUCTION FEATURES</u> 8.1 Type of pumps. 8.2 No. of stages. 8.3 Type of impeller. 8.4 Type of stuffing box sealing offered. 8.5 Type of coupling offered. 8.6 Type of bearing and lubrication. 8.7 Impeller diameter. 9.0 Any deviation taken against specifications. Yes/No 10.0 Deviation taken as mentioned here. 11.0 Cross referred Standards: Nil							
REV. NO. 08		SUPERSEDES		निर्माणकर्ता WORKED BY H.GUPTA		13/02/12	
INVENTORY NO. P-5539				जांचकर्ता CHECKED BY A. JAIN		13/2/12	

उत्पाद मानक PRODUCT STANDARD STEAM TURBINE ENGINEERING		ST38013 पृष्ठ 10 का 10 Page 10 of 10	
स्वाधिकार एवं गोपनीय इस प्रतिका में दी गई सुचना भारत की इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए ।		हस्ताक्षर एवं दिनांक SIGN & DATE 5/12/12	
समर्पित एवं संख्या को अधिकारिता करता है SUPERSEDES INVENTORY		निर्माण एवं हस्ताक्षर SIGN & DATE	
SECTION B-B  1. TANK. 2. D.C. BEARING OIL PUMP. 3. A.C. AUXILIARY OIL PUMP. 4. A.C. AUXILIARY STAND BY OIL PUMP. 5. INJECTION PIPE. 6. SUCTION PIPE (INJECTOR). 7. INLET. 8. STRAINER. 9. PARTITION. 10. DRAIN. OIL TANK ARRANGEMENT DRG. NO. STE-TL-001			
REV. NO. 08		निर्माणकर्ता WORKED BY H.GUPTA	
समर्पित एवं संख्या को अधिकारिता करता है INVENTORY NO. P-5539		जांचकर्ता CHECKED BY A.JAIN	
SUPERSEDES		13/02/12 13/2/12	



उत्पाद मानक

ST- 39014

पृष्ठ 6 का 1

PRODUCT STANDARD
(STEAM TURBINE ENGINEERING)

Page 1 of 6

**TECHNICAL SPECIFICATION FOR
AUXILIARY OIL PUMP SET
(CENTRIFUGAL PUMP)**

1.0 INTENT OF SPECIFICATION:-

THIS SPECIFICATION IS INTENDED TO COVER DESIGN, MANUFACTURE, ASSEMBLY, TESTING AND DELIVERY OF PUMP SET COMPLETE WITH BASE PLATE, LIFTING LUGS, COUPLING, MOTOR AND OTHER ACCESSORIES IF FELT NECESSARY BY SUPPLIER.

THE PUMPING SETS ARE INTENDED FOR OPERATION IN CONJUNCTION WITH STEAM TURBINES AND SHOULD BE SUITABLE FOR CONTINUOUS OPERATION AT AN AMBIENT TEMPERATURE OF 50°C + AVERAGE HUMIDITY 90% AND MAXIMUM HUMIDITY 100%.

2.0 FUNCTION:-

A.O.P. COMES IN OPERATION WHEN THE TURBINE IS INITIALLY STARTED AND WHENEVER PRESSURE IN THE LINE IS BELOW SET POINT, GOVERNING SYSTEM IS TO BE CHARGED AND LUBE OIL SUPPLY IS NEEDED FOR THE BEARING. THESE ARE TWO IN QUANTITY / SET. ONE PUMP IS KEPT AS STANDBY PUMP.

3.0 APPLICABLE CODE/STANDARD:- IS:4722, IS:325, IS:2253, IS:2254, IS:3202, IS:4029.

4.0 OIL SPECIFICATION:-

THE OIL TO BE HANDLED BY THE PUMP IS SERVOPRIME-46 OR IOC 46 OF IOC BRAND AND TURBINOL-47 OF M/S HINDUSTAN PETROLEUM CORPORATION LTD. (ISO VG 46).

KINEMATIC VISCOSITY AT 65°C/20°C	: 16 cs/100 cs
SPECIFIC GRAVITY AT 65°C	: 0.8488
FLASH POINT	: 200°C (min.)
OPERATIONAL TEMPERATURE	: 65°C
POUR POINT	: -6.6°C (max.)

हस्ताक्षर एवं दिनांक SIGN & DATE	नाम NAME	दिनांक एवं हस्ताक्षर SIGNATURE & DATE
	अनुवादक TRANSLATED BY	-
TSX	निर्माणकर्ता WORKED BY	DHARAMPAL
QAX	जांचकर्ता CHECKED BY	ANUJ JAIN
सहमत विभाग AGREED DEPTT.	पर्यवेक्षणकर्ता SUPERVISED BY	S.C.AGRAWAL
नाम NAME	दिनांक एवं हस्ताक्षर DATE & SIGNATURE	
	स्वीकृति APPROVED : (A.K.JAIN) AGM	
REV.NO. 09	निर्माण PREPARED : STE	द्वारा ISSUED : TSX
DL 08-11-11		दिनांक : DATE : 03-08-84



उत्पाद मानक

ST39014

PRODUCT STANDARD

STEAM TURBINE ENGINEERING

पृष्ठ 06 का 02

Page 02 of 06

5.0 PUMP SPECIFICATION:-

5.1 IDENTIFICATION NO. TO BE MENTIONED ON NAME PLATE MAV22AP001 AND MAV23AP001.

5.2 DESIGN TEMPERATURE = 100°C
OPERATING TEMPERATURE = 65°C
NORMAL SUCTION PRESSURE = 0.05 Bar
MINIMUM SUCTION PRESSURE = 0.025 Bar

VARIANT NUMBER	NORMAL DISCHARGE CAPACITY (Liter/Min)	NORMAL DISCHARGE PRESSURE (Bar)	MAXIMUM DISCHARGE CAPACITY (Liter/Min)	MAXIMUM DISCHARGE PRESSURE (Bar)
VAR. 1	2544	7.0	4700	6.6
VAR. 2	3248	6.1	4560	5.8
VAR. 3	2820	6.6	5355	6.2
VAR. 4	3240	7.4	5460	6.6
VAR. 5	3060	7.3	6600	7.1
VAR. 6	2544	8.0	4700	6.6
VAR. 7	2356	7.4	3204	6.9
VAR. 8	2905	8.2	5177	6.6
VAR. 9	1930	7.5	-	-
VAR. 10	2880	6.7	6016	6.3
VAR. 11	3060	7.3	6600	7.1
VAR. 12	3180	8.2	5400	6.6
VAR. 13	1852	8.0	4649	7.0
VAR. 14	2392	8.3	2767	8.0
VAR. 15	2774	8.4	5144	8.0
VAR. 16	1656	8.5	1919	8.0
VAR. 17	2210	8.0	3765	6.6
VAR. 18	3040	6.7	6900	6.3
VAR. 19	2400	8.2	-	-
VAR. 20	2355	8.3	4065	8.0

5.3 DURING INITIAL STARTUP IN WINTER OIL TEMPERATURE MAY GO AS BELOW AS 20°C. THE CAPACITY OF MOTOR SHALL BE AS INDICATED IN CLAUSE NO. 7.3 OF THIS SPECIFICATION.

5.4 PUMP WITH DROOPING CHARACTERISTIC SHALL NOT BE ACCEPTABLE.

5.5 PUMP SHALL BE SUITABLE FOR MOUNTING VERTICALLY ON THE OIL TANK & PUMP BED PLATE SHALL MATCH THE COUNTER FLANGE PROVIDED ON THE TANK AS PER SKETCH ON SHEET NO. 6.

5.6 PUMP SUPPLIER SHALL FURNISH THE PERMISSIBLE TIME FOR THE OPERATION OF PUMP AT SHUT OFF LOAD.

6.0 MOTOR:-

A SUITABLE MOTOR CONFORMING TO THE PUMP REQUIREMENT SHALL BE SUPPLIED. THE MOTOR SHALL ALSO MEET THE FOLLOWING REQUIREMENTS BROADLY. THE MOTOR SHALL CONFIRM TO IS:4722, IS:325, IS:2253, IS:2254, IS:4029 & IS:3202 OR EQUIVALENT BS: SPECIFICATIONS. THE MOTOR SHALL MEET ALL INDIAN STATUTORY REQUIREMENTS.

6.1 APPLICATION:-

TO DRIVE OIL PUMP FOR SUPPLYING OIL TO BEARING & GOVERNING ELEMENTS.

6.2 TYPE OF MOTOR:-

SQUIRREL CAGE, INDUCTION MOTOR.

6.3 KW RATING OF THE MOTOR SHOULD BE THE MAXIMUM OF THE FOLLOWING THREE CONDITIONS:

6.3.1 IT SHALL HAVE ATLEAST 15% RESERVE CAPACITY THAN REQUIRED TO DRIVE THE PUMP WHEN IT IS DISCHARGING MAXIMUM QUANTITY AT A VISCOSITY CORRESPONDING TO 50°C TEMPERATURE.

6.3.2 IT SHALL HAVE ATLEAST 5% RESERVE CAPACITY THAN REQUIRED TO DRIVE THE PUMP WHEN IT IS DISCHARGING MAXIMUM QUANTITY AT A VISCOSITY CORRESPONDING TO 35°C TEMPERATURE.

6.3.3 IT SHALL HAVE AT LEAST 5% RESERVE CAPACITY THAN REQUIRED TO DRIVE THE PUMP WHEN IT IS DISCHARGING 70% OF MAXIMUM QUANTITY AT A VISCOSITY CORRESPONDING TO 20° TEMPERATURE. FINALLY SUPPLIER SHALL FURNISH THE KW RATING AT AN AMBIENT TEMPERATURE OF 50°C.

COPYRIGHT AND CONFIDENTIAL

The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.

स्वत्वाधिकार एवं गोपनीय

इस दस्तावेज में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी की हित में हानिकारक हो न किया जाए।

हस्ताक्षर एवं दिनांक
SIGN & DATE

सामग्री सूची संख्या
INVENTORY NO.

REV. NO.

09

SUPERSEDES

निर्माणकर्ता
WORKED BY

H.GUPTA

जांचकर्ता
CHECKED BY

A.JAIN



Hgupta

AJain

13/12/12

13/12/12

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD STEAM TURBINE ENGINEERING		ST39014 पृष्ठ 06 का 03 Page 03 of 06	
सुपरसेड्स INVENTORY		6.4 KW ACTUALLY REQUIRED BY DRIVEN EQUIPMENT : PUMP CAPACITY UNDER SPECIFIED OPERATION/STARTUP CONDITIONS. 6.5 RATED VOTAGE : 415V FREQUENCY : 50 Hz 6.6 PERMISSIBLE VOLTAGE AND FREQUENCY : $\pm 10\%$ VOLT. VARIATION UNDER NORMAL RUNNING : $\pm 5\%$ FREQUENCY CONDITIONS. 6.7 COMBINED VARIATION : 10% (SUM OF ABSOLUTE VALUES) 6.8 MINIMUM VOLTAGE REQUIRED UNDER STARTING : 80% RATED CONDITION TO BRING DRIVEN EQUIPEMENT UPTO RATED SPEED. 6.9 NO. OF PHASES : 3 ϕ 6.10 TYPE OF DUTY : CONTINUOUS 6.11 FULL LOAD SPEED : IT SHALL BE COMMENSURATE WITH PUMP SPEED AS PER DESIGN. 6.12 FULL LOAD CURRENT : AS PER DESIGN. 6.13 STARTING CURRENT : NOT TO EXCEED 600% OF RATED CURRENT (EXCLUSIVE OF IS TOLERANCES) 6.14 STARTING TORQUE : 1.3 (MIN.) OF RATED TORQUE. 6.15 BREAK DOWN TORQUE : 2.05 TIMES (MIN.) OF RATED VALUE. 6.16 EFFICIENCY AT FULL LOAD : 90% (MIN.) 6.17 POWER FACTOR AT FULL LOAD : 0.85% MINIMUM 6.18 MOTOR SHALL BE DESIGNED TO WITH STAND THE VOLTAGE AND TORQUE STRESSES DEVELOPED DUE TO THE DIFFERENCE BETWEEN THE MOTOR RESIDUAL VOLTAGE AND INCOMING SUPPLY VOLTAGE EQUAL TO 150% OF THE RATED MOTOR VOLTAGE DURING FAST CHANGEOVER OF BUSES.			
COPYRIGHT AND CONFIDENTIAL. The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company		7.0 <u>STARTING DATA OF MOTOR:</u> 7.1 STARTING : SUITABLE FOR DOL STARTING. 7.2 ACCELERATION TIME WITH FULL LOAD : 3.5 $\pm$ 0.5 SECS. CONNECTED. 7.3 LOCKED ROTOR WITHSTAND TIME UNDER HOT CONDITION AT RATED VOLTAGE SHALL BE AT LEAST 2.5 SEC. MORE THAN STARTING TIME. 7.4 PERMISSIBLE STARTING DUTY CYCLE : 3 STARTS EQUALLY SPREAD OVER NO. OF STARTS. HOUR AND 2 CONSECUTIVE STARTS FROM HOT CONDITION WITHOUT ANY INJURIOUS HEATING TO THE WINDING. 7.5 OVER LOAD (% OF FULL LOAD) THAT : MOTOR SHALL BE CAPABLE OF CAN BE CARRIED BY THE MOTOR WITHOUT RUNNING AT FULL LOAD AT 80% OF IMPAIRING, OVERALL PERFORMANCE AND PERIOD FOR WHICH THIS OVERLOAD IS APPLICABLE. RATED VOLTAGE FOR FIVE MINUTES AND 70% OF RATED VOLTAGE FOR 1 SEC. 7.6 LOCATION : INDOOR 7.7 CLASS OF INSULATION : CLASS-F, FUNGUS RESISTANT, TROPICALISED AS PER IS:3202 WITH TEMP. RISE LIMITED TO THAT OF CLASS B.			
स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।		REV. NO. 09 SUPERSEDES			
दिनांक SIGN & DATE 25/12/11		निर्माणकर्ता WORKED BY H.GUPTA		जांचकर्ता CHECKED BY A.JAIN	
दिनांक एवं हस्ताक्षर SIGN & DATE 25/12/11		निर्माणकर्ता WORKED BY H.GUPTA		जांचकर्ता CHECKED BY A.JAIN	

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD STEAM TURBINE ENGINEERING	ST39014 पृष्ठ 06 का 05 Page 05 of 06			
सुपरसेड इन्वेंटरी SUPERSEDES INVENTORY	(a) DEGREE OF PROTECTION TEST TO CONFORM TO THE SPECIFIED DEGREE OF PROTECTION. (b) MEASUREMENT OF NOISE LEVEL AS PER IS: 12065. MOTOR NOISE LEVEL SHALL BE LIMITED SO AS TO ACHIEVE COMBINED PUMP MOTOR NOISE LEVEL AS PER CLAUSE 1.4 OF ST38013. <u>ADDITIONAL ROUTINE TESTS:</u> (a) 20% OVERSPEED TEST FOR 2 MINUTES. (b) MEASUREMENT OF VIBRATION AS PER IS: 12075.					
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	10.0 DOCUMENTS TO BE SUPPLIED WITH OFFER OF MOTOR:- THE OFFER SHOULD BE ACCOMPANIED WITH FOLLOWING DOCUMENTS IN TWO COPIES. THE OFFER WILL NOT BE CONSIDERED IF ALL THESE DOCUMENTS ARE NOT SUPPLIED. 10.1 CHARACTERISTICS AT 80%, 100% AND 110% VOLTAGES. 10.1.1 STARTING CURRENT V/S TIME. 10.1.2 TORQUE V/S SLIP. 10.1.3 THERMAL WITHSTAND CHARACTERISTIC FOR HOT AND COLD CONDITION. 10.2 TYPE AND FRAME SIZE. 10.3 <u>STARTING TIME</u> 10.3.1 WITH 100% VOLTAGE AT TERMINAL. 10.3.2 WITH 80 % VOLTAGE AT TERMINAL. 10.4 SAFE STALL TIME AT 110% VOLTAGE UNDER HOT CONDITION. 10.5 POWER (Kw) RATING CALCULATION W.R.T. PUMP REQUIREMENT. 10.6 EXPECTED LIFE OF BEARING.					
स्वत्वाधिकार एवं गोपनीय इस प्रत्यक्ष में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है। इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।	11.0 <u>DOCUMENTS TO BE FURNISHED WITHIN FOUR WEEKS OF PLACEMENT OF ORDER OF MOTOR (FOR BHEL OR THEIR CUSTOMER'S APPROVAL):-</u> 11.1 SIX HARD COPIES AND ONE SOFT COPY (IN PDF FORMAT) OF MOTOR DATA SHEET AND G.A. DRAWING. 11.2 DRAWING SHOWING TERMINAL DETAIL OF ALL TERMINALS AND LOCATION AND DIMENSION OF TERMINAL BOXES. 11.3 ROTOR WEIGHT AND TOTAL MOTOR WEIGHT. 11.4 CHARACTERISTIC CURVES OF THE MOTOR. 12.0 SIX COPIES OF TESTS CARRIED OUT AS PER CLAUSE NO. 9.0 ON EACH MOTOR SHALL BE FURNISHED TO BHEL FOR SCRUTINY AND APPROVAL. ONLY ON ACCEPTANCE FROM BHEL SIDE, MOTOR CAN BE CONSIDERED SUITABLE FOR DISPATCH.					
हस्ताक्षर एवं दिनांक SIGN & DATE 25/12/11	13.0 FOR TECHNICAL DELIVERY CONDITION AND GENERAL FEATURES OF PUMP, PLEASE REFER ST38013. 14.0 <u>CROSS REFERRED STANDARDS:</u> IS:325, IS:4722, IS:2253, IS:2254, IS:3202, IS:4029, IS:12065, IS:12075, ST38013.					
श्रमपत्री सूची संख्या INVENTORY NO. P-554-1	REV. NO. 09	SUPERSEDES	निर्माणकर्ता WORKED BY जांचकर्ता CHECKED BY	H.GUPTA A.JAIN	 	02/12/11 2/12/11


निर्माक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD STEAM TURBINE ENGINEERING		ST39014 पृष्ठ 06 का 06 Page 06 of 06	
सामग्री सूची संख्या को अधिकृतित करना है SUPERSEDES INVENTORY		सामग्री सूची संख्या को अधिकृतित करना है SUPERSEDES INVENTORY			
COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited It must not be used directly or indirectly in any way detrimental to the interest of the company		COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited It must not be used directly or indirectly in any way detrimental to the interest of the company			
स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।		स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।			
हस्ताक्षर एवं तिनांक SIGN & DATE 8/11/11		हस्ताक्षर एवं तिनांक SIGN & DATE 8/11/11			
सामग्री सूची संख्या INVENTORY NO P-5541		सामग्री सूची संख्या INVENTORY NO P-5541			
REV. NO. 09		SUPERSEDES		निर्माणकर्ता WORKED BY H.GUPTA	
				जांचकर्ता CHECKED BY A.JAIN	

Technical drawing of a rectangular plate with dimensions and hole locations. The plate has a width of 900.0±0.3 and a height of 1500.0±0.3. It features 32 THROUGH HOLES Ø18 arranged in a grid. The drawing includes various dimension lines and values for hole positions and plate size.

Dimensions and Hole Locations:

- Overall Width: 900.0±0.3
- Overall Height: 1500.0±0.3
- Inner Width: 700±0.3
- Inner Height: 1300±0.3
- Top Margin: 1400±0.3
- Bottom Margin: 1450.0±0.3
- Left Margin: 72.7±0.3
- Right Margin: 50.0±0.3
- Hole Spacing (Horizontal): 198.5±0.3, 324.2±0.3, 450.0±0.3, 575.7±0.3, 701.5±0.3, 827.2±0.3
- Hole Spacing (Vertical): 190±0.3, 330.0±0.3, 470.0±0.3, 610.0±0.3, 750.0±0.3, 890.0±0.3, 1030.0±0.3, 1170.0±0.3, 1310.0±0.3

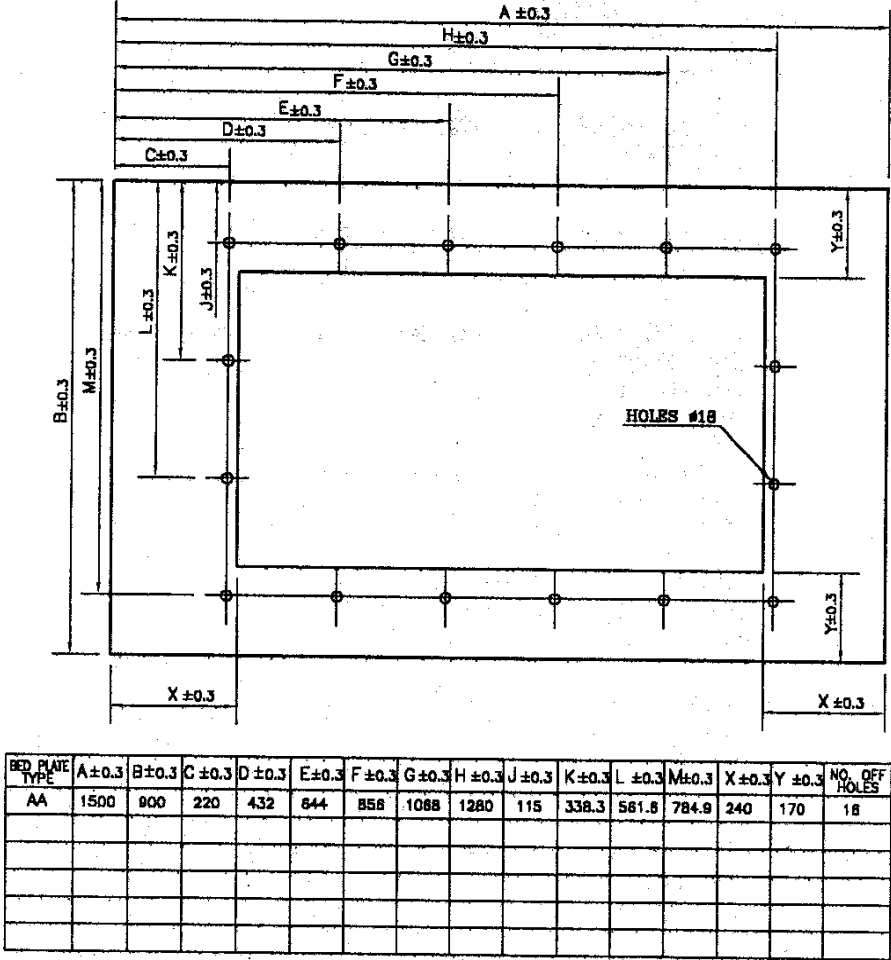
SIGNATURE & DATE 21/08/06	INVENTORY NO. P-5540	स्वत्वधिकार एवं गोपनीय इस दस्तावेज में की गई सूचना भारत देश की इलेक्ट्रिकल की संपत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी की परीक्षा प्रयोग, जो कि कंपनी के हित में हुआ करता है न किया जाए	COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electricals Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company	SUPERSEDES INVENTORY NO.	SIGNATURE & DATE 21/08/06	उत्पाद मानक PRODUCT STANDARD (STEAM TURBINE ENGINEERING)	ST-39015 पृष्ठ 6 का 1 Page 1 of 6
						TECHNICAL SPECIFICATION FOR EMERGENCY OIL PUMP SET (CENTRIFUGAL PUMP)	1.0 INTENT OF SPECIFICATION:- THIS SPECIFICATION IS INTENDED TO COVER DESIGN, MANUFACTURE, ASSEMBLY, TESTING AND SUPPLY OF PUMP SETS COMPLETE WITH BASE PLATE, LIFTING LUGS, COUPLING, MOTOR WITH STARTING RESISTANCE AND OTHER ACCESSORIES IF FELT NECESSARY BY THE SUPPLIER. THE PUMPING SETS ARE INTENDED FOR OPERATION IN CONJUNCTION WITH STEAM TURBINES AND SHOULD BE SUITABLE FOR CONTINUOUS OPERATION AT AN AMBIENT TEMPERATURE 50°C & AVERAGE HUMIDITY 90% AND MAXIMUM HUMIDITY 100%. 2.0 FUNCTION:- WHEN THERE IS AC POWER FAILURE, THIS PUMP COMES IN OPERATION WITH DC POWER SUPPLY. MAINLY THE FUNCTION OF THIS PUMP IS TO SUPPLY OIL TO BEARINGS SO AS TO SAVE THESE FROM STARVATION DURING EMERGENCY. THIS IS ONE IN QUANTITY/SET. 3.0 APPLICABLE CODE/STANDARD:- IS:2253, IS:2254, IS:3202, IS:4691, IS:4722 AND IS:4729. 4.0 OIL SPECIFICATION:- THE OIL TO BE HANDELED BY THE PUMP IS SERVOPRIME-46 OR IOC-46 OF IOC BRAND AND TURBINOL-47 OF M/S HINDUSTAN PETROLEUM CORPORATION LTD. (ISO VG-46). KINEMATIC VISCOSITY AT 65°C/20°C : 16 cs/100 cs SPECIFIC GRAVITY AT 65°C : 0.8488 FLASH POINT : 200°C (min.) OPERATIONAL TEMPERATURE : 65°C POUR POINT : -6.6°C (max.)
नाम NAME विनाक एवं हस्ताक्षर SIGNATURE & DATE						अनुवादक TRANSLATED BY	
निर्माणकर्ता WORKED BY DHARAMPAL						14/08/06	
जांचकर्ता CHECKED BY ANUJ JAIN						14/08/06	
पर्यवेक्षणकर्ता SUPERVISED BY S.C. AGRAWAL						28/06/06	
स्वीकृति APPROVED : (A.K.JAIN) AGM						21.08.06	
निर्माण PREPARED : STE (TL/TA)						जारी ISSUED : TSX	
दिनांक DATE : 03-08-84							

SIGN & DATE 	उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD		ST39015																			
			पृष्ठ 6 का 2 Page 2 of 6																			
SUPERSEDES INVENTORY NO ग्राहक सूची संख्या Customer No.	5.0 <u>PUMP SPECIFICATION:-</u> 5.1 IDENTIFICATION NO. TO BE MENTIONED ON NAME PLATE MAV24AP001 5.2 <u>TYPE</u> <u>CENTRIFUGAL TYPE</u> DESIGN TEMPERATURE = 100°C OPERATING TEMPERATURE = 65°C NORMAL SUCTION PRESSURE = 0.05 Bar MINIMUM SUCTION PRESSURE = 0.025 Bar																					
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	<table border="1"> <thead> <tr> <th>VARIANT NUMBER</th> <th>NORMAL DISCHARGE CAPACITY (Litre/Min.)</th> <th>NORMAL DISCHARGE PRESSURE (Bar)</th> </tr> </thead> <tbody> <tr> <td>VAR. 1</td> <td>1800.00</td> <td>2.3</td> </tr> <tr> <td>VAR. 2</td> <td>1920.00</td> <td>1.7</td> </tr> <tr> <td>VAR. 3</td> <td>1200.00</td> <td>2.0</td> </tr> <tr> <td>VAR. 4</td> <td></td> <td></td> </tr> <tr> <td>VAR. 5</td> <td></td> <td></td> </tr> </tbody> </table>				VARIANT NUMBER	NORMAL DISCHARGE CAPACITY (Litre/Min.)	NORMAL DISCHARGE PRESSURE (Bar)	VAR. 1	1800.00	2.3	VAR. 2	1920.00	1.7	VAR. 3	1200.00	2.0	VAR. 4			VAR. 5		
	VARIANT NUMBER	NORMAL DISCHARGE CAPACITY (Litre/Min.)	NORMAL DISCHARGE PRESSURE (Bar)																			
VAR. 1	1800.00	2.3																				
VAR. 2	1920.00	1.7																				
VAR. 3	1200.00	2.0																				
VAR. 4																						
VAR. 5																						
स्वामित्व अधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत भारती इलेक्ट्रिकल्स लि. की संपत्ति है। इसका उपयोग केवल 2 दिनों के लिए किया जा सकता है। इसका उपयोग करने वाले को इसकी गोपनीयता के लिए भी उत्तरदायी होना चाहिए।	5.3 DURING INITIAL STARTUP IN WINTER OIL TEMPERATURE MAY GO AS BELOW AS 20°C. MOTOR SHALL BE CAPABLE OF STARTING AND CONTINUOUS RUNNING OF THE PUMPING SET AT THIS SPECIFIED VALUE OF TEMPERATURE . 5.4 PUMP WITH DROOPING CHARACTERSTIC SHALL NOT BE ACCEPTABLE. 5.5 PUMP SHALL BE SUITABLE FOR MOUNTING VERTICALLY ON THE OIL TANK AND PUMP BED PLATE SHALL MATCH THE COUNTER FLANGE PROVIDED ON THE TANK AS PER SKETCH ON SHEET NO. 6. 5.6 PUMP SUPPLIER SHALL FURNISH THE PERMISSIBLE TIME FOR THE OPERATION OF PUMP AT SHUT OFF LOAD. 6.0 <u>MOTOR:-</u> A SUITABLE MOTOR CONFORMING TO THE PUMP REQUIREMENT SHALL BE SUPPLIED. THE MOTOR SHALL ALSO MEET THE FOLLOWING SPECIFICATIONS BROADLY. THE MOTOR SHALL CONFIRM TO IS:2253, IS:2254, IS:3202 AND IS:4722 OR EQUIVALENT BS: SPECIFICATIONS. THE MOTOR SHALL MEET ALL INDIAN STATUTORY REQUIREMENTS. 6.1 <u>APPLICATION:-</u> TO DRIVE OIL PUMP FOR SUPPLYING OIL TO BEARINGS IN THE EVENT OF A.C. 6.2 <u>TYPE OF MOTOR:-</u> SEPARATELY EXCITED OR COMPOUND MOTOR WITH 10% COMPOUNDING . 6.3 <u>KW RATING:-</u> IT SHALL HAVE AT LEAST 25% RESERVE CAPACITY THAN REQUIRED TO DRIVE THE PUMP WHEN IT IS DISCHARGING MAX. QUANTITY, AT VISCOSITY CORRESPONDING TO 65°C. FINALLY SUPPLIER SHALL MENTION KW RATING AT AN AMBIENT TEMP. OF 50°C. 6.4 KW ACTUALLY REQUIRED BY DRIVE : PUMP CAPACITY EQUIPMENT UNDER SPECIFIED OPERATING AND START UP CONDITION. 6.5 RATED VOLTAGE : 220 V D.C. 220 V D.C.FIELD.																					
SIGN & DATE 	REV. NO 04																					
ग्राहक सूची संख्या INVENTORY NO P-5540	निर्माणकर्ता WORKED BY DHARAMPAL		 14/6/06																			
	जांचकर्ता CHECKED BY ANUJ JAIN		 14/6/06																			

दिनांक एवं हस्ताक्षर SIGN & DATE			उत्पाद मानक PRODUCT STANDARD (STEAM TURBINE ENGINEERING)		ST-39015 पृष्ठ 6 का 3 Page 3 Of 6	
सुपरसेडिज INVENTORY NO.		संपत्ति सूची संख्या का अतिरिक्तित्व करता है	6.6 PERMISSIBLE VOLTAGE VARIATIONS UNDER NORMAL RUNNING CONDITIONS. : -15% +10% 6.7 MINIMUM VOLTAGE REQUIRED UNDER STARTING CONDITION TO BRING DRIVEN EQUIPEMENT UPTO RATED SPEED. : 80% RATED CURRENT 6.8 TYPE OF DUTY : CONTINUOUS 6.9 FULL LOAD SPEED : IT SHALL BE COMENSURATE WITH PUMP SPEED AS PER DESIGN. 6.10 FULL LOAD CURRENT : AS PER DESIGN. 6.11 STARTING CURRENT : 3 TO 3.5 TIMES. I RATED 6.12 STARTING TORQUE : 3 TO 3.5 TIMES. TORQUE 6.13 EFFICIENCY AT FULL LOAD : 85% MINIMUM 7.0 <u>STARTING DATA</u> 7.1 <u>STARTING</u> SUITABLE FOR DIRECT ON LINE STARTING WITH A PERMANENT RESISTANCE CONNECTED IN THE ARMATURE CIRCUIT. UNDER THIS CONDITION MOTOR SHALL BE CAPABLE OF DRIVING THE PUMP AT 100% LOAD. THE MOTOR SHALL ACCELERATE TO FULL SPEED WITH FULL LOAD CONNECTED WITHIN 3±0.5 SECONDS. SUCH RESISTANCE SHALL ALSO BE INCLUDED IN THE OFFER. THE RESISTANCE SHALL BE FOR CONTINUOUS DUTY. THE RESISTANCE BOX ENCLOSURE TEMP. RISE OVER AMBIENT SHOULD NOT EXCEED 70°C AND IT IS OF FeCr-AI OR CUPRO-NICKLE TYPE SHOULD HAVE IP21 (MIN.) DEGREE OF PROTECTION. 7.2 STARTING RESISTANCE BOX/PANEL SHALL BE IN VENDOR SCOPE OF SUPPLY. 7.3 <u>PERMISSIBLE STARTING DUTY CYCLE/NO. OF STARTS:-</u> THREE STARTS SPREAD OVER AN HOUR AND TWO CONSECUTIVE STARTS FROM HOT CONDITION WITHOUT ANY INJURIOUS HEATING TO THE WINDING. 7.4 OVER LOAD (% OF FULL LOAD) THAT CAN BE CARRIED BY THE MOTOR WITHOUT IMPAIRING, OVERALL PERFORMANCE AND PERIOD FOR WHICH THIS OVERLOAD IS APPLICABLE. : 25% FOR 5 MINUTES. 7.5 LOCATION : INDOOR 7.6 CLASS OF INSULATION : CLASS-F, FUNGUS RESISITANT, TROPICALISED AS PER IS:3202 WITH TEMP. RISE LIMITED TO THAT OF CLASS B. 7.7 SHAFT DISPOSITION/MOUNTING : VERTICAL / FLANGE MOUNTED 7.8 METHOD OF CONNECTION TO DRIVEN EQUIPEMENT. : FLANGE FLEXIBLE COUPLING. 7.9 DIRECTION OF ROTATION AND CORRESPONDING TERMINAL DESIGNATION. : TO SUIT PUMP 7.10 ENCLOSURE AND VENTILATION : TOTALLY ENCLOSED FAN COOLED IP-55			
COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.						
स्वतंत्राधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत भारती इलेक्ट्रिकल्स लि. की संपत्ति है। इसका प्रयोग एवं प्रसारण बिना लिखी अनुमति के बिना कठिनीय है। इस दस्तावेज को बिना लिखी अनुमति के बिना किसी भी तहत प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए						
दिनांक एवं हस्ताक्षर SIGN & DATE	29/10/06					
संपत्ति सूची संख्या INVENTORY NO.	P-5540	REV. NO. 04		निर्माणकर्ता WORKED BY	DHARAMPAL	 14/6/06
			जांचकर्ता CHECKED BY	ANUJ JAIN	 14/6/06	

SIGN & DATE 14/06/06		उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD	ST39015	
			पृष्ठ 6 का 4 Page 4 of 6	
INVENTOR NO P-5540	REV. NO. 04	7.11 BEARING 7.12 GROUNDING DEVICE 7.13 TERMINAL CONNECTORS 7.14 CABLE FOR GROUNDING POINTS 7.15 TERMINAL BOX 8.0 SPECIAL REQUIREMENTS 8.1 THE MOTOR SHALL BE RE-WOUNDABLE. 8.2 THE MOTOR SHALL HAVE ON LINE GREASING FACILITY. 8.3 THE MOTOR CONSTRUCTION SHALL BE SUITABLE FOR EASY DIASSEMBLY AND REASSEMBLY. 8.4 THE MOTOR SHALL BE SUITABLE FOR WORKING IN AN ENVIRONMENT OF OIL FUMES WITHOUT ANY HAZARD. 8.5 THE MOTOR SHALL BE PAINTED WITH PAINT SUITABLE FOR WORKING CONDITION AND ITS COLOUR SHALL BE INTIMATED LATER ON. 9.0 TESTS AT MANUFACTURER'S WORKS: (i) MOTOR AFTER COMPLETE ASSEMBLY SHALL BE SUBJECTED TO BOTH TYPE AND ROUTINE TESTS AS PER IS:4722. TYPE TEST SHOULD NOT BE MORE THAN 5 YEARS OLD w.r.t. DATE OF ORDERING. (ii) IN ADDITION THE FOLLOWING TESTS SHALL ALSO BE CARRIED OUT. ADDITIONAL TYPE TESTS: (a) DEGREE OF PROTECTION TEST TO CONFORM TO THE SPECIFIED DEGREE OF PROTECTION. (b) MEASUREMENT OF NOISE LEVEL AS PER IS: 12065. MOTOR NOISE LEVEL SHALL BE LIMITED SO AS TO ACHIEVE COMBINED PUMP MOTOR NOISE LEVEL AS PER CLAUSE 1.4 OF ST38013.	: THRUST BEARING WITH A MINIMUM STANDARD LIFE OF NOT LESS THAN 30,000 WORKING HOURS. : SUITABLE ARRANGEMENT SHALL BE PROVIDED FOR EARTHING THE MOTOR AT TWO SEPARATE & DISTINCT CONNECTION POINTS. DESIGNATION OF EARTHING CONDUCTOR SHALL BE AS PER IS:4722-1992. : 2 FOR ARMATURE SUITABLE FOR ALUMINIUM CABLE. 2 FOR FIELD. SUITABLE FOR 2C-10 mm ALUMINIUM CABLE. : TO BE PROVIDED : TERMINAL BOX SHALL BE PROVIDED WITH DOUBLE COMPRESSION TYPE BRASS CABLE GLANDS (Nickel Chromium PLATED HEAVY DUTY, CONFIRMING TO BS:6121) AND COPPER CABLE LUGS TO MATCH OWNER'S ALUMINIUM CABLES, THE SIZE OF WHICH SHALL BE INTIMATED LATER. TERMINAL BOX SHALL BE CAPABLE OF BEING ROTATED THROUGH 180° IN STEPS OF 90°. IT SHALL HAVE A DEGREE OF PROTECTION OF IP-55.	
INVENTOR NO P-5540	REV. NO. 04	7.11 BEARING 7.12 GROUNDING DEVICE 7.13 TERMINAL CONNECTORS 7.14 CABLE FOR GROUNDING POINTS 7.15 TERMINAL BOX 8.0 SPECIAL REQUIREMENTS 8.1 THE MOTOR SHALL BE RE-WOUNDABLE. 8.2 THE MOTOR SHALL HAVE ON LINE GREASING FACILITY. 8.3 THE MOTOR CONSTRUCTION SHALL BE SUITABLE FOR EASY DIASSEMBLY AND REASSEMBLY. 8.4 THE MOTOR SHALL BE SUITABLE FOR WORKING IN AN ENVIRONMENT OF OIL FUMES WITHOUT ANY HAZARD. 8.5 THE MOTOR SHALL BE PAINTED WITH PAINT SUITABLE FOR WORKING CONDITION AND ITS COLOUR SHALL BE INTIMATED LATER ON. 9.0 TESTS AT MANUFACTURER'S WORKS: (i) MOTOR AFTER COMPLETE ASSEMBLY SHALL BE SUBJECTED TO BOTH TYPE AND ROUTINE TESTS AS PER IS:4722. TYPE TEST SHOULD NOT BE MORE THAN 5 YEARS OLD w.r.t. DATE OF ORDERING. (ii) IN ADDITION THE FOLLOWING TESTS SHALL ALSO BE CARRIED OUT. ADDITIONAL TYPE TESTS: (a) DEGREE OF PROTECTION TEST TO CONFORM TO THE SPECIFIED DEGREE OF PROTECTION. (b) MEASUREMENT OF NOISE LEVEL AS PER IS: 12065. MOTOR NOISE LEVEL SHALL BE LIMITED SO AS TO ACHIEVE COMBINED PUMP MOTOR NOISE LEVEL AS PER CLAUSE 1.4 OF ST38013.	: THRUST BEARING WITH A MINIMUM STANDARD LIFE OF NOT LESS THAN 30,000 WORKING HOURS. : SUITABLE ARRANGEMENT SHALL BE PROVIDED FOR EARTHING THE MOTOR AT TWO SEPARATE & DISTINCT CONNECTION POINTS. DESIGNATION OF EARTHING CONDUCTOR SHALL BE AS PER IS:4722-1992. : 2 FOR ARMATURE SUITABLE FOR ALUMINIUM CABLE. 2 FOR FIELD. SUITABLE FOR 2C-10 mm ALUMINIUM CABLE. : TO BE PROVIDED : TERMINAL BOX SHALL BE PROVIDED WITH DOUBLE COMPRESSION TYPE BRASS CABLE GLANDS (Nickel Chromium PLATED HEAVY DUTY, CONFIRMING TO BS:6121) AND COPPER CABLE LUGS TO MATCH OWNER'S ALUMINIUM CABLES, THE SIZE OF WHICH SHALL BE INTIMATED LATER. TERMINAL BOX SHALL BE CAPABLE OF BEING ROTATED THROUGH 180° IN STEPS OF 90°. IT SHALL HAVE A DEGREE OF PROTECTION OF IP-55.	

निर्माण की तिथि SH.N. & DATE		उत्पाद मानक STEAM TURBINE ENGINEERING PRODUCT STANDARD	ST39015	
			पृष्ठ 6 का 5 Page 5 of 6	
समझी गयी संख्या INVENTORY NO.	SUPERSEDES INVENTORY NO.	ADDITIONAL ROUTINE TESTS: (a) 20% OVERSPEED TEST FOR 2 MINUTES. (b) MEASUREMENT OF VIBRATION AS PER IS: 12075. 10.0 DOCUMENTS TO BE SUPPLIED WITH OFFER:- THE OFFER SHOULD BE ACCOMPANIED WITH FOLLOWING DOCUMENTS IN TWO COPIES. THE OFFER WILL NOT BE CONSIDERED IF ALL THESE DOCUMENTS ARE NOT SUPPLIED. 10.1 CHARACTERISTICS 10.1.1 STARTING CURRENT V/S TIME. 10.2 TYPE AND FRAME SIZE. 10.3 STARTING TIME IN SECOND. 10.3.1 WITH 100% VOLTAGE AT TERMINALS. 10.3.1 WITH 85 % VOLTAGE AT TERMINALS. 10.3.2 WITH 80 % VOLTAGE AT TERMINALS. 10.4 SAFE STALL TIME AT 100% VOLTAGE UNDER HOT CONDITIONS. 10.5 POWER (Kw) RATING CALCULATIONS W.R.T. PUMP REQUIREMENT. 10.6 EXPECTED LIFE OF BEARING. 11.0 DOCUMENTS TO BE FURNISHED WITHIN FOUR WEEKS OF PLACEMENT OF ORDER:- 11.1 SIX HARD COPIES AND ONE SOFT COPY (IN PDF FORMAT) OF MOTOR DATA SHEET AND G.A. DRAWING. 11.2 DRAWING SHOWING TERMINAL DETAIL OF ALL TERMINALS AND LOCATION AND DIMENSION OF TERMINAL BOXES. 11.3 ROTOR WEIGHT AND TOTAL MOTOR WEIGHT. 11.4 CHARACTERISTIC CURVES OF THE MOTOR. 12.0 SIX COPIES OF TESTS CARRIED OUT AS PER CLAUSE NO. 9.0 ON EACH MOTOR SHALL BE FURNISHED TO BHEL FOR SCRUTINY AND APPROVAL. ONLY ON ACCEPTANCE FROM BHEL SIDE, MOTOR CAN BE CONSIDERED SUITABLE FOR DISPATCH. 13.0 FOR TECHNICAL DELIVERY CONDITION AND GENERAL FEATURES OF PUMP. PLEASE REFER ST38013. 14.0 CROSS REFERRED STANDARDS: IS:2253, IS:2254, IS:3202, IS:4691 IS:4722 AND IS:4729.		
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electricals Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		स्वत्वधिकार एवं गोपनीय इस दस्तावेज में दी गयी सूचना भारतीय भारती लिमिटेड की संपत्ति है। इस सूचना को किसी भी रूप में बिना अनुमति के प्रयोग नहीं किया जाना चाहिए।		
निर्माण की तिथि SH.N. & DATE:	19/06			
समझी गयी संख्या INVENTORY NO.	REV. NO. 04	निर्माणकर्ता WORKED BY	DHARAMPAL	14/06/06
P-5540		जांचकर्ता CHECKED BY	ANUJ JAIN	14/06/06

निर्माता की संख्या INVENTORY NO. P-55-40	हस्ताक्षर एवं तिथि SIGN & DATE 29/10/06	स्वाम्यधिकार एवं गोपनीय The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	संपत्ति सूची संख्या को उपदिष्ट करें।	पृष्ठ 6 का 6 Page 6 Of 6	उत्पाद मानक PRODUCT STANDARD (STEAM TURBINE ENGINEERING)	ST-39015																																																																																																																																																																																
BED PLATE EXISTING ON OIL TANK																																																																																																																																																																																						
																																																																																																																																																																																						
<table border="1" style="width: 100%; border-collapse: collapse; font-size: 8px;"> <thead> <tr> <th>BED PLATE TYPE</th> <th>A ±0.3</th> <th>B ±0.3</th> <th>C ±0.3</th> <th>D ±0.3</th> <th>E ±0.3</th> <th>F ±0.3</th> <th>G ±0.3</th> <th>H ±0.3</th> <th>J ±0.3</th> <th>K ±0.3</th> <th>L ±0.3</th> <th>M ±0.3</th> <th>X ±0.3</th> <th>Y ±0.3</th> <th>NO. OFF HOLES</th> </tr> </thead> <tbody> <tr> <td>AA</td> <td>1500</td> <td>900</td> <td>220</td> <td>432</td> <td>644</td> <td>858</td> <td>1068</td> <td>1280</td> <td>115</td> <td>338.3</td> <td>561.8</td> <td>784.9</td> <td>240</td> <td>170</td> <td>18</td> </tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> </tbody> </table>							BED PLATE TYPE	A ±0.3	B ±0.3	C ±0.3	D ±0.3	E ±0.3	F ±0.3	G ±0.3	H ±0.3	J ±0.3	K ±0.3	L ±0.3	M ±0.3	X ±0.3	Y ±0.3	NO. OFF HOLES	AA	1500	900	220	432	644	858	1068	1280	115	338.3	561.8	784.9	240	170	18																																																																																																																																																
BED PLATE TYPE	A ±0.3	B ±0.3	C ±0.3	D ±0.3	E ±0.3	F ±0.3	G ±0.3	H ±0.3	J ±0.3	K ±0.3	L ±0.3	M ±0.3	X ±0.3	Y ±0.3	NO. OFF HOLES																																																																																																																																																																							
AA	1500	900	220	432	644	858	1068	1280	115	338.3	561.8	784.9	240	170	18																																																																																																																																																																							
REV. NO. 04		निर्माणकर्ता WORKED BY DHARAMPAL		जांचकर्ता CHECKED BY ANUJ JAIN		तिथि DATE 14/06/06																																																																																																																																																																																