

TABLE-1 (SPARES OF LP BYPASS STOP VALVE):

S/L.NO.	QUANTITY	DESCRIPTION
1.	1 SET	SET OF ALL INTERNALS REQUIRED FOR ONE COMPLETE VALVE EXCEPT VALVE BODY & BONNET
2.	1 SET	STRAINER
3.	1 SET	VALVE PLUG & STEM ASSEMBLY
4.	1 NO.	VALVE SEAT
5.	1 SET	PACKING SET
6.	1 SET	GASKET SET
7.	1 SET	PISTON RING
8.	1 SET	GLAND BUSH
9.	1 SET	HARDWARE ITEMS (ALL STUDS, BOLTS, NUTS & WASHERS)

TABLE-3 (SPARES OF LP BYPASS CONTROL VALVE):

S/L.NO.	QUANTITY	DESCRIPTION
1.	1 SET	SET OF ALL INTERNALS REQUIRED FOR ONE COMPLETE VALVE EXCEPT VALVE BODY & BONNET
2.	1 SET	STRAINER
3.	1 SET	VALVE PLUG & STEM ASSEMBLY
4.	1 NO.	VALVE SEAT
5.	1 SET	PACKING SET
6.	1 SET	GASKET SET
7.	1 SET	PISTON RING
8.	1 SET	GLAND BUSH
9.	1 SET	HARDWARE ITEMS (ALL STUDS, BOLTS, NUTS & WASHERS)
10.	1 NO.	SPRAY NOZZLE

TABLE-5 (SPARES OF WATER INJECTION VALVE):

S/L.NO.	QUANTITY	DESCRIPTION
1.	1 SET	SET OF ALL INTERNALS REQUIRED FOR ONE COMPLETE VALVE EXCEPT VALVE BODY & BONNET
2.	1 SET	STRAINER
3.	1 SET	VALVE PLUG & STEM ASSEMBLY
4.	1 NO.	VALVE SEAT
5.	1 SET	PACKING SET
6.	1 SET	GASKET SET
7.	1 SET	GLAND BUSH
8.	1 SET	HARDWARE ITEMS (ALL STUDS, BOLTS, NUTS & WASHERS)

TABLE-2 (SPARES OF LP BYPASS STOP VALVE ACTUATOR):

S/L.NO.	QUANTITY	DESCRIPTION
1.	1 NO.	COMPLETE ACTUATOR
2.	1 SET	CONTROL UNIT
3.	1 SET	SEAL SET OF ACTUATOR
4.	1 NO.	PILOT VALVE
5.	1 NO.	CARTIRAGE VALVE
6.	1 NO.	TRIP SOLENOID VALVE
7.	1 NO.	FILTER FOR PRESSURE LINE
8.	1 SET	OIL HOSES FOR PRESSURE & RETURN LINES
9.	1 NO.	PISTON OF ACTUATOR
10.	1 NO.	PISTON ROD OF ACTUATOR

TABLE-4 (SPARES OF LP BYPASS CONTROL VALVE ACTUATOR):

S/L.NO.	QUANTITY	DESCRIPTION
1.	1 NO.	COMPLETE ACTUATOR
2.	1 SET	CONTROL UNIT
3.	1 SET	SEAL SET OF ACTUATOR
4.	1 NO.	SERVO VALVE
5.	1 NO.	SEAL SET OF SERVO VALVE
6.	1 NO.	FILTER FOR SERVO VALVE
7.	1 NO.	INTERLOCKING VALVE
8.	1 SET	OIL HOSES FOR PRESSURE & RETURN LINES
9.	1 NO.	CARTIRAGE VALVE
10.	1 NO.	TRIP SOLENOID VALVE
11.	1 NO.	FILTER FOR PRESSURE LINE
12.	1 NO.	PISTON OF ACTUATOR
13.	1 NO.	PISTON ROD OF ACTUATOR

TABLE-6 (SPARES OF WATER INJECTION VALVE ACTUATOR):

S/L.NO.	QUANTITY	DESCRIPTION
1.	1 NO.	COMPLETE ACTUATOR
2.	1 SET	CONTROL UNIT
3.	1 SET	SEAL SET OF ACTUATOR
4.	1 NO.	SERVO VALVE
5.	1 NO.	SEAL SET OF SERVO VALVE
6.	1 NO.	FILTER FOR SERVO VALVE
7.	1 NO.	INTERLOCKING VALVE
8.	1 SET	OIL HOSES FOR PRESSURE & RETURN LINES
9.	1 NO.	FILTER FOR PRESSURE LINE
10.	1 NO.	PISTON OF ACTUATOR
11.	1 NO.	PISTON ROD OF ACTUATOR

TABLE-7 (SPARES OF HPSU):

S/L.NO.	QUANTITY	DESCRIPTION
1.	1 SET	MAIN PUMP WITH DRIVE MOTOR
2.	1 SET	FILTER PUMP WITH DRIVE MOTOR
3.	1 NO.	FILTER FOR MAIN CIRCUIT
4.	1 NO.	FILTER FOR COOLING CIRCUIT
5.	1 NO.	FILTER FOR REGENERATION CIRCUIT
6.	1 NO.	AIR FILTER
7.	1 NO.	PRESSURE RELIEF VALVE
8.	1 NO.	BLADDER FOR HYDRAULIC ACCUMULATOR
9.	1 NO.	CONNECTION BLOCK FOR HYDRAULIC ACCUMULATOR
10.	1 NO.	NITROGEN GAS FILLING DEVICE FOR HYDRAULIC ACCUMULATOR
11.	1 NO.	SUPPLY MANIFOLD
12.	1 SET	O-RINGS, GASKETS, SEALING & PACKING (EACH TYPE) IN HPSU.
13.	1 NO.	COOLING WATER REGULATING VALVE
14.	1 NO.	OIL COOLER (COMPLETE ASSEMBLY)
15.	1 SET	HIGH PRESSURE HOSES
16.	1 SET	MAIN PUMP WITHOUT MOTOR
17.	1 SET	FILTER PUMP WITHOUT MOTOR
18.	1 SET	COUPLING FOR MAIN PUMP
19.	1 SET	COUPLING FOR FILTER PUMP

NOTES:

- SUPPLIER TO FURNISH PRICE AGAINST EACH OF THE OFFERED ITEM FOR REFERENCE & FUTURE ORDERING.
- SUPPLIER TO FURNISH THE RELEVANT BILL OF MATERIAL & DRAWING OF MAIN EQUIPMENT ALONG WITH THE OFFER.
- SUPPLIER TO FURNISH CO-ORELATION WITH MAIN EQUIPMENT (i.e. ITEM NO. & ASSEMBLY DRAWING NO.) FOR EACH OF THE OFFERED ITEMS.

COPYRIGHT AND CONFIDENTIAL
THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED
IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETRIMENTAL TO THE INTEREST OF THE COMPANY.

1
REF. DRG NO.

2
SIGN & DATE

3
INVENTORY NO.

12
11
10
9
8
7
6
5
4
3

GRADE OF UNTOL. DIM:--
M/E:- V/G/M/F-AA-0230208
WELDING-A/B/C/B-AA621104
GWS-007110-137446021104
REV. DATE ALTERED
CHECKED

REV. DATE ALTERED
CHECKED

CBOM NO.
AGREED
U
DATE

NAME
SIGN
DATE

STATUS
U
DATE

TYPE OF PRODUCT
OR
NAME OF CUSTOMER/ PROJECT

STREAM TURBINE

DEPT. STE
CODE 4011

SCALE
N.T.S

WEIGHT(Kg)
--

DRW U
VERMA

SD-
11.12.15

SIGN
--

DATE
11.12.15

VAR.
--

TITLE
RECOMMENDED SPARES FOR
LPBP SYSTEM (MECHANICAL)

DRAWING NO.
1-12300-56008

SHEET NO.01
NO.OF SHEETS 01

0001C-00321-2

ON SHIMWAD

7

6

FIRST ANGLE PROJECTION

(ALL DIMENSIONS ARE IN mm)

4

3

2

1

TECHNICAL REQUIREMENTS

ALL THE REQUIREMENTS UNLESS OTHERWISE SPECIFIED IN THIS DRAWING SHALL BE AS PER ST47050 . ALL THE TECHNICAL DATA REQUIRED AS PER ST47050 FOR THE OFFERED SYSTEM SHALL BE FURNISHED BY THE SUPPLIER AT THE TIME OF SUBMISSION OF THE OFFER. LP BY PASS VALVES ALONG WITH THEIR ACTUATORS AND HYDRAULIC SUPPLY UNIT INCLUDING THE WATER INJECTION VALVES, FLOW NOZZLE etc. AS PER THE SCOPE OF SUPPLY MENTIONED IN ANNEXURE-1 SHALL BE OFFERED TO SUIT THE OPERATING PARAMETERS AS GIVEN IN THE CORRESPONDING DRAWINGS/SPECIFICATIONS AND SHALL ALSO MEET THE DESIGN, MANUFACTURING AND SUPPLY REQUIREMENTS AS SPECIFIED BELOW :-

1. DESIGN, MANUFACTURING AND TESTING REQUIREMENTS:-

1.1 LP BYPASS VALVE ALONGWITH DESUPERHEATER AND ELECTRO-HYDRAULIC ACTUATOR:

1.1.1 LP BYPASS STOP & CONTROL VALVES, DESUPERHEATER AND ACTUATORS SHALL BE DESIGNED & MANUFACTURED TO SUIT THE INPUT PARAMETERS SPECIFIED IN THE DRAWING NO.3-12300-31001.

1.1.2 SUPPLIER TO FURNISH THE SIZING CALCULATIONS FOR LP BYPASS VALVE, DESUPERHEATER & ACTUATORS FOR BHEL REVIEW.

01

1.1.3 (A) VALVE BODY ALONG WITH DESUPERHEATER BODY MATERIAL SHALL BE OF MATERIAL GRADE ASTM A182G.F92.

1.1.3 (B) MATERIAL FOR MAJOR VALVE COMPONENTS VIZ. VALVE STEM, VALVE PLUG, VALVE SEAT, INLET CAGE/STRAINER SHALL BE ASTM A182G.F92/ INCONEL 718 OR EQUIVALENT PROVEN MATERIAL SUITABLE FOR DESIGN PARAMETERS.

1.1.4 VALVE BODY SHALL HAVE THE TYPE OF CONSTRUCTION AS SHOWN IN THE ARRANGEMENT DRAWING NO. 3-12300-31002. OVERALL DIMENSIONS OF THE VALVE ALONGWITH ASSOCIATED EQUIPMENT SHALL BE IN ACCORDANCE WITH THE ARRANGEMENT DRAWING. VALVE SEAT OF LP BYPASS VALVE SHALL BE DIRECTLY MOUNTED ON THE VALVE BODY.

1.1.5 WELD END DETAIL AT THE INLET & OUTLET OF LPBP VALVE SHALL BE AS PER ASME B16.25, FORM/ FIGURE-6B.

1.1.6 LP BYPASS VALVE WITH DESUPERHEATER WILL BE WELDED BETWEEN THE INLET & OUTLET PIPES AND SUSPENDED THROUGH VALVE SUSPENSION (IN BHEL SCOPE OF SUPPLY). THE VENDOR SHOULD ENSURE PROVISION OF SUSPENSION BRACKETS ON THE VALVE BODY IN LINE WITH BHEL DRG. NO. 3-12300-31002.

1.1.7 (a) SIZING AND DESIGN OF THE ACTUATOR SHALL BE DONE TO SUIT THE OPERATING CONDITION WITH LINEAR VALVE CHARACTERISTICS & SHALL BE SUITABLE FOR OPERATION WITH NORMAL WORKING PRESSURE OF 160 BAR AND MIN WORKING PRESSURE OF 115 BAR CONTROL FLUID FRF (FIRE RESISTANT FLUID) AS MEDIUM. THE DESIGN OF SERVO VALVE GIVEN IN THE SPECIFICATION ST47050 IS TYPICAL. THE CONTROL BLOCK OF EACH ACTUATOR SHALL BE MOUNTED ON ACTUATOR .THE PROVEN SERVO VALVE IS TO BE OFFERED FOR CONTROL VALVE ACTUATORS.

1.1.7 (b) THE VENDOR TO SUBMIT THE DETAILED SIZING CALCULATION OF THE ACTUATOR IN ALL APPLICABLE OPERATING CONDITIONS MAINLY INCLUDING THE FOLLOWING.

(i) OPENING OF VALVE AT 0% STROKE CONDITION.

(ii) OPENING OF VALVE AT ABOUT 100% STROKE CONDITION.

(iii) CLOSING OF VALVE AT ABOUT 100% STROKE CONDITION.

(iv) CLOSING OF VALVE AT ABOUT TO CLOSE CONDITION.

FURTHER VENDOR TO NOTE THAT CALCULATION FOR OPENING CASE SHOULD BE DONE AT MIN WORKING PRESSURE OF 115 BAR AND THERE SHOULD BE SUFFICIENT MARGIN OF AT LEAST 15% FOR THESE CASES (CASE I & II).

1.1.8 FRF SHALL BE USED FOR ACTUATION OF ACTUATORS. (ALSO REFER CLAUSE 6.4 OF ST47050). THE FRF SHALL BE 100% TRIXYLENYL PHOPHATE (TXP) AND AS PER ANY OF THE FOLLOWING BRANDS:

A) RELOUBE TURBOFLUID 46XC OR B) FYRQUEL EHC-N. VENDOR SHALL ENSURE COMPATIBILITY OF ITS ACTUATORS WITH THESE BRANDS OF FRF.

1.1.9 FUNCTIONAL TESTING OF COMPLETE LPBP SYSTEM INCLUDING WATER INJECTION VALVE (WITH HYDRAULIC ACTUATOR) SHALL BE CARRIED OUT USING ANY BRAND OF FRF SPECIFIED AT CL.1.8 ABOVE. IN CASE ANY OTHER BRAND OF FRF IS USED FOR TESTING, THEN IT SHALL BE DRAINED COMPLETELY AND ALL THE EQUIPMENTS SHALL BE FLUSHED WITH ANY BRAND OF FRF SPECIFIED AT CL.1.1.8.

1.1.10 VENDOR TO FURNISH WARMUP PROCEDURE ALONG WITH RECOMMENDED STEAM QUANTITY AND STEAM PARAMETERS. WARM UP & DRAIN CONNECTION SHALL BE OF SIZE 60.3X6.35mm. MATERIAL P92 OR EQUIVALENT.

1.1.11 THE VENDOR TO FURNISH CASING DRG. OF LPBP VALVE WITH COMPLETE DIMENSIONS OF ALL CONTOURS REQUIRED FOR PROCUREMENT OF THERMAL INSULATION BY BHEL ALONG WITH SURFACE AREA.

1.1.12 THE VENDOR SHALL FURNISH STEAM BLOWING DEVICE (SBD) DRAWING & ITS PART LIST FOR LPBP VALVE. THE DESIGN PRESSURE AND TEMPERATURE FOR SBD SHALL BE 60 BAR & 400°C RESPECTIVELY. FURTHER THE VENDOR TO SUBMIT SIZING CALCULATIONS OF SBD INDICATING DISTURBANCE FACTOR CONSIDERED IN THE DESIGN.

1.1.13 THE VENDOR SHALL FURNISH CROSS-SECTIONAL DRG. & BOM OF LPBP VALVE , ACTUATOR & DESUPERHEATER INDICATING DIMENSIONS, WEIGHT & C.G. ALONG WITH THE OFFER.

1.1.14 IN FAILURE MODE (INTERRUPTION OF CONTROL FLUID SUPPLY OR ELECTRICAL SIGNAL FAILURE), LPBP STOP VALVE SHALL BE IN CLOSED CONDITION.

1.1.15 ALL COMPONENTS OF ACTUATORS (i.e. POS. TRANSMITTERS, LIMIT SWITCHES, SERVO VALVES, POPPET VALVES, CARTRIDGE VALVES, INSTRUMENTS ETC.) SHALL BE PROVEN ONE & PERMANENTLY IDENTIFIED WITH FRF-RESISTANT NAME/RATING PLATES & INSCRIPTION PLATES/TAG NOS. ACCORDING TO THE SYSTEM P&I DIAGRAM TO BE FINALIZED AFTER THE PLACEMENT OF ORDER. THE VENDOR SHALL FURNISH, THE DRG & PART LIST OF HYDRAULIC TEST DEVICE. 1.1.16 STRAINER IS TO BE PROVIDED MANDATORILY BY THE VENDOR & MAX. HOLE SIZE (DIA) IN THE STRAINER TO BE < 3 mm. REST OF THE REQUIREMENTS SHALL BE AS PER CL. 4.5 OF ST47050.

1.1.17 OPERATING PHILOSOPHY OF LP BYPASS STOP VALVE ACTUATOR SHALL BE:

FRF PRESSURE TO OPEN AND SPRING FORCE TO CLOSE.

1.2 HYDRAULIC SUPPLY UNIT (HPSU) :

1.2.1 DESIGN & SIZING OF HYDRAULIC SUPPLY UNIT (HPSU) FOR SUPPLY OF OPERATING FLUID FRF (FIRE RESISTANT FLUID) TO VARIOUS ACTUATORS AT NOMINAL PRESSURE OF 160 BAR SHALL BE CARRIED OUT BASED ON THE SELECTED DESIGN OF ACTUATORS FOR LPBP VALVES, WATER INJECTION VALVES & THEIR NOS. SPECIFIED FOR THE LPBP SYSTEM. SUPPLIER SHALL FURNISH THE SIZING CALCULATION OF HPSU FOR BHEL REVIEW AT THE TIME OF SUBMISSION OF OFFER.

1.2.2 HPSU SHALL BE PROVIDED WITH PRESSURE RELIEF VALVES WITH SUITABLE PRESSURE SWITCHES AND GAUGES & TRANSMITTER AS PER SUPPLIERS PRACTICE. SETTING PRESSURE OF RELIEF VALVES SHALL BE INDICATED BY THE SUPPLIER IN THEIR OFFER FOR BHEL REVIEW.

1.2.3 ALL COMPONENTS OF HPSU (I.E. COOLERS, ACCUMULATORS, FILTERS, HEATERS, PUMPS, MOTORS, VALVES, INSTRUMENTS ETC) SHALL BE PROVEN ONE & PERMANENTLY IDENTIFIED WITH FRF-RESISTANT NAME/RATING PLATES & INSCRIPTION PLATES/TAG NOS ACCORDING TO THE SYSTEM P&I DIAGRAM TO BE FINALISED AFTER THE PLACEMENT OF ORDER.

1.2.4 THE HPSU SHALL BE DESIGNED WITH A SUITABLE PROTECTIVE ENCLOSURE. TECHNICAL DETAILS OF THE SAME SHALL BE FURNISHED IN THE OFFER. DESIGN OF PROTECTIVE CABINET SHALL BE SUITABLE FOR MAX. SOUND PRESSURE LEVEL OF 85dBA AT FULL OUTPUT OF MOTOR/PUMP UNIT AND AUXILIARY CYCLE GIVEN IN THE OFFER.

1.2.5 THE HPSU SHOULD ALSO BE PROVIDED WITH:

A. 100% REDUNDANT OF PUMPS (AXIAL PISTON PUMP) & MOTORS.

B. 100% REDUNDANT PUMP FOR COOLING CUM FILTRATION & REGENERATION CIRCUIT, MOTORS, WATER COOLERS, TEMPERATURE CONTROL VALVES ETC.

C. AIR BREATHER ARRANGEMENT, FILTERS, BALL VALVES, CHECK VALVES, ACCUMULATORS, TANK HEATER, LEVEL INDICATOR, REGENERATION UNIT, LEAK FLUID COLLECTING PAN ETC.

1.2.6 CONTROL FLUID REGENERATION UNIT SHALL BE A WELL PROVEN SYSTEM. VENDOR TO PROVIDE COMPLETE DETAILS IN THE OFFER FOR BHEL REVIEW.

1.2.7 THE PRELIMINARY DATA FOR DESIGN/SIZING OF WATER COOLERS FOR HPSU SHALL BE AS FOLLOWS:

A. DESIGN PRESSURE OF COOLER (MECHANICAL)-30 KG/CM2.

B. DESIGN TEMPERATURE OF COOLER (MECHANICAL)-100°C.

C. COOLING WATER INLET TEMPERATURE - 40°C.

D. MAXIMUM COOLING WATER FLOW RATE-3 CU.M/HR PER COOLER (TOTAL MAX. FLOW RATE-2X3 CU.M/HR=6 CU.M/HR).

E. COOLING WATER SHALL BE PASSIVATED DEMINERALISED WATER (Ph=9.5).

F. INLET TEMPERATURE OF FRF -60°C.

G. INLET WATER PRESSURE -10 BAR(MAX).

H. INLET PRESSURE OF FRF ≥ 12 BAR.

THE FINAL DATA FOR DESIGN/SIZING OF WATER COOLERS FOR HPSU SHALL BE CONFIRMED BY BHEL AFTER PLACEMENT OF ORDER.

1.2.8 VENDOR TO PROVIDE PRESSURE RELIEF VALVE, VENT LINES, DRAIN LINES, ISOLATING VALVES & THERMOSTATIC FLOW CONTROL VALVES IN COOLING WATER CIRCUIT OF HPSU (AS PER COOLING WATER SCHEME GIVEN IN SHEET NO. 2).

1.3 WATER INJECTION CONTROL VALVE (MWI):

1.3.1 DESIGN, MANUFACTURING AND SUPPLY OF THE WATER INJECTION CONTROL VALVE AND ITS HYDRAULIC ACTUATOR SHALL BE AS PER THE REQUIREMENTS SPECIFIED IN THE DRAWING NO. 2-12300-31003.

1.3.2 VENDOR SHALL PROVIDE COMPLETE DETAILS OF CONTROL PHILOSOPHY FOR ENTHALPY BASED CONTROL FOR SPRAY WATER VALVE. CONTROL ALGORITHM CONTAINING DETAILS OF GENERATION OF ENTHALPY SET POINT AND CALCULATION OF ACTUAL ENTHALPY SHALL BE FURNISHED ALONG WITH THE OFFER. A SCHEME (P & ID) INDICATING THE INSTRUMENTS REQUIRED TO IMPLEMENT THE SYSTEM SHALL ALSO BE FURNISHED.

1.4 FLOW NOZZLES FOR WATER INJECTION VALVE:

1.4.1 DESIGN, MANUFACTURING AND SUPPLY OF FLOW NOZZLE SHALL BE AS PER DRG.NO.3-13360-82501

1.5 DUMP TUBE:

1.5.1 DUMP TUBE SHALL BE DESIGNED FOR THE FOLLOWING CONDITIONS:

A) DUMP TUBE SHALL BE OF 2 STAGE. PRESSURE AFTER FIRST STAGE OF DUMP TUBE SHALL BE 3 BAR (MAXIMUM) FOR CASE-1 MENTIONED IN 3-1230031001. B) ENTHALPY OF EXHAUST STEAM SHALL BE 2650 KJ/KG . C) MECHANICAL DESIGN PRESSURE/TEMPERATURE- 15 BAR/ 500 °C. D) 5% MARGIN ON THE CALCULATED NUMBER OF HOLES IN THE VMO CASE.

E) CONDENSER HOT BOX PARAMETERS DURING LPBP OPERATION (PRESSURE 0.2133 BAR (ABSOLUTE) & STEAM TEMPERATURE 61.5 °C). 1.5.2 DUMP TUBE SHALL BE PLACED INSIDE HOT BOX AS PER ARRANGEMENT DRG.NO.3-12300-31002. FURTHER , THE EXHAUST STEAM

SHALL GO TO AIR COOLED CONDENSER. VENDOR TO SUBMIT MATERIAL GRADE/DETAILS, SIZING CALCULATIONS & DRAWING OF DUMP TUBE FOR BHEL REVIEW. THE DETAILS OF LIFTING/HANDLING, MOUNTING & SUPPORTING OF DUMP TUBE SHALL BE MUTUALLY AGREED BETWEEN BHEL & VENDOR. VENDOR TO INCLUDE THESE DETAILS IN THE DRAWING OF DUMP TUBE. ANY OTHER INFORMATION/DETAIL REQUIRED FROM ERECTION/COMMISSIONING POINT OF VIEW SHALL ALSO BE INCLUDED IN THE DRAWING.

1.5.3 WELD END DETAIL AT THE INLET OF DUMP TUBE SHALL BE AS PER ASME B16.25, FORM/ FIGURE-6B.

1.5.4 THE MATERIAL OF DUMP TUBE SHALL BE P22 OR EQUIVALENT FORGING GRADE.

1.5.5 THE VENDOR TO PROVIDE PROVISION OF DRAIN STUB AT THE LOWEST POINT IN DUMP TUBE AS PER DETAILS SHOWN IN DRG.

3-12300-31002

1.5.6 WEIGHT OF DUMP TUBE SHALL NOT EXCEED 6000 KG. LENGTH OF DUMP TUBE SHALL BE BETWEEN 4-5 METER.

1.5.7 THE VENDOR TO ENSURE THAT NOISE LEVEL SHALL BE LESS THAN 85 dBA AT A DISTANCE OF 1 METER FROM DUMP TUBE DURING LPBP VALVE OPERATION.

1.6 PIPING BETWEEN DESUPERHEATER AND DUMP TUBE (BHEL SCOPE) :

1.6.1 ARRANGEMENT OF THE PIPING SHALL BE AS PER DRG.NO.3-12300-31002. THE MATERIAL GRADE/DETAIL OF PIPE SHALL BE P22 OR EQUIVALENT.

2. CIE REQUIREMENTS:-

2.1 ALL INDOOR ELECTRICAL/ELECTRONIC EQUIPMENT SHALL BE DESIGNED TO OPERATE WITHOUT AIR CONDITIONING AT AN INDOOR AMBIENT DESIGN TEMPERATURE RANGE BETWEEN 0°C TO 50° C.

2.2 WELL PROVEN SERVO-VALVES SHALL BE SUPPLIED FOR CONTROL OF THE BYPASS VALVE AND WATER INJECTION VALVE ACTUATORS.

MATERIAL CODE : W90312300530

STEAM TURBINE

TYPE OF PRODUCT
OR
NAME OF CUSTOMER/PROJECT

BHARAT HEAVY ELECTRICALS LTD.
RANIPUR, HADDWAR



NAME	DATE	NO. OF
DRN H.SINGH	-SD-	28.02.19
CHD AKS/NN	-SD-	28.02.19
APPR.R. RAWAT	-SD-	03.03.19
73	74	75

DEPT	STE	SCALE	WEIGHT (KG)	REF. TO ASSY. DRG.	ITEM NO. OF
CODE 4011		N.T.S.	--	----	75

TITLE :

LP BYPASS SYSTEM

CARD CODE	DRAWING NO.
2-12300-31000	22123
7	24

12300-50000	12300-76000
12300-76000	12300-76000
Ref. Drawing No.	

Sign & Date	Inventory No
REV DATE ALTERED CHECKED	8

Sign & Date	Inventory No
REV DATE ALTERED CHECKED	7

Sign & Date	Inventory No
REV DATE ALTERED CHECKED	6

Sign & Date	Inventory No
REV DATE ALTERED CHECKED	5

Sign & Date	Inventory No
REV DATE ALTERED CHECKED	4

Sign & Date	Inventory No
REV DATE ALTERED CHECKED	3

2001C-00271-2
DRAWING NO.

7

6

FIRST ANGLE PROJECTION

(ALL DIMENSIONS ARE IN mm)

4

3

2

1

INPUT DATA FOR VALVE & ACTUATOR:

MAX. CALCULATED WATER MASS FLOW : 122.3 KG/SEC
MIN. CONTROLLED WATER MASS FLOW : 12.2 KG/SEC
WV DESIGN PRESSURE/TEMPERATURE : 47 BAR (o) / 100°C
MAX. WATER PRESSURE ACROSS THE VALVE : 43 BAR (o)
WATER PRESSURE AT VALVE INLET : 17.62 BAR (o)
WATER INLET TEMPERATURE : 30 TO 60°C
NOISE REQUIREMENTS : < 85 dB(A)
INLET & OUTLET CONNECTIONS : SHALL BE FLANGED END (AS SHOWN)
VALVE SIZE : DN 200

TECHNICAL REQUIREMENTS:-

ACTUATOR TYPE: : ELECTRO-HYDRAULIC
OPERATING MEDIUM : FIRE RESISTANT FLUID (FRF)
CONTROL FLUID NORMAL OPERATING PRESSURE : 160 BAR (*)
CONTROL FLUID MINIMUM OPERATING PRESSURE: 115 BAR (*)
NORMAL CONTROL FLUID TEMPERATURE : 50+5°C
MAXIMUM CONTROL FLUID TEMPERATURE : 75°C
CONTROL SIGNAL : ±30ma
OPENING TIME : <=3 SEC. (MAX.)
ACTUATOR SPINDLE MOUNTING : VERTICAL
VALVE CHARACTERISTICS : EQUAL PERCENTAGE
FAILURE MODE : STAY PUT
SUPPLY LINE : 48.3X5.08
RETURN LINE : 48.3X3.68

1. VALVE TO BE SUPPLIED ALONG WITH INLET / OUTLET COUNTER FLANGES (WELD NECK, RAISED TYPE), ASSOCIATED FASTENERS AND SEALINGS.
2. SCOPE OF SUPPLY SHALL BE AS PER TABLE-1.
3. BODY MATERIAL : CAST STEEL GS-C25 (1.0619) / A216 WCB.
4. VALVE SUPPLIER MUST SHOW THE WATER FLOW DIRECTION WITH AN ARROW EMBOSSED OVER THE VALVE BODY.
5. THE ACTUATOR SHALL BE CAPABLE OF MANUAL OPERATION & FURNISH RELEVANT TECHNICAL DETAILS ALONGWITH OFFER.
6. CONTROL BLOCK/MANIFOLD SHOULD BE MOUNTED ON THE POWER CYLINDER AND IT SHOULD CONSIST OF SERVO-VALVE, FILTER, SOLENOID VALVES, CARTRIDGES/CHECK VALVES ETC.
7. ELECTRONIC POSITION FEEDBACK TRANSMITTER SHALL BE NON-CONTACT TYPE REQUIRED FOR MEASURING THE POSITION OF THE CONTROL VALVE. OUTPUT OF THE POSITION TRANSMITTER SHALL BE 4mA (VALVE FULLY CLOSED) TO 20mA (VALVE FULLY OPENED).
8. STRENGTH & LEAK TIGHTNESS TEST : AS PER CLASS V ANSI B 16.104
9. VALVE BODY SHALL BE HYDRAULICALLY TESTED AT MIN. 1.5 TIMES DESIGN PRESSURE AS PER DIN 3230 PT III BA/BQ/ANSI B16.34.
10. WATER INJECTION VALVE (W.I.V.) IS TO BE DESIGNED FOR OPERATION WITH HYDRAULIC ACTUATOR. IN FAILURE MODE THE VALVE SHALL BE IN STAYPUT CONDITION.
11. VALVE CONFIGURATION SHALL BE "FLOW TO CLOSE".
12. SELECTED CV OF WATER INJECTION VALVE SHALL HAVE 15% MARGIN OVER THE MAXIMUM CV VALUE CALCULATED BASED ON MAXIMUM CALCULATED WATER MASS FLOW AS SPECIFIED IN THE DRAWING.
13. THE VALVE SIZING SHALL BE SUITABLE FOR OBTAINING SPRAY WATER FLOW CORRESPONDING TO CASE -1 OF OPERATING REGIME MENTIONED IN DRAWING NO. 3-12300-31001, I.E. 100.92 kg/s WITHIN 80% OF TOTAL VALVE TRAVEL.

(*) - HYDRAULIC OPERATING PRESSURE SHALL BE MADE AVAILABLE FROM THE CENTRALISED HYDRAULIC POWER SUPPLY UNIT (HPSU). MEANT FOR TURBINE BYPASS SYSTEM.

DOCUMENTS REQUIRED ALONG WITH THE OFFER ARE:-

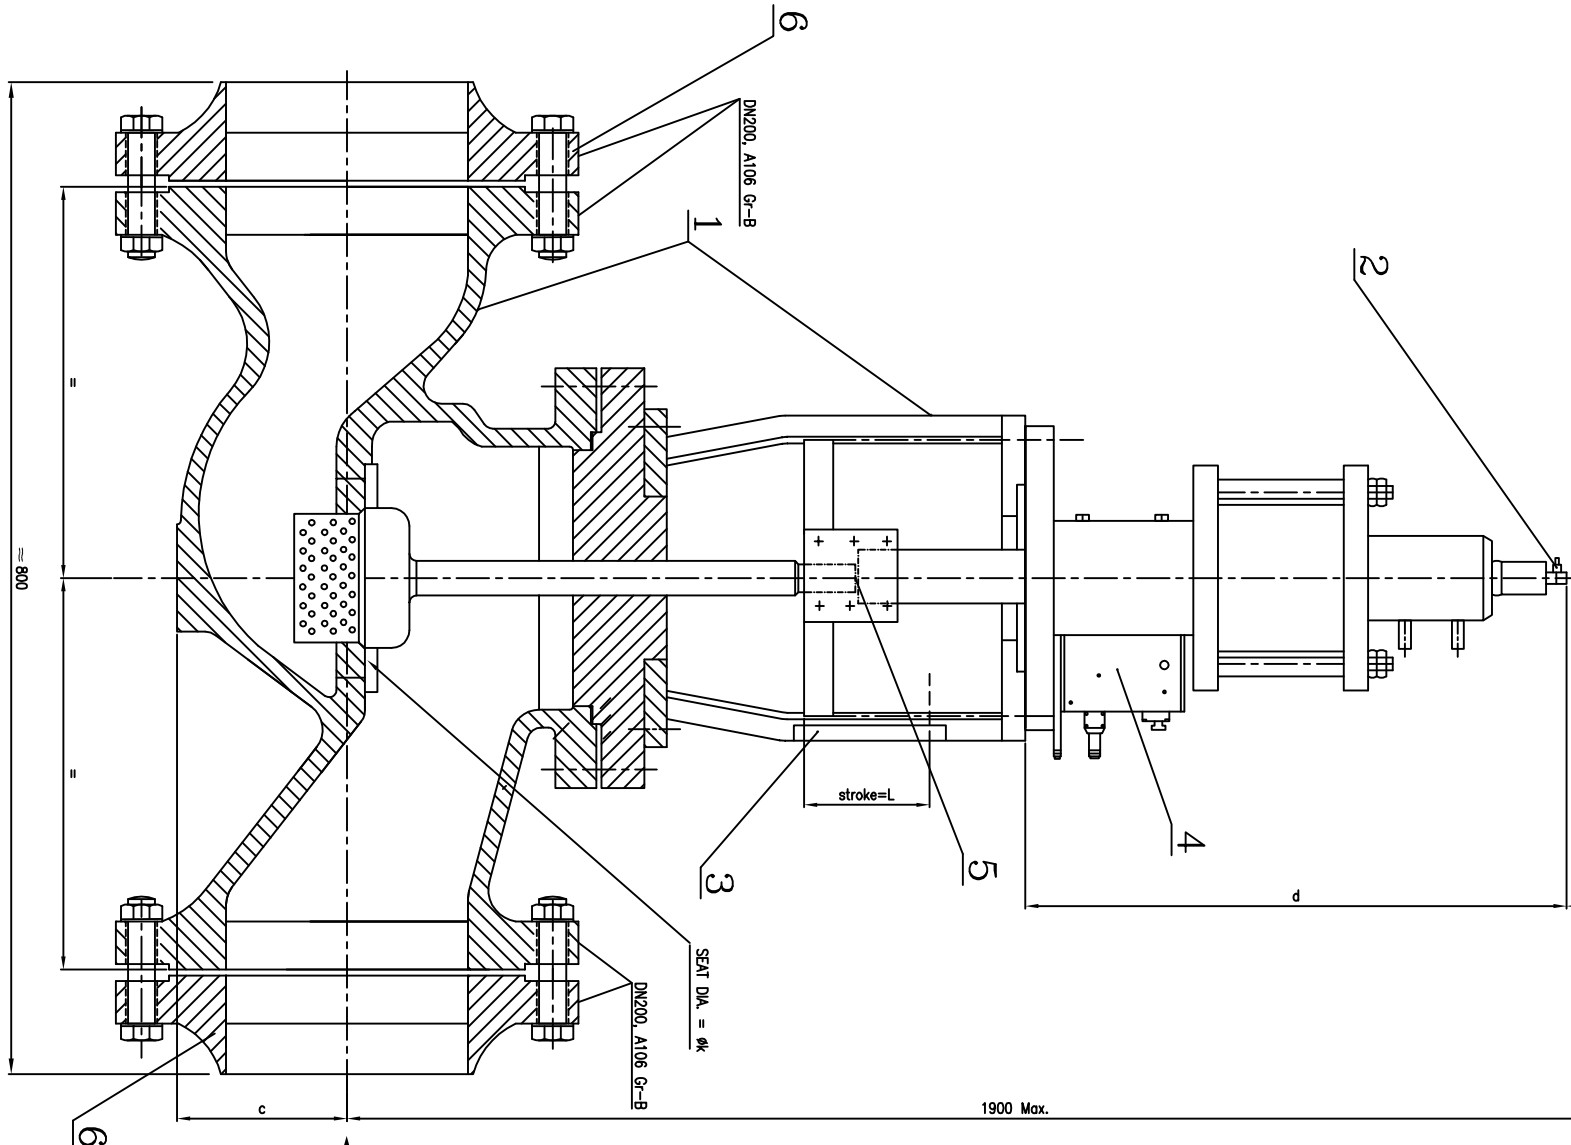
1. DOCUMENTS REQUIRED ALONG WITH THE OFFER SHALL BE AS PER CL. 12.2.3 OF ST47050.
2. IN ADDITION TO CL.12.2.3 OF ST47050 FOLLOWING DOCUMENTS ARE REQUIRED TO BE SUBMITTED ALONG WITH THE OFFER-
- 2.1. LIST OF ALL RECOMMENDED SPARES FOR VALVE & ACTUATOR AS PER BHEL DRAWING NO. 1-12300-56006.
- 2.2. MATERIAL DETAIL OF THE COUNTER FLANGES TO BE FURNISHED.
- 2.3. QUALITY PLAN.

NOTES:-

1. VALVE INLET & OUTLET COUNTER FLANGE END CONNECTIONS: Ø219.1X8.18, MATERIAL AS PER ASTM A105.
2. PRESSURE DROP IN PIPE LINE FROM OUTLET OF WV TO INLET OF DESUPERHEATER SHALL BE 0.7 BAR.

Table-1

IT.NOS	ITEM DESCRIPTION
1.	CONTROL VALVE WITH HYDRAULIC ACTUATOR
2.	POSITION TRANSMITTER
3.	SCALE FOR LOCALISED DISPLAY
4.	CONTROL MANIFOLD
5.	COUPLING
6.	COUNTER FLANGES WITH FASTENERS
7.	COMMISSIONING SPARES AS PER BHEL DRAWING NO. 3-12300-56005



NOTE : - ALL DIMENSIONS AS MARKED (ØK, L, c, d) SHALL BE FURNISHED BY THE SUPPLIER

Inventory No	Sign & Date	21230007603 Ref.Drawing No>
--------------	-------------	--------------------------------

GRADE OF UNTOL.DIM		AGREED DEPT	NAME	SIGN	DATE	STATUS OF Dwg	
M/CG.-C/M/F AA0230208		CIE	GURPREET	SD/-	05.03.19		
WELDING-A/B/C/D AA0621104							
GAS CUTTING-T3'AA0621101							
REV	DATE	ALTERED	CHECKED	REV	DATE	ALTERED	CHECKED

TYPE OF PRODUCT OR NAME OF CUSTOMER/PROJECT				STEAM TURBINE			
BHARAT HEAVY ELECTRICALS LTD. RANIPUR, HARDWAR				DRN	H. SINGH	SD/-	28.02.19
				CHD	AKS/NN	SD/-	28.02.19
				APPDR.	RAWAT	SD/-	03.03.19
DEPT	STE	SCALE	WEIGHT (KG)	REF.	TO ASSY. DRG.	ITEM No.	NO. OF
CODE 4011		NTS	≤600.0	-		75	74
TITLE : WATER INJECTION CONTROL VALVE				CARD CODE	DRAWING NO.		
					2-12300-31003		
					22.23		24
					7		
					SHEET No. 01	No. OF SHEETS 01	

DESCRIPTION		INPUT / PROCESS DATA	
Design Pressure (bar abs.)	INLET	OUTLET	
	75	15	
Design Temp. (°C)	608	608	
Valve Diameter – DN	** – Supplier to specify		
Pressure Rating – PN	** – Supplier to specify		
Type of Valve Connections –	Butt welded		
Valve Characteristics– Linear /Quadratic /Equal %	Linear		
Valve Type – Straight / Angle	As per DRG. 3-12300-31002		
Hydraulic Medium – Mineral Oil / FRF for Actuation	Fire Resistant Fluid (FRF)		
Ambient condition	0°C to 50°C		
Material for Valve Casing	ASTM A182 Gr.F92		
OPERATING REGIMES	CASE:1	CASE:2	CASE:3
Operating pressure at valve inlet P1 (bar abs.)	29.25	60.36	22.47
Operating temp. at valve inlet T1 (°C)	600	600	512
Steam flow per LP Bypass valve for various operating condition (kg/sec.)	234.05	290.51	180.44
Required spray water quantity (kg/sec.)	100.92	122.30	63.4
Flow (steam & water) at outlet of each LPBP valve (kg/sec.)	334.97	412.81	243.84
Operating pressure at valve outlet P2 (bar abs.)	5-6 BAR	SUPPLIER TO SPECIFY	
Enthalphy of steam at valve outlet (kJ/kg)	2650		
Pressure after first stage of dump tube	3 BAR	SUPPLIER TO SPECIFY	
Condenser pressure (bar abs.)	0.2133	0.2133	0.2133

1. ALL COMPONENTS OF LP BYPASS STOP VALVE, CONTROL VALVE ALONG WITH ACTUATORS SHALL BE DESIGNED FOR OPERATION AT DESIGN PRESSURE 75 bar (a), TEMPERATURE 608°C & CORRESPONDING STEAM FLOW (INDICATIVE STEAM FLOW VALUE IS 359.80 kg/sec.).

2. THE LPBP VALVE SHALL ALSO BE SUITABLE FOR OPERATION AT MAX. SHORT TERM PRESSURE 78 bar (a) & MAX. SHORT TERM TEMPERATURE 624°C.

MAX. SHORT TERM PRESSURE & TEMPERATURE ARE ONLY ALLOWED FOR BRIEF SWINGS OF 15 MINUTES OR LESS, PROVIDED THAT THE TOTAL OPERATING TIME DOES NOT EXCEED 80 HOURS DURING ANY 12 MONTHS OPERATING PERIOD.

3. THE SELECTED CV OF LP BYPASS VALVE SHALL HAVE SUFFICIENT MARGIN (AT LEAST 8%) OVER THE MAXIMUM CV VALUE CALCULATED AS PER THE OPERATING CONDITIONS MENTIONED IN THE DRAWING.

4. OFFERED LP BYPASS STOP & CONTROL VALVE ALONG WITH ACTUATORS & HPSU SHALL BE SUITABLE FOR OPERATION (OPENING AND CLOSING OF VALVES AGAINST CORRESPONDING STEAM FLOW) FOR ABOVE MENTIONED T.R. 1 & 2 RESPECTIVELY.

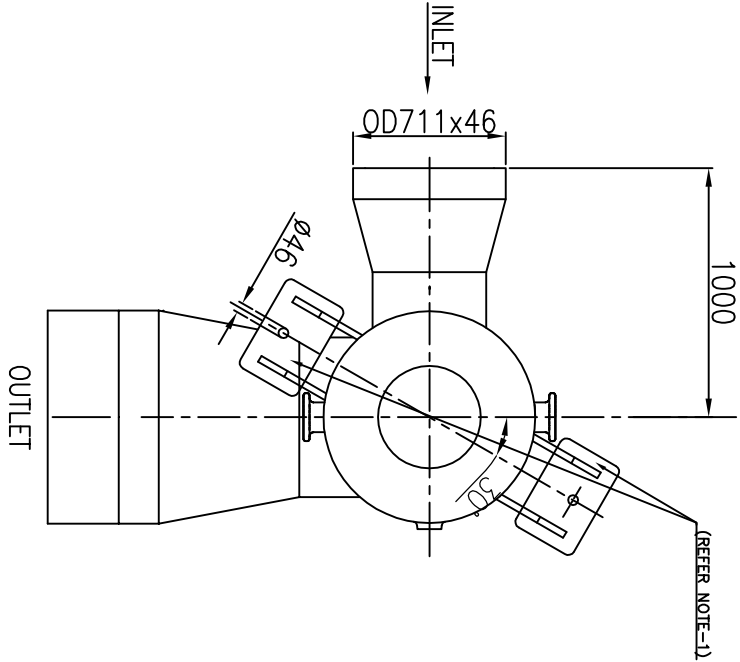
GMS No. /		C B O M		STATUS OF DRG		
AGREED DEPT	NAME	SIGN	DATE			
TYPE OF PRODUCT OR NAME OF CUSTOMER/PROJECT						
STEAM TURBINE						
BHARAT HEAVY ELECTRICALS LTD.		DRN	H.SINGH	SD	27.02.19	NO. OF VAR
RANIPUR, HARDWAR		CHD	AKS/NN	SD	27.02.19	-
		APPD	R.RAWAT	SD	01.03.19	73 74
DEPT STE	SCALE NTS	WEIGHT (KG)	REF. TO ASSY. DRG.	ITEM No.	NO. OF ITEMS	
CODE 4011		-----	---		75 77	
TITLE : INPUT/PROCESS DATA FOR LPBP VALVE AND ACTUATORS		CARD CODE	DRAWING NO.		3-12300-31001	
					22 23 24	
		SHEET No.	1	No. OF SHEETS	1	

20012-0021-2

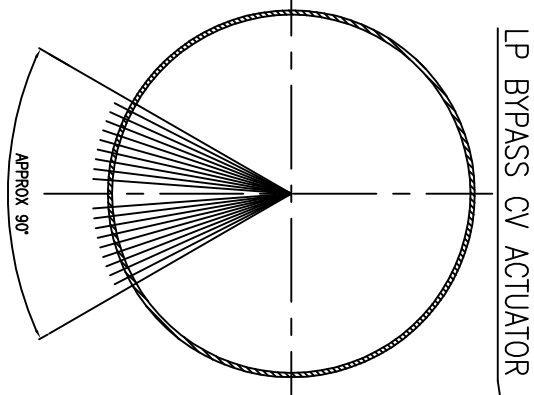
ON GINWARD

COPYRIGHT AND CONFIDENTIAL

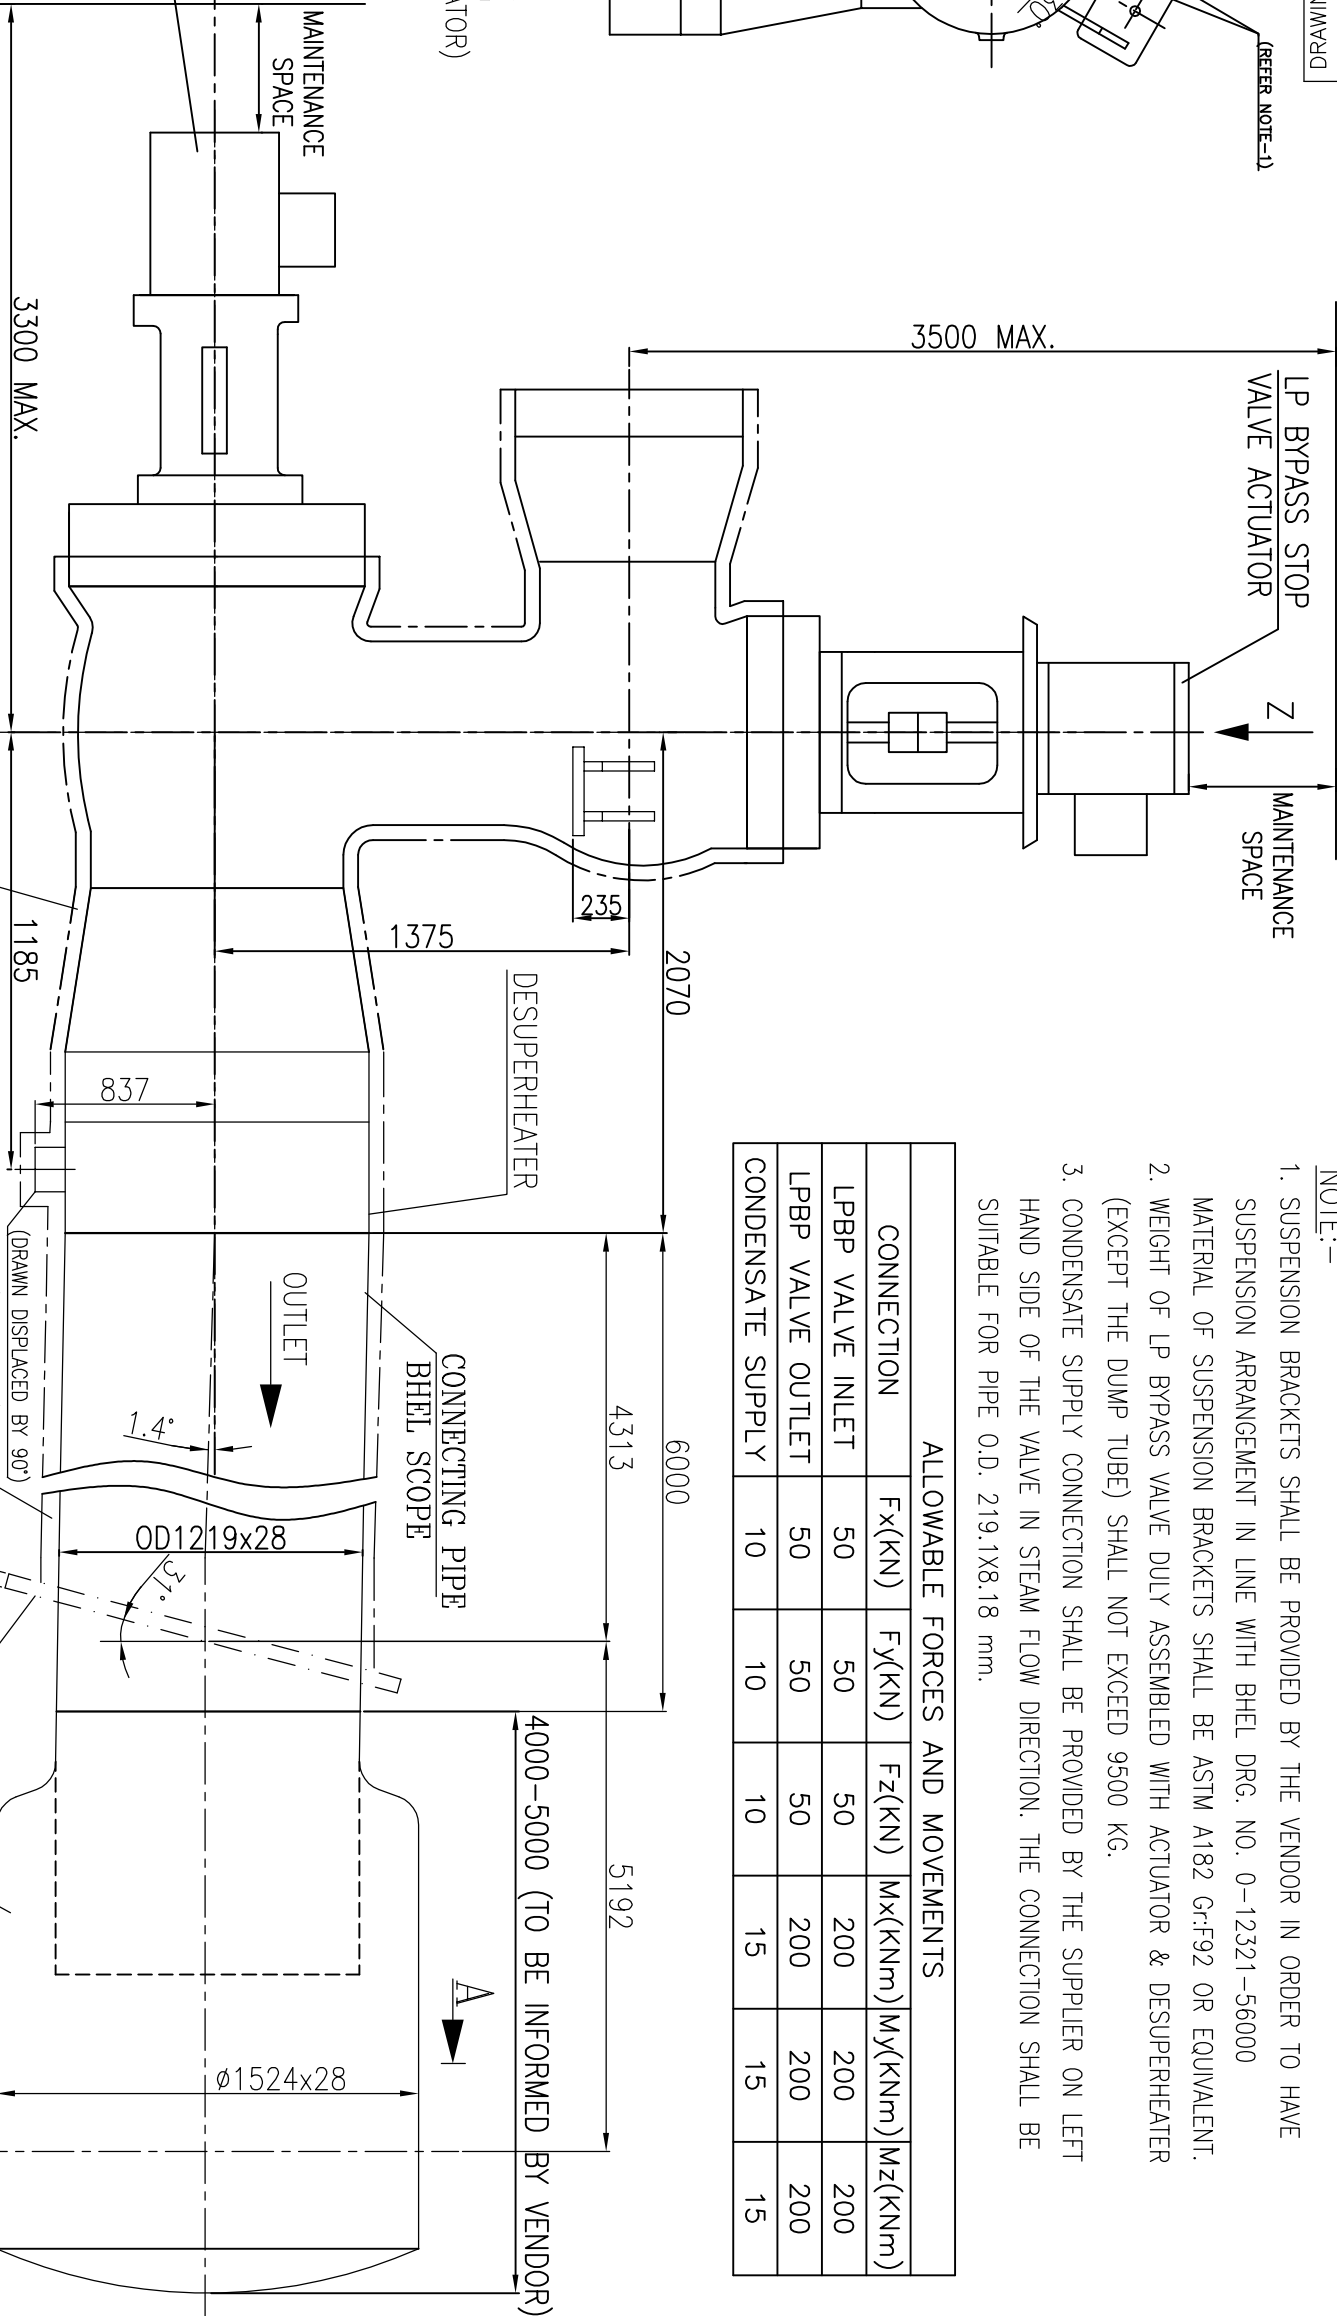
THE INFORMATION ON THIS DOCUMENT IS THE PROPERTY OF BHARAT HEAVY ELECTRICALS LIMITED. IT MUST NOT BE USED DIRECTLY OR INDIRECTLY IN ANY WAY DETERIMENTAL TO THE INTEREST OF THE COMPANY.



VIEW-Z
(WITHOUT ACTUATOR)



SECTION-AA



SCHEMATIC ARRANGEMENT OF ANGLE TYPE VALVE

- NOTE:-
- SUSPENSION BRACKETS SHALL BE PROVIDED BY THE VENDOR IN ORDER TO HAVE SUSPENSION ARRANGEMENT IN LINE WITH BHEL DRG. NO. 0-12321-56000
 - WEIGHT OF LP BYPASS VALVE DULY ASSEMBLED WITH ACTUATOR & DESUPERHEATER (EXCEPT THE DUMP TUBE) SHALL NOT EXCEED 9500 KG.
 - CONDENSATE SUPPLY CONNECTION SHALL BE PROVIDED BY THE SUPPLIER ON LEFT HAND SIDE OF THE VALVE IN STEAM FLOW DIRECTION. THE CONNECTION SHALL BE SUITABLE FOR PIPE O.D. 219.1X8.18 mm.

ALLOWABLE FORCES AND MOVEMENTS							
CONNECTION	F _x (KN)	F _y (KN)	F _z (KN)	M _x (KNm)	M _y (KNm)	M _z (KNm)	
LPBP VALVE INLET	50	50	50	200	200	200	
LPBP VALVE OUTLET	50	50	50	200	200	200	
CONDENSATE SUPPLY	10	10	10	15	15	15	

CONDENSATE SUPPLY (DRAWN DISPLACED BY 90°)

DESUPERHEATER

CONNECTING PIPE

BHEL SCOPE

OUTLET

1.4°

OD1219x28

3°

30

THERMAL INSULATION

HOT BOX DOME WALL

TWO STAGE DUMP TUBE

CENTRE LINE OF HOT BOX

1185

837

1375

235

2070

4313

5192

4000-5000 (TO BE INFORMED BY VENDOR)

1524x28

3500 MAX.

DRAWN DISPLACED BY 90°

—GMS No.— C B O M

STATUS OF DRG

AGREED

DEPT

NAME

SIGN

DATE

PED

HARDEEP

—SD—

01.03.19

HXE

MUKESH

—SD—

01.03.19

TYPE OF PRODUCT OR

NAME OF CUSTOMER/PROJECT

STEAM TURBINE



BHARAT HEAVY ELECTRICALS LTD.
RANIPUR, HARDWAR

NAME	SIGN	DATE	NO. OF
DRN H. SINGH	—SD—	28.02.19	OF
CHD AKS./NN	—SD—	28.02.19	VAR
APPD R. RAWAT	—SD—	03.03.19	73 74

DEPT	STE	SCALE	WEIGHT (KG)	REF. TO ASSY. DRG.	ITEM	NO. OF
CODE 4011		N.T.S.	----	—	No.	ITEMS
					75	77

TITLE :	CARD	DRAWING NO.	
ARRANGEMENT OF LPBP VALVE	CODE	3-12300-31002	—
ALONG WITH ASSOCIATED EQUIPMENT		22 23 24	

Inventory No.	Sign & Date	Ref.Drawing No>

REV	DATE	ALTERED	CHECKED

REV	DATE	ALTERED	CHECKED

REV	DATE	ALTERED	CHECKED

GRADE OF UNTOL. DIM	
M/CG.— AA0230208 m	
WELDING—CLASS 'B' OF AA0621104	
GAS CUTTING—TABLE 3 OF AA0621104	

0011C-00621-C

LIST OF MANDATORY SPARES AS PER CLAUSE NO.11.2 OF ST47050:-

A. TABLE-1:-

MECHANICAL ITEMS

SL. NO.	CUSTOMER CLAUSE NO.	ITEM DESCRIPTION	QTY.	UNIT.
1	B.I.21	LP BYPASS CONTROL VALVE (SET OF ALL INTERNALS REQUIRED TO COMPLETE ONE VALVE ASSEMBLY EXCEPT VALVE BODY & BONNET AND INTERNALS OF DESUPERHEATER)	1	SET
2	B.I.22 & B.I.28.1	ELECTRO HYDRAULIC ACTUATOR FOR LP BYPASS CONTROL VALVE (COMPLETE ASSEMBLY WITH CONTROL BLOCK)	2	NO.
3	B.I.23	LP BYPASS STOP VALVE (SET OF ALL INTERNALS REQUIRED TO COMPLETE ONE VALVE ASSEMBLY EXCEPT VALVE BODY AND BONNET)	1	SET
4	B.I.24 & B.I.28.2	ELECTRO HYDRAULIC ACTUATOR FOR LP BYPASS STOP VALVE (COMPLETE ASSEMBLY WITH CONTROL BLOCK)	2	NO.
5	B.I.25	WATER INJECTION VALVE FOR LP BYPASS SYSTEM – COMPLETE ASSEMBLY	2	NO.
6	B.I.28.3	ELECTRO HYDRAULIC ACTUATOR FOR WATER INJECTION VALVE OF LP BYPASS SYSTEM (COMPLETE ASSEMBLY WITH CONTROL BLOCK)	1	NO.
7	B.I.28.4	SEAL KIT FOR ELECTRO HYDRAULIC ACTUATOR FOR LP BYPASS STOP VALVE	12	SET
8	B.I.28.5	SEAL KIT FOR ELECTRO HYDRAULIC ACTUATOR FOR LP BYPASS CONTROL VALVE	12	SET
9	B.I.28.6	SEAL KIT FOR ELECTRO HYDRAULIC ACTUATOR FOR WATER INJECTION VALVE FOR LP BYPASS SYSTEM	12	SET
10	2.II.1	SOFT PACKING LIKE GASKETS, GLAND PACKING, O RINGS FOR LP BYPASS STOP VALVE.	2	SET
11	2.II.2	SOFT PACKING LIKE GASKETS, GLAND PACKING, O RINGS FOR LP BYPASS CONTROL VALVE	2	SET
12	2.III.3	ACTUATOR SPINDLE WITH PISTON FOR ELECTRO HYDRAULIC ACTUATOR FOR LP BYPASS STOP VALVE	1	SET
13	2.III.4	ACTUATOR SPINDLE WITH PISTON FOR ELECTRO HYDRAULIC ACTUATOR FOR LP BYPASS CONTROL VALVE	1	SET
14	I.2.A.1	SERVO VALVE FOR LP BYPASS CONTROL VALVE ACTUATOR	1	NO.
15	I.2.A.2	SERVO VALVE FOR ACTUATOR OF WATER INJECTION VALVE OF LP BYPASS SYSTEM	1	NO.
16	I.2.B.1	BLOCKING UNIT OF LPBP CONTROL VALVE ACTUATOR	1	NO.
17	I.2.B.2	BLOCKING UNIT OF WATER INJECTION VALVE OF LP BYPASS SYSTEM	1	NO.
18	I.4.1	ALL HOSES LP BYPASS VALVE ACTUATORS, WATER INJECTION VALVE ACTUATORS, HPSU OF LPBP SYSTEM AND REGENERATION CIRCUIT (COMPLETE SET FOR 1 TG SET)	2	SETS
19	I.D.1.2	SOLENOID VALVES FOR LPBP VALVES AND WATER INJECTION VALVE FOR LPBP SYSTEM	3 NO. EACH TYPE	

B. TABLE-2:-

C&I ITEMS

SL. NO.	CUSTOMER CLAUSE NO.	ITEM DESCRIPTION (C & I ITEMS)	QTY.	UNIT.
1	C.IX.1	LP BYPASS CONTROL FLUID PUMP MOTOR	1	NO.
2	C.IX.2	LP BYPASS CONTROL FLUID RECIRCULATION PUMP MOTOR	1	NO.
3	B.I.2.C.1	POSITION TRANSMITTER FOR LPBP CVS	1	NO.
4	B.I.2.C.2	POSITION TRANSMITTER FOR WV CVS	1	NO.
5	B.V.1 (i).1	PRESSURE TRANSMITTER	1	NO.
6	B.V.1 (i).2	LEVEL TRANSMITTER	1	NO.
7	B.V.2 (iv)	TEMPERATURE TRANSMITTER	2	NO.

TECHNICAL REQUIREMENTS :-

1. ALL THE SPARES MENTIONED ABOVE ARE FOR REPLACEMENT WITH THEIR PARTS IN THE MAIN EQUIPMENTS. INTERCHANGEABILITY OF THESE SPARES WITH THE ORIGINAL SUPPLY HAS TO BE ENSURED BY THE SUPPLIER.
2. ALL THE SPARES MUST BE PACKED IN SEALED TRANSPARENT PLASTIC BAGS AND CLEARLY MARKED OR LABELED ON THE OUTSIDE OF THE PACKING WITH ITS DESCRIPTION & ASSEMBLY PART NUMBERS.
3. QUALITY CHECKS & TESTING NORMS/REQUIREMENTS FOR SPARES SHALL BE AS PER APPROVED QUALITY PLAN (QP) APPLICABLE FOR THE MAIN EQUIPMENT.
4. ALL THE RELEVANT ASSEMBLY DRGS. SHALL BE FURNISHED BY THE VENDOR MARKING ALL THE OFFERED ITEMS.
5. OFFERED ITEMS SHALL BE CORRELATED WITH THE ITEMS MENTIONED IN THIS DRAWING & WITH RESPECTIVE BOM OF MAIN EQUIPMENT DRAWING.
6. ITEM WISE / UNIT WISE PRICE OF ALL MANDATORY SPARES ARE TO BE INCLUDED IN OFFER.

Ref.Drawing No

Sign & Date

Inventory No.

MAT. CODE : W99312301764

TYPE OF PRODUCT

OR

NAME OF CUSTOMER/PROJECT

STEAM TURBINE

BHARAT HEAVY ELECTRICALS LTD.
RANIPUR, HARDWAR

DRN	H SINGH	-SD-	23.10.2018	NO. OF VAR
CHD	AKS/NN	-SD-	24.10.2018	-
APPD	R RAWAT	-SD-	29.10.2018	73, 74

DEPT STE

SCALE NTS

WEIGHT (KG)

REF. TO ASSY. DRG.

ITEM NO.

NO. OF ITEMS

CARD CODE

DRAWING NO.

MANDATORY SPARES-LP BYPASS SYSTEM

3-12300-31100

7

22, 23, 24

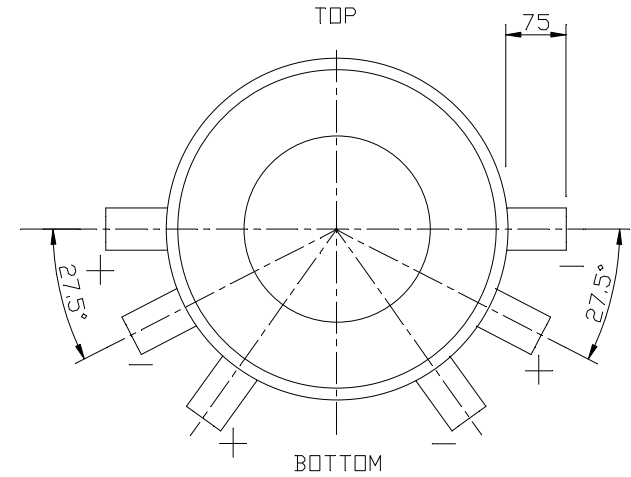
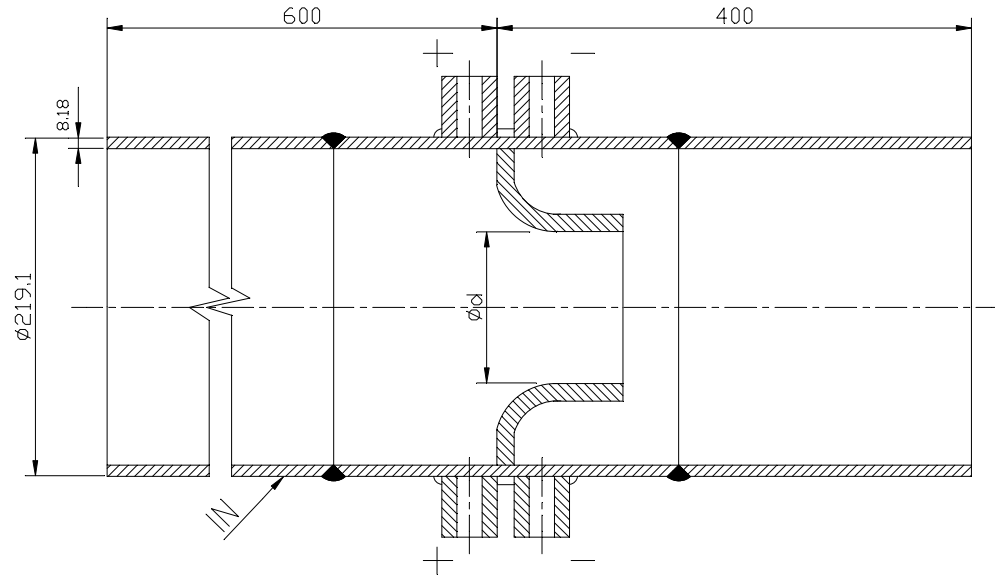
SHEET No.

1

No. OF SHEETS

1

DRAWING NO. 31336082501



TECH.REQUIREMENTS: –

TYPE	WELD IN TYPE WITH CORNER TAP AS PER ISA 1932.
MATERIAL OF NOZZLE	15 MO 3
PIPE MATERIAL	ASTM A106 Gr.B
PIPE SIZE.....	ø219.1x8.18
MEDIUM.....	CONDENSATE
MAXIMUM FLOW	135 Kg/Sec
OPERATING/DESIGN PRESS.....	18.2/46.1 BAR
OPERATING/DESIGN TEMP.....	30-65/100°C
DIFFERENTIAL PRESSURE	Approx. 1500m BAR
(AT MAX. FLOW)	
TAPS	3+3 CORNER TAPS SUTABLE FOR PIPE SIZE 13.5x2.6
TAP LENGTH	75 MM

DOCUMENTS WITH THE OFFER

1. DESIGN CALCULATIONS.
2. DRG. OF THE FLOW NOZZLE.
3. FLOW VERSUS DIFFERENTIAL OF PRESSURE CURVE.

MATERIAL CODE NO. W90313360545

[illegible]

SIZE A3

REF. DRG NO.

SIGN & DATE

INVENTORY NO.

3.1. Vendor must have previously designed (either by itself or under collaboration / licensing agreement), manufactured / got manufactured the equipment of the type and minimum equipment rating as per the details given below, such that the equipment is in successful operation in at least one (1) plant for a period not less than one (1) year prior to the date 03.03.17 :-

Name of Equipment	Type of Equipment	Equipment Rating
LP Bypass System	LP Bypass System For steam turbine generator sets	Capacity of each valve not less than 750 Ton/hr. at specified rated steam parameters (i.e. pressure & temperature)

3.2. In case the vendor is not manufacturer of proven equipment as per ‘**Clause 3.1**’ above but is a manufacturer for such equipment for units of at least 500 MW rating, the vendor can manufacture such equipment for 800 MW supercritical units also, provided it has collaboration or valid licensing agreement for design, engineering, manufacturing, supply of such equipment in India with such manufacturer(s) who meet the requirements stipulated at ‘**Clause 3.1**’ above for LP Bypass system.

3.3. A JV / Subsidiary Company formed for manufacturing and supply of LPBP system in India can also manufacture such equipment, provided that it has a valid collaboration or licensing agreement for design, engineering, manufacturing LP Bypass system in India with a qualified equipment manufacturer who meets the requirements stipulated at ‘**Clause 3.1**’ above (or the technology provider of the qualified equipment manufacturer). Further, in such a case, such qualified equipment manufacturers should have, directly or indirectly through its holding company/ subsidiary company, at least 26% equity participation in the Indian Joint Venture Company/ Subsidiary Company, which shall be maintained for a lock-in period of seven (7) years from the date of incorporation of such Joint Venture/ Subsidiary or up to the end of defect liability period of the contract, whichever is later. In addition, the sub-vendor along with the Indian Joint Venture Company/ Subsidiary Company, qualified equipment manufacturers and its holding/ subsidiary Company, as applicable, shall furnish DJU in which executants of the DJU shall be jointly and severally liable for the successful performance of the equipment as per the format in the bidding document. The DJU shall be submitted prior to the placement of order on the approved sub-vendor for a particular equipment. In case of award, each executant of the DJU be required to furnish an on demand bank guarantee for INR 1.5 Million (Rupees One and Half Million) for each equipment.

4. Before taking up the manufacturing LPBP system as per ‘**Clause 3.2 and 3.3**’ above, the vendor must create (or should have created) manufacturing and testing facilities at its works as per Collaborator / licensor’s design, manufacturing and quality control system for such equipment duly certified by the Collaborator / licensor. Further, the Collaborator / Licensor shall provide (or should have provided) all design, design calculation, manufacturing drawings and must provide (or should have provided) technical and quality surveillance assistance and supervision during manufacturing, erection, testing, commissioning of equipment.

5. Vendor shall be required to furnish the documents as required in Annexure-D for submission to the customer for their approval.

Name of Equipment	Name & Address of proposed Vendor	Name & address of proven equipment manufacturer (If proposed vendor himself does not meet the provenness criteria	Clause i.e. 3.1, 3.2 & 3.3 of Annexure-C against which qualification of vendor is sought
-------------------	-----------------------------------	--	--

LP Bypass

3.1*/ 3.2*/ 3.3*

System

1. If qualification is sought as per 'Clause 3.1' then details of the vendor shall be filled as per Annexure E.
2. If qualification is sought as per 'Clause 3.2' then details of the vendor is to be filled as per Annexure E & details of the collaborator (i.e. manufacturer of proven equipment) to be filled as per Annexure F.
3. If qualification is sought as per 'Clause 3.3' then details of the vendor as per Annexure E is to be filled & details of the collaborator (i.e. manufacturer of proven equipment) to be filled as per Annexure G.

* Strike out whichever is not applicable.

.....
Signature of authorized signatory

EPC PACKAGE FOR
PATRATU SUPER THERMAL POWER STATION EXPANSION PHASE-I
(3X800 MW)
BIDDING DOCUMENT NO. CS-9585-001-2

Bidder's Name and Address :

To
NTPC Limited
Noida -201301

S. No.	Item Description	Installation-1
1.00.00	Details of manufacturer of equipment for units of atleast 500 MW rating as per clause 3.2 of Sub-Section-I-A, Section-VI, Part-A.	
1.01.01	Name and Address of Sub-Vendor	
1.01.02	Name and Address telephone No. & Fax No. of responsible persons of the Sub-Vendor	
1.01.03	Name of the equipment to be supplied by the Sub-Vendor	
1.02.00	Details of Reference Plant	
1.02.01	Name of the Station and its Location	
1.02.02	Client Name and its Address, Fax No. & Tel.Nos.	
1.02.03	Name and Designation of the responsible person in Client's Organisation	
1.02.04	Contract No. & Date	
1.02.05	Capacity in MW of Unit and no. of Units	
1.02.06	Starting Date of Work / Date of Order	

Signature of authorized signatory.....

S. No.	Item Description	Installation-1
1.02.07	Scheduled Date of Completion	
1.02.08	Actual Date of Completion	
1.02.09	Date of Commissioning of System/Package	
	Whether the system/equipments are in successful operation prior to the date of techno-commercial bid opening	Yes/No
1.02.10	Date of Commencement of Successful Operation	
1.02.11	Brief Scope of Work	
1.02.12	M/s (Name of the Sub-vendor) is a regular manufacturer of (Name of the equipment) for units of atleast 500 MW rating	Yes/No
1.02.13	Certificate from such Owner that aforesaid equipment has been supplied by the sub-vendor and is running satisfactorily prior to the date of techno-commercial bid opening is enclosed to this Attachment at Annexure.....	Yes/No
1.02.14	The proposed sub-vendor M/s. has a collaboration/valid licensing agreement for design, engineering, manufacturing, supply of (Name of the equipment) in India with M/s (Name of Collaborator) who meets the requirement at clause no. 3.1 of sub-section-IA, Part-A, Section-VI & the relevant details are furnished at relevant Attachment (as applicable)	Yes/No
	Also the copy of Collaboration/Licensing agreement is enclosed to this Attachment at Annexure.....	Yes/No

Signature of authorized signatory.....

S. No.	Item Description	Installation-1
2.00.00	Details of Subsidiary/JV Company proposed for manufacturing of critical equipment as per Clause 3.3 of Sub-section-1A, Section-VI, Part-A	
2.01.00	Name and Address with Telephone Number of the Indian Subsidiary / JV Company proposed for manufacturing of (Name of the equipment).	
2.02.00	Name and Address with Telephone No. of the promoter(s) of the Subsidiary/ JV Company	
2.03.00	% of the Equity held by the promoter(s)	
2.04.00	Equity lock in period (from the date of incorporation of JV/Subsidiary Company)	
2.05.00	Name and Address with Telephone No. of a promoter of Subsidiary / JV Company formed at 2.01.00 above who meets the requirement of Clause 3.1 Sub-section-I-A, Section-VI, Part-A (Please furnish experience details as per relevant Attachment 3K)	
2.06.00	M/s. (the subsidiary/ JV Company) has a collaboration or valid licensing agreement with M/s (subsidiary/JV promoter) for design, Engineering, Manufacturing & Supply of (Name of the equipment) in India. Also the copy of Collaboration/Licensing agreement is enclosed to this Attachment at Annexure.....	Yes/No

Signature of authorized signatory.....

S. No.	Item Description	Installation-1
2.07.00	If equity held by the Qualified Equipment Manufacturer (as per clause 3.1)	
2.08.00	Whether equity held directly or indirectly ?	
2.09.00	If indirectly then furnish the relationship tree alongwith all relevant subsidiaries and holding company	
2.10.00	Please furnish the commitment for lock in period as per requirement	
2.11.00	Certified that DJU and Bank Guarantee shall be furnished as per format enclosed in the Bidding document meeting the requirement ?	
2.12.00	Bidder to furnish documentary evidence in support of above data	

Date : (Signature).....

Place : (Printed Name).....

(Designation).....

(Common Seal).....

Signature of authorized signatory.....

S. No.	Item Description	Station-I
--------	------------------	-----------

2. LP Bypass System

- | | |
|---------|--|
| 1.01.00 | Name, Address, Telephone Number of manufacturer |
| 1.02.00 | Name of the Station and its Location |
| 1.03.00 | Client Name and its Address, Fax No. & Tel. Nos. |

Signature of authorized signatory.....

S. No.	Item Description	Station-I
1.04.00	Name and Designation of the responsible person in Client's Organisation	
1.05.00	Contract No. & Date	
1.06.00	Capacity in MW of Unit and No. of Units	
1.07.00	Starting Date of Work/Date of Order	
1.08.00	Scheduled Date of Completion	
1.09.00	Actual Date of Completion	
1.10.00	Date of Commissioning of System/Package	
1.11.00	Whether the System/Equipments are in Successful Operation for a minimum period of one (1) year	Yes/No
1.12.00	Date of Commencement of Successful Operation	
1.13.00	Brief Scope of Work	
1.14.00	Brief Technical Particulars of the System/Package/Equipments	
	(i) Designed by	
	(ii) Manufactured by	
	(iii) No. of Valves per Unit	
	(iv) Type/Size	
	(v) Rated Steam Flow through each LP Bypass Valve (T/hr)	

Signature of authorized signatory.....

S. No.	Item Description	Station-I
	(vi) Rated Steam Parameters	
	(a) Steam Pressure at Inlet/Outlet [Kg/sq.cm. (g)]	
	(b) Steam Inlet/Outlet Temp. (deg.C)	
	(vii) Design Spray Water Flow (T/hr)	
	(viii) Spray Water Press/Temp. (ata/deg.)	
	(ix) Type of Actuator	
	(x) Control System designed by and manufactured by	
	(xi) Whether actuation is by Governor Oil System or not	
	(xii) Make / Model No.	
1.15.00	Is this LP Bypass system running with Steam Turbine Generator Sets	Yes/No

Signature of authorized signatory.....

Purchase Indent No. 20186520 rev 02

1. Total scope of supply against 3x800 MW Patratu project shall be as per the details given below:

SL. No.	Description	Quantity/TG set	Quantity for 3 Units
1.	LP Bypass Valve with EHA & Desuperheater	02 Sets	06 Sets
2.	Hydraulic Power Supply Unit (HPSU)	01 Set	03 Sets
3.	Water Injection Control Valve with Hydraulic Actuator	02 Nos.	06 Nos.
4.	Flow Nozzle for WIV	02 Nos.	06 Nos.
5.	Dump Tube	02 Nos.	06 Nos.
6.	Steam Blowing devices for LPBP valves	02 Sets	02 Sets
7.	Hydraulic test devices for LPBP valve	02 Sets	02 Sets
8.	Assembly & disassembly device	01 Set	01 Set
9.	Flushing Device for Control Fluid System	01 Set	01 Set
10.	Filling and gauging device for hydraulic accumulator	01 No.	01 No.
11.	Manually operated control fluid pump for filling of fluid in CF Tank for HPSU	01 No.	01 No.
12.	Special tools & tackles as per clause-8.0 of ST47050 (Refer Point No. 3)	01 set	01 set
13.	Mandatory spares as per BHEL Drg No.3-12300-31100 (Refer Point No.-5)	01 Set	01 Set
14.	Commissioning Spares as BHEL Drg No.3-12300-56005	01 Set	01 Set
15.	Servo Valve (as spare)	01 No. each type & model	
16.	Solenoid Valve (as spare)	01 No. each type & model	
17.	Supervision and Training to customer during erection and commissioning at site for each TG set		

2. Following BHEL Drawings/specification may be referred:

- Drg. No.2-12300-31000 Rev. 01 (sh.01 &sh.02) for 'LP Bypass System'.
- ST47050 Rev.02.
- Drg. No. 3-12300-31001 Rev.00 for 'Input/Process data for LPBP valve and actuators'.
- Drg. No. 3-12300-31002 Rev.00 for 'Arrangement of LPBP valve along with associated equipment'.
- Drg. No.2-12300-31003 Rev.00 for 'Water Injection valve with Actuator'.
- Drg. No.3-12300-56005 Rev.03 for 'Commissioning spare parts for LP Bypass System.'
- Drg. No.3-13360-82501 for 'Flow Nozzle for W.I.V.'
- Drg. No.3-12300-31100 Rev 00 for 'Mandatory spares'.
- Drg. No.0-12321-56000 Rev.00 for 'Suspension of LP Bypass valve'.
- Drg. No.1-12300-56008 Rev 00 for 'Recommended Spares'.
- Annexure-II (Check list to be submitted along with the offer).
- Annexure-III Rev.04 (Master list of documents).

- In case special tools & tackles are not offered, these will have to be supplied free of cost, if required, at any stage of the project in future.
- Additional 4 set of packing/ gaskets applicable for steam blowing devices shall also be supplied by the vendor to take care the requirement against Unit-2 & 3.
- Mandatory spares shall be packed in a separate Box & shall be painted with Green color for easy identification at site.

ANNEXURE-II A**LP Bypass System - List for Documents to be submitted by the vendor
along with Check list (Annexure-II B) during offer stage**

Sl.No.	Document details	Enclosed (Yes/No)
1	GA drawing and Datasheet of LP bypass stop and control valve	
2	Cross-sectional drawing along with BOM of LP bypass stop and contro valve	
3	GA drawing and Datasheet of water injection valve	
4	Cross-sectional drawing along with BOM of Water injection valve	
5	GA drawing and Datasheet of Dump Tube (having information regarding total flow area, hole dia & Total No. of holes)	
6	GA drawing & Datasheet of HPSU	
7	Schematic diagram of HPSU and corresponing Bill of material	
8	Schematic diagrams of actuators and corresponing Bill of materials	
9	Flow Nozzle data sheet & drawing	
10	List of Mandatory spares duly correlated with the corresponding part no. of vendor's Bill of material of main equipment	
11	List of Commissioning spares duly correlated with the corresponding part no. of vendor's Bill of material of main equipment	
12	Priced list of recommended spares for future ordering.	
13	Priced offer of mandatory spares as per BHEL drawing 3-12300-31100	

Sign & Date:**Name:****Designation:**

		ANNEXURE-II (B)
Check list for Technical Evaluation of vendor offers for LPBP system.		
Project:660MW BHUSAWAL		BHEL Enquiry No.....
SL. No.	BHEL REQUIREMENT	VENDOR'S CONFIRMATION/ RESPONSE
A)	FOR LP BYPASS VALVES ALONG WITH ACTUATOR AND DESUPERHEATER	
1	All components of LP Bypass stop and control valve shall be designed for operation at design pressure 75 bar (a), temperature 608°C & corresponding steam flow 359.8 kg/sec as mentioned in BHEL drg. no. 3-12300-31001.	
2	LP bypass stop and control valve shall be suitable for operating conditions as mentioned in BHEL drg. no. 3-12300-31001.	
3	LP bypass stop and control valve shall also be suitable for operation at short term operating conditions (pressure & temperature) as per Technical requirement 2 of BHEL drg. no. 3-12300-31001.	
4	The material of LP bypass valve shall be as per cl. 1.1.3 (A) & (B) of BHEL drg. no. 3-12300-31001.	
5	Material of Suspension bracket of LP bypass valve shall be as per BHEL drg. no. 3-12300-31002.	
6	The selected Cv of LP bypass valve shall have sufficient margin (atleast 8%) over the maximum Cv value calculated as per operating conditons mentioned in BHEL drawing no. 3-12300-31001.	
7	The weld end details of LP bypass valve shall be as per BHEL drg. no. 3-12300-31002 and clause 1.1.5 of BHEL drg. nos. 2-12300-31000.	
8	Arrangement and all the dimensions of LP bypass valve shall be strictly as per BHEL drg. no. 3-12300-31002.	
9	Suspension arrangement of LP bypass valve shall be as per BHEL drg. no. 3-12300-31002 and 0-12321-56000.	
10	The valve characteristics of LP bypass valve should be linear as per BHEL drg. no. 3-12300-31001.	
11	Sizing of LP bypass valve actuator shall be done for normal working pressure of 160 bar & min. working pressure of 115 bar.	
12	Actuator sizing calculation shall be submitted by the vendor in the event of ordering as per clause 1.1.7 (b) of BHEL drg. no. 2-12300-31000 and there shall be sufficient margin (atleast 15 %) in the actuator as mentioned in BHEL drg. no. 2-12300-31000.	
13	The control block of actuator should be mounted on actuator itself.	
14	The size & material of warm up & drain connection of LP bypass valve shall be as per clause 1.1.10 of BHEL drg. no. 2-12300-31000.	
15	The Steam blowing device shall be designed for design parameters mentioned as per clause 1.1.12 of BHEL drg. no. 2-12300-31000.	
16	In failure mode, LP bypass stop valve shall be in closed condition as per clause 1.1.14 of BHEL purchase specification drg. no. 2-12300-31000.	
17	All the components selected for actuator viz. Servo valve, Solenoid valve, position transmitter etc. shall be proven as per clause 1.1.15 of BHEL drg. no. 2-12300-31000.	
18	Steam strainer to be provided with the specified hole size as per clause 1.1.16 of BHEL drg. no. 2-12300-31000.	
19	The operating time (opening, closing & trip) of LP bypass valve shall be as per clause 6.2 of BHEL specification ST47050.	
20	The valve seat leakage class shall confirming to MSS SP61 as per clause 4.3 of BHEL specification ST47050.	
21	Weight of LP bypass valve duly assembled with actuator & desuperheater shall be as per note 2 of BHEL drg. no. 3-12300-31002.	
22	Size & orientation of Condensate supply connection at LP bypass valve outlet shall be as per BHEL drg. no. 3-12300-31002.	
23	The LP bypass valve shall be IBR certified as per clause 5 of BHEL specification ST47050.	

SL. No.	BHEL REQUIREMENT	VENDOR'S CONFIRMATION/ RESPONSE
24	The allowable forces & moments at LPBP Valve Inlet, LPBP Valve Outlet & Condensate supply connection shall be as mentioned in BHEL drg. no. 3-12300-31002.	
25	The operating philosophy of LP bypass actuator shall be "FRF PRESSURE TO OPEN AND SPRING FORCE TO CLOSE" as per clause 1.1.17 of BHEL drg. no. 2-12300-31000.	
26	The LP bypass stop and control valve along with actuators and HPSU shall be suitable for operation (opening and closing of valves against corresponding steam flow) for conditions specified as per technical requirement 1 & 2 of BHEL drawing 3-12300-31001	
B)	<u>FOR WATER INJECTION VALVE</u>	
1	Water injection valve shall be designed as per design parameters mentioned in BHEL drg no. 2-12300-31003.	
2	The overall dimensions of Water injection valve shall be as per BHEL drg no. 2-12300-31003.	
3	The size & material of weld ends of Water injection valve (inlet & outlet) shall be as per BHEL drg no. 2-12300-31003.	
4	Valve to be supplied along with Inlet/Outlet counter flanges (Weld neck, Raised type), associated fasteners and sealing as per T.R. 1 of BHEL purchase specification drg no. 2-12300-31003.	
5	The body material of Water injection valve shall be cast steel (ASTM A216 WCB) as per BHEL drg no. 2-12300-31003.	
6	The selected Cv of Water injection valve shall have sufficient margin (atleast 15%) over the maximum Cv value calculated for design water mass flow i.e. 122.3 Kg/sec as mentioned in BHEL drawing no. 2-12300-31003.	
7	The valve characteristics of Water injection valve should be equal % as per BHEL drg no. 2-12300-31003.	
8	Sizing of Water injection valve actuator shall be done for normal working pressure of 160 bar & min. working pressure of 115 bar as per BHEL drg no. 2-12300-31003.	
9	The water injection valve shall be capable of manual operation as per T.R. 5 of BHEL drg no. 2-12300-31003.	
10	The control block of actuator shall be mounted on actuator itself as per T.R. 6 of BHEL drg no. 2-12300-31003.	
11	Actuator sizing calculation shall be submitted by the vendor as per BHEL specification requirements and there shall be sufficient margin (atleast 15 %) in the actuator as mentioned in BHEL purchase specification.	
12	All components of selected for actuator viz. Servo valve, Solenoid valve, position transmitter etc. shall be proven.	
13	The opening time of Water injection valve shall be 3 sec. (max.) as per BHEL drg no. 2-12300-31003.	
14	The strength & Leak tightness test shall be as per T.R. 8 of BHEL drg no. 2-12300-31003.	
15	Hydraulic testing of valve body shall be carried out as per T.R. 9 of BHEL drg no. 2-12300-31003.	
16	In failure mode, water injection valve shall be in stay-put condition as per T.R. 10 of BHEL drg no. 2-12300-31003.	
17	Valve configuration shall be "Flow to close" as per T.R. 11 of BHEL drg no. 2-12300-31003.	
C)	<u>FOR HYDRAULIC POWER SUPPLY UNIT</u>	
1	The hydraulic power supply unit shall be suitable for operation of all actuators of LP bypass valve & water injection valve.	
2	The hydraulic power supply unit shall be supplied with all the required items & instruments as per BHEL purchase specifications requirements.	

SL. No.	BHEL REQUIREMENT	VENDOR'S CONFIRMATION/ RESPONSE
3	All the components of hydraulic power supply unit viz. pumps, motors, coolers, accumulators, filters, instruments etc. shall be proven as per Cl. 1.2.3 of BHEL drg. no. 2-12300-31000 . Further, sizing calculation of major components of HPSU such as Tank, Pumps, Coolers, Accumulators shall be provided for BHEL review after placement of order.	
4	The hydraulic power supply unit shall be supplied with protective cabinet as per Cl. 1.2.4 of BHEL drg. no. 2-12300-31000 .	
5	The hydraulic power supply unit shall be supplied with proven Regeneration unit as per Cl. 1.2.6 of BHEL drg. no. 2-12300-31000 .	
6	The sizing of HPSU cooler shall be done as per parameters given in Cl. 1.2.7 of BHEL drg. no. 2-12300-31000 .	
7	The sizing of accumulators of HPSU shall be done as per Cl. 7.0 of BHEL specification ST47050 .	
8	All the surface of cooler coming in contact of FRF shall be made from stainless steel.	
9	The cooler should be having sufficient margin in the provided surface area (atleast 15 %) viz-a-viz the calculated surface area.	
10	Water Regulating Valve applicable for cooling circuit arrangement of Cooler in HPSU shall be as per note-1 mentioned in Sheet-2 of BHEL drawing no. 2-12300-31000 .	
11	The cooling circuit arrangement & connections of Cooler in HPSU shall be as per Sheet-2 of BHEL drawing no. 2-12300-31000 .	
12	The vendor to provide 3 no. pressure & 3 no. return line connections in HPSU as per cl. 7.0 of BHEL specification ST47050 .	
13	Fasteners and foundations Bolts for fastening of HPSU shall be in vendor's scope as per Cl. 1.1 Note-ii of BHEL specification ST47050 .	
	D) FOR DUMP TUBE	
1	Design of Dump Tube shall be carried for the following parameters:- Steam flow- 412.81 Kg/sec (290.51+122.3), Outlet Steam Pressure & Temp.- 0.2133 bar & 61.5 deg. C, with additional 5% margin on calculated number of holes.	
2	The vendor to confirm to supply Dump tube meeting all the requirements of Cl. 1.5 of BHEL drawing no. 2-12300-31000 .	
3	Dump tube shall be of 2 stage. Pressure after first stage of dump tube shall be 3 bar for case -1 mentioned in BHEL drawing no. 3-1230031001.	
	E) C&I REQUIREMENTS	
1	Vendor to confirm that all the points mentioned in C&I addendum to ST47050 are acceptable. Note: - Any deviation shall be separately specified.	
2	Vendor to confirm Flow nozzle and its documents shall be in line with flow nozzle drawing no. 3-13360-82501	
3	Vendor to confirm that all C&I interfaces with DCS shall be in line with previous supplied LPBP system (if any) to BHEL of similar rating except for project specific changes. Note:- Kindly mention project name (if applicable).	
4	Vendor to confirm that the signals from Junction box shall directly go into BHEL DCS. There shall be no controlling element (control box or so) in vendor scope. All the equipments shall be directly controlled from BHEL DCS.	
5	Vendor to indicate corresponding KKS tags/part no. of main supply in mandatory spare list.	
6	Vendor to confirm that in main supply BOM, if more type of instruments are found w.r.t mandatory spares offered by vendor, then supply of spares (i.e. PG, DPS, PS etc.) shall be as per BHEL specification.	
7	Vendor to confirm that C&I spares packing list shall be separate from the main supply and the same shall be approved by BHEL.	

SL. No.	BHEL REQUIREMENT	VENDOR'S CONFIRMATION/ RESPONSE
F)	GENERAL REQUIREMENTS	
1	The vendor to confirm that the vendor's offer is inline with BHEL specification requirements. Any deviation is to be separately specified by the vendor.	
2	The working fluid and functional/testing requirements of complete LP bypass system shall be as per clause 1.1.8, 1.1.9 of BHEL drawing no. 2-12300-31000 and clause 10 of BHEL specification ST47050.	
3	The size & material of terminal connections in actuators & HPSU shall be as per Cl. 3.2 of BHEL drawing no. 2-12300-31000.	
4	All the flanged end connection of HPSU, Actuators & equipments of LP bypass system shall be supplied with matching counter flanges, seal & fasteners by vendor for piping connection by BHEL.	
5	Applicable tightening torques for all the Bolts/Nuts shall be provided by the vendor in drawing of all the equipment as per Cl. 3.3 of BHEL drawing no. 2-12300-31000.	
7	Thermal expansion values at all terminal connections shall be provided by the vendor as per Cl. 3.5 of BHEL drawing no. 2-12300-31000.	
8	The equipment tolerances shall be as per Cl. 3.8 of BHEL drawing no. 2-12300-31000.	
9	Painting of equipment shall be as per Cl. 5.1 of BHEL drawing no. 2-12300-31000.	
10	Maximum noise level of LP bypass system shall be as per Cl. 4.6 of BHEL specification ST47050.	
11	The sizing calculation & selection of equipment of LPBP system shall be adequate w.r.t. BHEL specification requirements & any modification if required, at a later stage during detailed engineering, will be done by vendor without any price implication to BHEL.	
12	The vendor to confirm that quantity of FRF i.e. 800 liters is sufficient for Flushing, First fill & Top up for one year of operation as per Cl. No.-6.4(a) of ST47050. However, supply of FRF is in BHEL scope.	
13	The vendor to confirm that mandatory spares shall be supplied as per BHEL drawing no. 3-12301-31100 with proper correlation with corresponding part no. of vendor's BOM/Drawing of main equipment .	
14	The vendor to confirm that Commissioning spares shall be supplied as per BHEL drawing no. 3-12300-56005 with proper correlation with corresponding part no. of vendor's BOM/Drawing of main equipment .	
15	In the event of ordering, if it is found that any mandatory/commissioning spares as per BHEL specification has not been included in vendor's list, then the same shall be supplied by the vendor without any price implication. The vendor to confirm.	
16	In case of order, the vendor to supply 22 no. Hard copies & 4 no. CDs Of O&M manuals at BHEL Hardwar as per MDL (Annexure-iii). 3 no. Hard copies & 1 no. CD of O&M manual shall be supplied along with equipments at site.	
17	Storage & handling instructions of the equipments shall be furnished by the vendor separately and 2 copies of the same shall be supplied to site along With main equipment.	
18	Instructions for packing: A) All the equipment/items shall be supplied in closed steel boxes/closed wooden boxes with steel cover sheet. Packing boxes should be rain proof. B) Packaging of item should be done in such a way that it should not require any internal package inspection for at least one year. C) Packing box of mandatory spares shall be painted with green colour for easy identification at project sites.	

Annexure-III**MASTER LIST OF DOCUMENTS (MDL) OF LP BYPASS SYSTEM (STE-TG)****Rev.04 Dt.01.05.12**

Sl. No.	Document	Remarks
<u>A. Documents to be submitted for BHEL reference prior to manufacturing:</u>		
1.	LP bypass stop and control valve sizing calculations	STE-TG
2.	Water injection valve sizing calculations	STE-TG
3.	LP bypass stop and control valve actuator selection sheet/sizing calculations	STE-TG
4.	Water injection valve actuator selection sheet/sizing calculations	STE-TG
5.	HPSU & its major component sizing calculations	STE-TG
6.	Desuperheater sizing calculation	STE-TG
7.	Dump tube sizing calculation	STE-TG
8.	HPSU water cooler diagram/ detailed technical catalogues including type/size/material of end connections for water inlet/outlet.	STE-TG
9.	Feed forward philosophy (Enthalpy based control) for spray water	STE-TG/CIE
10.	Complete system write up for LPBP system	STE-TG
11.	CV test report	STE-TG
<u>B. Documents to be submitted for BHEL approval prior to manufacturing:</u>		
1.	LP bypass stop and control valve cross sectional drawing, datasheet & bill of material	STE-TG
2.	GA drg. Of LP bypass stop and control valve with Desuperheater & dump tube indicating overall & dismantelling dimension and weight	STE-TG
3.	WIV drawing, datasheet & bill of material	STE-TG
4.	HPSU GA drawing data sheet & bill of material	STE-TG
5.	HPSU schematics	STE-TG/CIE
6.	I & R Diagram system	STE-TG/CIE
7.	Steam blowing device & bill of material	STE-TG
8.	Details of Oil/FRF flushing device	STE-TG
9.	Flow nozzle datasheet as per ISO 5167	CIE
10.	Flow nozzle drawing	CIE
11.	Flow nozzle characteristic curve between differential pressure and flow (indicating calculation formula also)	CIE
<u>C. Other documents to be submitted for BHEL approval :-</u>		
1.	LP bypass stop and control valve actuator drawing & bill of material	STE-TG
2.	WIV actuator drawing & bill of material	STE-TG
3.	O & M manual	STE-TG
4.	Shipping/dispatch plan of the offered equipments including details of each boxes & sub boxes	STE-TG
5.	WPS field piping for the system and recommendations	STE-TG/HXE
6.	Instructions for sequence of erection & commissioning along with supporting drawings/sketches	STE-TG
7.	List of special materials tools, equipments, facilities required for erection and commissioning.	STE-TG

Notes:

1. The vendor to submit the documents within 4 weeks from the data of placement of purchase order.

2. While submitting the documents the vendor to clearly mention the exceptions w.r.t. the documents already approved earlier by BHEL against similar projects.

C&I ADDENDUM TO ST47050 REV. 02 (Patratu)

1. Under Clause no. 6.1.1, Position transmitter of only Balluf make is acceptable.
2. Under Clause no. 7.1.1, Pressure switches are to be provided for changeover of Circulation Pump Units. Flow switches shall not be accepted.
3. Clause no. 7.1.1 (a) should be read as 'Three (3) no. Pressure Transmitters are to be provided in HPSU Header. Pressure Transmitters at individual discharge line of each CFP shall not be accepted'.
4. Under Clause no. 7.1.1 (g), complete instrument list shall contain the range, model no. ordering code, set point, make and process connection for all the instruments.
5. Under Clause no. 7.1.2 and 12.2.2, for Interfacing with DCS only Servo valve should be considered. Wherever in the BHEL specification Proportional valve should be read as Servo valve.
6. Under Clause no. 7.1.2, (a) +/-7.5 mA signal should not be considered as it corresponds to Proportional valve. Only +/-30mA or +/-50mA shall be applicable for Servo Valve.
7. Under Clause no. 7.1.2, following additional points to be noted and considered:
 - a. 20% spare Terminals in the JB are to be provided
 - b. Cable Gland to be provided in JB for DCS end also.
8. Under Clause no. 7.1.3, following additional points should be considered:
 - 1.) a. Motors above 2KW shall be of Premium efficiency class IE3, conforming to IS 12615, or IEC:60034- 30 and also comply with the requirements stipulated in IEC: 60034- 18-41 and IEC: 60034-18-42 as applicable.
 - b. Complete Load list including power, voltage supply, rated current, starting current and RPM values is to be furnished within 4 weeks from the date of placement of P.O.
 - c. Motor shall be painted with corrosion proof paints as per IS-5.
 - d. Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.
- 2) Terminal box for Motors shall comply with following requirements
 - a. Terminal box shall be dust and vermin proof (IP54).
 - b. **DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS Motor MCR in KW**
Minimum distance between center of stud and gland plate in mm
UP to 3 KW as per manufacturer's practice.
Above 3 KW – up to 7 KW 85
Above 7 KW – up to 13 KW 115
Above 13 KW – up to 24 KW 167
9. Under Clause no. 6.1 (a),
 - Appendix 3&4 and Appendix 5 should be specially paid attention.
 - a) All the instruments, equipment's and their KKS tags should be as per the schemes only. In addition to this scheme there should be additional Temperature Transmitters at the Inlet and Outlet of Control fluid (while entering into the Water cooler).
 - b) Following points should be specially noted:
Filter and its Differential pressure switch should be provided in each oil supply line for each servo valve.


(Ashutosh Srivastava)


(Suresh Chandra)

C&I ADDENDUM TO ST47050 REV. 02 (Patraru)

10. Type Test report (As per BS-6647/IEC60770) of all Electronic Transmitters is required for Customer Approval.
11. Under Clause no. 7.0, Appendix 2 should be read in conjunction with Annexure 2. All the instruments, equipment and their KKS tags should be as per this scheme (Annexure 2) only. Following points should be specially noted:
 - a) Separate motor for regeneration unit should be provided.
 - b) Only one heater (If applicable) of suitable rating should be provided.
12. Under Clause no. 7.0, for Water Cooler (if applicable), mechanical thermostatic valves should be provided for control of oil flowing through the Water cooling circuit thus altogether maintaining the uniform oil temperature in the tank. This Thermostatic valve shall operate independently and no signal exchange from BHEL DCS shall take place.
13. Under Clause no. 11.2, List of Mandatory spares furnished by supplier shall duly mention all the KKS tags for which the corresponding item is applicable.
14. Junction Boxes for the Instruments shall be of Pyrotech, Rittal or equivalent Make , standard off the shelf available in market .
15. Process connection for the different type of instruments shall be as follows:
 - a. Level Transmitter MAX05CL001/2/3: G $\frac{3}{4}$ Threaded
 - b. Temperature Transmitter MAX05 CT001/2: G $\frac{1}{2}$
 - c. Level Gauge MAX05 CL501: M10
 - d. All Pressure Gauges : G $\frac{1}{2}$
 - e. Leakage sensor: M30
 - f. All Pressure Switches: G $\frac{1}{2}$
 - g. All Differential Pressure Switches: G $\frac{1}{2}$
 - h. All Pressure Transmitters: $\frac{1}{2}$ " NPT

Ashutosh
8/9/18


(Ashutosh Srivastava)

Suresh Chandra
8/9/18

(Suresh Chandra)


MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL			
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114						
				DATED	10/09/2014							
		DRG. NO.	AS PER PO									
		SPEC.	AS PER PO									
		REV	02		Page 1 of 11							
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS
									M	B	N	
1	2	3	4	5	6	7	8	9	D	10		11

LP BYPASS STOP & CONTROL VALVE												
1.0	RAW MATERIAL											
1.1	VALVE BODY	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		B. MECHANICAL PROPERTIES	MAJOR	-MECH. TEST	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		C. NDT	MAJOR	UT RT MPI	100%(EXCEPT WELD ENDS) ON WELD ENDS 100%	AS PER APPROVED DATASHEET/ DRAWING	TC	√	P	V		
1.2	BONNET	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		B. MECHANICAL PROPERTIES	MAJOR	-MECH. TEST	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		C. NDT	MAJOR	UT MPI	100% 100%	AS PER APPROVED DATASHEET	TC	√	P	V		
1.3	NOZZLES	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		B. MECHANICAL PROPERTIES	MAJOR	-MECH. TEST	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		C. NDT	MAJOR	UT/MPI	100%	AS PER APPROVED DATASHEET	TC	√	P	V		
1.4	TRANSITION PIECES	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		B. MECHANICAL PROPERTIES	MAJOR	-MECH. TEST	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		
		C. NDT	MAJOR	UT/MPI	100%	AS PER APPROVED DATASHEET	TC	√	P	V		
1.5	SUSPENSION	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PER APPROVED DATASHEET	TC	√	P	V		

MANUFACTURER/SUB CONTRACTOR		LEGEND:	FOR CUSTOMER USE
		! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	
		APPROVED BY	

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL					
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114								
				DATED	10/09/2014									
		DRG. NO.	AS PER PO											
		SPEC.	AS PER PO											
		REV	02		Page 2 of 11									
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS		
1	2	3	4	5	6	7	8	9	D	M	B	N	10	11

		B.MECHANICAL PROPERTIES	MAJOR	-MECH.TEST	PERHEAT	AS PERAPPROVED DATASHEET	TC	√	P	V			
		C.NDT	MAJOR	UT/MPI	100%	AS PERAPPROVED DATASHEET	TC	√	P	V			
1.6	BOLTS /NUTS	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PERAPPROVED DATASHEET	TC	√	P	V			
		B.MECHANICAL PROPERTIES	MAJOR	-MECH.TEST	PERHEAT	AS PERAPPROVED DATASHEET	TC	√	P	V			
1.7	ACTUATOR	CHECKS ON ACTUATOR	MAJOR	TCREVIEW	PERPIECE	AS PERAPPROVED DATASHEET	COC	√	P	V			
2.0	MANUFACTURING												
2.1	MACHINING PARTS	VISUAL& DIMENSIONAL INSPECTION	MAJOR	VISUAL/ MEASUREMENT	PERPIECE	SHOPTRAVELER	-	√	P				
2.2	WELDING & HEAT TREATMENT	WPS	MAJOR	VISUAL TIME/TEMPERATURE	PERPIECE	EN287 /ASMEIX		√	P				
2.3	ASSEMBLY	ASSY.DRWG.	MAJOR	VISUAL	PERPIECE	AS PERAPPROVED ASSY.DRAWING		√	P				
3.0	TESTING & INSPECTION												
3.1	NDEWELDING	RT/UT	MAJOR	RT/UT	PERPIECE	ASMESEC.V/VIII/ HW0980830	TC	√	P	W	-		N CASE OF RT VERIFICATION OF X-RAY FILM
3.2	NDEWELDING	MT/ PT	MAJOR	MT/PT	PERPIECE	ASME SEC. V/VIII/HW0980829	TC	√	P	W	-		N CASE OF RT VERIFICATION OF X-RAY FILM
3.3	HYDROSTATIC PRESSURETEST	ASSY.DRWG.	MAJOR	HYDRAULICTEST	ALLVALVES	AS PERAPPROVED DATASHEET/ DRAWING	TC	√	P	W	-		BRFORM
3.4	SEATLEAKAGE	ASSY.DRWG.	MAJOR	LEAKAGETEST	ALLVALVES	AS PERAPPROVED DATASHEET/ DRAWING	TC	√	P	W	-		

MANUFACTURER/SUB CONTRACTOR		LEGEND:	FOR CUSTOMER USE	APPROVED BY
		! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER		

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL					
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114								
				DATED	10/09/2014									
		DRG. NO.	AS PER PO											
		SPEC.	AS PER PO											
		REV	02		Page 3 of 11									
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS		
1	2	3	4	5	6	7	8	9	D	M	B	N	10	11

3.5	DIMENSION& WALL- THICKNESS CHECK	WELDING+ MAIN DIMENSION	MAJOR	MEASUREMENT	ALLVALVES	AS PERDRAWING	TC	√	P	V			
3.6	NDE MACHINED	PT	MAJOR	PT	ALLVALVES	ASMESEC. V/VIII/HW0980829	TC	√	P	V			
3.7	FUNCTION / PERFORMANCE TEST	FUNCTIONALTEST AS PERAPPROVED TEST PROCEDURE	MAJOR	PERFORMANCE	ALLVALVES	AS PERAPPROVED DATASHEET/ DRAWING	TC	√	P	W			ACTUATOR +VALVE
	NOISELEVEL	CONFIRMATION FOR MEETING NOISE LEVEL	MAJOR	NOISETEST					P	V			
3.8	CV TEST		MAJOR	CV TEST	PERDESIGN	AS PERAPPROVED DATASHEET/ DRAWING	TC	√	P	V			
3.9	PAINTING,PACKI NG AND PRESERVATION		MAJOR	VISUAL	ALLVALVES	VENDOR'S STANDARD	-	√	P				

MANUFACTURER/SUB CONTRACTOR	 Digitally signed by Sanjeev Kr. Bhardwaj Date: 2020.02.29 11:14:47 +05'30'	LEGEND: ! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	
				APPROVED BY

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL				
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114							
				DATED	10/09/2014								
		DRG. NO.	AS PER PO										
		SPEC.	AS PER PO										
		REV	02		Page 4 of 11								
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS		CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS		AGENCY		REMARKS
1	2	3		4	5	6	7	8	9	D	10		11

HPSU												
1	INCOMING MATERIAL CONTROL											
1.1	OILTANK	DAMAGE	MAJOR	VISUAL	100%	MANUFACTURERDRAWING	COC	√	P	V		
		DIMENSIONS	MINOR	MEASURMENT	100%	MANUFACTURERDRAWING	COC	√	P	V		
		VERIFICATION OF SUPPLIER CERTIFICATE, IDENTIFICATION& CORRELATION FOR RAW MATERIAL PLATES	MAJOR	CERTIFICATE REVIEW	100%	MANUFACTURERDRAWING	COC	√	P	V		
1.2	BOUGHT OUT ITEMS											
	LEVEL TRANSMITTER	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		MODEL CODE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		CALIBRATION	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	PRESSURE TRANSMITTER	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		MODEL CODE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		CALIBRATION	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	TEMPERATURE TRANSMITTER	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		MODEL CODE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		CALIBRATION	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		

MANUFACTURER/SUB CONTRACTOR	 Digitally signed by Sanjeev Kr. Bhardwaj Date: 2020.02.29 11:14:57 +05'30'	LEGEND: ! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	APPROVED BY


MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL					
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114								
				DATED	10/09/2014									
		DRG. NO.	AS PER PO											
		SPEC.	AS PER PO											
		REV	02		Page 5 of 11									
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS		
1	2	3	4	5	6	7	8	9	D	M	B	N	10	11

	THREEPHASE MOTORS	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		MODEL CODE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		VERIFICATION OF SUPPLIER CERTIFICATE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	ACCUMUFATOR S	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		MODEL CODE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		PRESSURE TEST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	PRESSURE RELIEF VALVES	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		MODEL CODE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		ADJUSTMENT	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	PRESSURE GUAGES	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		MODEL CODE	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
		CALIBRATION	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	THERMOMETER	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	CF AIR COOLER	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		
	COOLING CUM FILTERATION	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P	V		

MANUFACTURER/SUB CONTRACTOR	Digitally signed by: Sanjeev Kr. Bhardwaj Date: 2020.02.29 11:15:08 +05'30'	LEGEND:	FOR CUSTOMER USE
		! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	
		APPROVED BY	

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL				
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114							
				DATED	10/09/2014								
		DRG. NO.	AS PER PO										
		SPEC.	AS PER PO										
		REV	02		Page 6 of 11								
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS		CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS		AGENCY		REMARKS
									D	M	B	N	
1	2	3		4	5	6	7	8	9		10		11

	CFPUMPS	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P			
	GEARPUMPS	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P			
	COUPLING	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P			
	FILTERS	DAMAGE, RUST	MAJOR	VISUAL	100%	DRG./DATASHEET	COC	√	P			
2	FUNCTION TEST /FINAL INSPECTION											
2.1	HPSU	DIMENSIONS	MAJOR	MEASUREMENT	100%	AS PERDRAWING	TC	√	P	W		
2.2	HPSU	CORRECT FITMENT	MAJOR	VISUAL	100%	AS PERDRAWING/CIRCUIT DIAGRAM	TC	√	P	W		
2.3	HPSU	FUNCTION TEST	MAJOR	MEASUREMENT	100%	FP_0019	TC	√	P	W		
2.4	HPSU	PAINTING	MAJOR	VISUAL	100%	DRG./VENDORPROCEDURE	-	√	P			

MANUFACTURER/SUB CONTRACTOR	 Digitally signed by: Sanjeev Kr. Bhardwaj Date: 2020.02.29 11:15:19 +0530'	LEGEND: ! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	APPROVED BY

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL			
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114						
				DATED	10/09/2014							
		DRG. NO.	AS PER PO									
		SPEC.	AS PER PO									
		REV	02		Page 7 of 11							
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS
									M	B	N	
1	2	3	4	5	6	7	8	9	D	10		11

WATER INJECTION VALVES												
1.0	RAW MATERIAL											
1.1	BODY & BONNET	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PER APPROVED DATA SHEET	TC	√	P	V		
		B. MECHANICAL PROPERTIES	-	MECH. TEST	PERHEAT	AS PER APPROVED DATA SHEET	TC	√	P	V		
		C. APPEARANCE	-	VISUAL INSPECTION	PER LOT	MSS SP-55	TC	√	P	V		
1.2	STUDS & NUTS	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	EN 10204 TYPE 3.1 ASTM A193 B7 ASTM A194 2H	TC	√	P	V		
		MECHANICAL PROPERTIES	-	MECH. TEST	PERHEAT	EN 10204 TYPE 3.1 ASTM A193 B7 ASTM A194 2H	TC	√	P	V		
2.0	ASSEMBLY											
2.1	STEM	DIMENSION / VISUAL	MAJOR	VISUAL & DIMENSIONAL INSPECTION	PER LOT	DRAWING	COC	√	P			
2.2	PLUG	DIMENSION / VISUAL	MAJOR	VISUAL & DIMENSIONAL INSPECTION	PER LOT	DRAWING	COC	√	P			
2.3	SEAT RING	DIMENSION / VISUAL	MAJOR	VISUAL & DIMENSIONAL INSPECTION	PER LOT	DRAWING	COC	√	P			
2.4	BODY ASSLY	A. HYDRO	MAJOR	HYDRO	ALL VALVES	AS PER APPROVED DATA SHEET / DRG.	TEST REPORT	√	P	W		
		B. SEAT LEAKAGE	MAJOR	LEAKAGE	ALL VALVES	AS PER APPROVED DATA SHEET / DRG.	TEST REPORT	√	P	W		
		C. FUNCTION	MAJOR	•FUNCTION •DIMENSION •PAINT	ALL VALVES	AS PER APPROVED DATA SHEET / DRG.	TEST REPORT	√	P	W		ASSEMBLED WITH ACTUATOR


MANUFACTURER/SUB CONTRACTOR  Digitally signed by Sanjeev Kr. Bhardwaj Date: 2020.02.29 11:15:30 +05'30'	LEGEND: 1 RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	
			APPROVED BY

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL				
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114							
				DATED	10/09/2014								
		DRG. NO.	AS PER PO										
		SPEC.	AS PER PO										
		REV	02		Page 8 of 11								
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS	
1	2	3	4	5	6	7	8	9	D	M	B	N	11
2.5	TOPASSLY	A.DEMENSION / VISUAL	MAJOR	DEMENTIONAL/ VISUAL	ALLVALVES	TOPASSLY DRWG.	.	✓	P				ASSEMBLED WITH ACTUATOR
		B.PAINT	-	VISUAL	ALLVALVES	VENDOR'S STANDARD	.	✓	P				
		C.PACKING	-	VISUAL	ALLVALVES	BHELP.O. VENDOR'S STANDARD	.	✓	P				

MANUFACTURER/SUB CONTRACTOR	 Digitally signed by Sanjeev K. Bhardwaj Date: 2020.02.29 11:15:41 +05'30'	LEGEND:	FOR CUSTOMER USE	APPROVED BY
		1 RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION.		
		M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM.INSPECTION AGENCY N: CUSTOMER		
		INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION		
		ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER		

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL				
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114							
				DATED	10/09/2014								
		DRG. NO.	AS PER PO										
		SPEC.	AS PER PO										
		REV	02		Page 9 of 11								
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS		CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS		AGENCY		REMARKS
1	2	3		4	5	6	7	8	9	D	10		11

FLOW NOZZLE FOR WIV													
1.0	RAW MATERIAL												
	BRANCH PIPE	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PER LOT	AS PER APPROVED DATASHEET/ DRG.	TC	√	P	V			
		B. MECHANICAL PROPERTIES		-MECH. TEST		AS PER APPROVED DATASHEET/ DRG.	TC	√	P	V			
		C. NDT		UT		AS PER APPROVED DATASHEET/ DRG.	TC	√	P	V			
	FLOW NOZZLE	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	-DO-	AS PER APPROVED DATASHEET/ DRG.	TC	√	P	V			
		B. MECHANICAL PROPERTIES		-MECH. TEST		AS PER APPROVED DATASHEET/ DRG.	TC	√	P	V			
2.0	MANUFACTURING												
2.1	MACHINING PARTS	VISUAL & DIMENSIONAL INSPECTION	MAJOR	VISUAL/ DIMENSIONAL	PER PIECE	SHOP TRAVELER		√	P				
2.2	WELDING & HEAT TREATMENT	SEED DRAWING	MAJOR		PER PIECE	EN288 /ASME IX		√	P				
2.3	ASSEMBLY	SEED DRAWING	MAJOR	VISUAL	PER DESIGN	AS PER APPROVED DATASHEET/ DRG.		√	P				
3.0	TESTING & INSPECTION							√	P				
3.1	NDE WELDING	RT OR UT	MAJOR	RT/UT	PER PIECE	ASMESECV/VIII/HW0980830	TC	√	P	V			
	NDE MACHINED WELD END	PT	MAJOR	PT	PER PIECE	ASMESECV/VIII/HW0980830	TC	√	P	V			
3.2	HYDROSTATIC PRESSURE TEST	PRESSURE TEST	MAJOR	HYDRO	PER PIECE	AS PER APPROVED DATASHEET/ DRG./Follow HW0980829	TC	√	P	W			

MANUFACTURER/SUB CONTRACTOR		LEGEND: I RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	APPROVED BY

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL			
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114						
				DATED	10/09/2014							
		DRG. NO.	AS PER PO									
		SPEC.	AS PER PO									
		REV	02		Page 10 of 11							
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS	AGENCY			REMARKS
1	2	3	4	5	6	7	8	9	D	10	11	

3.3	DIMENSION CHECK	WELDEND + MAIN DIMENSION	MAJOR	DIMENSIONAL	PERPIECE	DRAWING	TC	√	P	W		
3.4	CALIBRATION REPORT		MAJOR	VISUAL	PERPIECE		COC	√	P	V		
4	FINAL INSPECTION PACK -& SHIPPING	VERIFICATION OF COMPLETION STAMPING PACKING	MAJOR	VISUAL	100%	AS PERAPPROVED DRAWING/ DATASHEET	COC	√	P	V		

MANUFACTURER/SUB CONTRACTOR	 Digitally signed by Sanjeev Kr. Bhardwaj Date: 2020.02.29 11:16:04 +05'30'	LEGEND: ! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	
				APPROVED BY

MANUFACTURER'S NAME AND ADDRESS			STANDARD QUALITY PLAN				TO BE FILLED BY BHEL		TO BE FILLED BY BHEL				
BHEL	VENDOR'S NAME	ITEM	LP BYPASS SYSTEM		QP NO.	QA/BI/QP/114							
				DATED	10/09/2014								
		DRG. NO.		AS PER PO									
		SPEC.		AS PER PO									
REV		02		Page 11 of 11									
SL. NO.	COMPONENT & OPERATIONS	CHARACTERISTICS		CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORDS		AGENCY		REMARKS
1	2	3		4	5	6	7	8	9	D	10		11


DUMP TUBE												
1.0	RAWMATERIAL											
1.1	DUMP TUBE	A. CHEMICAL COMPOSITION	MAJOR	CHEMICAL ANALYSIS	PERHEAT	AS PERAPPROVED DATASHEET	TC	√	P	V		
		B.MECHANICAL PROPERTIES	MAJOR	-MECH.TEST	PERHEAT	AS PERAPPROVED DATASHEET	TC	√	P	V		
		C.NDT	MAJOR	UT	100	AS PERAPPROVED DATASHEET	TC	√	P	V		
2.0	IN PROCESS											
2.1	WELDING & HEAT TREATMENT	WPS	MAJOR	VISUAL TIME/TEMPERATUR E	PERPIECE	ASMEIX / EN288		√	P	-		
2.2	NDEWELDING	RT MPI/DPT	MAJOR	RT MPI/DPT	PERPIECE	ASMESEC.V/VIII/ HW0980830	TC	√	P	W		

MANUFACTURER/SUB CONTRACTOR	 Digitally signed by Sanjeev Kr. Bhardwaj Date: 2020.02.29 11:16:16 +05'30'	LEGEND: ! RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION. M: MANUFACTURER / SUBCONTRACTOR B: BHEL / NOM. INSPECTION AGENCY N: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION ALL 'W' INDICATED IN COLUMN 'N' SHALL BE 'CHP' OF CUSTOMER	FOR CUSTOMER USE	APPROVED BY

मसौदा संख्या SIGN & DATE		उत्पाद मानक PRODUCT STANDARD	ST 47050			
			पृष्ठ 28 का 1 Page 1 of 28			
समीचीन संख्या को अधिकृतित करता है	SUPERSEDES INVENTORY NO.	Based on own experience				
Purchase Specification For <u>Combined LP Bypass Stop & Control Valves</u> <u>With Electro-hydraulic Actuators (EHA)</u> & <u>Hydraulic Power Supply Unit (HPSU)</u> For <u>Steam Turbine</u>						
स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।		COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited it must not be used directly or indirectly in any way detrimental to the interest of the company				
हस्ताक्षर एवं दिनांक SIGN & DATE	दिनांक एवं हस्ताक्षर SIGN & DATE	दिनांक एवं हस्ताक्षर SIGNATURE & DATE				
मसौदा संख्या INVENTORY NO. P-6301	दिनांक एवं हस्ताक्षर SIGN & DATE 12/8/11	C.I.E MEMBER-PSC QAX TSX सहमत विभाग AGREED DEPTT.	S.K.DAS V.K. CHAUHAN N.K.MANWANI B. CHOUDHARY नाम NAME	दिनांक एवं हस्ताक्षर DATE & SIGNATURE अनुवादक TRANSLATED BY निर्माणकर्ता WORKED BY जांचकर्ता CHECKED BY पर्यवेक्षणकर्ता SUPERVISED BY	नाम NAME - S.MITTAL R.C.AGARWAL R.C.AGARWAL	दिनांक एवं हस्ताक्षर SIGNATURE & DATE - 16/4/11 16/4/11 16/4/11
स्वीकृति APPROVED : G.C. MISRA - AGM (STE>E) दिनांक : 25.7.11		PR.GP. 3.40				
REV.NO. 02 (Supersedes) Dt. 16.04.11		PREPARED : STE ISSUED : STE -TG DATE : 16.4.11				



दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक		ST 47050	
		PRODUCT STANDARD		पृष्ठ 28 का 2 Page 2 of 28	
सामग्री सूची संख्या को अधिकृत करता है	I TABLE OF CONTENTS 1.0 INTENT OF SPECIFICATION 1.1 Scope Of Contract 1.2 Responsibility of Bidder 1.3 Reliability & Provenness 2.0 FUNCTION 3.0 SCOPE OF SUPPLY 4.0 COMBINED LP BYPASS STOP & CONTROL VALVE: 4.1 Valve Sizing 4.2 Valve Connections (For Piping) 4.3 Valve Seat tightness 4.4 Drain & Warm-up Connections 4.5 Steam Strainer 4.6 Noise Level 4.7 General Valve Mounting Arrangement 4.8 Steam Blowing blanking arrangement 4.9 Other Requirements 5.0 INDIAN BOILER REGULATION 6.0 LP BYPASS STOP & CONTROL VALVE ACTUATORS 6.1 LP Bypass Stop & Control Valve Actuators Schemes (Proposed) 6.1.1 Position Measurement of Valves 6.2 Operating Time 6.3 Mounting Arrangement of Actuators 6.3.1 Mounting Arrangement of Control Block for Actuators 6.3.2 Actuator Control Fluid Connections 6.4 Control Fluid (CF) Specification 6.5 CF Pressure & Temperature 6.6 Control Fluid Tray for LP Bypass Valve Actuator (Vertically mounted) 7.0 HYDRAULIC POWER SUPPLY UNIT (HPSU) 7.1 Electrical Wiring 7.1.1 Instruments in HPSU 7.1.2 Interface with BHEL's system. 7.1.3 Power Supply 7.2 Coating, Cleaning & Preservation				
COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.					
स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रचलन एवं अन्वयक रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।					
हस्ताक्षर एवं दिनांक SIGN & DATE 28/11/11	REV. NO. 02				
सामग्री सूची संख्या INVENTORY NO. P-6301	निर्माणकर्ता WORKED BY SHUBHAM MITTAL		16.4.11		जांचकर्ता CHECKED BY R.C. AGARWAL
				16.4.11	

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD		ST 47050	
				पृष्ठ 28 का 3 Page 3 of 28	
सामग्री सूची संख्या INVENTORY NO.	SUPERSEDES INVENTORY NO.	8.0 TOOLS & TACKLES 9.0 MATERIAL & SURFACE PROTECTION 9.1 Material Selection 9.2 Material Testing 9.3 Welding Material & Consumables 9.4 Welder Qualification 10.0 FUNCTIONAL & TESTING REQUIREMENTS 10.1 TEST CERTIFICATES 11.0 SPARES 11.1 Commissioning & Start-up Spares 11.2 Mandatory Spares 11.3 Recommended Spares 11.4 General Technical Requirements for Spares 12.0 PROCESSING & DOCUMENTATION 12.1 Processing Documents 12.2 Review Documents 12.2.1 Documents Related to HPSU 12.2.2 Documents Related to LP Bypass Valves & Actuators 12.2.3 Documents Related to Water Injection Valves & Actuators 12.2.4 Other Documents Related to C&I. 13.0 MARKING 14.0 PACKING & TRANSPORTATION 15.0 SUPERVISION DURING ERECTION- COMMISSIONING AND TRAINING AT SITE 16.0 GUARANTEE 17.0 PRICE 18.0 LIST OF CROSS-REFERRED DOCUMENTS			
सामग्री सूची संख्या को अप्रतिबंधित करता है	COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.				
स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में स्वत्वाधिकार को न नुकसान जाए।	दिनांक SIGN & DATE 28/11/11				
सामग्री सूची संख्या INVENTORY NO. P-6301	REV. NO. 02				
निर्माणकर्ता WORKED BY SHUBHAM MITTAL	जांचकर्ता CHECKED BY R.C. AGARWAL	16.4.11	16.4.11		

दिनांक एवं हस्ताक्षर SIGN & DATE				उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 4 Page 4 of 28	
सामग्री सूची संख्या को अधिकारित करता		SUPERSEDES INVENTORY NO.		II LIST OF APPENDICES TO THIS SPECIFICATION			
COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company		- GENERAL ARRANGEMENT OF LP BYPASS VALVES -		APPENDIX-1			
		- HYDRAULIC POWER SUPPLY UNIT FOR LP BYPASS - SYSTEM		APPENDIX-2 (TYPICAL)			
		- LP BYPASS STOP VALVE ACTUATOR SCHEME -		APPENDIX-3 (TYPICAL)			
		- LP BYPASS CONTROL VALVE ACTUATOR SCHEME -		APPENDIX-4 (TYPICAL)			
		- LP BYPASS VALVE (SINGLE STEM) ACTUATOR SCHEME -		APPENDIX-5 (TYPICAL)			
		- MANUFACTURING QUALITY PLAN -		APPENDIX-6, FORMAT-1			
स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हितकारक हो न किया जाए।		दिनांक SIGN & DATE 28/11/11					
सामग्री सूची संख्या INVENTORY NO. P-6301		REV. NO: 02		निर्माणकर्ता WORKED BY SHUBHAM MITTAL		 16.4.11	
				जांचकर्ता CHECKED BY R.C. AGARWAL		 16.4.11	

दिनांक एवं हस्ताक्षर SIGN & DATE			उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 5 Page 5 of 28	
सामग्री सूची संख्या INVENTORY NO.		1.0 INTENT OF SPECIFICATION 1.1 Scope of Contract The Scope of the contract for the system shall be on the basis of the single point responsibility completely covering the following activities and services in respect of all the equipment covered under the specification. i. Detailed functional design, calculation, analysis & engineering of all equipment, systems, all type of spares, special tools for assembly & disassembly of various equipments & steam blowing devices. ii. Material Procurement. iii. Complete manufacturing including functional testing. iv. Providing engineering data, drawings for purchaser/owner's approval. v. Providing instruction manuals, as-built drawings, O & M manuals, safety instructions, waste disposal instructions of hydraulic medium etc. vi. Generation of quality/inspection reports indicating therein the complete test details and their acceptance norms i.e. test certificates indicating therein the chemical, physical & mechanical properties. These test certificates are to be provided as per mutually agreed Quality Plan. vii. Furnishing list of commissioning & recommended spares. viii. Seaworthy packing, preservation and transportation from the manufacturer's works to the nearest port for foreign supply; packing and supply ex-works basis for indigenous supply. ix. Supplier is to make provision that the equipments shall be capable for working continuously at an ambient temperature specified in the input data sheet.				
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.						
स्वत्वधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है। इसका प्रयोग एवं प्रसारण बिना भारत भारती इलेक्ट्रिकल्स की लिखित अनुमति के बिना नहीं किया जा सकता।		Notes: i. No civil work relating to ground level is in bidder's scope. However, the foundation detail and necessary instructions, if any, in respect to locating of the centralized hydraulic supply unit from foundation point of view, has to be furnished by the bidder well in advance. This detail is required for finalization of the interface engineering activities. ii. Foundation bolts and fasteners for equipment fastening shall be in the bidder's scope. iii. Counter flanges along with fasteners & seals suiting to the end connections of actuators & HPSU shall be in bidder's scope. iv. In this bid specification, the company submitting the inquiry, namely ' BHARAT HEAVY ELECTRICALS LIMITED, HARDWAR, INDIA ' is herein after referred to as "Purchaser" or "BHEL", the manufacturer tendering the bid is referred to as "Bidder", the bidder to whom contract is awarded to as "Supplier".				
हस्ताक्षर एवं दिनांक SIGN & DATE	16/11/11	1.2 Responsibility of bidder: 1.2.1 The bidder shall be responsible for providing all material, equipment and services, specified or otherwise which are required to complete the system and fulfill the intent of ensuring the successful operation, maintainability and the reliability of the complete work covered under this specification. It is not the intent to specify completely here in, all aspects of design and construction of equipment. Nevertheless, the equipment shall conform in all respects to high standards of engineering, design & workmanship & shall be capable of performing in continuous commercial operation, in a manner acceptable to Purchaser/owner.				
सामग्री सूची संख्या INVENTORY	P-6301	REV. NO. 02		निर्माणकर्ता WORKED BY	SHUBHAM MITTAL	16.4.11
				जांचकर्ता CHECKED BY	R.C. AGARWAL	16.4.11



दिनांक एवं हस्ताक्षर SIGN & DATE			उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 6 Page 6 of 28	
सामग्री सूची संख्या को अतिरिक्तित्व करता	SUPERSEDES INVENTORY NO.	1.2.2 The bidder is requested to carefully examine and understand the specification prior to submitting the technical offer. Any deviation with respect to BHEL specifications shall be clearly identified in the offer & shall be submitted for BHEL review and approval. No deviation will be allowed after placement of order. 1.2.3 The bidder shall furnish the filled up checklist of documents to ensure completeness of their offer. 1.3 Reliability & Provenness: All equipments, components & accessories furnished against this specification shall be from the latest proven product range of the bidder. The satisfactory operation & high reliability of these equipments, components & accessories should have been fully established by a considerable record of successful operation. Purchased items shall be procured only from the proven suppliers & the list of all such items shall be furnished for BHEL review/ approval. The Major casting/ forging shall be procured from experienced vendors only. The vendor to submit list of vendors of major casting/ forgings incorporating their experience in last 5 years for the casting/ forgings of applicable material & weight (equal or higher) for BHEL review/approval. 2.0 FUNCTION: During startup, shutdown due to load shedding or turbine trip out, and also at operations below minimum boiler load, the LP turbine cannot accommodate the entire volume of steam. The LP Bypass control system enables to establish an alternative path for dumping the excess steam into the condenser after de-superheating. 3.0 SCOPE OF SUPPLY: 3.1 The requirement is for LP Bypass Valves comprising of combined Stop & Control valves mounted in a single valve body with respective Electro-hydraulic Actuators and a centralized Hydraulic Power Supply Unit (HPSU). Water injection valve(s) with actuator(s), flow nozzle(s) for measuring water injection quantity are also envisaged in the supplier's scope. The specifications for water injection valve(s) and flow nozzle(s) are separately envisaged. Accessories for valves e.g. hydraulic test device, steam blowing devices, accessories for hydraulic system e.g. flushing device, filling & gauging device for hydraulic accumulator and manually operated control fluid pump for filling of fluid in control fluid tank of HPSU shall also be in the supplier's scope. Desuperheating of downstream steam and Fire Resistant Fluid (FRF) may be or may not be in supplier's scope. Such requirements are clarified in input data sheet enclosed with the specification. Scope of supply with regard to other requirements e.g. special tools & tackles, commissioning spares, mandatory spares, supervision during erection and commissioning, connecting pipe, dump tube etc. shall be as per the input data sheet. 3.2 LP bypass valve with only one stem (single stem valve) is foreseen in some projects as per owner's requirements. In such cases, the valve is actuated for stop as well as control functions by its hydraulic actuator. This requirement is defined in the enclosed input data sheet.				
COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.						
स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।						
हस्ताक्षर एवं दिनांक SIGN & DATE	दिनांक एवं हस्ताक्षर SIGN & DATE					
सामग्री सूची संख्या INVENTORY NO. P-6301	REV. NO.02		निर्माणकर्ता WORKED BY	SHUBHAM MITTAL		16.4.11
			जांचकर्ता CHECKED BY	R.C. AGARWAL		16.4.11

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD		ST 47050	
				पृष्ठ 28 का 7 Page 7 of 28	
सामग्री सूची संख्या INVENTORY NO.	4.0 COMBINED LP BYPASS STOP & CONTROL VALVE: Valves are to be designed to meet the requirements as stipulated in the input data sheet. The supplier shall ensure that LP bypass valve design shall be capable to withstand thermal shocks occurring during operations.				
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	4.1 Valve Sizing: Valve supplier will do the valve sizing calculation for critical flow based on steam parameters as indicated in the input data sheets and furnish the same for BHEL review and acceptance. The valve supplier shall also furnish the valve data sheets duly indicating therein the valve casing and valve stem material, steam forces, Cv value, valve stroke, opening and closing times etc. Valve manufacturer shall also furnish the Valve characteristics (<u>Flow vs. lift</u>).				
	4.2 Valve Connections (For Piping) : Valve manufacturer shall also indicate the steam inlet & outlet connection sizes, material & the type of weld edge preparation inline with input data sheet for BHEL review and approval.				
	4.3 Valve Seat Tightness : Seat tightness of LP bypass stop and control valves shall be equivalent to block valve tightness confirming to MSS-SP-61.				
	4.4 Drain & Warm-up Connections: Location for warm-up Connection : To be provided at the lowest position of Stop Valve Location for Drain Connection : To be provided at the lowest position of Control Valve Drain connection size : Ø60.3X3.91 Warm-up connection size : Ø60.3X3.91 The supplier shall furnish drain & warm-up connection Size, Material and Weld edge detail for BHEL review and approval.				
स्वतंत्र अधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की संपत्ति है इसका प्रयोग एवं अथवा वितरण के बिना भी तदर्थ प्रयोग, जो कि कंपनी के हित में संतुष्टिकारक हो न सके जाए।	4.5 Steam Strainer: Steam strainer is to be provided on Stop valve side and it is not mandatory for Control Valve side. It should be installed inside the valve casing in such a way that it renders trouble free, reliable and safe service and is also easy to carryout maintenance. Valve manufacturer is to furnish the detailed sectional view drawing indicating therein the strainer material, fitting details and also specify the pressure drop across the strainer.				
हस्ताक्षर एवं दिनांक SIGN & DATE 28/11/14	4.6 Noise Level: Maximum Noise Level: 85dB (A) at a distance of 1 meter from the body.				
सामग्री सूची संख्या INVENTORY NO. P-6301	4.7 General Valve Mounting Arrangement: Type of valve arrangement shall be in accordance with the input data sheet. The valve may be suspended type or pipe mounted as specified in the input data sheet. A typical arrangement of				
REV. NO. 02		निर्माणकर्ता WORKED BY	SHUBHAM MITTAL		16.4.11
		जांचकर्ता CHECKED BY	R.C. AGARWAL		16.4.11







SIGN & DATE	ST 47050	उत्पाद मानक PRODUCT STANDARD		पृष्ठ 28 का 8	
				Page 8 of 28	
SUPERSEDES INVENTORY NO.	vertically suspended valve is shown in the Appendix-1 . Valve manufacturer shall provide the valve support paws/brackets, which may be welded or integrally cast or fastened to the valve body. Details of the valve support paws/bracket shall be furnished at the time of offer. <i>In case of suspended type valve, frame for valve suspension and valve suspension arrangement shall be in BHEL scope.</i> Valve manufacturer shall furnish the General Arrangement drawing duly indicating therein the overall assembly dimensions, actuators dismantling space, total weight & must show the location of actuator oil connection and C.G (Center of Gravity) of the complete assembly.				
समग्री सूची संख्या को अधिकतम करने					
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	4.8 Steam Blowing blanking arrangement: Steam blowing of steam inlet pipes is done before putting the valves in actual operation. Valve supplier shall also supply one no. Steam blowing blanking arrangement per LP Bypass valves per Steam Turbine unit along with the main equipment and furnish the blanking arrangement drawing for review.				
	4.9 Other Requirements: The supplier to furnish leakage flow quantity through glands of stop & control valve for which pressure of 0.5 bar may be considered at the downstream. Size & material of the weld end for leakage flow connections shall be furnished. In case no leakage from valve glands for stop and control valve are foreseen in the design, specific confirmation for this shall be given in the offer.				
स्वाधिकार एवं गोपनीय	5.0 INDIAN BOILER REGULATION: LP Bypass valves covered under this specification fall under the purview of Indian Boiler Regulation (IBR) and hence must satisfy all the conditions of IBR and the test certificate in IBR form III-C counter signed by an independent inspecting agency/authority approved by Indian Boiler Board shall be required. Assembly drawings of LP bypass valve shall be duly approved/countersigned by the IBR approved inspecting agency/authority.				
	6.0 LP BYPASS STOP & CONTROL VALVE ACTUATORS: 6.1 LP Bypass Stop & Control Valve Actuators Schemes (Proposed): a) Sizing of actuators and all other elements such as Filters, Cartridge valves, check valves and throttle orifices etc. mounted on the control manifold of the respective actuators is in the supplier's scope. Servo-valves for control valve actuators shall act as an interface between the actuators and BHEL's control system, which shall position the control valves as per system requirement. The vendor may offer Servo-valve/ proportional valve as per their standard practice. The design of the Control Valve Actuator shall be such that in case of interruption of CF supply or the electrical signal, the LP bypass control valve shall remain "IN PLACE" during failure mode. For quick closing of stop valves, 2 nos. solenoid operated Poppet valves (TSV's) shall be supplied. Solenoid shall be with single / double coils as per supplier's standard practice and operation of coil(s) (simultaneous operation on both coils in case of double coils) of any one				
हस्ताक्षर एवं दिनांक	SIGN & DATE				
सूची संख्या	INVENTORY NO.				
P-6301	REV. NO. 02	निर्माणकर्ता WORKED BY		SHUBHAM MITTAL	16.4.11
		जांचकर्ता CHECKED BY		R.C. AGARWAL	16.4.11

निर्माता एवं समीक्षक SIGN & DATE		उत्पाद मानक PRODUCT STANDARD		ST 47050	
				पृष्ठ 28 का 9 Page 9 of 28	
शीर्षक सूची संख्या INVENTORY NO.	TSV should affect trip. The Trip Solenoid valves shall be connected to protection system supplied by BHEL. All Solenoid Valves (Pilot Valves and TSVs) shall be rated for 25V±5V. All the valve actuators shall be capable of operating at 60°C control fluid temperature continuously. Refer proposed actuator schemes as per enclosed Appendix-3 & 4. However, Supplier will prepare their own schemes and submit the same for BHEL review and approval. b) In case of LP bypass valve with one actuator (Single stem valve), the applicable scheme as per Supplier's standard practice shall be submitted for BHEL review & approval. However a typical scheme is attached as per Appendix-5. c) All filters of actuators shall be equipped with differential pressure switches for alarm along with local indication for clogging. 6.1.1 Position Measurement of Valves: Each Stop Valve Actuator should be equipped with 4 Limit Switches (i.e. 2 for Open & 2 for Close position). Limit Switches shall be of mechanical type. Each Control Valve actuator should be equipped with non-contact type position transmitter for measuring the position of the Control valve. Details of the same shall be furnished along with the offer. The output of the Position Transmitter shall be 4 mA (valve fully closed) to 20mA (valve fully opened). 6.2 Operating Time: (a) For LP bypass stop & control valve (Double stem): (i) LP Bypass Stop Valve Actuator: Opening time : < 2 Seconds for full stroke (Against spring force) Closing time : = 1±10% Seconds for full stroke (With spring force) (ii) LP Bypass Control Valve Actuator: Opening time : < 2 Seconds for full stroke Closing time : < 2 Seconds for full stroke (b) For LP bypass valve (Single stem): In case of single stem valve actuator, the operating time shall be as follows: Opening time : < 2 Seconds for full stroke (Against spring force) Closing time : = 1±10% Seconds for full stroke (For emergency closure) Closing time : < 2 Seconds for full stroke (For modulating control) To adjust the opening and closing time of actuators, throttle orifices shall be provided wherever necessary.				
शीर्षक सूची संख्या INVENTORY NO.	SUPERSEDES INVENTORY NO.	COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly, in any way, detrimental to the interest of the company.			
स्वत्वधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत छोड़ो आंदोलन के अंतर्गत है। इसका प्रसारण एवं उपयोग केवल शीर्षक सूची संख्या के अंतर्गत ही होना चाहिए। अन्य किसी भी संस्था में इसका प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किता जाए।	हस्ताक्षर एवं दिनांक SIGN & DATE	28/11/11			
शीर्षक सूची संख्या INVENTORY NO.	REV. NO.02	निर्माणकर्ता WORKED BY	SHUBHAM MITTAL		16.4.11
शीर्षक सूची संख्या INVENTORY NO.	P-6301	जांचकर्ता CHECKED BY	R.C. AGARWAL		16.4.11



निम्नक एवं दिनांक SIGN & DATE		उत्पाद मानक PRODUCT STANDARD	ST 47050 पृष्ठ 28 का 10 Page 10 of 28		
SUPERSEDES INVENTORY NO सामग्री सूची संख्या को अधिदेशित करें	6.3 Mounting Arrangement of Actuators: Type of arrangement required is specifically mentioned in the input data sheet. A typical arrangement of LP Bypass valve is shown in Appendix-1 for straight type of valves for which orientation of actuators shall be as follows: - Stop Valve Actuator : Vertical (Standing) - Control Valve Actuator : Vertical (Hanging) Incase of Angle type of valve arrangement, the Stop valve and Control Valve actuators shall be perpendicular to each other respectively. Supplier is to ensure & make provision for proper venting in the actuators for such angle type of valve arrangement. 6.3.1 Mounting Arrangement of Control Block for Actuators: The Control Block for each actuator shall be mounted on the Power Cylinder. EHA supplier shall ensure that supply and return line connections shall preferably be on the same side of the actuators as shown in the enclosed sketch (Appendix-1). 6.3.2 Actuator Control Fluid Connections: Supplier will ensure the flange end connections of supply & return pipelines as per sizes given below: - Supply Pipeline : Ø26.7X3.91, Material as per ASTM A312, GradeTP321 - Return Pipeline : Ø33.4X2.6, Material as per ASTM A312, GradeTP321 If the actuating medium used is MINERAL OIL of viscosity class as per ISOVG100 according to DIN51519 then supplier shall also make a provision for guarded pipeline connection as per size given below: - Guarded Pipeline : Ø88.9X5.49, Material Carbon Steel 6.4 Control Fluid (CF) Specification: (a) The Electro-hydraulic actuation (EHA) system shall be designed suiting to the control fluid medium as specified in the input data sheet. Total control fluid quantity comprising of quantities required for regular bypass system operation + flushing of the complete EHA system + sufficient quantity for one year make-up shall be worked out by the EHA supplier and informed to BHEL at the time of offer. (b) If specified in the input data sheet control fluid of required quantity shall be supplied by the supplier. The supplier shall furnish the specification and source of procurement for BHEL review and approval.				
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.					
	स्वत्वाधिकार एवं गोपनीय इस प्रलेख में की गई सूचना भारत हेवी इलेक्ट्रिकल्स लि. की संपत्ति है इसका प्रयोग एवं आश्रय के बिना किसी भी तरह प्रयोग, उसे किसी अन्य व्यक्ति को देना या प्रसारित करना गैर कानूनी है।				
हस्ताक्षर एवं दिनांक SIGN & DATE 28/4/11					
सामग्री सूची संख्या INVENTORY NO P-6301	REV. NO.02		निर्माणकर्ता WORKED BY जांचकर्ता CHECKED BY	SHUBHAM MITTAL R.C. AGARWAL	16.4.11 16.4.11

दिनांक व हस्ताक्षर SIGN & DATE		उत्पाद मानक		ST 47050		
		PRODUCT STANDARD		पृष्ठ 28 का 11 Page 11 of 28		
सामग्री सूची संख्या INVENTORY NO.	SUPERSEDES INVENTORY NO.	6.5 CF Pressure & Temperature: - Normal operating pressure - 160 bar - Minimum operating pressure - 115 bar - Normal Control Fluid temperature - 50+5°C - Maximum Control Fluid temperature - 75°C 6.6 Control Fluid Tray for LP Bypass Valve Actuator (Vertically mounted): CF tray shall be provided to prevent CF falling on valve body in case of leakage & CF sensor shall also be provided in the CF tray to detect leakage for indication in control room. 7.0 HYDRAULIC POWER SUPPLY UNIT (HPSU): (Refer Appendix-2, Proposed) The Hydraulic Power Supply Unit (HPSU) is required for actuation of LP Bypass Stop & Control Valve Actuators and water injection valve actuator(s) (if hydraulically actuated water injection valve(s) are envisaged in applicable specification). The EHA supplier, suiting to the control medium as specified in the input data sheet, shall do the design & sizing of HPSU. HPSU will consist of all necessary components like CF pumps, filters, hydraulic accumulators, check valves, pressure & temperature measuring instruments, Level measuring instruments, filtration-cum-cooling unit and regeneration unit for Control Fluid (CF) purification. Supplier to ensure that all the surfaces coming in contact with control fluid including control fluid tank shall be made of stainless steel. The Control fluid (CF) tank shall be adequately sized to accommodate total system quantity of fluid including fluid contained in pressure lines, return lines, actuators & hydraulic accumulators etc. Suitable provision for vapor extraction shall be provided by the supplier in the CF tank. Two nos. CF Pumps shall be provided in the CF tank with their pressure and flow control valves and shall be immersed into the CF medium in the CF tank. The electric motors of CF pumps and the pressure control valves for system pressure adjustment shall be mounted on the CF tank cover. Two CF pumps are required in the HPSU, one of that can be pre-selected for operation, whereas the other shall act as standby, operation of which shall be automatically switched over in case of any fault. Changeover of pumps shall take place depending on the CF pressure as well as outage of the working pump motor. Control of Pumps & cooling circuit will be realized in BHEL's control system. Pumps are to be designed by the HPSU supplier as pressure-controlled pumps, which shall maintain the constant pressure to a constant preset value i.e. 160bar and shall regulate the CF quantity according to the demand. Pressure surges/pulsations are required to be dampened by bladder type hydraulic accumulators, which will also ensure that the system pressure does not collapse. Accumulators shall ensure positive supply of oil to hydraulic actuators even when hydraulic oil pumps are not available. Accumulators shall be adequately sized to ensure supply for at least two complete stroking operations of all connected actuators. Sizing of the accumulators shall be done by the HPSU supplier and supplier shall decide the quantity & capacity of accumulators for reliable operation of the actuators.				
सामग्री सूची संख्या INVENTORY NO.	REV. NO. 02	निर्माणकर्ता WORKED BY	SHUBHAM MITTAL		16.4.11	
सामग्री सूची संख्या INVENTORY NO.	REV. NO. 02	जांचकर्ता CHECKED BY	R.C. AGARWAL		16.4.11	

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 12 Page 12 of 28	
सामग्री सूची संख्या INVENTORY NO.	SUPERSEDES INVENTORY NO.	Two nos. separate cooling-cum-filtration circuits (filtration rate of return line filters is 3μ absolute) shall be provided in order to maintain the cleanliness of the system and to ensure proper cooling. Separate AC driven circulation pumps with 2X100% capacity shall be provided to pump CF into these circuits. 2X100% coolers shall be provided for cooling of CF. The fans of the coolers shall cut in and out depending upon the CF temperature. The circulation pumps shall also pump CF into the regeneration circuit, which shall be equipped with filter (12μ) for continuous filtration of the CF. (Applicable if CF is used). Cooling by air shall be foreseen if the ambient temperature is up to 49°C. For ambient temperature more than 49°C, cooling with water shall be foreseen. Water quantity & quality requirements shall be furnished by the supplier along with the offer for arranging the same by the purchaser. Provision of heater for heating the control fluid shall be kept for projects where ambient temperature goes up to 5°C and below. The HPSU supplier shall mount a console containing local pressure gauges, pressure switches & nipples for commissioning measurements on the CF tank. Moreover, coarse filters with contamination indicator & pressure relief valves for pump protection are to be provided by the supplier. The complete HPSU shall be housed inside the cabinet and for emergency manual tripping, a switch shall be provided on the terminal box. HPSU Circuit diagrams drawn on either metallic or plastic sheet in color should be riveted inside the door panel. Supplier is to make an arrangement for mounting electric lamps inside the housing. The HPSU supplier shall provide 03 no. pressure line and 03 no. return line connections in HPSU as per the following details: 01 no. each of pressure and return line connections for LPBP stop & control valve no.-1. 01 no. each of pressure and return line connections for LPBP stop & control valve no.-2. 01 no. each of pressure and return line connections for water injection valve(s). In case the water injection valve(s) are with pneumatic actuators only 2 no. of pressure and 2 no. of return line connections shall be applicable as mentioned at sl. no. a) & b) above.			
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used, directly or indirectly, in any way detrimental to the interest of the company		7.1 Electric Wiring: Electrical wiring of all the hydraulic assemblies is part of the supplier's scope of supply. It includes measuring & signal devices. All electric components must be wired up to junction box (JB) of the unit. The JB will have IP55 degree of protection. A separate JB meant for pump motors connection shall also be provided. No internal wiring shall be done by BHEL inside the HPSU housing cabinet. JB wiring diagram along with data of all the electrical equipment as mounted on HPSU & as well as on control block of Actuators, Position measuring instruments and cable termination details must be supplied along with the main equipment. Internal wiring to JB must be housed in protective channels of galvanized sheet metal with removable covers. Steel-clad hose/conduit must protect the connecting cable to individual components. The length of free cables (i.e. at plugs or connections) should not be longer than 500mm. Protective devices for wiring should also be supplied for equipment, which is not wired (i.e. motors, solenoid valves), ending at the appropriate location of the base frame.			
स्वत्वधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।					
हस्ताक्षर एवं दिनांक SIGN & DATE 					
सामग्री सूची संख्या INVENTORY NO. P-6301	REV. NO. 02		निर्माणकर्ता WORKED BY SHUBHAM MITTAL		16.4.11
			जांचकर्ता CHECKED BY R.C. AGARWAL		16.4.11

	उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 13 Page 13 of 28									
दिनांक एवं स्थान SIGN & DATE	SUPERSEDES INVENTORY NO.	7.1.1 Instruments in HPSU: (a) Pressure transmitter is to be provided at the discharge of each CF pump and also in the CF header. All pressure transmitter to be 'SMART' type with HART protocol. (b) All filters to be equipped with differential pressure switches for alarm along with local indication for clogging. (c) Suitable pressure switches and gauges to be provided in HPSU. (d) Two (2) nos. Resistance temperature detectors along with temperature transmitters to be provided for measuring the temperature in the tank. (e) Suitable level gauges & three (3) no. level transmitters to be provided on the CF tank for level measuring. (f) Contact rating of all the switches to be furnished. (g) Number & type of instruments shall be subject to BHEL approval. Complete instrument list showing range, model no. and set point of various instruments shall be furnished for BHEL approval.										
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electricals Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		7.1.2 Interface with BHEL's System: Signals from the instruments shall be processed in BHEL's system & commands from BHEL's control system shall go for controlling the motors, fans etc in the HPSU and also the Pilot valves, Servo-valves/proportional valve and TSVs in the valve actuators. Supplier is to furnish the recommended operation logics for the entire system enabling BHEL to develop suitable control schemes.										
स्वतंत्रिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।		(a) For operation of Control Valves, BHEL shall supply ± 7.5 mA / ± 30 mA signal to servo-valves/ proportional valves from its DCS. (b) In case vendor system is not able to accept this signal, 4-20 mA demand signal can be furnished by BHEL. In such a case suitable positioner shall be supplied by the vendor for interfacing with servo-valve / proportional valve. In this case, final operation of all the components of actuators (stop valves, control valves and water injection valves), i.e. TSVs, Pilot valves and interlocking valves shall also be from vendor's system. Suitable signals shall be provided from BHEL's DCS for control of these elements. Necessary software for calibration / parameterization of the positioner shall also be supplied.										
दिनांक एवं स्थान SIGN & DATE 28/11/11		7.1.3 Power Supply: Power supply requirements for all 3 phase motors shall be 415V $\pm$ 10% AC. In case of different requirement the same shall be specified in the input data sheet.										
शीर्षक एवं संख्या INVENTORY NO. P-6301		7.2 Coating, Cleaning and Preservation: Supplier shall furnish the colour scheme for BHEL review and acceptance. Before preservation, the interior surface of the HPSU must be cleaned thoroughly. Before delivery of HPSU, the unit should be coated inside with hydraulic fluid containing a suitable inhibitor. Additives used must not degrade the quality of hydraulic medium. All external connections must be sealed with metal plugs. All items as listed in the supplier's part list have TAG nos. & must have nameplates, which shall be attached in such a way so that they can be seen & read easily. Nameplates must be designed 10X50 mm with 7-mm inscription height & mounted by notch spikes.										
REV. NO. 02		<table border="1"> <tr> <td>निर्माणकर्ता WORKED BY</td> <td>SHUBHAM MITTAL</td> <td></td> <td>16.4.11</td> </tr> <tr> <td>जांचकर्ता CHECKED BY</td> <td>R.C. AGAWRAL</td> <td></td> <td>16.4.11</td> </tr> </table>			निर्माणकर्ता WORKED BY	SHUBHAM MITTAL		16.4.11	जांचकर्ता CHECKED BY	R.C. AGAWRAL		16.4.11
निर्माणकर्ता WORKED BY	SHUBHAM MITTAL		16.4.11									
जांचकर्ता CHECKED BY	R.C. AGAWRAL		16.4.11									

दिनांक एवं हस्ताक्षर, SIGN & DATE			उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 14 Page 14 of 28	
सामग्री सूची संख्या INVENTORY NO.		8.0 TOOLS & TACKLES: The bidder shall submit with the equipment one complete set of all special tools & tackles & other instrument required for site erection & commissioning, assembly, disassembly & proper maintenance of the LP Bypass system. The bidder along with the offer shall submit a list of such tools and tackles. In case, new requirement of any special tool arises during installation of LP bypass system equipments the same shall be supplied by the supplier free of cost.				
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		9.0 MATERIAL & SURFACE PROTECTION: 9.1 Material Selection The materials for all components must be for maximum corrosion resistance under the prevailing ambient conditions. The material utilized for manufacture of various components shall be those, which are already established for use in such applications. Material of all the major items of LP Bypass valves, actuators & HPSU shall be informed during offer stage for purchaser's acceptance. However, during detailed engineering stage if it is established that the materials as informed by the bidder is inferior to present practices, the supplier without any commercial implications shall change it. 9.2 Material Testing: Product forms for load-bearing parts shall be supplied with Inspection Certificate 3.1 B as per EN10204. The product forms for other parts shall be specified in the parts list including bill of material, indicating therein the material number and the standard, including trade names if necessary.				
स्वतंत्राधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की संपत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग को कि कम्पनी के हित में संश्लेषण न हो न किया जाए।		9.3 Welding Materials & Consumables: The properties of welding materials and consumables to be employed (mechanical, chemical, thermal, long term performance etc.) shall be matched to the base metal. The supplier shall ensure that the welding materials and consumables have National/International approval for the intended application. For site erection purpose, the supplier shall submit to the purchaser the Field Welding Schedule (FWS) for field welding activities. The FWS shall be submitted to the Purchaser/Owner along with all supporting procedures, like welding procedures, heat treatment procedures, NDT procedures etc., at least 30 days before schedule start of erection work at site.				
दिनांक एवं हस्ताक्षर SIGN & DATE	28/11/11	9.4 Welder Qualifications: For the work to be performed only those welders shall be used who are qualified as per DIN EN287-1 or per any comparable Indian/International standard for metals to be welded and the welding procedure to be employed.				
सामग्री सूची संख्या INVENTORY NO.	P-6301	REV. NO. 02		निर्माणकर्ता WORKED BY	SHUBHAM MITTAL	16.4.11
				जांचकर्ता CHECKED BY	R.C. AGARWAL	16.4.11


दिनांक एवं हस्ताक्षर SIGN & DATE				उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 15 Page 15 of 28	
सामग्री सूची संख्या INVENTORY NO. को अभिलेखित करना		10.0 FUNCTIONAL & TESTING REQUIREMENTS: (Refer Format-1, APPENDIX-6) Supplier shall furnish & specify the various functional & test requirements of LP Bypass valves, Actuators & HPSU in the prescribed format as enclosed and submit the same for BHEL approval. The supplier shall also furnish copies of the reference documents/their standards/acceptance norms/tests & inspection procedure etc. as specified in the format-1. Without approval of functional & testing requirements, the supplier will not start manufacturing. This document shall form a part of the contract. BHEL/Owner shall identify customer hold points (CHP), i.e. test/checks which shall be carried out in presence of the BHEL/Owner's Engineer or his authorized representative and beyond which the work will not proceed without consent of Purchaser/Owner/Authorized representative in writing. Following functional tests are to be carried out at supplier works: 1. HPSU testing as per suppliers approved test procedure 2. LP Stop & Control Valve Actuators testing without bypass valve as per supplier's approved procedure 3. Cv test (type test) of LP Bypass Valve without actuators: (i) Cv test will be carried out for LP Bypass valve as per ISA 75.02 and test report shall be submitted for BHEL approval. The Cv test can be carried out physically on the valve or through computer simulation. (ii) The Cv test shall be carried out in presence of the BHEL representative, for which minimum 30 days notice shall be given by the supplier. The supplier shall obtain the BHEL approval for the Cv test procedure before conducting the Cv test. The Cv test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different parameters, interval of recording, precautions to be taken etc. for the Cv test to be carried out. (iii) In case test report is already available on the same model/type/size/rating of the valve as proposed to be supplied under this contract and the Cv test have been either conducted at any independent laboratory or have been witnessed by a client, the same can be considered if Cv test have been carried out not more than 5 years from the date of bid opening. (iv) In case the offered valve is already in successful operation using the same valve body, seat and trim combination as of the offered valve, the vendor may furnish the name of project, data sheet, cross sectional drawing of that valve for review in lieu of the Cv test report. 4. NDT of castings/forgings: (a) The ultrasonic test shall be carried out as follows: I. Forgings conforming to quality level-4 as per EN 10228-3. II. Castings conforming to the following requirements as per EN 12680-2: (i) All the weld seams, high stress areas and sealing surfaces shall conform to quality level-I. (ii) Rest of the casting shall conform to quality level-II.					
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारता भारती इलेक्ट्रिकल्स की संपत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।					
दिनांक एवं हस्ताक्षर SIGN & DATE 		सामग्री सूची संख्या INVENTORY NO. P-6301					
REV. NO. 02				निर्माणकर्ता WORKED BY SHUBHAM MITTAL		 16.4.11	
				जांचकर्ता CHECKED BY R.C. AGARWAL		 16.4.11	

निम्नक एवं दिनांक SIGN & DATE				उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 16 Page 16 of 28	
सामग्री सूची संख्या INVENTORY NO.		SUPERSEDES INVENTORY NO.		(b) WPS & PQR shall be got approved by BHEL, before start of welding on weld seams. (c) Stress relieving shall be performed after welding. The vendor shall report the hardness survey of the heat affected zone (HAZ), weld and parent materials. (d) All the weld seams shall be radiographically tested conforming to quality level-I as per ASTM E446. 5. Hydrostatic body test of LP bypass valve in accordance with ANSI B-16.34 prior to seat leakage test. 6. Valve closure test and seat leakage test in accordance with ANSI B-16.34 and as per the leakage class MSS SP61. 7. LP Bypass valves testing along with actuators in assembled condition. 8. Functional test: The fully assembled valves including actuators control devices and accessories shall be functionally tested to demonstrate times from open to close position. Any additional requirement, if any, shall be separately specified in the purchase order. In general, highest quality of workmanship shall be ensured while manufacturing and assembly of LP Bypass valves, their actuators and HPSU. 10.1 TEST CERTIFICATES: Supplier has to furnish the Test Certificates, Material Certificates; certificates for weld examination, leakage test, hot tensile tests etc before delivery. 11.0 SPARES: 11.1 Commissioning & Startup Spares: Spare & wear parts are included in the scope of supply up to completion of trial operation. The supplier shall prepare lists of all probable spares and wear parts, which indicate the recommended quantities and clear parts identification. The parts shall be manufactured in accordance with the requirements of this specification. (1) It will be the responsibility of the supplier to provide all commissioning and startup spares required for initial operation till the satisfactory completion of the Trial Operation. The supplier to ensure that no hold ups shall occur at site during erection & commissioning due to non-availability of commissioning spares. The supplier shall furnish a list of all such spares within 60 days from the date of Letter of award & such list shall be reviewed by the purchaser/Owner & mutually agreed to. List of commissioning spares shall include 1 set each of all those items which may get damage during transportation/storage such as receptical connectors & other items e.g. gaskets, packing rings, filters etc. (2) These spares will be received & stored by the purchaser at least 3 months prior to the date of commencement of trial operation & utilized as and when required.			
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.				स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।			
निम्नक एवं दिनांक SIGN & DATE 28/11/11		सामग्री सूची संख्या INVENTORY NO. P-6301		REV. NO. 02		निर्माणकर्ता WORKED BY SHUBHAM MITTAL	
जांचकर्ता CHECKED BY R.C. AGARWAL		16.4.11		16.4.11		16.4.11	

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD	ST 47050	
			पृष्ठ 28 का 17 Page 17 of 28	
समीची सूची संख्या को SUPERSEDES INVENTORY	11.2 Mandatory Spares: The bidder shall submit their commercial offer separately for the mandatory spares as per the list furnished by the Purchaser/Owner. List of mandatory spares furnished by the bidder shall be duly correlated with their bill of material.			
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electricals Limited. It must not be used directly or indirectly in any way detrimental to the interest of this company.	11.3 Recommended Spares: In addition to the mandatory spares, the bidder is required to submit as part of the contract, a complete list of recommended spare parts, for the equipment supplied based on his experience, which are essential for a plant operation of ten (10) years. In the offer, the bidder is required to furnish item wise price and total lump sum price. The purchaser is free to order these recommended spare parts at any time. The bidder shall also indicate the service expectancy period for the spare parts under normal operating condition before the replacement is necessary. All categories of spares to be supplied under this contract shall be strictly interchangeable with the parts for which they are intended for replacement. The spares shall be treated and packed for long storage under the climate conditions prevailing at the site e.g. small items shall be packed in sealed transparent plastic bags with desiccators packs as necessary.			
	Each spare shall be clearly marked or labeled on the outside of the packing with its description and assembly parts number.			
स्वत्वाधिकार एवं गोपनीय इस दस्तावेज में कोई सूचना भारत डीसी इलेक्ट्रिकल्स की संपत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न	11.4 General Technical requirements for Spares: (i) All the mandatory spares covered under the contract shall be manufactured along with the main equipment as a continuous operation and the delivery of the spares will be affected along with the main equipment. In case of recommended spares the above will be applicable provided the order for the recommended spares have been placed with the supplier prior to commencement of manufacture of the main equipment. (ii) The quality plan and the inspection requirement finalized for the main equipment will also be applicable to the corresponding spares. (iii) The bidder will submit along with the offer the manufacturing drawings, catalogues, assembly drawings and any other document to identify the recommended spares. (iv) The supplier will provide the purchaser with all the addresses and particulars of his sub-vendors while placing the order on them for items/components/equipment covered under the contract. He will further ensure that the purchaser/Owner if so desires will have the right to place order for spares directly on his sub-suppliers on mutually agreed terms based on their offers.			
समीची सूची संख्या INVENTORY NO. P-6301	दिनांक एवं हस्ताक्षर SIGN & DATE 28/11/11	REV. NO. 02	निर्माणकर्ता WORKED BY SHUBHAM MITTAL	16.4.11
			जांचकर्ता CHECKED BY R.C. AGARWAL	16.4.11

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD	ST 47050		
			पृष्ठ 28 का 18 Page 18 of 28		
SUPERSEDES INVENTORY	सामग्री सूची संख्या को	12.0 PROCESSING & DOCUMENTATION: It is the duty of the system supplier to clarify interfaces and good cooperation with their sub-suppliers of products that interface with his scope of supply, both in the planning phase as well as on site. The supplier will be notified in writing in the event of any changes (additions or deletions) in the scope of supply and services, with written confirmation to follow on the part of the purchaser. The written confirmation does not constitute acceptance of the indicated additional or reduced costs. All major functional and mechanical design decisions shall be made together with the purchaser as per mutually agreed meeting schedules. 12.1 Processing Documents: All verification analysis, which demonstrates compliance with design warranted & specified data and which include information on interface to adjacent systems shall subsequently be designated processing, documents and shall be submitted to the purchaser for review. Verification analysis required by legislative bodies, regulatory authorities or similar entities of this nature should also be treated as processing documents. The documents to be reviewed by the purchaser or his authorized representative are listed in Section 14.2 & 14.3 below. The purchaser or designated authorized inspectors can also demand to see the documents or verification analysis to be submitted for preliminary review. All documents shall be reviewed by the supplier before being submitted unsolicited to the purchaser /authorized representative. Fabrication/Manufacturing may begin only after the submission of approved documents by the purchaser. The supplier shall check the drawings provided for parts from outside vendors for any interface with his own parts at his own end. The supplier shall also finalize all type of interface activities with their own sub-vendors. The supplier shall be held responsible for any mistake done during detailed engineering or manufacturing by their sub-vendor. The extra cost incurred due to this interface shall be borne by the supplier. The lists and schematic diagrams for instrumentation and open- and closed loop controls if prepared by the supplier shall be thoroughly checked by the supplier for completeness and correctness. All necessary drawings, detailed drawings and spare parts drawings shall be prepared using computer- based drawing programs. These must be deposited finally to the purchaser on disk and must be "AutoCAD" compatible. The required scope of documentation is established in the scope of supply. All documents shall be prepared in the project-specific language stipulated. In all instances, project-specific requirements must be duly noted and complied with when preparing & identifying the documents. The purchaser shall be made aware of all changes in the supplier's drawings by pointing out the revision remarks and indices on them is not sufficient. Physical parameters and drawing dimensions shall be given in metric units in accordance with Indian Standards.			
COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company		स्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत भारती इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग एवं आश्रयक का से बिना की सह प्रयोग, जो कि भारत के हित में हानिकारक हो न किया जाए।			
दिनांक एवं हस्ताक्षर SIGN & DATE	सामग्री सूची संख्या INVENTORY NO.	REV. NO. 02	निर्माणकर्ता WORKED BY	SHUBHAM MITTAL	16.4.11
दिनांक एवं हस्ताक्षर SIGN & DATE	सामग्री सूची संख्या INVENTORY NO.	REV. NO. 02	जांचकर्ता CHECKED BY	R.C. AGARWAL	16.4.11

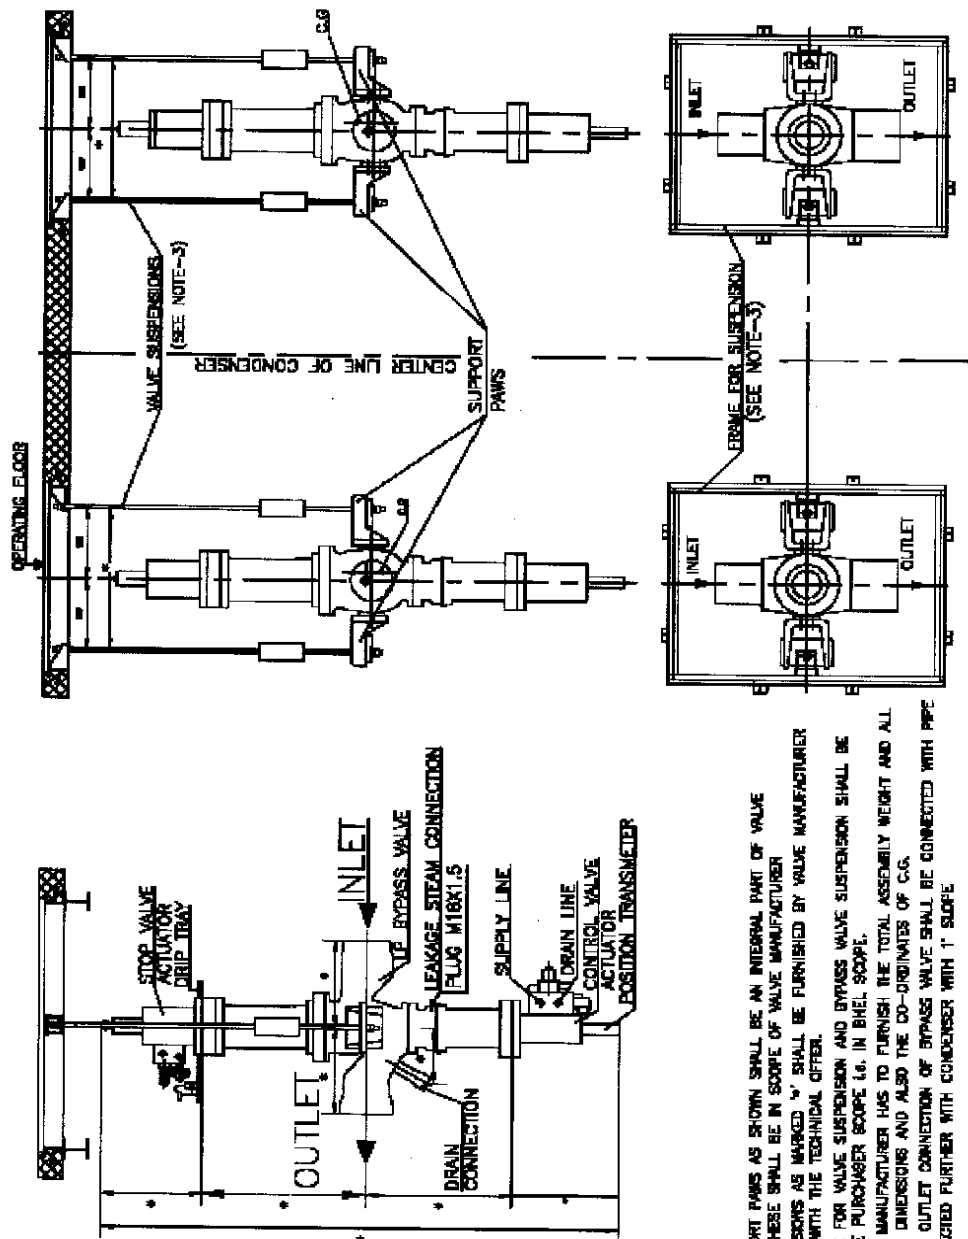
नाम एवं दिनांक SIGN & DATE		उत्पाद मानक PRODUCT STANDARD	ST 47050	
			पृष्ठ 28 का 19 Page 19 of 28	
सामग्री सूची संख्या INVENTORY NO.	SUPERSEDES INVENTORY NO.	12.2 Review Documents: Following drawings and data are to be furnished along with the technical offers in triplicate . 12.2.1 Documents related to HPSU: 1. Schematic circuit diagram showing connection of HPSU with respective bypass actuators & Sizing calculation of HPSU & its main components. 2. General arrangement drawing of HPSU indicating therein the total assembly weight, overall major layout dimensions, foundation detail, space requirement for maintenance, Flanges end connection detail and their material. 3. Schematic diagram duly indicated with all item nos., Tag Nos. and legends. In this diagram, tank capacity, pump capacity of each CF Pumps, Circulation Pumps, rated power consumption of each pump motor, filtration rating of each filter and capacity of each Hydraulic Accumulators has to be specified. 4. Part list duly indicated with item no/Position No., quantity, catalogued / Drg. reference no. & source of procurement etc. BHEL will indicate their TAG nos. against each item for identification purpose and submit the same to the supplier for necessary updation. 5.* HPSU Test procedure duly indicating therein the test detail & their acceptance norms. 6. Data sheets & *functional description of all individual items. Electrical wiring diagram. 7.* Operation, Maintenance & Erection manual. 8.* Field Weld Schedule and erection instruction for site engineers. 9.* List of Bought out items, the source of procurement has to be specified for each item. 10. List of recommended and commissioning spares. 11. Detailed 'Quality Plan' for HPSU. (See Clause no. 10.0) 12.2.2 Documents related to LP Bypass Valves & Actuators: 1. Overall General arrangement cross-sectional assembly drawing with all major dimensions required from layout point of view. Steam Inlet & Outlet weld edge sizes, bracket for Valve suspension arrangement, and location of center of gravity and also total assembly weight has to be specified in the drawings. Bill of material (BOM) of the valve with actuator assembly has to be tabulated. Assembly & disassembly maintenance space dimensions should be indicated in the drawings. 2. Separate Stop & Control Valve actuator drawings indicating therein the flange end connection detail, total actuator weight, overall dimension & dismantling space requirement. All items should be marked and listed in the BOM on the drawing itself. On the actuator drawings, schemes for Stop & Control valve actuator should also to be shown schematically. 3.* Catalogs and technical literature of Solenoid valves, Servo-valves, proportional valves, Position transducer, Positioners, Limit Switches, Relief Valves etc. 4. Sizing Calculation for Bypass valves & actuators. 5. Valve Data Sheets for LP Bypass Valve 6. List of special tools (if any)		
सामग्री सूची संख्या INVENTORY NO.	REV. NO. 02	निर्माणकर्ता WORKED BY	SHUBHAM MITTAL	16.4.11
सामग्री सूची संख्या INVENTORY NO.	REV. NO. 02	जांचकर्ता CHECKED BY	R.C. AGARWAL	16.4.11

निर्माक एवं दिनांक SIGN & DATE				उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 20 Page 20 of 28	
सामग्री सूची संख्या INVENTORY NO		7. Valve characteristics - Lift vs Area ; Lift vs Flow - Pressure vs flow (upstream side/ down stream side) 8.* Part list of Valves, Actuators. BHEL will indicate their Tag nos. against each item and the same shall be submitted to the supplier for necessary updation. This is required for identification purpose. 9. List of Recommended & Commissioning spares. The supplier along with the main equipment shall supply commissioning spares for Valves, Actuators & HPSU. 10.* Valve & actuator test procedure. Test log sheets for valves and actuators. 11. Detailed QP for combined LP Bypass Stop & Control valves and their actuators. 12.* List of Instruments duly indicated with BHEL Tag Nos., service, set points, range & make etc. to be furnished. 12.2.3 Documents related to Water Injection Valves & Actuators: 1. Data sheets of valve & actuator indicating therein all parameters & material details. 2. General arrangement drawing of valve with actuator indicating therein major dimensions, dismantling dimensions & assembly weight. Bill of material must be tabulated on the assembly drawing. 3. Pneumatic/ Hydraulic actuator scheme (as applicable) indicating therein part numbers. 4. Part List of valve actuator. 5. Drawing for valve & actuator coupling arrangement. 6. Sizing calculation for valve & actuator. 7. Curve for water mass flow vs. % lift (indicating % lift at max. design water mass flow & min. controlled water mass flow). 8. Data sheets for all the items mounted on the control manifold. 9. Wiring diagram for electrical items. 12.2.4 Other Documents related to C & I: 1. Flow Nozzle data sheet as per ISO 5167. 2. Flow Nozzle drawing. 3. Flow Nozzle characteristic curve between differential pressure and flow (indicating calculation formula also). 4. List of Instruments (HPSU and Actuators) duly indicated with KKS Tag Nos., type, service, set points, range & make etc. 5.* Consumer list, Drive list, Signal I/O List. 6.* Recommended system logics/write-up. 7.* Electrical Terminal Wiring Details (HPSU Junction Boxes/Positioners and other components) 8.* Cabling Layout Diagram. 9.* Electro-pneumatic positioner catalogue (If applicable). 10.* Instruments Catalogues and data sheets of all electrical components. 11.* Separate feeder load list to be furnished, giving details of Power Supply, KW rating, Current drawn etc. for various motors, fans and other electrical drives. Note: “*”- These documents are required separately after placement of order.					
सामग्री सूची संख्या INVENTORY NO		COPYRIGHT AND CONFIDENTIAL The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.		स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग एवं आश्रय के बिना किसी भी तरह प्रयोग, जो कि कंपनी के हित में सकारात्मक हो न किया जाए !		निर्माक एवं दिनांक SIGN & DATE 	
सामग्री सूची संख्या INVENTORY NO P-6301		REV. NO. 02		निर्माणकर्ता WORKED BY SHUBHAM MITTAL		16.4.11	
				जांचकर्ता CHECKED BY R.C. AGARWAL		16.4.11	

दिनांक एवं हस्ताक्षर SIGN & DATE		उत्पाद मानक PRODUCT STANDARD		ST 47050		
				पृष्ठ 28 का 21 Page 21 of 28		
SUPERSEDES INVENTORY NO.	सामग्री पुराने संख्या को अधिकतमि जस्ता	Documents as sent along with the technical offer shall be scrutinized and finalized at BHEL end and the same shall be sent to the supplier for furnishing the final copy in triplicate after incorporating all comments, if any, in their drawings/documents for final approval. One copy of the final document shall be sent to the suppliers for their own record and reference. Order shall be placed on the supplier only after freezing all the technical points mutually. 25 hard copies & 3 soft copies on CD of the O&M manual and all other relevant documents shall be furnished by the vendor in the event of ordering. Out of 25 hard copies of O&M manual, 3 copies shall be kept with the equipments for ready reference & use at site and remaining 22 copies along with 3 soft copies on CD shall be sent to BHEL, Hardwar 10 weeks in advance prior to dispatch of equipment. 13.0 MARKING: - All items shall be attached / fixed with a metal identification plate indicating thereon the tag number as per schemes, equipment title & main parameters of the equipment. - All the final documents shall bear the following identification markings: - Component manufacturer's name - Name of Power Plant - Item Description - Purchaser Name - BHEL P.O. No. - Revision index for documents 14.0 PACKING & TRANSPORTATION: (a) All the equipment shall be suitably protected, coated or boxed (sea worthy packing) and crated to prevent damage or deterioration during transit, handling and storage at site till the time of erection. The bidder shall provide the site storage instruction applicable for the equipment after it arrives at the site. Lifting points & lugs shall be clearly identified. (b) Painting scheme along with relevant technical details for all the offered equipments shall be furnished by the supplier with the offer for review and approval by BHEL. (c) Supplier shall intimate shipping/dispatch plan of the offered equipment including details of each boxes & sub boxes to the purchaser at least 2 months prior to dispatch. One complete set of packing list duly indicating therein the detail of all items, should be placed inside the packing box for material verification at site and three copies of the same should be forwarded to the purchaser for their advance information & record. In case, there is any change in the shipping plan the same shall be informed to the purchaser well in advance.				
COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way, detrimental to the interest of the company.		स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भारत देश के इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रयोग एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए ।				
दिनांक SIGN & DATE	दिनांक SIGN & DATE	28/11/11				
सामग्री पुराने संख्या INVENTORY NO.	REV. NO. 02	निर्माणकर्ता WORKED BY		SHUBHAM MITTAL	16.4.11	
P-6301		जांचकर्ता CHECKED BY		R.C. AGARWAL	16.4.11	

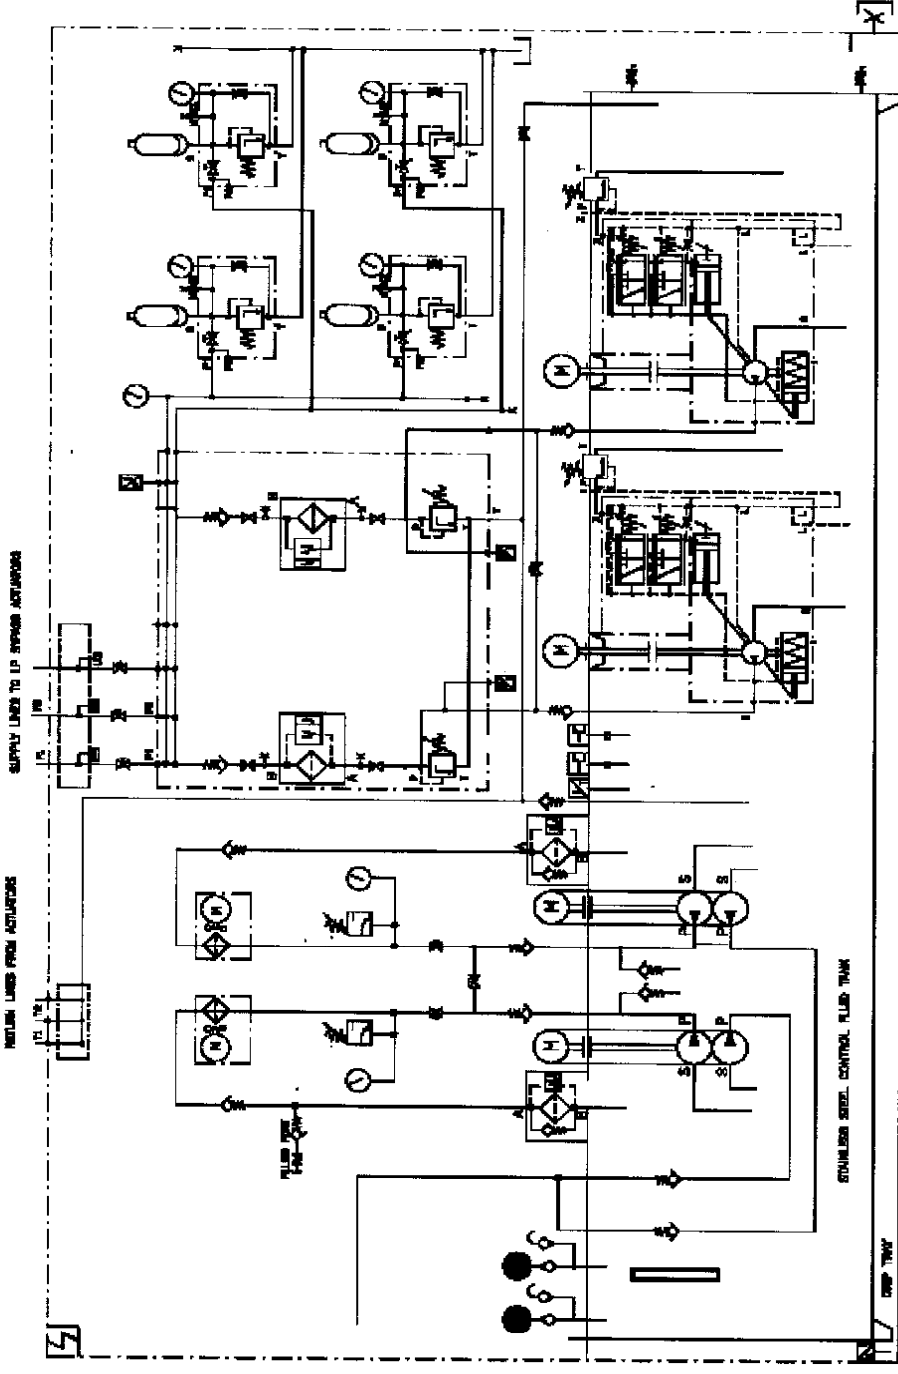
दिनांक एवं हस्ताक्षर SIGN & DATE			उत्पाद मानक PRODUCT STANDARD		ST 47050 पृष्ठ 28 का 22 Page 22 of 28	
शीर्षक सूची संख्या INVENTORY NO	SUPERSEDES INVENTORY NO	15.0 SUPERVISION DURING ERECTION-COMMISSIONING & TRAINING AT SITE: The supplier shall depute their representative at project site for erection & commissioning supervision. The lump sum charges for site supervision shall be included in the main offer for which the supplier has to provide the justification in the offer. The supplier shall conduct minimum 2 days training program at site regarding design/construction features, operation & maintenance of the supplied equipments (including C&I) for customer engineers and BHEL engineers during erection and commissioning. Schedule of the program shall be mutually agreed between supplier and customer/ BHEL engineers. The vendor to clearly indicate the extent of association of their service engineer during erection and commissioning of the supplied equipments at site in their offer. Further special instructions which are required to be followed at site during erection and commissioning shall be furnished by the vendor as per the schedule mentioned in the enclosed MDL. 16.0 GUARANTEE: The complete unit shall be guaranteed for 24 months of trouble free performance from the date of shipment or 18 months from commissioning date whichever is earlier. Incase of any failure or trouble reported from site, the supplier would depute their representative immediately to attend the problem and replace the defective component/parts if required. 17.0 PRICE: The supplier is to furnish the price against each assembly separately for the scope of supply as indicated in the input data sheet. 18.0 LIST OF CROSS REFERRED DOCUMENTS: - ASTM A312; DIN51519; EN10204; DIN EN287-1, EN 10228-3, EN 12680-2, ASTM E446.				
COPYRIGHT AND CONFIDENTIAL. The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company						
स्वत्वधिकार एवं गोपनीय दृष्टा प्रत्यक्ष में ही मंडल सुचना भारत हेवी इलेक्ट्रिकल्स की सम्पत्ति है इसका प्रत्यक्ष एवं अप्रत्यक्ष रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए।						
उत्तराक्षर एवं दिनांक SIGN & DATE	28/4/11					
शीर्षक सूची संख्या INVENTORY NO	P-6301	REV. NO. 02		निर्माणकर्ता WORKED BY	SHUBHAM MITTAL	16.4.11
				जांचकर्ता CHECKED BY	R.C. AGARWAL	16.4.11

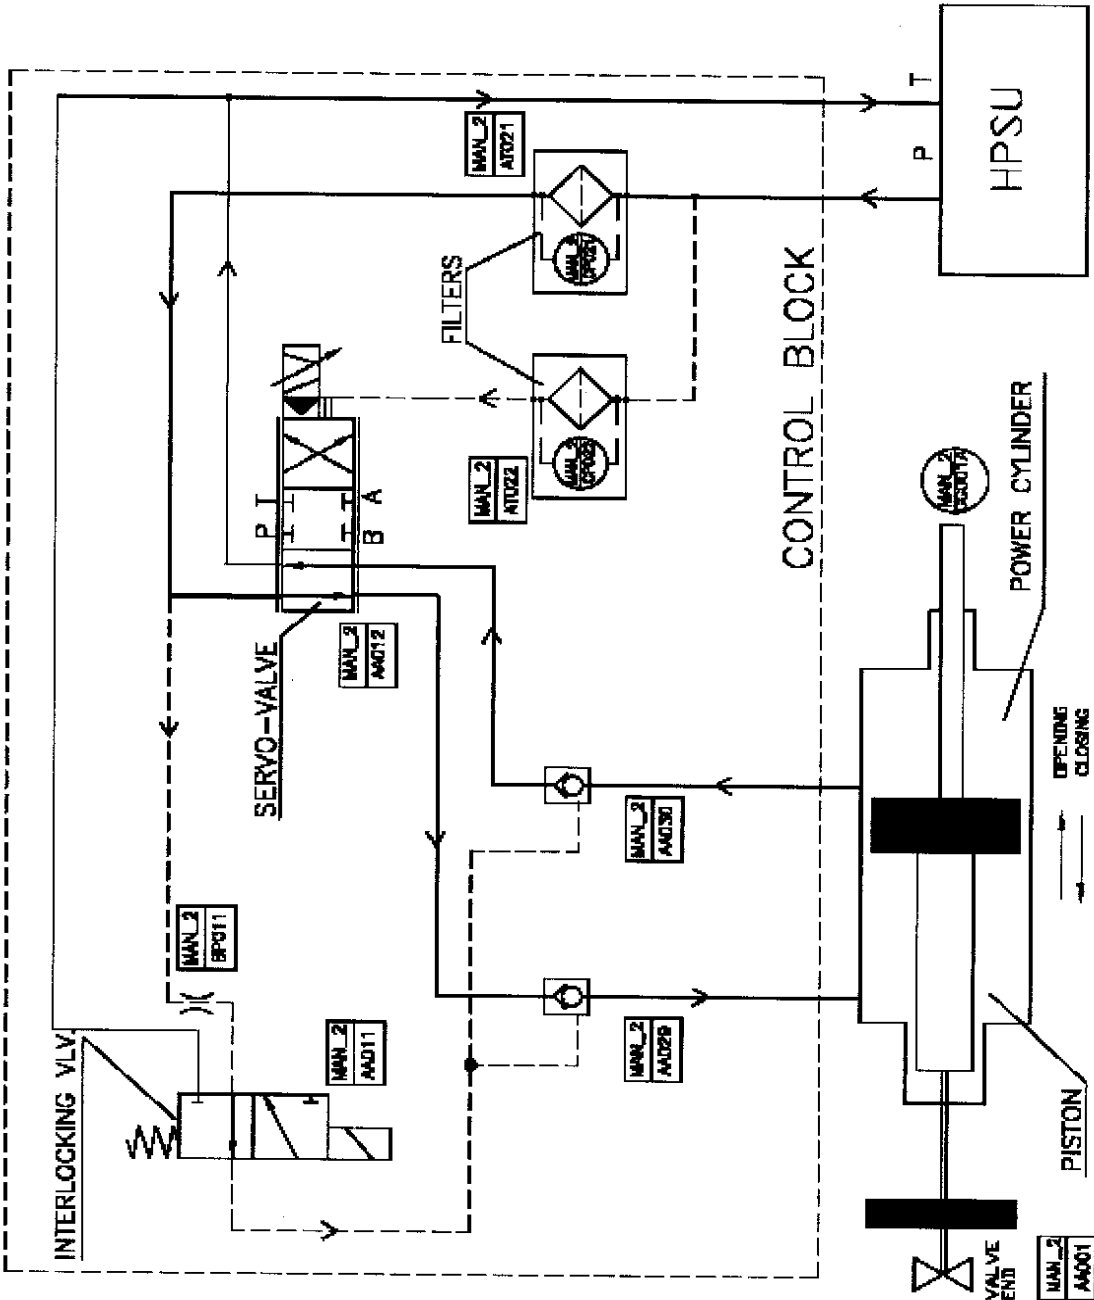
सामग्री पुरी संख्या INVENTORY NO. P-6301	हस्ताक्षर एवं दिनांक SIGN & DATE 28/11/11	स्वतंत्राधिकार एवं गोपनीय इस दस्तावेज में दी गई सूचना भारत हेतु इलेक्ट्रिकल्स के सम्पत्ति है इसका प्रयोग या अपरव्यवहार बिना लिखित अनुमति के बिना कम्पनी के हित में अधिकारक ही न किया जाए :	COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company	संशुद्धि सूची संख्या को अधिकारित व्यक्ति SUPERSEDES INVENTORY NO.	दिनांक एवं हस्ताक्षर SIGN & DATE
REV. NO. 02					
				उत्पाद मानक PRODUCT STANDARD	ST 47050 पृष्ठ 28 का 23 Page 23 of 28
निर्माणकर्ता WORKED BY SHUBHAM MITTAL जांचकर्ता CHECKED BY R.C. AGARWAL	16.4.11	16.4.11	APPENDIX-1 GENERAL ARRANGEMENT OF LP BYPASS VALVES (TYPICAL)		



NOTE :

1. SUPPORT FRAME AS SHOWN SHALL BE AN INTERNAL PART OF VALVE AND THESE SHALL BE IN SCOPE OF VALVE MANUFACTURER
2. DIMENSIONS AS MARKED '*' SHALL BE FURNISHED BY VALVE MANUFACTURER ALONGWITH THE TECHNICAL OFFER.
3. FRAME FOR VALVE SUSPENSION AND BYPASS VALVE SUSPENSION SHALL BE IN THE PURCHASER SCOPE I.E. IN BHEL SCOPE.
4. VALVE MANUFACTURER HAS TO FURNISH THE TOTAL ASSEMBLY WEIGHT AND ALL MAJOR DIMENSIONS AND ALSO THE CO-ORDINATES OF C.G.
5. STEAM OUTLET CONNECTION OF BYPASS VALVE SHALL BE CONNECTED WITH PIPE CONNECTED FURTHER WITH CONDENSER WITH 1° SLOPE

शारीरी सूची संख्या INVENTORY NO. P-6301	हस्ताक्षर एवं दिनांक SIGN & DATE 28/11/11	स्वत्वाधिकार एवं गोपनीय इस प्रलेख में दी गई सूचना भर्तृ के अतिरिक्त किसी तीसरे व्यक्ति को प्रसारित है इसका प्रसारण एवं प्रकाशन बिना लिखित अनुमति के ग्राहक को नहीं किया जा सकता है। अन्यथा इस से कानूनी भीतर प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाय।	COPYRIGHT AND CONFIDENTIAL. The information on this document is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	शारीरी सूची संख्या और अतिरिक्त संख्या SUPERSEDES INVENTORY NO.	दिनांक एवं हस्ताक्षर SIGN & DATE	REV. NO. 02	 उत्पाद मानक PRODUCT STANDARD ST 47050 पृष्ठ 28 का 24 Page 24 of 28 HYDRAULIC POWER SUPPLY UNIT FOR LP BYPASS SYSTEM (TYPICAL) APPENDIX-2 		
निर्माणकर्ता WORKED BY SHUBHAM MITTAL	जांचकर्ता CHECKED BY R.C. AGARWAL	16.4.11 16.4.11							

सामग्री सूची संख्या INVENTORY NO P-6301	स्वतःहस्ताक्षर एवं तिथि SIGN & DATE 28/11/11	स्वतःहस्ताक्षर एवं गोपनीय दृष्टावधान से दी गई सूचना भारत हेतु इलेक्ट्रिकल एंड मशीनरी हेतु दस्तावेज एवं उपकरण रूप से किसी भी तरह प्रयोग, जो कि कंपनी के हित में हानिकारक हो न किया जाए ।	COPYRIGHT AND CONFIDENTIAL The information on this documents is the property of Bharat Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	सामग्री सूची संख्या को अधिकतम जस्ता SUPERSEDES INVENTORY NO	तिथि एवं तारीख SIGN & DATE
REV. NO. 02					
				उत्पाद मानक PRODUCT STANDARD	ST 47050 पृष्ठ 28 का 26 Page 26 of 28
निर्माणकर्ता WORKED BY SHUBHAM MITTAL	जांचकर्ता CHECKED BY R.C. AGARWAL			APPENDIX-4 SCHEME FOR LP BYPASS CONTROL VALVE ACTUATOR (TYPICAL)	
					

ST 47050	
पृष्ठ 28 का 28	
Page 28 of 28	

उत्पाद मानक	
PRODUCT STANDARD	

APPENDIX-6, FORMAT-1	
----------------------	--

स्वत्वधिकार एवं गोपनीय The information on this documents is the property of Bhara, Heavy Electrical Limited. It must not be used directly or indirectly in any way detrimental to the interest of the company.	
COPYRIGHT AND CONFIDENTIAL	
समूची सूची संख्या SUPERSEDES INVENTORY NO.	
दिनांक एवं मंजूर SIGN & DATE	

MANUFACTURING QUALITY	
PROJECT PACKAGE CONTRACT NO. CONTRACTOR	
ITEM QP NO. REV. DATE	
SUB-SYSTEM	
TYPE OF CHECK QUANTUM OF CHECK REFERENCE OF ACCEPTANCE OF NORMS	
CLASS CHARACTERISTICS COMPONENT OPERATION SL. NO.	
1 2 3 4 5 6 7 8 9 10 11	
LEGEND: RECORDS IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY CONTRACTOR IN QA DOCUMENTATION * M : MANUFACTURER/SUBCONTRACTOR C : CONTRACTOR/NOMINATED INSPECTION AGENCY INDICATE 'P'-PERFORM, 'W'-WITNESS & 'V'-VERIFICATION AS APPROPRIATE, 'CHP' -SHALL BE IDENTIFIED IN COLUMN-11	
MANUFACTURER'S NAME & ADDRESS	
CONTRACTOR SIGNATURE	

REV. NO. 02	
निर्माणकर्ता WORKED BY SHUBHAM MITTAL	
जांचकर्ता CHECKED BY R.C. AGARWAL	
16.4.11	
16.4.11	