

**TAMIL NADU GENERATION DISTRIBUTION CORPORATION
LTD. (TANGEDCO)
2X800 MW UPPUR THERMAL POWER PROJECT**

**TECHNICAL SPECIFICATION
FOR
VIBRATION ISOLATION SYSTEM
FOR**

**ID FAN (4 NOS) FOUNDATION
PA FAN (4 NOS) FOUNDATION
FD FAN (4 NOS) FOUNDATION**

SPECIFICATION NO.: PE-TS-425-618-C001 (Rev 0)



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA-201301**

	TITLE : TECHNICAL SPECIFICATION FOR VIS FOR ID (4 NOS), PA(4 NOS) & FD(4 NOS) FAN FOUNDATION	SPECIFICATION NO. PE-TS-425-618-C001	
		SECTION	
		REV. NO. 0	DATE 12.10.2017

CONTENTS

This Technical Specification consists of two Sections:

SECTION I

- SPECIFIC TECHNICAL REQUIREMENTS.

SECTION II

- STANDARD TECHNICAL SPECIFICATION.
- REFERENCE QUALITY PLAN



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 1 of 9

COMPLIANCE CERTIFICATE

The bidder shall confirm compliance to the following by signing/ stamping this compliance certificate and furnishing same with the offer.

01. The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusion/ deviation with regard to same.
02. There are no deviation with respect to specification other than those furnished in the schedule of deviations.'
03. Only those technical submittals which are specifically asked for in NIT to be submitted at tender stage shall be considered as part of offer. Any other submission, even if made, shall not be considered as part of offer.
04. Any comments/ clarifications on technical/ inspection requirements furnished as part of bidder's covering letter shall not be considered by BHEL, and bidder's offer shall be construed to be in conformance with the specification.
05. Any changes made by the bidder in the price schedule with respect to the description/ quantities from those given in 'BOQ-Cum-Price schedule' of the specification shall not be considered (i.e., technical description& quantities as per the specification shall prevail).
06. QP will be subject to BHEL/Customer approval in the event of order & customer hold points for inspection/ testing shall be marked in the QP at the contract stage. Inspection/ testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc.

The charges for 3rd party inspection (Lloyds, or equivalent) for imported components shall be included in the base price of the equipment by the bidder.

07. All drawings/data – sheets etc. to be submitted during contract shall be subject to BHEL/Customer review/ approval.
08. GA drawings/ datasheet / QP as submitted with offer at tender stage are for reference purpose only. and shall be subject to approval during contract stage.
09. All sub vendors shall be subject to BHEL/CUSTOMER approval.
10. Any special tools & tackles, if required, shall be in bidder's scope.



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 2 of 9

SECTION-I
SPECIFIC TECHNICAL REQUIREMENTS



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 3 of 9

1.0 SCOPE

1.01 SUPPLY OF VIBRATION ISOLATION SYSTEM (VIS):

- i) Vibration Isolation System (VIS)
- ii) Tools and facilities required for erection and commissioning including seaworthy packing & transportation etc. complete.

1.02 SUPERVISION OF ERECTION AND COMMISSIONING OF THE VIS.

Vendor shall deploy experienced manpower for setting the VIS in position and final adjustments after machine installation. Vendor shall also confirm the readiness at site before deploying the manpower for supervision of erection. Vendor shall furnish proposed erection strategy of the entire system and procedure for replacement of VIS and downtime involved.

1.03 DESIGN & ENGINEERING FOR THE VIBRATION ISOLATION SYSTEM AND TOP DECK (INCLUDED IN VENDOR'S SCOPE)

Design and engineering shall consist of the following:

- i) Selection of Vibration Isolation System (VIS).
- ii) Static and dynamic analysis and design of RCC deck slab (supporting arrangement for the equipment supported on VIS)
- iii) Calculation of loads on supporting structure along with their points of application and deflection limitations.
- iv) Calculation should establish that not more than 10 % of the dynamic loads are transmitted to the substructure supporting VIS and that the foundation system meets the amplitude/frequency requirements.
- v) Checking of stiffness for structure supported on VIS.

1.04 DOCUMENTATION

Vendor shall furnish following documents:

- i) Bill of materials of various elements included in the supply along with detailed specifications of system and various items included in supply and standards local or international standards to which they conform.
- ii) General Arrangement (GA) drawing showing location and supporting details of VIS. **(Included in vendor's scope).**
- iii) GA and reinforced concrete details drawings for deck slab including bar bending schedule. **(Included in vendor's scope).**
- iv) Embedment drawings showing location of all embedment and their details pertaining to RCC deck slab **(Included in vendor's scope).**
- v) Design document. **(Included in vendor's scope).**
- vi) Methodology of providing the shuttering and its removal as well as concreting of deck slab, installation of VIS and sequence of above operation.
- vii) Installation and maintenance manual indicating equipment, procedures, etc. necessary for installation/maintenance of VIS.
- viii) List of power plants where such systems have been successfully installed for such applications.
- ix) Performance certificate from the end user/customer for at least two successfully executed contracts for such system.



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 4 of 9

2.0 GENERAL:

- 2.1 In case of any conflict between section –I and section-II, Section-I will prevail over section-II.
- 2.2 Vibration Isolation system (VIS) shall consist of steel helical springs and viscous damper.
- 2.3 The isolation efficiency of the foundation system comprising RCC deck and steel helical springs shall be at least 90%.
- 2.4 The ratio of actual spring supported weight to the nominal spring capacity shall be limited to 0.8.
- 2.5 Bidder shall quote based on the input drawings as per Table-1 to satisfy the design requirement as per the relevant applicable codes and section - II.

Table-1

<u>Sl. No</u>	<u>TITLE</u>	<u>DRAWING NO.</u>
1	GENERAL ARRANGEMENT DRAWING FOR ID FAN WITH FOUNDATION PLAN AND LOADING DATA- SAF 41/22.4-2	1-00-099-29098(R1)
2	GENERAL ARRANGEMENT DRAWING FOR PA FAN WITH FOUNDATION PLAN AND LOADING DATA- PAF 20/11.2.-2	1-00-100-29099(R1)
	GENERAL ARRANGEMENT DRAWING FOR FD FAN WITH FOUNDATION PLAN AND LOADING DATA- FAF 26/12.5.-1	1-00-098-29097(R1)

2.6 Bidder shall furnish the information about the entire range of spring units, damper units and spring cum damper units, manufactured by the vendor. The information to be furnished should include the load carrying capacity, stiffness (vertical & horizontal), damping resistance, dimension of spring and damper units as well as quality plan. Bidder shall also furnish the spring selection in their offer based on the input drawings.

2.7 The steel helical springs and viscous damper supplied should be of proven make.

3.0 DOCUMENTS TO BE SUBMITTED BY VENDOR

3.1 Document submission schedule after the award of contract shall be as below:

PACKAGE	BHEL DRG NO	DRG TITLE	Drg Submission schedule
	Primary Documents - affecting Manufacturing/ Delivery Directly		
	PE-V0-425-618-C201	Data sheet of VIS for ID/PA/FD Fan Foundation	R-0 within Two (02) weeks from LOI/PO & subsequent revisions within 10 days of comments received from BHEL/customer.
	PE-V0-425-618-C202	QAP of VIS for ID/PA/FD Fan Foundation	
	PE-V0-425-618-C203	Test certificate of VIS for ID/PA/FD Fan Foundation Mill	



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0 **DATE 12.10.2017**

SHEET 5 of 9

		Foundation	
	PE-V0-425-618-C206	Static & dynamic Analysis of VIS for ID Fan Foundation	
	PE-V0-425-618-C204	Static & dynamic Analysis of VIS for PA Fan Foundation	
	PE-V0-425-618-C205	Static & dynamic Analysis of VIS for FD Fan Foundation	
	PE-DG-425-618-C001	Civil GA drwg of ID Fan Foundation	
	PE-DG-425-618-C003	Civil GA drwg of PA Fan Foundation	
	PE-DG-425-618-C005	Civil GA drwg of FD Fan Foundation	
	Secondary Documents - NOT affecting Manufacturing / Delivery Directly		
	PE-DG-425-618-C002	RC details of Top Deck of ID Fan Foundation	
	PE-DG-425-618-C004	RC details of Top Deck of PA Fan Foundation	R-0 within Two (02) weeks of Cat-I(or)II approval on GA drawing
	PE-DG-425-618-C006	RC details of Top Deck of FD Fan Foundation	

3.2 The documents shall be submitted as mentioned below:

- Soft copy of all documents/drawings shall be furnished in pdf and AutoCAD format as applicable.
- Hard copies shall also be submitted.
- Submission of civil drawings/documents shall be as mentioned in the table-2.

Table-2

	Drawing	Document
For Approval	Soft copy + 10 nos. hard copies	Soft copy + 10 nos. hard copies
For RFC	Soft copy + 8 nos. hard copies	

4.0 SPECIFIC REQUIREMENTS

- The VIS module shall consist of a number of springs with same or different stiffness properties.
- The total number of springs in a VIS module should be even.
- The VIS module should be structurally stable. Stability of the module in all direction needs to be ensured under maximum load carrying capacity.
- The springs shall conform to codes DIN EN 13906-1 and DIN 2096 or equivalent.
- The spring units shall have definite stiffness in both vertical and horizontal directions with the horizontal stiffness not less than 50% of vertical stiffness.
- The vertical deflection of the VIS module under its rated nominal load shall not be less than 47 mm. However, in case bidder offers to supply their standard VIS module with variation in the value of deflection, same may be accepted by BHEL subject to variation of - 5 %.



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 6 of 9

- 4.7 The damper units or spring cum damper units should be of viscous type offering velocity proportional damping.
- 4.8 The damper units shall be suitable for temperatures ranging from 0 to 50° c.
- 4.9 The damping resistance of the individual damper units shall be such that the designed damping can be provided using reasonable number of units.
- 4.10 Damper units shall have damping resistance in the range of 40kNsec/m to 750 kN-sec/m.
- 4.11 The visco-liquid shall be silicon based visco-liquid (of M/s Wacker make or equivalent) or equivalent satisfying QP requirements.
- 4.12 The sizes of the spring units, damper units, spring cum damper units should be such that groups of such units can be accommodated on column heads in case of elevated foundations and on pedestals/walls in case of foundations at ground level.
- 4.13 The minimum plan dimension of contact area of the VIS module shall not be less than 100 mm x 280 mm. The VIS module in the same foundation should have same deflection under its rated load carrying capacity. The height of all the modules to be used in a foundation must be same.
- 4.14 The bolts in the VIS module shall be designed with minimum factor of safety of 2.
- 4.15 One nut along with lock nut shall be used in top and bottom plate.
- 4.16 The steel helical springs and viscous dampers shall be designed for ensuring "fit and forget" guarantee.
- 4.17 Bidder shall furnish manufacturer's certificate for the bought out items.
- 4.18 Bidder shall furnish details of their sub vendors for approval of BHEL.
- 4.19 The steel helical springs and viscous dampers shall be designed for a minimum operating life of 30 years.
- 4.20 Price per Visit is lumpsum which includes travel and accommodation charge. Payment for site visit shall be made on site certification for the actual number of days stayed at site.
- 4.21 The requirement has been mentioned in the reference quality plan. Requirement of major items again summarised below :

Description of Items	REQUIREMENT
Material for boxes	IS 2062/DIN EN 10025/ JVHT 02/JVHHT 01B00/SAILMA 350 HI/SAILMA 350 or equivalent
Material for Springs	50 Cr V 4 As per DIN 17221 or 51 Cr V 4 As per EN10089 or Equivalent
Studs & Nuts	Material: Galvanised Mild steel
Visco-liquid	Silicone based or Equivalent



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 7 of 9

	• M/s Wacker make or equivalent satisfying QP requirements • Manufacturer's Certificate
Welding	Refer annexure-1
Shot Blasting	Sa 2-1/2 as per EN ISO12944-4
Painting	Refer Annexure-2

5.0 SEISMIC LOADING:

The project site is in Zone-II as per IS: 1893/Part I-2003 & IS: 1893-Part II-2005.

Zone factor Z: 0.10

Importance factor: 1.75

6.0 WIND LOADING:

Basic wind speed at project site is 47 m/sec. as per IS:875-1987 Part-3

Probability factor, (k1 risk coefficient), terrain, height and structure size factor, k2 and topography factor, k3 shall be as per IS:875.

7.0 MATERIAL OF CONSTRUCTION

- Minimum grade of concrete: M35.
- Reinforcing bars will be TMT bars of grade Fe500 conforming to IS-1786.

8.0 MATERIAL (DESIGN & SUPPLY)

7.1 Supply of Steel helical springs and viscous dampers shall consist of:

- Steel helical spring units and viscous dampers along with viscous liquid including associated auxiliaries for installation of the spring units and dampers like steel shims, adhesive pads, etc.
- Frames for pre-stressing of spring elements.
- Suitable hydraulic jack system including electric pumps, high pressure tubes, manifold, lifting hook, packing plate, supporting stool, etc. required for the erection, alignment etc. of the spring units. One set of extra hydraulic jacks, and hand operated pumps shall also be provided.
- Any other items may be required for the pre-stressing, erection, release of pre-stress, alignment and commissioning of the steel helical springs and viscous dampers.

7.2 The sizes of the spring units, damper units, spring cum damper units should be such that groups of such units can be accommodated on column heads in case of elevated foundations and on pedestals/walls in case of foundations at ground level.



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 8 of 9

- 7.3 The steel helical springs and viscous dampers shall be designed for ensuring “fit and forget” guarantee.

9.0 MANUFACTURING & TESTING

- 9.1 Complete manufacturing and testing of the steel helical springs and viscous dampers shall be done at the manufacturing shop of the vendor. For this purpose the vendor shall submit the detailed programme for approval of customer and take up the manufacturing / testing after approval of such programme. The programme (quality plan) shall include:

- i. Manufacturing schedule and quality check exercised during manufacturing.
- ii. Detail of test to be carried out at the manufacturing shop with its schedule.
- iii. Special requirements, if any, regarding concreting of top deck.
- iv. Complete step- by- step procedure covering the installation and commissioning of the spring system.
- v. Manuals for erection, commissioning, testing and maintenance of the steel helical springs and viscous dampers.
- vi. A checklist for confirming the readiness of the civil fronts for erection of steel helical springs and viscous dampers.
- vii. Checklist for equipment required at each stage of erection.
- viii. Bill of materials (data sheet) of various elements such as spring units, viscous dampers, with their rating, stiffness etc. included in the supply.
- ix. Bill of material (data sheet) for frames for pre stressing, hydraulic jack including electric pump, high pressure tubes, hand operated pump etc. with their rating and numbers.
- x. Any other details which may be necessary to facilitate design and construction of the foundations / structures.

- 9.2 The springs shall conform to codes DIN EN 13906-1 and DIN 2096. The quality assurance and inspection procedure shall be finalised on the basis of the above codes and the quality plans be drawn accordingly.

10.0 ERECTION AND COMMISSIONING AND SUPERVISION

- 10.1 Complete erection and commissioning of the steel helical springs and viscous dampers including pre-stressing of elements, placing of elements in position, checking clearances on the shuttering of the RCC top deck, releasing of pre-stress in spring elements, making final adjustments and alignments etc. all shall be supervised by a specialist supervisor.
- 10.2 The scope of work shall be deemed to include all activities, which may not have been explicitly mentioned but are reasonably implied for the successful commissioning of steel helical springs and viscous dampers.

11.0 REALIGNMENT OF SPRING SYSTEM

If any realignment of the steel helical springs and viscous dampers is required to be done for aligning the shaft or for any other reasons during the first one year of operation from the date of commissioning of the machine, the same shall be done by the vendor without any price implication.

12.0 TRANSPORTATION



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.) , PA(4 NOS.) & FD (4 NOS.)
FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION I

REV. NO. 0

DATE 12.10.2017

SHEET 9 of 9

12.1 Steel helical springs and viscous dampers shall be suitably protected, coated, covered, boxed and crated to prevent damage or deterioration during transit and handling.

12.2 The vendor shall be responsible for any loss or damage during transportation, handling.

13.0 INSPECTION REQUIREMENTS

13.1 Minimum requirement for quality plan shall be as per quality plan attached in section –II of the specification. Quality plan shall be subject to approval during detail engineering. No price implication shall be admissible to QP approval by BHEL/Customer.

13.2 Inspection for imported item shall be done from third party like Lloyd or equivalent and certificate shall be submitted for review of BHEL.

13.3 In case of new bidder, bidder may need to carry out damping test, stiffness test etc. during customer approval stage before price bid opening. No price implication shall be admissible for these tests.

13.4 Vendor shall furnish the quality plan and Test certificate for the hardware in their scope of supply. The quality plan shall be reviewed by BHEL/Consultant wherein the inspection and hold points shall be indicated. Vendor shall submit test certificate based on approved quality plan. Despatch of material by the vendor shall only take place after the receipt of Material Dispatch Clearance Certificate (MDCC) issued by BHEL/Consultant on the basis of test reports/test certificates submitted by the Vendor after manufacture.

14.0 CODES AND STANDARDS

Latest revision of following codes or equivalent international standard shall be used for the design of the spring-supported foundations:

- 1) IS: 456 Codes practice for plain and reinforced concrete.
- 2) IS: 2974 Code of practice for design and construction of machine foundations.
- 3) IS: 1893 Criteria for earthquake resistant design of structures.
- 4) DIN: 4024 Machine foundations; Flexible supporting structures for machine with rotating masses
- 5) DIN EN 13906-1: Helical compression springs out of round wire and rod: calculation & design.
- 6) DIN: 2096 Helical compression springs out of round wire and rod: quality requirements for hot formed compression springs.
- 7) ISO 10816 (Part 1 to Part 7) Mechanical vibration – Evaluation of machine vibration by measurements on non-rotating parts.



TITLE :
TECHNICAL SPECIFICATION FOR
VIBRATION ISOLATION SYSTEM

SPECIFICATION NO. PE-TS-999-600-C026

SECTION II

REV. NO. 0

DATE 14.06.2016

SHEET 1 OF 3

SECTION-II

STANDARD TECHNICAL SPECIFICATION



TITLE :
TECHNICAL SPECIFICATION FOR
VIBRATION ISOLATION SYSTEM

SPECIFICATION NO. PE-TS-999-600-C026

SECTION II

REV. NO. 0 **DATE 14.06.2016**

SHEET 2 OF 3

1.0 SCOPE :

This section covers supply, supervision of erection commissioning & design engineering of the vibration isolation system (VIS) suitable for ID/PA/FD Fans/ TDBFP/MDBFP/ TURBOGENERATORS/ MILLS. The vibration isolation system shall be of proven make and should be in successful operation for similar machines.

2.0 SUPPLY OF VIBRATION ISOLATION SYSTEM (VIS)

VIS shall be supplied complete along with recommended spares if any. The selection of VIS shall be done by the vendor, in case not done by customer so that the amplitude at bearing locations are within permissible limits as per machine supplier recommendation or ISO 10816 whichever is governing and no dynamic loads are transferred to structure supporting VIS. Minimum 90% isolation shall be achieved and the system shall be capable of withstanding Seismic/Wind forces.

3.0 SUPERVISION OF ERECTION AND COMMISSIONING

3.01 Manual

Vendor shall supply installation and maintenance manual indicating equipment procedures etc. necessary for installation and replacement of VIS with downtime involved.

3.02 Tools and facilities

Vendor shall supply all tools and facilities as required for successful erection and commissioning of VIS. Vendor shall deploy experienced manpower to supervise successful installation of VIS.

4.0 DESIGN ENGINEERING OF VIBRATION ISOLATION SYSTEM

4.01 Dynamic Analysis

The dynamic analysis shall consist of free vibration analysis and forced vibration analysis. Isolation efficiency of at least 90% shall be obtained. The fundamental natural frequency shall be sufficiently above or below the frequency corresponding to operating speed. Vibration amplitude shall be calculated at all bearing locations and shall satisfy the permissible limits as per ISO 10816 or as specified by the machine supplier. Transient analysis shall be carried out for the short circuit / blade failure condition with an appropriate force function if required by the machine supplier. The forces for which substructure is to be designed shall be furnished.

4.02 Static Analysis

The static analysis shall include the

- a) Dead weights of machine stationary parts
- b) Dead weights of machine rotary parts
- c) Loads due to machine power torque
- d) Loads due to maximum allowable unbalance
- e) Temperature loads
- f) Loads due to blade unbalance/short circuit
- g) Erection loads
- h) Seismic loads
- i) Any other loads given by the supplier

Various loads combinations must be investigated to obtain the most severe loads for



TITLE :
TECHNICAL SPECIFICATION FOR
VIBRATION ISOLATION SYSTEM

SPECIFICATION NO. PE-TS-999-600-C026

SECTION II

REV. NO. 0 **DATE 14.06.2016**

SHEET 3 OF 3

foundation design purpose as per relevant IS codes or as per machine supplier recommendation whichever is more critical.

4.03 CHECK FOR SHAFT MISALIGNMENT

Foundation deck must be adequately stiff to withstand all operating load combinations without excessively upsetting the rotor shaft alignment. The structural design must carefully be analysed for relative deflection for the members supporting machine shaft to satisfy the limits as given by machine supplier if any.

4.04 DESIGN OF RCC DECK SUPPORTED ON VIS

Vendor shall provide General arrangement drawing of deck showing location and supporting detail of VIS, all embedment and their details as per the machine supplier drawing.

RCC design shall be done by working stress method for all machine foundations. Minimum reinforcement shall be governed by IS: 2974 as well IS:456.

All documents/drawings shall be supplied in 25 (twenty five) prints. All calculations shall be supplied in 6 (six) sets. Soft copy of the drawings in Auto Cad shall be supplied along with the soft copy of the documents supplied. All documentation shall be in English language and all RCC/structural design shall be conforming to the relevant Indian Standard Code of practice.

5.0 QUALITY PLAN AND TEST CERTIFICATE

Vendor shall furnish the quality plan and Test certificate for the hardware in their scope of supply. The quality plan shall be reviewed by BHEL/Consultant wherein the inspection and hold points shall be indicated. Vendor shall submit test certificate based on approved quality plan. Despatch of material by the vendor shall only take place after the receipt of Material Dispatch Clearance Certificate (MDCC) issued by BHEL/Consultant on the basis of test reports/test certificates submitted by the Vendor after manufacture.

6.0 ENVIRONMENTAL PROTECTION

VIS shall be suitably protected against environmental damages e.g. abrasion, discolouration, corrosion, oily water etc. to give a prolonged service matching the plant life.



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR ID (4 NOS.), PA(4 NOS.) & FD(4
NOS.) FAN FOUNDATION

SPECIFICATION NO. PE-TS-425-618-C001

SECTION II

REV. NO. 0

DATE 12.10. 2017

SECTION-II

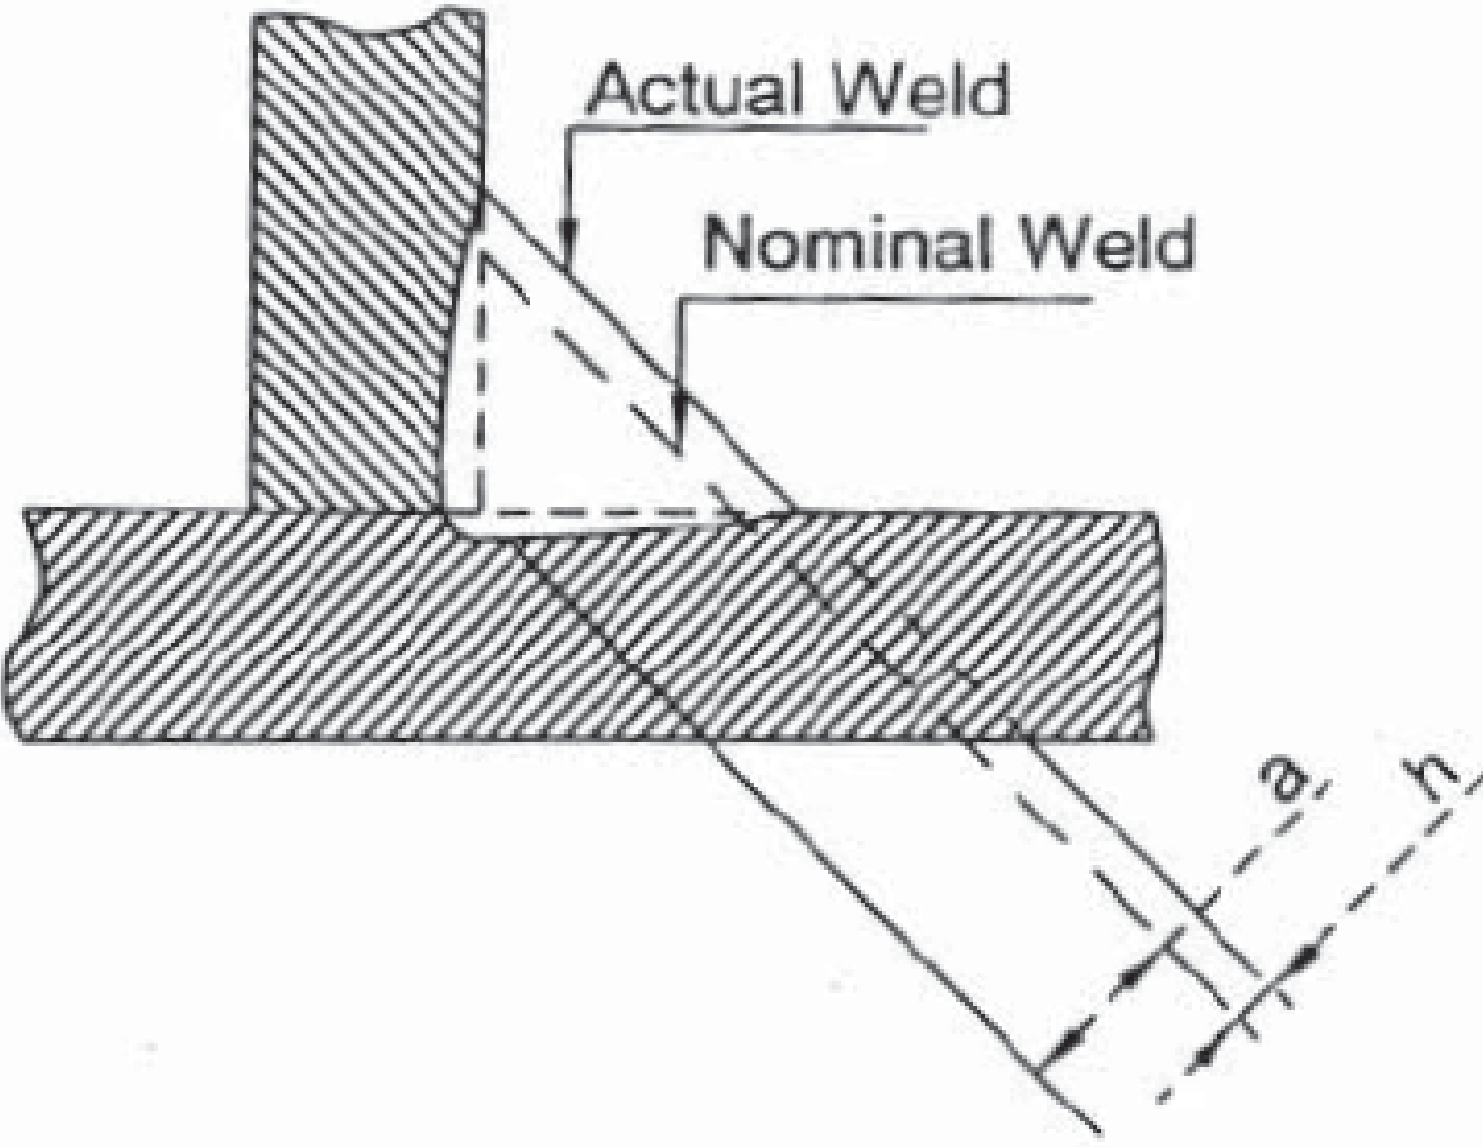
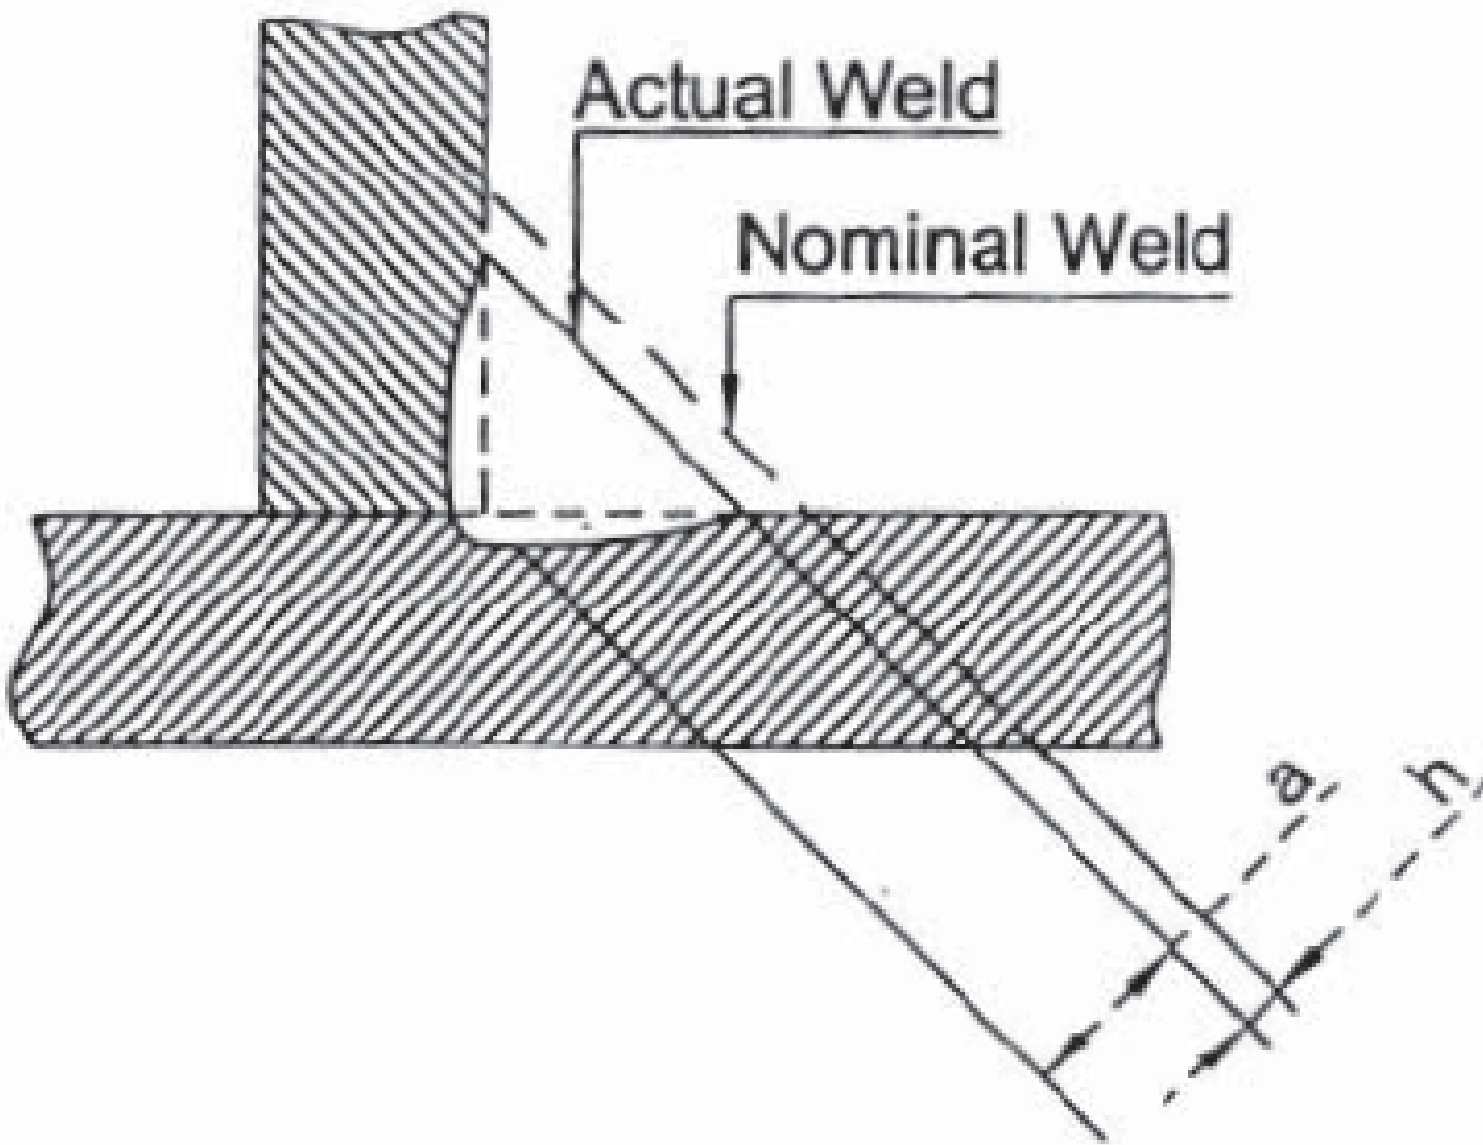
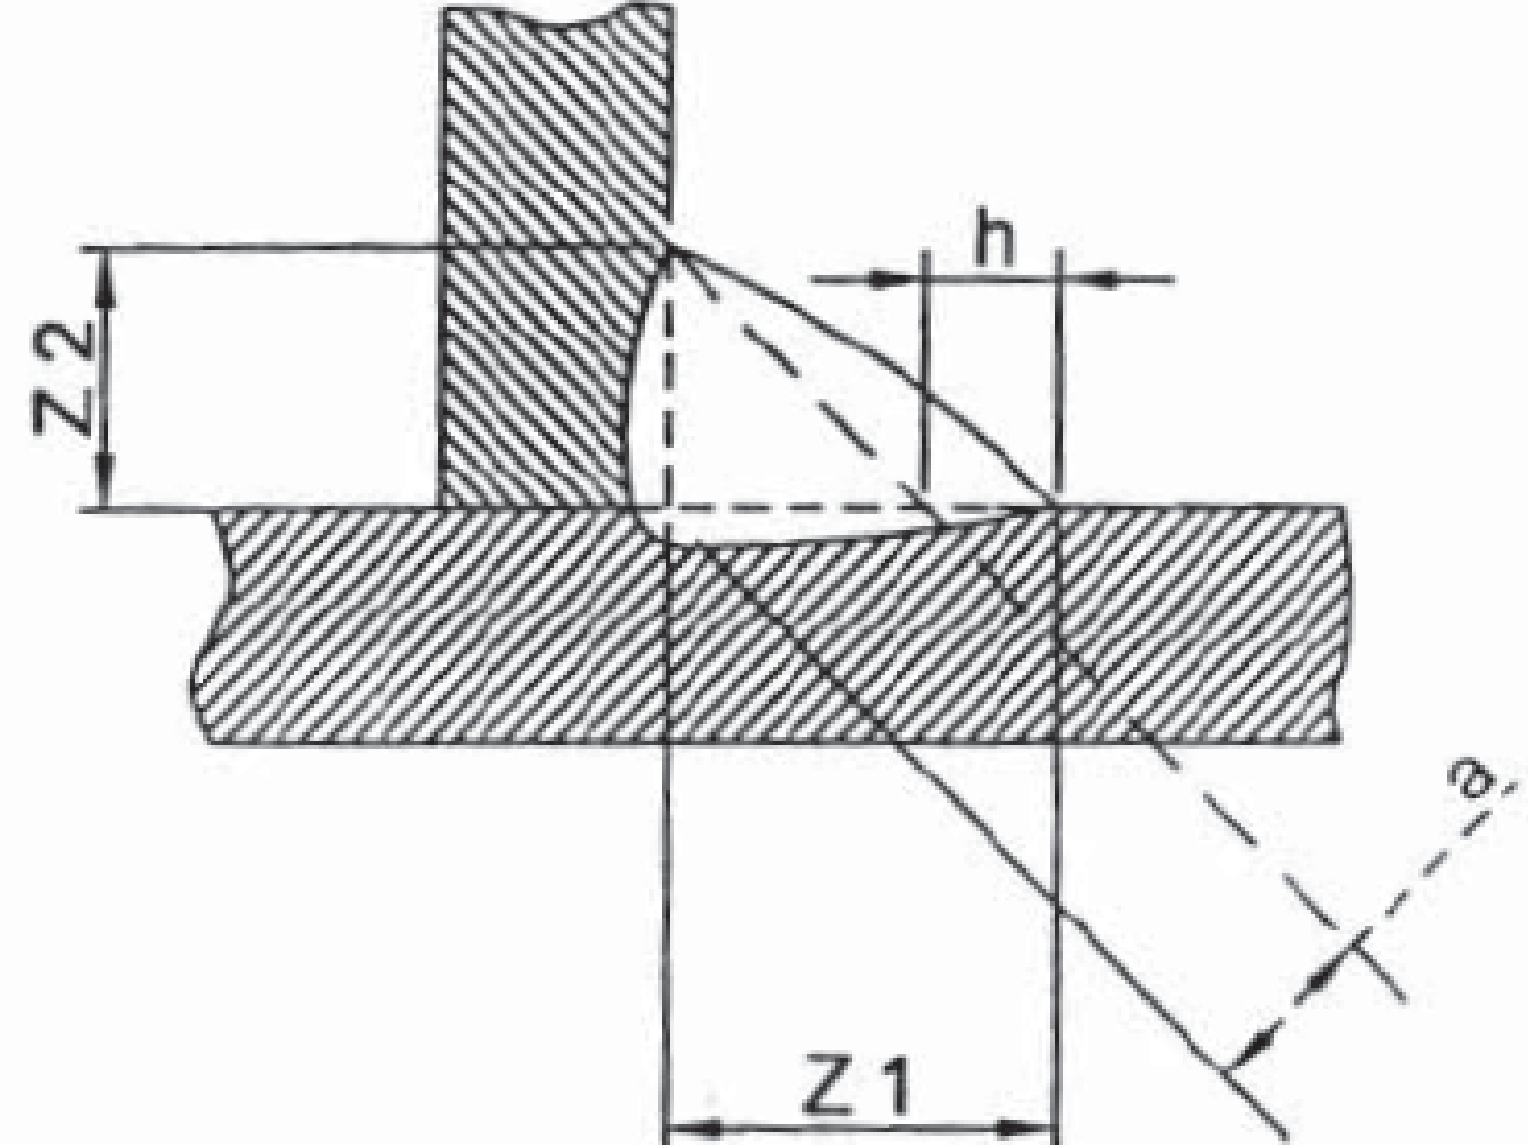
REFERENCE QUALITY PLAN

Manufacturer's logo		Manufacturer's name and Address				MANUFACTURING QUALITY PLAN (I-QAP)			Project: Main supplier: BHEL BHEL P.O NO:					
						ITEM : Vibration isolation system Equipment: Spring Unit: Module name as per Vendor								
Sl. No.	COMPONENT AND OPERATION	CHARACTERISTICS	CLASS	TYPE OF CHECK	QUANTUM OF CHECK	REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD	AGENCY 10				REMARKS	
1	2	3	4	5	6	7	8	9	D	M	C	B	11	
1	Materials													
1.1	For boxes	Chemical/Mechanical	Minor	Verify	One / Heat	IS 2062/DIN EN 10025/ JVHT 02/JVHHT 01B00/SAILMA 350 HI/SAILMA 350 or equivalent	Same as column "7"	Certificate	✓	P	V	V		
1.2	For Springs	a) Chemical	Major	Verify	One / Lot	50 Cr V 4 As per DIN 17221 or 51 Cr V 4 As per EN10089 or Equivalent	Same as column "7"	Certificate	✓	P	V	V		
		b) Grain Size	Major	Verify	One / Lot	ASTM E 112	ASTM 5 or finer	Certificate	✓	P	V	V		
		c) NMI	Major	Verify	One / Lot	IS 4163	ABCD series T/H-2.0/1.5	Certificate	✓	P	V	V		
		d) Micro structure	Major	Verify	One / Lot	--	DIN 17221or equivalent	Certificate	✓	P	V	V		
1.3	Springs at Manufacturer's end	Hardness	Major	Test	One/Lot	IS 1500	415-460 BHN	Certificate	✓	P	V	V		
1.4	Springs at Manufacturer's end	Decarburization	Major	Test	One / Lot	IS 6396	Max. depth 0.5% of bar dia - partial	Certificate	✓	P	V	V		
1.5	Springs at Manufacturer's end	NDE after compression	Major	Test	100%	IS 3703	No cracks	Certificate	✓	P	V	V		
1.6	Springs (at vendor end)	Spring Rate	Major	Test	AQL 4.0	DIN 2096	Same as column "7"	Lab Register	✓	P	V	V		
1.7	Adhesive pads (jute),4mm thick, Steel shims	Dimensions (mm)	Minor	Measure / Visual	5 %	Drawing	DIN 7168 Sg	Internal Record	✓	P	V	V		
1.8	Viscoliquid	Viscosity/ Penetration speed (mm/sec)	Major	Test	Sample	DIN 53019 or equivalent	Same as column "7"	Certificate	✓	P	V	V		
1.9	Damping resistance (To be done once for each visco damper module)	kN-s/m	Major	test	Sample	Vendor's datasheet	Same as column "7"	Certificate	✓	P	V	V		
1.10	Studs & Nuts	Chemical Dimensions (mm)	Minor Minor	Verify Measure	One / Lot 5%	IS 1367 (Grade 6.8 & Class 6) IS 4218 (Tolerance Class 6g & 6H)	Same as column "7" Same as column "7"	Lab Test Report	✓	P	V	V		
2	In Process Inspection													
2.1	Welding	Visual / Surface exam (mm)	Major	Visual / Measure	10% on welds	Annexure-1(attached)	Same as column "7"	Certificate	✓	P	V	V		
		NDE	Major	DPT	10% Random	ASTM / E 165	Same as column "7"	Certificate	✓	P	V	V		
2.2	Boxes	Dimensions (mm)	Major	Measure	10%	Drawing & data sheet	EN ISO 13920 C	Internal record	✓	P	V	V		
3	Final Inspection													
3.1	Shot Blasting	Picture	Major	Compare	10%	EN ISO12944-4	SA – 2 ½	Certificate	✓	P	V	V		
3.2	Painting	Thickness (270 microns)	Major	Measure / Visual	10%	Annexure-2(attached)	Same as column "7")	Certificate	✓	P	V	V		
3.3	Spring Unit	Dimensions (Except HF&HV)	Minor	Measure	10%	Drawing / Datasheet	EN ISO 13920 C	Internal Record	✓	P	W	V		
3.4	Constant of Spring Units (Vertical; Kv)	Load Vs Displacement (kN/mm)	Critical	Test	10%	DIN 2096 & DIN 2089	Data Sheet	Certificate	✓	P	W	V		
3.5	Document Control	Verification of above documents (TC/IR)	Major	Compare	All	MQP	Same as column "7"	Certificate	✓	P	V	V		
3.6	Packing / Marking	Visual	Major	Visual / Compare	100%	As per vendor's standard	Same as column "7"	Certificate	✓	P				
MANUFACTURER/ SUB-CONTRACTOR			LEGEND: # RECORDS, IDENTIFIED WITH 'TICK' SHALL BE ESSENTIALLY INCLUDED BY MANUFACTURER IN QA DOCUMENTATION M: MANUFACTURER/ SUB-CONTRACTOR C: : MAIN SUPPLIER, B: CUSTOMER INDICATE 'P' PERFORM 'W' WITNESS AND 'V' VERIFICATION					NAME & SIGNATURE OF APPROVING AUTHORITY WITH SEAL						
SIGNATURE							REVIEWED BY							

ANNEXURE - 1

WELDING

WELDING DETAILS

SI No	Imperfection Designation	Outside status	Limits for Imperfection with reference to quality level: DIN EN 25817 / D
1.	Excessive convexity		$h \leq 1\text{mm} + 0.25\text{ } b \text{ ; max. } 5\text{mm}$
2.	Fillet weld having a throat thickness smaller than the nominal value	 A fillet weld with an apparent throat thickness smaller than that prescribed should not be regarded as being imperfect if the actual throat thickness with a compensating greater depth of penetration complies with the nominal value.	Short imperfections: $h \leq 0.3\text{ mm} + 0.1.a \text{ ; max. } 2\text{mm}$ Long imperfections: Not Permitted
3.	Excessive asymmetry of fillet weld	 It is assumed that the asymmetric fillet weld has not been expressly prescribed.	$h \leq 2\text{mm} + 0.2\text{ } a$

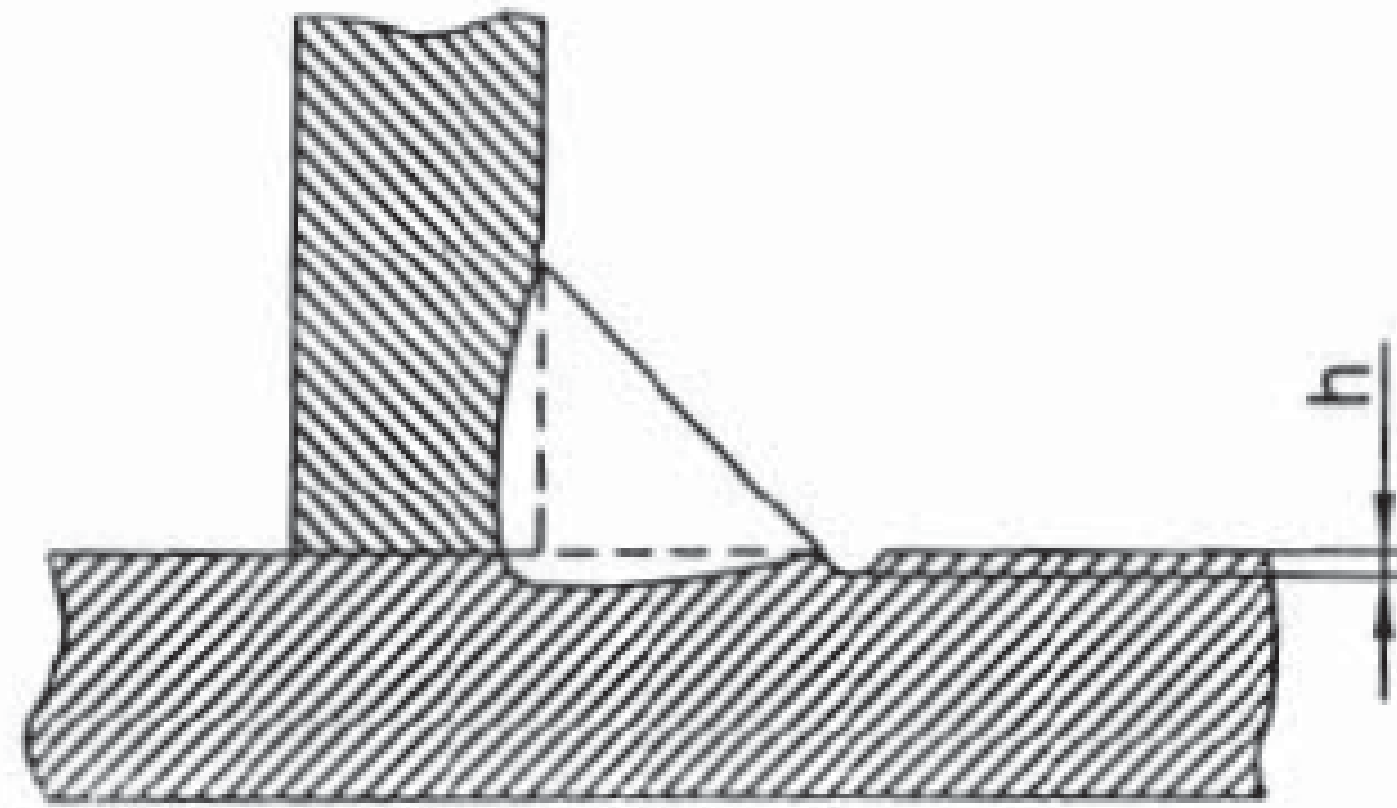
WELDING DETAILS

Limits for Imperfection with
reference to quality level:
DIN EN 25817 / D

SI
No Imperfection
Designation

Outside status

4. Undercut



Smooth transition is required

$h \leq 1.5\text{mm}$

5. Gas pores and porosity

The following conditions and limits for
imperfections shall be fulfilled

a) Maximum dimension of the summation of the
projected or surface crack area of the
imperfection.

4%

b) Maximum dimension of a single pore for
-butt welds
-fillet welds

$d \leq 0.5 s$
 $d \leq 0.5 a$

c) Maximum dimension for a single pore

5 mm

6. Localised (clustered)
porosity

The total pore area within the cluster should be
summed and calculated as a percentage of the greater
of the two areas; an envelop surrounding all the pores
or a circle with a diameter corresponding to the weld
width.

The permitted porous area should be local. The
possibility of masking other imperfections should be
taken into consideration.

The following conditions and limits for imperfections
shall be fulfilled:

a) Maximum dimension of the summation of the
projected or surface crack area of the imperfection

16%

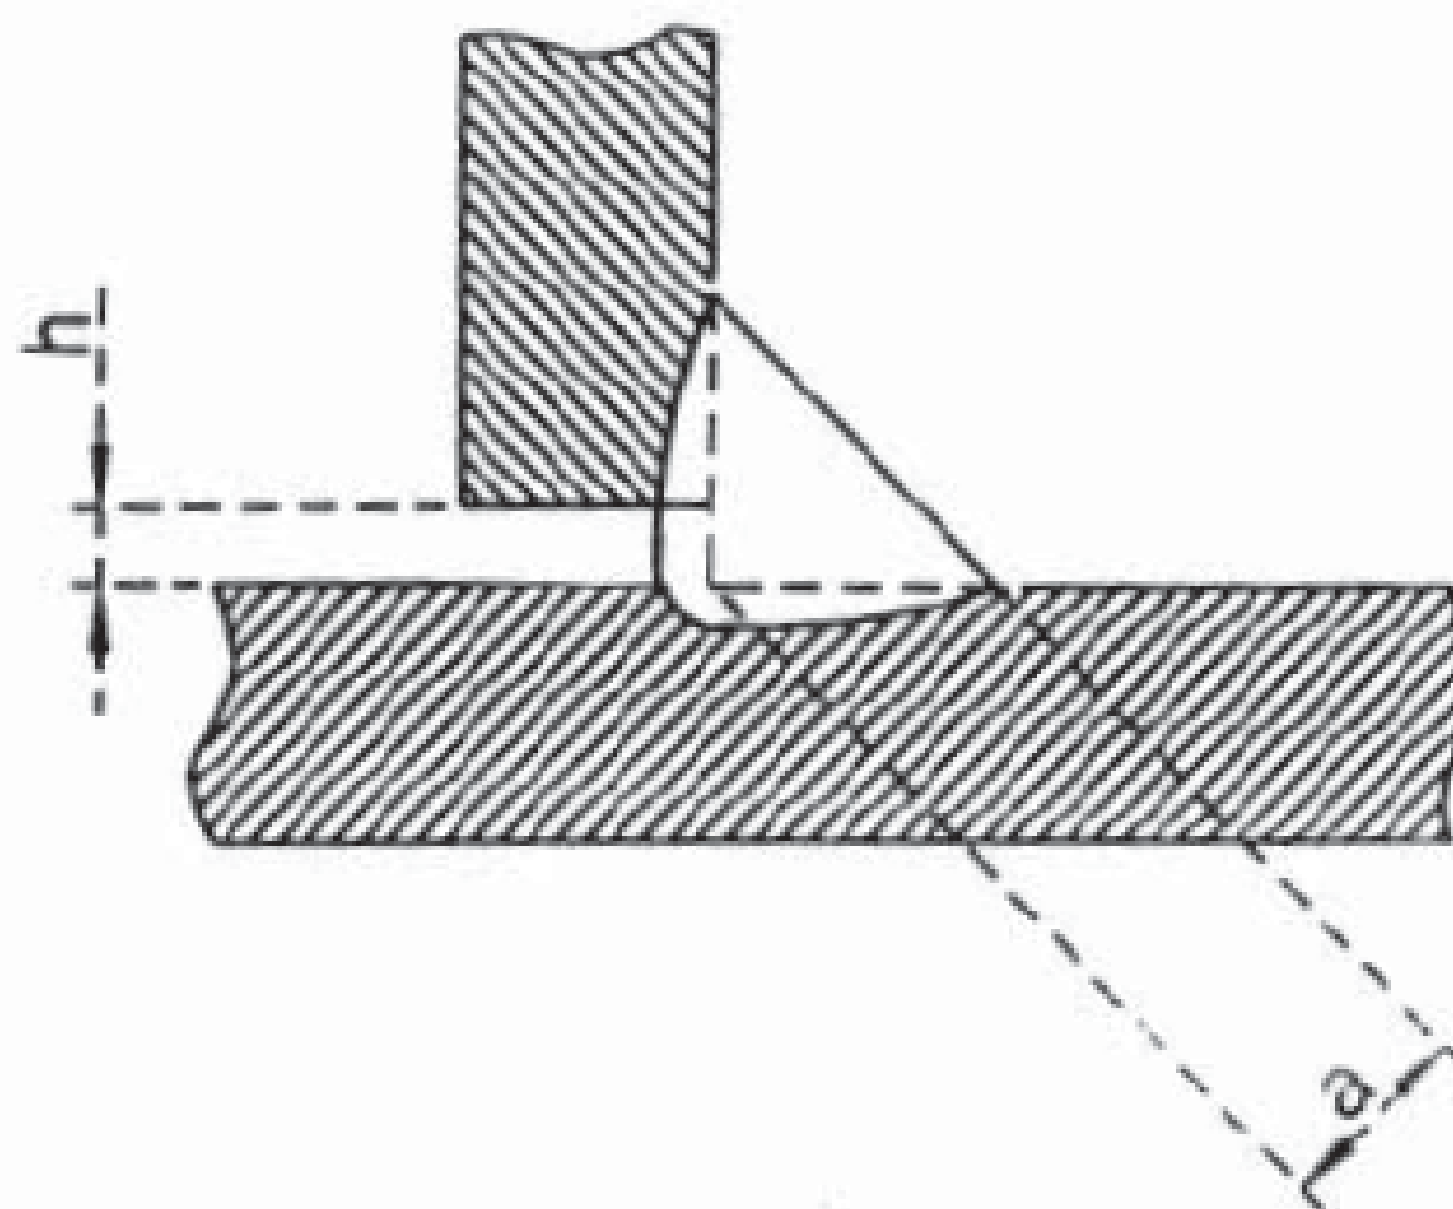
b) Maximum dimension of a single pore for
-butt weld
-fillet weld

$d \leq 0.5 s$
 $d \leq 0.5 a$

c) Maximum dimension for localised clustered porosity.

4mm

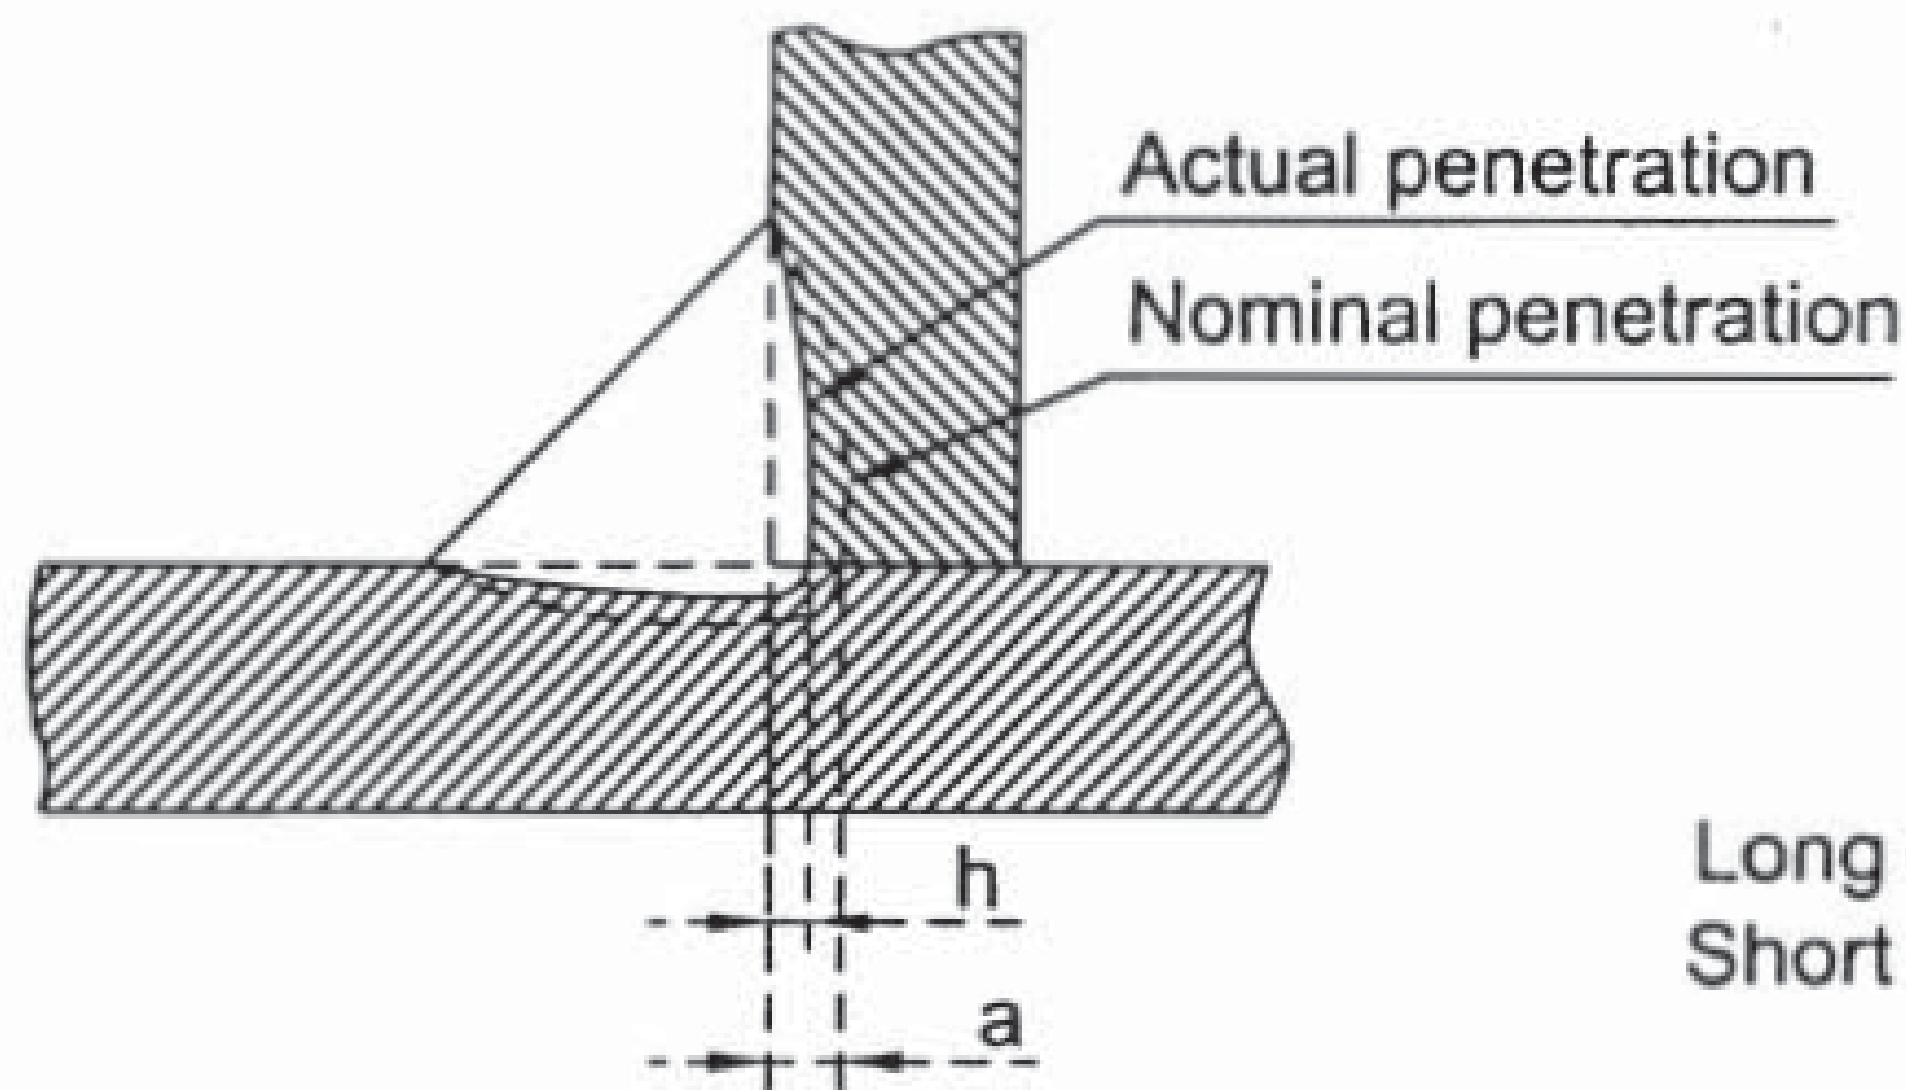
WELDING DETAILS

Sl No	Imperfection Designation	Outside status	Limits for Imperfection with reference to quality level: DIN EN 25817 / D
7.	Elongated cavities, worm holes	Long imperfections for -butt welds -fillet welds In any case, maximum dimension for elongated cavities, worm holes	$h \leq 0.5 s$ $h \leq 0.5 a$ 2mm
		Short imperfections for -butt welds -fillet welds In any case, maximum dimension for elongated cavities, worm holes	$h \leq 0.5 s$ $h \leq 0.5 a$ 4mm or Not Larger Than Thickness (NLTT)
8.	Solid inclusions (other than copper)	Long imperfections for -butt welds -fillet welds In any case, maximum dimension for elongated cavities, worm holes	$h \leq 0.5 s$ $h \leq 0.5 a$ 2mm
		Short imperfections for -butt welds -fillet welds In any case, maximum dimension for elongated cavities, worm holes	$h \leq 0.5 s$ $h \leq 0.5 a$ 4mm or Not Larger Than Thickness (NLTT)
9.	Lack of fusion (Incomplete fusion)		Permitted, but only intermittently and not breaking the surfaces
10.	Bad fit-up, fillet weld		
		An excessive or insufficient gap between the parts to be joined. Gaps exceeding the appropriate limit may in cases be compensated for by a corresponding increase in the throat.	$h \leq 1\text{mm} + 0.3 a$ max. 4mm

SI
No Imperfection
Designation

Outside status

11. Incomplete penetration



Long imperfections: Not permitted

Short imperfections: $h \leq 0.2 s$,
max. 2mm

12. Cracks

All types of cracks

Not Permitted

13. Crater cracks

Permitted

14. Spatters

Fused welding splashes are material trickless
(drops) fused to the basic material or welding
seam.

Permissible

15. Stray flash or
arc strike

Ignition points are local fuses caused by the
electric arc on the surface of the basic material
or welding seam.

Permissible

Abbreviations

- a nominal fillet weld throat thickness (fillet thickness), in mm
- b width of weld reinforcement, in mm
- d pore diameter in mm
- h size (height or width) of imperfection, in mm
- l length of imperfection, in mm
- s nominal butt weld thickness or, in the case of partial penetration, the prescribed depth of penetration, in mm
- t tube-wall- or plate thickness, in mm
- z leg length of fillet welds (in case of isoscele-right angle triangular section $z = a \cdot \sqrt{2} / 2$) in mm



TITLE :
TECHNICAL SPECIFICATION FOR
VIS FOR TD (4 NOS) & MD (2 NOS.) BFP
FOUNDATION

SPECIFICATION NO. PE-TS-425-614-C001

SECTION II

REV. NO. 0

DATE 10.10. 2017

ANNEXURE-2

CORROSION PROTECTION PAINTING

1. Painting requirement for MS plate except springs & stud & nuts

All steel parts must be coated immediately after shot blast cleaning to near white metal surface (Sa 2- 1/2) according to EN-ISO 12944-4 / SIS05-5900. Surface must be free of fat.

a. Material, Execution & colour:

- i. Prime coat of minimum 25 microns (DFT) of applying epoxy based zinc phosphate primer
- ii. Intermediate coating of epoxy based Titanium dioxide (TiO₂) or micaceous iron oxide (MIO) of minimum 75micron DFT.
- iii. two coats of epoxy based colour finish paint with minimum 70 micron total dry film thickness (DFT) of approved make and shade to achieve an even shade including further finishing with top coat of UV resistant (minimum 30 micron DFT) polyurethane of approved shade.

RAL 6011 Green or equivalent
RAL 1000 Black or equivalent
RAL 1004 Yellow colour or equivalent

b. Coating:

Coating is performed with spray gun. Baking temperature 80 °C. furnace exposing time 45 minutes.

c. Coating thickness control:

Measurements to be taken at 5 random points. Acceptable thickness is 10% below specified thickness.

2. Painting requirement for Springs

All the springs must be powder coated by "Electrostatic powder coating spray process" (EPS).

a. Preparation:

Springs must be oil free

b. Execution:

Electrostatic spray coating with an epoxy polyester powder. Baking temperature 190 °C +10 °C. furnace exposing time of 40 minutes.

Colour: Black.

c. Coating thickness:

Coating thickness must be minimum of 70 microns.

Note.

1. The colour of paint is subjected to as per customer requirement.