

**TECHNICAL SPECIFICATION
FOR
RATE CONTRACT
OF
PLATE HEAT EXCHANGERS**

Specification No. : PE-RC-999-179-N001 (REV 0)



**BHARAT HEAVY ELECTRICALS LIMITED
POWER SECTOR
PROJECT ENGINEERING MANAGEMENT
NOIDA-201301**



TITLE :
**TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS**

SPECIFICATION NO. PE-RC-999-179-N001

SECTION

REV. NO. 0

DATE 17/4/18

CONTENTS

This Technical Specification consists of three Sections:

SECTION TITLE

SECTION I SPECIFIC TECHNICAL REQUIREMENTS

IA SPECIFIC TECHNICAL REQUIREMENTS.

IB DATA SHEET – A.

SECTION II STANDARD TECHNICAL REQUIREMENTS

IIA STANDARD TECHNICAL SPECIFICATION.

IIB STANDARD QUALITY PLAN.

SECTION III DOCUMENTS TO BE SUBMITTED BY BIDDER

IIIA COMPLIANCE CERTIFICATE (TO BE SUBMITTED BY BIDDER DURING TENDER STAGE).

IIIB GUARANTEE SCHEDULE (TO BE SUBMITTED BY BIDDER DURING TENDER STAGE).

IIIC DATASHEET –B & BALANCE DOCUMENTS AS PER CL. NO. 8 OF SECTION- IA (TO BE SUBMITTED BY SUCCESSFUL BIDDER AFTER AWARD OF CONTRACT).



TITLE :
TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N001

SECTION I

REV. NO. 0

DATE 17/4/18

SECTION I

IA SPECIFIC TECHNICAL REQUIREMENTS

IB DATASHEET – A



TITLE :
TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N001

SECTION IA

REV. NO. 0 DATE 17/4/18

SHEET 1 OF 2

1.0 GENERAL :

- 1.1 This specification is intended for finalization of rate contract between BHEL PEM and Bidder. Standard technical detail as indicated in the specification shall be agreed upon between BHEL PEM and Bidder. Project specific technical detail shall be made available to the bidder during the specific project ordering.
- 1.2 This enquiry covers the design, manufacture, assembly, inspection and testing at manufacturer's and/ or his sub-contractors works, painting, proper packing & delivery of the item namely PLATE HEAT EXCHANGERS complete with all spares (as applicable), accessories, commissioning spares (if any), counter flanges with nuts, bolts, gaskets and coatings (wherever necessary), including special tools & tackles (if any), including site PG test (as applicable) as mentioned in this specification.

Note:

1. This specification is being made with the intent of entering into rate contract for the supply of Plate Heat Exchangers (PHEs) of various type applicable for the various projects from time to time.
2. Type of PHEs have been bifurcated in to two groups viz. Group-A and Group-B, same has been detailed in Data Sheet-A, Section-1B. The bidder shall include complete supplies for a Group (A/B) in his scope. Part supplies offered for a Group (A/B) shall disqualify the bidder's offer for that Group (A/B). Evaluation shall be separate for each group and further details shall be indicated in NIT.

The Plate heat Exchangers complete with all accessories including special tools and tackles (if any) shall conform to the Data Sheet-A (Section IB) and other requirements of section IIA. In addition, the requirements of this Section IA including Customer Specification attached at Appendix 1 (as applicable) shall also be complied with.

**In the event of Contradictions between Section IA /Customer Specification (Appendix 1)/ Datasheet A (Section IB), the same shall prevail in the order as:
Customer Specification (Appendix 1), Section IA, Datasheet-A (Section IB).**

- 1.3 The bids shall be evaluated as per NIT. Ordering shall be done separately as per NIT.
- 1.4 Bidder to quote for items as per price schedule attached in NIT. The quantity as mentioned in the BOQ is only for evaluation purpose. However actual ordered quantity may vary from project to project throughout the year.

2.0 SPECIFIC REQUIREMENTS:

- 2.1 Project specific requirements for Flow &/ or Temp rise for PHE at primary side as well secondary side may vary slightly vis-à-vis those indicated in Datasheet A at section IB. However Flow variation shall be within +/- 20 % for primary side as well secondary side &/or Temp rise shall be within +/- 20 % for primary side as well as secondary side but Heat Load of PHE (Flow x Temp Rise) shall be within +/- 10 % vis-à-vis Flow x Temp Rise as per Datasheet A at section IB. Exact Parameters for specific project shall be



TITLE :
TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N001

SECTION IA

REV. NO. 0 **DATE 17/4/18**

SHEET 2 OF 2

informed during project specific order Bidder to meet the above requirement during project specific ordering, without any cost implication to BHEL.

2.2 PG test at site (if applicable) as per Project specific requirement shall have to be conducted as per clause 8.02.00 of Section-IIA. Bidder to quote Unit Rate for PG test accordingly.

3.0 Document submission schedule after the award of contract shall be as below:

PACKAGE	BHEL DRG NO	DRG TITLE	Drg Submission schedule
PLATE HEAT EXCHANGERS (PHE)	Primary Documents -		
	PE-V5-XXX-179-N001	Technical Data sheet of PHE	R-0 within 20 days from LOI/PO & subsequent revisions within 10 days of comments received from BHEL.
	PE-V5-XXX-179-N002	GA drawing of PHE	
	PE-V5-XXX-179-N003	Thermal sizing calculation of PHE	
	PE-V5-XXX-179-N005	QAP of PHE	
	Secondary Documents -		
	PE-V5-XXX-179-N004	Performance curves of PHE	R-0 within 20 days of Cat-I(or)II approval on TDS
	PE-V5-XXX-179-N006	O&M MANUAL for PHE	Within 30 days from MDCC
	PE-V5-XXX-179-N007	PG TEST PROCEDURE -PHE (If Applicable)	R-0 within 20 days of Cat-I(or)II approval on PHE document.



	TECHNICAL SPECIFICATION FOR RATE CONTRACT OF PLATE HEAT EXCHANGER			Technical specification no	PE-RC-999-179-N001 (Rev 0)
	DATASHEET - A			Section	IB
	FOR CLARIFIED WATER APPLICATION			Rev	0
				Date	16/04/2018
				GROUP-A	GROUP-A
	PHE DESCRIPTION			TYPE I	TYPE II
1.0	General				
1.1	Number of Plate Heat Exchanger		Nos	Nine (9) nos	Six (6) nos
1.2	Arrangement			3X50% configuration per unit	2X100% configuration per unit
1.3	Location			Indoor	Indoor
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid			Clarified water (Refer enclosed water analysis)	Clarified water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	600	350
		(Secondary Side)	NB	600	350
1.7	Maximum permitted Length of the PHE		mm	5000 mm (excluding reducer)	5000 mm (excluding reducer)
2.0	Design				
2.1	Design Code			Latest IS/BS/DIN/ASTM Standards	Latest IS/BS/DIN/ASTM Standards
2.2	Design Pressure		Kg/cm ² (g)	10	12
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)	8.0 to 9.0 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)	2.0 to 2.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.		°C	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	6500 (Max.)	6500 (Max.)
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1	1
		(Secondary Side)	Cal/gmDeg.C	1	1
2.7	Density of Fluid	(Primary Side)	gm/cc	1	1
		(Secondary Side)	gm/cc	1	1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:				
3.1	Flow rate	(DMCW Side)	M ³ /hr	2000	640
		(ACW Side)	M ³ /hr	2000	640
3.2	Inlet temperature	(DMCW Side)	°C	46.5	44.3
		(ACW Side)	°C	36	36
3.3	Outlet temp	(DMCW Side)	°C	38	38
		(ACW Side)	°C	44.5	42.3
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	7	7
		(ACW Side)	MWC	7	7
* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.					

	TECHNICAL SPECIFICATION FOR RATE CONTRACT OF PLATE HEAT EXCHANGER		Technical specification no	PE-RC-999-179-N001 (Rev 0)
			Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE I	TYPE II
4.0	Additional HT plates on Design Plates	%	NIL	NIL
5.0	Heat Transfer Coefficient/Margin			
5.1	Overall fouling resistance (minimun)	Hr m2deg C/Kcal	0.00008	0.00008
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts,nozzles,sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	SS-316
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding	Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding
6.5	Support Beam/ column		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)
6.13	Wetted fasteners		SS-316	SS-316
6.14	Painting			
	External Surface			
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.	For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.
	c.) Final Paint			

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE I	TYPE II
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25
8.0	Spares	Unit of Measurement		
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	20 LOTS	20 LOTS
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	1 LOT	30 LOTS
8.3	Valves	NOS.	1	1
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	1 LOT	10 LOTS
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	1 LOT	10 LOTS
9.0	Hydrotesting at Shop			
9.1	Hydrotesting Pressure	Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	60	60
10.0	Performance curves and figures to be furnished during contact stage			
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.			
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)			
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)			
10.4	Primary side water outlet temperature vs. Primary side inlet temp.			
10.5	Film heat transfer coefficient curve			
10.6	Correction Curves.			
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.			
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)			
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.			
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.			
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.			
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.			
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.			
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.			

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
		GROUP-A		GROUP-A
	PHE DESCRIPTION		TYPE III	TYPE IV
1.0	General			
1.1	Number of Plate Heat Exchanger	Nos	Three (15) nos	Ten (10) nos
1.2	Arrangement		3X50% configuration per unit	2X100% configuration per unit
1.3	Location		Indoor	Indoor
1.4	Primary side (Hot) Fluid		Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid		Clarified water (Refer enclosed water analysis)	Clarified water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	500
		(Secondary Side)	NB	500
1.7	Maximum permitted Length of the PHE	mm	5000 mm (excluding reducer)	5000 mm (excluding reducer)
2.0	Design			
2.1	Design Code		Latest IS/BS/DIN/ASTM Standards	Latest IS/BS/DIN/ASTM Standards
2.2	Design Pressure	Kg/cm ² (g)	10	12
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.	°C	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate	Kcal/Hr./m ²	To be decided by bidder	To be decided by bidder
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1
		(Secondary Side)	Cal/gmDeg.C	1
2.7	Density of Fluid	(Primary Side)	gm/cc	1
		(Secondary Side)	gm/cc	1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:			
3.1	Flow rate	(DMCW Side)	M ³ /hr	1375
		(ACW Side)	M ³ /hr	541
3.2	Inlet temperature	(DMCW Side)	°C	47
		(ACW Side)	°C	44.6
3.3	Outlet temp	(DMCW Side)	°C	36
		(ACW Side)	°C	38
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	8
		(ACW Side)	MWC	8
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.			
4.0	Additional HT plates on Design Plates	%	NIL	NIL
5.0	Heat Transfer Coefficient/Margin			
5.1	Overall fouling resistance (minimun)	Hr m2deg C/Kcal	0.00008	0.00008

				
TECHNICAL SPECIFICATION FOR RATE			Technical specification no	PE-RC-999-179-N001 (Rev 0)
CONTRACT OF PLATE HEAT EXCHANGER			Section	IB
DATASHEET - A			Rev	0
FOR CLARIFIED WATER APPLICATION			Date	16/04/2018
			GROUP-A	GROUP-A
PHE DESCRIPTION			TYPE III	TYPE IV
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	SS-316
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, ASTM A-283 Grade C, Epoxy painted	Carbon Steel, ASTM A-283 Grade C, Epoxy painted
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding	Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding
6.5	Support Beam/ column		Carbon Steel, ASTM A-283 Grade C, Epoxy painted	Carbon Steel, ASTM A-283 Grade C, Epoxy painted
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolts / nuts		SS-316	SS-316
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)
6.13	Wetted fasteners		SS-316	SS-316
6.14	Painting			
	External Surface			
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.	For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.
	c.) Final Paint			
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25
8.0	Spares	Unit of Measurement		
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	30 LOTS	20 LOTS

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE III	TYPE IV
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	1 LOT	1 LOT
8.3	Valves	NOS.	2	2
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	1 LOT	1 LOT
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	1 LOT	1 LOT
9.0	Hydrotesting at Shop			
9.1	Hydrotesting Pressure	Kg/cm ² (g)	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	60	60
10.0	Performance curves and figures to be furnished during contact stage			
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.			
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)			
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)			
10.4	Primary side water outlet temperature vs. Primary side inlet temp.			
10.5	Film heat transfer coefficient curve			
10.6	Correction Curves.			
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.			
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)			
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.			
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.			
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.			
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.			
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.			
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.			

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE V	TYPE VI
1.0	General			
1.1	Number of Plate Heat Exchanger	Nos	Three (3) nos	Four (4) nos
1.2	Arrangement		3X50% configuration	2X100% configuration
1.3	Location		Indoor	Indoor
1.4	Primary side (Hot) Fluid		Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid		Clarified water (Refer enclosed water analysis)	Clarified water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	700
		(Secondary Side)	NB	700
1.7	Maximum permitted Length of the PHE	mm	5000 mm (excluding reducer)	5000 mm (excluding reducer)
2.0	Design			
2.1	Design Code		Latest IS/BS/DIN/ASTM Standards	Latest IS/BS/DIN/ASTM Standards
2.2	Design Pressure		Kg/cm ² (g)	10.5
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.		°C	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	To be decided by bidder
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1
		(Secondary Side)	Cal/gmDeg.C	1
2.7	Density of Fluid	(Primary Side)	gm/cc	1
		(Secondary Side)	gm/cc	1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:			
3.1	Flow rate	(DMCW Side)	M ³ /hr	2815
		(ACW Side)	M ³ /hr	2815
3.2	Inlet temperature	(DMCW Side)	°C	43.5
		(ACW Side)	°C	36
3.3	Outlet temp	(DMCW Side)	°C	38
		(ACW Side)	°C	41.5
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at 1.1 times of design flow	(DMCW Side)	MWC	8
		(ACW Side)	MWC	8
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.			
4.0	Additional HT plates on Design Plates	%	5%	5%
5.0	Heat Transfer Coefficient/Margin			
5.1	Overall fouling resistance (minimum)	Hr m2deg C/Kcal	0.00008	0.00008

				
TECHNICAL SPECIFICATION FOR RATE CONTRACT OF PLATE HEAT EXCHANGER			Technical specification no	PE-RC-999-179-N001 (Rev 0)
DATASHEET - A			Section	IB
FOR CLARIFIED WATER APPLICATION			Rev	0
			Date	16/04/2018
			GROUP-A	GROUP-A
PHE DESCRIPTION			TYPE V	TYPE VI
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	SS-316
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 % shore hardness	Nitrile rubber, 65 ± 5 % shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding	Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding
6.5	Support Beam/ column		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)
6.13	Wetted fasteners		SS-316	SS-316
6.14	Painting			
	External Surface			
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.	For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.
	c.) Final Paint			
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25
8.0	Spares	Unit of Measurement		
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	30 LOTS	40 LOTS

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE V	TYPE VI
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	90 LOTS	260 LOTS
8.3	Valves	NOS.	1	1
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	30 LOTS	20 LOTS
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	30 LOT	120 LOT
9.0	Hydrotesting at Shop			
9.1	Hydrotesting Pressure	Kg/cm ² (g)	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	60	60
10.0	Performance curves and figures to be furnished during contact stage			
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.			
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)			
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)			
10.4	Primary side water outlet temperature vs. Primary side inlet temp.			
10.5	Film heat transfer coefficient curve			
10.6	Correction Curves.			
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.			
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)			
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.			
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.			
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.			
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.			
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.			
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.			

							
	TECHNICAL SPECIFICATION FOR RATE CONTRACT OF PLATE HEAT EXCHANGER			Technical specification no		PE-RC-999-179-N001 (Rev 0)	
				Section		IB	
	DATASHEET - A			Rev		0	
	FOR CLARIFIED WATER APPLICATION			Date		16/04/2018	
				GROUP-A		GROUP-A	
	PHE DESCRIPTION			TYPE VII		TYPE VIII	
1.0	General						
1.1	Number of Plate Heat Exchanger		Nos	Three (3) nos		Two (2) nos	
1.2	Arrangement			3X50% configuration		2X100% configuration	
1.3	Location			Indoor		Indoor	
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)		Passivated DM water (Refer enclosed water analysis)	
1.5	Secondary side (Cold) fluid			Clarified water (Refer enclosed water analysis)		Clarified water (Refer enclosed water analysis)	
1.6	Connecting Pipe size	(Primary Side)	NB	500		300	
		(Secondary Side)	NB	450		300	
1.7	Maximum permitted Length of the PHE		mm	5000 mm (excluding reducer)		5000 mm (excluding reducer)	
2.0	Design						
2.1	Design Code			Latest IS/BS/DIN/ASTM Standards		Latest IS/BS/DIN/ASTM Standards	
2.2	Design Pressure		Kg/cm ² (g)	10		12	
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)		8.0 to 9.0 Kg/sq. cm(g)	
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)		2.0 to 2.5 Kg/sq. cm(g)	
2.4	Mechanical Design Temp.		°C	60		60	
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	To be decided by bidder		To be decided by bidder	
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1		1	
		(Secondary Side)	Cal/gmDeg.C	1		1	
2.7	Density of Fluid	(Primary Side)	gm/cc	1		1	
		(Secondary Side)	gm/cc	1		1	
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:						
3.1	Flow rate	(DMCW Side)	M ³ /hr	1175		500	
		(ACW Side)	M ³ /hr	1175		500	
3.2	Inlet temperature	(DMCW Side)	°C	46.6		44.4	
		(ACW Side)	°C	36		36	
3.3	Outlet temp	(DMCW Side)	°C	38		38	
		(ACW Side)	°C	44.6		42.4	
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	8		8	
		(ACW Side)	MWC	8		8	
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.						
4.0	Additional HT plates on Design Plates		%	5%		5%	
5.0	Heat Transfer Coefficient/Margin						
5.1	Overall fouling resistance (minimun)		Hr m2deg C/Kcal	0.00008		0.00008	

				
TECHNICAL SPECIFICATION FOR RATE			Technical specification no	PE-RC-999-179-N001 (Rev 0)
CONTRACT OF PLATE HEAT EXCHANGER			Section	IB
DATASHEET - A			Rev	0
FOR CLARIFIED WATER APPLICATION			Date	16/04/2018
			GROUP-A	GROUP-A
PHE DESCRIPTION			TYPE VII	TYPE VIII
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	SS-316
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 % shore hardness	Nitrile rubber, 65 ± 5 % shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, ASTM A-283 Gr.C, Epoxy painted	Carbon Steel, ASTM A-283 Gr.C, Epoxy painted
6.4	Guide Rails/ bar		Carbon Steel, ASTM A-283 Gr.C, Epoxy painted	Carbon Steel, ASTM A-283 Gr.C, Epoxy painted
6.5	Support Beam/ column		Carbon Steel, ASTM A-283 Gr.C, Epoxy painted	Carbon Steel, ASTM A-283 Gr.C, Epoxy painted
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.9	Tightening Bolts/Rods & Nuts		SAE 1045 EPOXY COATED	SAE 1045 EPOXY COATED
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)
6.13	Wetted fasteners		SS-316	SS-316
6.14	Painting			
	External Surface			
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.	For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.
	c.) Final Paint			
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25
8.0	Spares	Unit of Measurement		
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	30 LOTS	20 LOTS

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE VII	TYPE VIII
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	200 LOT	200 LOTS
8.3	Valves	NOS.	1	1
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	1 LOT	1 LOT
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	100 LOT	100 LOT
9.0	Hydrotesting at Shop			
9.1	Hydrotesting Pressure	Kg/cm ² (g)	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	60	60
10.0	Performance curves and figures to be furnished during contact stage			
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.			
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)			
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)			
10.4	Primary side water outlet temperature vs. Primary side inlet temp.			
10.5	Film heat transfer coefficient curve			
10.6	Correction Curves.			
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.			
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)			
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.			
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.			
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.			
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.			
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.			
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.			

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE IX	TYPE X
1.0	General			
1.1	Number of Plate Heat Exchanger	Nos	Three (3) nos	Two (2) nos
1.2	Arrangement		3X50% configuration	2X100% configuration
1.3	Location		Indoor	Indoor
1.4	Primary side (Hot) Fluid		Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid		Clarified water (Refer enclosed water analysis)	Clarified water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	600
		(Secondary Side)	NB	600
1.7	Maximum permitted Length of the PHE	mm	5000 mm (excluding reducer)	5000 mm (excluding reducer)
2.0	Design			
2.1	Design Code		Latest IS/BS/DIN/ASTM Standards	Latest IS/BS/DIN/ASTM Standards
2.2	Design Pressure	Kg/cm ² (g)	10.5	12.6
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.	°C	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate	Kcal/Hr./m ²	To be decided by bidder	To be decided by bidder
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1
		(Secondary Side)	Cal/gmDeg.C	1
2.7	Density of Fluid	(Primary Side)	gm/cc	1
		(Secondary Side)	gm/cc	1
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:			
3.1	Flow rate	(DMCW Side)	M ³ /hr	1610
		(ACW Side)	M ³ /hr	1610
3.2	Inlet temperature	(DMCW Side)	°C	47.61
		(ACW Side)	°C	36
3.3	Outlet temp	(DMCW Side)	°C	38
		(ACW Side)	°C	45.61
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at 1.1 times of design flow	(DMCW Side)	MWC	8
		(ACW Side)	MWC	8
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.			
4.0	Additional HT plates on Design Plates	%	5%	5%
5.0	Heat Transfer Coefficient/Margin			
5.1	Overall fouling resistance (minimum)	Hr m2deg C/Kcal	0.00008	0.00008

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE IX	TYPE X
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	SS-316
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 % shore hardness	Nitrile rubber, 65 ± 5 % shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding	Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding
6.5	Support Beam/ column		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	Carbon steel IS 2062, Gr. B, Epoxy Coated
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	SA 193 B7/ SA 194 2H
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	AISI 316 18'-8' SS (3 mm thick)
6.13	Wetted fasteners		SS-316	SS-316
6.14	Painting			
	External Surface			
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.	For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.
	c.) Final Paint			
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	25
8.0	Spares	Unit of Measurement		
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	30 LOTS	20 LOTS

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	GROUP-A
	PHE DESCRIPTION		TYPE IX	TYPE X
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	90 LOTS	60 LOTS
8.3	Valves	NOS.	1	1
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	30 LOTS	20 LOTS
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	30 LOT	20 LOT
9.0	Hydrotesting at Shop			
9.1	Hydrotesting Pressure	Kg/cm ² (g)	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	60	60
10.0	Performance curves and figures to be furnished during contact stage			
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.			
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)			
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)			
10.4	Primary side water outlet temperature vs. Primary side inlet temp.			
10.5	Film heat transfer coefficient curve			
10.6	Correction Curves.			
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.			
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)			
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.			
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.			
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.			
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.			
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.			
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.			

	TECHNICAL SPECIFICATION FOR RATE CONTRACT OF PLATE HEAT EXCHANGER			Technical specification no	PE-RC-999-179-N001 (Rev 0)
				Section	IB
	DATASHEET - A			Rev	0
	FOR CLARIFIED WATER APPLICATION			Date	16/04/2018
				GROUP-A	
	PHE DESCRIPTION			TYPE XI	
1.0	General				
1.1	Number of Plate Heat Exchanger		Nos	Three (3) nos	
1.2	Arrangement			3X50% configuration	
1.3	Location			Indoor	
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)	
1.5	Secondary side (Cold) fluid			Clarified water (Refer enclosed water analysis)	
1.6	Connecting Pipe size	(Primary Side)	NB	600	
		(Secondary Side)	NB	600	
1.7	Maximum permitted Length of the PHE		mm	5000 mm (excluding reducer)	
2.0	Design				
2.1	Design Code			Latest IS/BS/DIN/ASTM Standards	
2.2	Design Pressure		Kg/cm ² (g)	10	
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)	
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)	
2.4	Mechanical Design Temp.		°C	60	
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	To be decided by bidder	
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1	
		(Secondary Side)	Cal/gmDeg.C	1	
2.7	Density of Fluid	(Primary Side)	gm/cc	1	
		(Secondary Side)	gm/cc	1	
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:				
3.1	Flow rate	(DMCW Side)	M ³ /hr	1835	
		(ACW Side)	M ³ /hr	1835	
3.2	Inlet temperature	(DMCW Side)	°C	43.5	
		(ACW Side)	°C	36	
3.3	Outlet temp	(DMCW Side)	°C	38	
		(ACW Side)	°C	41.5	
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	8	
		(ACW Side)	MWC	8	
* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.					
4.0	Additional HT plates on Design Plates		%	5%	
5.0	Heat Transfer Coefficient/Margin				
5.1	Overall fouling resistance (minimun)		Hr m2deg C/Kcal	0.00008	

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	
	PHE DESCRIPTION		TYPE XI	
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		SS-316	
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 % shore hardness	
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon Steel, ASTM A-283 Gr.C, Epoxy painted	
6.4	Guide Rails/ bar		Carbon Steel, ASTM A-283 Gr.C, Epoxy painted	
6.5	Support Beam/ column		Carbon Steel, ASTM A-283 Gr.C, Epoxy painted	
6.6	Nozzle (Reducer/Expander)		Carbon steel IS 2062, Gr. B, Epoxy Coated	
6.7	Nozzle flanges		Carbon Steel IS 2062 (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	
6.8	Flange/ Counter flanges		Carbon Steel as per IS 2062 Gr. B (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated	
6.9	Tightening Bolts/Rods & Nuts		SAE 1045 EPOXY COATED	
6.10	Nozzle flange bolts / nuts		SA 193 B7/ SA 194 2H	
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	
6.12	Name Plate		AISI 316 18'-8' SS (3 mm thick)	
6.13	Wetted fasteners		SS-316	
6.14	Painting			
	External Surface			
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval. For all the steel surfaces, a coat of epoxy resin based zinc phosphate primer of min thickness of 50 microns followed up with undercoat of epoxy resin based paint pigmented with Titanium dioxide with min thickness of 50 microns shall be applied. The top coat shall consist of two coats each of min 50 microns thickness of epoxy paint. Thus total thickness shall be minimum 200 microns.	
	b.) Primer			
	c.) Final Paint			
7.0	Extra Carrying capacity to be provided on frame assembly.	%	25	
8.0	Spares	Unit of Measurement		
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	30 LOTS	

				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR CLARIFIED WATER APPLICATION		Date	16/04/2018
			GROUP-A	
	PHE DESCRIPTION		TYPE XI	
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	200 LOT	
8.3	Valves	NOS.	1	
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	1 LOT	
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	100 LOT	
9.0	Hydrotesting at Shop			
9.1	Hydrotesting Pressure	Kg/cm ² (g)	1.5 times the design pressure	
9.2	Duration of Hydrotesting	Minutes	60	
10.0	Performance curves and figures to be furnished during contact stage			
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.			
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)			
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)			
10.4	Primary side water outlet temperature vs. Primary side inlet temp.			
10.5	Film heat transfer coefficient curve			
10.6	Correction Curves.			
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.			
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)			
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.			
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.			
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.			
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.			
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.			
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.			

					
	TECHNICAL SPECIFICATION FOR RATE			Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER			Section	IB
	DATASHEET - A			Rev	0
	FOR SEA WATER APPLICATION			Date	16/04/2018
				GROUP-B	GROUP-B
	PHE Description			TYPE XII	TYPE XIII
1.0	General				
1.1	Number of Plate Heat Exchanger	Nos		Total Six (6) nos	Total Four (4) nos
1.2	Arrangement			3 x 50% per unit	2 x 100% per unit
1.3	Location			Indoor	Indoor
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid			Sea Water (Refer enclosed water analysis)	Sea Water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	500	300
		(Secondary Side)	NB	500	300
1.7	Maximum permitted Length of the PHE	mm		Length 5000 mm (excluding reducer)	Length 5000 mm (excluding reducer)
2.0	Design				
2.1	Design Code			Latest IS/BS/DIN/ASTM Standards	Latest IS/BS/DIN/ASTM Standards
2.2	Design Pressure		Kg/cm ² (g)	10	12
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)	8.0 to 9.0 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)	2.0 to 2.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.		°C	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate	Kcal/Hr./m ²		To be decided by bidder	To be decided by bidder
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1	1
		(Secondary Side)	Cal/gmDeg.C	0.94	0.94
2.7	Density of Fluid	(Primary Side)	gm/cc	1	1
		(Secondary Side)	gm/cc	1.03	1.03
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:				
3.1	Flow rate	(DMCW Side)	M ³ /hr	1431	529
		(ACW Side)	M ³ /hr	1478	546
3.2	Inlet temperature	(DMCW Side)	°C	46.2	44.2
		(ACW Side)	°C	36	36
3.3	Outlet temp	(DMCW Side)	°C	38	38
		(ACW Side)	°C	44.2	42.2
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	7	7
		(ACW Side)	MWC	7	7

	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR SEA WATER APPLICATION		Date	16/04/2018
			GROUP-B	GROUP-B
	PHE Description		TYPE XII	TYPE XIII
	* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.			
4.0	Additional HT plates on Design Plates	%	NIL	NIL
5.0	Heat Transfer Coefficient/Margin			
5.1	Overall fouling resistance (minimun)	Hr m2deg C/Kcal	0.00008	0.00008
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts,nozzles,sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		Titanium	Titanium
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon steel to IS-2062 E-410, Gr B Epoxy Coated (Wth Titanium Cladding on Ports on ACW Side)	Carbon steel to IS-2062 E-410, Gr B Epoxy Coated (Wth Titanium Cladding on Ports on ACW Side)
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding (CS to be epoxy painted)	Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding (CS to be epoxy painted)
6.5	Support Beam/ column		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)		DMCW Side: Carbon steel IS 2062, Gr. B, Epoxy Coated ACW Side: BHEL Scope.	DMCW Side: Carbon steel IS 2062, Gr. B, Epoxy Coated ACW Side: BHEL Scope.
6.7	Nozzle flanges		DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.	DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.
6.8	Flange/ Counter flanges		DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.	DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolt and nut		DMCW Side: SA 193 B7/ SA 194 2H ACW Side: SS 316L	DMCW Side: SA 193 B7/ SA 194 2H ACW Side: SS 316L

					
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no		PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section		IB
	DATASHEET - A		Rev		0
	FOR SEA WATER APPLICATION		Date		16/04/2018
			GROUP-B		GROUP-B
	PHE Description		TYPE XII		TYPE XIII
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber		3mm wire inserted Red Rubber
6.12	Name Plate		SS 316L		SS 316L
6.13	Wetted fasteners		Duplex SS		Duplex SS
6.14	Painting				
	External Surface				
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces inside the (indoor installation) building, two coats of epoxy polyimide resin based red oxide-zinc phosphate (primer) of minimum thickness of 30 microns/coat followed up with one coat of epoxy resin based paint with MIO/coal tar based epoxy paint of minimum thickness of 80 microns shall be applied. The top coat shall consist of two coats of epoxy polyamide enamel suitably pigmented of minimum thickness of 30 microns/coat. Thus total thickness shall be minimum 200 microns.		For all the steel surfaces inside the (indoor installation) building, two coats of epoxy polyimide resin based red oxide-zinc phosphate (primer) of minimum thickness of 30 microns/coat followed up with one coat of epoxy resin based paint with MIO/coal tar based epoxy paint of minimum thickness of 80 microns shall be applied. The top coat shall consist of two coats of epoxy polyamide enamel suitably pigmented of minimum thickness of 30 microns/coat. Thus total thickness shall be minimum 200 microns.
	c.) Final Paint				
7.0	Extra Carrying capacity to be provided on frame assembly.		%	25	25
8.0	Spares		Unit of Measurement		
8.1	Heat Transfer Plates		1 Lot = 1% of plates in each PHE	1 LOT	1 LOT
8.2	Gaskets (All types)		1 Lot = 1% of gaskets of each type in each PHE	1 LOT	1 LOT
8.3	Valves		NOS.	1	1
8.4	Tie Rods		1 Lot = 1% of tie-rod of each type in each PHE	1 LOT	1 LOT
8.5	Fasteners (Nuts & bolts etc.)		1 Lot = 1% of Nuts & bolts of each type & size in each PHE	1 LOT	1 LOT
9.0	Hydrotesting at Shop				
9.1	Hydrotesting Pressure		Kg/cm2 (g)	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting		Minutes	60	60
10.0	Performance curves and figures to be furnished during contact stage				
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.				
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)				

			
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no
	CONTRACT OF PLATE HEAT EXCHANGER		Section
			IB
	DATASHEET - A		Rev
			0
	FOR SEA WATER APPLICATION		Date
			16/04/2018
			GROUP-B
			GROUP-B
	PHE Description		TYPE XII
			TYPE XIII
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)		
10.4	Primary side water outlet temperature vs. Primary side inlet temp.		
10.5	Film heat transfer coefficient curve		
10.6	Correction Curves.		
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.		
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)		
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.		
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.		
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.		
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.		
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.		
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.		



	TECHNICAL SPECIFICATION FOR RATE CONTRACT OF PLATE HEAT EXCHANGER			Technical specification no	PE-RC-999-179-N001 (Rev 0)
	DATASHEET - A			Section	IB
	FOR SEA WATER APPLICATION			Rev	0
				Date	16/04/2018
				GROUP-B	GROUP-B
	PHE Description			TYPE XIV	TYPE V
1.0	General				
1.1	Number of Plate Heat Exchanger		Nos	Total Six (6) nos	Total Four (4) nos
1.2	Arrangement			3 x 50% per unit	2 x 100% per unit
1.3	Location			Indoor	Indoor
1.4	Primary side (Hot) Fluid			Passivated DM water (Refer enclosed water analysis)	Passivated DM water (Refer enclosed water analysis)
1.5	Secondary side (Cold) fluid			Sea Water (Refer enclosed water analysis)	Sea Water (Refer enclosed water analysis)
1.6	Connecting Pipe size	(Primary Side)	NB	500	250
		(Secondary Side)	NB	500	250
1.7	Maximum permitted Length of the PHE		mm	Length 5000 mm (excluding reducer)	Length 5000 mm (excluding reducer)
2.0	Design				
2.1	Design Code			Latest IS/BS/DIN/ASTM Standards	Latest IS/BS/DIN/ASTM Standards
2.2	Design Pressure		Kg/cm ² (g)	10	12
2.3	Operating Pressure	(Primary Side)	Kg/cm ² (g)	6.0 to 7.0 Kg/sq. cm(g)	8.0 to 9.0 Kg/sq. cm(g)
		(Secondary Side)	Kg/cm ² (g)	2.0 to 2.5 Kg/sq. cm(g)	2.0 to 2.5 Kg/sq. cm(g)
2.4	Mechanical Design Temp.		°C	60	60
2.5	Heat Transfer per Sq.Mtr. Of Heat Transfer Plate		Kcal/Hr./m ²	To be decided by bidder	To be decided by bidder
2.6	Specific Heat of Fluid	(Primary Side)	Cal/gmDeg.C	1	1
		(Secondary Side)	Cal/gmDeg.C	0.94	0.94
2.7	Density of Fluid	(Primary Side)	gm/cc	1	1
		(Secondary Side)	gm/cc	1.025	1.025
3.0	Guaranteed Performance Requirements for each Heat Exchangers in fouled condition:				
3.1	Flow rate	(DMCW Side)	M ³ /hr	1314	434
		(ACW Side)	M ³ /hr	1500	450
3.2	Inlet temperature	(DMCW Side)	°C	46.8	44.6
		(ACW Side)	°C	36	36
3.3	Outlet temp	(DMCW Side)	°C	38	38
		(ACW Side)	°C	44	42.6
3.4	* Allowable pressure drop across heat exchanger from inlet to outlet in fouled conditions at design flow	(DMCW Side)	MWC	7	7
		(ACW Side)	MWC	7	7
* High pressure drop than the specified figure will not be accepted, no credit shall be, however, given for lower pressure drop in bid evaluation. Pressure drop mentioned shall be calculated against flow mentioned at S. No 3.1. Each heat exchanger shall be capable of passing a flow of at least 1.1 times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.					
4.0	Additional HT plates on Design Plates		%	NIL	NIL



TECHNICAL SPECIFICATION FOR RATE				
CONTRACT OF PLATE HEAT EXCHANGER			Technical specification no	PE-RC-999-179-N001 (Rev 0)
DATASHEET - A			Section	IB
FOR SEA WATER APPLICATION			Rev	0
			Date	16/04/2018
			GROUP-B	GROUP-B
PHE Description			TYPE XIV	TYPE V
5.0	Heat Transfer Coefficient/Margin			
5.1	Overall fouling resistance (minimun)	Hr m2deg C/Kcal	0.00008	0.00008
5.2	Minimum corrosion allowance on heat exchanger parts of carbon steel (e.g. pressure parts, nozzles, sliding channel and frame) (refer note 1)	mm	1.6	1.6
6.0	Material of Construction :			
6.1	Heat Transfer Plates (Minimum acceptable plate thickness 0.6 mm). Refer Note no. 3		Titanium	Titanium
6.2	Plate Gasket		Nitrile rubber, 65 ± 5 Deg. shore hardness	Nitrile rubber, 65 ± 5 Deg. shore hardness
6.3	Compression/Fixed/Frame/Movable Pressure plates		Carbon steel to IS-2062 E-410, Gr B Epoxy Coated (Wth Titanium Cladding on Ports on ACW Side)	Carbon steel to IS-2062 E-410, Gr B Epoxy Coated (Wth Titanium Cladding on Ports on ACW Side)
6.4	Guide Rails/ bar		Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding (CS to be epoxy painted)	Carbon Steel, IS-2062, E-410, Gr.B, with SS Cladding (CS to be epoxy painted)
6.5	Support Beam/ column		Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted	Carbon Steel, IS-2062, E-410, Gr.B, Epoxy painted
6.6	Nozzle (Reducer/Expander)		DMCW Side: Carbon steel IS 2062, Gr. B, Epoxy Coated ACW Side: BHEL Scope.	DMCW Side: Carbon steel IS 2062, Gr. B, Epoxy Coated ACW Side: BHEL Scope.
6.7	Nozzle flanges		DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.	DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.
6.8	Flange/ Counter flanges		DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.	DMCW Side: Carbon Steel, IS-2062, E-410, Gr.BR (Confirming to ANSI B 16.5 class, Min.-150 lb) Epoxy Coated. ACW Side: BHEL scope. However gaskets and connecting nuts/bolts are in bidder's scope.
6.9	Tightening Bolts/Rods & Nuts		IS-1367 Gr.8.8 or equivalent	IS-1367 Gr.8.8 or equivalent
6.10	Nozzle flange bolt and nut		DMCW Side: SA 193 B7/ SA 194 2H ACW Side: SS 316L	DMCW Side: SA 193 B7/ SA 194 2H ACW Side: SS 316L
6.11	Nozzle flange gasket		3mm wire inserted Red Rubber	3mm wire inserted Red Rubber
6.12	Name Plate		SS 316L	SS 316L
6.13	Wetted fasteners		Duplex SS	Duplex SS
6.14	Painting			
	External Surface			



TECHNICAL SPECIFICATION FOR RATE				
CONTRACT OF PLATE HEAT EXCHANGER			Technical specification no	PE-RC-999-179-N001 (Rev 0)
DATASHEET - A			Section	IB
FOR SEA WATER APPLICATION			Rev	0
			Date	16/04/2018
			GROUP-B	GROUP-B
PHE Description			TYPE XIV	TYPE V
	a.) Surface Preparation		All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.	All surface other than stainless steels shall be painted. The steel surface to be applied with painting shall be thoroughly cleaned before applying painting by shotblasting (SA 2.5) etc shall be subjected to BHEL/Customer approval.
	b.) Primer		For all the steel surfaces inside the (indoor installation) building, two coats of epoxy polyimide resin based red oxide-zinc phosphate (primer) of minimum thickness of 30 microns/coat followed up with one coat of epoxy resin based paint with MIO/coal tar based epoxy paint of minimum thickness of 80 microns shall be applied. The top coat shall consist of two coats of epoxy polyamide enamel suitably pigmented of minimum thickness of 30 microns/coat. Thus total thickness shall be minimum 200 microns.	For all the steel surfaces inside the (indoor installation) building, two coats of epoxy polyimide resin based red oxide-zinc phosphate (primer) of minimum thickness of 30 microns/coat followed up with one coat of epoxy resin based paint with MIO/coal tar based epoxy paint of minimum thickness of 80 microns shall be applied. The top coat shall consist of two coats of epoxy polyamide enamel suitably pigmented of minimum thickness of 30 microns/coat. Thus total thickness shall be minimum 200 microns.
	c.) Final Paint			
7.0	Extra Carrying capacity to be provided on frame assembly.	%	10	10
8.0	Spares	Unit of Measurement		
8.1	Heat Transfer Plates	1 Lot = 1% of plates in each PHE	1 LOT	1 LOT
8.2	Gaskets (All types)	1 Lot = 1% of gaskets of each type in each PHE	1 LOT	1 LOT
8.3	Valves	NOS.	1	1
8.4	Tie Rods	1 Lot = 1% of tie-rod of each type in each PHE	1 LOT	1 LOT
8.5	Fasteners (Nuts & bolts etc.)	1 Lot = 1% of Nuts & bolts of each type & size in each PHE	1 LOT	1 LOT
9.0	Hydrotesting at Shop			
9.1	Hydrotesting Pressure	Kg/cm ² (g)	1.5 times the design pressure	1.5 times the design pressure
9.2	Duration of Hydrotesting	Minutes	60	60
10.0	Performance curves and figures to be furnished during contact stage			
10.1	Primary side water outlet temperature vs. Secondary side water inlet temperature.			
10.2	Primary side water flow (80% to 115%) vs. Pressure drop and outlet temperature (Secondary side flow – 100%)			
10.3	Secondary side water flow (80% to 115%) vs. Secondary side pressure drop and primary side outlet temp (Primary side flow – 100%)			
10.4	Primary side water outlet temperature vs. Primary side inlet temp.			
10.5	Film heat transfer coefficient curve			
10.6	Correction Curves.			
11.0	Minimum Standard requirement of the PHE to be offered by the bidder.			
11.1	Minimum Corrosion allowance on thickness (as per ASME Sec. VIII Div. I)			
11.2	Metallurgy specified above is bare minimum . Equivalent or Superior materials suitable for fluid handled is also acceptable subject to Customer/BHEL approval.			



				
	TECHNICAL SPECIFICATION FOR RATE		Technical specification no	PE-RC-999-179-N001 (Rev 0)
	CONTRACT OF PLATE HEAT EXCHANGER		Section	IB
	DATASHEET - A		Rev	0
	FOR SEA WATER APPLICATION		Date	16/04/2018
			GROUP-B	GROUP-B
	PHE Description		TYPE XIV	TYPE V
11.3	Plate thickness should be adequate to withstand all operating conditions but with Minimum plate thickness of 0.6 mm (No negative tolerance allowed in thickness specified). The plates shall be pressed from one single piece with the corrugation being smooth, uniform and identical for every plate.			
11.4	The plate Heat exchangers shall be single pass type. Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.			
11.5	Double sealing arrangement shall be provided at outer edge and around ports with the inter space between the seals vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.			
11.6	Each Plate shall be numbered in sequence with the number marked by indelible ink on each plate to permit easy reassembly.			
11.7	Flanges shall be as per ANSI 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sect. VIII div.1.			

DM WATER ANALYSIS

Applicable for ALL Projects (PHE-Primary Side)

ANNEXURE - A-9

CLAUSE NO.	PROJECT INFORMATION		
	ANALYSIS OF DM WATER TO BE USED		
	AS		
	PRIMARY FLUID FOR PHEs OF ALL THE PROJECTS		
	S.No.	Characteristics	Value
	i)	Silica (Max.)	0.02 ppm as SiO ₂
	ii)	Iron as Fe	Nil
	iii)	Total hardness	Nil
	iv)	pH value	CORRECTED TO 8.5-9.5
	v)	Conductivity excluding the effects of free CO ₂	Not more than 0.1
APPLICABLE FOR ALL PROJECTS		TECHNICAL SPECIFICATIONS SECTION-VI PART-A	PROJECT SYNOPSIS
			PAGE 1 OF 1

ANALYSIS OF RAW WATER

<u>SR. NO.</u>	<u>PARAMETERS</u>	<u>UNITS</u>	<u>VALUES</u>
1.0	pH		8.0 – 8.5
2.0	Temperature	^o C	22 - 30
3.0	Conductivity	μS/cm	1300
4.0	Colour	Hazen Units	Not Available
5.0	Odour		Not Available
6.0	Taste		Not Available
7.0	TDS	ppm	870
8.0	P-Alkalinity as CaCO ₃	ppm	Nil
9.0	M-Alkalinity as CaCO ₃	ppm	400
10.0	T – Alkalinity as CaCO ₃	ppm	400
11.0	Organic Matter as KMnO ₄	ppm	50
12.0	Iron (as Fe)	ppm	1
13.0	Turbidity (NTU)	ppm	100 during Non – Monsoon Up to 10,000 during Monsoon
14.0	CATIONS		
	(a) Ca as CaCO ₃	ppm	295
	(b) Mg as CaCO ₃	ppm	77
	(c) Na as CaCO ₃	ppm	203

<u>SR. NO.</u>	<u>PARAMETERS</u>	<u>UNITS</u>	<u>VALUES</u>
	(d) K as CaCO ₃	ppm	10
	Total Cation	ppm	585
15.0	ANIONS		
	(a) HCO ₃ as CaCO ₃	ppm	400
	(b) Chlorides	ppm	149
	(c) SO ₄ as CaCO ₃	ppm	33
	(d) Fluoride as CaCO ₃	ppm	1
	(e) Nitrate as NO ₃	ppm	2
	Total Anion	ppm	585
16.0	Ammonia	ppm	Absent - Traces
17.0	Silica Colloidal (as SiO ₂)	ppm	< 1 (can be present in summer)
18.0	Silica Non - Colloidal (as SiO ₂)	ppm	36
19.0	Free Chlorine	ppm	Nil
20.0	Total Suspended Solids	ppm	Not Available
21.0	Carbonates as CaCO ₃	ppm	Not Available
22.0	Boron	ppm	Not Available
23.0	Oil & Grease	ppm	Not Available
CYCLE OF CONCENTRATION (C.O.C) = 5.0			

Chemical analysis of Sea Water:

S.No.	Parameters	Value (ppm)
1.	Total Solids	35,000
2.	Dissolved solids	21,620
3.	Suspended Solids	580
4.	Ignited residue	17,500
5.	Volatiles Solids	4,700
6.	Acid Insolubles	112
7.	Chlorides (as Cl)	20,232
8.	Sulphates (as SO ₄)	1,457
9.	Iron (as Fe)	70
10.	Total alkalinity (as CaCO ₃)	525
11.	Alkalinity due to Normal Carbonates (as CaCO ₃)	Nil
12.	Alkalinity due to bi-Carbonates (as CaCO ₃)	525

13.	Total hardness (as CaCO ₃)	8,155
14.	Permanent hardness (as CaCO ₃)	6,200
15.	Temporary hardness (as CaCO ₃)	1,955
16.	Calcium hardness (as CaCO ₃)	1,255
17.	Magnesium hardness (as CaCO ₃)	6,900
18.	P _H	8.2

CYCLE OF CONCENTRATION (C.O.C) = 1.3



TITLE :
TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N001

SECTION II

REV. NO. 0

DATE 18/4/18

SECTION II

IIA STANDARD TECHNICAL SPECIFICATION
STANDARD QUALITY PLAN



TITLE :
STANDARD TECHNICAL SPECIFICATION
FOR
PLATE HEAT EXCHANGER

SPECIFICATION NO. PE-TS-999-179-N001

VOLUME :

SECTION : IIA

REV. NO. 01

DATE : 2/5/2018

SHEET 1 OF 1

SECTION - IIA
PLATE HEAT EXCHANGER
STANDARD TECHNICAL SPECIFICATION
DATA SHEET C

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 1 OF 11	

1.00.00 GENERAL

This specification covers the Design, Performance requirements, Constructional Features, Materials requirements, manufacture, assembly, Inspection and Testing at Manufacturer's and/ or his sub-contractor's works and Painting requirements for delivery of Plate Heat Exchanger complete with all accessories as specified herein-after.

1.01.00 SYSTEM DESCRIPTION:

1.01.01 The Plate Heat Exchanger are intended to be used in closed circuit DM cooling water circuit for Cooling Hot passivated DM Water by Auxiliary Cooling Water (Clarified / Sea Water).

1.01.02 Passivated DM Water is circulated through various auxiliary coolers of TG/SG/Station Aux., in closed loop by means of pumps. This DM water picks up heat from different cooling equipment's. Heat from DM water is transferred to auxiliary cooling water (Secondary side) thru' the Plate Heat Exchangers covered under this specification.

1.01.03 The analysis of DM Water, Clarified /Sea Water (Auxiliary cooling water) to be handled by the Plate Heat Exchangers are attached as Annexure to Data Sheet-A.

1.01.04 A strainer of 2 mm size at ACW inlet lines of PHE is provided and backwashing of PHE's is not envisaged.

2.00.00 CODES AND STANDARDS :

2.01.00 The design manufacture and testing of the plate heat exchanger complete with all accessories, shall generally conform to the latest editions of the following appropriate standards.

2.01.01 IS/BS/DIN/US Standards regarding pressure vessels, pressure piping, pipes, valves, flanges and other as necessary.

2.01.02 IS/ BS/ DIN/ ASTM for material specification and testing procedures.

2.02.00 In case of any conflict between the above codes/ standards and this

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 2 OF 11	

specification, the latter shall prevail and in case of any further conflict in the matter, the interpretation of the specification by the Engineer shall be final and binding.

3.00.00 SCOPE OF SUPPLY:

3.01.00 The details of the Plate Heat Exchangers with the quantity, design parameters etc. to be supplied shall be as per Data Sheet-A enclosed at Section IB.

3.02.00 Each Plate Heat Exchanger (quantity and other details specified in Data Sheet-A) shall be complete with the following accessories and auxiliaries.

- (i) Suitable drain and vent connections for both primary (DMCW) and Secondary Water (Raw Water/ Sea Water as applicable) streams complete with isolation valves.
- (ii) Supporting arrangement complete with foundation plate channels, anchor bolts, nuts, sleeves, inserts etc.
- (iii) Lifting arrangement i.e., lifting lugs, eye bolts etc.
- (iv) Matching counter flanges with necessary bolts, nuts, and gaskets for all flanged terminal points, including for DMCW and ACW inlet/outlet nozzles & reducers/ expanders.
- (v) Inspection ports at the End plates of the PHE.
- (vi) Other accessories as required to make PHE's complete in all respects.
- (vii) Commissioning spares, if any.
- (viii) One Ratchet spanner for each type of PHE is included in bidder's scope of supply.
- (ix) Matching piece (Reducer/Expander), with coatings (as required), to match the PHE nozzle connection with connecting pipe size at DMCW side/ ACW side as indicated in Data Sheet. In case of sea Water, Matching piece on ACW Side (Secondary) shall be flanged with coatings (as required for sea water application).
- (x) Spares as applicable as per data sheet A at Section IB.

3.03.00 Finish paints for touch up painting of equipment after erection at Site in sealed containers.

3.04.00 Items though not specifically mentioned in the specification but needed to complete the equipment to meet the intent of specification, shall also be deemed to be included unless otherwise specifically mentioned in exclusions.

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 3 OF 11	

4.00.00 **EXCLUSIONS :**

The following are excluded from the bidder's scope:

- 4.01.00 Civil foundation works required for installation of the heat exchangers.
- 4.02.00 Piping, valves etc., on the external circuit of both primary and secondary water streams.
- 4.03.00 Erection & Commissioning of equipment at site.

5.00.00 **DESIGN AND CONSTRUCTION:**

5.01.00 **General Requirements:**

- 5.01.01 Unless otherwise necessary manufacturer's standard and proven models of the plate heat exchanger shall be supplied.

- 5.01.02 The equipment shall be capable of safe, proper and continuous operation at all heat loads and water from up to those corresponding to the operating conditions mentioned in Data Sheet-A. Vibration, noise, mechanical and thermal stresses shall be kept within allowable limits specified by relevant codes/ standards in design. Due attention shall be given to ease of maintenance, repair and cleaning.

- 5.01.03 Suitable corrosion allowance shall be provided wherever necessary. The corrosion allowance for the heat exchanger parts such as pressure plates (support plates), nozzles, sliding channels and frame shall be 1.6 mm (minimum).

- 5.01.04 Each heat exchanger shall be capable of passing a flow of at least 1.1. times the design flow rate on both primary and secondary water sides. Bidder shall indicate maximum pressure drop through the heat exchanger under this condition.

- 5.01.05 For the purpose of calculating dirty overall heat transfer coefficient a total fouling factor as given in Data Sheet-A shall be assumed. It is expected that the cleaning frequency shall be once in a year with the above fouling factor.

- 5.01.06 No back wash for the heat exchangers is envisaged.

5.02.00 **Performance Requirements:**

- 5.02.01 The pressure drop across plate heat exchanger from inlet to outlet in fouled conditions for primary and secondary sides, shall not be more than those

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 4 OF 11	

specified in Data Sheet-A, for the specified flow rates.

5.02.02 For the specified flow rate and inlet temperature, the primary side (hot fluid) outlet temperature shall not be more than that specified in Data Sheet-A.

5.02.03 In the event of failure to meet the above stipulated performance requirements, the equipment will be outrightly rejected.

5.03.00 **Construction of Heat Exchanger:**

5.03.01 Heat transfer plates shall be packed in a frame consisting of fixed frame plate and movable pressure plate and aligned at top and bottom on carrying bars. Design shall be such that cleaning is possible without dismantling the piping.

5.03.02 Heat transfer plates shall be sealed at their outer edges and around the ports by gaskets in order to prevent leakage and inter-mixing of fluids.

Double sealing arrangement shall be provided at outer edge and around ports. The interspace between the seals shall be vented to atmosphere in order to avoid inter-mixing of liquids in case of gaskets failure.

The gasket arrangement shall be such that it receives continuous support to ensure a long gasket life. The gasket should be able to retain their properties and shape over a life period of 10 years.

5.03.03 Heat transfer plates shall be provided with sufficient thickness in order to impart sufficient rigidity to the plates particularly from handling considerations. Plates shall have contact points in order to provide inter-plate supports. The recesses on the plates are suitably strengthened by a reinforcement plate.

Plate thickness shall be adequate to withstand all operating conditions as specified in Datasheet-A. Flanges shall be as per ANSI B 16.5 or equivalent. Thickness of pressure and frame plates shall be as per ASME Sec. VIII Div. 1. 25% extra capacity for additional plates shall be provided in frame.

Each plate shall be numbered in sequence. The number shall be marked by indelible ink on the plate to permit easy reassembly. The plates shall be pressed from one piece. They shall be pressed in single / progressive manner.

The corrugation shall be smooth, uniform and identical for every plate. The PHE

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 5 OF 11	
		bottom frame plate and support should have fixing lugs and cleats to keep provision for enabling to fit trough with outlet nozzle fitted underneath to collect and drain out water in the event of leakages.	
5.03.04	Frame for each heat exchanger shall have extra capacity to accommodate the additional plates if required in future because of any reason whatsoever. The extra capacity to be provided is indicated in Data Sheet-A.		
	The upper carrying bar and lower guide bar shall be rigid in construction without any risk or sagging or buckling, and shall facilitate easy guiding of the plates.		
5.03.05	All inlet, outlet and other nozzles shall be flanged type and shall be as specified in Data Sheet-A. Counter flanges complete with gaskets, bolts, nuts and coatings (wherever necessary) shall be supplied for all the nozzle connections. The nozzle sizes of primary / secondary streams of PHEs shall be of adequate size within acceptable range of velocity. The size selection shall be subject to approval in the event of order.		
5.03.06	If necessary, relief valves shall be provided on both the streams.		
5.04.00	Materials of construction :		
	Material of the heat transfer plates and gaskets shall be consistent with the fluid handled. However, material specification for various parts shall be equal or superior to those specified in Data Sheet - A.		
5.05.00	Foundation And Lifting Arrangements:		
5.05.01	Plate heat exchanger shall be supplied with necessary foundation plates, anchor bolts, sleeves, nuts, inserts etc.		
5.05.02	Plate heat exchanger shall be equipped with suitable lifting lugs/ eye-bolts to facilitate handling during erection and maintenance.		
6.00.00	PAINTING:		
6.01.00	The surface preparation of all exterior and interior surfaces of plate heat exchanger shall include the following:		
	a) Removal of oil, grease, dirt and swarf etc.,		

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 6 OF 11	
	b) Removal of rust and scale etc., c) Sand blasting/ shot blasing.		
6.02.00	All exterior surfaces of PHEs shall be sand / shot blasted, painted with primer and finish coated with coal tar based epoxy coating of min. 250 microns thickness. Colour shade etc. shall be subject to BHEL / customer approval.		
7.00.00	SHOP INSPECTION AND TESTS:		
7.01.00	General:		
7.01.01	Manufacturer shall conduct all tests and stage inspections as per the approved quality plan to ensure that the plate heat exchanger shall conform to the requirements of this specification and of the applicable codes/ standards.		
7.01.02	All materails used for manufacture/ fabrication of the plate heat exchanger components shall be of tested quality. Relevant test certificates for chemical analysis, mechanical tests and heat treatment shall be made available before the final shop inspection. In case the relevant test certificates are not available, the manufacturer shall arrange to carry out the necessary tests required as per approved quality plan and applicable codes at his cost, for which samples shall be identified by BHEL's representative.		
7.01.03	All shop tests shall be conducted in the presence of BHEL's representative and test certificates for the same shall be furnished to BHEL for approval.		
7.01.04	Qualification of welding procedures and welders shall be as per ASME B&PV Code, Section-IX/applicable code.		
7.02.00	Heat Transfer Plates:		
7.02.01	Plate material used for pressing shall be furnished with mill test report showing chemical and physical properties and heat treatment records. Suitable correlating mark shall be available, so that BHEL's inspector can identify the material with test certificates before pressing the plates.		
7.02.02	After pressing visual and dimensional checks on the plates shall be made in the presence of BHEL's inspector, on sampling basis.		

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 7 OF 11	

7.02.03

The heat transfer plates from each lot of the plates shall be tested by liquid / dye penetrant test in order to check for cracks and other surface defects in presence of BHEL / customer's representative / third party (Llyods, TUV or equivalent). If any defect is detected in any of these plates, the whole lot shall be tested and plates without defects only shall be accepted. Plates cleaning agent, liquid penetrant and developer shall not contain any halogen. Procedure for DP test shall be subjected to purchaser's approval. Quantum of check shall be subject to customer's/purchaser's approval in the event of order.

7.02.04

The heat transfer plates shall be tested by light box test in order to check for cracks and other surface defects in presence of BHEL / customer's representative / third party (Llyods, TUV or equivalent). The plates without defects only shall be accepted. Procedure for Light box test shall be subjected to purchaser's approval. Quantum of check shall be subject to customer's/purchaser's approval in the event of order.

7.02.05

Inspection Requirements

(i)

Inspection for "Pressing of plates to form whole corrugation of the heat transfer plate" shall be from third party like TUV/Lloyd and certificate shall be submitted for review of BHEL.

(ii)

Minimum requirement for quality Plan shall be as per quality plan attached in the Section IIA of the specification. Manufacturing Quality Plan for PHE shall be subject to approval during detail engineering. No price implication shall be admissible to QP approval by BHEL/Customer.

(iii)

Heat transfer area for the PHE shall be measured by White light scanning / similar method during contract stage to ascertain the correctness of heat transfer area.

Bidder to note that Heat Transfer Area measured by White Light Scanning should not have negative tolerance more than 3% w.r.t to the heat transfer area indicated by bidder. However in the case of negative tolerance (limited to maximum 3 percent) , bidder has to provide additional plates proportionately, as free issue, assembled into all the applicable PHE's before the Final inspection and "As built Certificate" shall be issued by the bidder accordingly. Bidder to note that negative tolerance beyond three percent shall not be accepted, however no credit shall be given to the bidder for positive tolerance of the plate area measurement.

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 8 OF 11	

7.03.00	Gaskets :
7.03.01	Certificate on Chemical composition of the gasket material shall be furnished to prove the quality. Sample testing in presence of BHEL’s inspector shall also be conducted if desired.
7.03.02	Shore hardness test shall be conducted on the gasket and certificate shall be furnished. Sample tests shall also be done in presence of BHEL’s inspector.
7.03.03	Visual and dimensional check on a sampling basis shall be done. Plates and gaskets assembled together, will be inspected for proper assembly.
7.04.00	Frame Assembly:
7.04.01	All materials for various components of frame assembly viz frame plate, pressure plate, carrying bar, guide bar, tightening/ clamping bolts and nuts etc., shall be of tested quality and test certificates for chemical composition and physical properties shall be furnished.
7.04.02	If the thickness of the plates used for frame and pressure plates is 40 mm or more the same shall be checked ultrasonically to demonstrate the absence of lamination and lack of fusion etc.
7.05.00	All weld joints used for fabrication of heat exchangers shall be subjected to suitable non-destructive examination. This shall include 100% magnetic particle examination or other suitable NDT of all welds.
7.06.00	Nozzle and Flanged Connections: All materails for various nozzles, flanges, gaskets, nuts, bolts etc., shall be of tested quality and correlating test certificates for chemical and mechanical properties shall be furnished. These shall be checked for the edge preparation, fit up, orientation and satisfactory working with matching parts.
7.07.00	Dimensional Checks: Dimensional checks of various components of plate heat exchanger, plate pack length etc., shall be carried out as per assembly drawings approved by BHEL.

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 9 OF 11	

7.08.00 Hydrostatic Test :

Plate heat exchanger shall be hydrostatically tested at a pressure of 1.5 times the design pressure. Pressure shall be applied first to both the sides of the plate at the same time, then only to one side and finally only to other side. Pressure shall be maintained for a minimum period of 30 Minutes for each of the three cases above and for such additional time as may be necessary to conduct the examination, for leakage. The examination shall be performed on all joints, connections and regions of high stress. Fluorescent dye shall be used during the test for ease of leak detection. There shall be no structural damage deformation of the plates.

8.00.00 PERFORMANCE GUARANTEE AND TESTING AT SITE:

8.01.00 Performance Guarantee

8.01.01 After completion of erection at site, performance test will be conducted to ensure that the plate heat exchanger operation meets the specified requirements. Rectification of all defects shall have to be done by the supplier at no extra cost to the purchaser. However the purchaser reserves the right to reject the equipment/ parts not meeting the requirement if the deficiency still persists.

8.01.02 The Plate Heat Exchanger shall be guaranteed to meet the performance requirements as given in Data Sheet-A of Section-IB and also for trouble free operation after commissioning.

8.02.00 PG Testing at Site

8.02.01 The guaranteed performance figures of the plate heat exchangers shall be proved by the supplier during the performance testing at site (as applicable). If the results of these tests show the non-performance of the heat exchanger to meet the guaranteed values, the supplier shall modify the heat exchanger as required to enable it to meet the guarantees.

Even If PG test is not envisaged for any project, in the event of performance shortfall at site or if insisted by customer, performance parameters (Flow, Temperature rise & Pressure drop) are to be demonstrated at site by bidder without any cost implication to BHEL.

8.02.02 All duly calibrated instruments required for PG testing including for flow

	TITLE : STANDARD TECHNICAL SPECIFICATION FOR PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 10 OF 11	

measurements shall be arranged by the bidder and taken back after the Test. The computation of flow by characteristics curve of Pumps for PG Testing of PHE's shall not be permitted.

8.02.03 It is clarified that pressure gauges and temperature gauges are provided at each PHE inlet / outlet on both primary / secondary sides and bidder can install their calibrated instruments on these locations. It is further clarified that due to layout constraints flow measuring instruments installation on pipe is not feasible. Bidder shall arrange the Ultra-sonic flow meter / similar type of instrument for PG testing.

8.02.04 At the time of performance testing, cleaning of the plates (if required) and instruments like pressure gauges, temp. Gauges, flow measuring instruments etc. shall be arranged by the bidder and no instruments shall be provided by BHEL for performance testing.

9.00.00 **QUALITY ASSURANCE & QUALITY PLAN:**

9.01.00 The Plate Heat Exchanger to be supplied shall have assured quality and workmanship.

9.02.00 Typical quality plan is enclosed in section-IIB for guidance. The bidder shall comply with these minimum requirements and shall furnish his own quality plan for approval. The quality plan shall be subjected to customer's / purchaser's approval in the event of order without any cost implication.

10.00.00 **DRAWINGS, DATA & INFORMATION TO BE SUBMITTED ALONG WITH THE OFFER:**

10.01.00 Compliance certificate (duly signed and stamped).

10.02.00 Guarantee Schedule (duly signed and stamped).

10.03.00 Thermal sizing calculations (only for reference and shall be reviewed during detailed engineering).

10.04.00 GA Drg. of PHE indicating all-important details for Layout purpose, withdrawal space required for plates, weight of assembly, nozzle & matching piece details etc. (only for reference and shall be reviewed during detailed engineering).

10.05.00 Deviation Schedule (as per NIT format; in case of nil Deviation, mention "No Deviation" in the schedule and submit).



TITLE :
STANDARD TECHNICAL SPECIFICATION
FOR
PLATE HEAT EXCHANGER

SPECIFICATION NO. PE-TS-999-179-N001

VOLUME :

SECTION : IIA

REV. NO. 01

DATE : 2/5/18

SHEET 11 OF 11

11.00.00

DRAWINGS, DATA & INFORMATION TO BE SUBMITTED AFTER THE AWARD OF CONTRACT:

The drawings, data and other documents as required in Data Sheet-C shall be furnished after the award of contract.

12.00.00

In the event of Contradictions between Section I and Section-II of the Specification, the requirements of Section-I shall prevail over the Section-II.

	TITLE : DATA SHEET - C PLATE HEAT EXCHANGER	SPECIFICATION NO. PE-TS-999-179-N001	
		VOLUME :	
		SECTION : IIA	
		REV. NO. 01	DATE : 2/5/18
		SHEET 1 OF 1	

1.00.00 DRAWINGS, DATA AND INFORMATION TO BE SUBMITTED AFTER THE AWARD OF CONTRACT

After the award of contract, the following drawings, data and information is to be submitted for review/ approval of BHEL as per the distribution schedule given in the enquiry.

1.01.00 Within 2 (two) weeks of the date of LOI, the following shall be submitted.

1.01.01 Data Sheet-B duly revised conforming to accepted bid.

1.01.02 Final versions of the following drawings to enable BHEL to design foundations and structures and to finalise the layout.

a) General Arrangement/ Installation drawings indicating principal dimensions, and heights of equipment being supplied, size and location of various nozzles, connections, supporting arrangement, withdrawal space, bill of quantities and materials of construction and scope of supply etc.

b) Foundation arrangement drawings showing load data on support, size and location of anchor bolts etc.

1.01.03 Sizing and calculations related to PHE/plates.

1.01.04 Performance curve and figures as indicated in Data Sheet-A (for both clean and fouled conditions).

1.01.05 Quality Plan for PHE.

1.01.06 PG Test procedure (as applicable).

1.02.00 Within the stipulated time period the following drawing/ document shall be submitted:

1.02.01 Drawings of components and details as deemed necessary.

1.02.02 Material Test Certificates.

1.02.03 Shop Tests Reports and Certificates.

1.02.04 Write-up and Instruction Manuals for Erection, Operation and Maintenance.

1.02.05 Storage Instruction.

		STANDARD QUALITY PLAN SHEET 1 OF 5		CUSTOMER:		PROJECT TITLE:		SPECIFICATION NO. : PE-TS-999-179-N001											
				BIDDER/VENDOR:		QUALITY PLAN NO.:		SPECIFICATION TITLE : TECHNICAL SPEC. FOR PHE											
				SYSTEM:		ITEM: PHE		STD. QP NO.: PE-QP-999-179-N001											
														SECTION : IIA					
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CAT	TYPE/ METHOD OF CHECK	EXTENT OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS					
					2/3	1				D*	P	W	V						
1.	2.	3.	4.	5.	6.		7.	8.	9.	D*	** 10.			11.					
1.0 RAW MATERIAL INSPECTION																			
1.1	Frame Plates & Pressure Plates, Counter Flanges, Connection Lining Material, Top And Bottom Carrying Bar.	Physical Properties	MA	Physical Test	1/ Heat/He-at Batch	1/ Heat/He-at Batch	App. Drg / Data Sheet	Relevant material spec.	Mill TC Or Lab Test Report	√	2,3	-	1	If co-related mill TCS are not available then check testing carried out by reputed lab					
		Chemical Properties	MA	Chemical Analysis	1/ Heat/He-at Batch	1/ Heat/He-at Batch	-do-	-do-	-do-	√	2,3	-	1	-do-					
		Dimensions	MA	Measurement	100%	100%	Approved Drawings		Inspection Reports	√	2,3	-	1						
		Workmanship And Finish	MA	Visual	100%	100%	-do-	-do-	-do-		2,3	-	1						
		Lamination (Applicable For Frame And Pressure Plate Only)	CR	Ultrasonic Test	100%	100%	SA 435	SA 435	-do-	√	2,3	-	1	Applicable for plate thickness more than 25 mm only					
1.2	Heat Transfer Plates/Coils	Physical Properties	MA	Physical Test	1/ Heat	1/ Heat	App. Drg. / Data Sheet	App. Drg. / Data Sheet	Mill TC Or Lab Test Report	√	2,3	-	1	Co-related mill TCS to be provided. See Remark 1					
		Chemical Properties	MA	Chemical Analysis	1/ Heat	1/ Heat	-do-	-do-	-do-	√	2,3	-	1	-do-					
		Dimensions	MA	Measurement	100%	Sample	Approved Drawings		Inspection Reports	√	2,3	-	1						
1.3	Gaskets	Dimensions	MA	Measurement	100%	Sample	Approved Drawings		Inspection Reports		2,3	-	1	Co-related mill TCS to be provided.					
		Workmanship And Finish	MA	Visual	-do-	-do-	No damage, No Surface defects.		-do-		2,3	-	1						
		Contour	MA	Visual	-do-	-do-	Mfg. Drgs / specification		-do-		2,3	-	1						

		LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. ** 1: BHEL 1* SHALL BE CLEARED BY BHEL 2: VENDOR, 3: SUB VENDOR P: PERFORM W: WITNESS AND V: VERIFICATION. AS APPROPRIATE CHP: CUSTOMER SHALL IDENTIFY IN COLUMN "N" AS 'W'	Cust. Logo	DOC. NO.:		REV.	CAT.
MANUFACTURER/ SUB-SUPPLIER							
SIGNATURE				FOR CUST. USE	REVIEWED BY	APPROVED BY	APPROVAL SEAL

		STANDARD QUALITY PLAN SHEET 2 OF 5		CUSTOMER:		PROJECT TITLE:		SPECIFICATION NO. : PE-TS-999-179-N001											
				BIDDER/VENDOR:		QUALITY PLAN NO.:		SPECIFICATION TITLE : TECHNICAL SPEC. FOR PHE											
				SYSTEM:		ITEM: PHE		STD. QP NO.: PE-QP-999-179-N001											
														SECTION : IIA					
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CAT	TYPE/ METHOD OF CHECK	EXTENT OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS					
					2/3	1				D*	P	W	V						
1.	2.	3.	4.	5.	6.		7.	8.	9.	D*	** 10.			11.					
		Hardness	CR	Measurement	-do-	-do-	Approved Drawings		-do-	√	2,3	-	1						
1.4	Tightening Bolts & Nuts. (Tie Rod)	Physical Properties	MA	Physical Test	1/ Heat	1/ Heat	App. Drg / data sheet	Relevant Material Spec.	Mill Tc Or Lab Test Report	√	2,3	-	1	Manufacturer test certificate will be submitted for review.					
		Chemical Properties	MA	Chemical Analysis	1/ Heat	1/ Heat	-do-	-do-	-do-	√	2,3	-	1	-do-					
		Dimensions	MA	Measurement	100%	100%	Approved Drawings		IR	√	2,3	-	1						
		Workmanship and Finish	MA	Visual	100%	100%	-do-	-do-	-do-		2,3	-	1						
		Internal Soundness (For diameter >= 40 mm)	CR	UT	100%	100%	ASTM A 388	See Remark - 3	-do-	√	2,3	-	1	UT will be carried on raw material stage.					
2.0	IN PROCESS INSPECTION																		
2.1	HT PLATES	Area Measurement	NA	White Light Scanning	1 per Type	1 per Type	Approved drawing/ data sheet	Approved drawing/ data sheet	IR	√	2,3	1	-	See Remark 2					
		Physical Properties	MA	Physical Test	1 Sample per Heat	1 Sample per Heat	Approved drawing/ data sheet	Relevant Material Spec.	Mill TC or Lab Test Report	√	2,3	-	1	Manufacturing test certificates will be submitted for review.					
		Chemical Properties	MA	Chemical Analysis	1 Sample per Heat	1 Sample per Heat	Approved/ drawing/ data sheet	Relevant Material Spec.	Mill TC or Lab Test Report	√	2,3	-	1	Manufacturing test certificates will be submitted for review.					
		Dimension	MA	Measurement	1 Sample per Heat	1 Sample per Heat	Approved drawing/ data sheet	Approved drawing/ data sheet	Inspection Report	√	2,3	-	1						

		LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. ** 1: BHEL 1* SHALL BE CLEARED BY BHEL 2: VENDOR, 3: SUB VENDOR P: PERFORM W: WITNESS AND V: VERIFICATION. AS APPROPRIATE CHP: CUSTOMER SHALL IDENTIFY IN COLUMN "N" AS 'W'	Cust. Logo	DOC. NO.:		REV.	CAT.
MANUFACTURER/ SUB-SUPPLIER							
SIGNATURE				FOR CUST. USE	REVIEWED BY	APPROVED BY	APPROVAL SEAL

बी एच ई एल BHEL		STANDARD QUALITY PLAN SHEET 3 OF 5		CUSTOMER:		PROJECT TITLE:		SPECIFICATION NO. : PE-TS-999-179-N001						
				BIDDER/VENDOR:		QUALITY PLAN NO.:		SPECIFICATION TITLE : TECHNICAL SPEC. FOR PHE						
				SYSTEM:		ITEM: PHE		STD. QP NO.: PE-QP-999-179-N001						
								SECTION : IIA						
SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CAT	TYPE/ METHOD OF CHECK	EXTENT OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
					2/3	1					P	W	V	
1.	2.	3.	4.	5.	6.		7.	8.	9.	D*	** 10.			11.
		Workmanship And Finish	MA	Visual	100%	100%	Approved drawing/ data sheet	No scratches, cracks etc.	-do-		2,3	-	1	
		Surface Defects And Cracks	CR	DP test	10%	2 % or min. 100 nos. whichever is higher	Manufacturer's DP test procedure (to be reviewed and approved by BHEL/Customer during contract stage)		DPT Report	√	2,3	1	-	See Remark 3
				Light Box Test/ Vacuum chamber test	100%	10%	Manufacturer's Light Box/Vacuum test procedure (to be reviewed and approved by BHEL/Customer during contract stage)		Vacuum Test Report	√	2,3	1	-	See Remark 3
		PMI testing	CR	PMI test	100 %	1 Sample per Heat	Approved drawing/ data sheet		PMI Compliance report	√	2,3	-	1	See Remark 5
2.2	Welding Procedures Specification (WPS)	Correctness	MA	Verification	100%	100%	ASME SEC-IX.	ASME SEC-IX.	QW 482 ASME SEC-IX	√	2,3	-	1	Customer /BHEL/ TPI (NPCIL, EIL, LLYODS & BVIS) approved WPS shall be used for welding
2.3	Procedure Qualification Records (PQR)	Suitability	MA	Visual & Mechanical Test	100%	100%	-do-	-do-	QW 483 ASME SEC-IX.	√	2,3	-	1	
2.4	Welders Performance Qualification	Welder's Performance Soundness Of Welds	MA	Visual / RT & Mechanical	100%	100%	-do-	-do-	QW 484 ASME SEC-IX	√	2,3	-	1	Only customer / BHEL/ TPI (NPCIL, EIL, LLYODS & BVIS) approved welder shall be engaged for welding.

MANUFACTURER/ SUB-SUPPLIER	MAIN-SUPPLIER	LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. ** 1: BHEL 1* SHALL BE CLEARED BY BHEL 2: VENDOR, 3: SUB VENDOR P: PERFORM W: WITNESS AND V: VERIFICATION. AS APPROPRIATE CHP: CUSTOMER SHALL IDENTIFY IN COLUMN "N" AS 'W'	Cust. Logo	DOC. NO.:		REV.		CAT.
			FOR CUST. USE	REVIEWED BY		APPROVED BY		APPROVAL SEAL

	STANDARD QUALITY PLAN SHEET 4 OF 5	CUSTOMER:		PROJECT TITLE:		SPECIFICATION NO. : PE-TS-999-179-N001							
		BIDDER/VENDOR:		QUALITY PLAN NO.:		SPECIFICATION TITLE : TECHNICAL SPEC. FOR PHE							
		SYSTEM:		ITEM: PHE		STD. QP NO.: PE-QP-999-179-N001							
												SECTION : IIA	

SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CAT	TYPE/METHOD OF CHECK	EXTENT OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
					2/3	1				D*	P	W	V	
1.	2.	3.	4.	5.	6.		7.	8.	9.	D*	** 10.			11.
2.5	Weld joint of expander/reducer.	Welding Of Outer Flange To Reducer/Expander	MA	Visual	100%	100%	Approved Drawings		Inspection Report	√	2,3	-	1	
				DPT	100%	100%	Manufacturer's DP test procedure (to be reviewed and approved by BHEL/Customer during contract stage)		DPT Report	√	2,3	1	-	
2.6	PHE Structure	Workmanship and finish	MA	Measurement & Visual	100%	100%	Approved Drawings		Inspection Report	√	-	2	1	
2.7	Plate Gaskets	Presence Of Gasket	MA	Visual	100%	100%	Mfg. Spec.	Mfg. Spec.	-do-	√	2	1	-	
2.8	Plate arrangement to flow diagram	Correctness	CR	Visual as per flow diagram	100%	100%	Approved Drawing		Inspection Report		2	-	1	
2.9	Assembly of tightening bolts and nuts	Squeezing of threads on T/B	MA	Visual	100%	100%	Approved Drawing / Data sheet		-do-		2	-	1	
2.10	Plate Pack	Length	MA	Dimension Measurement	100%	100%	Approved Drawing		-do-		2	-	1	
3.0	FINAL INSPECTION													
3.1	Complete Assembly	a. Conformance to GA drg.	MA	-do-	100%	100%	-do-	-do-	-do-		2	1	-	CHP
		B. Dimensions, No. of Heat Transfer Plates, Workmanship & finish	MA	-do-	100%	100%	-do-	-do-	-do-	√	2	1	-	CHP
3.2	Unbalanced hydrostatic pressure (Primary Side)	Leakage / strength of structure	MA	Hyd. Test	100%	100%	Manufacturer's Hydro test procedure (to be reviewed and approved by BHEL/Customer during contract stage)		Hydro Test Report	√	2	1	-	CHP; Hydro test @ 1.5 times the design pressure with 60 minutes holding time.

		LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. ** 1: BHEL 1* SHALL BE CLEARED BY BHEL 2: VENDOR, 3: SUB VENDOR P: PERFORM W: WITNESS AND V: VERIFICATION. AS APPROPRIATE CHP: CUSTOMER SHALL IDENTIFY IN COLUMN "N" AS 'W'	Cust. Logo	DOC. NO.:		REV.	CAT.
MANUFACTURER/ SUB-SUPPLIER	MAIN-SUPPLIER						
SIGNATURE				FOR CUST. USE	REVIEWED BY	APPROVED BY	APPROVAL SEAL

	STANDARD QUALITY PLAN SHEET 5 OF 5	CUSTOMER:	PROJECT TITLE:	SPECIFICATION NO. : PE-TS-999-179-N001
		BIDDER/VENDOR:	QUALITY PLAN NO.:	SPECIFICATION TITLE : TECHNICAL SPEC. FOR PHE
		SYSTEM:	ITEM: PHE	STD. QP NO.: PE-QP-999-179-N001
			SECTION : IIA	

SL. NO	COMPONENT & OPERATIONS	CHARACTERISTICS	CAT	TYPE/ METHOD OF CHECK	EXTENT OF CHECK		REFERENCE DOCUMENT	ACCEPTANCE NORMS	FORMAT OF RECORD		AGENCY			REMARKS
					2/3	1					P	W	V	
1.	2.	3.	4.	5.	6.		7.	8.	9.	D*	** 10.			11.
3.3	Unbalanced hydrostatic pressure (Secondary Side)	Leakage / strength of structure	MA	Hyd. Test	100%	100%	-do-	-do-	√	2	1	-		CHP; Hydro test @ 1.5 times the design pressure with 60 minutes holding time.
3.4	Completeness of all previous tests	Completeness	MA	Verification of reports	100%	100%	Tech. Specs / App. Drawings	Completion Certificate	√	2	-	1		
3.5	Painting	Dry film thickness & shade	MA	Measurement & visual	100%	100%	Customer/BHEL Tech. Spec. / Approved Data sheets	-do-	√	2	-	1		
3.6	Packing	Completeness	MA	Measurement & visual	100%	100%	Customer/BHEL Tech. Spec. / Approved Data sheets	-do-	√	2	-	1		Packing procedure as per Annexure B.

REMARKS:-

- Original Mill TC's to be furnished by vendor to BHEL representative during inspection stage. BHEL to verify physical correlation of Mill TC's with material.
- Inspection of Heat Transfer Plate Area Measurement shall be by White Light Scanning Method from BHEL(Refer Annexure –A). In case, inspection of plate area measurement by white light scanning method of specific PHE model has been witnessed by BHEL in past project then Type test certificates are acceptable to BHEL for same.
- Reg. Dye Penetrant Test & Light Box Test: There shall be random witness by BHEL/ Customer at Bidder's works, in case any defect is found in any of selected % of plates, the whole lot shall be tested in presence of BHEL & Customer. H.T. Plates without defect only shall only be accepted.
- Ultrasonic test of tie rods shall be carried out using 10 mm / 20 mm size Normal Beam Probe of frequency 2 MHz. Using this probe the back wall echo in the sound area of bar shall be adjusted to 100% of full Screen Height (FSH). The whole bar shall be scanned under this sensitivity setting. In this sensitivity setting any defect echo indication having height greater than 20% of FSH is not acceptable.
- 100% PMI Inspection for material grade of PHE Heat Transfer plates shall be from third party like TUV/Lloyd & certificate shall be submitted for review of BHEL. BHEL reserves the right to conduct random & independent PMI inspection on PHE's Heat Transfer plates to ascertain the plate material.

		LEGEND: * RECORDS, IDENTIFIED WITH "TICK" (√) SHALL BE ESSENTIALLY INCLUDED BY SUPPLIER IN QA DOCUMENTATION. ** 1: BHEL 1* SHALL BE CLEARED BY BHEL 2: VENDOR, 3: SUB VENDOR P: PERFORM W: WITNESS AND V: VERIFICATION. AS APPROPRIATE CHP: CUSTOMER SHALL IDENTIFY IN COLUMN "N" AS 'W'	Cust. Logo	DOC. NO.:	REV.	CAT.
MANUFACTURER/ SUB-SUPPLIER	MAIN-SUPPLIER		FOR CUST. USE			
SIGNATURE				REVIEWED BY	APPROVED BY	APPROVAL SEAL



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-TS-999-179-N001

SECTION IIA

REV. NO. 1 **DATE 18.05.2016**

SHEET 1 OF 2

Annexure-A to Standard Quality Plan

PROCEDURE FOR MEASUREMENT OF HEAT TRANSFER SURFACE AREA OF
THE PHE PLATES

Definition of Heat transfer area:-

The Heat transfer area of the PHE plate is the area of the plate participating in the heat transfer process viz. the wetted surface area inside the gasketed groove of the plate as shown in the **Annexure 1**.

Steps to Measure the Heat transfer Area:

- 1) The surface area of the plate shall be cleaned thoroughly.
- 2) Apply the developer (as used in Dye Penetrant test) over the entire surface area of the plate.
- 3) Fix the reference stickers at several appropriate locations on the plate.
- 4) White light (CFL) is projected on the plate.
- 5) The entire surface area including all the geometrical features of the plate (corrugations) is captured by the 3D camera.
- 6) The 3D image of the plate is then converted into CAD format.
- 7) The surface area can be measured from the 3D CAD drawing.



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-TS-999-179-N001

SECTION IIA

REV. NO. 1

DATE 18.05.2016

SHEET 2 OF 2

ANNEXURE-1

Heat transfer area to be measured-Shown in Hatched portion below

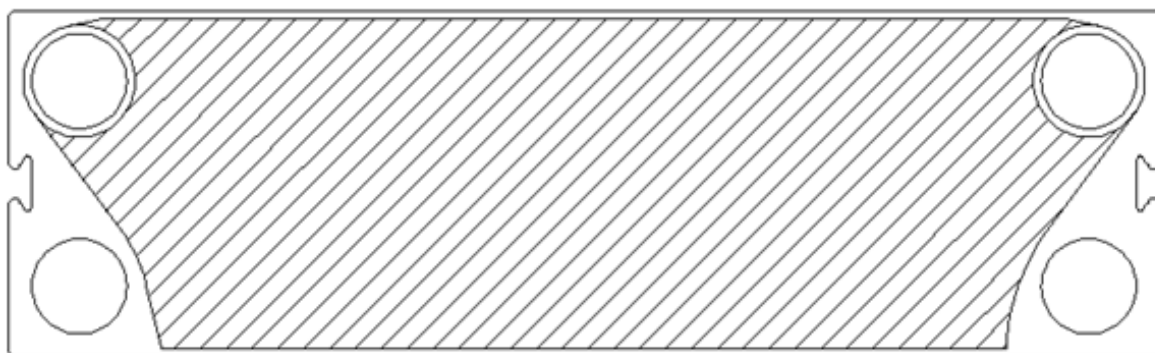


Fig. 1: Wetted Surface Area for Parallel Connection

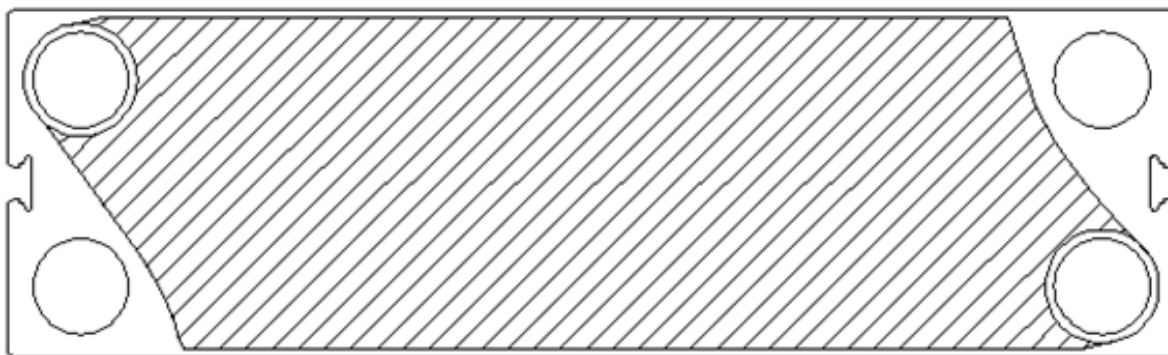


Fig. 2: Wetted Surface Area for Diagonal Connection



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-TS-999-179-N001

SECTION IIA

REV. NO. 1 **DATE 18.05.2016**

SHEET 1 OF 2

Annexure-B to Standard Quality Plan

PHE packing procedure before dispatch

1. Purpose:

The purpose of this procedure is to outline the requirements and procedures for protecting the equipment's during shipment and preserving during the storage.

2. Preparation for Packing:

- After hydro testing, operation, all fluids e.g. water etc., shall be completely drained from all PHE's, and the equipment blown dry.
- All material shall be cleaned internally and externally to remove, scale, rust fillings and any other foreign material.
- The PHE shall be placed on a strong wooden base & bolted to the wooden base using the foundation holes for further transportation upto site.

3. Protection of parts:

- Plate Heat Exchangers shall be packed in proper sizes of wooden cases. High grade woods like Rubber woods, jungle wood, hard wood, mango wood, pine wood, etc. is used for packing.
- All finished (or) machined (External C.S. Surfaces shall be protected against corrosion with corrosion resisting coating, which is easily removable (Compound shall be such that it will remain on the surface at temperature normally encountered during shipping & storage).
- All machined surfaces shall be protected from mechanical damage. All external unfinished carbon steel surfaces shall be sand blasted & shall be coated with rust preventive primer.
- Flanged opening if any shall be covered with blank flanges sealed with blank gasket of natural rubber or equivalent. Butt welded opening shall be closed with temporary closing covers. Internal threads shall be protected with metal plug sealed with Teflon tape (if applicable). External thread shall be protected with PVC sleeve.
- Wooden cases shall be covered with HDPE cloth from inside wooden box and the top. All the opening in plate heat exchanger shall be closed properly by suitably covering to prevent foreign material entering in plate heat exchanger.
- Loose material, primary and secondary a shall be packed in corrugated box and plastic bags with proper tagging.
- All fabricated wooden cases & crates conform to the requirement as per table given below:

Gross Weight [Kgs.]	Board Thickness	Batton / Rafter Thickness
2000 to 9000	Min. 30 mm	Min. 35 mm



TITLE :
TECHNICAL SPECIFICATION FOR
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-TS-999-179-N001

SECTION IIA

REV. NO. 1 **DATE 18.05.2016**

SHEET 2 OF 2

9000 to 18000

Min. 50 mm

Min. 35 mm

- All the equipment shall be protected for entire period of dispatch, storage and erection against corrosion, incidental damage due to vermin, sunlight, rain, high temperature, humid atmosphere, rough handling in transit and storage. All MS parts which are not painted shall be provided with coating of grease.
- Clay Desiccant or such other moisture absorbing material in small cotton bags shall be placed and tied at various points on the equipment, wherever necessary.

4. Special tools and Spare parts:

Special tools and tackles and spares shall be packed separately with adequate identification. Such packages shall be identified as Tools/Commissioning/Operational spares.

5. Preservation

The equipment's shall be stored under closed/open space in packed condition until installation. The packages containing loose plates and gaskets are to be protected from extreme climatic conditions.





TITLE :
TECHNICAL SPECIFICATION FOR
RATE CONTRACT OF
PLATE HEAT EXCHANGERS

SPECIFICATION NO. PE-RC-999-179-N001

SECTION III

REV. NO. 0 DATE 18/4/18

SECTION III

IIIA COMPLIANCE CERTIFICATE (TO BE SUBMITTED BY BIDDER DURING TENDER STAGE).

IIIB GUARANTEE SCHEDULE (TO BE SUBMITTED BY BIDDER DURING TENDER STAGE).

IIIC DATASHEET -B FORMAT (TO BE SUBMITTED BY SUCCESSFUL BIDDER AFTER AWARD OF CONTRACT).

	TITLE :	SPECIFICATION NO. PE-RC-999-179-N001	
	TECHNICAL SPECIFICATION FOR	SECTION IIIA	
	RATE CONTRACT OF	REV. NO. 0	DATE 18/4/18
	PLATE HEAT EXCHANGERS		

COMPLIANCE CERTIFICATE

The bidder shall confirm compliance with following by signing/ stamping this compliance certificate and furnishing same with the offer

- a.) The scope of supply, technical details, construction features, design parameters etc. shall be as per technical specification & there are no exclusions/ deviations with regard to same.
- b.) QP/ test procedures shall be submitted in the event of order based on the guidelines given in the specification & QP enclosed therein.
QP will be subject to BHEL/Customer approval in the event of order & customer hold points for inspection/ testing shall be marked in the QP at the contract stage. Inspection/ testing shall be witnessed as per same apart from review of various test certificates/ Inspection records etc.
The charges for 3rd party inspection (Lloyds, TUV or equivalent) for imported components shall be included in the base price of the equipment by the bidder.
- c.) All drawings/data – sheets etc. to be submitted during contract shall be subject to BHEL/Customer review/ approval.
GA drawings, as submitted with offer at tender stage are for reference purpose only and shall be subject to approval during contract stage.
- d.) There are no other deviations with respect to specification other than those furnished in the 'Schedule of Deviations'
- e.) The offered materials shall be either equivalent or superior to those specified. Also for components where material is not specified it shall be suitable for intended duty, materials shall be subject to approval in the event of order.
- f.) The commissioning spares (if any) are supplied on 'As Required Basis' & prices for same included in the base price (If bidders reply to this is "No commissioning spares are required" and if some spares are actually required during commissioning same shall be supplied by bidder without any cost to BHEL).
- g.) All sub vendors shall be subject to BHEL/CUSTOMER approval.
- h.) Any special tools & tackles, if required, shall be in bidder's scope.
- i.) Performance Guarantees for PHE's shall stand valid as per commercial terms and conditions.
- j.) Regarding bidder's association with their respective Principals (Plate & Gasket supplier) bidder confirms the following:
 - i. Plate supplier shall vet the thermal design of PHE at tender and contract stage and certify the adequacy of design and number of plates.
 - ii. Guarantee schedule duly vetted by Principal shall be submitted during contract stage.
 - iii. Bidders have back to back arrangement with their principal for technical guarantees.

	SCHEDULE OF PERFORMANCE GUARANTEES FOR RATE CONTRACT OF		SPECIFICATION NO.	PE-RC-999-179-N001
			Section	IIIB
	PLATE HEAT EXCHANGER		Rev No.	0
SL. NO.	DESCRIPTION	UNIT	GUARANTEE VALUE	
1.0	PRIMARY SIDE (HOT WATER SIDE)			
	CLEAN CONDITION			
a)	Flow rate	M ³ /Hr.		
b)	DMCW inlet temperature	°C		
c)	DMCW outlet temperature	°C		
d)	Pressure drop	MWC		
2.0	SECONDARY SIDE (COLD WATER SIDE)			
	CLEAN CONDITION			
a)	Flow rate	M ³ /Hr.		
b)	ACW inlet temperature	°C		
c)	ACW outlet temperature	°C		
d)	Pressure drop	MWC		
3.0	PRIMARY SIDE (HOT WATER SIDE)			
	FOULED CONDITION			
a)	Flow rate	M ³ /Hr.		
b)	DMCW inlet temperature	°C		
c)	DMCW outlet temperature	°C		
d)	Pressure drop	MWC		
4.0	SECONDARY SIDE (COLD WATER SIDE)			
	FOULED CONDITION			
a)	Flow rate	M ³ /Hr.		
b)	ACW inlet temperature	°C		
c)	ACW outlet temperature	°C		
d)	Pressure drop	MWC		
PARTICULARS OF BIDDER/ AUTHORISED REPRESENTATIVE				
NAME				
SIGNATURE				
DATE				

	Title DATA SHEET - B		SPECIFICATION NO. PE-RC-999-179-N001			
	PLATE HEAT EXCHANGER		VOLUME III	SECTION B		
			SHEET 1	OF 7		

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N001, Section – IA & IB.

2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS	
1.0	General			
1.1	Number of plate heat exchangers being supplied.	Nos.		
1.2	Manufacturer			
1.3	Model Number/ Type			
1.4	Whether single or double pass			
1.5	Flow Pattern			
2.0	Design			
2.1	Design Pressure	bar (g)		
2.2	Design Temperature	°C		
2.3	Heat Load(without LMTD correction)	KW		
2.4	Heat Load(with LMTD correction)	KW		
2.5	LMTD (Corrected)	°C		
3.0	Guaranteed Performance for Each Heat Exchanger (in fouled condition)		Primary Side (Hot Fluid)	Secondary Side (Cold Fluid)
3.1	Flow rate	M ³ /hr		
3.2	Inlet temperature	°C		
3.3	Outlet temperature	°C		
3.4	Total pressure drop across heat exchanger from inlet to outlet(including inlet & outlet nozzles) a) For design flow b) For 110% design flow rate	bar		
4.0	Heat Transfer & Fluid flow data		Primary Side (Hot Fluid)	Secondary Side (Cold Fluid)
4.1	Film heat transfer co-efficient	KCal/hrM ² °C		
4.2	Fouling factor	M ² hr °C/KCal		

Name of Bidder/ Vendor					
Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N001
	PLATE HEAT EXCHANGER	VOLUME III SECTION B SHEET 2 OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N001, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
4.3	Overall fouling	M ² hr°C/KCal	
4.4	Overall heat transfer coefficient	KCal/hrM ² °C	
	a) In clean conditions		
	b) In fouled conditions		
4.5	Total effective heat transfer area per heat exchanger	M ²	
4.6	Average velocity	m/s	
	a) Through ports		
	b) Through Plate Channels		
4.7	Pressure drop in ports	bar	
4.8	Pressure drop in channels	bar	
4.9	Maximum differential pressure between hot and cold fluids in plate channels (operating)	bar (g)	
5.0	Heat Transfer Plates		
5.1	Area of each plate	M ²	
5.2	Dimension (width x height)	mm x mm	
5.3	Thickness	mm	
5.4	Material & chemical composition		
5.5	Number of plates per heat exchanger	Nos.	
5.6	Maximum number of plates that can be accommodated in the heat exchanger frame	Nos.	
5.7	Type of corrugation		
5.8	Minimum plate pack length	mm	

Name of
Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N001		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	3	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N001, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
	a) As per 5.5 above b) As per 5.6 above Maximum plate pack length a) As per 5.5 above b) As per 5.6 above	mm	
5.9	Average spacing between two plates	mm	
5.10	Hold up volume of each passage	M ³	
5.11	Port size (diameter)	mm	
6.0	Plate Gaskets		
6.1	Type		
6.2	Material and composition		
6.3	Thickness of gasket	mm	
6.4	Hardness of gasket		
6.5	Expected life of gasket		
7.0	Carrying Bar		
7.1	Type of construction		
7.2	Number per heat exchanger		
7.3	Size		
7.4	Material		
8.0	Guide Bar		
8.1	Type of construction		
8.2	Number per heat exchanger		
8.3	Size		
8.4	Material		
9.0	Frame Plate		

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B		SPECIFICATION NO. PE-RC-999-179-N001	
		PLATE HEAT EXCHANGER		VOLUME III	SECTION B
				SHEET 4	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N001, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS	
9.1	Type of Construction			
9.2	Material			
10.0	Pressure Plate			
10.1	Type of construction			
10.2	Material			
11.0	Supporting Columns			
11.1	Type of Construction			
11.2	Material			
12.0	Clamping/Gasket Compression Arrangement			
12.1	Type of arrangement			
12.2	Tie Rod size & material (Length to take care 25% extra plates)			
12.3	Tie Rod Nuts size & material			
12.4	Nozzle flange stud size & material			
12.5	Nozzle flange Nut size & material			
13.0	Inlet & outlet Connection Nozzles		Primary Side (Hot Fluid)	Secondary Side (Cold Fluid)
13.1	Size	mm		
13.2	Rating			
13.3	Facing & drilling standard			
13.4	Flange material			
13.5	Are all nozzles counter-flanges, bolts, nuts, gaskets etc., are included in the		YES/NO	

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N001
	PLATE HEAT EXCHANGER	VOLUME III SECTION B
		SHEET 5 OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N001, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
	offer?		
14.0	Recommended Cleaning frequency of the heat exchanger for assumed fouling factor	Months	
15.0	Is backwash necessary		YES/NO
16.0	Are all auxiliaries and accessories included in the offer		YES/NO
17.0	Are all counter-flanges with nuts, bolts and gaskets for all terminal points included in the offer?		YES/ NO
18.0	Are all heat exchangers supplied with necessary foundation plates, anchor, bolts, sleeves, inserts, lifting lugs etc., as specified.		YES/ NO
19.0	Shop Tests & Inspection		
19.1	Whether all the tests and inspections as detailed in the specification/ quality plan are carried out		YES/ NO
19.2	Hydrostatic Test : a) Test Pressure b) Test duration	bar (g) min.	
19.3	Are all plates checked for cracks and other defects by the penetration method?		YES/NO

Name of
Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N001		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	6	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N001, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
	If not, what percentage is checked?		
19.4	Is hardness test conducted for plate gaskets?		YES/NO
20.0	Details of Painting		
20.1	Exterior surface a) Surface preparation b) Primer c) Finish Preparation		
20.2	Interior Surface a) Surface preparation b) Primer c) Finish Preparation		
21.0	Weight of each heat exchanger a) Empty b) Flooded Flooded Weight of heat exchanger with Max. Plates	kg.	
22.0	Overall dimensions - (Length x Breadth x Height)	mm x mm x mm	
23.0	withdrawal space		
24.0	Recommended Maintenance tools and tackles furnished		Yes/No

Name of

Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					

	Title	DATA SHEET - B	SPECIFICATION NO. PE-RC-999-179-N001		
		PLATE HEAT EXCHANGER	VOLUME	III	SECTION B
			SHEET	7	OF 7

INSTRUCTION TO BIDDER

1. This data sheet shall be read in conjunction with Specification No. PE-RC-999-179-N001, Section – IA & IB.
2. Items which deviate from Specification shall be marked with an asterisk (*)

SL.NO.	ITEM	UNIT	PARTICULARS
25.0	Mesh Size of recommended Strainer	mm	
26.0	Foundation nuts and bolts supplied		Yes/No
27.0	Other information (if any)		

Name of
Bidder/ Vendor

Revision Number	0	1	2	3	4
Signature of Bidder/ Vendor Authorised Representative					
Date :					