



BHARAT HEAVY ELECTRICALS LIMITED

TRANSMISSION PROJECTS ENGINEERING MANAGEMENT

DOCUMENT No.	TB-395-510-032A	Rev. No.	00		Prepared	Checked	Approved
TYPE OF DOC.	TECHNICAL SPECIFICATION			NAME	PC	RD	VK
TITLE FO (Fiber Optic) Cable				SIGN			
				DATE	18.3.2020		
				GROUP	TBEM	W.O. No	87003/ 87002
CUSTOMER	POWERGRID MEDINIPUR-JEERAT TRANSMISSION LIMITED						
PROJECTS	765/400kV Substations at Jeerat & Medinipur (New) & Extension of 400kV Jeerat S/s Project code : 395						

CONTENTS

Section	Description	No. of Sheets
1.	SCOPE, SPECIFIC TECHNICAL REQUIREMENTS & BILL OF QUANTITIES	4
2.	EQUIPMENT SPECIFICATION	1
3.	PROJECT DETAILS AND GENERAL SPECIFICATION	27
4.	CHECK LIST (To be filled at Tender stage)	1

Rev No.	Date	Altered	Checked	Approved	REVISION DETAILS
				Distribution	TBMM TBQM TBCM TBTS
				Copies	2 - - -

COPYRIGHT AND CONFIDENTIALITY
The information on this document is the property of BHARAT HEAVY ELECTRICALS LTD.
It must not be used directly or indirectly in anyway detrimental to the interest of the company

SECTION -I

SCOPE, SPECIFIC TECHNICAL REQUIREMENTS AND QUANTITIES

1.0 SCOPE

This technical specification covers the requirements of design, manufacture, testing at works, packing and dispatch of FO cable required for installation of PMU (Phasor Measurement Unit.) This section covers the specific technical requirements of FO Cable.

In case of any conflict between the technical details mentioned in this section and the remaining sections of this document, then Section-1 shall prevail and is to be considered as binding requirement.

The specification comprises of following sections:

Section-I: Scope, Specific Technical Requirements & Bill of Quantities
Section-II: Equipment Specification
Section-III: Project Details & General Technical Requirements
Section-IV: Checklist

In case of any conflict between various sections, order of precedence shall be in the same order as listed above.

Note: The terms used in this specification namely, “Employer/Purchaser” refers to Powergrid, “Contractor” refers to BHEL & “Sub-contractor” refers to successful bidder.

1.1 The equipment is required for the following Project.

Name of Customer : Power Grid Medinipur-Jeerat Transmission Limited

Name of the Project : 765/400kV Substations at Jeerat & Medinipur (New) & Extension of 400kV Jeerat S/s

Refer Section - III for Project Details and General Specifications.

2.0 SCOPE

The broad Scope of the FO cable shall include planning, designing, engineering, testing at OEM, supply, transportation, insurance, delivery at site. FO cables shall be of armoured type for protection against rodents and physical stresses. The characteristics of the cable shall be as per the IEC 60870-5-103 standard. The fibre optic cables shall be run in GI conduit pipes while passing through cable trenches / cable racks outside the control room building.

Data Requirement Sheets (DRS) of armoured FO cables are given in Section-IV.

For the completeness of the supply of FO cable, all items/ materials/services are deemed to be included in the offer and no claim whatsoever shall be entertained at later stage.

If any of the item supplied by bidder is found not meeting the technical specification requirement, the item shall be replaced without any price implication to BHEL and the technical requirement shall be met.

4.0 PROJECT WISE BILL OF QUANTITY:

A) 765/400kV Jeerat S/s

SN	DESCRIPTION	UNIT	QTY
1.	Single Mode-Armored Fiber Optic Cable	Meters	2000

B) 765/400kV Medinipur S/s

SN	DESCRIPTION	UNIT	QTY
1.	Multi-Mode-Armored Fiber Optic Cable	Meters	2000

NOTE-

- a) Qty variation shall be +/- 10%.
- b) Allowable tolerance on Cable Length per Drum shall be +5% of the standard drum length. However overall tolerance shall be +/-10%
- c) The quantity consumed for the testing deem to be included in the offer. No price implication will be entertained for the quantity consumed for the testing.
- d) Laying of the supplied cable shall be in scope of BHEL.
- e) Supply and laying of GI conduit pipes is in BHEL scope

5.0 APPROVAL CRITERION

- (a) The successful bidder shall have to extend all possible supports like timely submission/re-submission of drawings, visit to end customer to facilitate documents approval without any commercial implications to BHEL. Acceptance of bidder's documents shall be subject to end customer approval.
- (b) The items offered shall be of approved make and model from POWERGRID and is working satisfactorily in their projects.

6.0 TYPE TESTING REQUIREMENTS

Type test to be conducted as per Clause 09 of Section-III.

Type test/ acceptance test shall be conducted at OEM works as per Annexure-I (Section-I) which deem to be included in the scope and will be witnessed by POWERGRID. No price implication will be entertained at later stage.

7.0 INSPECTION, TESTING & ACCEPTANCE

Bidder has to follow Technical specification and POWERGRID approved Manufacturing Quality Plan of Power Grid Corporation of India Ltd.

8.0 DEVIATIONS:

The bidder shall list all the deviation from the specification separately. Offers without specific deviation will be deemed to be totally in compliance with the specification and NO DEVIATION on any account will be entertained at a later date.

9.0 DOCUMENTATION:

The drawings / documents submitted shall be project and product specific and shall incorporate all project details and title block of the customer as detailed in Section 2 & 3.

" Date of Submission of first lot of drawings will be counted only from the date of submission of reasonably correct drawings"

The drawings/ documents, as follows shall be used for providing engineering manufacturing clearance and furthermore, these shall be used for delay analysis, if any from the bidder. The schedule for submission and resubmission shall be in line with details provided in Section-3

Sl. No.	List of Documents/Drawings
1	FO Cable-DRS & GTP
2	Type Test Reports
3	Quality Assurance Plan & Inspection Test Schedule

Final Documentation (after approval) shall be separate for each Substation.

10.0 DOCUMENTS REQUIRED DURING TENDER STAGE:

Following documents are required during tender stage:

- Clause wise compliance to the specification
- Available catalogs of offered items
- Filled checklist
- Un-priced Bill of Quantity

Annexure-I

Type Tests Fibre Optic Approach Cable

S.NO.	Test Name	Test Procedure
1	Water Ingress Test	(IEC 60794-1-F5 / EIA 455-82B) Test duration : 24 hours
2	Seepage of filling compound	(EIA 455-81A) Preconditioning : 72 hours, Test duration : 24 hours.
3	Crush Test	(IEC 60794-1-E3/ EIA 455-41)
4	Impact Test	(IEC-60794-1-E4/ EIA 455-25A)
5	Stress strain Test	(EIA 455-33A)
6	Cable Cut-off wavelength Test	(EIA 455-170)
7	Temperature Cycling Test	(IEC60794-1-F1/EIA-455-3A) – 2 cycles
-End Of Table		

Factory Acceptance Tests On Approach Cable

S. No.	Factory Acceptance Test
1	Attenuation Co-efficient at 1310 nm and 1550 nm
2	Point discontinuities of attenuation
3	Visual Material verification and dimensional checks as per approved DRS/Drawings

SECTION –II

EQUIPMENT SPECIFICATION

Fibre Optic Approach Cables

For purposes of this specification, a fibre optic approach cable is defined as the Armoured fibre optic cable required to connect LIU in the Switchyard Panel Room and LIU in the Control Room as shown in fig1.2. The characteristics of the fibre optic shall be as per the IEC 60870-5-103 standard. The fibre optic cables shall be run in GI conduit pipes while passing through cable trenches / cable racks outside the control room building. The estimated fibre optic approach cabling length requirements are indicated in the Bill of Quantities.

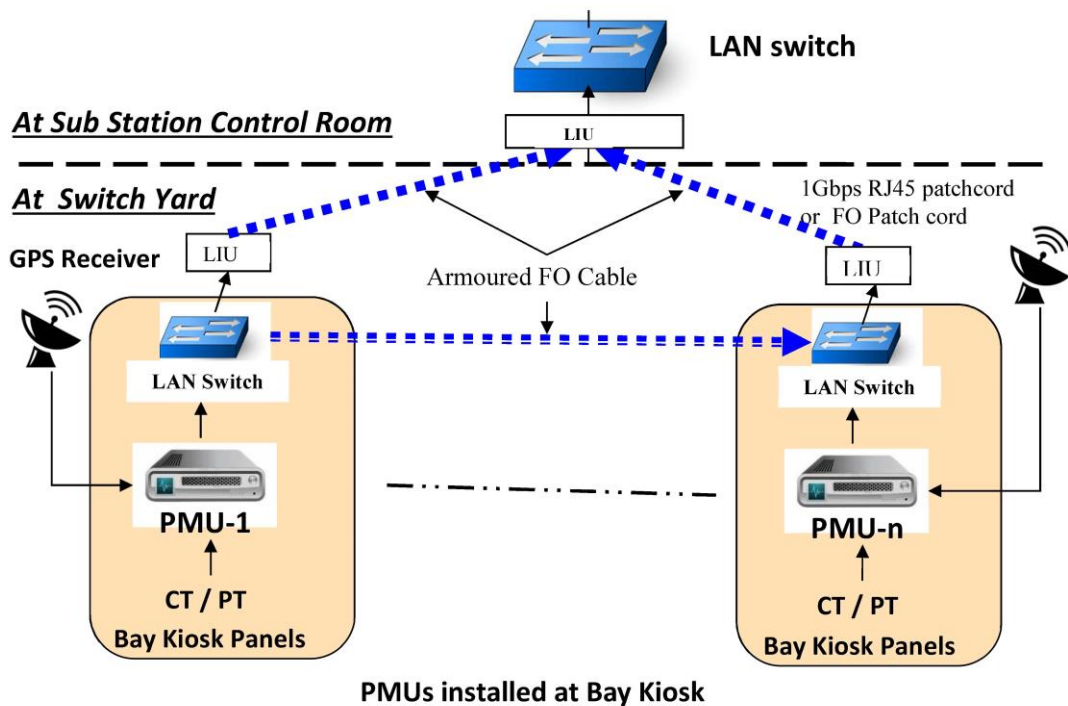


Fig 1.2: Typical Network Architecture at Sub Stations having Bay Kiosks at Switch Yard.

Basic Construction

The cable shall be suitable for direct burial, laying in trenches & PVC/Hume ducts, laying under false flooring and on indoor or outdoor cable raceways.

Jacket Construction & Material

The Approach Cable shall be a UV resistant, rodent proof, armoured cable with metallic type of armouring. The outer cable jacket for approach cable shall consist of carbon black polyethylene resin to prevent damage from exposure to ultra-violet light, weathering and high levels of pollution. The jacket shall conform to ASTM D1248 for density.

Electrical and Mechanical Requirements

The cable core shall comprise of tensile strength member(s), fiber support/bedding structure, core wrap/bedding, and an overall impervious jacket.

SECTION-III

PROJECT DETAILS & GENERAL SPECIFICATION

SITE INFORMATION

	Particular	Details	
a)	Owner	POWERGRID	
b)	Customer	POWERGRID	
c)	Project Title	765/400kV Switchyard at Medinipur & Jeerat	
d)	Location	Medinipur	Jeerat (new)
		West Bengal	West Bengal
e)	Transport Facilities	Nearest rail head - Medinipur	Nearest rail head - Kolkata
SITE CONDITIONS			
a)	Max. ambient air temp.	50°C	
b)	Min. ambient air temp.	0°C	
c)	Max. design ambient temp.	50°C	
d)	Design reference temp.	50°C	
e)	Average Humidity	Max. 100%	
f)	Special corrosion conditions	No	
g)	Solar Radiation		
h)	Atmospheric UV radiation	High	
i)	Altitude above sea level	Less than 1000meter	
j)	Pollution Severity	High Pollution level	
k)	Seismic Zone	As per the seismic zone defined in the relevant BIS / IEC-62271-300 but not less than 0.3g horizontal	
WIND DATA			
	Wind velocity	50m/s	
	Average No. of thunderstorm days per annum	As per IS	

	Main Electrical Parameters:	
	Fault Levels:	765kV: 50kA for 1 sec 400kV: 63kA for 1 sec 66kV : 25kA for 3 sec
	Creepage Distance	31mm/kV for string insulator hardware and 25mm/kV for Equipment

1.0 GENERAL

This Chapter covers Technical Requirements and requirements of auxiliary items.

- a) Equipment furnished shall be complete in every respect with all mountings, fittings, fixtures and standard accessories normally provided with such equipment and/or needed for erection, completion and safe operation of the equipment as required by applicable codes unless included in the list of exclusions.
- b) Material and components not specifically stated in this specification but which are necessary for satisfactory operation of the equipment and accessories specified in this specification shall be deemed to be included unless specifically excluded and shall be supplied at no extra cost.
- c) Whenever a material or article is specified or described by the name of a particular brand, manufacturer or vendor, the specific name mentioned shall be understood as establishing type, function and quality and not as limiting competition.
- d) In case any Deviation Schedule, Bid Proposal Sheet, Schedule of Data Requirements (DRS), test reports or any other document/information are not furnished along-with the bid, the bid is liable to be rejected. Unless brought out clearly, the Bid will be deemed to conform to the specification scrupulously. All deviations from the specification shall be clearly brought out in the respective deviation schedule.
- f) The Bidder shall clearly indicate in the bid, the specific standards in accordance with which the works will be carried out.
- g) The equipment must be new, of highest grade, the best quality of their kind, to best engineering practice and latest state of art, and in accordance with purpose for which they are intended and ensure satisfactory performance throughout the service life.
- h) All similar parts of the equipment shall be made to gauge and shall be interchangeable with and shall be made of same materials and workmanship as the corresponding parts of the equipment. Where feasible, common components, units shall be employed in different pieces of equipment in order to optimize the spare part stock-up and utilization.
- i) The requirement regarding external RIV as specified for equipment shall include the

terminal fittings and the equipment shall have been tested preferably with fittings, if any.

2.0 SERVICES TO BE PERFORMED BY THE EQUIPMENT BEING FURNISHED

- a) The equipment furnished under this specification shall perform all its functions and operate satisfactorily without showing undue strain, restrike etc.
- b) The equipment shall be able to withstand forces due to wind load, short circuit, system over voltages, fluctuations, frequency variations etc., all forces considered together.

3.0 SUPPORT STRUCTURES (If in the scope of Bidder)

- a) The support structures should be hot dip galvanised with minimum **610 gm/sq-m** net of zinc.
- b) The design calculations taking into account the environmental conditions of the substations shall be furnished for sizing of the structures.

4.0 STANDARDS

- a) The equipment to be furnished under this specification shall conform to latest issue with all amendments of standard specified under respective Chapters of this Specification. The Bidder shall note that standards mentioned in the specification are not mutually exclusive or complete in themselves, but intended to compliment each other. The bidder shall also note that list of standards presented in this specification is not complete. Whenever necessary the list of standards shall be considered in conjunction with specific IS/IEC. When the specific requirements stipulated in the specifications exceed or differ than those required by the applicable standards, the stipulation of the specification shall take precedence.
- b) Other internationally accepted standards which ensure equivalent or better performance than that specified in the standards referred shall also be accepted.
- c) In case governing standards for the equipment is different from IS or IEC, the salient points of difference shall be clearly brought out in additional information schedule alongwith English language version of standard or relevant extract of the same. The equipment conforming to standards other than IS/IEC shall be subject to POWERGRID's approval.

5.0 ENGINEERING DATA AND DRAWINGS

5.1 The list of drawings/documents which are to be submitted to the Purchaser shall be discussed and finalised by the Purchaser at the time of award. The supplier shall necessarily submit all the drawings/ documents unless anything is waived.

5.2 The Contractor shall submit 4 (four) sets of drawings/ design documents /data / detailed bill of quantity and 1 (one) set of test reports for the approval of the Purchaser. The contractor shall also submit the softcopy of the above documents in addition to hardcopy.

5.3 Drawings

5.3.1 All drawings submitted by the Contractor shall be in sufficient detail to indicate the

type, size, arrangement, material description, Bill of Materials, weight of each component, break-up for packing and shipment, dimensions, internal & the external connections, fixing arrangement required and any other information specifically requested in the specifications.

5.3.2 Drawings submitted by the Contractor shall be clearly marked with the name of the Purchaser, the unit designation, the specifications title, the specification number and the name of the Project. POWERGRID has standardized a large number of drawings/documents of various make including type test reports which can be used for all projects having similar requirements and in such cases no project specific approval (except for list of applicable drawings alongwith type test reports) is required. However, distribution copies of standard drawings/documents shall be submitted as per provision of the contract. All titles, noting, markings and writings on the drawing shall be in English. All the dimensions should be in SI units.

5.3.3 The review of these data by the Purchaser will cover only general conformance of the data to the specifications and documents, interfaces with the equipment provided under the specifications, external connections and of the dimensions which might affect substation layout. This review by the Purchaser may not indicate a thorough review of all dimensions, quantities and details of the equipment, materials, any devices or items indicated or the accuracy of the information submitted. This review and/or approval by the Purchaser shall not be considered by the Contractor, as limiting any of his responsibilities and liabilities for mistakes and deviations from the requirements, specified under these specifications and documents.

5.4 All manufacturing and fabrication work in connection with the equipment prior to the approval of the drawings shall be at the Contractor's risk. The Contractor may make any changes in the design which are necessary to make the equipment conform to the provisions and intent of the Contract and such changes will again be subject to approval by the Purchaser. Approval of Contractor's drawing or work by the Purchaser shall not relieve the contractor of any of his responsibilities and liabilities under the Contract.

5.5 All engineering data submitted by the Contractor after final process including review and approval by the Purchaser shall form part of the Contract Document and the entire works performed under these specifications shall be performed in strict conformity, unless otherwise expressly requested by the Purchaser in Writing.

5.7 Approval Procedure

The scheduled dates for the submission of the drawings as well as for, any data/information to be furnished by the Purchaser would be discussed and finalised at the time of award. The following schedule shall be followed generally for approval and for providing final documentation.

i)	Approval/comments/ Purchaser on initial	As per agreed by schedule submission
ii)	Resubmission (whenever required)	Within 3 (three) weeks from date of comments
iii)	Approval or comments	Within 3 (three) weeks of

receipt of resubmission.

- | | | |
|-------|---|---|
| iv) | Furnishing of distribution copies (5 hard copies per substation and one scanned copy (pdf format) for Corporate Centre) | 2 weeks from the date of approval |
| v) | Furnishing of distribution copies of test reports | |
| (a) | Type test reports (one scanned softcopy in pdf format per substation plus one for corporate centre & one hardcopy per substation) | 2 weeks from the date of final approval |
| (b) | Routine Test Reports (one copy for each substation) | -do- |
| vi) | Furnishing of instruction/ manuals (2 copies per substation and one softcopy (pdf format) for corporate centre & per substation) | As per agreed schedule operation |
| (vii) | As built drawings (two sets of hardcopy per substation & one softcopy (pdf format) for corporate centre & per substation) | On completion of entire works |

NOTE :

- (1) The supplier may please note that all resubmissions must incorporate all comments given in the earlier submission by BHEL/POWERGRID or adequate justification for not incorporating the same must be submitted failing which the submission of documents is likely to be returned.
- (2) All drawings should be submitted in softcopy form, however substation design drawings like SLD, GA, all layouts etc. shall also be submitted in AutoCAD Version. SLD, GA & layout drawings shall be submitted for the entire substation in case of substation extension also.
- (3) The instruction Manuals shall contain full details of drawings of all equipment being supplied under this contract, their exploded diagrams with complete instructions for storage, handling, erection, commissioning, testing, operation, trouble shooting, servicing and overhauling procedures.
- (4) If after the commissioning and initial operation of the substation, the instruction manuals require any modifications/ additions/changes, the same shall be incorporated and the updated final instruction manuals shall be submitted by the supplier to BHEL/POWERGRID.
- (5) The manufacturer shall furnish to the Purchaser catalogues of spare parts.
- (6) All As-built drawings/documents shall be certified by site indicating the changes before final submission.

6.0 MATERIAL WORKMANSHIP

6.1 General Requirement

-
- 6.1.1 Where the specification does not contain references to workmanship, equipment, materials and components of the covered equipment, it is essential that the same must be new, of highest grade of the best quality of their kind, conforming to best engineering practice and suitable for the purpose for which they are intended.
- 6.1.2 Incase where the equipment, materials or components are indicated in the specification as "similar" to any special standard, the Purchaser shall decide upon the question of similarity. When required by the specification or when required by the Purchaser the Contractor shall submit, for approval, all the information concerning the materials or components to be used in manufacture. Machinery, equipment, materials and components supplied, installed or used without such approval shall run the risk of subsequent rejection, it being understood that the cost as well as the time delay associated with the rejection shall be borne by the supplier.
- 6.1.3 The design of the Works shall be such that installation, future expansions, replacements and general maintenance may be undertaken with a minimum of time and expenses. Each component shall be designed to be consistent with its duty and suitable factors of safety, subject to mutual agreements. All joints and fastenings shall be devised, constructed and documented so that the component parts shall be accurately positioned and restrained to fulfill their required function. In general, screw threads shall be standard metric threads.
The use of other thread forms will only be permitted when prior approval has been obtained from the BHEL/POWERGRID.
- 6.1.4 Whenever possible, all similar part of the Works shall be made to gauge and shall also be made interchangeable with similar parts. All spare parts shall also be interchangeable and shall be made of the same materials and workmanship as the corresponding parts of the Equipment supplied under the Specification. Where feasible, common component units shall be employed in different pieces of equipment in order to minimize spare parts stocking requirements. All equipment of the same type and rating shall be physically and electrically interchangeable.
- 6.1.5 All materials and equipment shall be installed in strict accordance with the manufacturer's recommendation(s). Only first-class work in accordance with the best modern practices will be accepted. Installation shall be considered as being the erection of equipment at its permanent location. This, unless otherwise specified, shall include unpacking, cleaning and lifting into position, grouting, levelling, aligning, coupling of or bolting down to previously installed equipment bases/foundations, performing the alignment check and final adjustment prior to initial operation, testing and commissioning in accordance with the manufacturer's tolerances, instructions and the Specification. All factory assembled rotating machinery shall be checked for alignment and adjustments made as necessary to re-establish the manufacturer's limits suitable guards shall be provided for the protection of personnel on all exposed rotating and / or moving machine parts and shall be designed for easy installation and removal for maintenance purposes. The spare equipment(s) shall be installed at designated locations and tested for healthiness.
- 6.1.6 The supplier shall apply oil and grease of the proper specification to suit the machinery, as is necessary for the installation of the equipment. Lubricants used for installation purposes shall be drained out and the system flushed through where necessary for applying the lubricant required for operation. The supplier shall apply all operational lubricants to the equipment installed by him.
-

-
- 6.1.7 All oil, grease and other consumables used in the Works/ Equipment shall be purchased in India unless the Contractor has any special requirement for the specific application of a type of oil or grease not available in India. In such is the case he shall declare in the proposal, where such oil or grease is available. He shall help POWERGRID in establishing equivalent Indian make and Indian Contractor. The same shall be applicable to other consumables too.
- 6.1.8 Corona and radio interference voltage test and seismic withstand test (for 132kV and above voltage level) procedures for equipments shall be in line with the procedure given at Annexure-A and B respectively.

6.2 Provisions For Exposure to Hot and Humid climate

Outdoor equipment supplied under the specification shall be suitable for service and storage under tropical conditions of high temperature, high humidity, heavy rainfall and environment favourable to the growth of fungi and mildew. The indoor equipments located in non-air conditioned areas shall also be of same type.

6.2.1 Space Heaters

- 6.2.1.1 The heaters shall be suitable for continuous operation at 240V as supply voltage. On-off switch and fuse shall be provided.
- 6.2.1.2 One or more adequately rated thermostatically connected heaters shall be supplied to prevent condensation in any compartment. The heaters shall be installed in the compartment and electrical connections shall be made sufficiently away from below the heaters to minimize deterioration of supply wire insulation. The heaters shall be suitable to maintain the compartment temperature to prevent condensation.
- 6.2.1.3 Suitable anti condensation heaters with the provision of thermostat shall be provided.

6.2.2 FUNGI STATIC VARNISH

Besides the space heaters, special moisture and fungus resistant varnish shall be applied on parts which may be subjected or predisposed to the formation of fungi due to the presence or deposit of nutrient substances. The varnish shall not be applied to any surface of part where the treatment will interfere with the operation or performance of the equipment. Such surfaces or parts shall be protected against the application of the varnish.

6.2.3 Ventilation opening

Wherever ventilation is provided, the compartments shall have ventilation openings with fine wire mesh of brass to prevent the entry of insects and to reduce to a minimum the entry of dirt and dust. Outdoor compartment openings shall be provided with shutter type blinds and suitable provision shall be made so as to avoid any communication of air / dust with any part in the enclosures of the Control Cabinets, Junction boxes and Marshalling Boxes, panels etc.

6.2.4 Degree of Protection

The enclosures of the Control Cabinets, Junction boxes and Marshalling Boxes, panels etc. to be installed shall provide degree of protection as detailed here under:

- a) Installed out door: IP- 55

-
- b) Installed indoor in air conditioned area: IP-31
 - c) Installed in covered area: IP-52
 - d) Installed indoor in non air conditioned area where possibility of entry of water is limited: IP-41.
 - e) For LT Switchgear (AC & DC distribution Boards) : IP-52

The degree of protection shall be in accordance with IS:13947 (Part-I) / IEC-60947(Part-I) / IS 12063 / IEC-60529. Type test report for degree of protection test, shall be submitted for approval.

6.3 Deleted

6.4 Deleted

7.0 DESIGN IMPROVEMENTS / COORDINATION

- 7.1 The bidder shall note that the equipment offered by him in the bid only shall be accepted for supply. However, the Purchaser or the Contractor may propose changes in the specification of the equipment or quality thereof and if the Purchaser & contractor agree upon any such changes, the specification shall be modified accordingly.
- 7.2 If any such agreed upon change is such that it affects the price and schedule of completion, the parties shall agree in writing as to the extent of any change in the price and/or schedule of completion before the Contractor proceeds with the change. Following such agreement, the provision thereof, shall be deemed to have been amended accordingly.
- 7.3 The supplier shall be responsible for the selection and design of appropriate equipments to provide the best co-ordinated performance of the entire system. The basic design requirements are detailed out in this Specification. The design of various components, sub-assemblies and assemblies shall be so done that it facilitates easy field assembly and maintenance.
- 7.4 The supplier has to coordinate designs and terminations with the agencies (if any) who are Consultants/Contractor for the Purchaser. The names of agencies shall be intimated to the successful bidders.
- 7.5 The supplier will be called upon to attend design co-ordination meetings with the Engineer, other Contractor's and the Consultants of the Purchaser (if any) during the period of Contract. The Contractor shall attend such meetings at his own cost at POWERGRID Corporate Centre, Gurgaon (Haryana) or at mutually agreed venue as and when required and fully cooperate with such persons and agencies involved during those discussions.

8.0 QUALITY ASSURANCE PROGRAMME

- 8.1 To ensure that the equipment and services under the scope of this Contract whether manufactured or performed within the supplier's Works or at his Sub- contractor's premises or at the Purchaser's site or at any other place of Work are in accordance with the specifications, the supplier shall adopt suitable quality assurance programme to control such activities at all points necessary. The detailed programme shall be submitted by the contractor after the award for reference. A quality assurance programme of the supplier shall generally cover the following:
 - (a) His organization structure for the management and implementation of the proposed quality assurance programme:

-
- (b) Documentation control system;
 - (c) Qualification data for bidder's key personnel;
 - (d) The procedure for purchases of materials, parts components and selection of sub-Contractor's services including vendor analysis, source inspection, incoming raw material inspection, verification of material purchases etc.
 - (e) System for shop manufacturing and site erection controls including process controls and fabrication and assembly control;
 - (f) Control of non-conforming items and system for corrective actions;
 - (g) Inspection and test procedure both for manufacture and field activities.
 - (h) Control of calibration and testing of measuring instruments and field activities;
 - (i) System for indication and appraisal of inspection status;
 - (j) System for quality audits;
 - (k) System for authorising release of manufactured product to the Purchaser.
 - (l) System for maintenance of records;
 - (m) System for handling storage and delivery; and
 - (n) A quality plan detailing out the specific quality control measures and procedures adopted for controlling the quality characteristics relevant to each item of equipment furnished and/or services rendered.

POWERGRID/BHEL or his duly authorised representative reserves the right to carry out quality audit and quality surveillance of the system and procedure of the supplier/his vendor's quality management and control activities.

8.2 Quality Assurance Documents

The supplier would be required to submit all the Quality Assurance Documents as stipulated in the Quality Plan at the time of POWERGRID/BHEL inspection of equipment/material

9.0 TYPE TESTING, INSPECTION, TESTING & INSPECTION CERTIFICATE

- 9.1 All equipment being supplied shall conform to type tests as per technical specification and shall be subject to routine tests in accordance with requirements stipulated under respective sections.
- 9.2 The reports for all type tests as per technical specification shall be furnished by the supplier alongwith equipment / material drawings. However, type test reports of similar equipments/ material already accepted in POWERGRID shall be applicable for all project with similar requirement. The type tests conducted earlier should have either been conducted in accredited laboratory (accredited based on ISO / IEC Guide 25 / 17025 or EN 45001 by the national accreditation body of the country where laboratory is located) or witnessed by POWERGRID or representative authorized by POWERGRID or Utility or representative of accredited test lab or reputed consultant.

The test reports submitted shall be of the tests conducted within last 10 (ten) years prior to the date of bid opening i.e. **23.11.16**. In case the test reports are

of the test conducted earlier than 10 (ten) years prior to the date of bid opening, the contractor shall repeat these test(s) at no extra cost to BHEL.

However, in case of instrument transformers, the following type tests should have been conducted within 5 (five) years prior to the date of bid opening.

- i) Lightning Impulse Test
- ii) Switching Impulse Test
- iii) Multiple Chopped Impulse Test (For CT)
- iv) Chopped Impulse Test (For CVT)

In case the test reports are of these tests (for instrument transformers) as mentioned above are conducted earlier than 5 (five) years prior to the date of bid opening i.e. **23.11.16**, the contractor shall repeat these test(s) at no extra cost to the purchaser.

Further, in the event of any discrepancy in the test reports i.e. any test report not acceptable due to any design/manufacturing changes (including substitution of components) or due to non-compliance with the requirement stipulated in the Technical Specification or any/all type tests not carried out, same shall be carried out without any additional cost implication to the Purchaser.

The supplier shall intimate the BHEL/POWERGRID the detailed program about the tests atleast two (2) weeks in advance in case of domestic supplies & six (6) weeks in advance in case of foreign supplies.

Further, in case type tests are required to be conducted/repeated and the deputation of Inspector/Purchaser's representative is required, then all the expenses shall be borne by the supplier.

- 9.3 The Purchaser intends to repeat the type tests on Power Transformer and Shunt Reactor except Dynamic short circuit tests on transformers, for which test charges shall be payable as per provision of contract. The price of conducting type tests shall be included in Bid price and break up of these shall be given in the relevant schedule of Bid Proposal Sheets. These Type test charges would be considered in bid evaluation. In case Bidder does not indicate charges for any of the type tests or does not mention the name of any test in the price schedules, it will be presumed that the particular test has been offered free of charge. Further, in case any Bidder indicates that he shall not carry out a particular test, his offer shall be considered incomplete and shall be liable to be rejected. BHEL/POWERGRID reserves the right to witness any or all the type tests. The BHEL/POWERGRID also reserves the right to waive the repeating of type tests partly or fully and in case of waiver, test charges for the same shall not be payable.

The Purchaser shall bear all expenses for deputation of purchaser's representative(s) for witnessing the type tests under this clause except in the case of re-deputation if any, necessitated due to no fault of the purchaser.

For outdoor receptacles, trefoil clamps, diesel engine, alternator, motors, cable glands, lighting fixtures, ACSR/AAC conductor, IPS aluminum tube and junction boxes, type test reports are not required to be submitted for the makes indicated at Annexure-E /POWERGRID approved list of subvendors. For the new makes(other than those indicated at Annexure-E / POWERGRID approved list of subvendors), type test reports as per relevant standard shall

be submitted for POWERGRID's approval.

- 9.4 The Purchaser, his duly authorised representative and/or outside inspection agency acting on behalf of the Purchaser shall have at all reasonable times free access to the Contractor's/sub-vendors premises or Works and shall have the power at all reasonable times to inspect and examine the materials and workmanship of the Works during its manufacture or erection if part of the Works is being manufactured or assembled at other premises or works, the Contractor shall obtain for the Engineer and for his duly authorised representative permission to inspect as if the works were manufactured or assembled on the Contractor's own premises or works. Inspection may be made at any stage of manufacture, despatch or at site at the option of the Purchaser and the equipment if found unsatisfactory due to bad workmanship or quality, material is liable to be rejected.
- 9.5 The supplier shall give the Purchaser /Inspector fifteen (15) days written notice for on-shore and six (6) weeks notice for off-shore material being ready for joint testing including contractor and POWERGRID. Such tests shall be to the Contractor's account except for the expenses of the Inspector. The Purchaser/inspector, unless witnessing of the tests is virtually waived, will attend such tests within fifteen (15) days of the date of which the equipment is notified as being ready for test/inspection, failing which the Contractor may proceed alone with the test which shall be deemed to have been made in the Inspector's presence and he shall forthwith forward to the Inspector duly certified copies of tests in triplicate.
- 9.6 The Purchaser or Inspector shall, within fifteen (15) days from the date of inspection as defined herein give notice in writing to the Contractor, of any objection to any drawings and all or any equipment and workmanship which in his opinion is not in accordance with the Contract. The Contractor shall give due consideration to such objections and shall either make the modifications that may be necessary to meet the said objections or shall confirm in writing to the Purchaser /Inspector giving reasons therein, that no modifications are necessary to comply with the Contract.
- 9.7 When the factory tests have been completed at the Contractor's or Sub- Contractor's works, the Purchaser/inspector shall issue a certificate to this effect within fifteen (15) days after completion of tests but if the tests are not witnessed by the Purchaser /Inspector, the certificate shall be issued within fifteen (15) days of receipt of the Contractor's Test certificate by the Engineer/Inspector. Failure of the Purchaser /Inspector to issue such a certificate shall not prevent the Contractor from proceeding with the Works. The completion of these tests or the issue of the certificate shall not bind the Purchaser to accept the equipment should, it, on further tests after erection, be found not to comply with the Contract. The equipment shall be dispatched to site only after approval of test reports and issuance of CIP by the Purchaser.
- 9.8 In all cases where the Contract provides for tests whether at the premises or at the works of the Contractor or of any Sub-Contractor, the Contractor except where otherwise specified shall provide free of charge such items as labour, materials, electricity, fuel, water, stores, apparatus and instruments as may be reasonably demanded by the Purchaser /Inspector or his authorised representative to carry out effectively such tests of the equipment in accordance with the Contract and shall give facilities to the Purchaser /Inspector or to his

authorised representative to accomplish testing.

9.9 The inspection by Purchaser and issue of Inspection Certificate thereon shall in no way limit the liabilities and responsibilities of the Contractor in respect of the agreed quality assurance programme forming a part of the Contract.

9.10 The Purchaser will have the right of having at his own expenses any other test(s) of reasonable nature carried out at Contractor's premises or at site or in any other place in addition of aforesaid type and routine tests, to satisfy that the material comply with the specification.

9.11 The Purchaser reserves the right for getting any field tests not specified in respective sections of the technical specification conducted on the completely assembled equipment at site. The testing equipments for these tests shall be provided by the Purchaser.

10.0 TESTS

10.1 Pre-commissioning Tests

On completion of erection of the equipment and before charging, each item of the equipment shall be thoroughly cleaned and then inspected jointly by the Purchaser and the Contractor for correctness and completeness of installation and acceptability for charging, leading to initial pre-commissioning tests at Site. The list of pre-commissioning tests to be performed are given in respective chapters and shall be included in the Contractor's quality assurance programme.

10.2 Commissioning Tests

10.2.1 The available instrumentation and control equipment will to be used during such tests and the Purchaser will calibrate, all such measuring equipment and devices as far as practicable.

10.2.2 Any special equipment, tools and tackles required for the successful completion of the Commissioning Tests shall be provided by the Contractor, free of cost.

10.2.3 The specific tests requirement on equipment have been brought out in the respective chapters of the technical specification.

10.3 The Contractor shall be responsible for obtaining statutory clearances from the concerned authorities for commissioning the equipment and the switchyard. However necessary fee shall be reimbursed by POWERGRID on production of requisite documents.

11.0 PACKAGING & PROTECTION

11.1 All the equipments shall be suitably protected, coated, covered or boxed and crated to prevent damage or deterioration during transit, handling and storage at Site till the time of erection. On request of the Purchaser, the Contractor shall also submit packing details/associated drawing for any equipment/material under his scope of supply, to facilitate the Purchaser to repack any equipment/material at a later date, in case the need arises. While packing all the materials, the limitation from the point of view of availability of Railway wagon sizes in India should be taken into account. The Contractor shall be responsible for any loss or damage during transportation, handling and storage due to improper packing. Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Contractor. Purchaser takes no responsibility of the availability of the wagons.

-
- 11.2 All coated surfaces shall be protected against abrasion, impact, discolouration and any other damages. All exposed threaded portions shall be suitably protected with either a metallic or a non-metallic protecting device. All ends of all valves and pipings and conduit equipment connections shall be properly sealed with suitable devices to protect them from damage.

12.0 Deleted

13.0 HANDLING, STORING AND INSTALLATION

- 13.1 In accordance with the specific installation instructions as shown on manufacturer's drawings or as directed by the Purchaser or his representative, the Contractor shall unload, store, erect, install, wire, test and place into commercial use all the equipment included in the contract. Equipment shall be installed in a neat, workmanlike manner so that it is level, plumb, square and properly aligned and oriented. Commercial use of switchyard equipment means completion of all site tests specified and energisation at rated voltage.
- 13.2 Contractor may engage manufacturer's Engineers to supervise the unloading, transportation to site, storing, testing and commissioning of the various equipment being procured by them separately. Contractor shall unload, transport, store, erect, test and commission the equipment as per instructions of the manufacturer's supervisory Engineer(s) and shall extend full cooperation to them.
- 13.3 The contractor shall have to ensure that the hard and flat indoor and outdoor storage areas are in place prior to commencement of delivery of material at site. Contractor shall also ensure availability of proper unloading and material handling equipment like cranes etc. and polyester/nylon ropes of suitable capacity to avoid damage during unloading and handling of material at site. All indoor equipments shall be stored indoors. Outdoor equipment may be stored outdoors but on a hard and flat raised area properly covered with waterproof and dustproof covers to protect them from water seepage and moisture ingress. However, all associated control panels, marshalling boxes operating boxes etc. of outdoor equipments are to be stored indoors only. Storage of equipment on top of another one is not permitted if the wooden packing is used. Material opened for joint inspection shall be repacked properly as per manufacturer's recommendations. During storage of material regular periodic monitoring of important parameters like oil level / leakage, SF6 / Nitrogen pressure etc. shall be ensured by the contractor.
- 13.4 In case of any doubt/misunderstanding as to the correct interpretation of manufacturer's drawings or instructions, necessary clarifications shall be obtained from the Purchaser. Contractor shall be held responsible for any damage to the equipment consequent to not following manufacturer's drawings/instructions correctly.
- 13.5 Where assemblies are supplied in more than one section, Contractor shall make all necessary mechanical and electrical connections between sections including the connection between buses. Contractor shall also do necessary adjustments/alignments necessary for proper operation of circuit breakers, isolators and their operating mechanisms. All components shall be protected against damage during unloading, transportation, storage, installation, testing and commissioning. Any equipment damaged due to

negligence or carelessness or otherwise shall be replaced by the Contractor at his own expense.

13.6 Supplier shall be responsible for examining all the shipment and notify the Purchaser immediately of any damage, shortage, discrepancy etc. for the purpose of Purchaser's information only. The Contractor shall submit to the Purchaser every week a report detailing all the receipts during the weeks. However, the Contractor shall be solely responsible for any shortages or damages in transit, handling and/or in storage and erection of the equipment at Site Any demurrage, wharfage and other such charges claimed by the transporters, railways etc. shall be to the account of the Contractor.

13.7 The supplier shall be fully responsible for the equipment/material until the same is handed over to the Purchaser in an operating condition after commissioning. Contractor shall be responsible for the maintenance of the equipment/material while in storage as well as after erection until taken over by Purchaser, as well as protection of the same against theft, element of nature, corrosion, damages etc.

13.8 Where material / equipment is unloaded by Purchaser before the Contractor arrives at site or even when he is at site, Purchaser by right can hand over the same to Contractor and there upon it will be the responsibility of Contractor to store the material in an orderly and proper manner.

13.9 The Contractor shall be responsible for making suitable indoor storage facilities, to store all equipment which requires indoor storage.

13.10 The words 'erection' and 'installation' used in the specification are synonymous.

13.11 Exposed live parts shall be placed high enough above ground to meet the requirements of electrical and other statutory safety codes.

13.12 Equipment Bases

A cast iron or welded steel base plate shall be provided for all rotating equipment which is to be installed on a concrete base unless otherwise agreed to by the Purchaser. Each base plate shall support the unit and its drive assembly, shall be of a neat design with pads for anchoring the units, shall have a raised lip all around, and shall have threaded drain connections.

- 14.0 Deleted
- 15.0 Deleted
- 16.0 Deleted
- 17.0 Deleted
- 18.0 Deleted
- 19.0 Deleted
- 20.0 Deleted
- 21.0 Deleted
- 22.0 Deleted
- 23.0 Deleted

ANNEXURE-A

DELETED

ANNEXURE-B

DELETED

SECTION -IV

**CHECK LIST FOR INFORMATION TO BE FURNISHED WITH OFFER
RETURN THIS CHECKLIST AS PART OF THE OFFER DULY SIGNED**

The offer may not be considered if the following information and this Checklist are not enclosed with the Offer.

BHEL ENQUIRY. NO:

BIDDER: OFFER REFERENCE:

TECHNICAL PARAMETERS-

S.No.	Description of the Features	Minimum Requirements		Confirmation by the Bidder
1	Manufacturer	Powergrid Approved Vendor		
2	Application	Between kiosks & Control Room		
3	Cable Type	Multimode	Singlemode	
4	Armoured /un-Armoured	Armoured	Armoured	
5	Core/cladding Diameter	62.5/125µm	9/125µm	
6	Wavelength	850nm/1300nm	1310nm /1550nm	
7	Attenuation	< 3.5 dB/km @850nm <1.0 dB/km @1300nm	<0.35 dB/km @1310nm <0.21 dB/km @1550nm	
8	Band Width	≥200MHz/km @850nm ≥500MHz/km@1300nm	~100 Terahertz @1550nm	
9	No of Fibres	24F	24F	
10	No. of tubes/fillers	6	6	
11	Colour for Fibre	Blue, Orange, Green, White	Blue, Orange, Green, White	
12	Cladding Diameter	125 µm ± 2	125 µm ± 2	
13	Core Diameter/ Mode field Diameter	62.5 µm ± 3	8.6 to 9.5 µm (± 0.6 µm) for 1310 nm	
14	Cable Diameter	Vendor Specific	Vendor Specific	
15	Bending Radius	20xD where D is diameter of cable		
16	Armoured Type	ECCS Tape (Electromagnetically Coated Corrugated Steel Tape)		
17	Operating Temperature	-20 °C to + 70 °C		

Indent no: 50I2000671 dtd: 18.03.2020

Qualifying Requirements for FO Cables:

- a) Bidder should have manufactured and supplied at least 100 meter of Minimum 24 fibre Multimode/single mode armoured FO cable in one single contract.
- b) Bidder should have adequate testing facilities to conduct the tests mentioned in TS



22/03/2020

Puneet Chawla
Senior Engineer (TBEM)

Vivek Kapil
SDGM(TBEM)


20.3.20.


Aruna Gulati
AGM(TBEM)


in leave


Indent no: 50I2000672 dtd: 18.03.2020

Qualifying Requirements for FO Cables:


- a) Bidder should have manufactured and supplied at least 100 meter of Minimum 24 fibre Multimode/single mode armoured FO cable in one single contract.
- b) Bidder should have adequate testing facilities to conduct the tests mentioned in TS


Puneet Chawla
Senior Engineer (TBEM)

Vivek Kapil
SDGM(TBEM)


21.3.20.

Aruna Gulati
AGM(TBEM)


on leave