


NOTES

1. ALL NOZZLES SHALL BE CONSIDERED BY TANK BIDDERS.
2. ALL VALVES, INSTRUMENTATION AND PRESSURE SAFETY VALVE SHALL BE SUPPLIED BY BIDDER.
3. NOZZLE INDICATION IN THE DRAWING IS TENTATIVE. NOZZLE FOR PSV SHALL BE LOCATED IN THE TOP OF THE TANK.
4. NOZZLE SIZE AS INDICATED FOR INSTRUMENTS ARE PRELIMINARY, HOWEVER THE SAME SHALL BE FINALIZED DURING DETAILED ENGINEERING.
5. SUITABLE LADDER SHALL BE PROVIDED BY BIDDER.
6. ALL FLANGED CONNECTIONS SHOULD BE SUPPLIED COMPLETE WITH MATCHING COUNTER FLANGES, NUTS, BOLTS AND GASKET MATERIALS, WHICH ARE IN BIDDER'S SCOPE OF SUPPLY

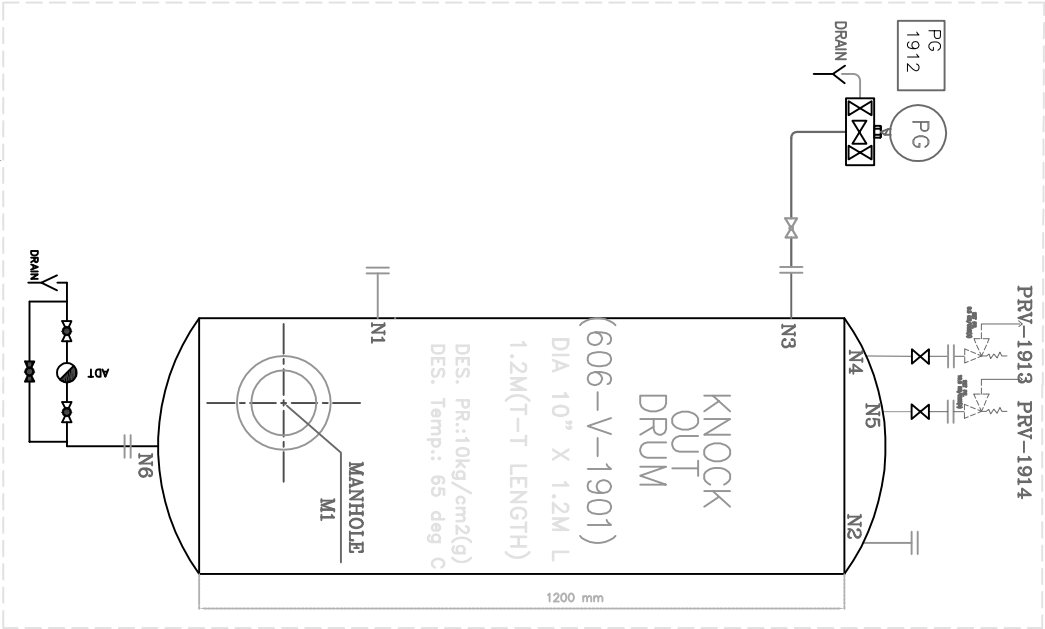

BIDDER'S SCOPE OF SUPPLY

TABLE - LIST OF NOZZLES

NOZZLE NO.	DESCRIPTION	NOZZLE SIZE	RATING
N1	INLET NOZZLE	50NB	150#
N2	OUTLET NOZZLE	50NB	150#
N3	PRESSURE GAUGE	20NB	150#
N4	PRESSURE SAFETY VALVE	25NB, FLANGED	150#
N5	PRESSURE SAFETY VALVE	25NB, FLANGED	150#
N6	DRAIN LINE	20NB, FLANGED	150#

NOMENCLATURE

1. PURCHASER - BHEL
2. BIDDER - TANK SUPPLIER

CUSTOMER:

CUSTOMER'S CONSULTANT:

PROJECT:

DEPT.	UNTO. DMS.	SCALE	WEIGHT (KG)	REF. TO ASSY. Dwg.	DATE	NO. OF
PRDSD	OR	N.T.S	N.A.	N.A.	08.02.19	WAR
CODE	g/w/y					

ANNEX-1: P&ID FOR KNOCK OUT DRUM