

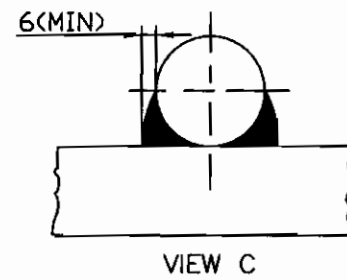
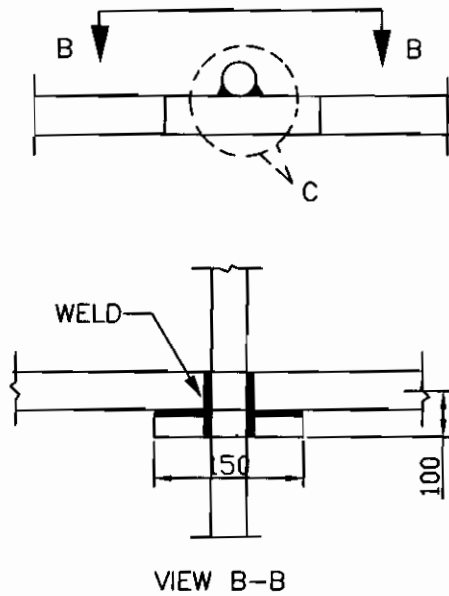


2. RIGHT ANGLED JOINT

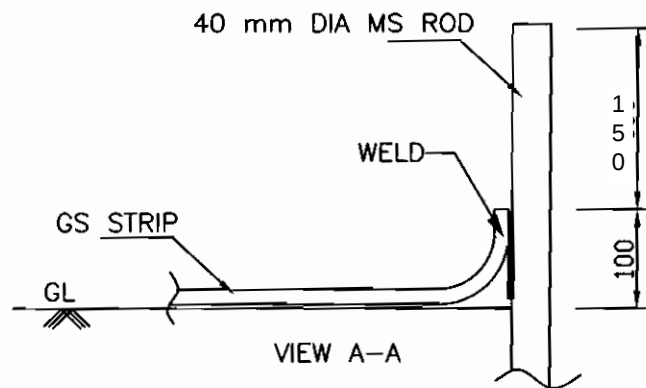

3. ROD TO STRIP

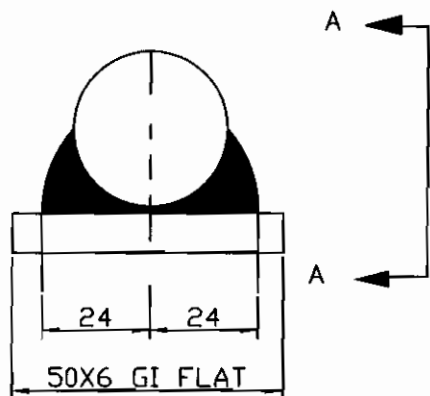

EQUIPMENT & STRUCTURE EARTHING DETAILS WELDING DETAILS - II

COMPUTER REF. NO.


DRG. No.

TB-STD-316-ROD WELDING


REV. 00

A. STRIP TO STRIP (50X6 MS FLAT)

1. STRAIGHT LAP JOINT/RISER

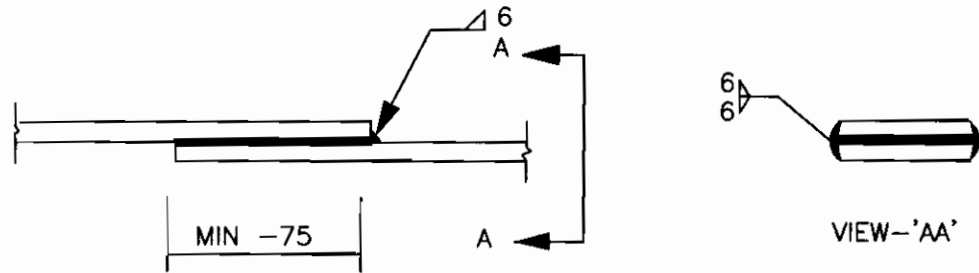

2. CROSS LAP JOINT

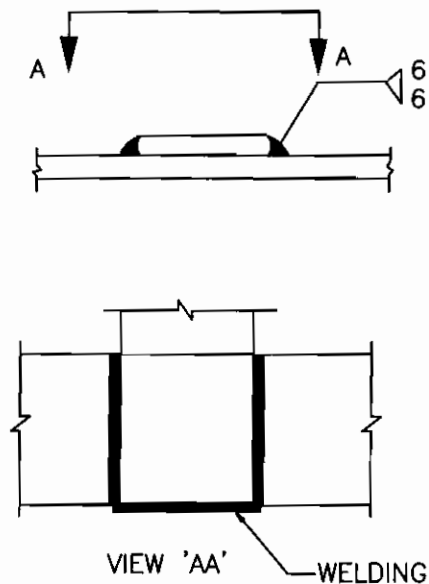




EQUIPMENT & STRUCTURE EARTHING DETAILS WELDING DETAILS - I

COMPUTERREF.NO.

DRG. No.

TB-STD-316-ROD WELDING

REV. 00

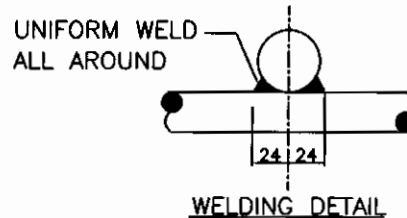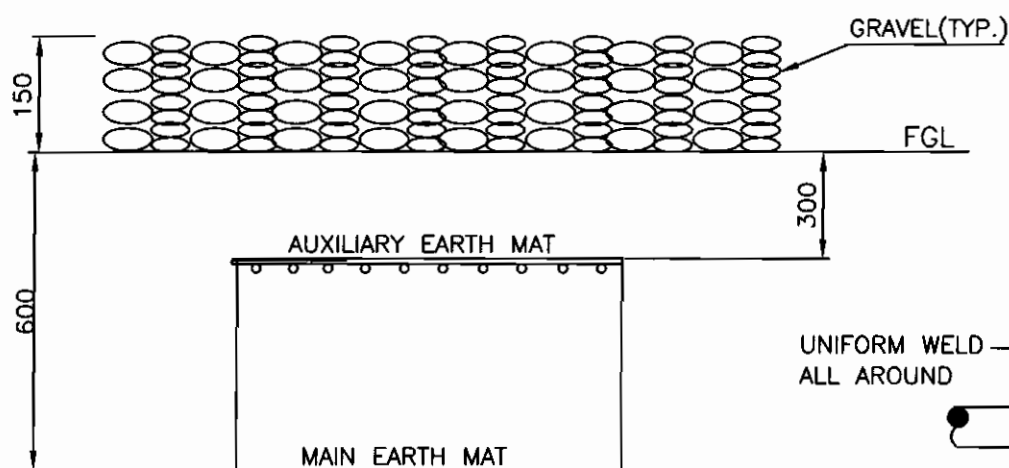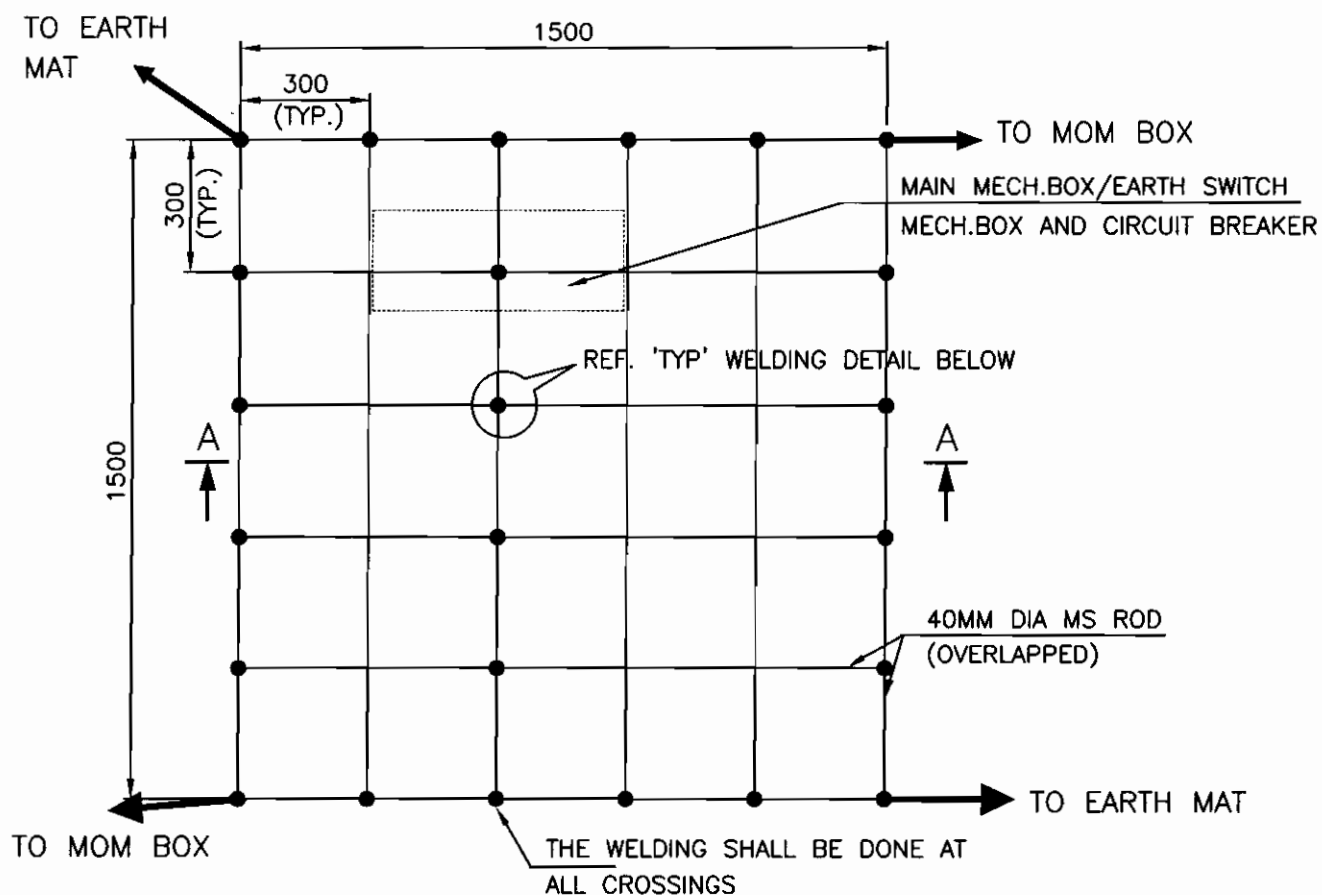

SECTION AA

NOTE:

AUX. EARTHMAT SHALL BE SO POSITIONED THAT THE FOOT OF THE OPERATOR ALWAYS LIE OVER THE AUX. EARTHMAT AREA WHILE ATTENDING / OPERATING THE MECH. BOX. THE CABLE TRENCH ROUTING SHALL BE PLANNED ACCORDINGLY.




EQUIPMENT & STRUCTURE EARTHING DETAILS
AUXILIARY EARTHMAT FOR ISOLATOR MAIN MECH., E/S
MECH. BOX & CB (TYP.)

COMPU. DRG. REF.

Report No.

TB-STD-316-AUX. MAT

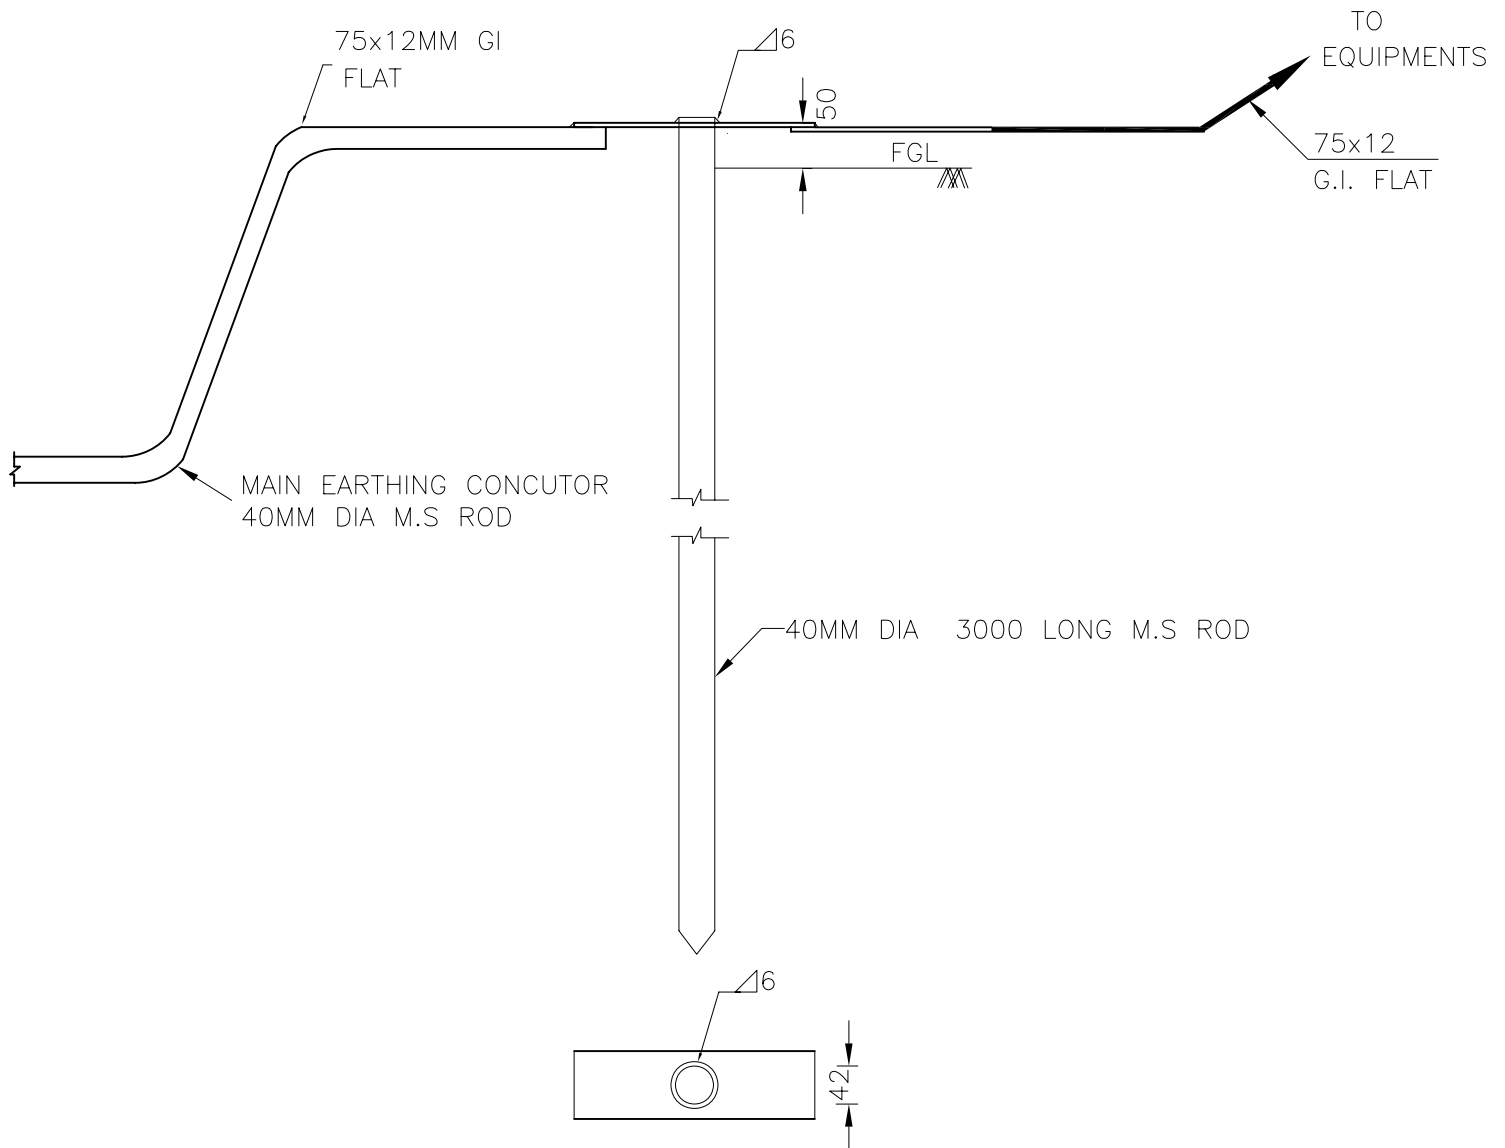

NOTE:—

1. TO BE USED FOR CONNECTING NEUTRAL OF CVT AND SURGE COUNTER OF LA




EQUIPMENT EARTHING DETAILS

ROD EARTH ELECTRODE WITHOUT TEST LINK

COMPU. DRG. REF.

DRG. No. TB-STD-316-ROD ELECTRODE W/O PIT

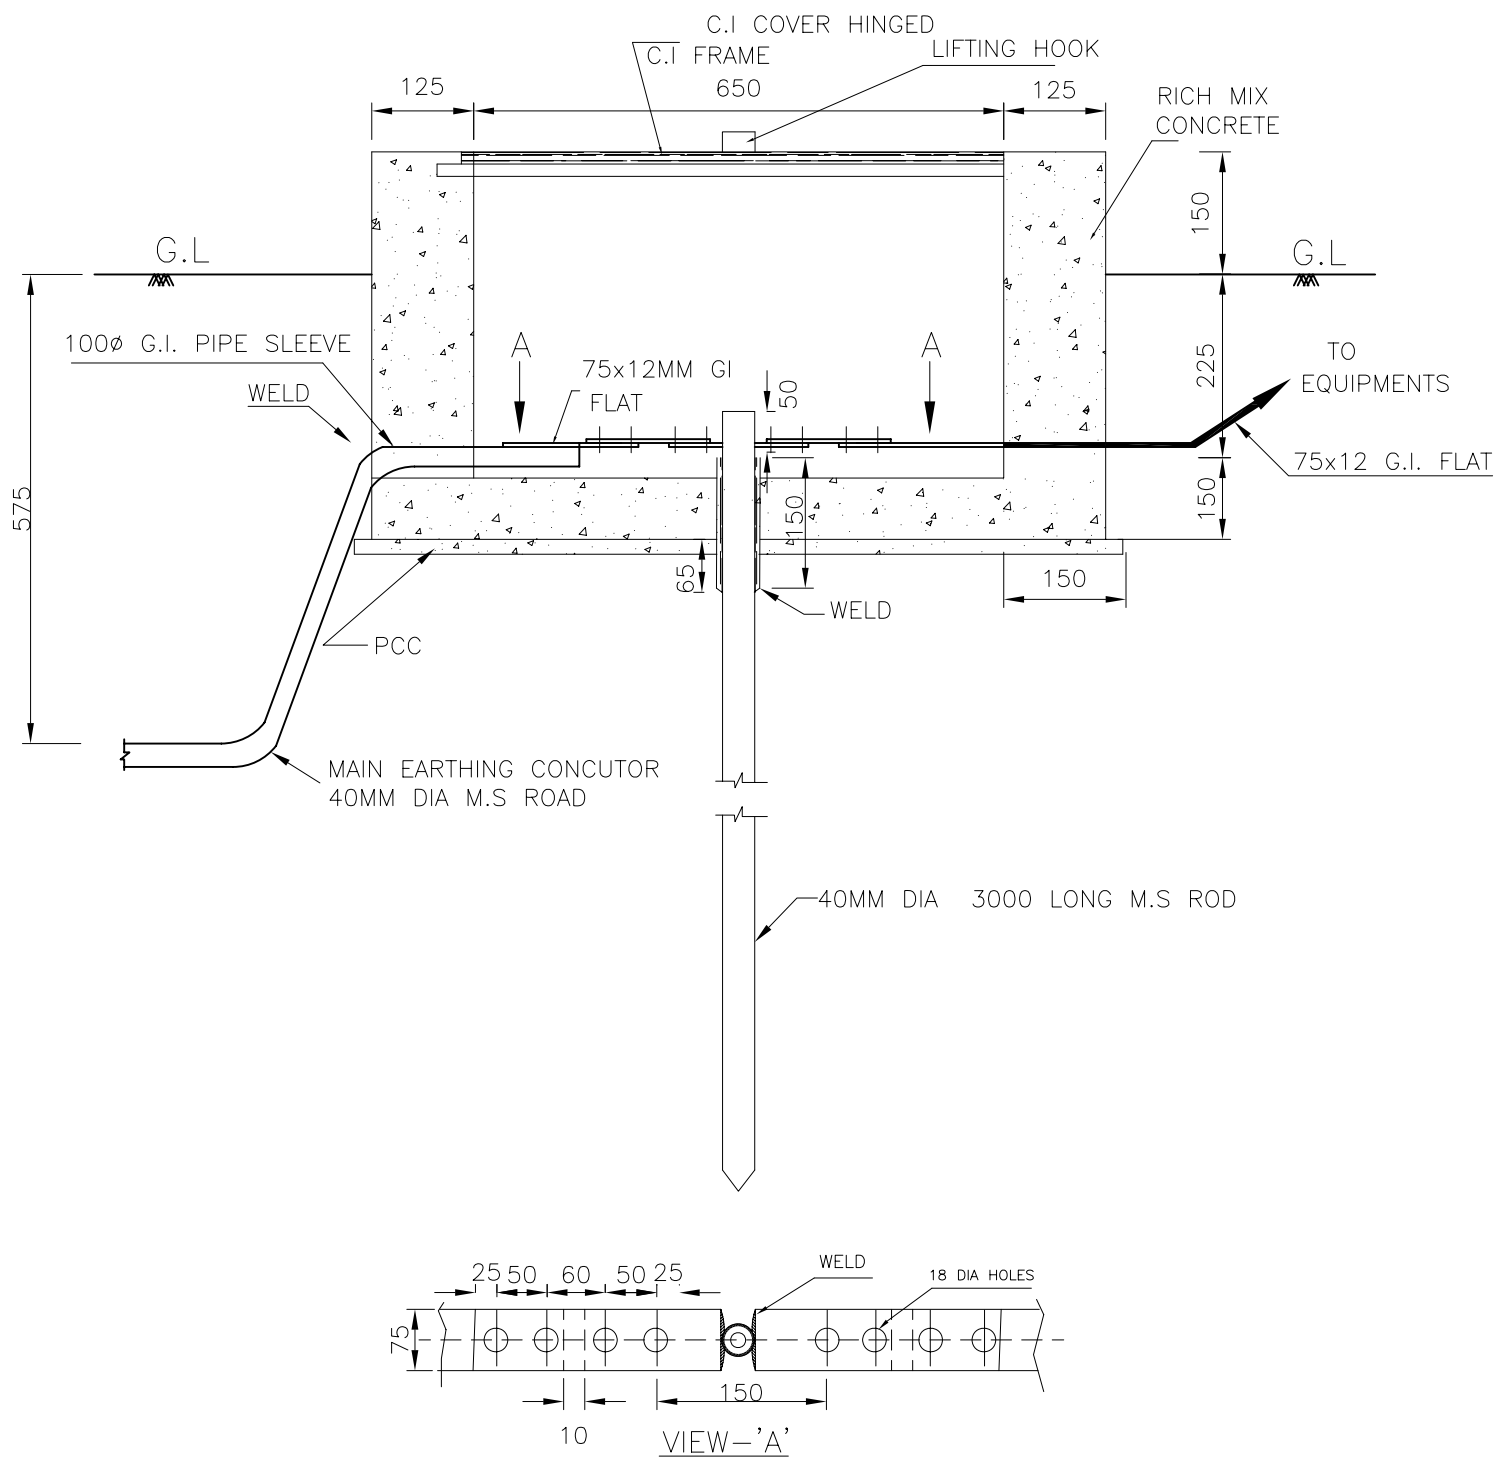

NOTE:-

1. TO BE USED FOR CONNECTING DOWN CONDUCTOR OF LIGHTNING PROTECTION SYSTEM.



EQUIPMENT EARTHING DETAILS

ROD EARTH ELECTRODE WITH TEST LINK

COMPU. DRG. REF.

DRG. No.

TB-STD-316-ROD ELECTRODE WITH PIT