









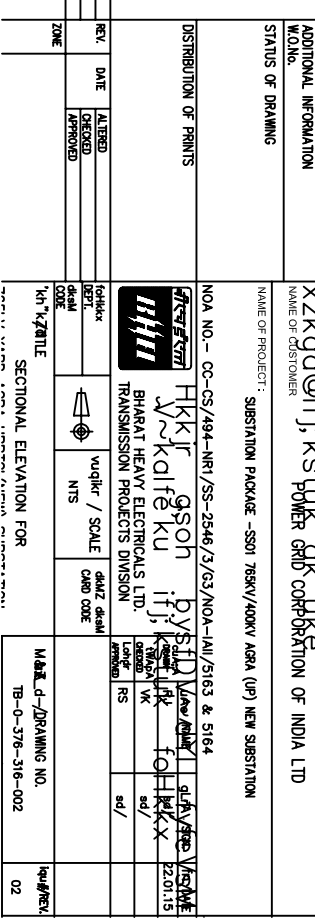


Note: 1. All dimensions are in mm.

2. The Insulator shall be installed in such a way as indicated, to avoid accumulation of rain water, i.e. shed profile projections towards down like other porcelain equipment.

Note: 1. All dimensions are in mm.

2. The Insulator shall be installed in such a way as indicated, to avoid accumulation of rain water, i.e. shed profile projections towards down like other porcelain equipment.

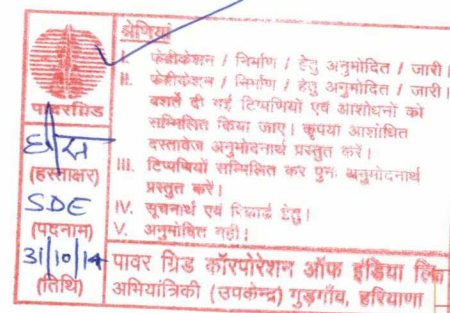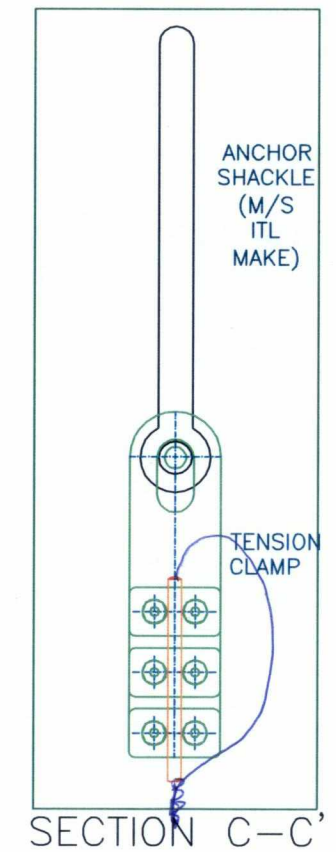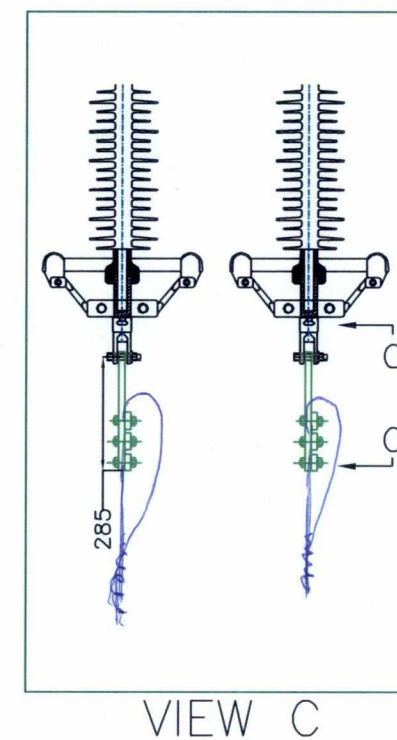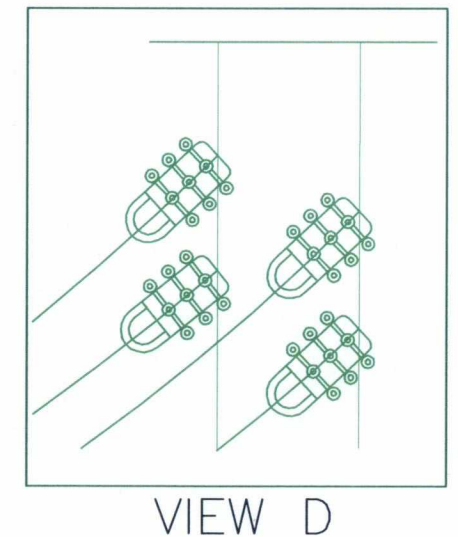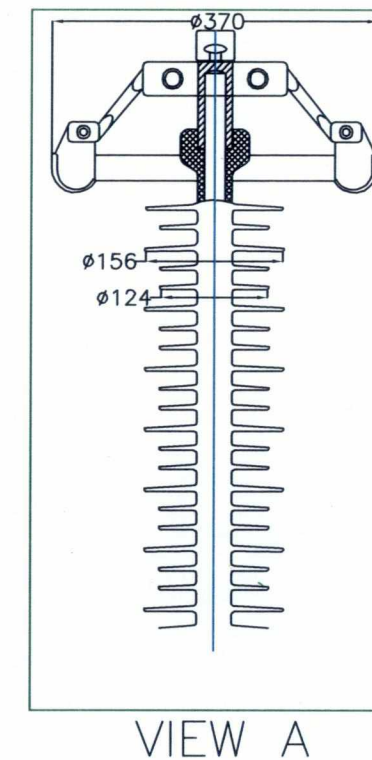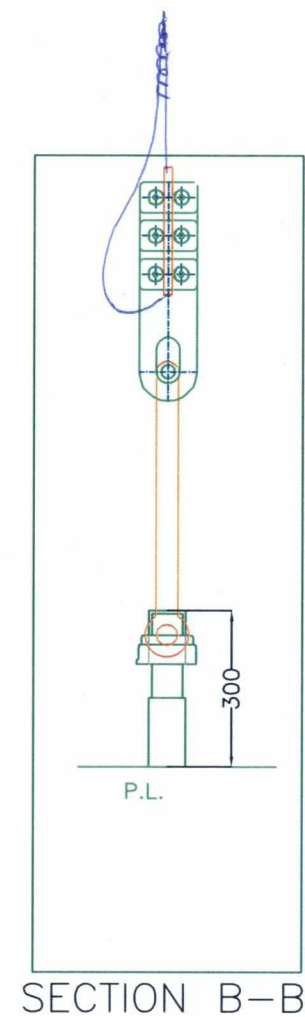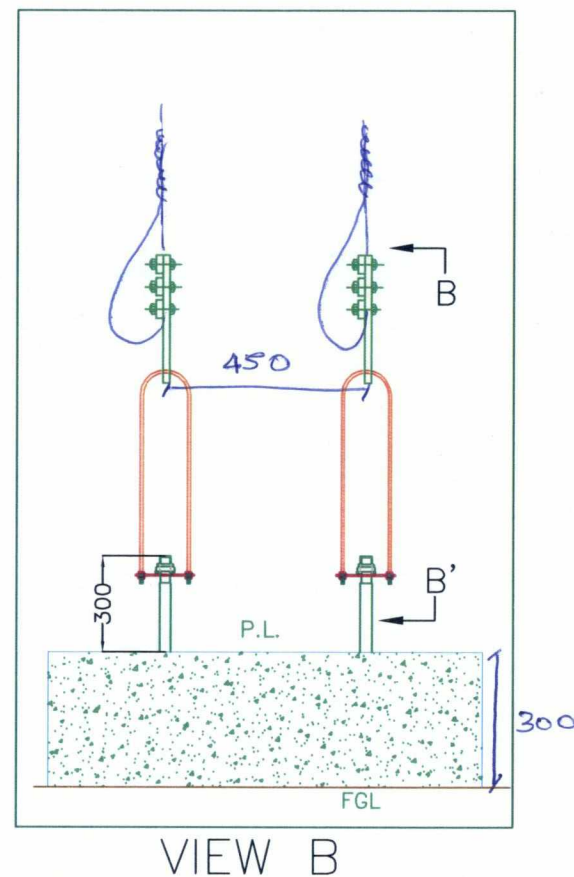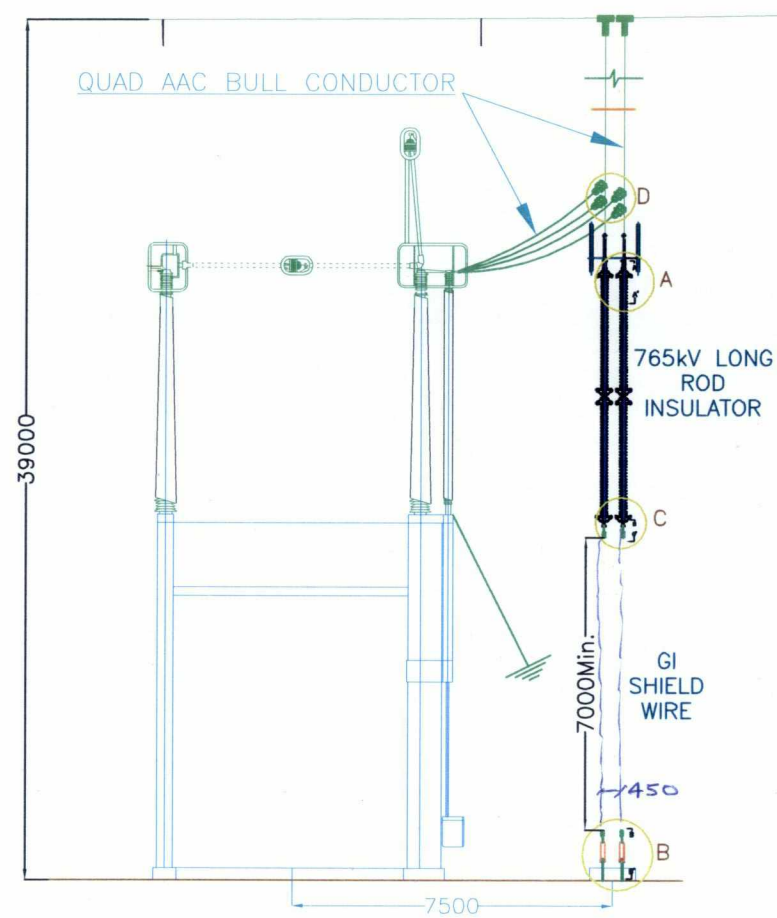

Cat-I

CLIENT:  POWER GRID CORPORATION OF INDIA LIMITED (A GOVERNMENT OF INDIA ENTERPRISE)	DRAWN	MP	SCALE
	CHECKED	DP	1:600
	APPROVED	BKM	DATE
PROJECT: EXTENSION OF 765kV S/S -PACKAGE-B	PASSED	VSC	30.10.2014
DRAWING: GUY ARRANGEMENT - 765KV SUBSTATION RAIPUR, WARDHA & AURANGABAD	DRAWING No. GUY-ARR-001		
 TBEA Always Reliable	TBEA Shenyang Transformer Group Co. Ltd.		SHEET No. 1 OF 1
	Doc. by - TBEA Energy (India) Pvt. Ltd		
		REV. "0"	