

C 604013

TRANSFORMER DIVISIONAL STANDARDS

B - JS - 02

BLOCKS & DOVETAIL STRIPS
(PRESS BOARD)

TR 25003 B

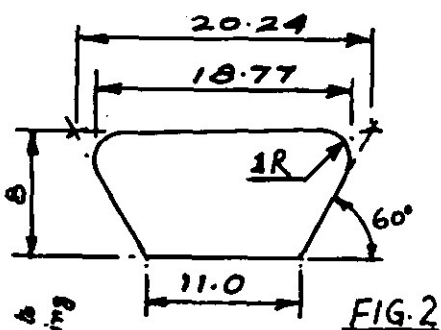


FIG. 2


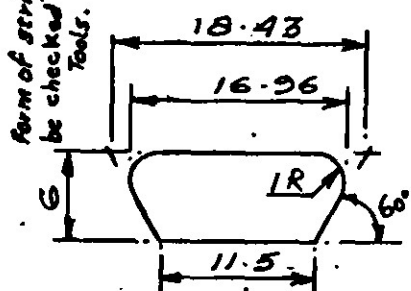


FIG. 1

DOVETAIL STRIPS

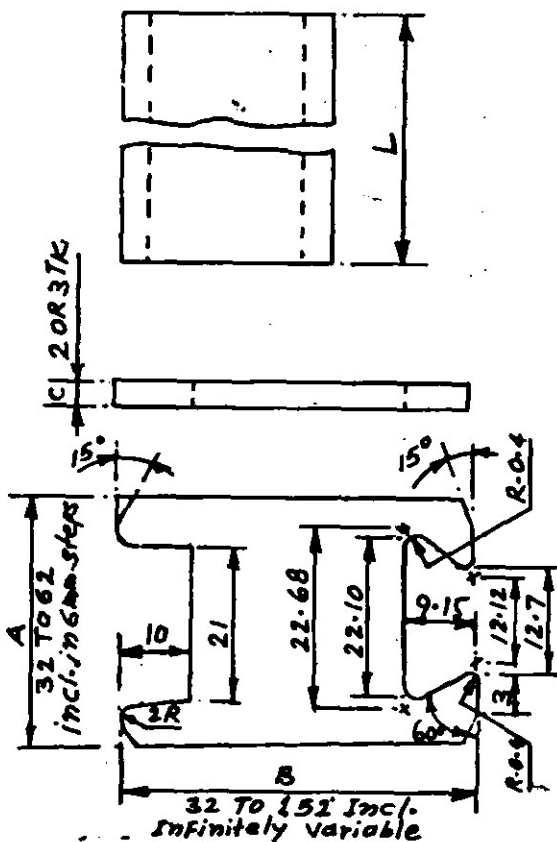

BLOCKS (AA211081:-

Blocks to be blanked out from precompressed pressboard strip, using blanking tool no. 60049. Width of strip to be checked before blanking.

When calling for blocks on Electrical specification or insulation drawing. Specify this drawing & give A, B & C dimensions.

DOVETAIL STRIPS (PRESS BOARD) TO AA21108

When calling for strips on Elec. Spec. or insulation drawing specify this drawing and give 'L' dimension & figure No. Length 'L' to include extension above top block washer for ease of winding as given here

1. For helical coil 17% 2. For R.S. Coil 14%

NOTE:—1. For details of stocked strips refer sheet no. TR 25006B

2. This sheet replaces C 600192

03	REVISED
02	IN FIG. 1 DIMS. HERE 18.17, 17.70 & 18.24
01	IN FIG. 2 DIMS. HERE 21.48, 18.56 & 12.24
01	IN FIG. 3 DIMS. HERE 18.17, 17.70 & 18.24
01	IN FIG. 3 DIMS. HERE 21.48, 18.56 & 12.24

Issued by	T.R.E. JS.
Appd.	D.O.
CHANGES TO BE APPD. BY DIVISIONAL STDS. ENGINEER ONLY.	

BHARAT HEAVY ELECTRICALS LTD.
UNIT: JHANSI



Scale

● TR 25003 B

Ref. No. JHS/SK/D10134

REVISIONS