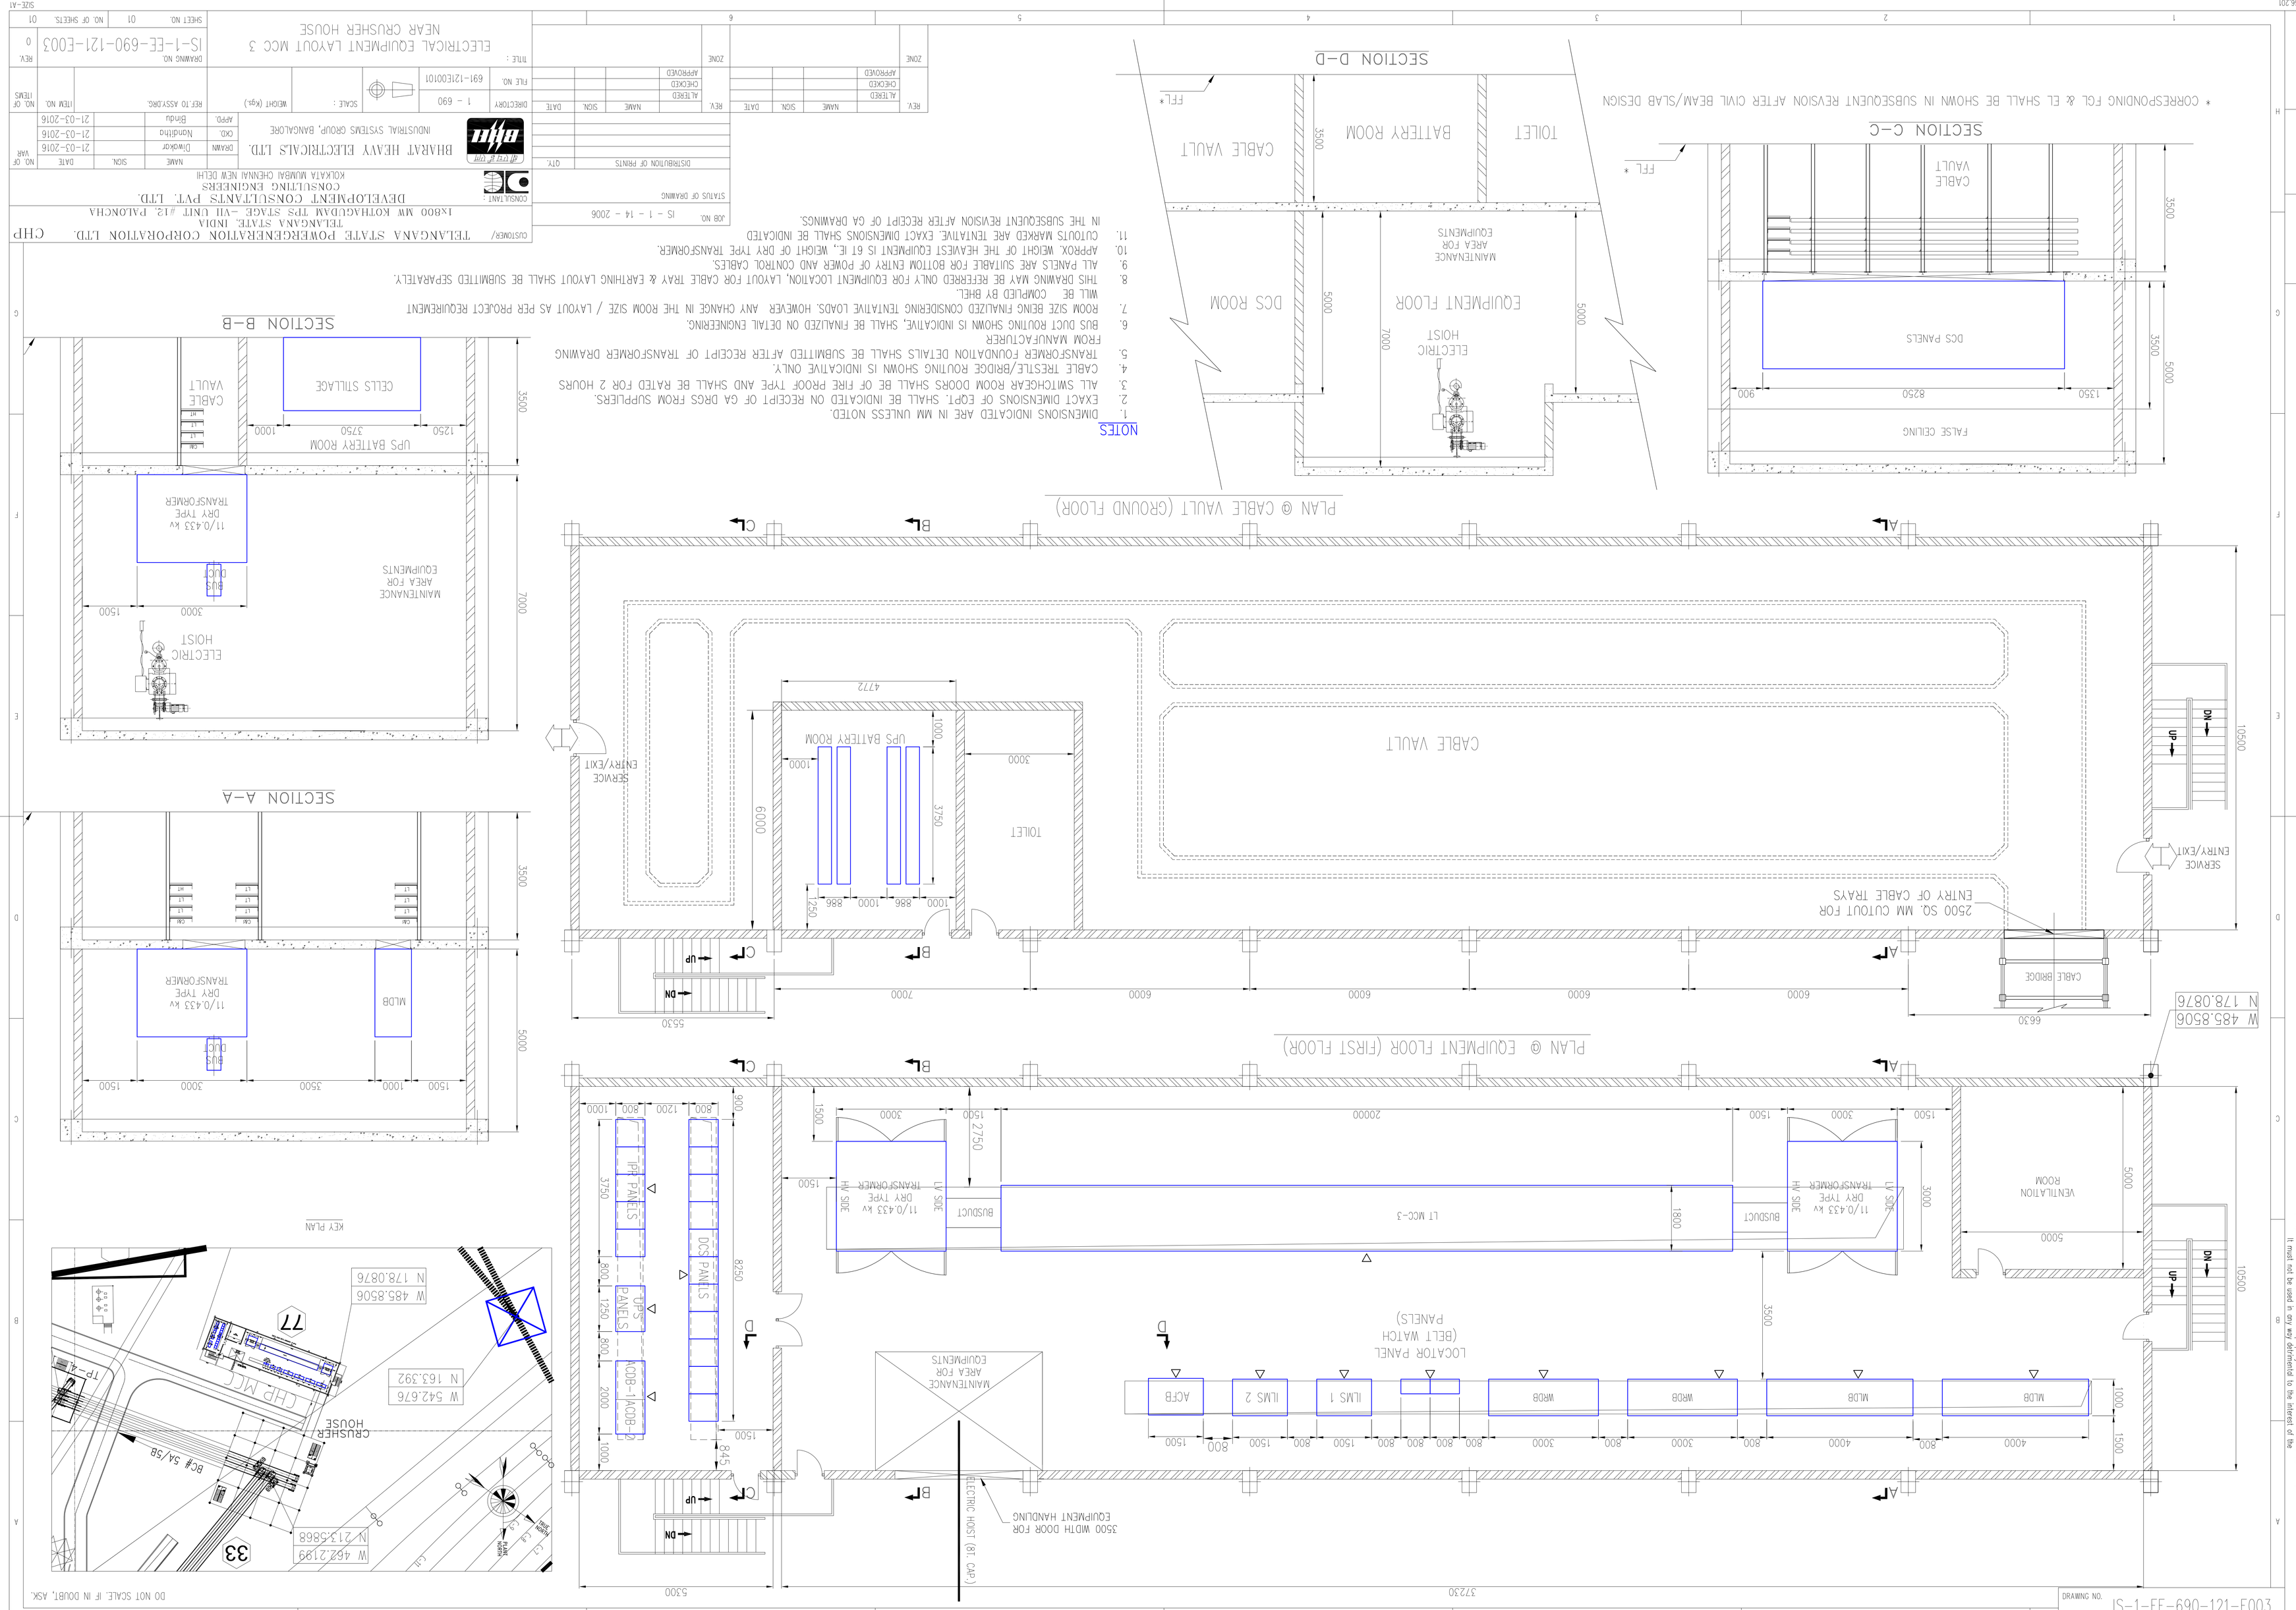

NOTES

1. DIMENSIONS INDICATED ARE IN MM UNLESS NOTED.
2. EXACT DIMENSIONS OF EQPT. SHALL BE INDICATED ON RECEIPT OF GA DRGS FROM SUPPLIERS.
3. ALL SWITCHGEAR ROOM DOORS SHALL BE OF FIRE PROOF TYPE AND SHALL BE RATED FOR 2 HOURS
4. CABLE TRESTLE/BRIDGE ROUTING SHOWN IS INDICATIVE ONLY.
5. TRANSFORMER FOUNDATION DETAILS SHALL BE SUBMITTED AFTER RECEIPT OF TRANSFORMER DRAWING FROM MANUFACTURER
6. BUS DUCT ROUTING SHOWN IS INDICATIVE, SHALL BE FINALIZED ON DETAIL ENGINEERING.
7. ROOM SIZE BEING FINALIZED CONSIDERING TENTATIVE LOADS. HOWEVER ANY CHANGE IN THE ROOM SIZE / LAYOUT AS PER PRODUCT REQUIREMENT WILL BE COMPLIED BY BHEL.
8. THIS DRAWING MAY BE REFERRED ONLY FOR EQUIPMENT LOCATION, LAYOUT FOR CABLE TRAY & EARTHING LAYOUT SHALL BE SUBMITTED SEPARATELY.
9. ALL PANELS ARE SUITABLE FOR BOTTOM ENTRY OF POWER AND CONTROL CABLES.
10. APPROX. WEIGHT OF THE HEAVIEST EQUIPMENT IS 6T IE., WEIGHT OF DRY TYPE TRANSFORMER.
11. CUTOUTS MARKED ARE TENTATIVE. EXACT DIMENSIONS SHALL BE INDICATED IN THE SUBSEQUENT REVISION AFTER RECEIPT OF GA DRAWINGS.

| | | |