


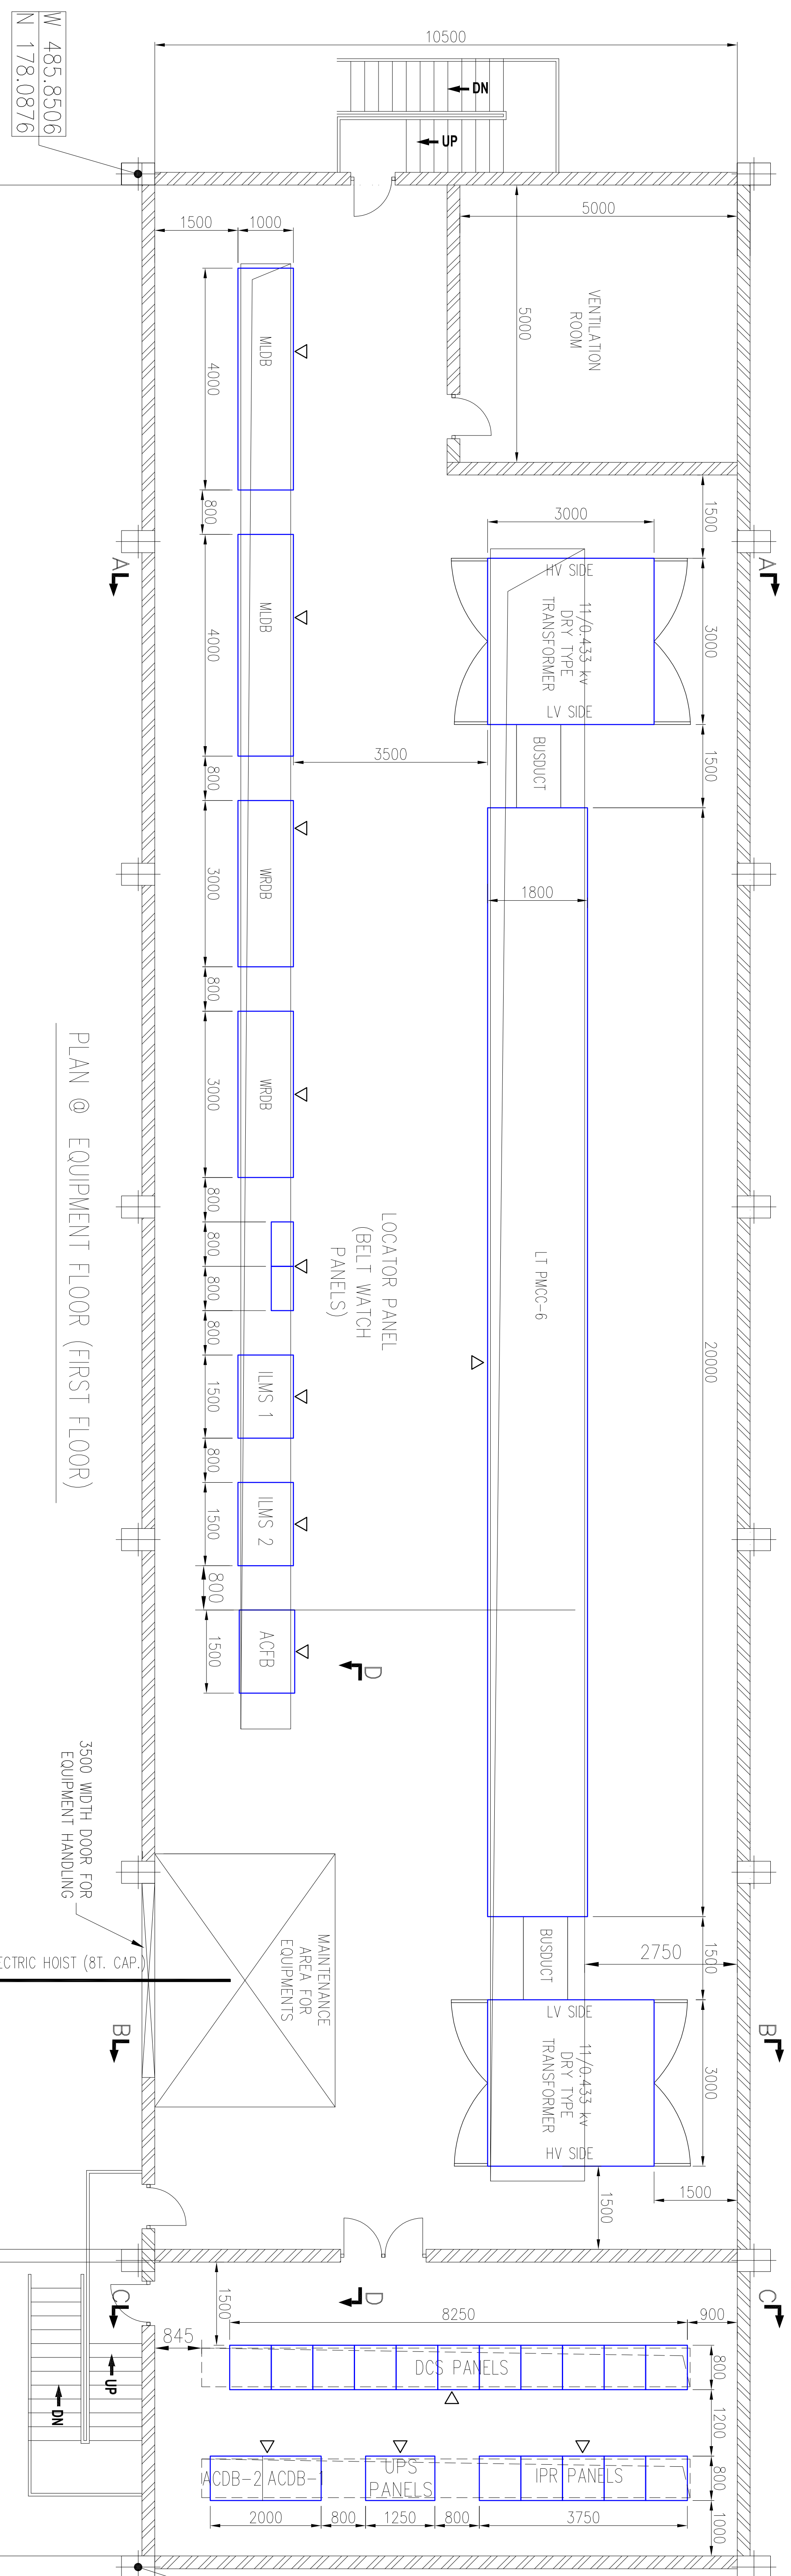


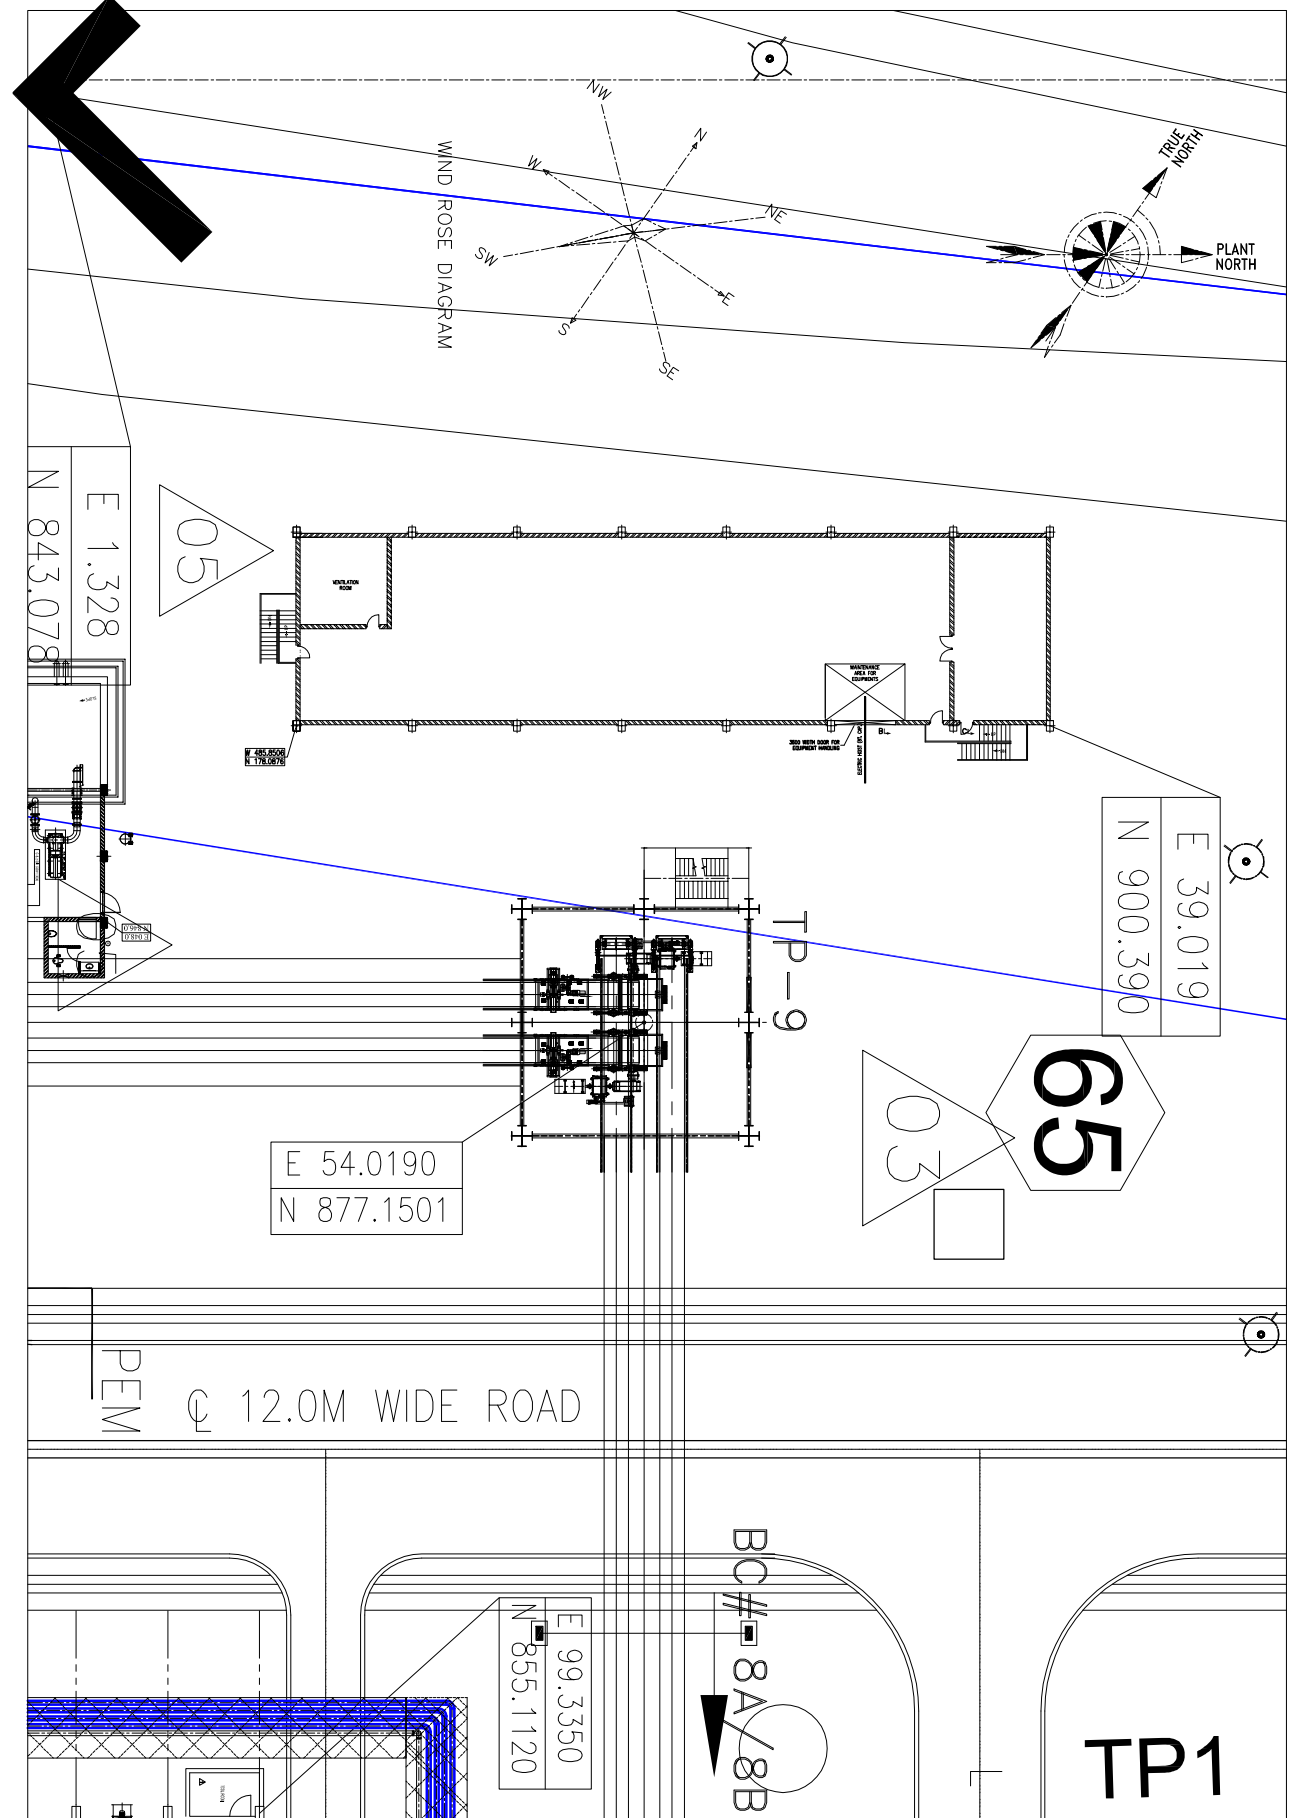


PLAN @ EQUIPMENT FLOOR (FIRST FLOOR)

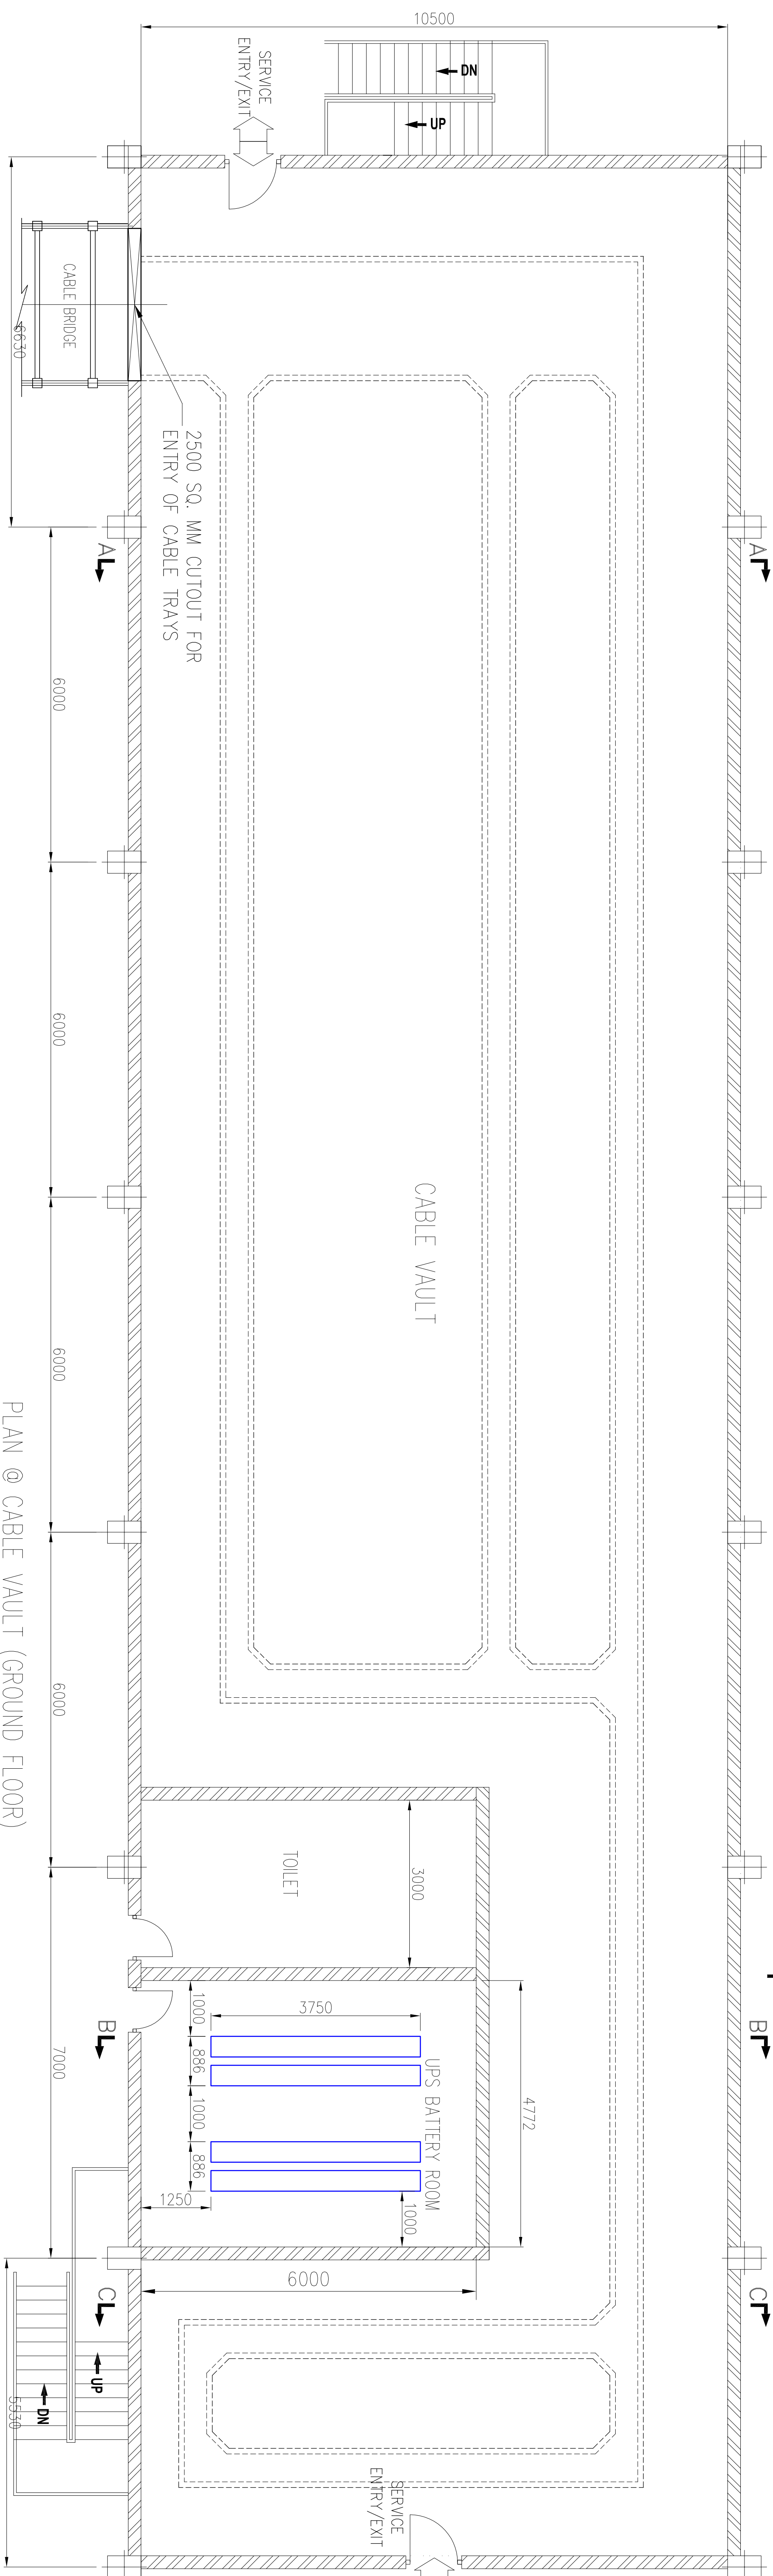


PLAN @ CABLE VAULT (GROUND FLOOR)

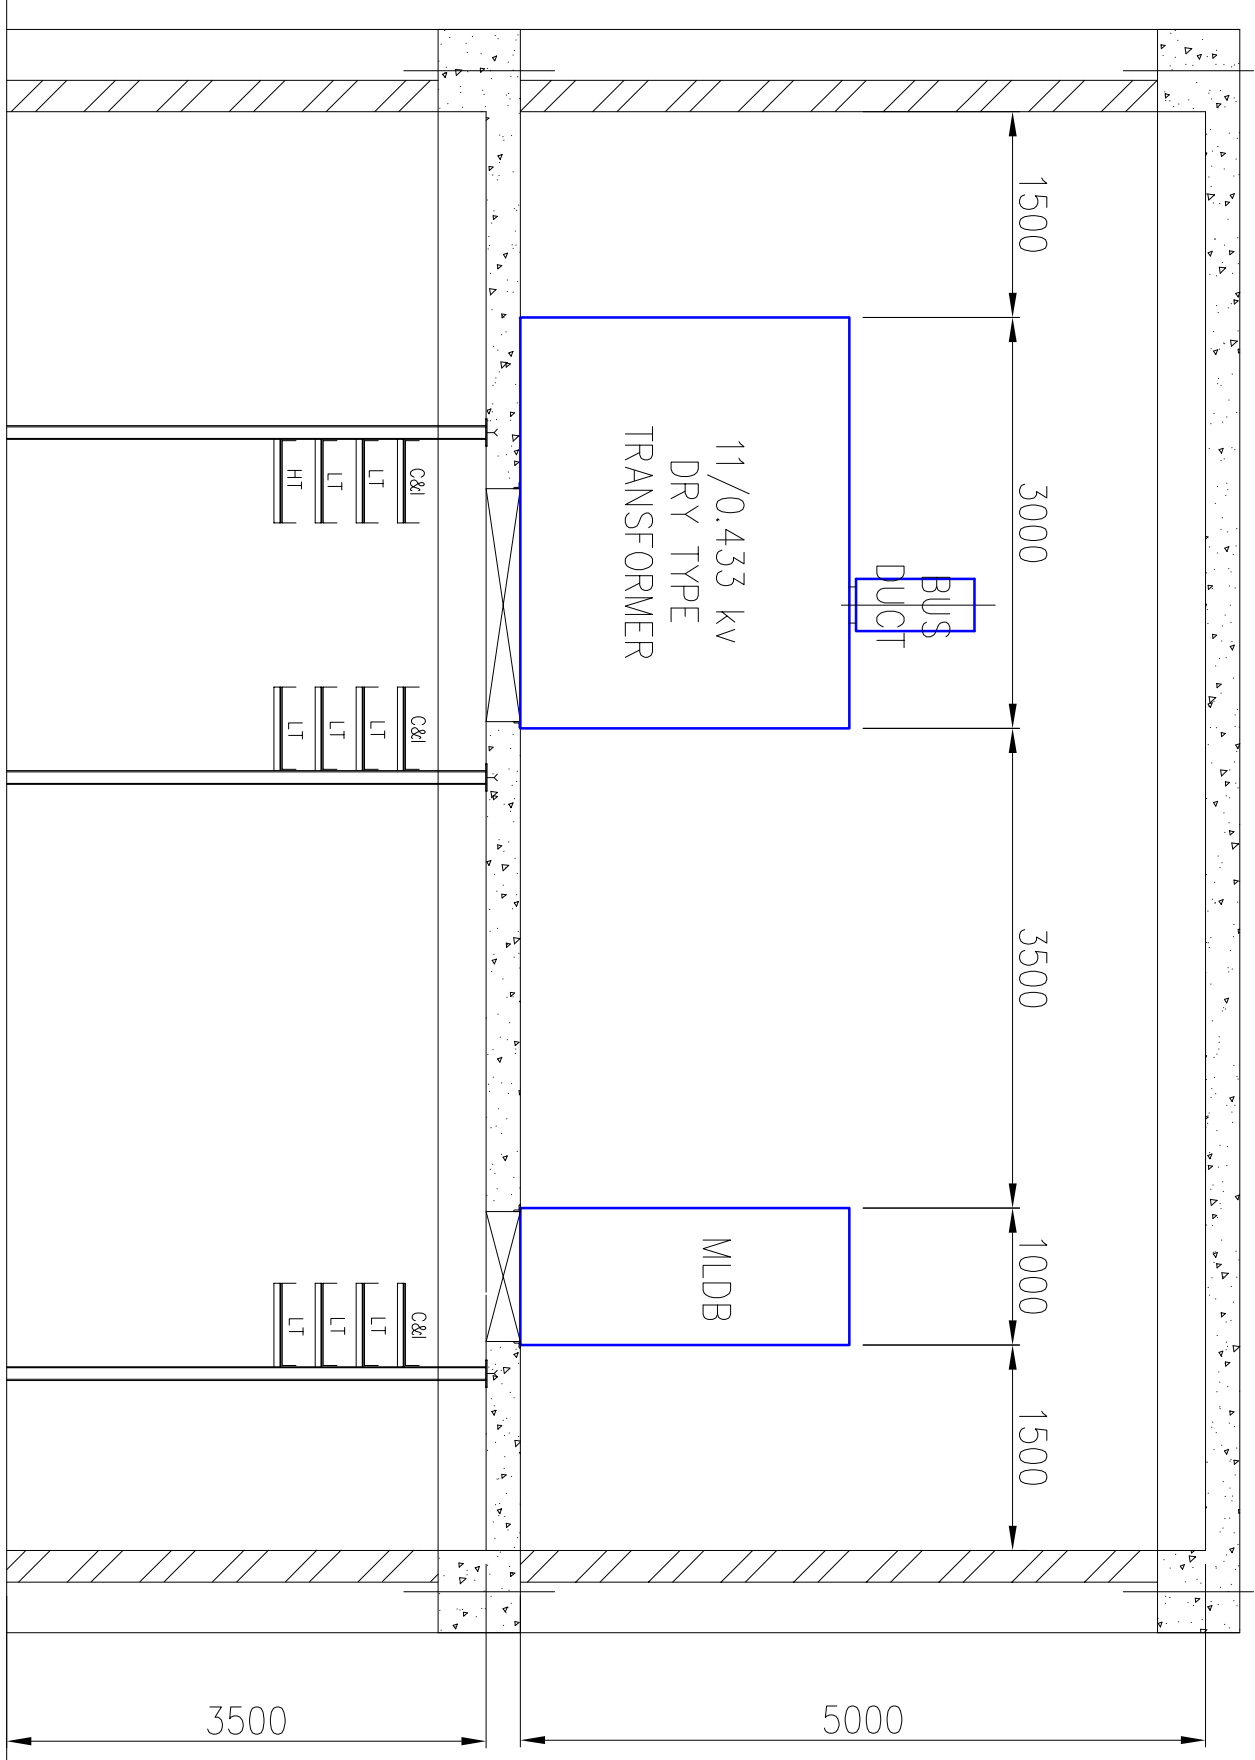

SECTION A-A

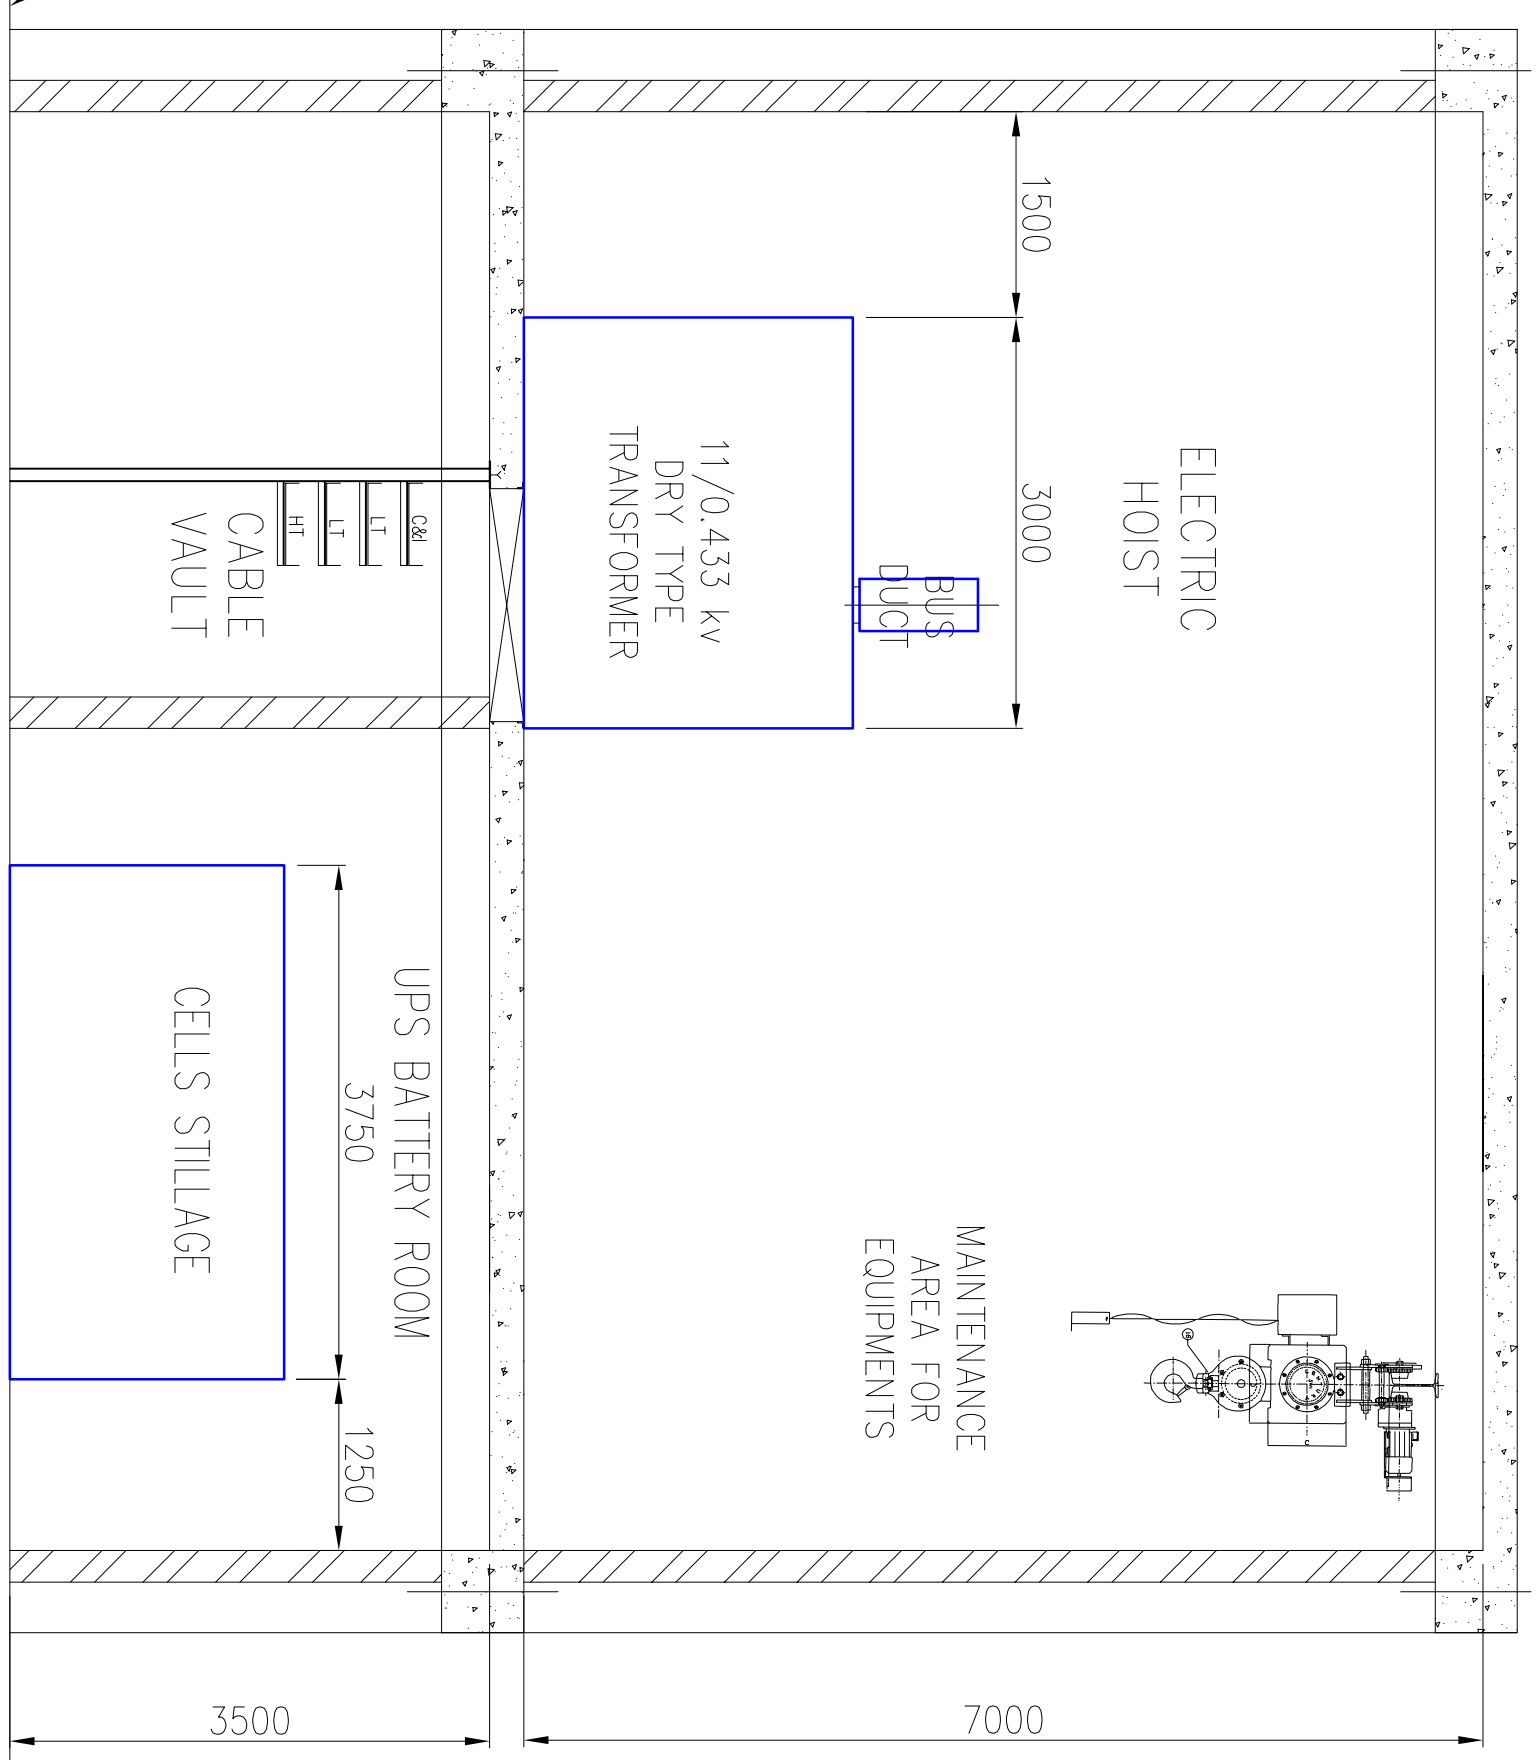

SECTION B-B

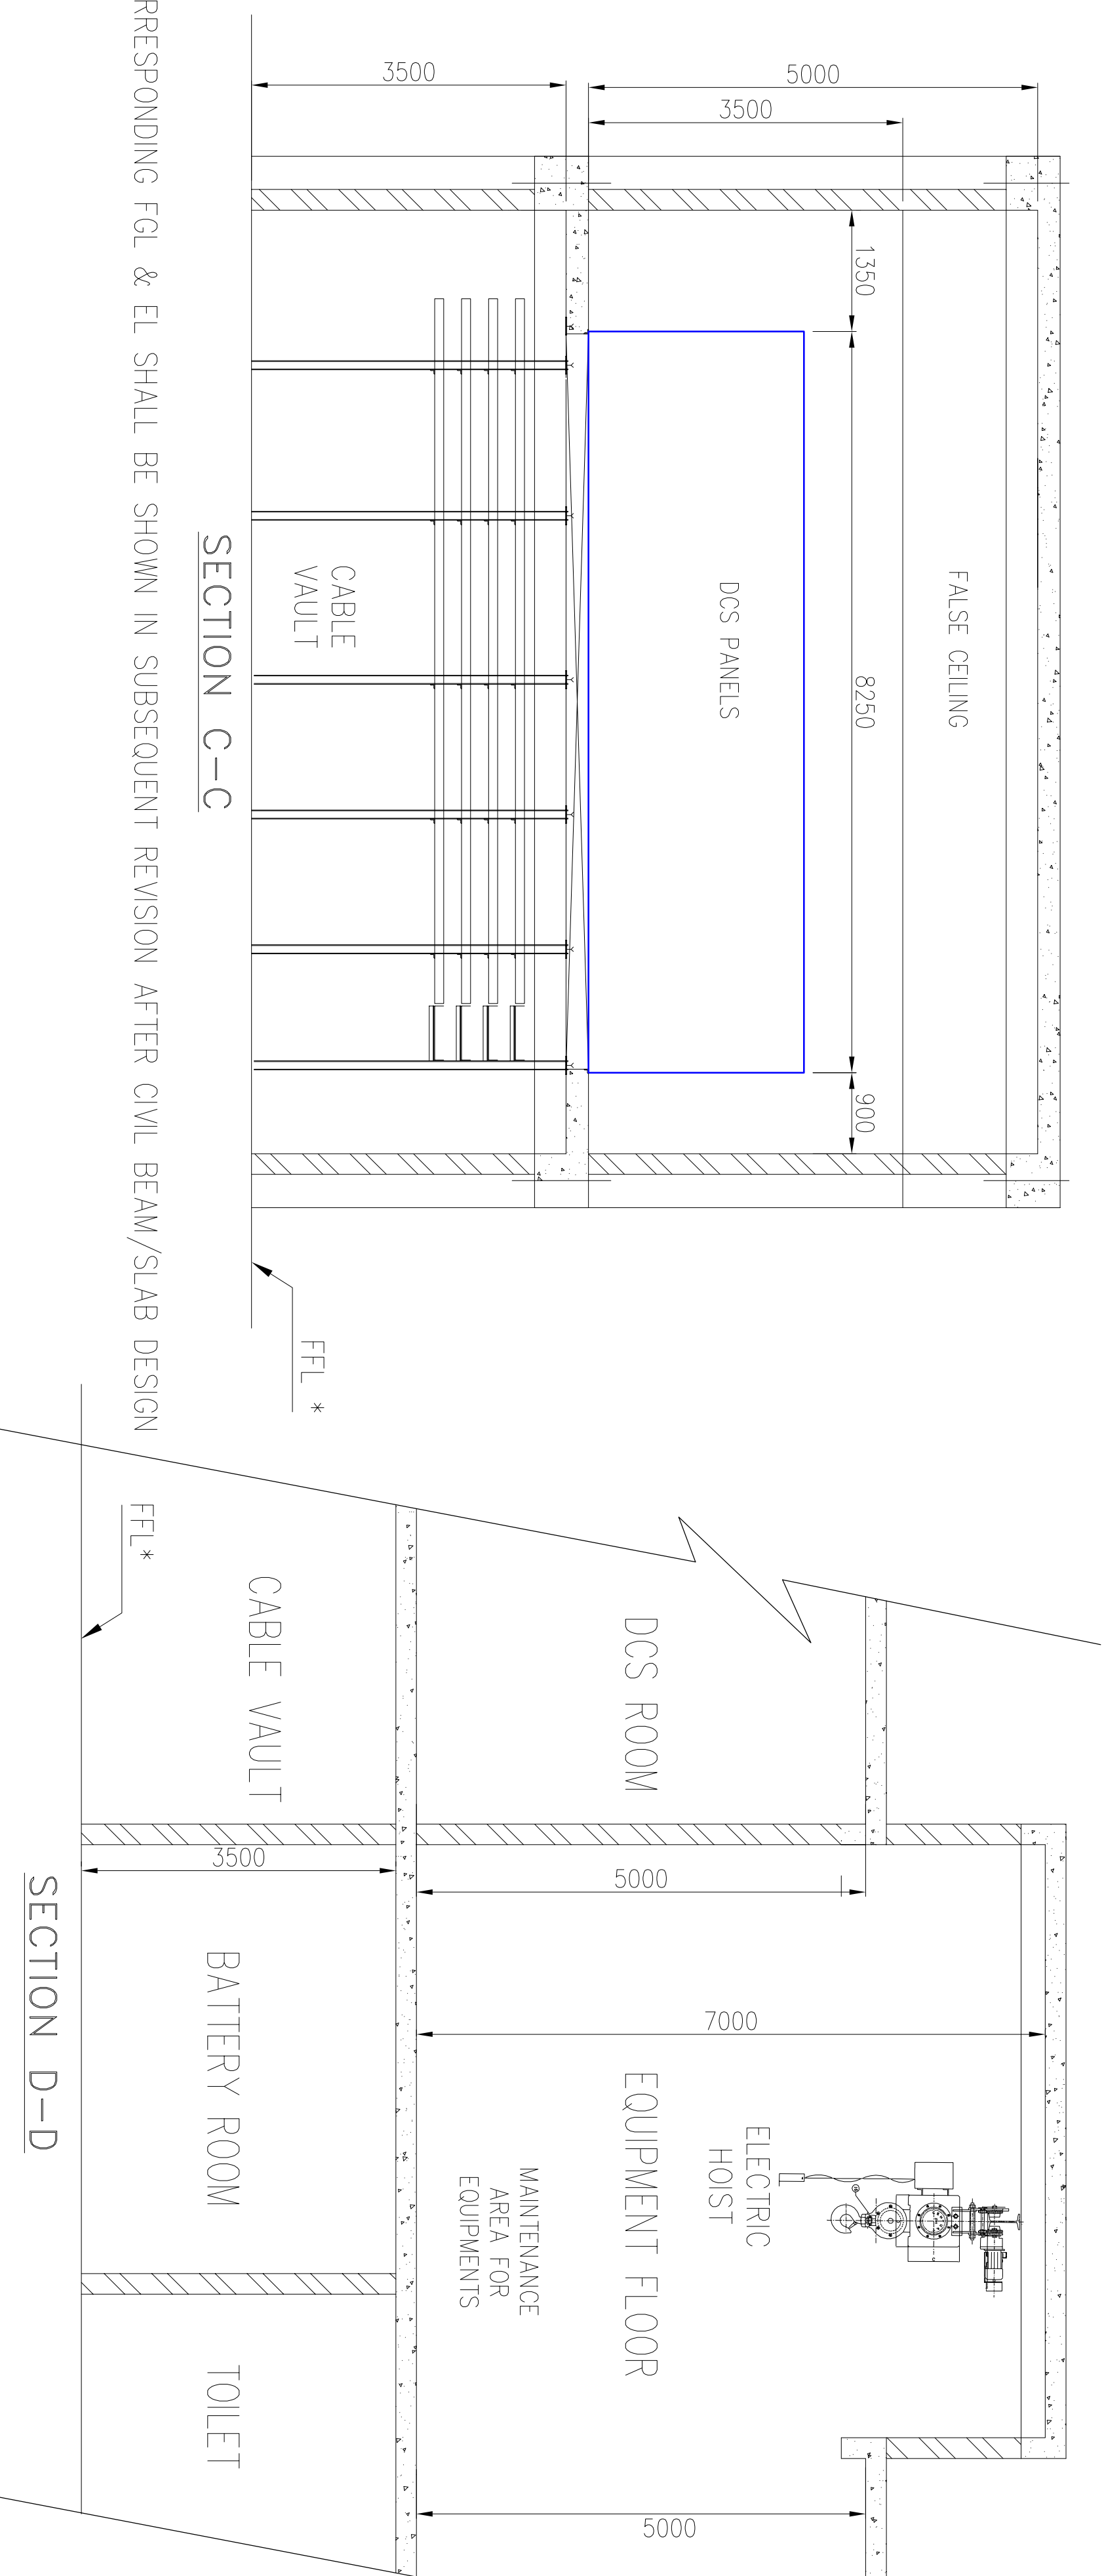

SECTION C-C

SECTION D-D

- NOTES**

 1. DIMENSIONS INDICATED ARE IN MM UNLESS NOTED
 2. EXACT DIMENSIONS OF COPI, SHALL BE INDICATED ON RECEIPT OF GA DRESS FROM SUPPLIERS.
 3. ALL SWITCHGEAR ROOM DOORS SHALL BE OF FIRE PROOF TYPE AND SHALL BE RATED FOR 2 HOURS
 4. CABLE TESTLE/BRIDGE ROUTING SHOWN IS INDICATIVE ONLY.
 5. TRANSFORMER FOUNDATION DETAILS SHALL BE SUBMITTED AFTER RECEIPT OF TRANSFORMER DRAWING FROM MANUFACTURER
 6. BUS DUCT ROUTING SHOWN IS INDICATIVE, SHALL BE FINALIZED ON DETAIL ENGINEERING.
 7. ROOM SIZE BEING FINALIZED CONSIDERING TENTATIVE LOADS. HOWEVER, ANY CHANGE IN THE ROOM SIZE / LAYOUT AS PER PROJECT REQUIREMENT WILL BE COMPLIED BY BHEL.
 8. THIS DRAWING MAY BE REFERRED ONLY FOR EQUIPMENT LOCATION, LAYOUT FOR CABLE TRAY & EARTHING LAYOUT SHALL BE SUBMITTED SEPARATELY.
 9. ALL PANELS ARE SUITABLE FOR BOTTOM ENTRY OF POWER AND CONTROL CABLES.
 10. APPROX. WEIGHT OF THE HEAVIEST EQUIPMENT IS 6T I.E., WEIGHT OF DRY TYPE TRANSFORMER.
 11. COLUMNS MARKED ARE TENTATIVE. EXACT DIMENSIONS SHALL BE INDICATED
 12. IN THE SUBSEQUENT REVISION AFTER RECEIPT OF GA DRAWINGS.

REV.	NAME	SON.	DATE	REV.	NAME	SON.	DATE
ALTERED				ALTERED			
CHECKED				CHECKED			
APPROVED				APPROVED			
ZONE				ZONE			

[illegible]