


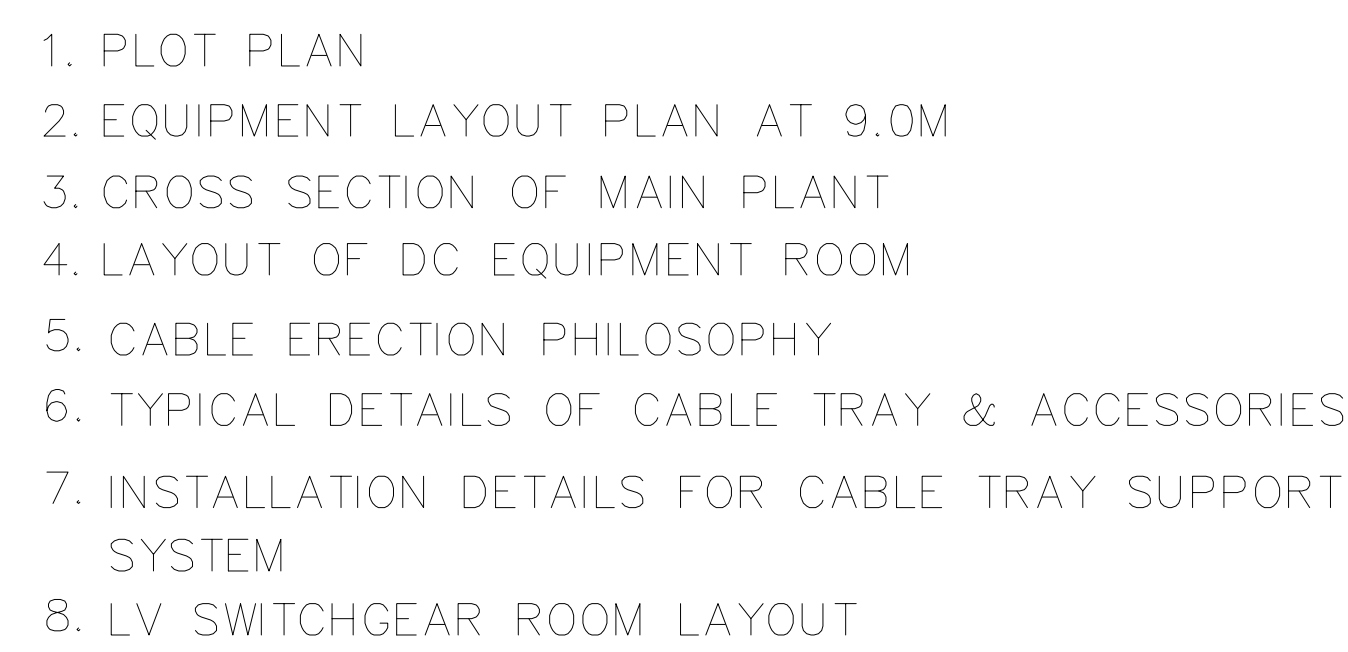

CHANGE IN ELEVATION OF TRAY

PE-DG-427-100-E003

PEM/ ELECTROLYTE

8. LOCAL CONNECTING TRAY OF 100/150MM WIDE (PERFORATED TYPE) SHALL BE PROVIDED FROM MAIN RUNS UPTO CUTOUTS FOR EJB/LP CABLING AS PER REQUIREMNT AT SITE.

SIZE-A1